

FRIDAYS

160 SOUTH VIEW DRIVE
BRIDGEPORT, WV 26330

PROTOTYPE
P11.1
BRIDGEPORT, WV

PROTO UPDATE NUMBER:
F11.1D

THE INFORMATION IN THESE CONSTRUCTION DOCUMENTS IS CONFIDENTIAL AND SHALL REMAIN PROPRIETARY INFORMATION OF FRIDAYS AND SHALL NOT BE DISSEMINATED TO THE PUBLIC OR FILED IN ANY PUBLIC RECORD UNLESS REQUIRED BY LAW.

d2A
damon
drennan
architect

931 n. edgefield avenue
dallas, texas 75208
214-865-6932
architect@drennans.net

FOR INFORMATION REGARDING THESE DOCUMENTS CONTACT: FRIDAYS, 4201 MARSH LANE, CARROLLTON, TX 75007 (972) 662-5400.

DRAWN BY:

CHECKED BY:

DATE: 07.22.15

ISSUES:

30% ISSUE	05.20.15
BID/PERMIT	07.22.15

PROJECT NO.: 14043

SHEET TITLE:

ROOF FRAMING PLAN


SHEET NO.:

S-102

Ronald R. Roberts
Associates, Inc.
Consulting Engineers TX PRM REG. #511


2948 N. Stemmons Freeway
Dallas, Texas 75247-6103
Phone: (214) 637-6899 Fax: (214) 637-6997
www.rara.net

PROFESSIONAL ENGINEER
STATE OF TEXAS
11666
1966

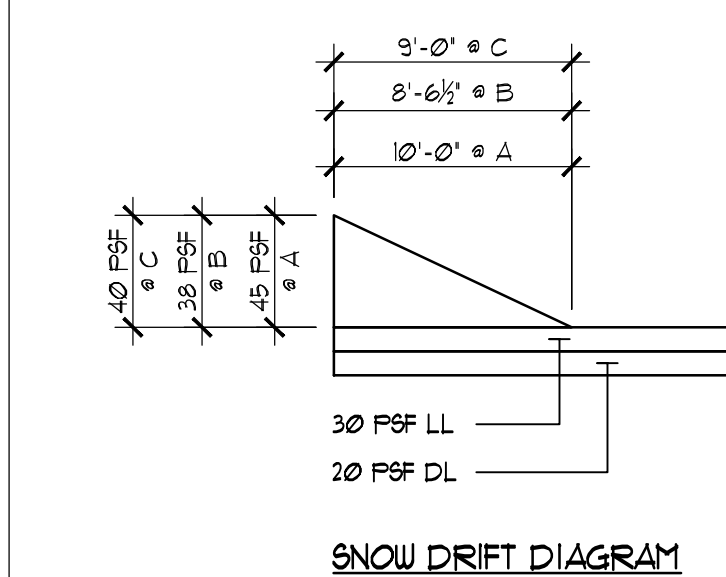

HEADER SCHEDULE	
TYPE	HEADER
(A)	3-2x8 W/ 1/2" PLYWOOD SPACERS
(B)	3-2x10 W/ 1/2" PLYWOOD SPACERS
(C)	3-2x12 W/ 1/2" PLYWOOD SPACERS
(D)	5 1/2"x6 1/2" GLULAM
(E)	
(F)	3-2x10
(G)	5 1/8"x21" GLULAM

⊗ - DESIGNATES HEADER TYPE
REF ARCHITECT FOR BOTTOM OF HEADER ELEVATIONS

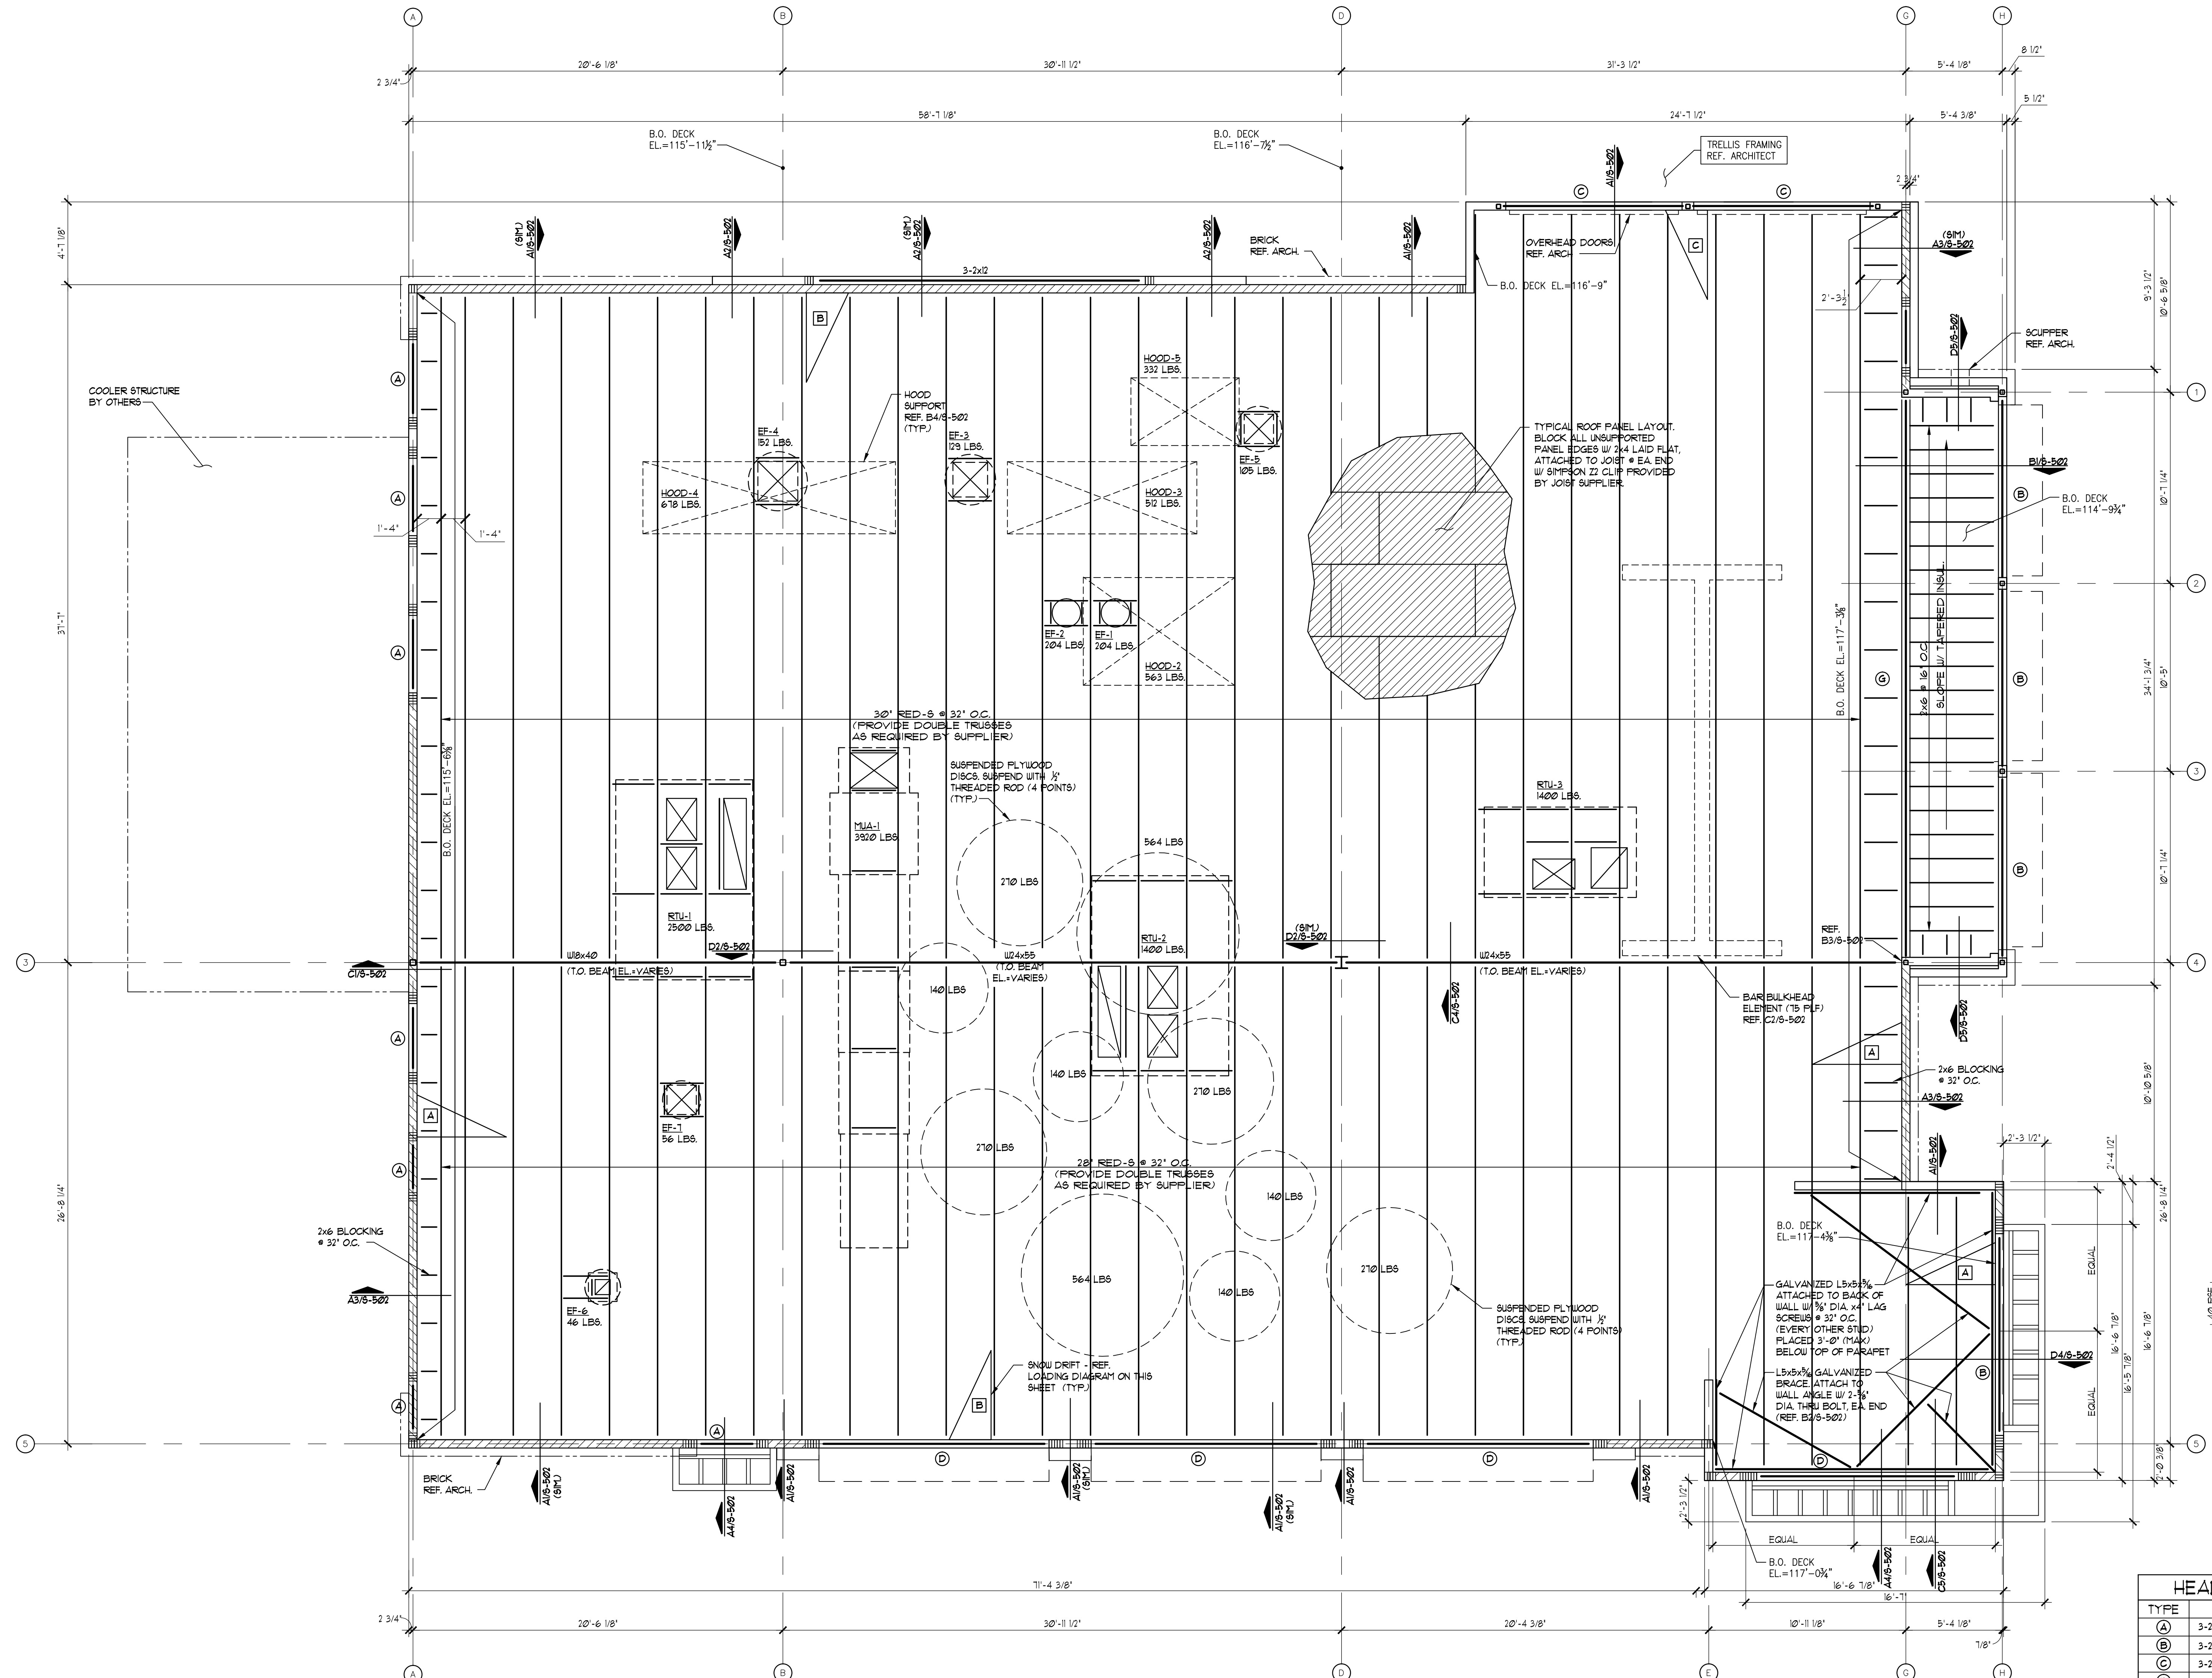

SHEARWALL SCHEDULE			
TYPE	PANEL EDGE NAIL SPACING	HOLDOWN	SILL ANCHOR
(1)	8d @ 6" O.C.	HDU5	5/8" @ 32" O.C.
(2)	8d @ 3" O.C.	HDU4	5/8" @ 16" O.C.
(3)	8d @ 6" O.C.	HDU5	5/8" @ 32" O.C.
(4)	8d @ 3" O.C.	HDU4	5/8" @ 16" O.C.

⊗ - DESIGNATES SHEARWALL TYPE

- NOTES:
- USE 8d COMMON NAILS.
 - NAIL PANEL FACES @ 12" O.C.
 - USE STRUCTURAL 1/2" PLYWOOD OR OSB.
 - COMMON HOLDOWNS AT INTERSECTING SHEARWALL CORNERS SHALL BE THE LARGEST OF THE TWO DESIGNATIONS.
 - BLOCKING IS REQUIRED AT EDGES OF SHEARWALL PANELS ONLY. COORDINATE FIRE STOP BLOCKING WITH ARCH.
 - REFERENCE C18-502 FOR TYPICAL HOLDOWN DETAIL.
 - FRAMING AT ADJOINING PANEL EDGES SHALL BE 3 INCHES NOMINAL OR WIDER, AND NAILS SHALL BE STAGGERED.

A1 ROOF FRAMING PLAN
SCALE: 1/4"=1'-0"

- PLAN NOTES:
- PROVIDE 2-2x8 BLOCKING BELOW ALL ROOF TOP EQUIPMENT CURBS.
 - PROVIDE 2x6 BLOCKING AROUND ALL ROOF PENETRATION OPENING (SHALL NOT REFLECT CURB BLOCKING).
 - REF. B3/5-502 FOR TYPICAL DETAIL @ 2x HEADER.

X:\PROJECTS\PROJECTS\2020\TG\Fridays Bridgeport WV\Sheet 24 July 2015 15:00:55 (12.dwg, 3102_1742015 1047.53 ANI, cadswat, DWG) TG_PFP.dwg, ARCH ET (30.00 x 42.00 inches), 1:1