



# A.D.A.A.G. & 2003 I.C.C./ANSI A117.1 INTERIOR ACCESSIBILITY COMPONENTS

THIS SPACE IS REQUIRED TO BE ACCESSIBLE AS SET FORTH IN THE AMERICANS WITH DISABILITIES ACT OF 2010. MAINTAIN COMPLIANCE WITH ALL APPLICABLE REQUIREMENTS OF THE ACT AND ITS ACCESSIBILITY GUIDELINES (A.D.A.), (A.D.A.A.G.).


- PATH OF TRAVEL**
- In accordance with 206.2.4, at least one accessible route shall connect accessible building or facility entrances with all accessible spaces and elements within the building or facility, which are otherwise connected by a circulation path unless exempted by 206.2.4.
  - The running slopes of walking surfaces that are part of an accessible route shall not be steeper than 1:20 with a cross slope that is not steeper than 1:48.
  - Changes in level shall comply with 303.
  - The clear width of walking surfaces on an accessible route shall comply with 403.5.1.
  - The clear width at turns along an accessible route shall comply with 403.5.2.
  - An accessible route with a clear width of less than 60 inches shall provide passing spaces at intervals of 200 feet in accordance with 403.5.3.

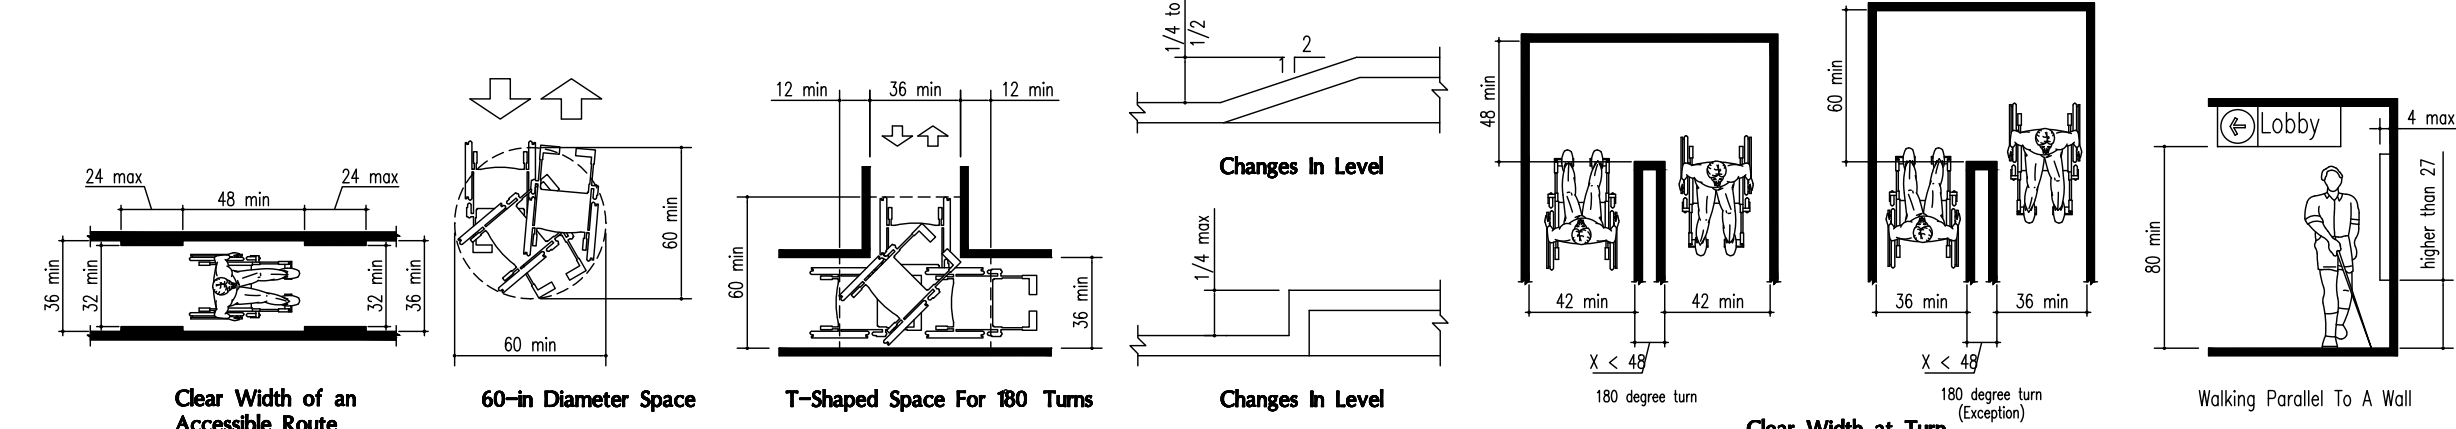


- DOORS**
- Doors, doorways, and gates that are part of an accessible route shall comply with 404.
  - Door openings shall provide a clear width of 32 inches, unless the opening is more than 24 inches deep, in which case the clear width of the opening shall be 36 inches. For swinging doors, the clear width shall be measured between the face of the door and the stop, with the door open 90 degrees.
  - There shall be no projections into the clear opening lower than 34 inches. Projections into the clear opening between 34 inches and 80 inches shall not exceed 4 inches.
  - Door closer's and stops shall be permitted to be a minimum of 78 inches above the floor or ground.
  - Maneuvering clearances at doors and gates shall comply with 404.2.4.
  - Fire doors shall have a minimum opening force allowable by the appropriate administrative authority.
  - Hinged doors other than fire doors shall have an opening force of 5 pounds maximum.
  - Sliding doors shall have an opening force of 5 pounds maximum.
  - Door and gate surfaces shall comply with 404.2.10.

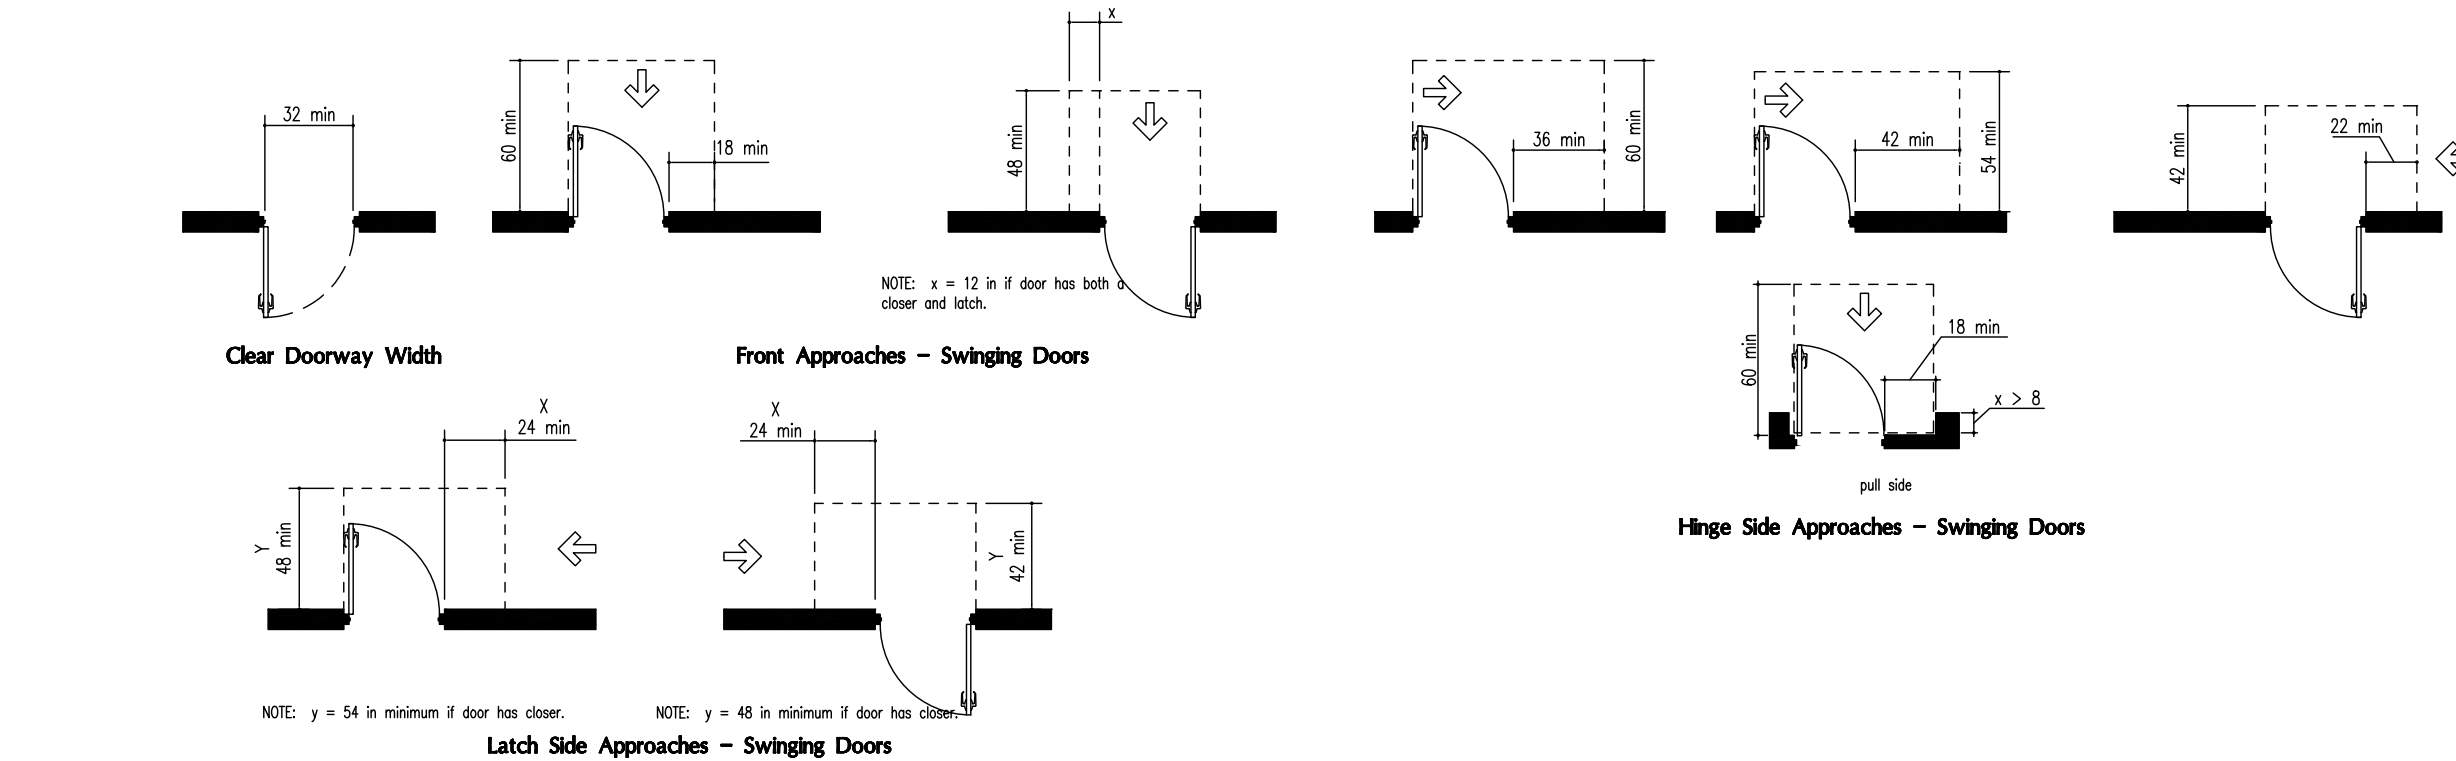



- RESTROOMS**
- Where toilet facilities are provided, they shall comply with 213. Where toilet rooms are provided, each toilet room shall comply with 603.
  - Where toilet compartments are provided, at least one toilet compartment shall comply with 604.8.1. In addition to the compartment required to comply with 604.8.1, at least one compartment shall comply with 604.8.2 where six or more toilet compartments are provided, or where the combination of urinals and water closets totals six or more fixtures.
  - Mirrors located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 40 inches maximum above finish floor or ground. Mirrors not located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 35 inches maximum above the finish floor or ground.
  - Coat hooks shall be located within one of the reach ranges specified in 308. Shelves shall be located 40 inches minimum and 48 inches maximum above the finish floor.
  - Water closets shall comply with 604.2 through 604.8.
  - Toilet paper dispensers shall comply with 305.4 and shall be 7 inches minimum and 9 inches maximum in front of the water closet measured to the centerline of the dispenser. The outlet of the dispenser shall be 15 inches minimum and 48 inches maximum above the finish floor and shall not be located behind grab bars. Dispensers shall not be of a type that controls delivery or that does not allow continuous paper flow.
  - Grab bars shall be provided at water closets and shall comply with 609.
  - Urinals shall comply with 605 and shall be either wall-hung or stall type urinals.
  - Lavatories shall comply with 606. Faucets for lavatories shall comply with 606.4. Exposed pipes under lavatories shall be insulated or otherwise protected to prevent against contact.

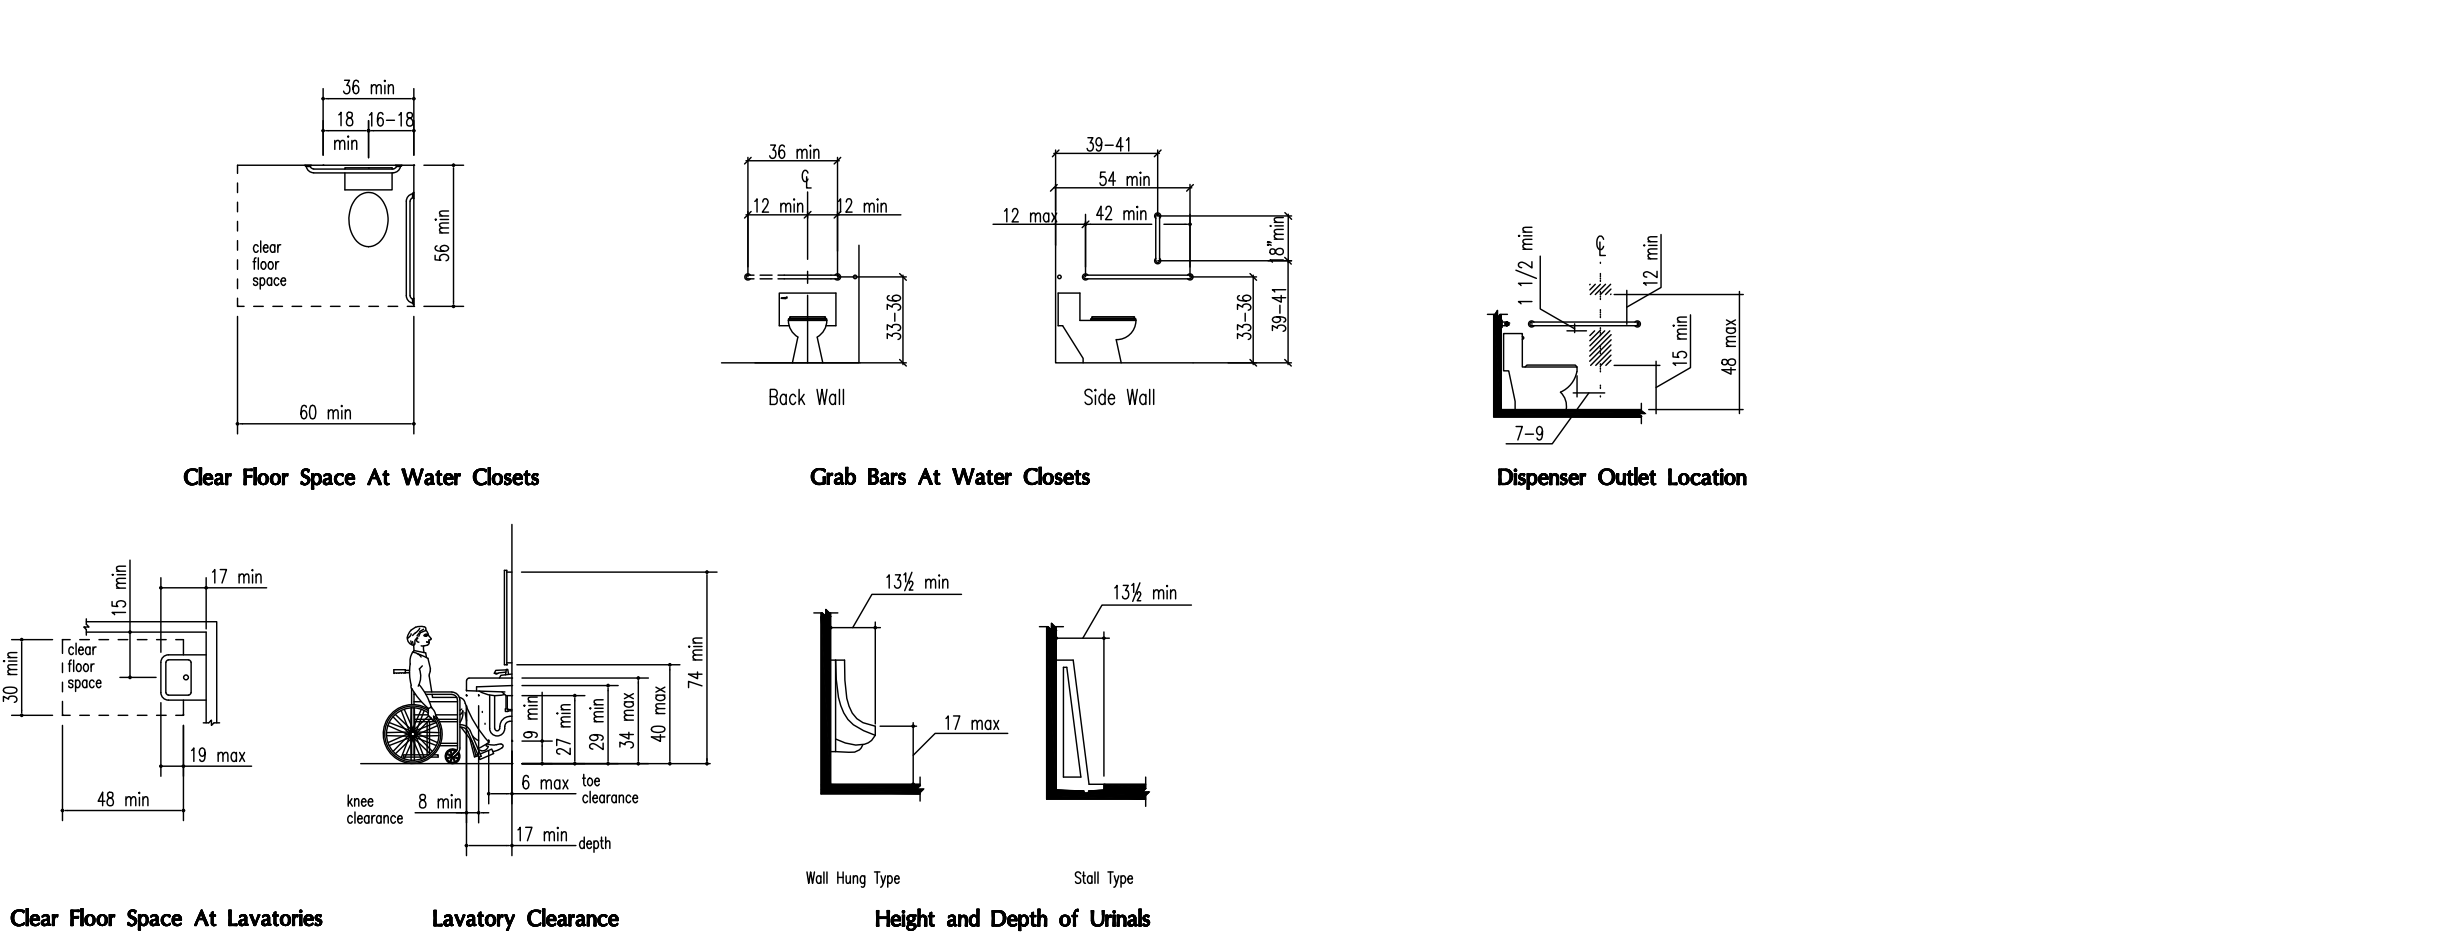

- SIGNAGE**
- Signs shall be provided in accordance with 216 and shall comply with 703.
  - Signs identifying permanent rooms and spaces shall comply with 703.1, 703.2, and 703.5. Where pictograms are provided as designations of permanent rooms and spaces, the pictograms shall comply with 703.6 and shall have text descriptors complying with 703.2 and 703.5.
  - Signs that provide direction to or information about spaces and facilities shall comply with 703.5.
  - Signs for means of egress shall comply with 216.4.
  - Where more than one check-out aisle is provided, check-out aisles complying with 904.3 shall be identified by the International Symbol of Accessibility complying with 703.7.2.1. Where check-out aisles are identified by numbers, letters, or functions, signs identifying check-out aisles complying with 904.3 shall be located in the same location as the check-out aisle identification.
  - Minimum character heights for visual signs shall be as listed in I.C.C./A.N.S.I. table 703.2.4 for text and table 703.4.3 for braille.
  - Where a sign containing tactile characters is provided at a door, the sign shall be alongside the door on the latch side. Where a tactile sign is provided at double doors, the sign shall be to the right of the right-hand door. Where there is no wall space on the latch side of a single door, or the right side of double doors, signs shall be on the nearest adjacent wall.

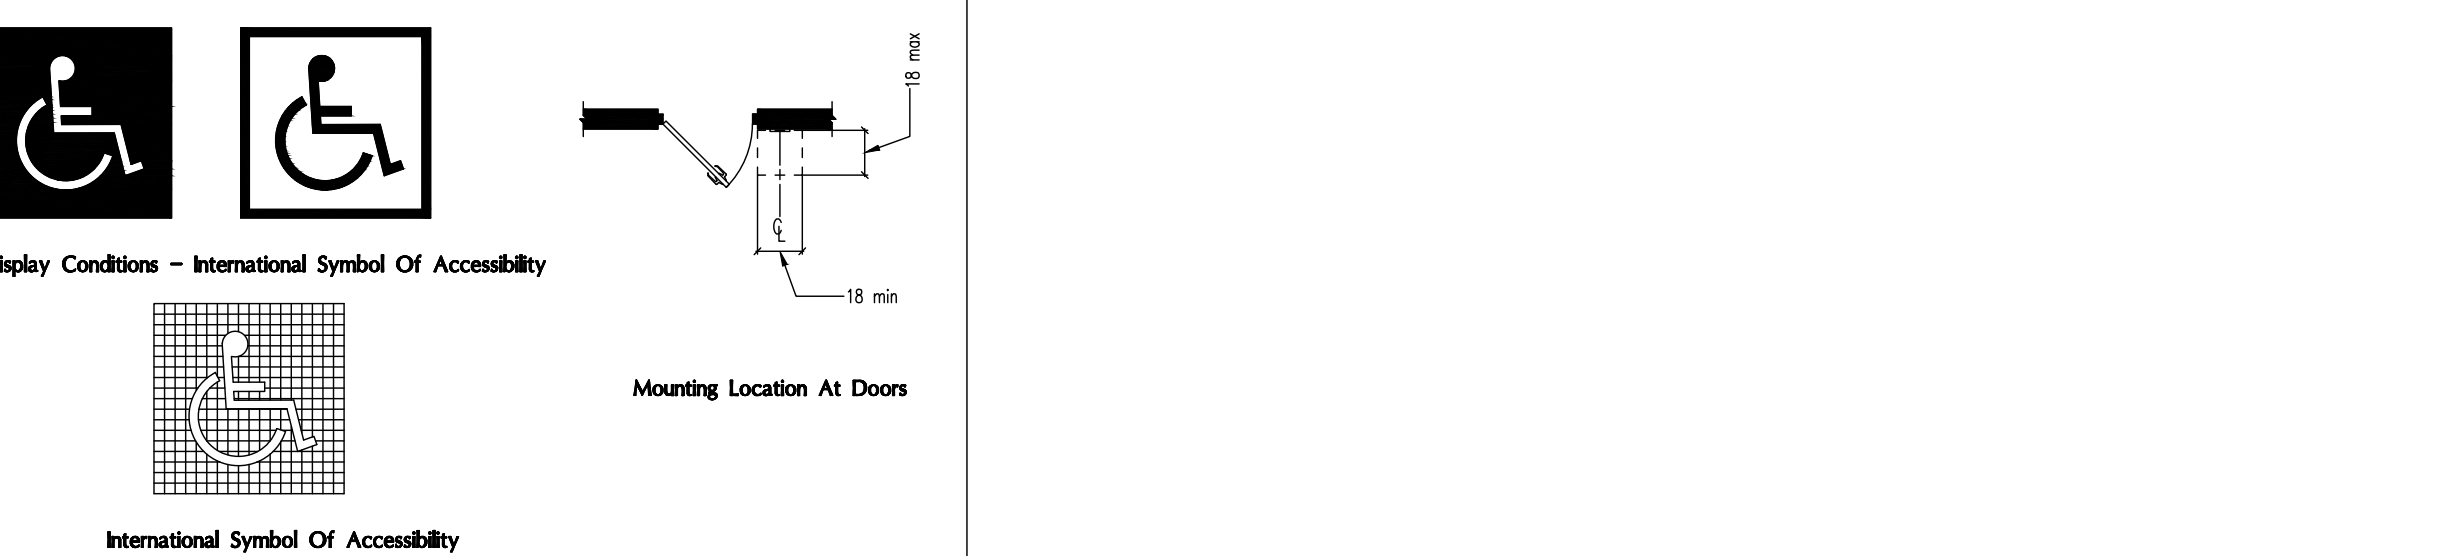

- REACH RANGES, CONTROLS & OPERATING MECHANISMS**
- Reach ranges shall comply with 308.
  - Operable parts shall comply with 309 and shall be placed within one or more of the reach ranges specified in 308.
  - Operable parts shall be operable with one hand and shall not require tight grasping, pinching, or twisting of the wrist. The force required to activate operable parts shall be 5 pounds maximum.
  - The tops of accessible portions of tray slides shall be 28" minimum and 34" maximum above the floor or ground.
  - Reach ranges as food service lines and tableware areas shall be as shown in the diagram below and shall comply with I.C.C./A.N.S.I. section 308.

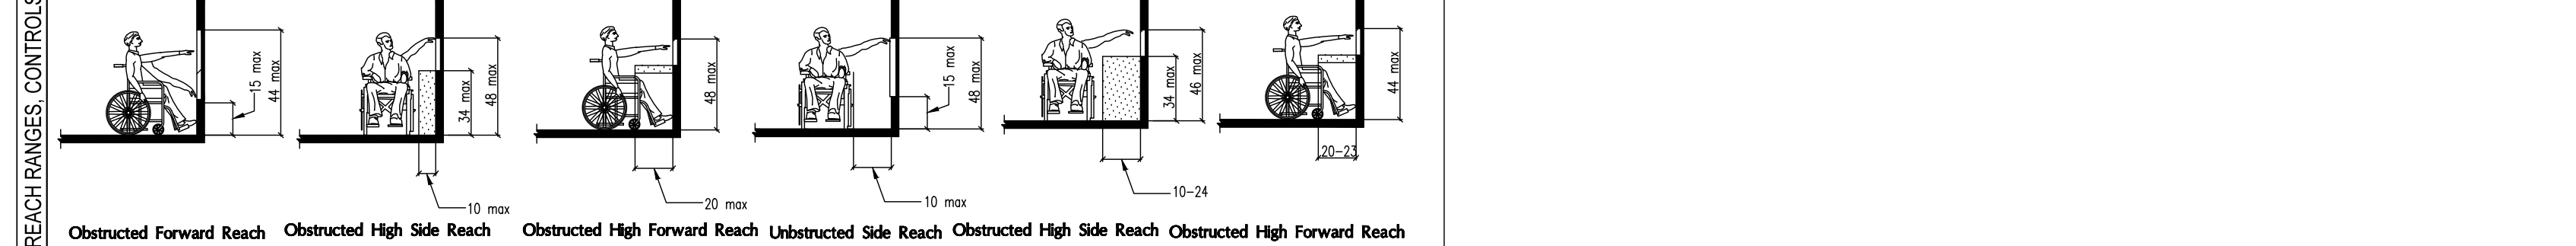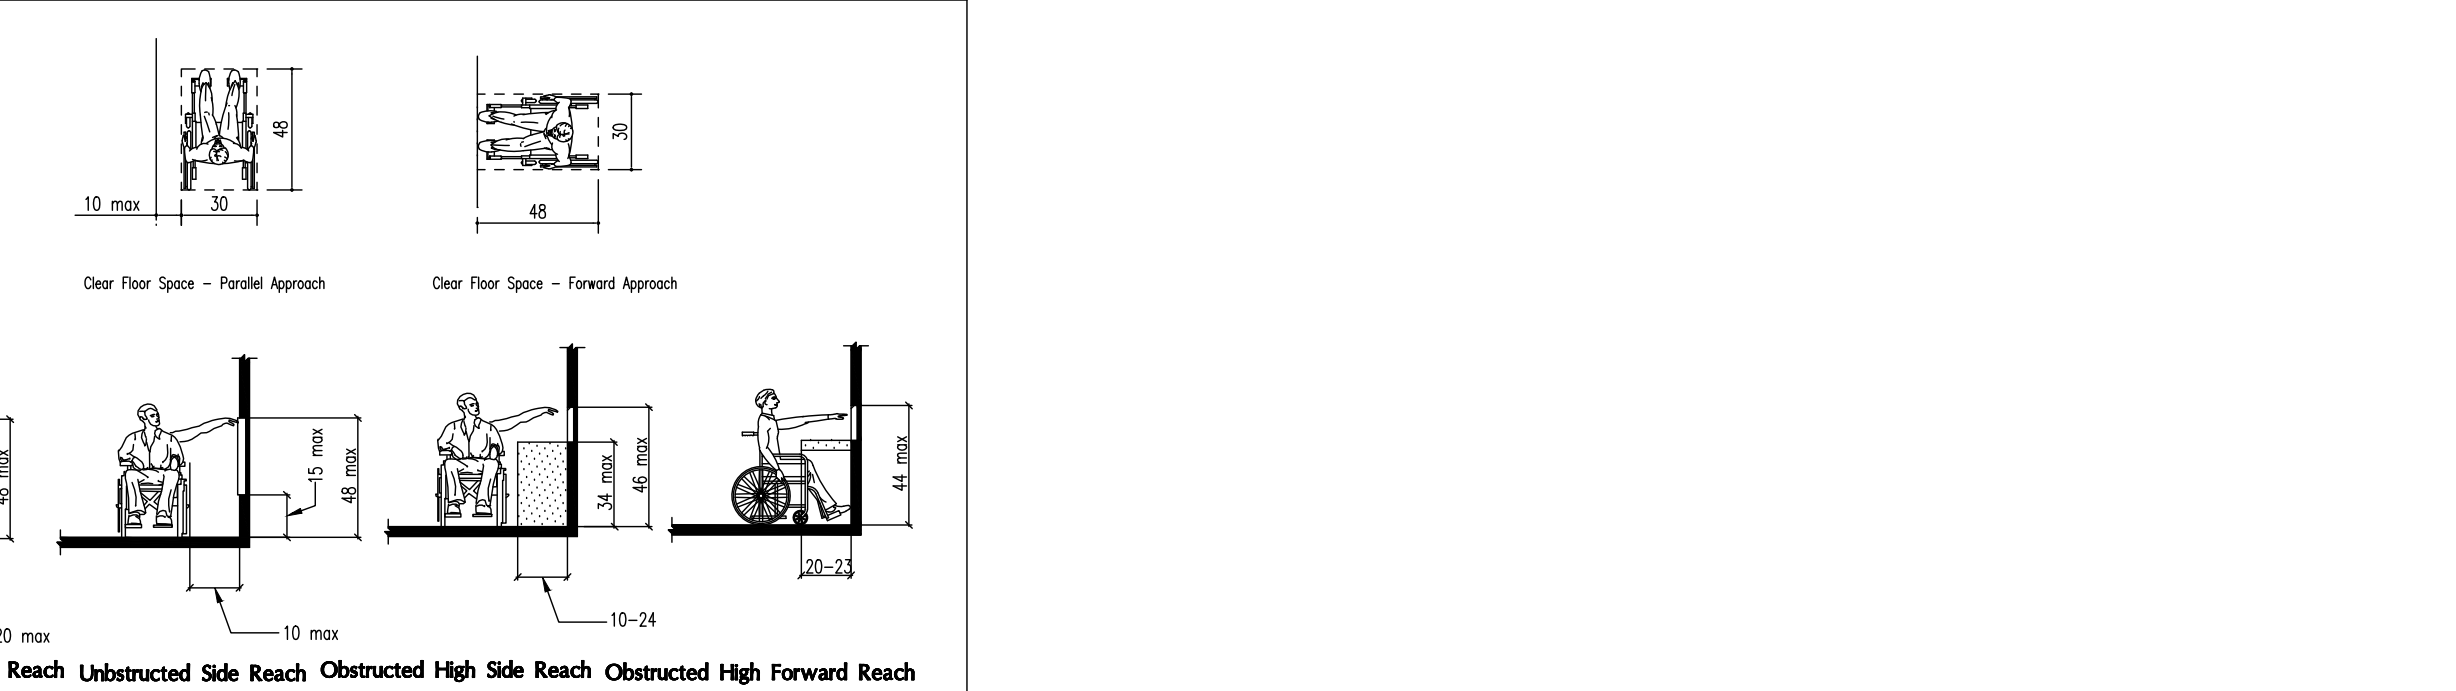

CONSULTANT:

15 Ninth Avenue North, Hopkins, MN 55343  
Phone: 952.941.8860 www.wilkusarch.com

CLIENT:

GEAUX SONIC LLC  
1012 SOUTH COOPER STREET  
GREENTOWN, IN 46901

PROJECT INFORMATION:

SONIC DRIVE-IN RESTAURANT  
2321 E. MARKLAND AVENUE  
KOKOMO, IN 46901  
STORE #6534

SEAL:

THIS DOCUMENT IS CERTIFIED BY MICHAEL J. WILKUS, ARCHITECT.

SIGNATURE  
MICHAEL J. WILKUS, ARCHITECT  
LICENSE NUMBER: AR00870040  
EXPIRATION DATE: 12-31-16

DATE  
03-18-16

PROJECT NO.: 2015-1674  
DRAWN BY: J.A.K.  
CHECKED BY: M.J.W.

ISSUE: DATE:  
PERMIT SET: 03-18-16

REVISION: DATE:

PROJECT LOCATION:  
KOKOMO, IN

SHEET NUMBER / TITLE:  
B1.01  
ACCESSIBILITY SHEET