


POPEYES INSIDE USED COOKING OIL TANK ROUGH-IN ELECTRICAL WITH INTERNET SENSOR

SIDE VIEW


FRONT VIEW

- 1.) GC TO PROVIDE & INSTALL A 2"x 4" J-BOX AT 90". GC TO RUN CAT-5e INTERNET DATA CABLE FROM TANK TO NETWORKING EQUIPMENT
- 2.) INSTALLER TO MAKE FINAL CONNECTIONS AT TANK.
- 3.) CUSTOMER'S IT DEPT TO MAKE FINAL CONNECTIONS WITH NETWORKING EQUIP.

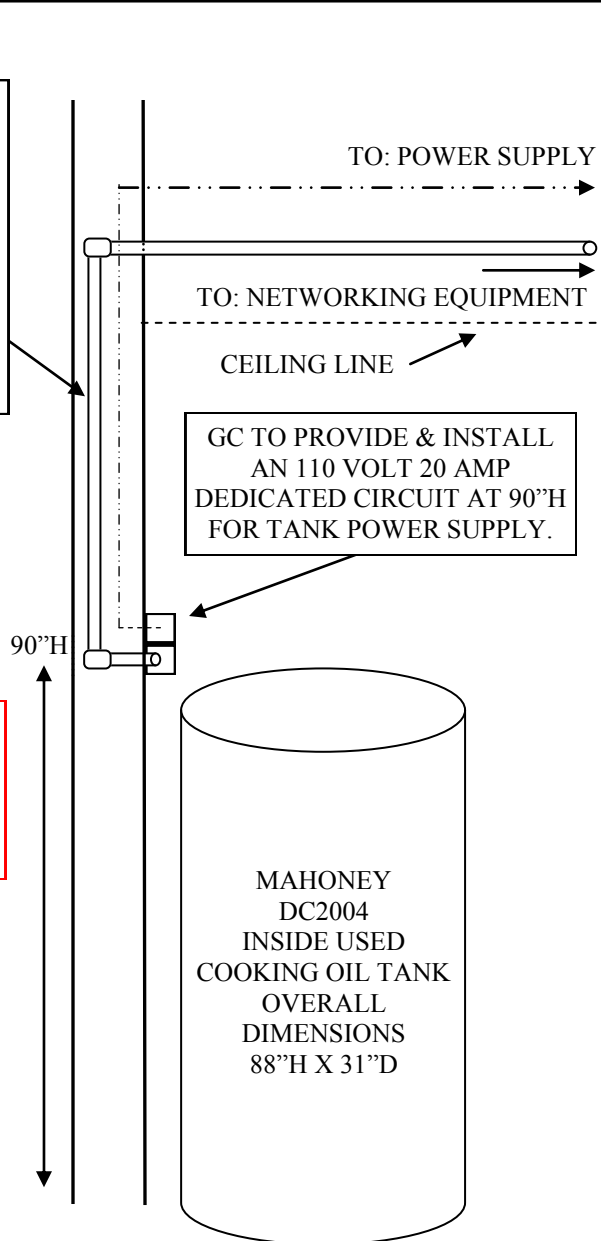

INSIDE TANK POWER SUPPLY
110 VOLT 20 AMP
DEDICATED CIRCUIT,
NON-GFCI BREAKER.
TANK TO BE PLUGGED-IN
BY INSTALLER.

POWER SUPPLY & JUNCTION
BOX SHOULD BE AT LEAST
6" FROM EITHER SIDE OF
GREASE LINE.

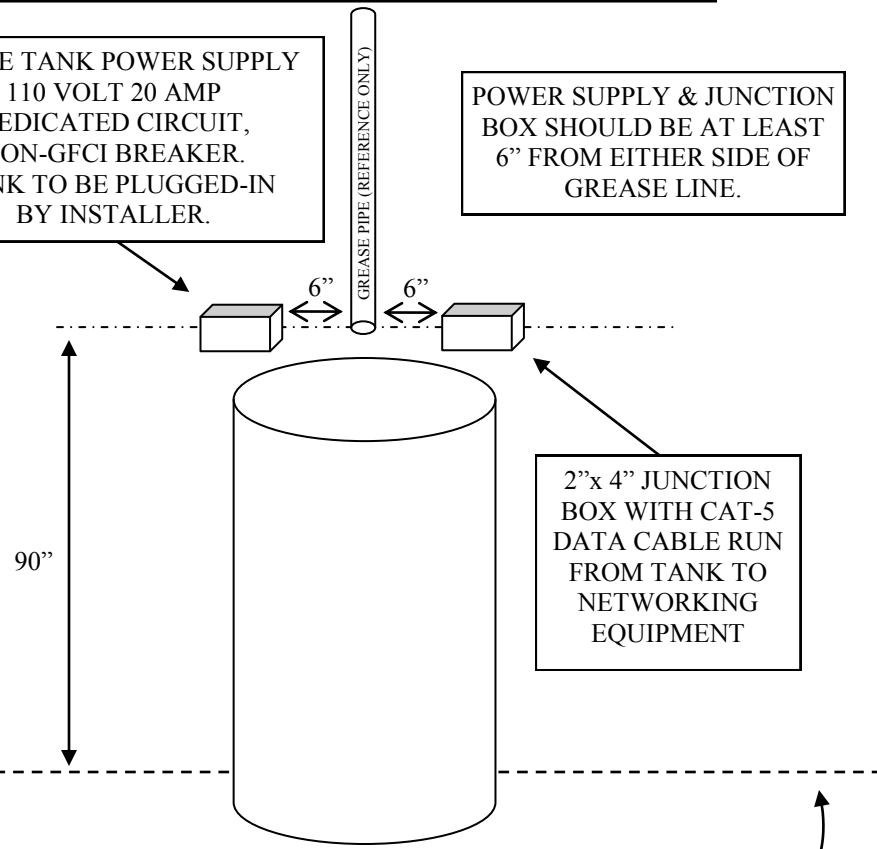

**ONCE DATA CABLE IS
PLUGGED-IN TO NETWORK,
CALL MAHONEY AT
800-892-9392 TO CONFIRM
CONNECTIVITY.**

GC TO PROVIDE & INSTALL
AN 110 VOLT 20 AMP
DEDICATED CIRCUIT AT 90" H
FOR TANK POWER SUPPLY.


**TANK INLET PIPE,
ELECTRONICS, & HEATER
ARE LOCATED ON TOP OF
TANK UNDERNEATH LID**

MAHONEY
DC2004
INSIDE USED
COOKING OIL TANK
OVERALL
DIMENSIONS
88" H X 31" D


**FINAL PLUMBING, ELECTRIC, &
HEAT TRACE TAPE
CONNECTIONS WILL BE MADE
AT THE TIME OF TANK INSTALL.**

GROUND LINE

CONFIDENTIAL—DO NOT DISTRIBUTE



1819 Moen Avenue
Joliet, IL 60436
800-892-9392 (Toll-Free)
815-741-6443 (Fax)
www.mahoneyes.com



Project Manager
Patrick Darin
815-272-2140
patrickd@mahoneyes.com

REV: 07/01/2015