

WEIGHT LBS.	MOUNTING HOLE SIZE
30	28" x 20"
40	36" x 22"
60	44" x 32"
55	50" x 24"
25	19" x 27"
28	19" x 27"
30	21" x 35"

GREENCASTLE AREA, FRANKLIN COUNTY, WATER AUTHORITY GREENCASTLE, PENNSYLVANIA

SERVICE CONNECTION

SKETCH NO. SK2


GENERAL SPECIFICATIONS

DATE AUGUST 2013

PORTION OF SHEET NO. W3

ALL MATERIALS AND CONSTRUCTION TECHNIQUES SHALL BE IN STRICT ACCORDANCE WITH ALL PENNDOT STANDARDS AND SPECIFICATIONS

- ① PREPARED SUBGRADE - 10' WIDE MINIMUM
- ② 6" PENNDOT APPROVED 2A COARSE GRADED AGGREGATE-BASE (1 - 6" LIFT) 9' MINIMUM WIDTH
- ③ 3" HOT MIX ASPHALT SUPERPAVE 9.5 MM FOR SURFACE - PG 64-22, LEVEL 2 (ONE 3" LIFT)

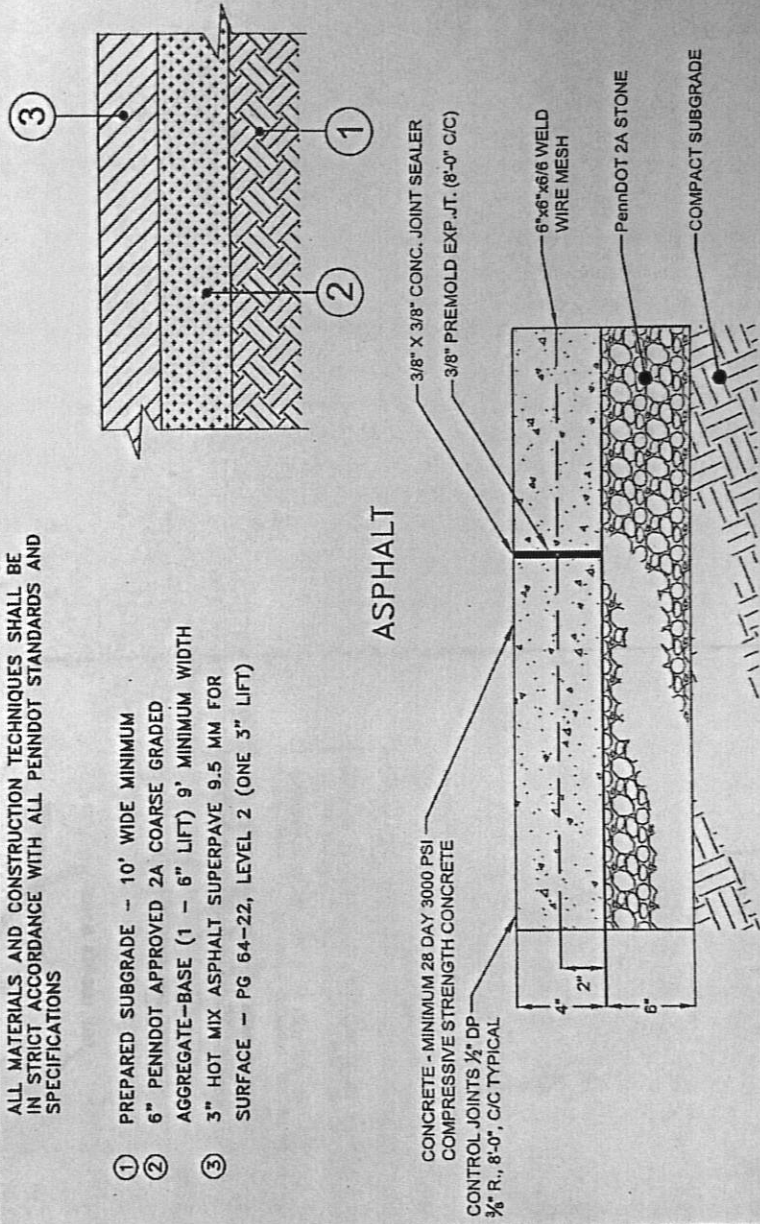

- NOTES:
- 1. CLASS P-I AIR ENTRAINED CONCRETE
  - 2. SIDEWALK TO HAVE 3/8" CONTRACTION JOINTS SCORED AT 5'-0" INTERVALS.
  - 3. CONSTRUCT 3/8" EXPANSION JOINTS SPACED EVERY 20' AND BETWEEN CURB AND SIDEWALK WHERE ADJACENT.
  - 4. SIDEWALK TO BE BRUSH FINISHED



CONCRETE  
 [EXHIBIT H]  
 SHARED USE PATH PAVEMENT SECTION  
 CHAPTER 125-17 (E)(3)d