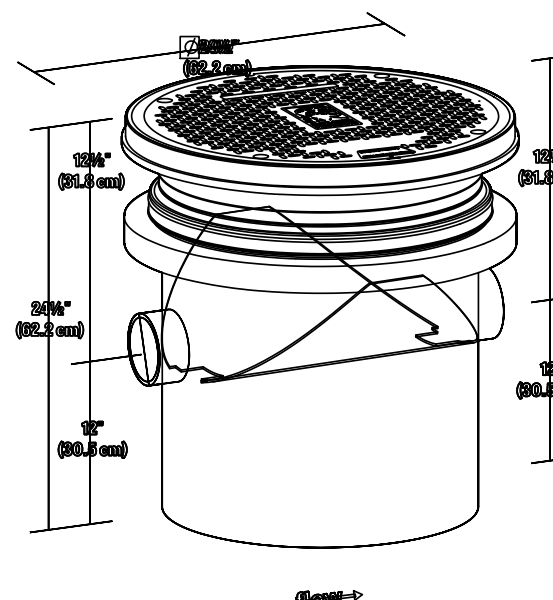
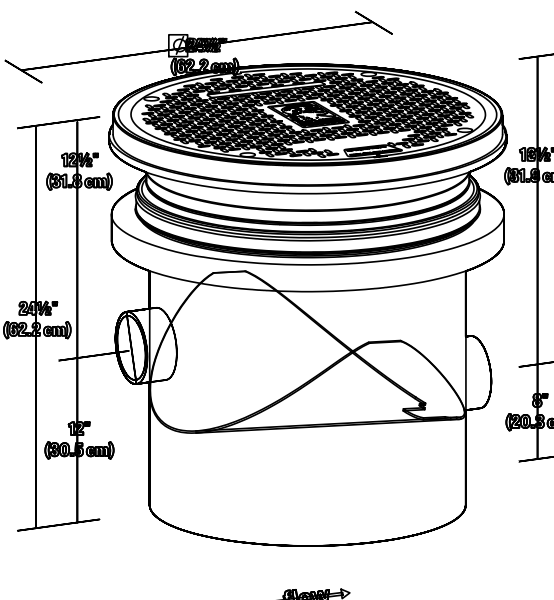


## SV24

*Sewer Viewer* Wastewater Sampling Port Technical Data  
 Submittal | Special Precautions | Specifications | Installation

**SV24-L**                      **SV24-O**

### SUBMITTAL

**STANDARD:** 4" plain end inlet/outlet | Highway traffic load rated, bolted, gas/water tight composite covers. (6,000 lbs.)

**OPTIONS:**

- L Level Connections
- O Offset Connections
- 4M 4" Male pipe thread connection
- 8P 6" Plain End SCH. 40 Inlet/Outlet
- CS6-48 Pedestrian rated cover (2,000 lbs.)
- CS6-48P H2O Load Rated Pickable Cast Iron Covers

**Table 1: Slab Rise**

CS26 (x1) 4'-1/2" - 23"
LS26 (x1) -23" - 37'-3/4"
CS26 (x2) -37'-3/4" - 42'-1/2"
CS26 (x1) + LS26 (x1) -42'-1/2" - 57'-1/2"
LS26 (x2) -57'-1/2" - 72"

**APPROVAL:**

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Company: \_\_\_\_\_

Specifying Engineer: \_\_\_\_\_

Engineering Firm: \_\_\_\_\_

**MODEL NUMBER:** SV24      **DESCRIPTION:** Polyethylene Wastewater Sampling Port

**PART #:** 8068-XXX-02    **DRAWN BY:** B. Karner    **DATE:** 2/25/2016    **REV:** 3 10/3/2017    **SDS:** 1067

8800 Wooded Road | Edwardsville, IL 62025 | Tel: 918-481-8800 | Fax: 918-481-8880 | www.schierproducts.com    © Copyright 2017 Schier, All Rights Reserved

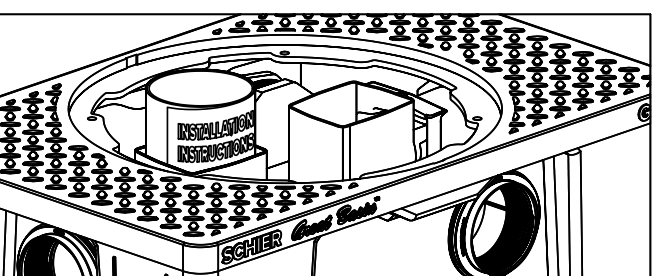
057-1080-02                      page 1 of 6

### SPECIAL PRECAUTIONS

For All Schier Grease Interceptor Installations

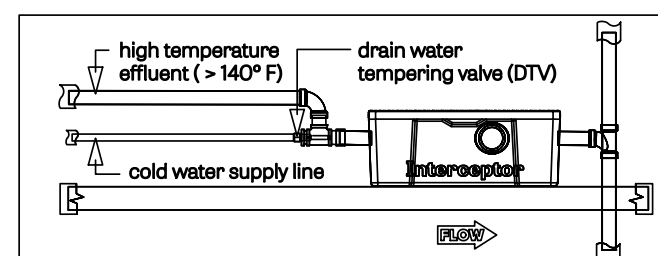
#### Installation Instructions

Installation instructions and additional components are located inside the interceptor. Read all instructions prior to installation. This interceptor is intended to be installed by a licensed plumber in conformance with all local codes.



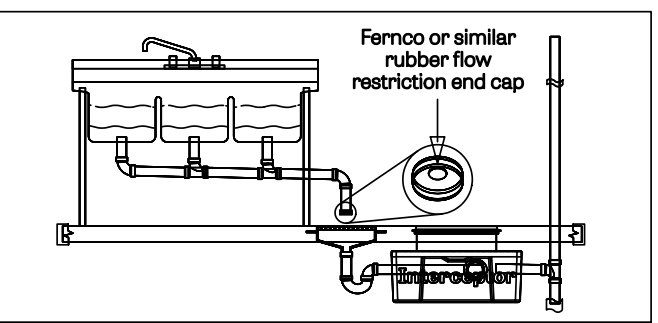
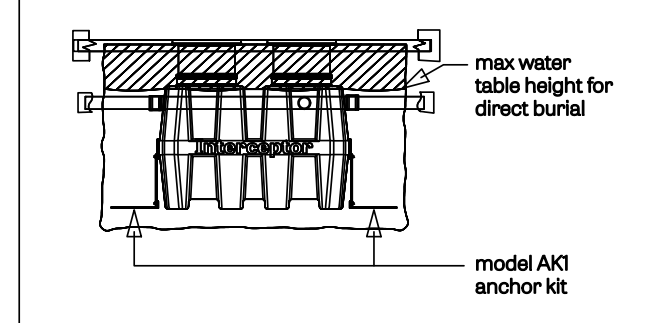
#### High Temperature Kitchen Water

If water is entering the interceptor at excessive temperature (over 140°F), a drain water tempering valve (DWT) must be installed. Most state and local plumbing codes prohibit water above 140°F being discharged into the sanitary sewer. Water above 140°F will weaken or deform PVC Schedule 40 pipe, poly drainage fixtures like interceptors and erode the coating of cast iron (leading to eventual failure). Failure to follow this guidance voids your warranty.



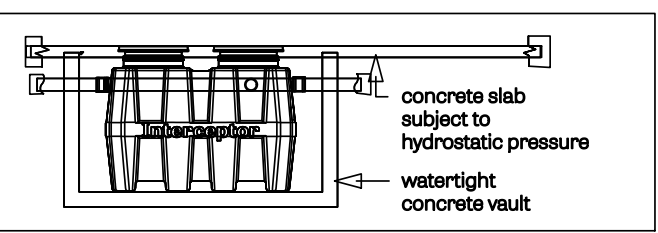
#### High Water Table Installations

Interceptors and risers are not designed to withstand water table height in excess of the top of the unit when buried (see Figure 1). If it is possible for this to occur, install the interceptor and risers in a water-tight concrete vault or backfill with concrete or flowable fill (wet concrete and flowable backfill should be poured in stages to avoid crushing the interceptor). At risk areas include but are not limited to tidal surge areas, floodplains and areas that receive storm water. Failure to follow this guidance voids your warranty. Models GB-50, GB-75, and GB-250 that are direct buried in high water table scenarios must be installed with model AKI anchor kit or warranty in void.

#### Hydrostatic Slabs (or Pressure Slabs)

When installed under a hydrostatic slab (slab designed to withstand upward lift, usually caused by hydrostatic pressure) interceptor must be enclosed in a watertight concrete vault. Failure to follow this guidance voids your warranty.



**MODEL NUMBER:** SV24      **DESCRIPTION:** Polyethylene Wastewater Sampling Port

**PART #:** 8068-XXX-02    **DRAWN BY:** B. Karner    **DATE:** 2/25/2016    **REV:** 3 10/3/2017    **SDS:** 1067

8800 Wooded Road | Edwardsville, IL 62025 | Tel: 918-481-8800 | Fax: 918-481-8880 | www.schierproducts.com    © Copyright 2017 Schier, All Rights Reserved

057-1080-02                      page 2 of 6

**APPROVAL:**

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Company: \_\_\_\_\_

Specifying Engineer: \_\_\_\_\_

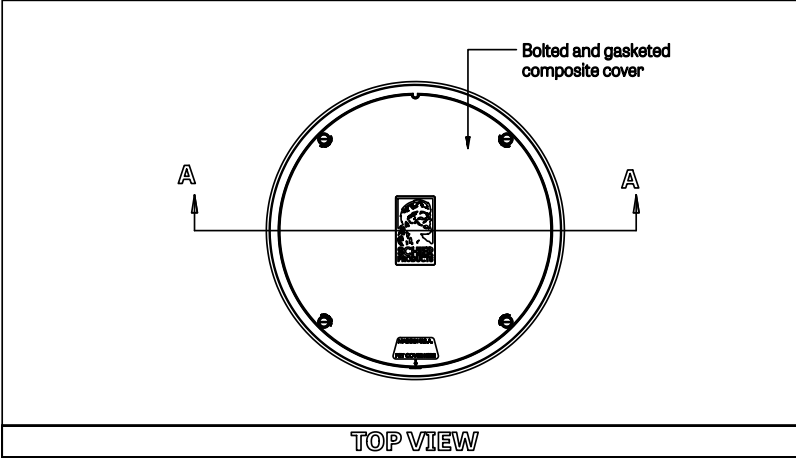
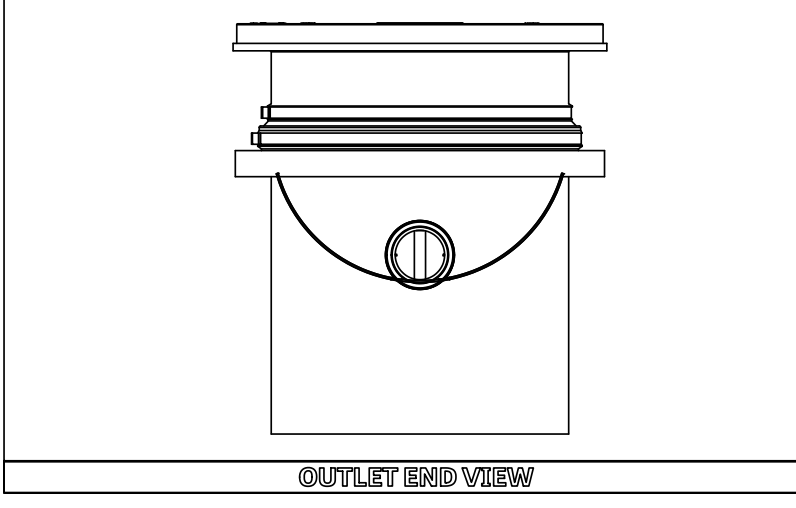
Engineering Firm: \_\_\_\_\_

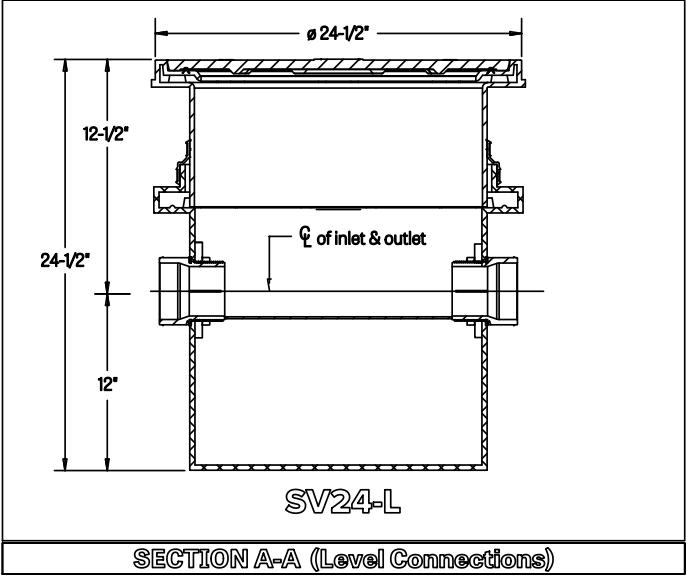
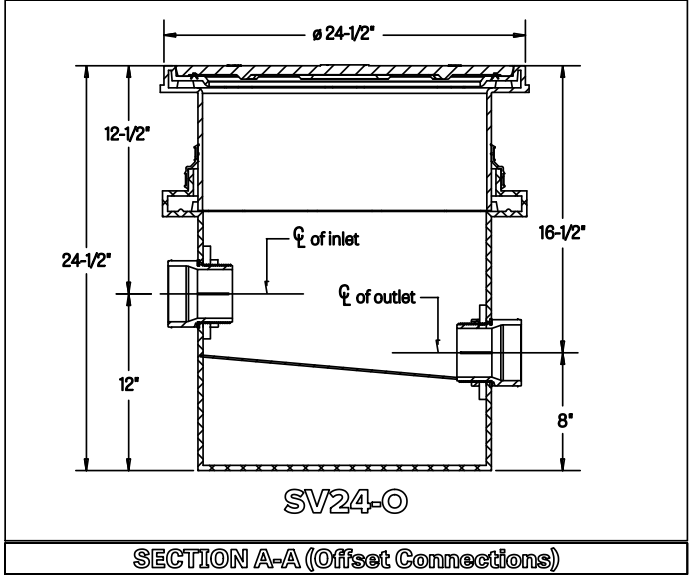
### SPECIFICATIONS

**NOTES:**

- 4" plain end inlet/outlet
- Unit weight - 65 lbs.
- Unit supplied with built-in adapter for up to 3" of continuous adjustability. Additional riser(s) are also available for deeper burial depth.
- Maximum operating temperature: 140°F continuous

**ENGINEER SPECIFICATION GUIDE**  
 Schier Sewer Viewer™ sampling port model SV24 shall be manufactured by Schier Products, Edwardsville, IL. Port shall be lifetime guaranteed and Made in USA of seamless, rotationally molded polyethylene.

**MODEL NUMBER:** SV24      **DESCRIPTION:** Polyethylene Wastewater Sampling Port

**PART #:** 8068-XXX-02    **DRAWN BY:** B. Karner    **DATE:** 2/25/2016    **REV:** 3 10/3/2017    **SDS:** 1067

8800 Wooded Road | Edwardsville, IL 62025 | Tel: 918-481-8800 | Fax: 918-481-8880 | www.schierproducts.com    © Copyright 2017 Schier, All Rights Reserved

057-1080-02                      page 3 of 6

**APPROVAL:**

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Company: \_\_\_\_\_

Specifying Engineer: \_\_\_\_\_

Engineering Firm: \_\_\_\_\_

### INSTALLATION (1 of 2)

**WARNING!** DO NOT AIR TEST UNIT OR TELESCOPE RISER SYSTEM! Doing so may result in property damage, personal injury or death.

#### LEAK/SEAL TESTING

Cap/plug all base unit plumbing connections and remove covers. For base unit testing, fill with water to just above the highest connection. Riser/sewer system testing (if required) fill with water to finished grade level. **CAUTION:** Always remain in exposed areas filling with water to prevent slipping. Inspect unit, connections and all gaskets and clamps (if applicable) for leaks. Check water level at specific time intervals per local code. **NOTE:** All gasket testing have been tested for leaks prior to shipment from the factory.

#### EXCAVATION

- Install unit as close as possible to grease interceptor being served.
- Surrounding soil must be undisturbed soil or well compacted engineering fill.
- Measure the width and length of the tank and excavate a hole that is a minimum of 12" greater than the tank on all sides and 6" deeper than tank bottom.
- After the excavation is complete create a well compacted support layer of sand/gravel mixture so that ground supporting tank is a minimum of 6" above native soil.

#### BELOW GRADE UNIT INSTALLATION

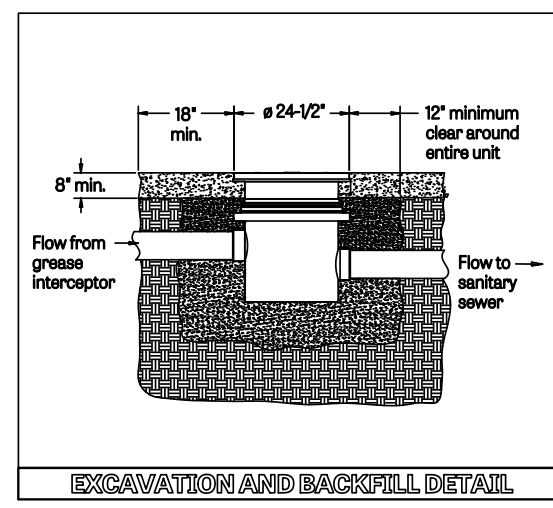
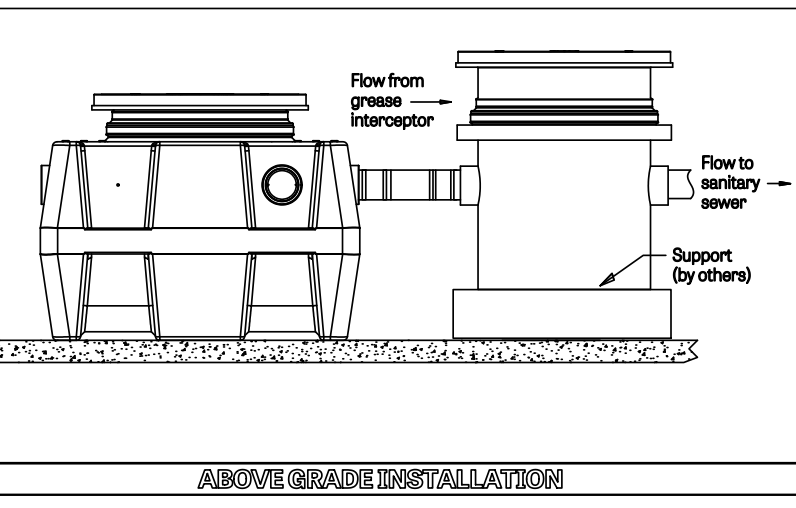
- Lower and center the unit into hole using straps around unit. Do not use chains or accessories to move the unit.
- Ensure the unit tops are level with finished grade.
- All pipe penetrations to be sleeved or flange connections.
- Fill unit with water before backfilling to stabilize unit and prevent foot-out during backfilling.

#### BACKFILLING AND FINISHED CONCRETE SLAB

- Before backfilling and pouring of slab, secure covers and risers (if necessary) to the unit.
- Backfill evenly around tank using crushed aggregate (approximately 3/4" size rock or sand, with no fines), or flowable fill. Work backfill under the unit using a probe to ensure the unit is fully supported.
- Thickness of concrete around cover to be determined by specifying engineer. If traffic loading is required the concrete slab dimensions shown are for guideline purposes only. Concrete to be 28 day compressive strength to 4,000 PSI. Slab must extend 18" outside the unit footprint.
- NO. 4 rebar (a 12" grade 60 steel per ASTM A615) connected with tie wires. Rebar to be 2'-1/2" from edge of concrete and spaced in a 12" grid with 4" spacing around access openings.

#### ABOVE GRADE INSTALLATION

- Set unit on a solid and level surface.
- If unit is to be suspended above the floor ensure bottom of unit is fully supported.
- Connect waste piping to the unit.
- To conduct a pressure test on pipes, if required, use expandable test plug. Do not pressure test unit.

**MODEL NUMBER:** SV24      **DESCRIPTION:** Polyethylene Wastewater Sampling Port

**PART #:** 8068-XXX-02    **DRAWN BY:** B. Karner    **DATE:** 2/25/2016    **REV:** 3 10/3/2017    **SDS:** 1067

8800 Wooded Road | Edwardsville, IL 62025 | Tel: 918-481-8800 | Fax: 918-481-8880 | www.schierproducts.com    © Copyright 2017 Schier, All Rights Reserved

057-1080-02                      page 4 of 6

**APPROVAL:**

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Company: \_\_\_\_\_

Specifying Engineer: \_\_\_\_\_

Engineering Firm: \_\_\_\_\_

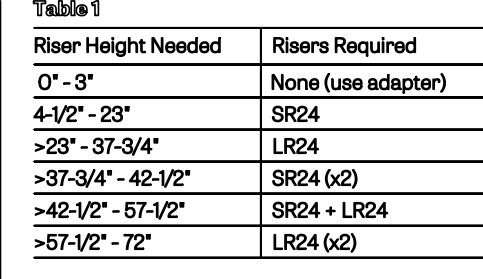
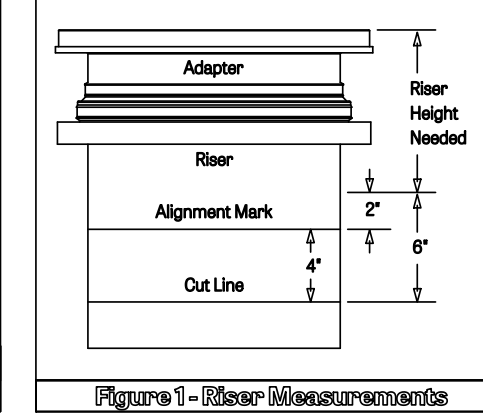
### INSTALLATION (2 of 2)

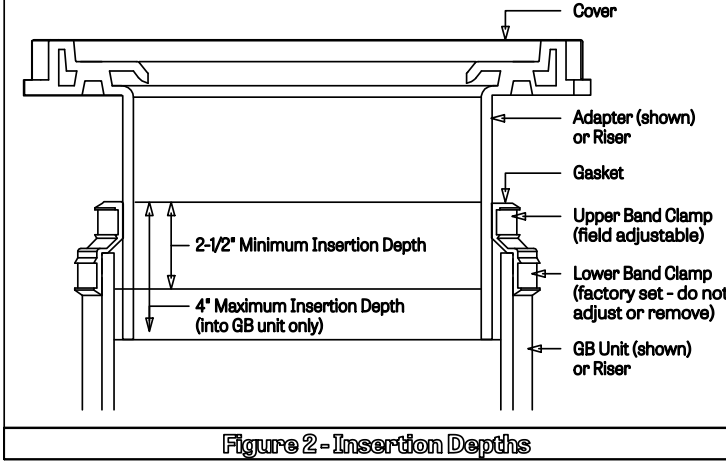

#### TELESCOPE RISER (2A SERIES) INSTALLATION (SUBSIDIARIES)

Tools needed: 7/16" Nut driver tool/bit (included), marker (included), tape measure and drill with 1/2" chuck, jigsaw, circular saw or reciprocating saw will be needed if risers are needed.

**NOTES:** To remove a component or adjust its position, the Upper Band Clamp needs to be loosened or removed using nut driver bit. Loosened clamps should be re-tightened to 5 - 8 ft. lbs. of torque (same as a rubber no-hub coupling). The Lower Band Clamp is factory set and should not be adjusted or removed.

- Set unit so the pipe connections line up with job site piping and measure riser height needed from top of cover to finished grade. See Table 1 to select risers needed.
- Remove covers from adapters. Remove adapters from main unit. On a level surface, pre-assemble the risers and adapters, adjusting the components upwards or downwards to achieve the riser height needed. Make sure to maintain minimum and maximum insertion depths as shown in Figure 2. If components are too long, make a circular line around the sidewall with marker and cut with a power saw. The lowest cut line on the riser assembly will be 6" beyond the riser height needed to allow for ideal insertion depth (See Figure 1). An alignment mark should be drawn 2" beyond the riser height needed which will align with the top of the base unit gasket. The Adapters and risers should sit level with each other. Tighten upper clamps to keep riser/adapter assembly from shifting. Make alignment marks on the sidewalls at the top of all riser gaskets to aid final assembly.
- IMPORTANT:** Before the next step, make sure both diffusers are installed inside the main unit at the appropriate locations. Check if there needs to be any flow control adjustment at the Inlet Diffuser (see general installation instructions).
- Take apart riser assembly and clean all sidewalls and insides of gaskets to remove dust/debris. Install components into the main unit starting from the lowest riser and work your way up to finished grade. Maintain minimum and maximum insertion depths for all components (see Figure 2). Tighten Upper Clamps to specified torque after correctly positioning components. Riser assembly may need to be supported during backfill.
- If tilting of the adapter is required to be flush with grade, do so AFTER all clamps have been tightened with riser(s)/adapter in a vertical and level position. Tilting is done using gasket flexibility. Tilting before tightening clamps may ruin a perfect gasket seal. Schier recommends tilting only the adapter versus the entire riser assembly to make sure your riser height and proper tank access is maintained.
- If riser height conditions change after completing above steps, there may be room for adjustment. As long as minimum and maximum insertion depths are maintained (see Figure 2), the adapters/risers can be adjusted/cut as many times as necessary. When riser system installation is complete, see Leak/Seal Testing procedure if required (pg 3 of 4).

**MODEL NUMBER:** SV24      **DESCRIPTION:** Polyethylene Wastewater Sampling Port

**PART #:** 8068-XXX-02    **DRAWN BY:** B. Karner    **DATE:** 2/25/2016    **REV:** 3 10/3/2017    **SDS:** 1067

8800 Wooded Road | Edwardsville, IL 62025 | Tel: 918-481-8800 | Fax: 918-481-8880 | www.schierproducts.com    © Copyright 2017 Schier, All Rights Reserved

057-1080-02                      page 5 of 6

**APPROVAL:**

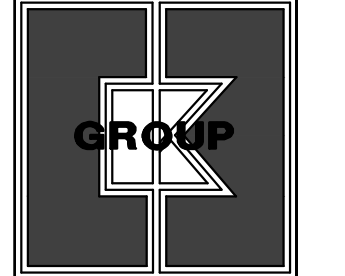
Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Company: \_\_\_\_\_

Specifying Engineer: \_\_\_\_\_

Engineering Firm: \_\_\_\_\_



# CKE GROUP

INCORPORATED  
 engineering • architecture • planning

15500 NEW BARN ROAD  
 SUITE 106  
 MIAMI LAKES, FLORIDA 33014

PHONE: (305) 558-4124  
 FAX: (305) 826-0619  
 EB#000432

SEAL  
 EDUARDO L. CARCACHE  
 CIVIL ENGINEER-PE 31914  
 ANA A. GONZALEZ VALDEZ  
 ARCHITECT-AR 97769

NO.	DATE	DESCRIPTION
△	03-02-18	
△	07-24-18	(NEW SHEET)
△		
△		
△		
△		
△		
△		
△		

CONTRACT DATE: -----  
 BUILDING TYPE: CUSTOM  
 PLAN VERSION: 1  
 SITE NUMBER: 309797  
 STORE NUMBER: 420630

**TACO BELL**  
 5070 W. Atlantic Blvd.  
 Delray Bch., FL

  
 T-40  
 OPEN KITCHEN  
**DELRAY BEACH SOL**  
 GREASE TRAP  
 DETAILS

**GT-2**

PLOT DATE: 07-26-2018