

NOTE: VERIFY ALL OVERHANGS WITH ARCH'L DRAWINGS - SEE 1/A4.1.

- ROOF FRAMING NOTES:**
1. VERIFY ALL DIMENSIONS WITH ARCHITECTURAL DRAWINGS.
  2. ALL SCHEDULED MARK DESIGNATIONS MAY NOT NECESSARILY BE FOUND ON THIS PLAN. SCHEDULES ARE TYPICAL TO THE PROJECT.
  3. B1, B2, ETC - AS SHOWN ON PLAN INDICATES BEAM, SEE SCHEDULE THIS SHEET.
  4. T1, T2, ETC - AS SHOWN ON PLAN INDICATES PREFABRICATED WOOD TRUSS, SEE SCHEDULE THIS SHEET.
  5. SL1, SL2, ETC - AS SHOWN ON PLAN INDICATES STEEL LINTEL, SEE SCHEDULE THIS SHEET.
  6. FOR CLARITY, DETAILS MAY SHOW ONLY ONE SIDE OF FRAMING CONDITION.
  7. FOR CLARITY, ALL ROOF OPENINGS MAY NOT BE SHOWN ON ROOF FRAMING PLAN. FOR EXACT SIZE, NUMBER AND LOCATION OF OPENINGS, SEE ARCHITECTURAL MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS. FOR FRAMING AT OPENINGS, SEE TYPICAL DETAILS.
  8. VERIFY EXACT SIZE AND WEIGHT OF EQUIPMENT ON ROOF WITH MECHANICAL CONTRACTOR.

**BEAM (B) SCHEDULE**

MARK	BEAM SIZE	CAMBER	REMARKS
B1	GLB 5 1/8" X 12"	---	----
B2	GLB 5 1/8" X 15"	.1"	----
B3	H12 X 30	1/2"	----
B4	H12 X 22	1/2"	5/8" X 6" X 8" BEARING PLATE AT MASONRY BEARING
B5	H12 X 16	---	5/8" X 6" X 8" BEARING PLATE AT MASONRY BEARING

**STEEL LINTEL (SL) SCHEDULE**

1. WHEN SPAN EXCEEDS 6'-0", SHORE LINTEL AT MIDSPAN.
2. WELD DOWELS TO LINTELS TO MATCH AND LAP VERTICAL REINFORCING PER G.S.N.
3. GROUT ALL CELLS SOLID TO 1'-4" MINIMUM ABOVE LINTELS.
4. AT 'TYPE B' LINTELS, USE VENEER TIES AT 16" O.C. EACH SIDE OF BEAM. TACK WELD TIES TO WEB OF BEAM.
5. AT 'TYPE B' LINTELS, EXTEND BOTTOM PLATE TO END OF BEAM.
6. 5" MINIMUM BEARING EACH END UNLESS NOTED OTHERWISE. INSTALL ON FRESH MORTAR BED.

MARK	TYPE	LINTEL SIZE	BEARING EACH JAMB
SL1	B	H8 X 13 WITH 1/4" X 7 1/2" CONTINUOUS STEEL PLATE	5"
SL2	A	DOUBLE STEEL ANGLES 6" X 3 1/2" X 5/16" (LLV)	5"
SL3	A	DOUBLE STEEL ANGLES 3 1/2" X 3 1/2" X 1/4"	5"


**TRUSS (T) SCHEDULE**

MARK	TYPE	SPACING	REMARKS
T1	COMMON-DOUBLE STUB TOP CHORD BEARING	24" O.C.	----
T2	STEP DOWN HIP-DOUBLE STUB TOP CHORD BEARING	24" O.C.	HIP GIRDER AT T2A
T3	JACK-TOP CHORD BEARING AT BEAM	24" O.C.	HIP CARRIER (4:17) AT T3A
T4	SCISSOR BOTTOM CHORD BEARING	24" O.C.	----
T5	STEP DOWN HIP BOTTOM CHORD BEARING	24" O.C.	HIP GIRDER AT T5A
T6	JACK BOTTOM CHORD BEARING	24" O.C.	HIP CARRIER (4:17) AT T6A
T7	VALLEY SETS	24" O.C.	----
T8	STEP DOWN CAMBERED BOTTOM CHORD BEARING	24" O.C.	----

**ROOF FRAMING PLAN**  
SCALE: 1/8" = 1'-0"

	88-581 Project Number	For additional information shown,
	CRP Project Manager	but not noted,
	CRP Project Engineer	see sheet S1.1
	WLC Project Drafter	

Architectural/Planning/Interior Design  
**LENDRUM DESIGN GROUP**  
3033 North Fourth Street  
Phoenix, Arizona 85018  
602/955-2100

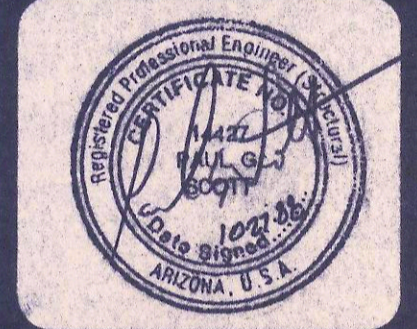

**MeraBank**  
KINGMAN, ARIZONA  
BRANCH BANK

JOB NUMBER  
**10434.00**

DATE  
**11-11-88**

DRAWN  
**WLC**

CHECKED  
**CRP**

SHEET TITLE  
**ROOF FRAMING PLAN**

SCALE  
**1/8" = 1'-0"**

REVISIONS  
**10/20/88**

DRAWING NUMBER  
**S2.2**