


NOTE: STATIC QUEUING BOARDS TO BE HARD WIRED. G.C. TO PROVIDE J-BOX ABOVE CEILING CENTERED BETWEEN BOARDS.

STATIC MENU BOARDS

INSTALL J-BOXES FOR FUTURE DATA/POWER. RUN CONDUIT AND TERMINATE AT CEILING. TYP. OF THREE (3) LOCATIONS.

3 MAIN MENUBOARD ROUGH-IN ELEVATION

NOT TO SCALE

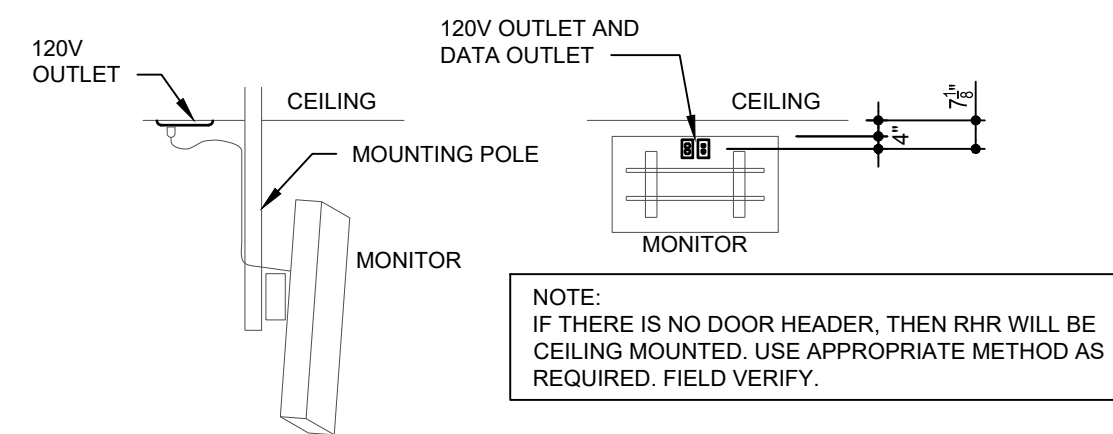

NOTE: IF THERE IS NO DOOR HEADER, THEN RHR WILL BE CEILING MOUNTED. USE APPROPRIATE METHOD AS REQUIRED. FIELD VERIFY.

2 REDHEAD ROASTER (RHR) POWER MONITOR SCHEMATIC

NOT TO SCALE

ELECTRICAL LEGEND

- JUNCTION BOX
- * = A-H AS COOKLINE. JUNCTION BOXES REFER TO DETAIL #3 ON SHEET E4.2
- 20 AMP 120V-1PH SIMPLEX RECEPTACLE +16" AFF OR AS NOTED
- 20 AMP 120V-1PH DUPLEX RECEPTACLE +16" AFF OR AS NOTED
- 20 AMP 120V-1PH GROUND FAULT INTERRUPTING RECEPTACLE
- 20 AMP 120V-1PH WEATHERPROOF RECEPTACLE
- 20 AMP 120V-1PH RECESSED RECEPTACLE
- 120V-1PH QUADRUPLX RECEPTACLE
- 20 AMP 120V-1PH HUBBELL #USB20X2BK RECEPTACLE
- 20 AMP QUADRUPLX 120V-1PH HUBBELL # USB20X2W (QTY 2)
- 20 AMP 120V-1PH HUBBELL #G5362 ISOLATED GROUND RECEPTACLE
- 20 AMP QUAD HUBBELL #G5362 (QTY 2) ISOLATED GROUND RECEPTACLE
- SPECIAL RECEPTACLE. SEE KITCHEN EQUIPMENT SCHEDULE
- DISCONNECT SWITCH BY ELECTRICAL CONTRACTOR
- DISCONNECT SWITCH SUPPLIED WITH EQUIPMENT
- TELEPHONE CONNECTION
- TELEPHONE/DATA CONNECTION
- DATA CONNECTION
- REMOTE TEST STATION (S4')
- PARTIAL CIRCUIT
- HOME RUN TO PANEL. CIRCUIT NUMBERS, PHASE, NEUTRAL & GROUND CONDUCTORS INDICATED ALONG WITH ISOLATED GROUND CONDUCTOR IF APPLICABLE.
- THERMOSTAT. TEMPERATURE SENSOR AND HUMIDISTAT BY MECHANICAL CONTRACTOR

EQUIPMENT & CONNECTIONS

CIRCUIT NUMBER	DESCRIPTION	LOAD				VOLTAGE		CONNECTIONS			FEEDER			NOTES
		HORSEPOWER	KILOWATTS	120V-1PH	208V-1PH	208V-3PH	120/208V-1PH	TYPE	PLUG CORD FURNISHED	CONDUCTORS #	WIRE SIZE	GROUND SIZE	CONDUIT SIZE	
(E)	DRIVE THRU FREESTYLE		.7	0			EXIST. RECEPTACLE	ES	2	12	12	3/4"	EXISTING	
(E)	POS MONITOR/TERMINAL		.3	0			RECEPTACLE	(E)						
(E)	POS MONITOR/TERMINAL		.3	0			RECEPTACLE	(E)						
(E)	BEVERAGE DISPENSER		.4	0			RECEPTACLE	ES	2	12	12	3/4"	EXISTING	
--	--		--	0			--	--	--	--	--	--	--	
--	MENUBOARD		1.5	0			DIRECT	EC	2	12	12	3/4"		
--	REDHEAD ROASTER		.5	0			DIRECT	EC	2	12	12	3/4"		
(E)	D.T. ICE MAKER		2.5	0			WP DISC SWITCH @ UNIT	ES	3	10	10	3/4"	VERIFY FOR REUSE	
(E)	BEVERAGE DISPENSER		1.4	0			RECEPTACLE	ES	2	12	12	3/4"		
(E)	BEVERAGE ICE MAKER		2.5	0			WP DISC SWITCH @ UNIT	ES	3	10	10			
(E)	DOUBLE SIDED GRILL		15.9	0			RECEPTACLE NEMA 15-60	EC	3	6	10	1-1/2"		
(E)	DOUBLE SIDED GRILL		12.8	0			RECEPTACLE NEMA 15-60	EC	3	6	10	1-1/2"		


ES /EQUIPMENT SUPPLIER
EC /ELECTRICAL CONTRACTOR
-- CONDUCTOR QUANTITY DOES NOT INCLUDE GROUND WIRE

GENERAL NOTES

- A. REFER TO "WIRING AND SITE PREPARATION GUIDE" AS PREPARED BY "WENDY'S INTERNATIONAL" "INFORMATION SYSTEMS DEPARTMENT" FOR INSTALLATION OF POINT OF SALE CASH REGISTER SYSTEM.
- B. ELECTRICAL CONTRACTOR TO COORDINATE WORK WITH MECHANICAL, REFRIGERATION AND EQUIPMENT CONTRACTORS, INCLUDING COOLER/FREEZER WORK. (IF APPLICABLE)
- C. ELECTRICAL CONTRACTOR TO VERIFY ALL ROUGH-IN DIMENSIONS AND POWER REQUIREMENTS WITH KITCHEN EQUIPMENT DISTRIBUTOR PRIOR TO ROUGH-IN.
- D. ELECTRICAL CONTRACTOR TO HOOK UP FIELD CONNECTIONS WITHIN FRONT COUNTER, AND ICE MACHINE REMOTE UNIT (ON ROOF) AT TIME OF INSTALLATION.
- E. HEIGHTS INDICATED FOR RECEPTACLES AND JUNCTION BOXES ARE MEASURED FROM FINISH FLOOR TO THE CENTER OF THE BOX UNLESS OTHERWISE NOTED.
- F. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR INSTALLING ALL TELEPHONE LINES AND TERMINATIONS. VERIFY QUANTITY AND LOCATIONS WITH OWNER PRIOR TO BIDDING.
- G. ALL CIRCUITS MAY BE CORRECTED TO THE LEAST AMOUNT OF CONDUIT RUN UNLESS OTHERWISE NOTED.
- H. ALL COVER PLATES TO BE SATIN FINISH STAINLESS STEEL THROUGHOUT UNLESS OTHERWISE NOTED.
- I. ALL NEW 120V RECEPTACLES IN KITCHEN TO HAVE GROUND-FAULT CIRCUIT INTERRUPTER PROTECTION. OTHER GFIS SHOWN SEPARATELY.
- J. FOR THE IBM POINT OF SALE REGISTER SYSTEM ONLY: ALTERNATE P.O.S. SUPPLIERS MUST CONFORM TO THE REGISTER LAYOUT OR PROVIDE THE OWNER AND/OR GENERAL CONTRACTOR WITH WIRING DIAGRAMS AND INSTALLATION DETAILS BEFORE THE ELECTRICAL CONTRACTOR STARTS ANY WORK.
- K. ALL CONDUITS SHOULD BE STEEL FLEX OR PLASTIC STUBBED OUT ABOVE THE CEILING LINE AND TERMINATED INTO A J-BOX AS NOTED AND CAPABLE OF ACCEPTING A FACEPLATE COVER.
- L. ALL J-BOXES SHOULD BE INSTALLED IN SUCH A WAY THAT THEY ARE NOT BLOCKED BY OTHER EQUIPMENT OR STRUCTURAL COMPONENTS.
- M. ALL IG OUTLETS (HUBBELL IG5362 - ORANGE OR EQUAL) MUST BE CLEARLY LABELED.
- N. ALL CABLE ACCESS OPENINGS THRU S/S MUST HAVE RUBBER OR PLASTIC GROMMETS INSTALLED.
- O. THE ELECTRIC SERVICE FOR THE GFI OUTLET/SCOREBOARD MUST BE ON A SEPARATE BREAKER (NOT CONNECTED TO THE MENU BOARD OR OUTSIDE LIGHT FEED).
- P. HEIGHTS INDICATED FOR RECEPTACLES AND J-BOXES ARE MEASURED FROM FINISH FLOOR TO THE CENTER OF BOX. U.N.O.
- Q. EXISTING ENERGY MANAGEMENT SYSTEM TO REMAIN AND BE FULLY OPERATIONAL AT COMPLETION OF REMODEL.
- R. ALL CUSTOMER ACCESSIBLE RECEPTACLES MUST BE TAMPER RESISTANT.

X CODED NOTES:

1. CIRCUIT TO EXISTING 20A, 120V. SPARE CIRCUIT BREAKER AS INDICATED ON PLANS IN EXISTING PANELBOARD (FIELD VERIFY). VERIFY THAT THE ADDITIONAL LOAD DOES NOT OVERLOAD EXISTING PANELBOARD OR ANY UPSTREAM ELECTRICAL DEVICE.
2. ALL EXISTING ELECTRICAL DEVICES, CONDUIT, WIRING, AND EQUIPMENT IN THIS AREA AND ON ROOF TO REMAIN, UNLESS NOTED OTHERWISE. MAINTAIN AND PROTET EXISTING BRANCH CIRCUITS.
3. PROVIDE POWER AND DATA FOR STATIC MENUBOARDS. PROVIDE CIRCUITING TO MENU BOARDS IN SERVING AREA VIA LIGHTING CONTACTOR. DESIGN INTENT IS FOR MENU BOARDS TO BE CONTROLLED ON AND OFF WITH GENERAL LIGHTING IN THIS AREA.
4. PROVIDE CEILING MOUNTED DUPLEX RECEPTACLE AND DATA FOR DIGITAL RHR MONITOR. SEE RHR POWER MONITOR SCHEMATIC DETAIL ON THIS SHEET.
5. PROVIDE POWER AND DATA FOR QUEUING BOARDS. PROVIDE CIRCUITING TO QUEUING BOARDS IN SERVING AREA VIA LIGHTING CONTACTOR. DESIGN INTENT IS FOR QUEUING BOARDS TO BE CONTROLLED ON AND OFF WITH GENERAL LIGHTING IN THIS AREA.

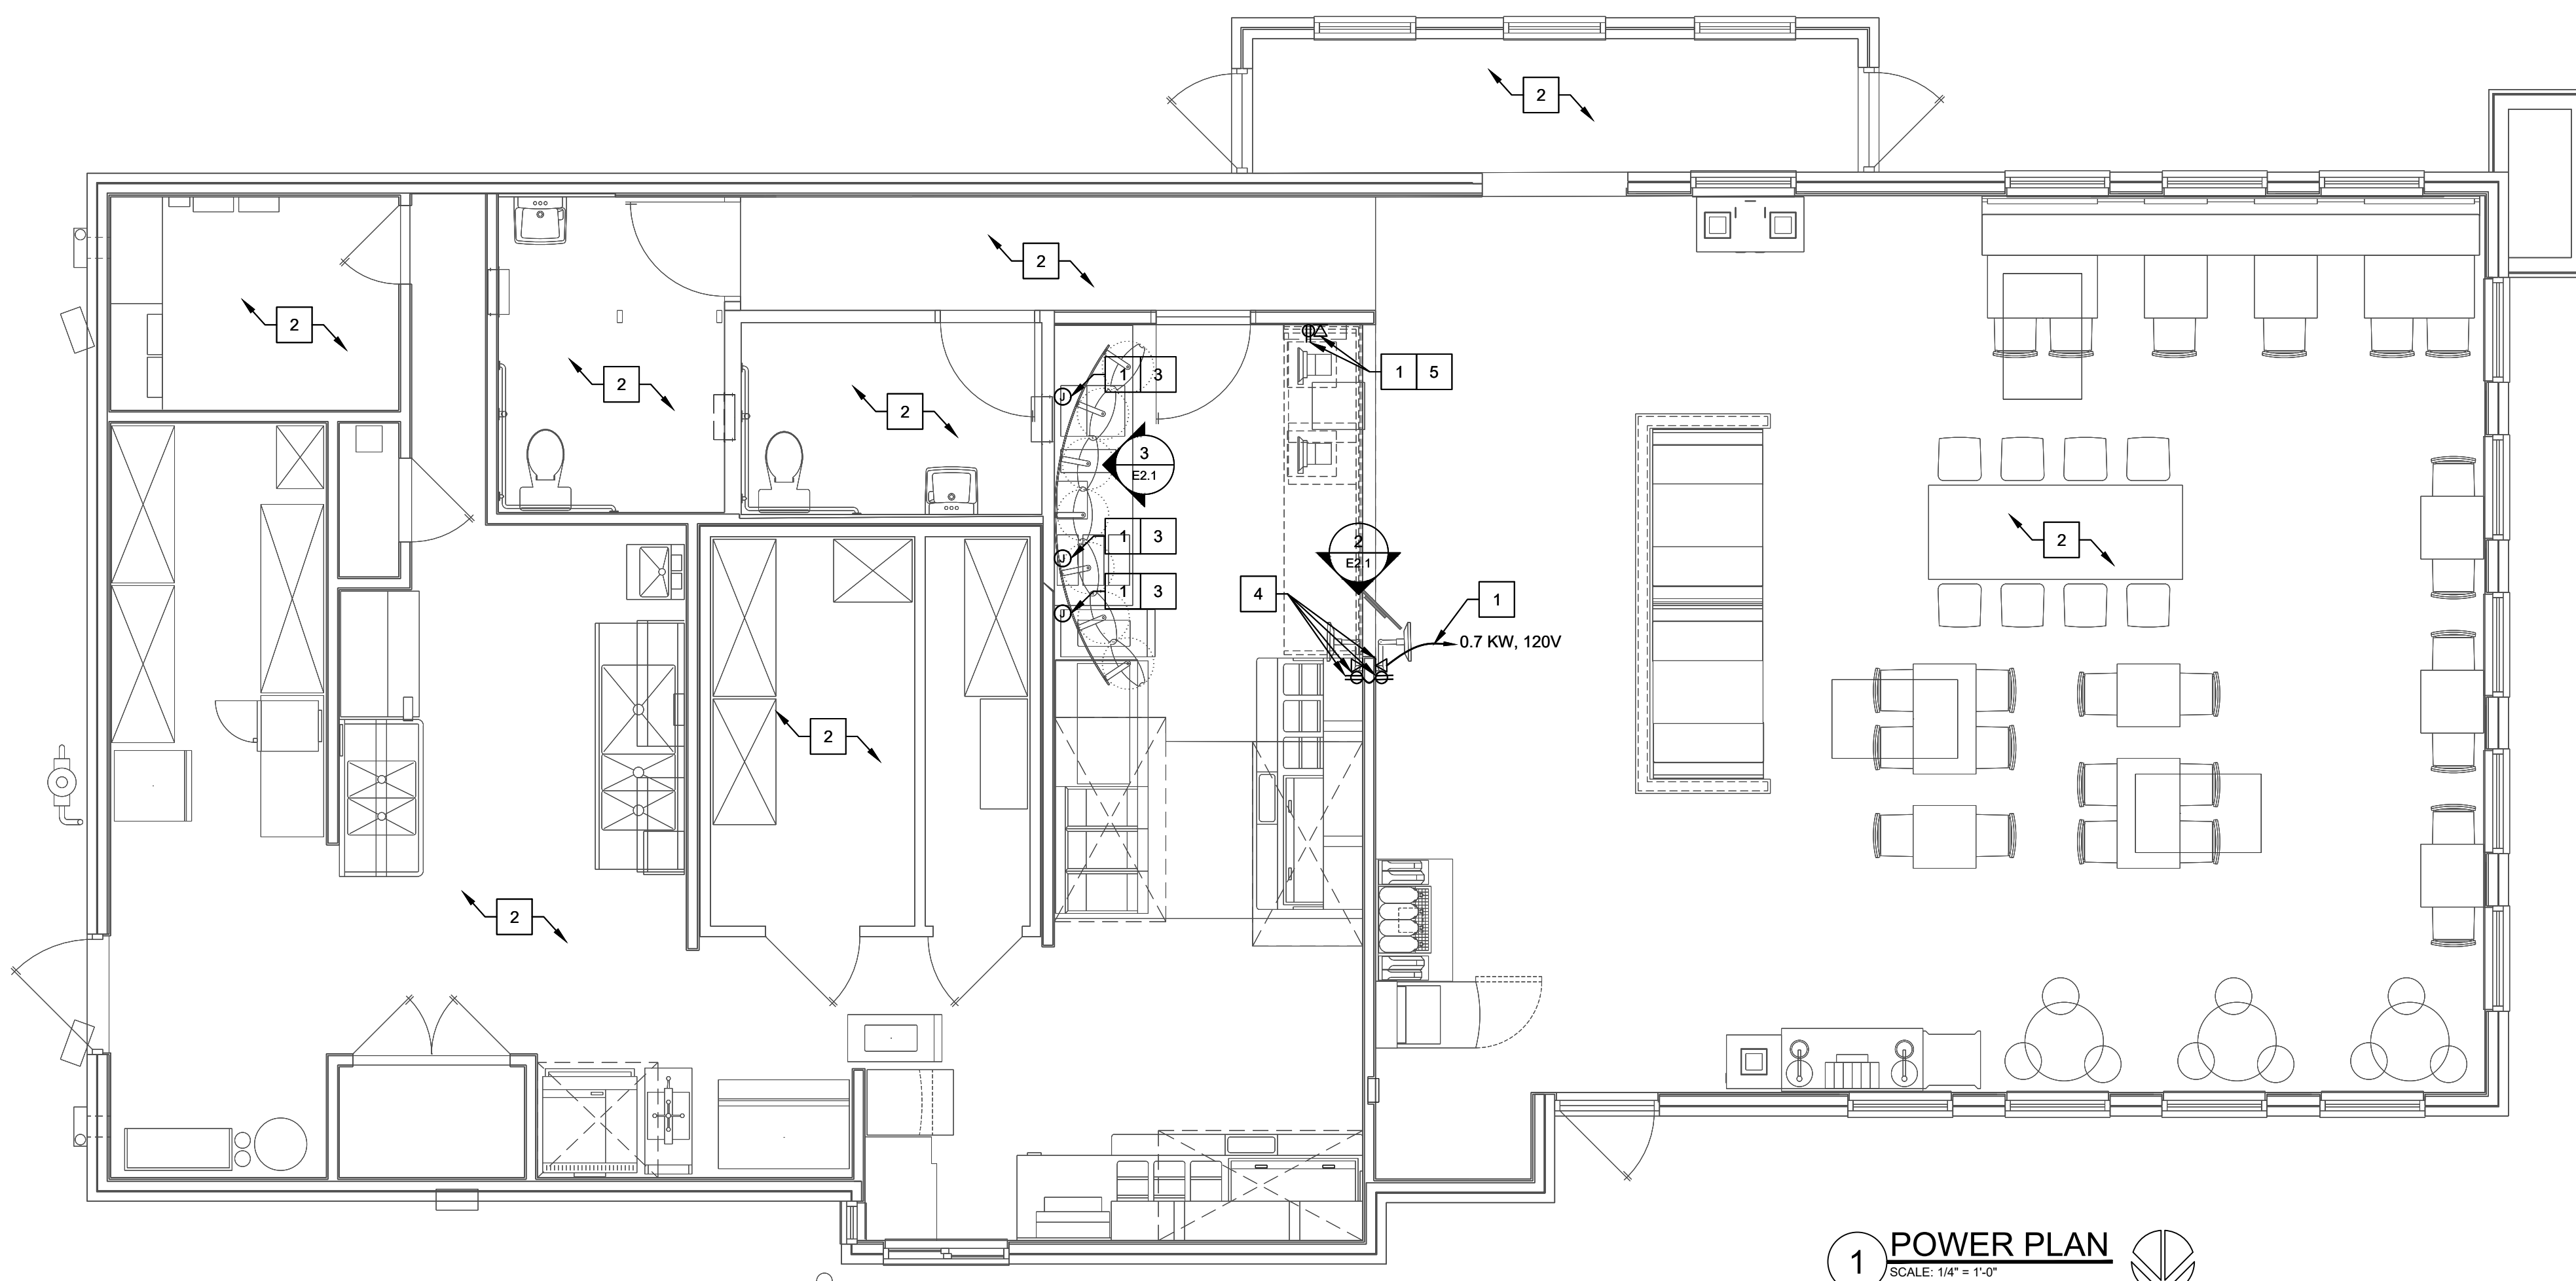

1 POWER PLAN

SCALE: 1/4" = 1'-0"

SITE NUMBER:	00915
BUILDING TYPE:	3076
ASSET TYPE:	FREE STANDING
CLASSIFICATION:	REFRESH
OWNER:	STARBOARD
BASE VERSION:	2021 SPRING
UPGRADE CLASSIFICATION:	
	N/A
PROJECT YEAR:	2022
DESIGN TYPE:	(2.0) UM BRIGHT
DRAWING RELEASE:	2021 SPRING




STARBOARD GROUP
12540 W. ATLANTIC BLVD.
CORAL SPRINGS, FL 33071
OFFICE: (954)255-2266

Wendy's.

#00915 (STARBOARD #507)
13119 N. DALE MABRY HWY.
TAMPA, FL 33618

REV.	DATE	DESCRIPTION

ISSUE DATE: 12/09/2021
PROJECT NUMBER: 21-121
DRAWN BY: MS/BS
CHECKED BY: AR/CF

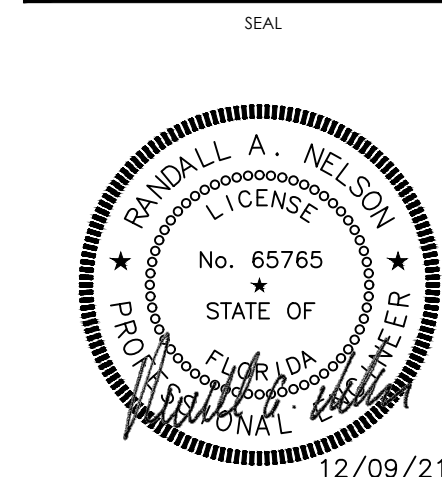

SHEET NAME
POWER PLAN

SHEET NUMBER

E2.1