



1 Site Electrical Plan
SCALE: 1/16" = 1'-0"

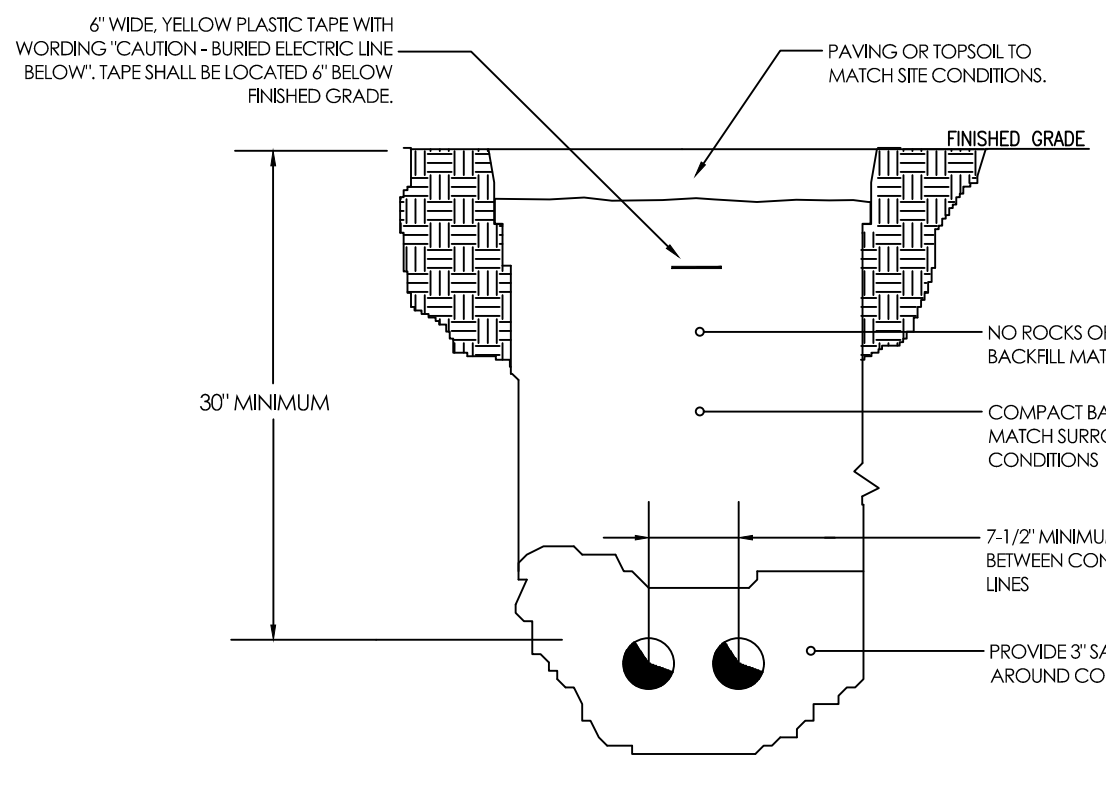

3 Typical Direct Burial Detail
SCALE: NO SCALE

- GENERAL NOTES:**
1. INSTALL CONDUIT 30 BOTTOM OF DUCT IS AT PROPER ELEVATION.
 2. PROVIDE SILLKROPE IN ALL SPARE CONDUIT.
 3. PROVIDE 42" GRC RIGID SWEEP ELBOWS FOR ALL BENDS.
 4. ALL UNDERGROUND CONDUITS SHALL BE OF TYPE SCH. 80 PVC OR GRS.

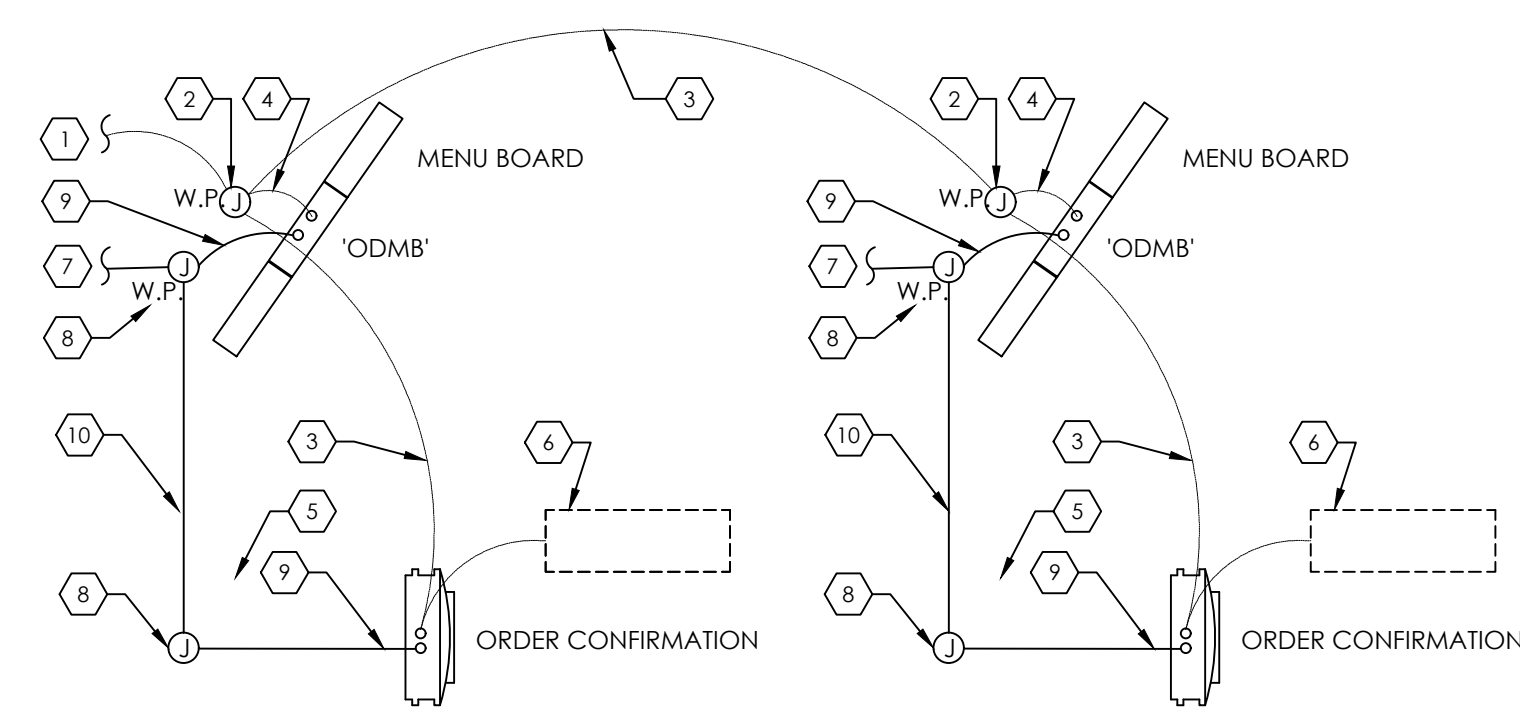



LANE 1 DRIVE-THRU EQUIPMENT **LANE 2 DRIVE-THRU EQUIPMENT**

- NOTES:**
- A. COORDINATE ALL CIRCUITING REQUIREMENTS WITH VENDOR / SUPPLIER PRIOR TO COMMENCING WORK. PROVIDE REQUIRED CIRCUITING.
 - B. PROVIDE DEDICATED CIRCUITS FOR EACH UNIT.
 - C. PROVIDE LIGHTING CIRCUIT PER MANUFACTURER'S REQUIREMENT.
 - D. VERIFY CONDUIT ROUTING AND REQUIREMENTS PRIOR TO COMMENCING WORK.
 - E. FOR POWER CIRCUITING REFER TO THE ELECTRICAL SCHEDULE E-3.
- KEYED NOTES - DRIVE THRU:**
- DATA**
1. 2" UNDERGROUND DATA CONDUIT FROM DRIVE-THRU.
 2. WATERPROOF JUNCTION DATA BOX LOCATED BEHIND 'ODMB'.
 3. 2" UNDERGROUND DATA CONDUIT TO LANE 2.
 4. 3/4" PVC SWEEP INTO 'ODMB' FOOTER.
 5. 3/4" PVC SWEEP INTO 'SPEAKER POST'.
 6. 1/2" PVC SWEEP INTO 'SPEAKER POST' FROM UNDER CONCRETE LOOP.
- ELECTRICAL**
7. 1" UNDERGROUND POWER CONDUIT TO DEDICATED CIRCUIT. REFER TO PANEL SCHEDULE.
 8. WATERPROOF JUNCTION POWER BOX LOCATED BEHIND 'ODMB'.
 9. 1/2" CONDUIT SWEEP INTO 'ODMB' FOOTER FOR DEDICATED POWER. REFER TO PANEL SCHEDULE.

ELECTRICAL PLAN KEYNOTE:

- (E1)** PROVIDE (2) #10, (1) #10GND IN 1" UNDERGROUND CONDUIT BACK TO PANEL 'A' FOR FLAG POLE LIGHTS. PROVIDE (3) LIGHTS: F.W. HAXEL CO., CDA SERIES. VERIFY POLE DIAMETER PRIOR TO ORDERING LIGHT FIXTURES. COORDINATE MOUNTING HEIGHT WITH BURGER KING REP.. ROUTE BRANCH CIRCUITING TO LIGHTS THROUGH POLE. PROVIDE LIGHTS WITH PHOTOCELL CONTROL.
- (E2)** PROVIDE (2) # 4,(1) #6 GND IN 1-1/2" UNDERGROUND CONDUIT BACK O PANEL 'M' FOR GRINDER PUMP STATION . PROVIDE AN ADDITIONAL 1" UNDERGROUND CONDUIT WITH PULL STRINGS FOR PUMP STATION ALARM BACK TO THE MAIN OFFICE. COORDINATE THIS WORK WITH ALL TRADES PRIOR TO COMMENCING WORK.

2 Drive Thru Detail
SCALE: NOT TO SCALE

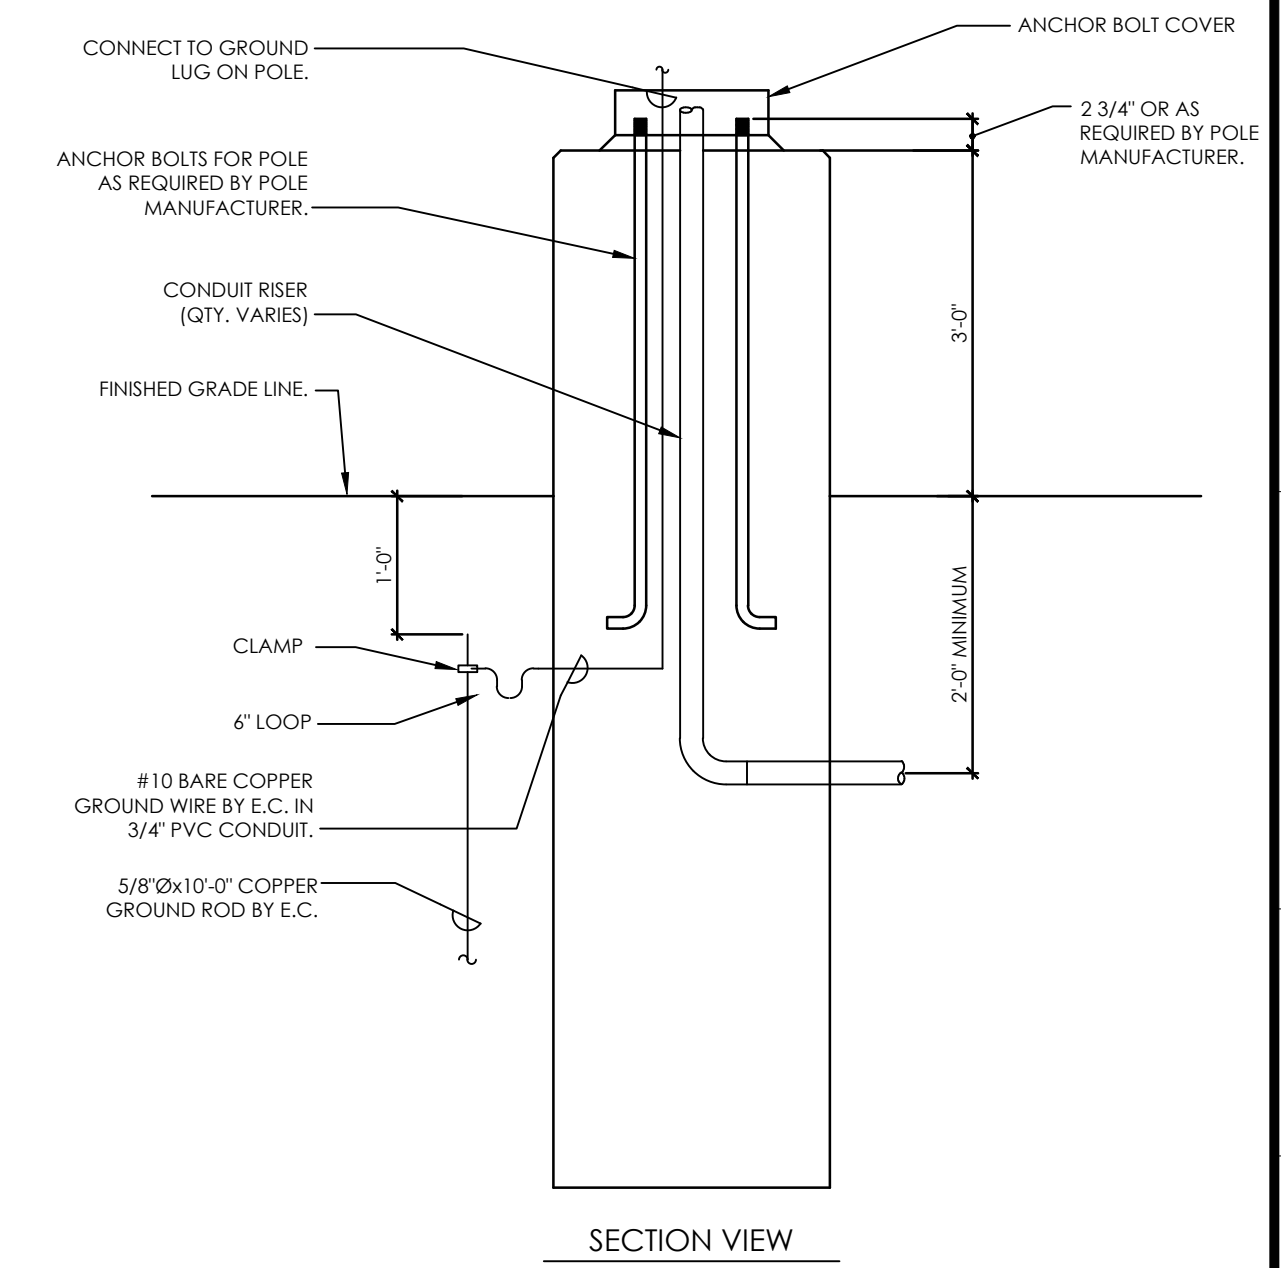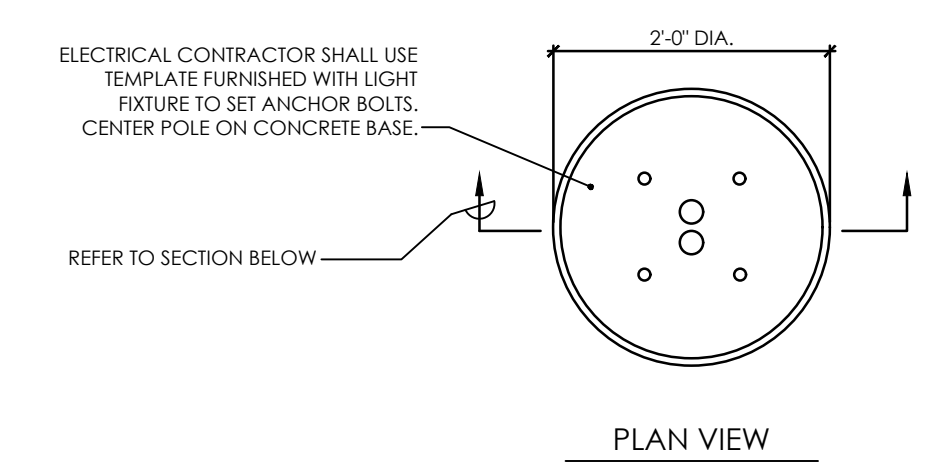

4 Lighting Pole Base Detail
SCALE: N.T.S.

Issued:	Date:
A BKC Approval	10/29/2021
B Permit Set	1/28/2022
C Bid Set	4/25/2022
D	
E	
Revisions:	Date:
1	
2	
3	
4	
5	
6	
7	
8	
9	

Seal PROJECT ARCHITECT/ENGINEER DATE

PROJECT LEAD DATE

PROJECT DESIGNER DATE

Copyright © 2022 APD Engineering & Architecture, LLC

Drawing Alteration

It is a violation of law for any person, unless acting under the direction of a licensed Architect, Professional Engineer, Landscape Architect, or Land Surveyor to alter any item on this document in any way. Any licensee who alters this document is required by law to affix his or her seal and to add the notation "Altered By" followed by his or her signature and the specific description of the alteration or revision.

[DO NOT SCALE PLANS]

Copying, Printing, Software and other processes required to produce these prints can stretch or shrink the actual paper or layout. Therefore, scaling of this drawing may be inaccurate. Contact APD E&A with any need for additional dimensions or clarifications.



Burger King Inc.
Store # 30011
108 Egg Harbor Road
Sewell, NJ 08080
Gloucester County
Project Name & Location:

Site Electrical Plan	
Drawing Name:	Project No.
Date: 11/8/2021	21-0458
Type: BK ROC-60	SE-1.0
Drawn By: MK	Drawing No.
Scale: As Noted	

PLOTTED: 4/25/2022 11:18 AM