

**1** Site Electrical Plan  
SCALE: 1/16" = 1'-0"

**GENERAL NOTES:**

- E.C. TO VERIFY LOCATION OF PYLON, DIRECTIONAL SIGNS PRIOR TO COMMENCING WORK.
- E.C. TO COORDINATE WITH THE DRIVE THROUGH SIGN SUPPLIER FOR EXACT ELECTRICAL REQUIREMENTS.
- ALL UNDERGROUND CONDUITS SHALL BE OF TYPE SCH. 80 PVC OR APPROVED EQUAL.


**ELECTRICAL PLAN KEYNOTE:**

- (E1) PROVIDE (2) #10, (1) #10 GND IN 1" UNDERGROUND CONDUIT BACK TO PANEL 'A' FOR FLAG POLE LIGHTS. PROVIDE (3) LIGHTS: F.W. HAXEL CO., CDA SERIES. VERIFY POLE DIAMETER PRIOR TO ORDERING LIGHT FIXTURES. COORDINATE MOUNTING HEIGHT WITH BURGER KING REP., ROUTE BRANCH CIRCUITING TO LIGHTS THROUGH POLE. PROVIDE LIGHTS WITH PHOTOCCELL CONTROL.

LUMINAIRE SCHEDULE					
TYPE	DESCRIPTION	VOLTS	MANUFACTURER & CATALOG NUMBER	QTY	WATTS
A	WALL MOUNT LIGHT FIXTURE WITH INTEGRATED ON/OFF MOTION SENSOR OPERATION REFRACTIVE LENS. INSTALL AT HIGHEST POINT ON WALL	120	COOPER LIGHTING 'AXCS3A-BK-MSP-L12	1	72

**LEGEND**

- E — E — UNDERGROUND ELECTRIC
- T — T — UNDERGROUND DATA / TELEPHONE

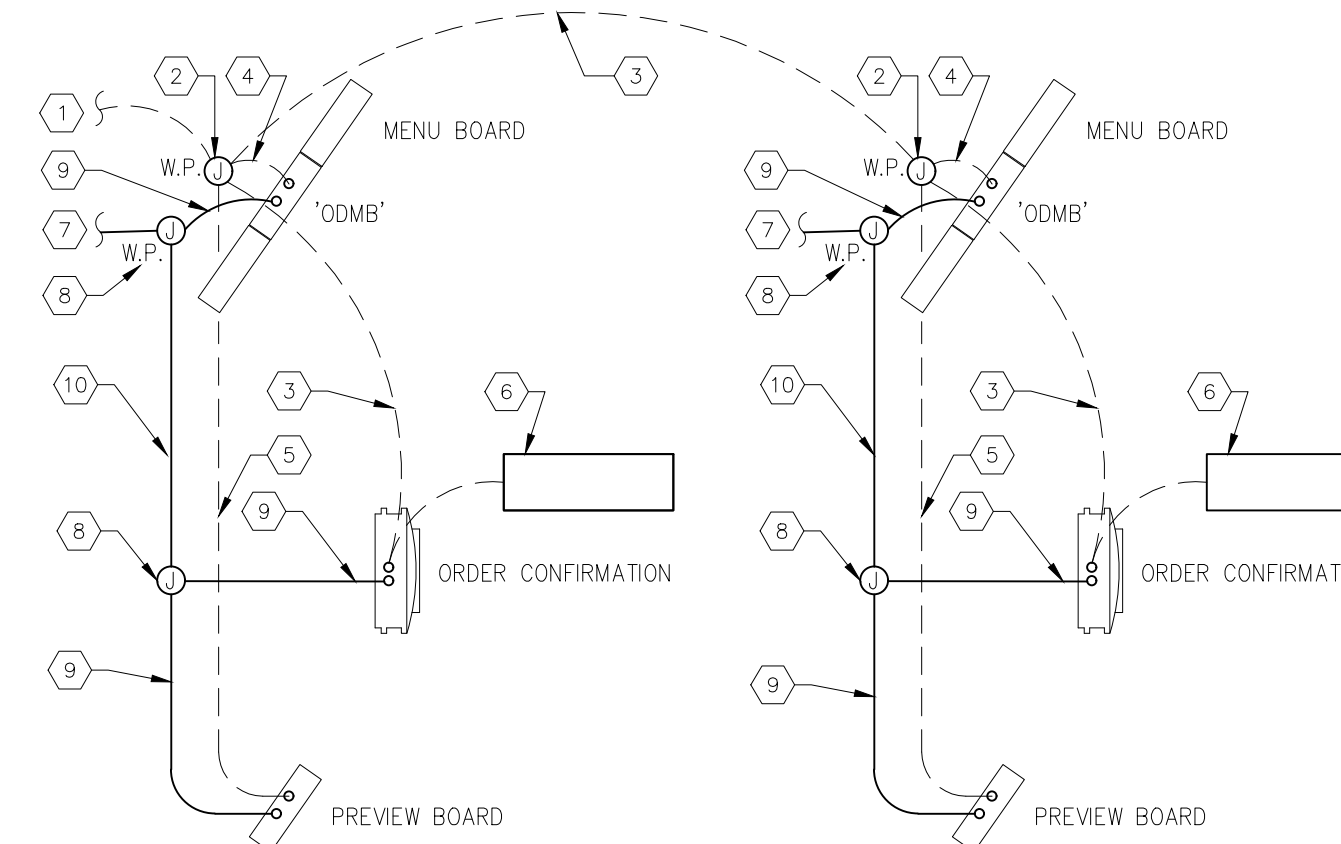


- NOTES:**
- COORDINATE ALL CIRCUITING REQUIREMENTS WITH VENDOR / SUPPLIER PRIOR TO COMMENCING WORK. PROVIDE REQUIRED CIRCUITING.
  - PROVIDE DEDICATED CIRCUITS FOR EACH UNIT.
  - PROVIDE LIGHTING CIRCUIT PER MANUFACTURER'S REQUIREMENT.
  - VERIFY CONDUIT ROUTING AND REQUIREMENTS PRIOR TO COMMENCING WORK.
  - FOR POWER CIRCUITING REFER TO THE ELECTRICAL SCHEDULE E-3.

**(X) KEYED NOTES - DRIVE THRU:**

- DATA:**
- 2" UNDERGROUND DATA CONDUIT FROM DRIVE-THRU.
  - WATERPROOF JUNCTION DATA BOX.
  - 2" DATA CONDUIT TO LANE 2.
  - 3/4" PVC SWEEP INTO MENU BOARD FOOTER.
  - 3/4" PVC SWEEP INTO 'PREVIEW BOARD FOOTER'.
  - 1/2" PVC SWEEP INTO 'SPEAKER POST' FROM UNDER CONCRETE LOOP.
- ELECTRICAL:**
- 2" UNDERGROUND CONDUIT FOR POWER CIRCUITING TO INDICATED PANEL.
  - WATERPROOF JUNCTION POWER BOX.
  - 3/4" CONDUIT FOR POWER.
  - 1" CONDUIT FOR POWER.

**2** Drive Thru Detail  
SCALE: NOT TO SCALE

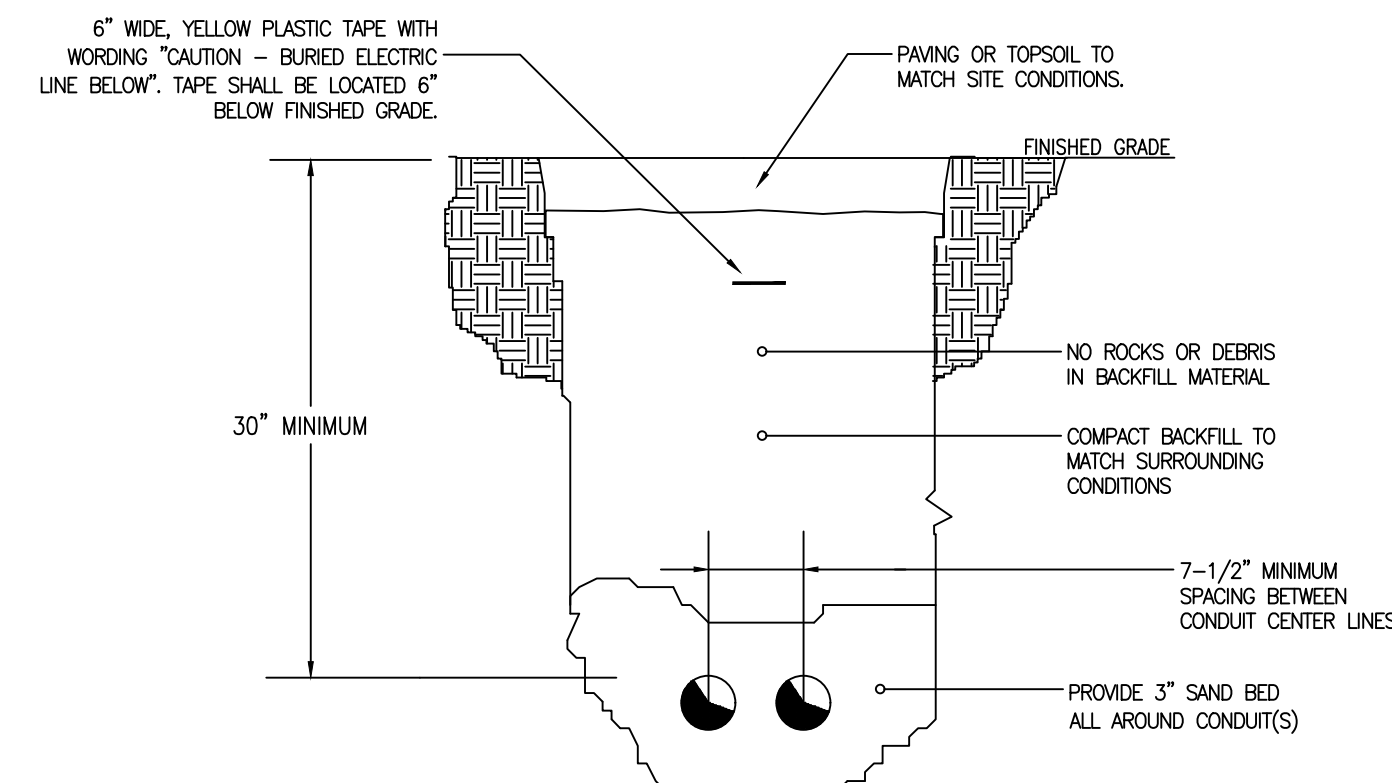

- GENERAL NOTES:**
- INSTALL CONDUIT SO BOTTOM OF DUCT IS AT PROPER ELEVATION.
  - PROVIDE PULLROPE IN ALL SPARE CONDUIT.
  - PROVIDE 42" GRC RIGID SWEEP ELBOWS FOR ALL BENDS.

**3** Typical Direct Burial Detail  
SCALE: NO SCALE

Issued:	Date:
A BKC Approval	10/29/2021
B Permit Set	1/21/2022
C Bid Set	1/24/2022
D Construction Set	3/14/2022
E	
Revisions:	
1 Addendum #1	02/08/22
2	
3	
4	
5	
6	
7	
8	
9	

Seal	Seal
PROJECT ARCHITECT/ENGINEER	DATE
PROJECT LEAD	DATE
PROJECT DESIGNER	DATE

Copyright ©2022  
APD Engineering & Architecture, LLC  
Drawing Alteration  
It is a violation of law for any person, unless acting under the direction of a licensed Architect, Professional Engineer, Landscape Architect, or Land Surveyor to alter any item on this document in any way. Any licensee who alters this document is required by law to affix his or her seal and to add the notation "Altered By" followed by his or her signature and the specific description of the alteration or revision.

**[DO NOT SCALE PLANS]**  
Copying, Printing, Software and other processes required to produce these prints can stretch or shrink the actual paper or layout. Therefore, scaling of this drawing may be inaccurate. Contact APD E&A with any need for additional dimensions or clarifications.



**Burger King Inc.**  
Store #  
322 Pottstown Ave  
Pennsburg, PA 18073  
Montgomery County  
Project Name & Location:

Site plan	
Drawing Name:	Project No.
Date: 11/8/2021	21-0327
Type: ROC-2502T	
Drawn By: MK	SE-1
Scale: As Noted	Drawing No.