



CHECK LIST NUMBER EXPLANATION:

THE CHECKLIST NUMBERS BELOW ALIGN WITH THE CREDIT NUMBERS IN THE YUM BLUELINE SYSTEM WEBSITE. FOR FURTHER DETAIL GO TO THE FOLLOWING WEB ADDRESS. NOTE: FOLLOW THE 'REQUIRED' AND 'OPTIONAL' DESIGNATION ON THIS SHEET RATHER THAN THE ONES ON THE YUMBLUELINE WEBSITE. THE SYSTEM HAS BEEN SETUP SO THAT IF YOU DO THE 'REQUIRED' ITEMS ON THIS LIST YOUR RESTAURANT WILL MEET THE YUMBLUELINE REQUIREMENTS.

- 1. GO TO THE REFERENCE VERSION OF THE YUM BLUELINE WEBSITE AT: WWW.YUMBLUELINE.COM
2. IN THE 'USER' SECTION CHOOSE 'GENERAL' FROM THE PULL DOWN MENU
3. IN THE 'PASSWORD' SECTION TYPE IN 'J212'/'KLA'

P = INDICATES THAT SCOPE IS ALREADY IN THE PROTOTYPE DRAWINGS
* = INDICATES OPTIONAL ITEMS

P = INDICATES THAT SCOPE IS ALREADY IN THE PROTOTYPE DRAWINGS
* = INDICATES OPTIONAL ITEMS

FEASIBILITY DESIGN CONSTRUCTION COMMISSIONING

FEASIBILITY DESIGN CONSTRUCTION COMMISSIONING

FEASIBILITY DESIGN CONSTRUCTION COMMISSIONING

Table with columns for project phases and rows for various categories like FORMALDEHYDE LIMITS, PRODUCT, VOC CONTENT LIMITS, COATING CATEGORY, and SPECIALTY COATINGS.

Table with columns for project phases and rows for various categories like RECYCLING, COOKING OIL RECYCLING, AIR VENTILATION, PROTECTION OF MATERIALS, and PAINTS AND COATINGS.

Table with columns for project phases and rows for various categories like CONTAMINATED SITES, LOCATION COMMITMENT, PAY UTILITIES DIRECTLY, and BUILDING WATER.

Table with columns for DATE and REMARKS, containing entry for 11.07.22 regarding construction.


CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0
GREEN
CHECKLIST
SHEET

G1.0

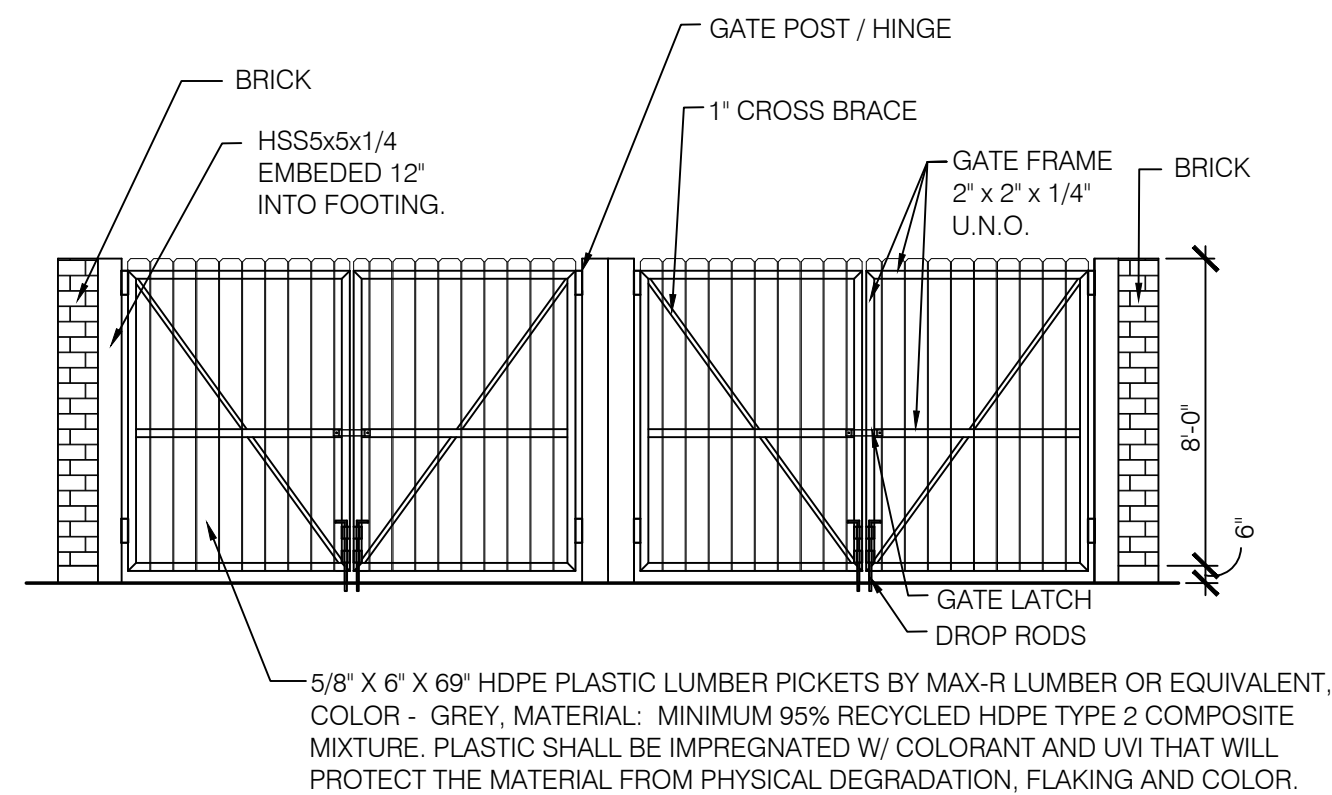

B ELEVATION
N.T.S.

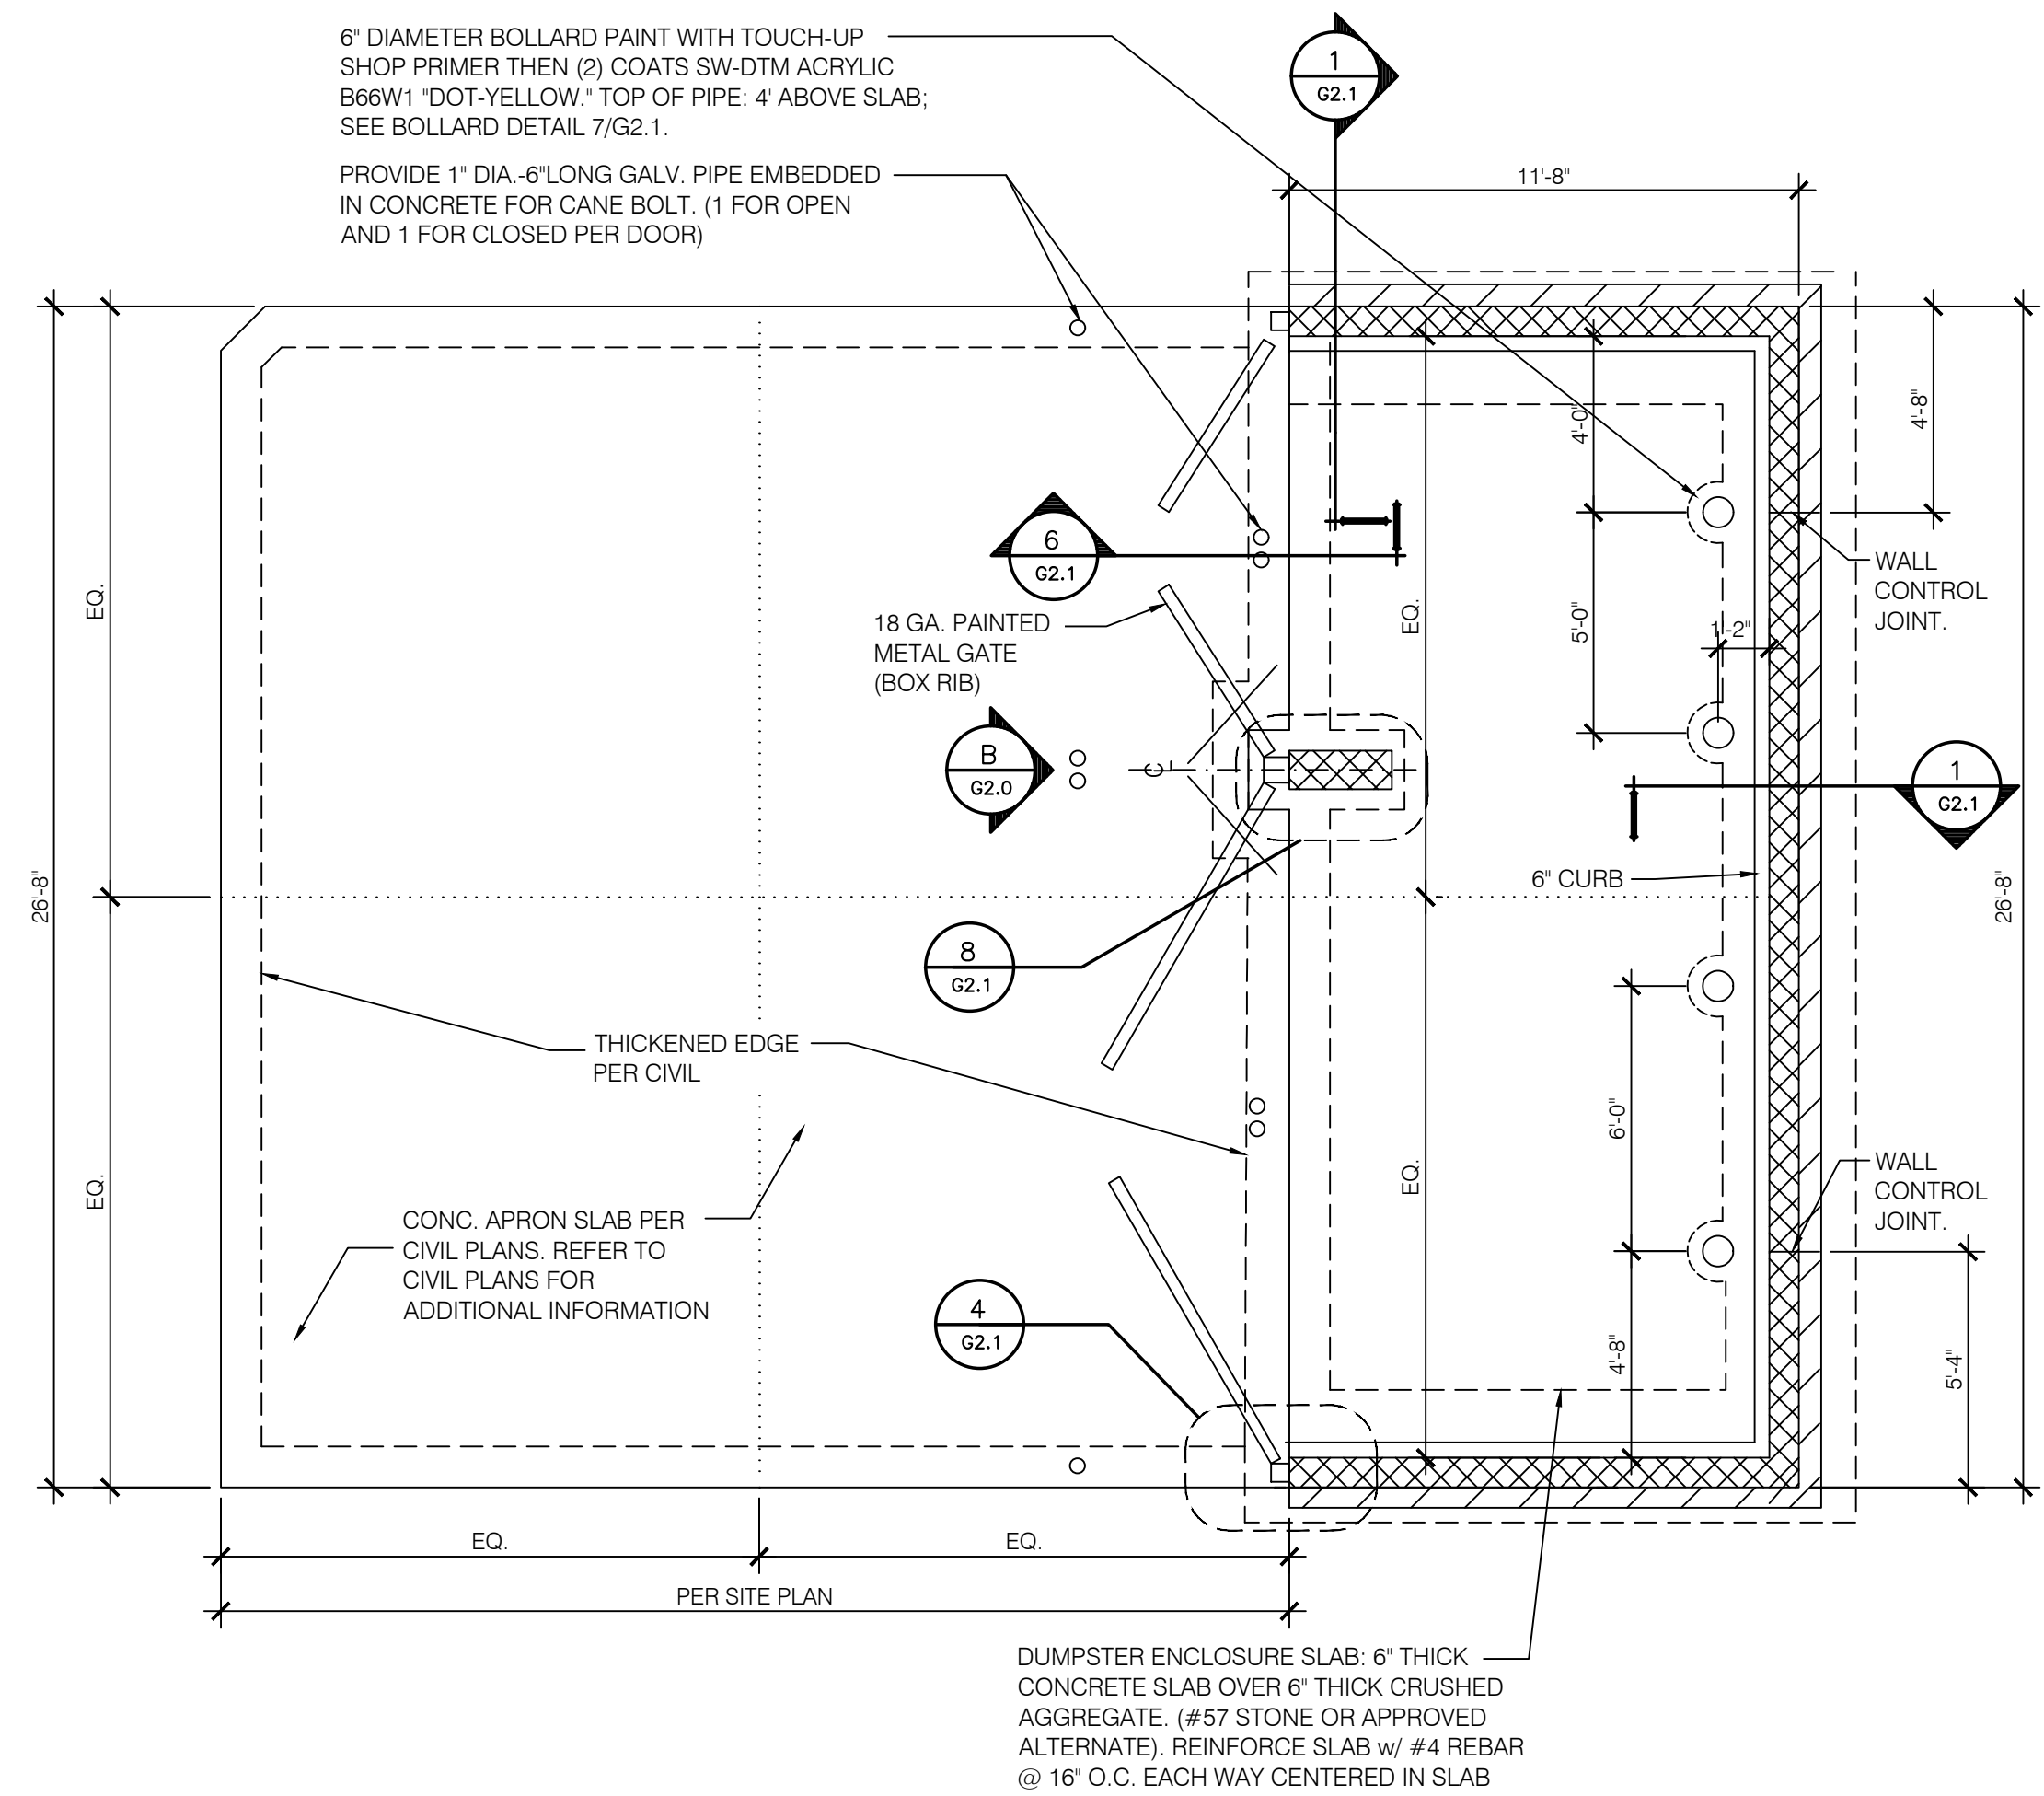

A DUMPSTER ENCLOSURE PLAN
N.T.S.

GENERAL NOTES:

- THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2015 MICHIGAN BUILDING CODE. MATERIALS AND SERVICES PROVIDED BY THE CONTRACTOR SHALL CONFORM TO THE ABOVE MENTIONED CODES AND THE CONTRACT SPECIFICATIONS.
- THE CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH THE JOB CONDITIONS AND RESTRICTIONS.
- IMPLEMENTATION OF JOB SITE SAFETY AND CONSTRUCTION PROCEDURES ARE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
- LOCATION SHALL BE APPROVED BY THE PUBLIC WORKS DEPARTMENT.
- AREAS SHALL BE ACCESSIBLE FOR DELIVERY AND COLLECTION.
- GATE LATCHES SHALL BE OF THE PLUNGER BAR TYPE OR EQUIVALENT AS APPROVED BY THE PUBLIC WORKS DEPARTMENT.

FOUNDATION NOTES:

- ALL SOILS WORK SHALL BE DONE IN ACCORDANCE WITH THE SPECIFICATIONS. ALL FOUNDATIONS SHALL BEAR ON ENGINEERED FILL AT OR EXCEEDING DEPTHS SHOWN ON THE DRAWINGS. INCREASE DEPTH AS REQ'D BY GEOTECHNICAL ENGINEER. ALL FOOTING EXCAVATIONS SHALL BE AS NEAT AS PRACTICAL. OVER-EXCAVATIONS IN DEPTH SHALL BE FILLED WITH CONCRETE, AND IN WIDTH MAY BE FILLED WITH LEAN CONCRETE OR COMPACTED, APPROVED BACKFILL. ALL LOOSE SOILS SHALL BE REMOVED FROM EXCAVATIONS PRIOR TO PLACEMENT OF REINFORCING OR CONCRETE.
- THE FOUNDATIONS HAVE BEEN DESIGNED FOR AN ALLOWABLE BEARING PRESSURE OF 3000 PSF ON APPROVED NATURAL SOILS OR PROPERLY PLACED, COMPACTED, AND TESTED ENGINEERED FILL.
- FOOTINGS SHALL EXTEND 3'-6" MINIMUM BELOW FINISH GRADE AND SHALL BE IN NATURAL SOIL OR CERTIFIED FILL.
- FOUNDATION DESIGN IS BASED ON THE GEOTECHNICAL REPORT PREPARED BY PSI INC DATED MAY 28, 2021 PSI PROJECT NO. 03811234.

GATE HARDWARE:

ALL HARDWARE AND ACCESSORIES SHALL BE HEAVY GALVANIZED.

GATE STOP:

MUSHROOM TYPE OR FLUSH PLATE WITH ANCHORS SET IN CONCRETE TO ENGAGE THE CENTER DROP ROD OR PLUNGER BAR.

GATE NOTES:

- 8'-0" HIGH MTL. GATES (SEE PLAN FOR WIDTH), PLASTIC LUMBER PICKETS FASTEN TO STEEL TUBE FRAME W/ STAINLESS STEEL SELF TAPPING SCREWS, 1" X 1" X 3/16" METAL ANGLE DIAGONAL BRACE. PRIME AND PAINT ALL STEEL COMPONENTS.

MASONRY NOTES:

- ALL BRICK MASONRY SHALL COMPLY WITH THE RECOMMENDATIONS OF BRICK INSTITUTE OF AMERICA (BIA AND LOCAL BUILDING CODE REQUIREMENTS).
- ALL CONCRETE MASONRY SHALL CONFORM TO 'BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES' (ACI 530-13/ASCE 5-13/TMS 402-13) AND 'SPECIFICATION FOR MASONRY STRUCTURES' (ACI 530-1-13/ASCE 6-13/TMS 602-13) AND LOCAL BUILDING CODE REQUIREMENTS.
- CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90, TYPE II.
- ASTM C270, TYPE 'S' MORTAR WITH A MINIMUM COMPRESSIVE STRENGTH OF 1800 PSI SHALL BE USED FOR ALL MASONRY WALLS EXCEPT TYPE 'N' MORTAR MAY BE USED FOR VENEER ONLY.
- GROUT TO FILL CORES SHALL BE ASTM C476, COARSE GROUT (3/8" MAXIMUM AGGREGATE) WITH A MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI IN 28 DAYS.
- REINFORCING BARS SHALL CONFORM TO ASTM A615, GRADE 60.
- LAY MASONRY UNITS WITH FULL MORTAR COVERAGE ON HORIZONTAL AND VERTICAL FACE SHELLS. BED WEBS IN MORTAR IN STARTING COURSE OF FOOTINGS AND IN ALL COURSES OF COLUMNS AND PILASTERS, AND WHERE ADJACENT TO CELLS OR CAVITIES TO BE REINFORCED OR FILLED WITH CONCRETE OR GROUT. BLOCKS TO BE STAGGERED (RUNNING BOND).
- VERTICAL REINFORCING LAP SPLICES SHALL BE 48 BAR DIAMETERS.
- PROVIDE HORIZONTAL LADDER TYPE JOINT REINFORCING WITH 9 GAGE SIDE AND CROSS RODS (GALVANIZED) SPACED AT 16" ON CENTER VERTICALLY. HORIZONTAL JOINT REINFORCING SHALL BE LAPPED A MINIMUM OF (2) CROSS BARS OR 6", WHICHEVER IS GREATER.
- MAXIMUM GROUT POUR SHALL BE 5 FEET. CONSOLIDATE BY MECHANICAL VIBRATION.
- MORTAR PROTRUSIONS, EXTENDING INTO CELLS OR CAVITIES TO BE REINFORCED AND FILLED, SHALL BE REMOVED. MORTAR PROTRUSIONS IN COLLAR-JOINT SHALL BE REMOVED.
- GROUT CORES SOLID A MINIMUM OF ONE COURSE BELOW ANY CHANGE IN WALL THICKNESS.
- THE COLLAR-JOINT IN MULTI-WYTHE WALLS BELOW GRADE SHALL BE FULLY GROUTED AS THE WALL IS CONSTRUCTED.
- WHERE THERE IS A CHANGE IN BOND BEAM ELEVATION, PROVIDE LAP BETWEEN BONDS BEAMS THROUGH 2 BARS OF VERTICAL REINFORCING OR 4 FEET, WHICHEVER IS GREATER.
- ALL CORNERS ARE TO BE TIED BY MASONRY BOND.
- ALL CELLS CONTAINING REINFORCING STEEL SHALL BE GROUTED.
- APPROVED GROUT STOPS ARE REQUIRED BELOW HORIZONTAL STEEL IN PARTIALLY GROUTED WALLS. BAGS, NEWSPAPERS, ETC. ARE NOT APPROVED GROUT STOPS.
- INITIAL BED JOINT SHALL BE 1/4" MIN. 1" MAX. SUBSEQUENT BED JOINTS SHALL BE 1/2" - MIN. 3/4" MAX.

CONCRETE NOTES:

- REINFORCED CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE 'BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE' (ACI 318-14) COMPLY WITH ASTM C94; ACI 301, SPECIFICATION FOR STRUCTURAL CONCRETE; ACI 117, 'SPECIFICATIONS FOR TOLERANCES FOR CONCRETE CONSTRUCTION AND MATERIALS'; AND CRSIS 'MANUAL OF STANDARD PRACTICE'.
- CAST-IN-PLACE CONCRETE SHALL HAVE A MINIMUM 4000 PSI 28 DAY COMPRESSIVE STRENGTH (FC).
- PROVIDE AIR ENTRAINMENT (6% ± 1%) FOR ALL CONCRETE EXPOSED TO FREEZE/THAW IN ACCORDANCE WITH ASTM C 260.
- DESIGN MIXES: SUBMIT DESIGNS FOR EACH CONCRETE MIX FOR THE PROJECT PER CHAPTER 5 OF ACI 318-14.
- CONCRETE SHALL BE NORMAL WEIGHT CONCRETE (145 PCF) WITH CEMENT CONFORMING TO ASTM C150, TYPE I.
- AGGREGATE SHALL CONFORM TO ASTM C33 FOR NORMAL WEIGHT CONCRETE. PRIOR TO CONCRETE PLACEMENT, THE CONTRACTOR SHALL SUBMIT A CONCRETE MIX DESIGN PREPARED IN ACCORDANCE WITH THE SPECIFICATIONS TO THE ARCHITECT FOR REVIEW.
- CONCRETE PRACTICES SHALL BE FOLLOWED FOR COLD WEATHER/HOT WEATHER CONSTRUCTION IN ACCORDANCE WITH ACI 305 & 306.
- REINFORCING BARS SHALL CONFORM TO ASTM A615, GRADE 60.
- PROVIDE CORNER BARS AT ALL LOCATIONS WHERE REINFORCEMENT CHANGES DIRECTION. PROVIDE STRAIGHT AND DIAGONAL BARS AT EDGES OF ALL OPENINGS.
- REINFORCEMENT SHALL BE DETAILED, FABRICATED, AND PLACED IN ACCORDANCE WITH THE A.C.I. 'DETAILING MANUAL NO. SP-66'. SUBMIT STEEL REINFORCEMENT SHOP DRAWINGS, INCLUDING DETAILS OF FABRICATION, BENDING, AND PLACEMENT, PREPARED ACCORDING TO ACI 315, DETAILS AND DETAILING OF CONCRETE REINFORCEMENT."
- REINFORCEMENT SHALL BE SECURELY HELD IN PLACE WHILE PLACING CONCRETE. IF REQUIRED, ADDITIONAL BARS, STIRRUPS, OR CHAIRS SHALL BE PROVIDED BY THE CONTRACTOR TO FURNISH SUPPORT FOR BARS.
- REINFORCING BARS SHALL HAVE THE FOLLOWING MINIMUM CONCRETE COVER:
CAST AGAINST EARTH: 3"
EXPOSED TO EARTH OR WEATHER (#5 OR SMALLER): 1 1/2"
EXPOSED TO EARTH OR WEATHER (#6 OR LARGER): 2"
CONCRETE NOT EXPOSED TO WEATHER: 3/4"
- LEVELING GROUT SHALL BE NON-SHRINK, NON-METALLIC TYPE, FACTORY PREMIXED GROUT IN ACCORDANCE WITH ASTM C109, WITH FC OF NOT LESS THAN 5000 PSI.
- ANCHOR RODS SHALL BE ASTM F1554, GRADE 36 (GALVANIZED).
- PROVIDE SAW-CUT CONTROL JOINTS IN THE CONCRETE SLAB AS SHOWN ON THE DRAWINGS. IF NOT SPECIFIED ON THE DRAWINGS, PROVIDE 1/8" WIDE x 1" DEEP SAW-CUT CONTROL JOINTS WITH THE FOLLOWING PROVISIONS: JOINTS SHALL BE LOCATED AT EACH BUILDING COLUMN AND SLAB DISCONTINUITY AND SHALL BE EQUALLY SPACED IN BOTH DIRECTIONS WITH A MINIMUM SPACING OF 10'-0" AND A MAXIMUM JOINT SPACING OF 12'-0".
- SLAB FINISHES: COMPLY WITH ACI 302.1R FOR SCREEDING, RESTRAIGHTENING, AND FINISHING OPERATIONS FOR CONCRETE SURFACES. DO NOT WET CONCRETE SURFACES. PROVIDE THE FOLLOWING FINISHES:
17.1. SMOOTH-FORMED FINISH FOR CONCRETE EXPOSED TO VIEW, COATED, OR COVERED BY WATERPROOFING OR OTHER DIRECT-APPLIED MATERIAL; ROUGH-FORMED FINISH ELSEWHERE.

STEEL NOTES:

- STRUCTURAL STEEL WORK SHALL BE IN ACCORDANCE WITH THE A.I.S.C. 'SPECIFICATIONS FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS' (FOURTEENTH EDITION) AND THE 'CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES' EXCEPT SECTION 4.2 OF THE CODE WHICH SHALL NOT BE APPLICABLE TO THIS PROJECT.
- STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING:
2.1. CHANNELS, ANGLES, PLATES AND MISCELLANEOUS CONNECTION MATERIAL: ASTM A-36 WITH A MINIMUM YIELD STRENGTH OF 36,000 PSI, UNO.
2.2. STEEL TUBING: ASTM A500, GRADE B, WITH A MINIMUM YIELD STRENGTH OF 46,000 PSI.
- NUTS SHALL CONFORM TO ASTM A563 HEAVY HEX CARBON STEEL.
- WASHERS SHALL CONFORM TO ASTM F436 HARDENED CARBON STEEL.
- BOLTS, NUTS, & WASHERS SHALL BE FURNISHED WITH ZINC COATING IN ACCORDANCE WITH ASTM A153.
- WELDING SHALL BE IN ACCORDANCE WITH THE STRUCTURAL WELDING CODE ANSI/AWS D1.1, AMERICAN WELDING SOCIETY. USE E70XX ELECTRODES.
- STEEL EXPOSED TO THE EXTERIOR SHALL BE HOT DIPPED GALVANIZED ACCORDING TO ASTM A123.
- DO NOT PAINT STEEL WHERE ENCASED WITH CONCRETE, OR AT FIELD WELD AREAS.
- NONMETALLIC SHRINKAGE-RESISTANT GROUT: PRE-MIXED, NONCORROSIVE, NONSTAINING PRODUCT CONTAINING SELECTED SILICA SANDS, PORTLAND CEMENT, SHRINKAGE COMPENSATING AGENTS, PLASTICIZING AND WATER REDUCING AGENTS, COMPLYING WITH CE-CRD C621.
- THE STRUCTURAL STEEL FABRICATOR, AND/OR GENERAL CONTRACTOR, SHALL VERIFY EXISTING DIMENSIONS AND CONDITIONS AT THE SITE. ANY DISCREPANCY FOUND SHALL BE REPORTED TO THE ARCHITECT PRIOR TO PREPARATION OF SHOP DRAWINGS. DRAWINGS SHALL INCLUDE FIELD MEASUREMENTS AND CONDITIONS.

SPECIAL INSPECTIONS:

SPECIAL INSPECTIONS ARE TO BE PROVIDED IN ACCORDANCE WITH SECTION 1704. SPECIAL INSPECTIONS SHALL BE IN ADDITION TO THE INSPECTIONS CONDUCTED BY THE DEPARTMENT OF BUILDING SAFETY AND SHALL NOT BE CONSTRUED TO RELIEVE THE OWNER OR HIS AUTHORIZED AGENT FROM REQUESTING THE PERIODIC AND CALLED INSPECTIONS REQUIRED BY THE BUILDING CODE. SPECIAL INSPECTION SHALL BE PAID BY THE OWNER.

REQUIRED SPECIAL INSPECTIONS:

IN ADDITION TO THE REGULAR INSPECTIONS, THE FOLLOWING ITEMS WILL ALSO REQUIRE SPECIAL INSPECTION IN ACCORDANCE WITH THE BUILDING CODE.

- SOILS COMPLIANCE PRIOR TO FOUNDATION INSPECTION (COMPACTING FILL, SPECIAL GRADING)
- STRUCTURAL CONCRETE OVER 2,500 PSI
- MASONRY

SPECIAL INSPECTOR SHALL MEET THE QUALIFICATIONS AS STATED IN THE BUILDING CODE AND SHALL PERFORM THE DUTIES AND RESPONSIBILITIES AS OUTLINED IN THE BUILDING CODE. THE SPECIAL INSPECTOR SHALL PROVIDE INSPECTION REPORTS TO THE CODE OFFICIAL, ENGINEER AND OWNER.

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY: RS
JOB NO.: 2020088.03

TACO BELL


18550 E. WARREN AVE
DETROIT, MI 48236




**ENDEAVOR 2.0
TRASH
ENCLOSURE
DETAILS**

G2.0


PLOT DATE:

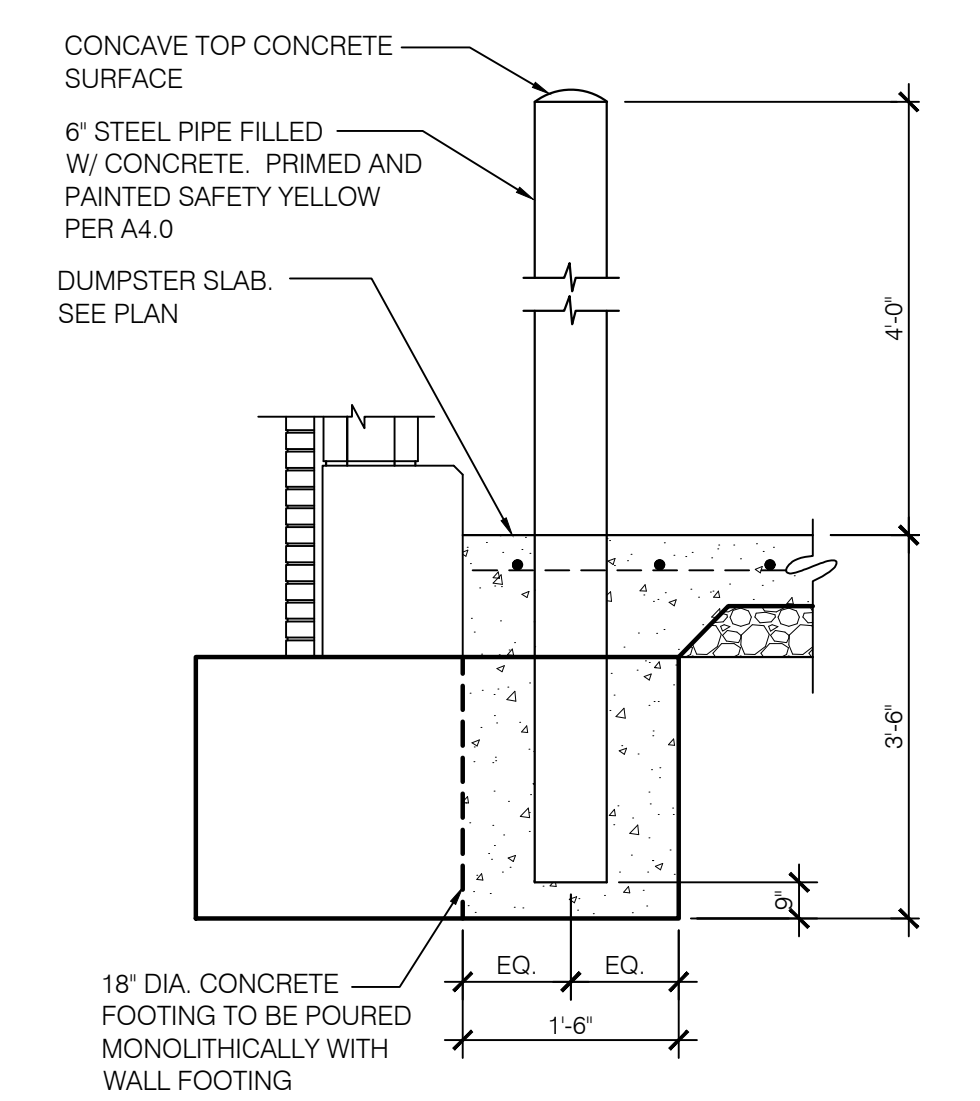


7 BOLLARD DETAIL
3/4"=1'-0"

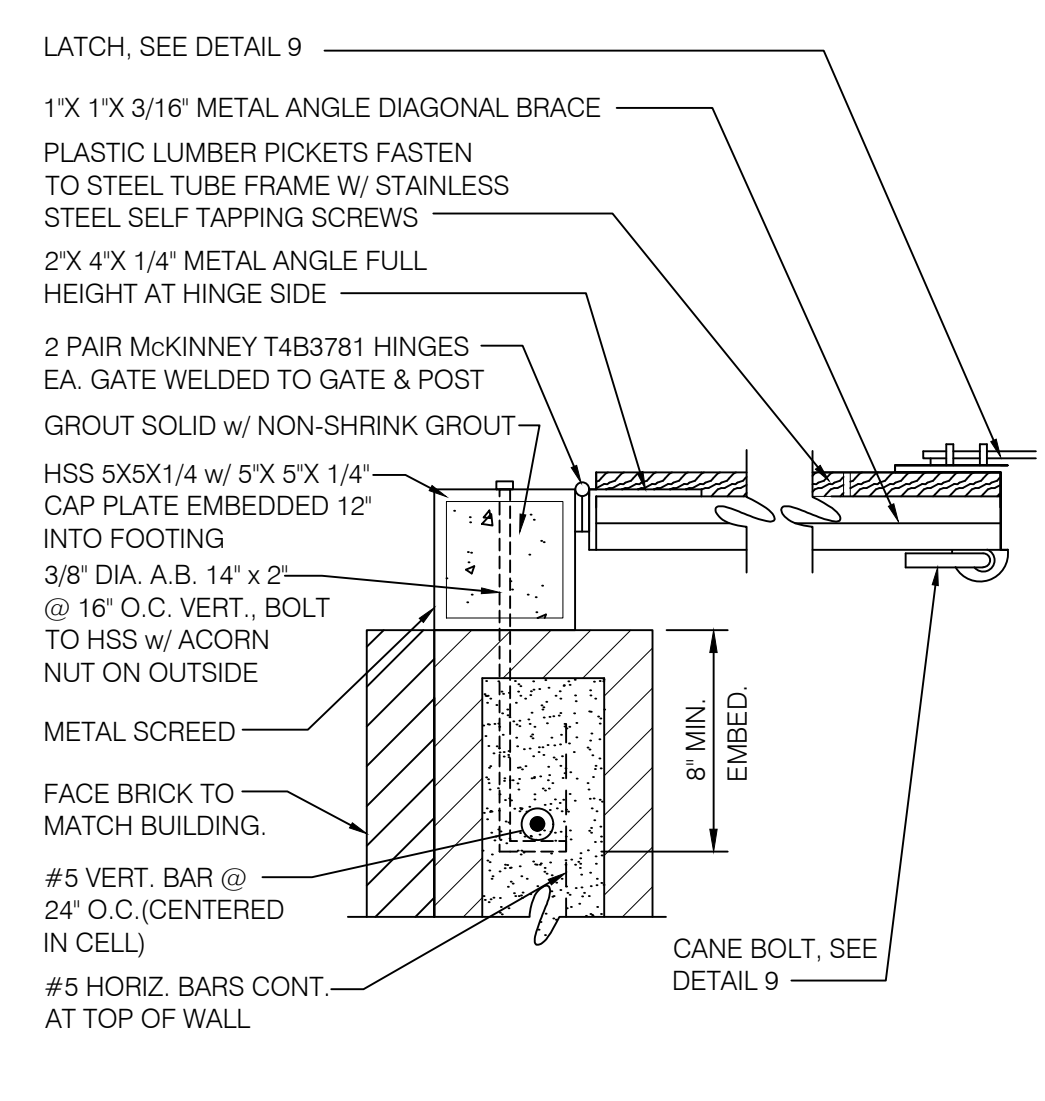


4 JAMB DETAIL - PLAN
N.T.S.

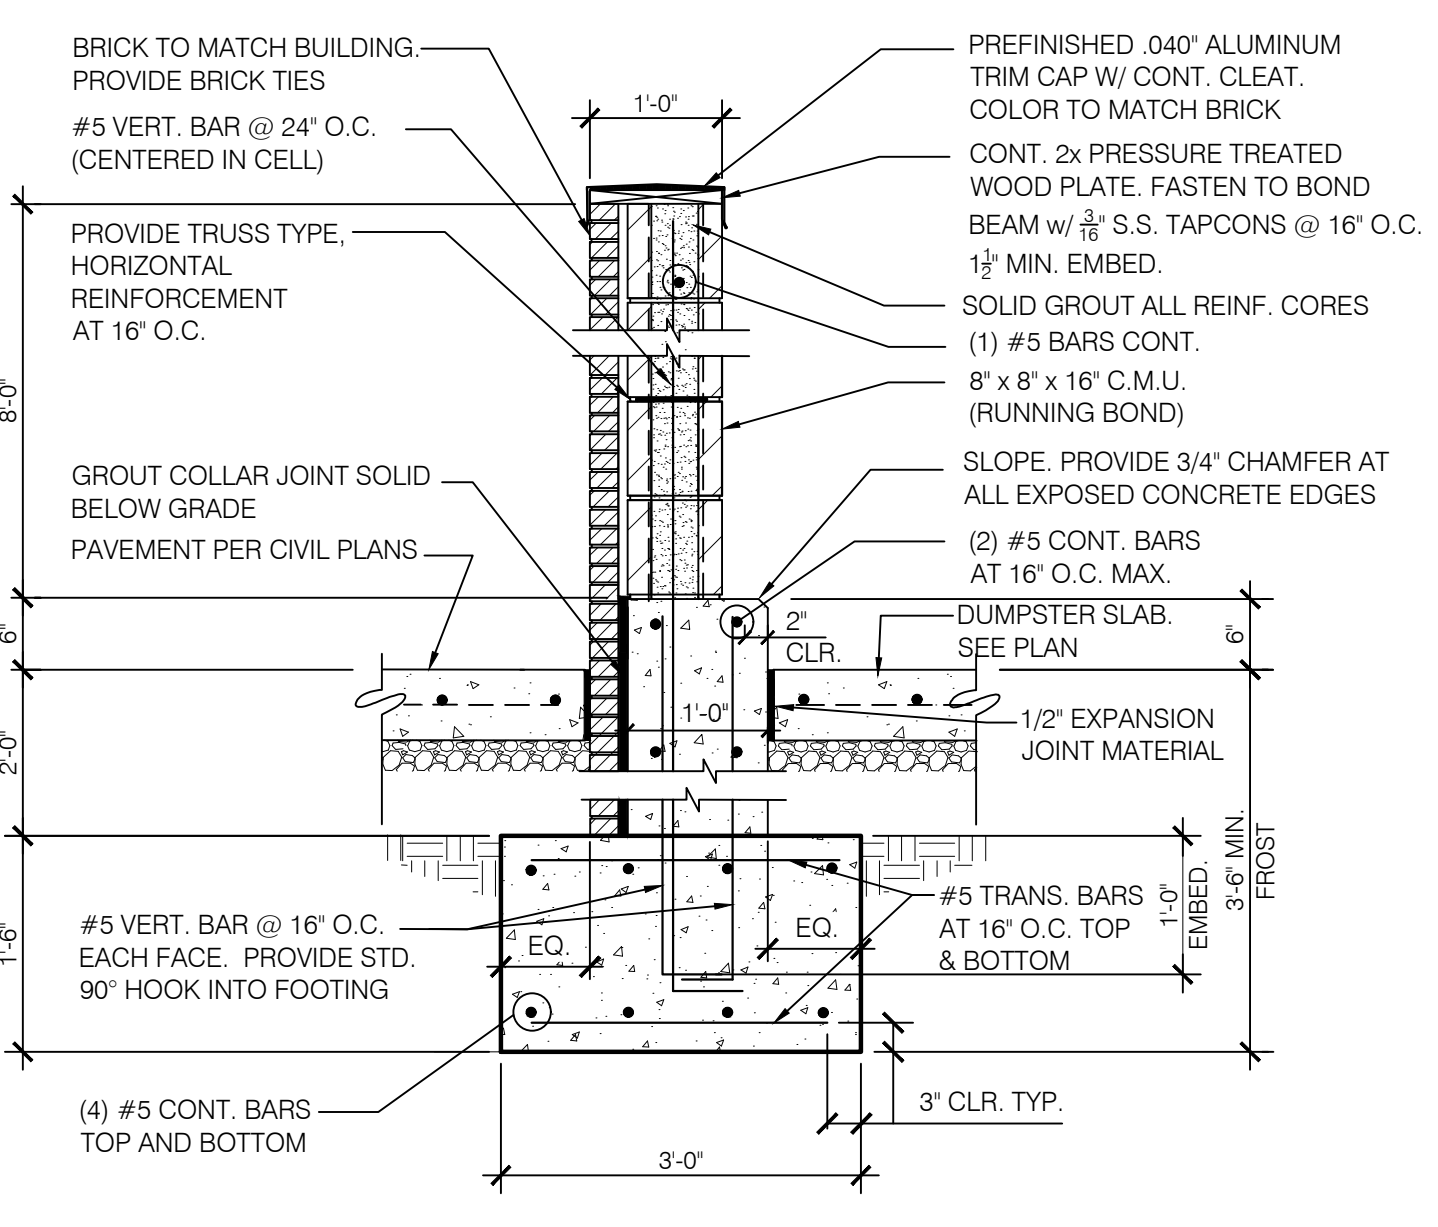


1 DUMPSTER ENCLOSURE WALL SECTION
3/4"=1'-0"

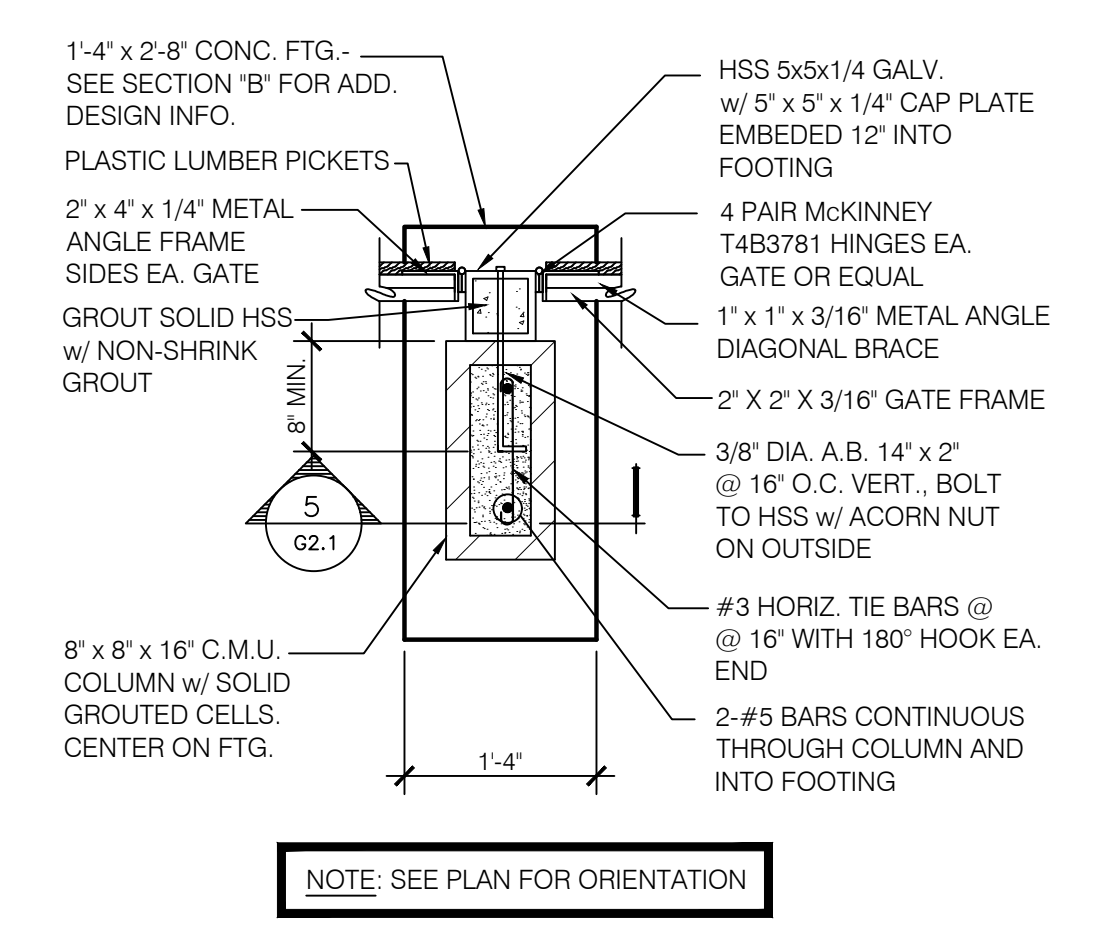


8 JAMB DETAIL - PLAN
3/4"=1'-0"

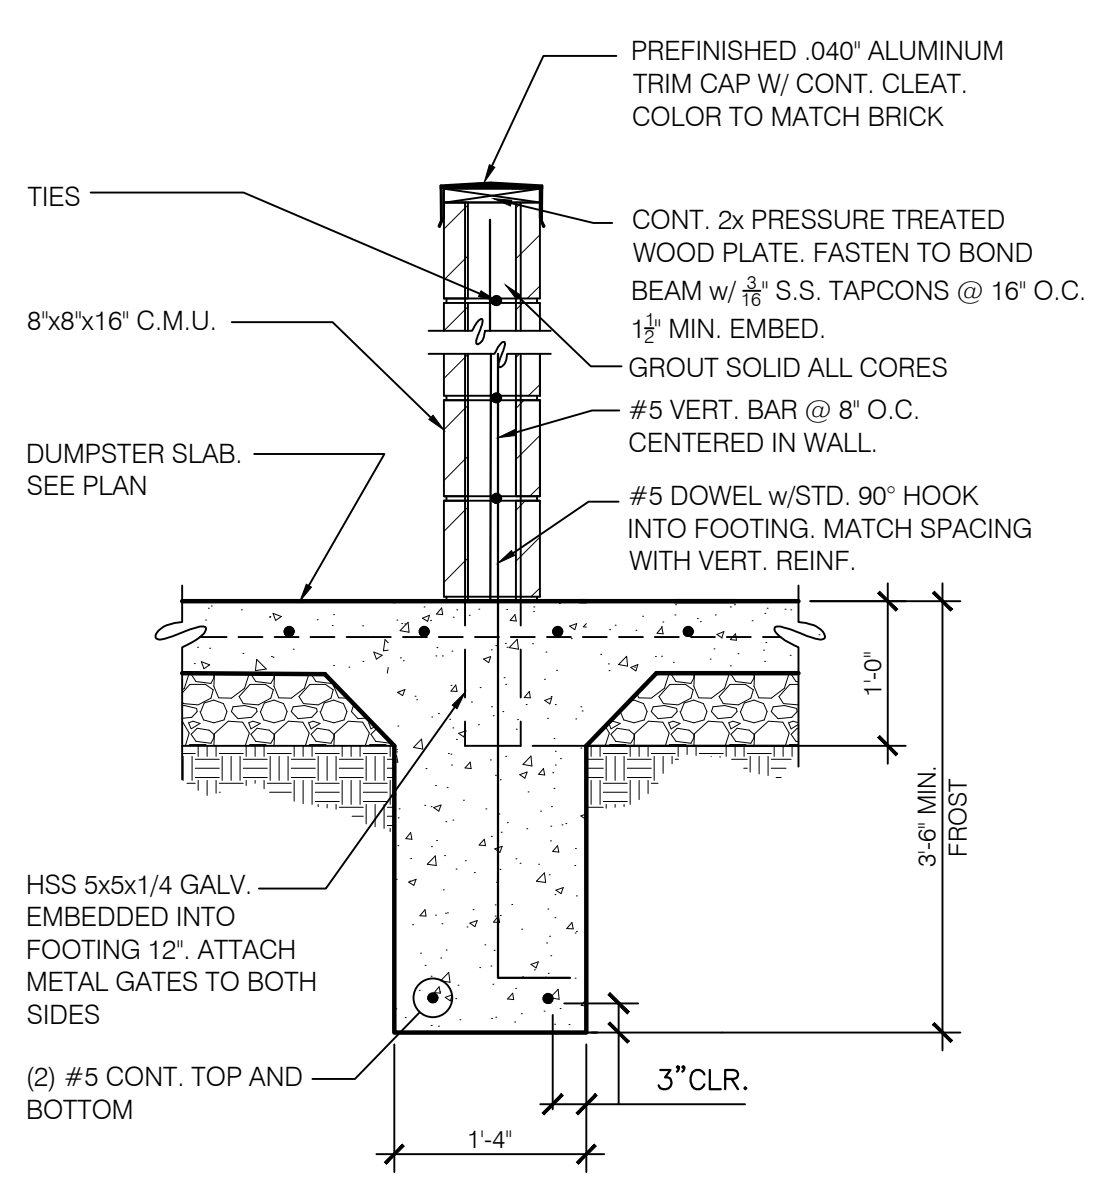


5 SECTION
3/4"=1'-0"

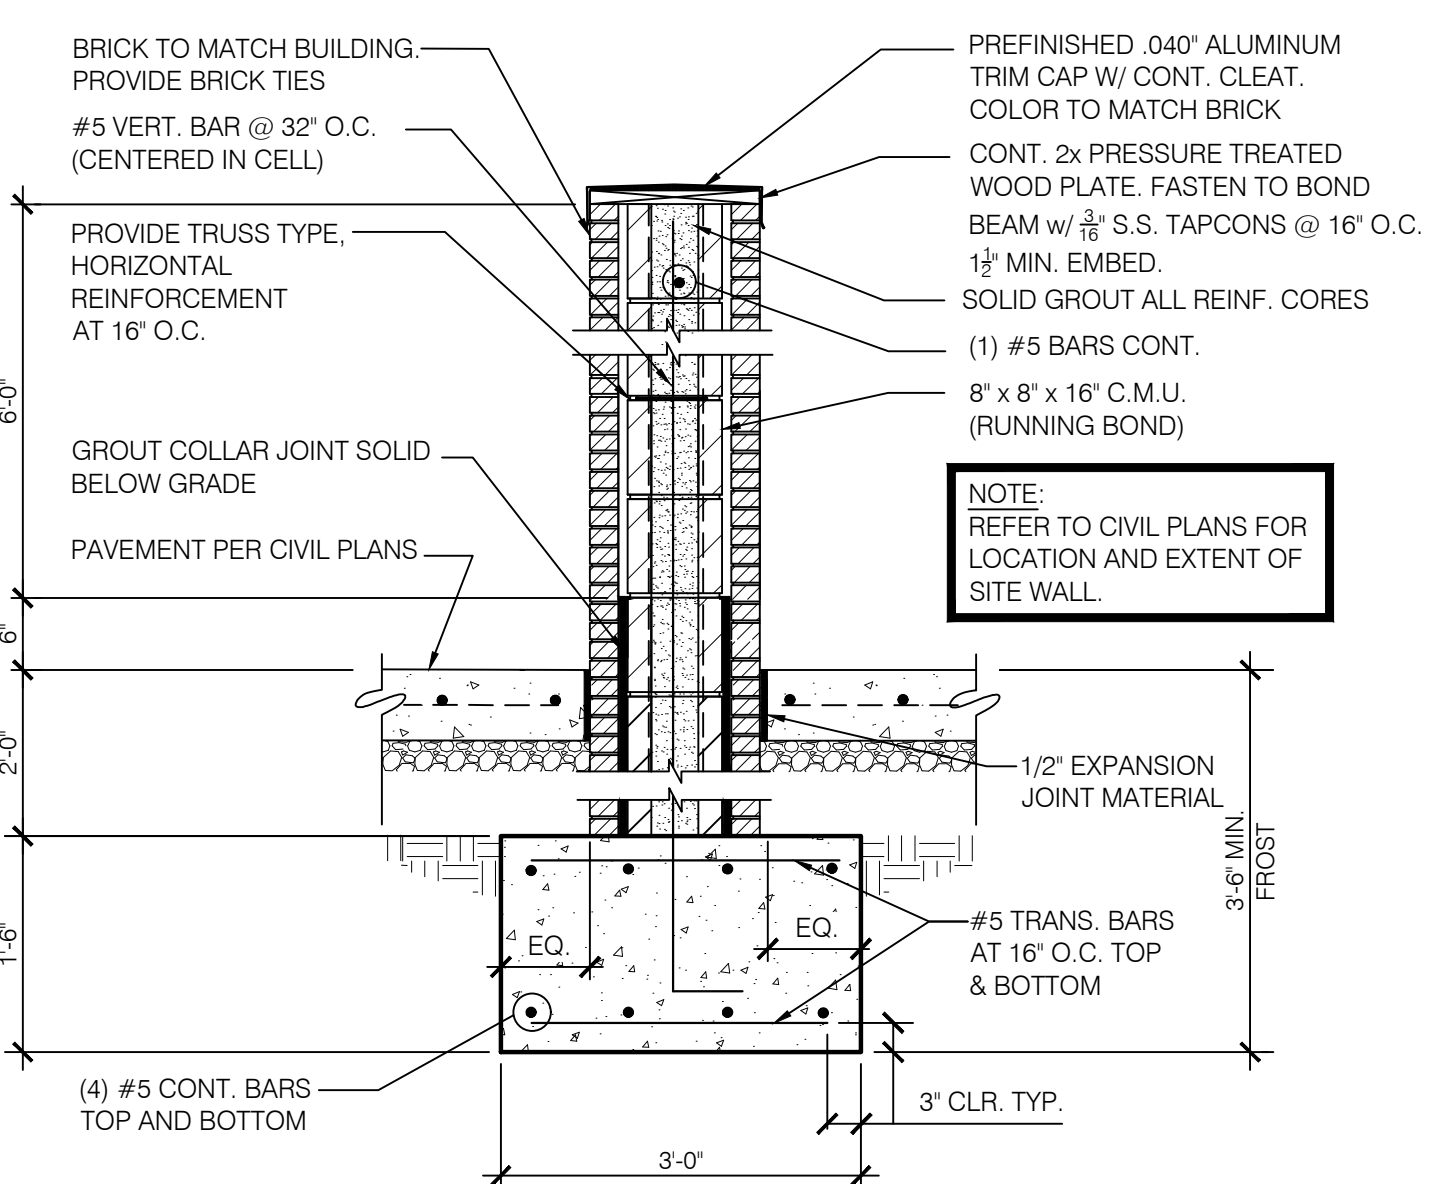


2 SITE WALL SECTION
3/4"=1'-0"

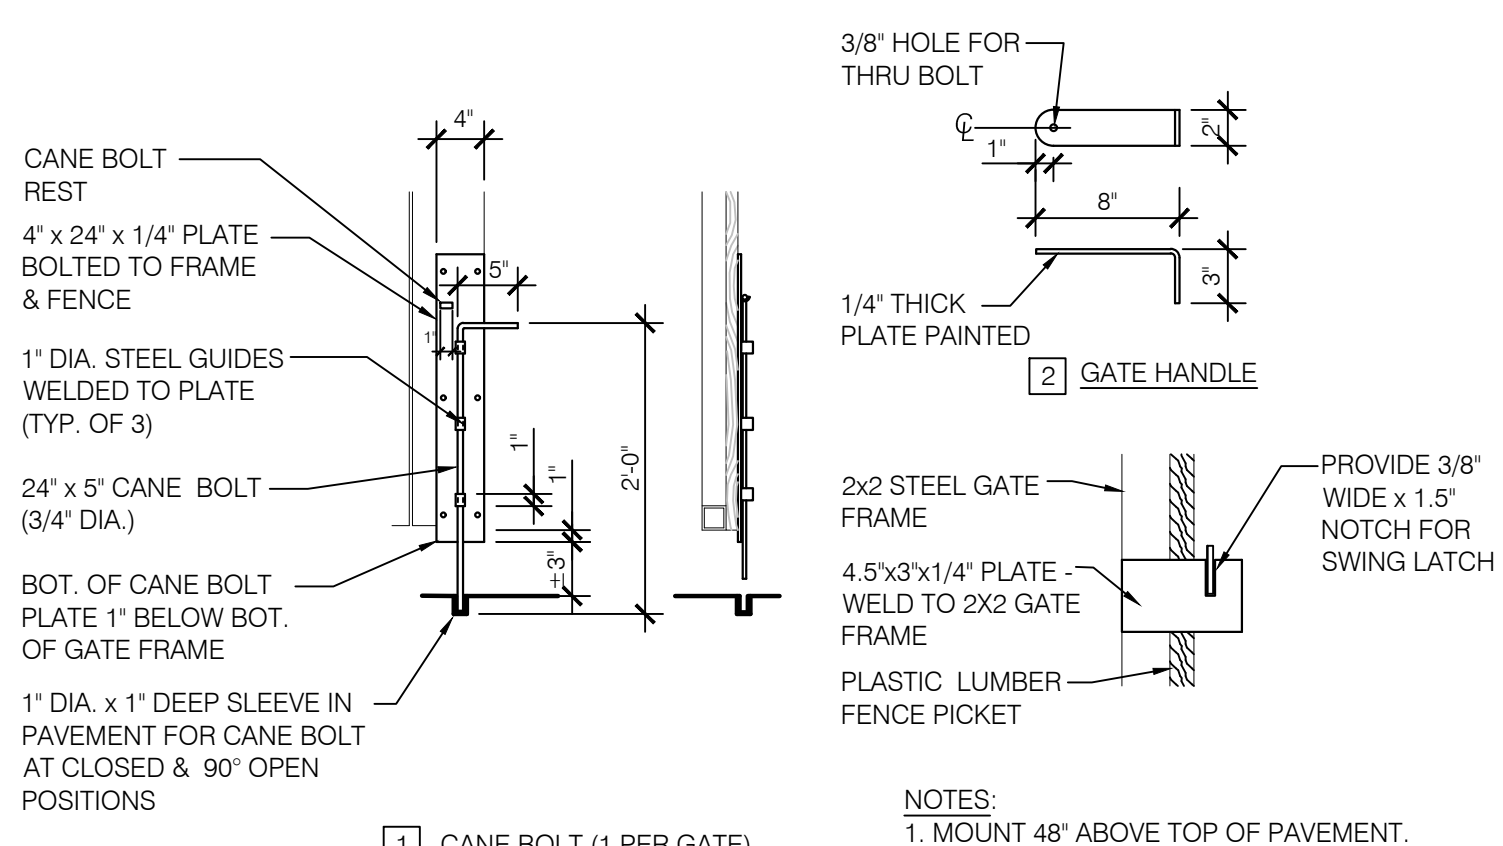

9 GATE DETAIL
N.T.S.

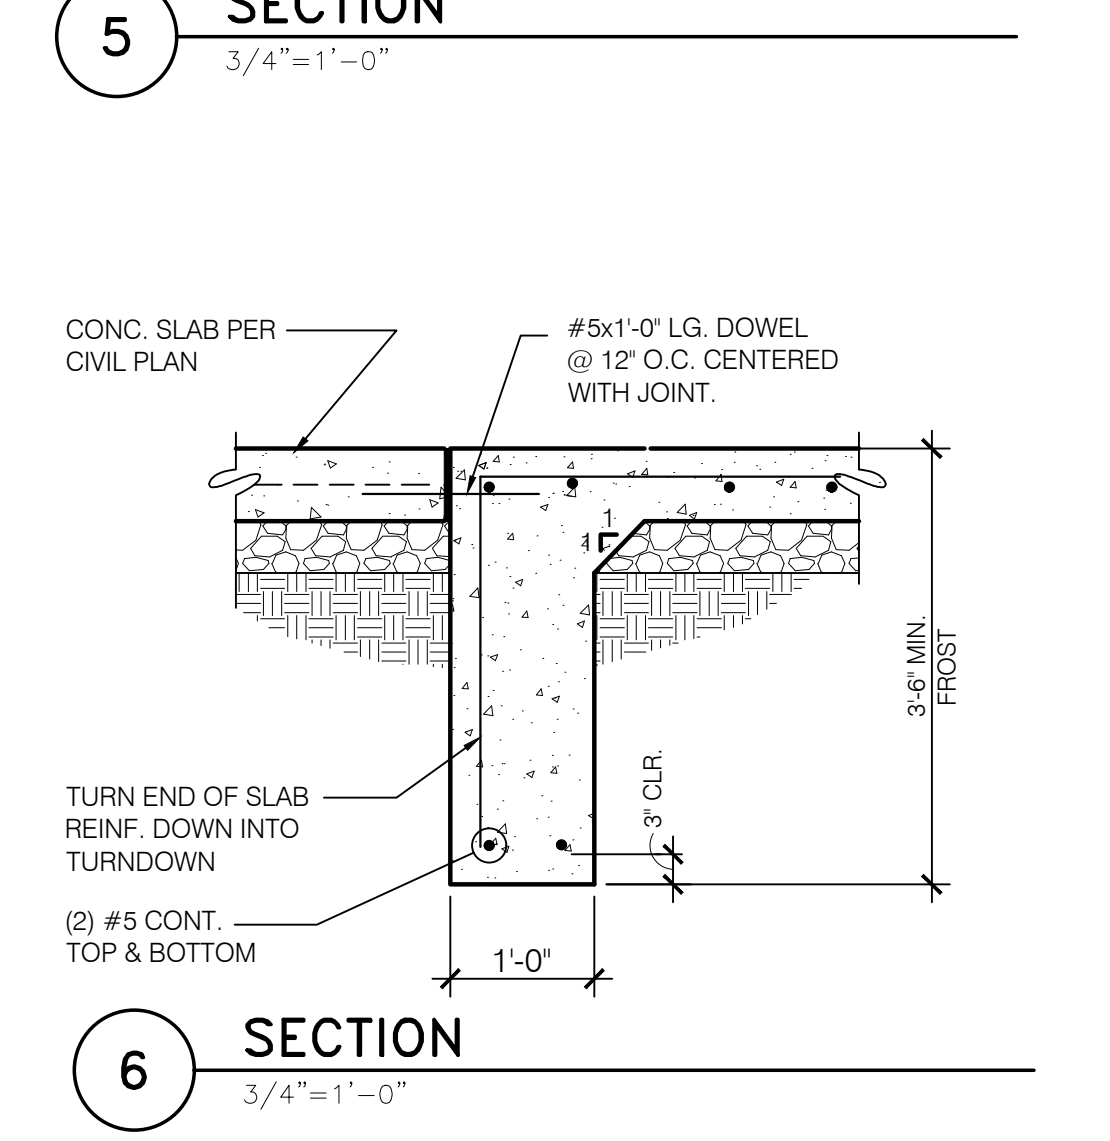

6 SECTION
3/4"=1'-0"

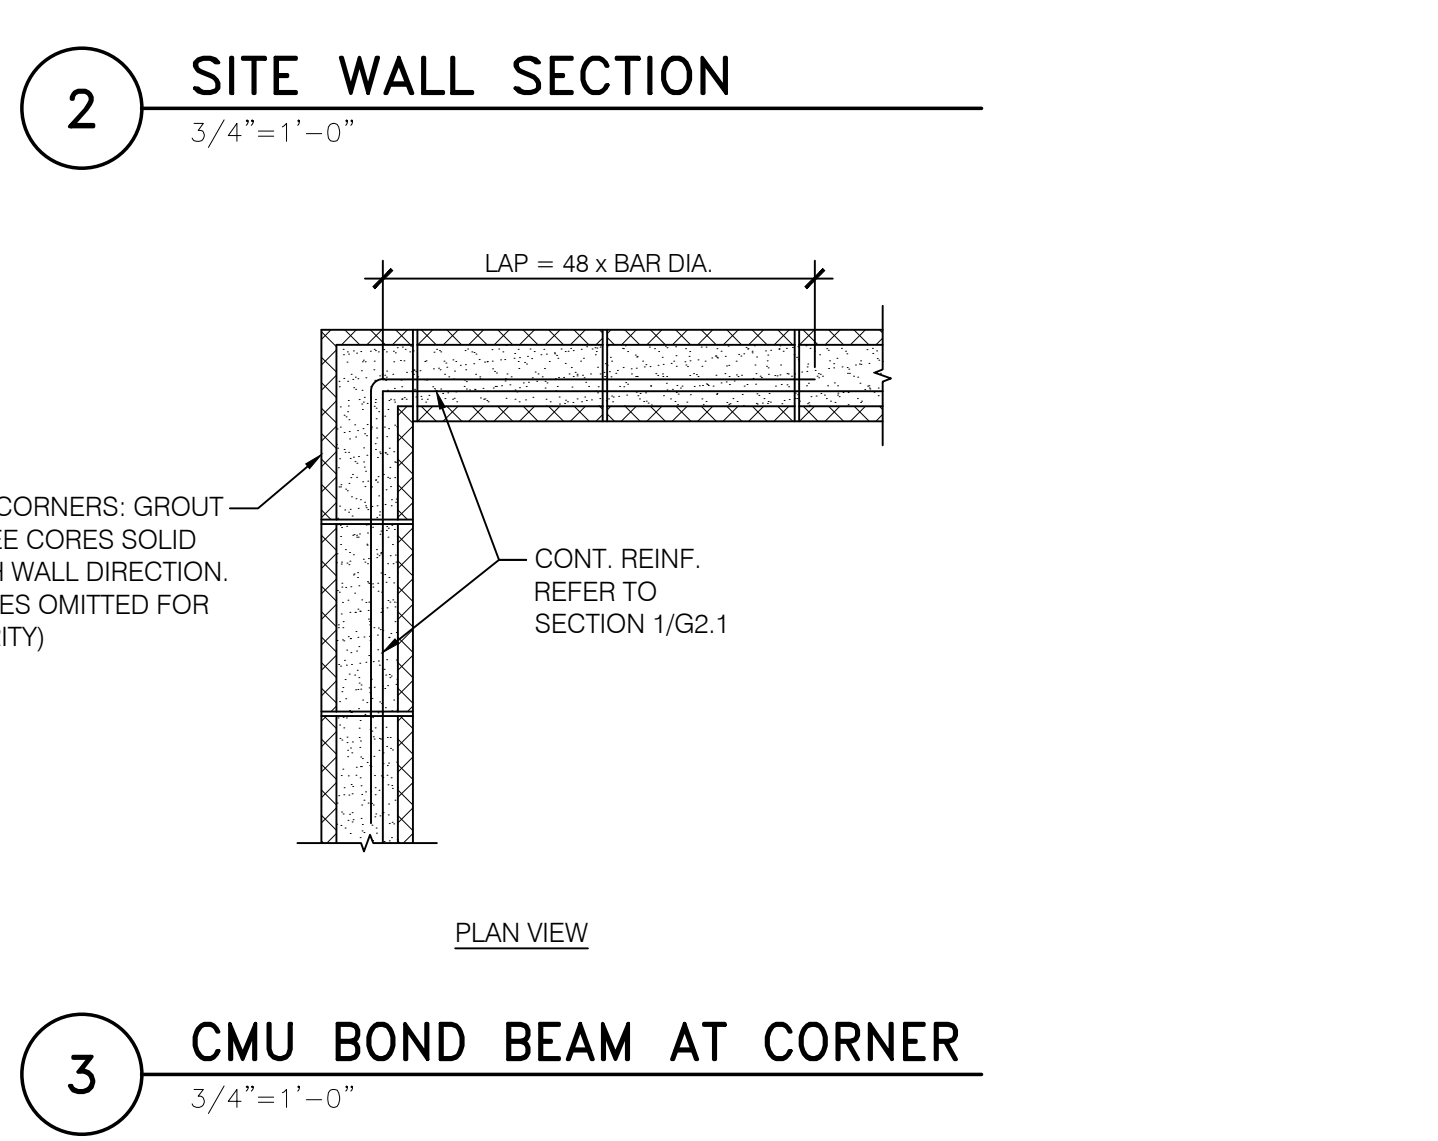

3 CMU BOND BEAM AT CORNER
3/4"=1'-0"

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY: RS
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



**ENDEAVOR 2.0
TRASH
ENCLOSURE
DETAILS**

G2.1

PLOT DATE:

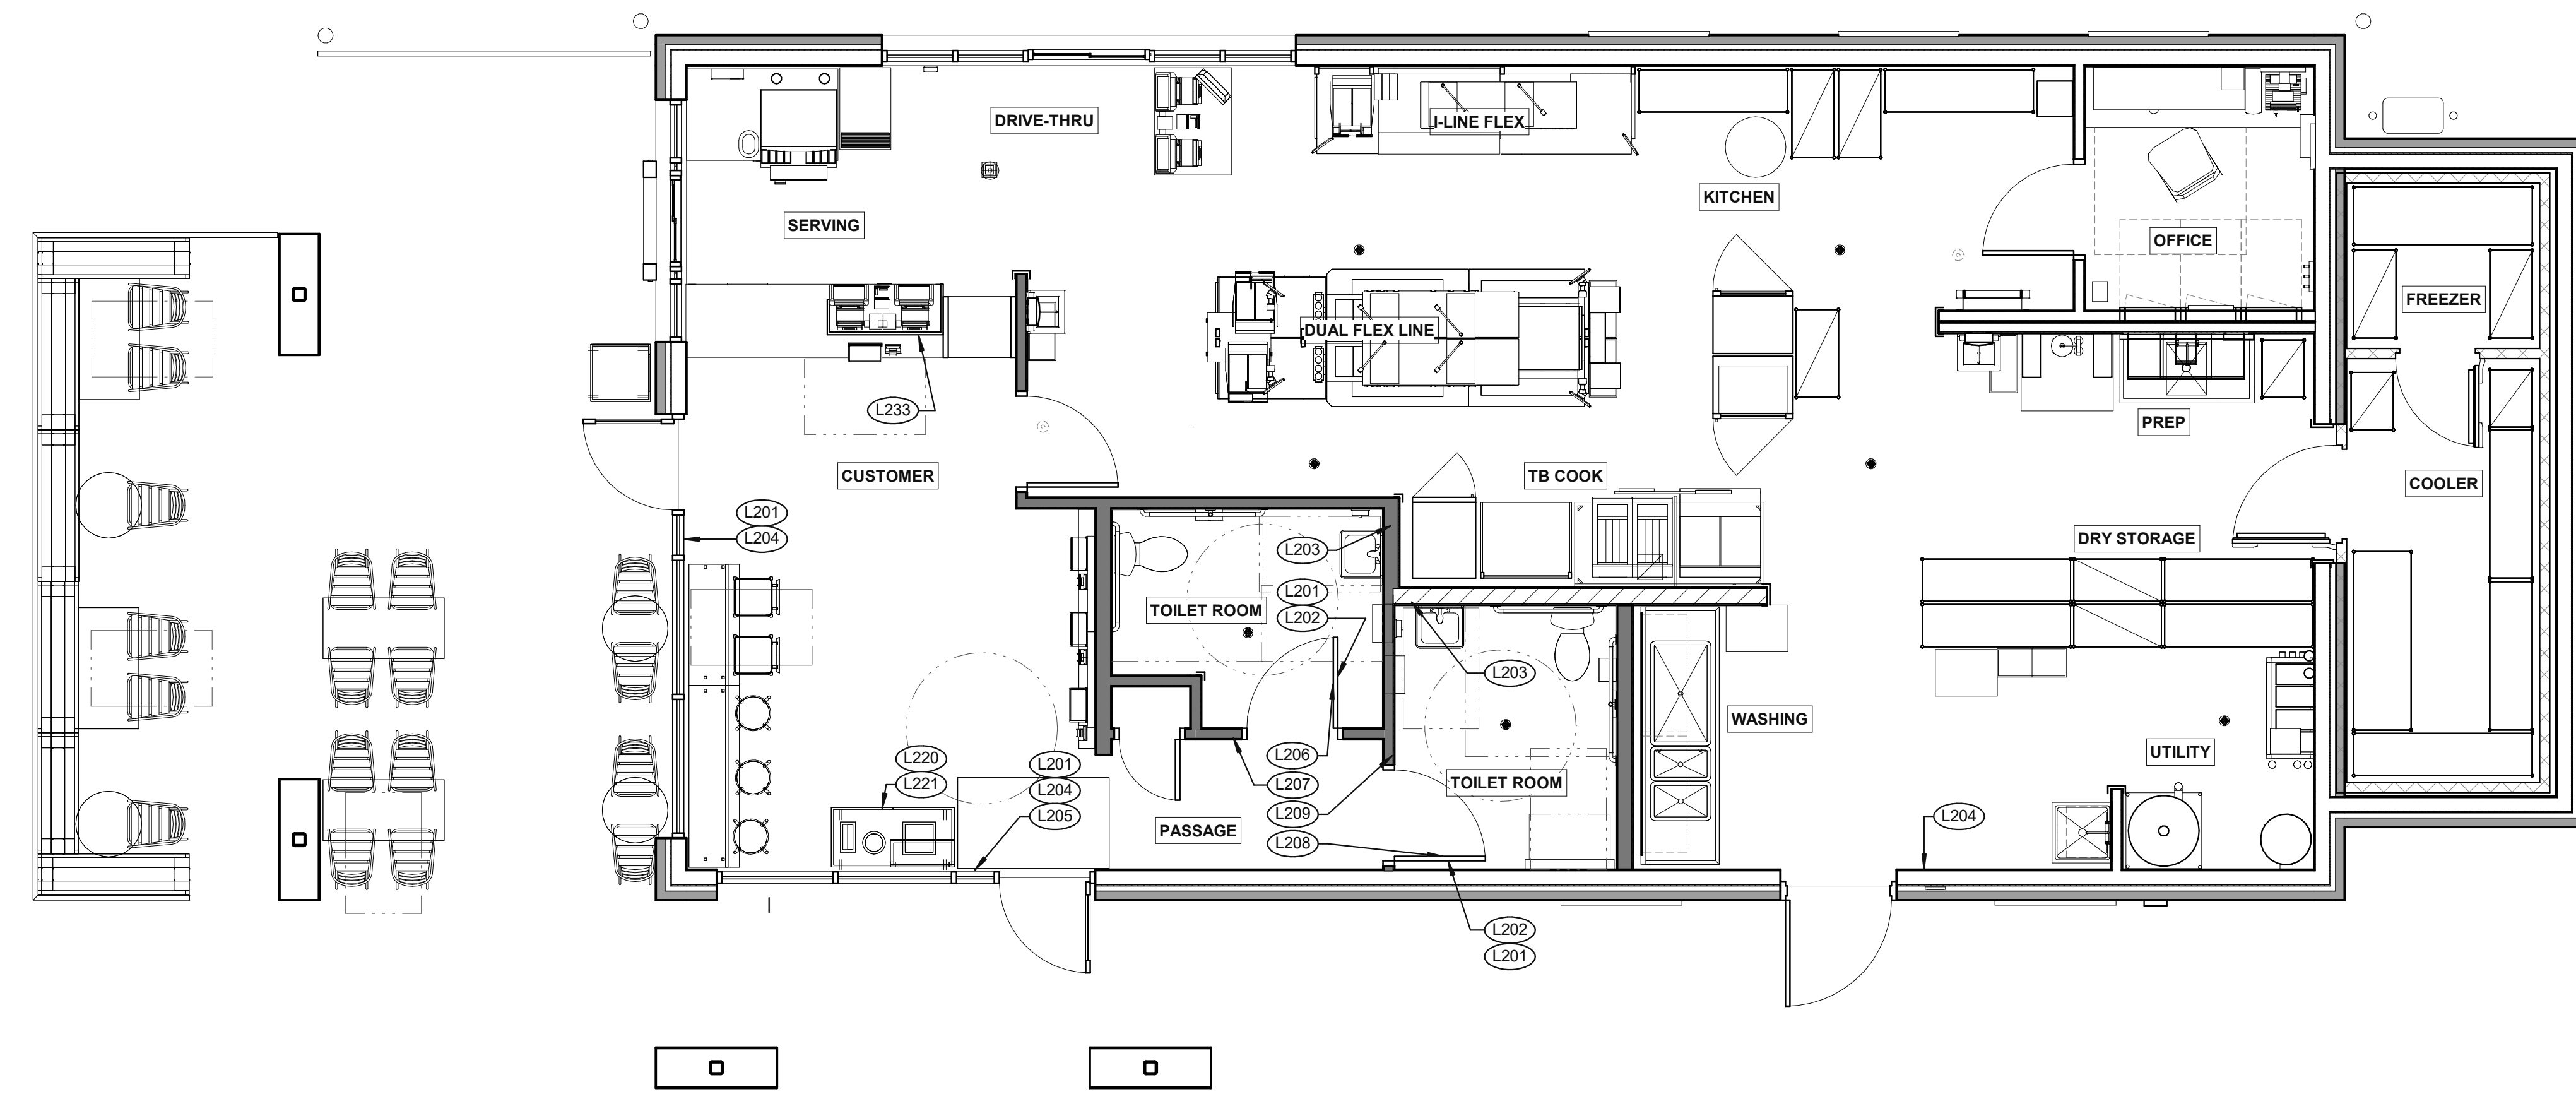

SIGNAGE PLAN 1/4" = 1'-0" 1

TAG	SIGN DESCRIPTION	SIGN VERBIAGE	SIZE	MOUNTING HEIGHT	QTY	LOCATION IN RESTAURANT
L201	Smoking	No Smoking or electronic cigarette use. This is a smoke free establishment	1/16 x 9 x 6	48" MIN. A.F.F. 60" MAX. A.F.F.	4	1 back of each restroom door, 1 at each door
L202	Clean Restroom	To our customers: We check our restrooms every 30 minutes to make sure they are always ready for you. If we have missed something, please tell our manager on duty. Thank you	1/16 x 6 x 9	60" A.F.F.	2	1 inside each restroom (back of restroom door)
L203	Hand Wash Notice	Employees must wash hands before returning to work	1/16 x 6 x 6	60" A.F.F.	2	1 inside each restroom near sink
L204	Exit (w/ Braille)	Exit	1/16 x 6 x 6	60" A.F.F.	3	1 at each exit, mounted on wall, according to ADA guidelines
L205	Occupancy	Maximum occupancy xxx persons	1/16 x 6 x 6	8'-0" to center of sign	1	Above customer exit. Only 1 is needed
L206	Men's Restroom Triangle (W/B)	INFOGRAPHIC of male	1/4 x 12 x 12	60" A.F.F.	1	Mounted on men's restroom door
L207	Men's Restroom (w/ Braille)	INFOGRAPHIC of male and braille to read: Men's restroom	1/4 x 10 x 6.5	60" A.F.F.	1	Mounted on wall next to restroom door. refer to plans and ADA guidelines for exact location
L208	Women's Restroom Circle (W/B)	INFOGRAPHIC of female	1/4 x 12 x 12	60" A.F.F.	1	Mounted on women's restroom door
L209	Women's Restroom (w/ Braille)	INFOGRAPHIC of female and braille to read: Women's restroom	1/4 x 10 x 6.5	60" A.F.F.	1	Mounted on wall next to restroom door. refer to plans and ADA guidelines for exact location
L233	If you need assistance? ADA	Please ask if you need assistance. And ADA infographic	1/16 x 3 x 6	60" A.F.F.	1	At front counter

TAG	SIGN DESCRIPTION	SIGN VERBIAGE	SIZE	MOUNTING HEIGHT	QTY	LOCATION IN RESTAURANT	LOCATION EQUIVALENT
L220	Landfill / Compost / Recycle	Landfill / Compost / Recycle	1/16 x 8.5 x 3	SEE 4/G4.0	SET OF 3	Mount on front doors of trash receptacle at top. MUST ALSO ORDER L222. Match label with shape on top of trash receptacle	L221 (use if restaurant is NOT COMPOSTING)
L221	Landfill / Plastic, Metal, Glass / Paper	Landfill / Plastic, Metal, Glass / Paper	1/16 x 8.5 x 3	SEE 4/G4.0	SET OF 3	Mount on front doors of trash receptacle at top. MUST ALSO ORDER L223. Match label with shape on top of trash receptacle	L220 (use if restaurant is COMPOSTING)

STANDARD REQUIRED SIGNAGE 3

NOT USED 2

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL

18550 E. WARREN AVE
 DETROIT, MI 48236



ENDEAVOR 2.0 SIGNAGE PLAN

G4.0


C:\Users\mim\Documents\TB_Gross\Plan_A\KB142_Ruays.rvt



3 STREAM TRASH 1 - BIN LABELS (L220) **13**



WOMEN RESTROOM WHITE SIGN (L208) **9**

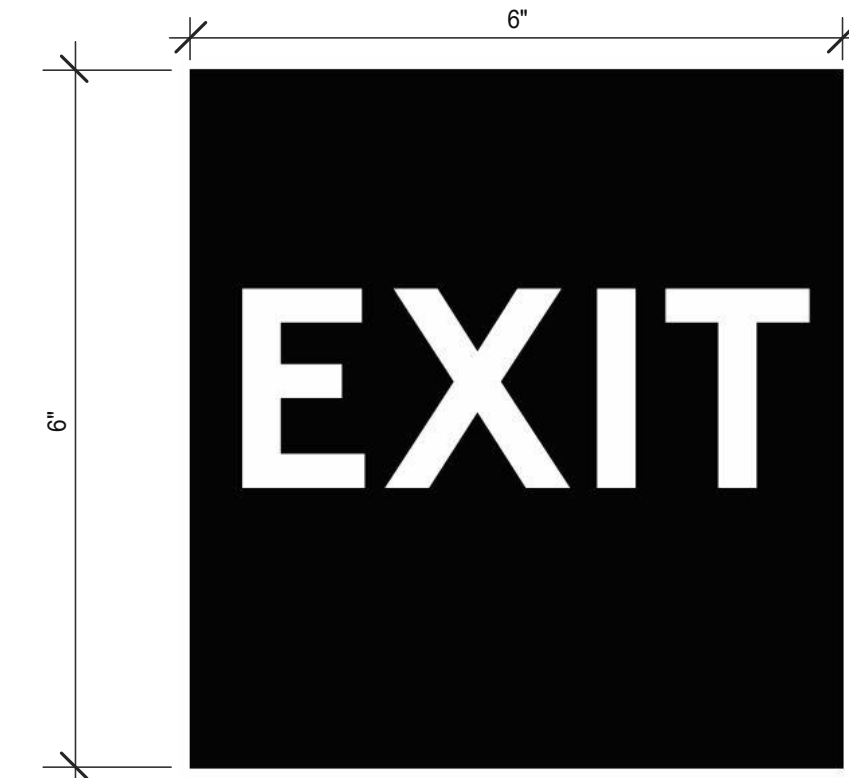

EXIT BRAILLE SIGN (L204) **5**




NO SMOKING SIGN (L201) **1**




3 STREAM TRASH 2 - LABELS (L221) **14**



WOMEN RESTROOM BRAILLE SIGN (L209) **10**

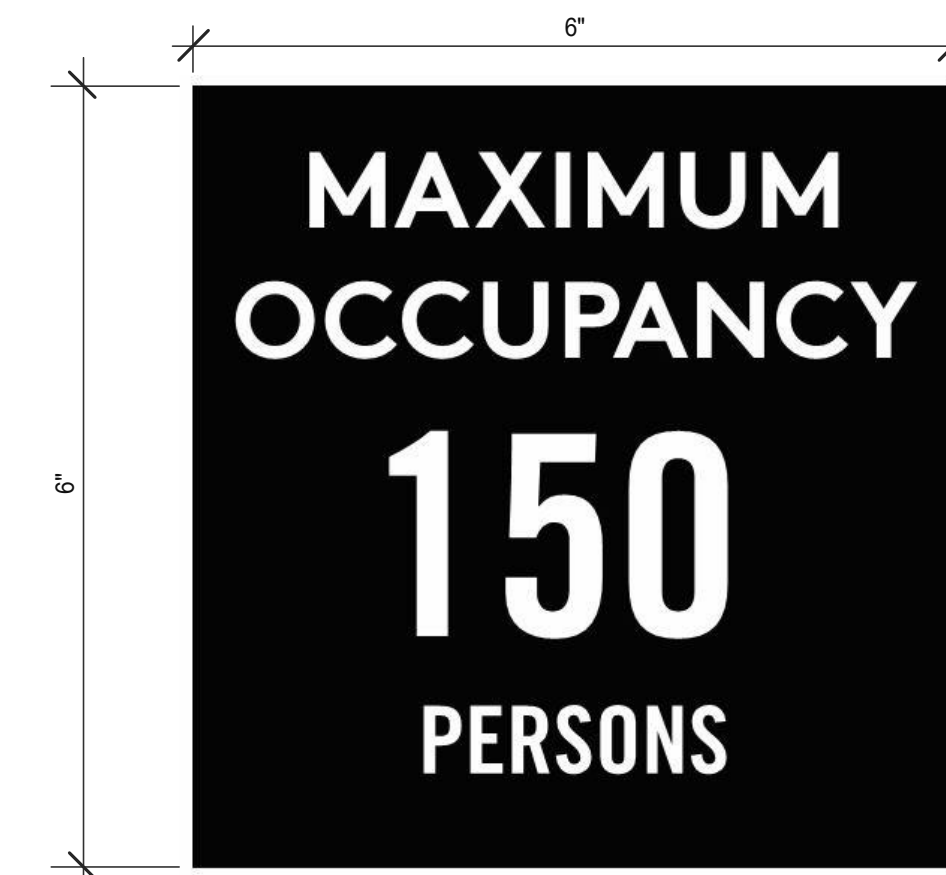


OCCUPANCY SIGN (L205) **6**

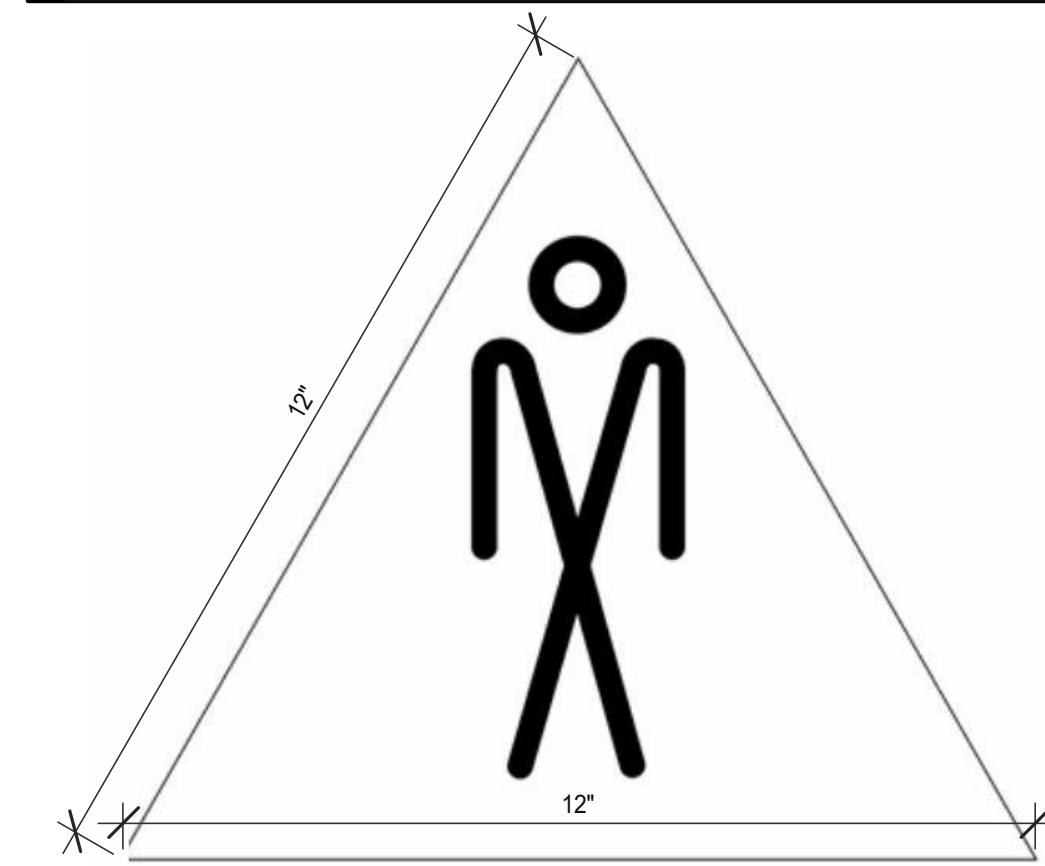

MEN RESTROOM WHITE SIGN (L206) **7**



CLEAN RESTROOM SIGN (L202) **3**

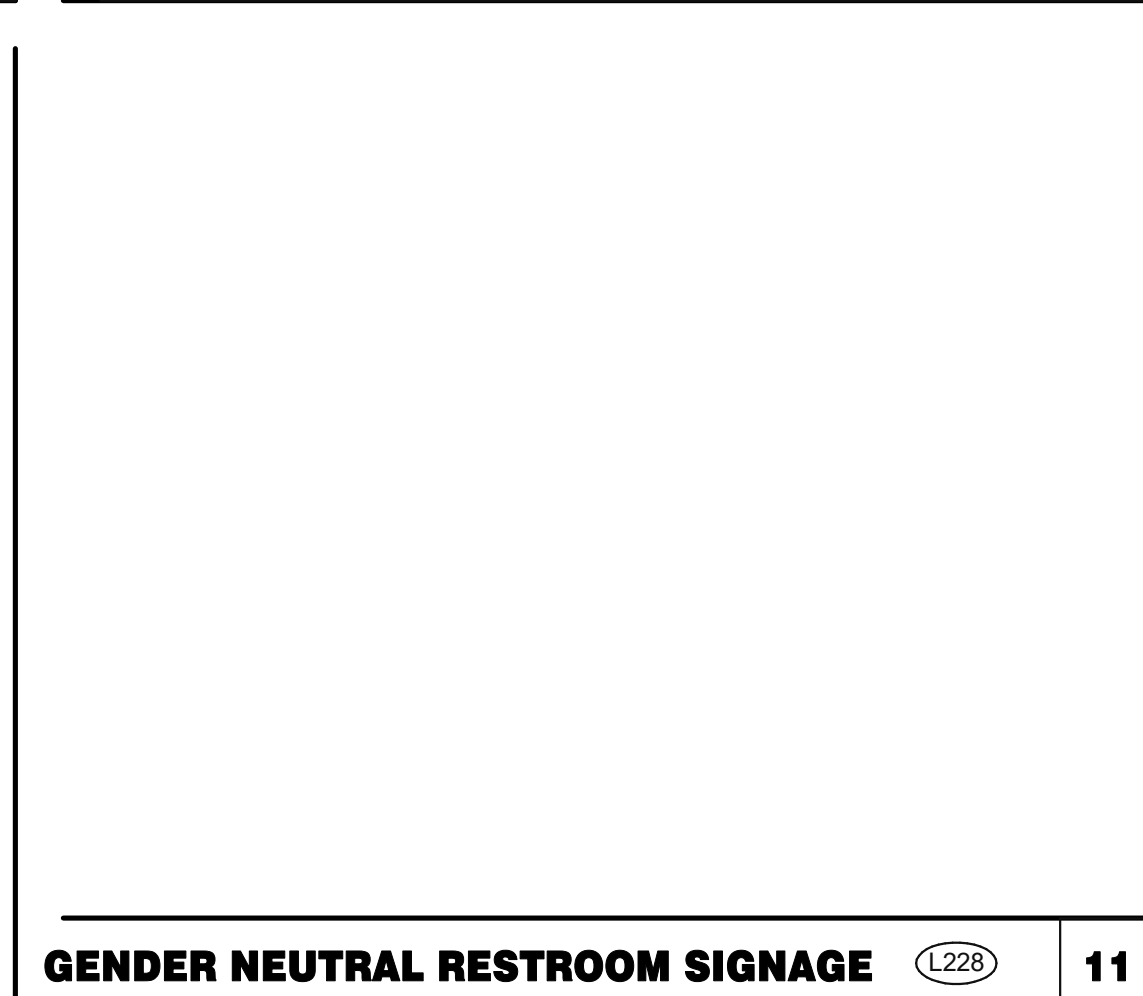

GENDER NEUTRAL RESTROOM SIGNAGE (L228) **11**



IF YOU NEED ASSISTANCE (L233) **12**



MEN RESTROOM BRAILLE SIGN (L207) **8**



HAND WASH NOTICE SIGN (L203) **4**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
**SIGNAGE
DETAILS**

G4.1

GOVERNING BUILDING CODE:

2015 MICHIGAN BUILDING CODE (2015 IBC)

DESIGN CRITERIA:

Table with design criteria including Roof Snow Loads (20 PSF), Wind Loads (115 MPH), and Risk Category (II).

COMPONENT AND CLADDING WIND LOAD SCHEDULE

Table showing wind load schedule for different wind areas and zones.

** INDICATES PRESSURE ACTING TOWARD EXTERIOR FACE
** INDICATES PRESSURE ACTING AWAY FROM EXTERIOR FACE

SEISMIC LOADS:

Table detailing seismic risk category, importance factor, mapped spectral response, and design category.

GENERAL NOTES:

- Typical details and general notes apply to all parts of the work except where specifically detailed or unless otherwise noted.
Drawings are not to be scaled.
For dimensions not shown, coordinate with architectural drawings.

DELEGATED DESIGN:

- Contractor is responsible for design of the following items including design of the connections of each item to the supporting structural framing.
Manufactured wood roof trusses.
Shoring.

SHOP DRAWINGS:

- Reproduction of the structural drawings for use in preparation of shop drawings is strictly prohibited without the written consent of the engineer of record.
Shop drawings submitted with reproduced structural drawings and/or details without consent will be rejected.
Shop drawings shall bear the contractor's stamp of approval.

FOUNDATION NOTES:

- Foundation design is based upon the geotechnical engineering report by professional services industry, dated May 28, 2021, Project No. 03811234.
Contractor to provide foundation & footing as required for pylon or monumental sign.
Coordinate structural plans and details with requirements of geotechnical report.

CONCRETE NOTES:

- Concrete shall be hard rock conc. (5 sack cement per cu yd. min.) and meet the following min. ultimate compressive strengths at 28 days:
Location: 28 Day PSI, Min Strength, Aggregate Size, Slump Inches, Tolerance.
Concrete mix design and testing shall meet with these specs.

MANUFACTURED ROOF TRUSS NOTES:

- MFRD roof trusses are at 2'-0" o.c. U.O.N.
"TD" denotes roof truss type. Refer to schedule 7/54.2.
Truss dwgs are provided for conceptual design only.

STRUCTURAL STEEL NOTES:

- Material properties: W shapes, M.S.C shapes, plate, angles, tube.
Detailing, fabrication, and erection shall conform to the 2010 AISC specifications.
Field connections shall be bolted, bearing type unless noted otherwise.

WOOD NOTES:

- Framing lumber 2x6 and larger (except sill and top plates) shall be SPF (spruce/pine/fir) no. 2 grade used at a maximum moisture content of 19% with the following minimum allowable stresses.
Framing lumber for sill and top plates shall be Douglas fir no. 2 grade used at a maximum moisture content of 15% (KO-15) with the following minimum allowable stresses.
PSL (parallel strand lumber) distributed as truss joist macmillan.

SPECIAL INSPECTION AND TESTING:

This project requires special inspection and testing in accordance with chapter 17 of the international building code. These notes and the statement of special inspections prepared for the project owner are intended to inform the contractor of the quality assurance program and the extent of the contractor's responsibilities.

THE SPECIAL INSPECTIONS & TESTING PROGRAM:

The special inspection and testing program is a quality assurance program intended to ensure that the work is performed in accordance with the contract documents. These inspections are in addition to the inspections specified in IBC section 1710. The special inspection program does not relieve the contractor of his or her responsibility to comply with the official contract documents.

The project owner is responsible for employing special inspection services. The special inspector/agency shall not be in the employ of the contractor, subcontractor or material supplier.

The special inspector is obligated to both the owner and the building official for observing that the work is executed in substantial accordance with the official contract documents.

The inspection and testing agents shall disclose any past or present business relationship or potential conflict of interest with the contractor or any of the subcontractors whose projects it is to inspect or tested.

SPECIAL INSPECTION REPORT REQUIREMENTS:

Special inspection reports and a final report in accordance with section 1704.2.4 shall be submitted to the building official prior to the time that phase of the work is approved for occupancy.

Report requirement: special inspectors shall keep records of all inspections and tests. The special inspector shall furnish the inspection reports to the building official, and to the registered design professional, in responsible charge.

CONTRACTOR RESPONSIBILITIES:

The contractor is responsible for notifying the special inspector in advance of construction schedules and planned operations in order to assure timely and appropriate inspection for the items listed in the schedule of special inspections.

The contractor shall cooperate with and assist the special inspector in performing his inspection duties. The special inspector shall have free access to the project at all times.

Provide access to approved plans: the contractor is responsible for providing the special inspector access to approved plans. The contractor shall maintain a current set of the contract documents at the job site.

Correct discrepancies and deviations: the contractor shall, upon being informed by the special inspector, immediately cause to eliminate such discrepancies and deviations.

Work completed without inspection: work requiring inspection which is completed without inspection will be rejected solely on that basis.

Retain special inspection records: the contractor is also responsible for retaining at the job site all special inspection records completed by the special inspector.

Coordinate and submit: the contractor is responsible for preparing and submitting to the building official and the owner a statement of contractor responsibility, IBC section 1704.4, for themselves and for submitting a statement of contractor responsibility for each structural component subcontractor.

- The statement of contractor responsibility shall contain the following:
1. Acknowledgement of awareness of the special inspection requirements contained in the quality assurance plan.
2. Acknowledgement that control will be exercised to obtain conformance with the construction documents approved by the building official.

Structural component subcontractors include but are not limited to structural steel fabricators or erectors, component fabricators such as steel joists, metal or wood trusses, concrete, and masonry contractors.

At the completion of structural component fabrication, the fabricators shall submit a certificate of compliance stating that the work was performed in accordance with the approved construction documents.

The special inspector is obligated to both the owner and the building official for observing that the work is executed in substantial accordance with the official contract documents.

The inspection and testing agents shall disclose any past or present business relationship or potential conflict of interest with the contractor or any of the subcontractors whose projects it is to inspect or tested.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR COSTS OF:

Retesting and reinspection of materials, work, and/or products that do not meet the requirements of the contract documents and shop drawings/submittal data.

Review of proposed repair and/or replacement procedures by the registered design professional in responsible charge and the inspectors and testing agencies.

Repair or replacement of work that does not meet the requirements of the contract documents.

The contractor is responsible for the travel costs of the special inspector or agents when shop inspection is required of a non approved structural component fabricator.

INSPECTION OF FABRICATION:

Where fabrication of structural, load bearing, or lateral load resisting members or assemblies are performed on the premises of the fabricator, the shop fabrication requires special inspection during the fabrication of items for this project.

Exemption: fabricators approved by the building official are exempt from the on premise inspection. The approval by the building official of any fabricator should be properly documented prior to the commencement of fabrication.

At the completion of fabrication, the fabricator shall submit a certificate of compliance to the building official stating that the work was performed in accordance with the approved construction documents.

CONCRETE TESTING NOTES:

Concrete testing and inspection shall be performed in accordance with the requirements of ACI 318 and the schedule of special inspections. Samples for strength tests of each class of concrete placed each day shall be taken not less than once a day, nor less than once for each 75 cu yd. of concrete used for footings, nor less than once for each 5000 sq ft of fresh surface area for slabs.

STEEL INSPECTION & TESTING NOTES:

Structural steel testing and inspection shall be performed in accordance with the requirements of the referenced standards and the schedule of special inspections.

Field bolted connections will be tested and inspected according to RCSC's specification for structural joints using ASTM A325 OR A490 Bolts.

Field welds shall be inspected and tested according to AWS D1.1. In addition to visual inspection, welded moment connections will be tested by ultrasonic, ASTM E164, or other AWS approved method.

OTHER REQUIRED INSPECTIONS:

The requirements of special inspections and testing in accordance of the international building code are minimum requirements and do not limit the requirements for the contractor to provide other quality control inspections and testing required by the owner, contract documents, or other governing authorities having jurisdiction.

NOTES:

The inspection and testing agent or agents, shall be engaged by the owner or the owners agent, and not by the contractor or subcontractor whose work is to be inspected or tested.

Coordinate and submit: the contractor is responsible for preparing and submitting to the building official and the owner a statement of contractor responsibility, IBC section 1704.4, for themselves and for submitting a statement of contractor responsibility for each structural component subcontractor.

- The statement of contractor responsibility shall contain the following:
1. Acknowledgement of awareness of the special inspection requirements contained in the quality assurance plan.
2. Acknowledgement that control will be exercised to obtain conformance with the construction documents approved by the building official.

Structural component subcontractors include but are not limited to structural steel fabricators or erectors, component fabricators such as steel joists, metal or wood trusses, concrete, and masonry contractors.

At the completion of structural component fabrication, the fabricators shall submit a certificate of compliance stating that the work was performed in accordance with the approved construction documents.

The special inspector is obligated to both the owner and the building official for observing that the work is executed in substantial accordance with the official contract documents.

The inspection and testing agents shall disclose any past or present business relationship or potential conflict of interest with the contractor or any of the subcontractors whose projects it is to inspect or tested.

At the completion of fabrication, the fabricator shall submit a certificate of compliance to the building official stating that the work was performed in accordance with the approved construction documents.

Table with 5 columns: Material/Activity, Service, Y/N, Extent, and IBC Reference. Lists inspections for 1705.3 Concrete Construction and 1705.6 Sills.

SCHEDULE OF SPECIAL INSPECTIONS

Table with 5 columns: Material/Activity, Service, Y/N, Extent, and IBC Reference. Lists inspections for 1704.2.5 Inspection of Fabricators.

1705.2 STEEL CONSTRUCTION (AISC 360 CHAPTER N)

Table with 5 columns: Material/Activity, Service, Y/N, Extent, and IBC Reference. Lists inspections for steel construction including structural steel, welding, and bolting.

1705.3 CONCRETE CONSTRUCTION

Table with 5 columns: Material/Activity, Service, Y/N, Extent, and IBC Reference. Lists inspections for concrete construction including reinforcement, curing, and placement.


FOR SILL INCH = 25.4 mm. (A) WHERE APPLICABLE. SEE ALSO SECTION 1705.12 SPECIAL INSPECTIONS FOR SEISMIC RESISTANCE. (B) WHERE APPLICABLE. THE SPECIAL INSPECTIONS FOR SPECIAL INSPECTION SHALL BE INCLUDED IN THE RESEARCH REPORT FOR THE ANCHOR ISSUED BY AN APPROVED SOURCE IN ACCORDANCE WITH 17.8.2 AND 318. OR OTHER QUALIFICATION PROCEDURES. WHERE SPECIFIC REQUIREMENTS ARE NOT PROVIDED, SPECIAL INSPECTION REQUIREMENTS SHALL BE SPECIFIED BY THE REGISTERED DESIGN PROFESSIONAL AND SHALL BE APPROVED BY THE BUILDING OFFICIAL PRIOR TO THE COMMENCEMENT OF THE WORK.

1705.6 SILLS

Table with 5 columns: Material/Activity, Service, Y/N, Extent, and IBC Reference. Lists inspections for sills including material verification and curing.



ENDEAVOR 2.0 STRUCTURAL GENERAL NOTES S0.1 PLOT DATE: 11/7/2022 4:36:12 PM

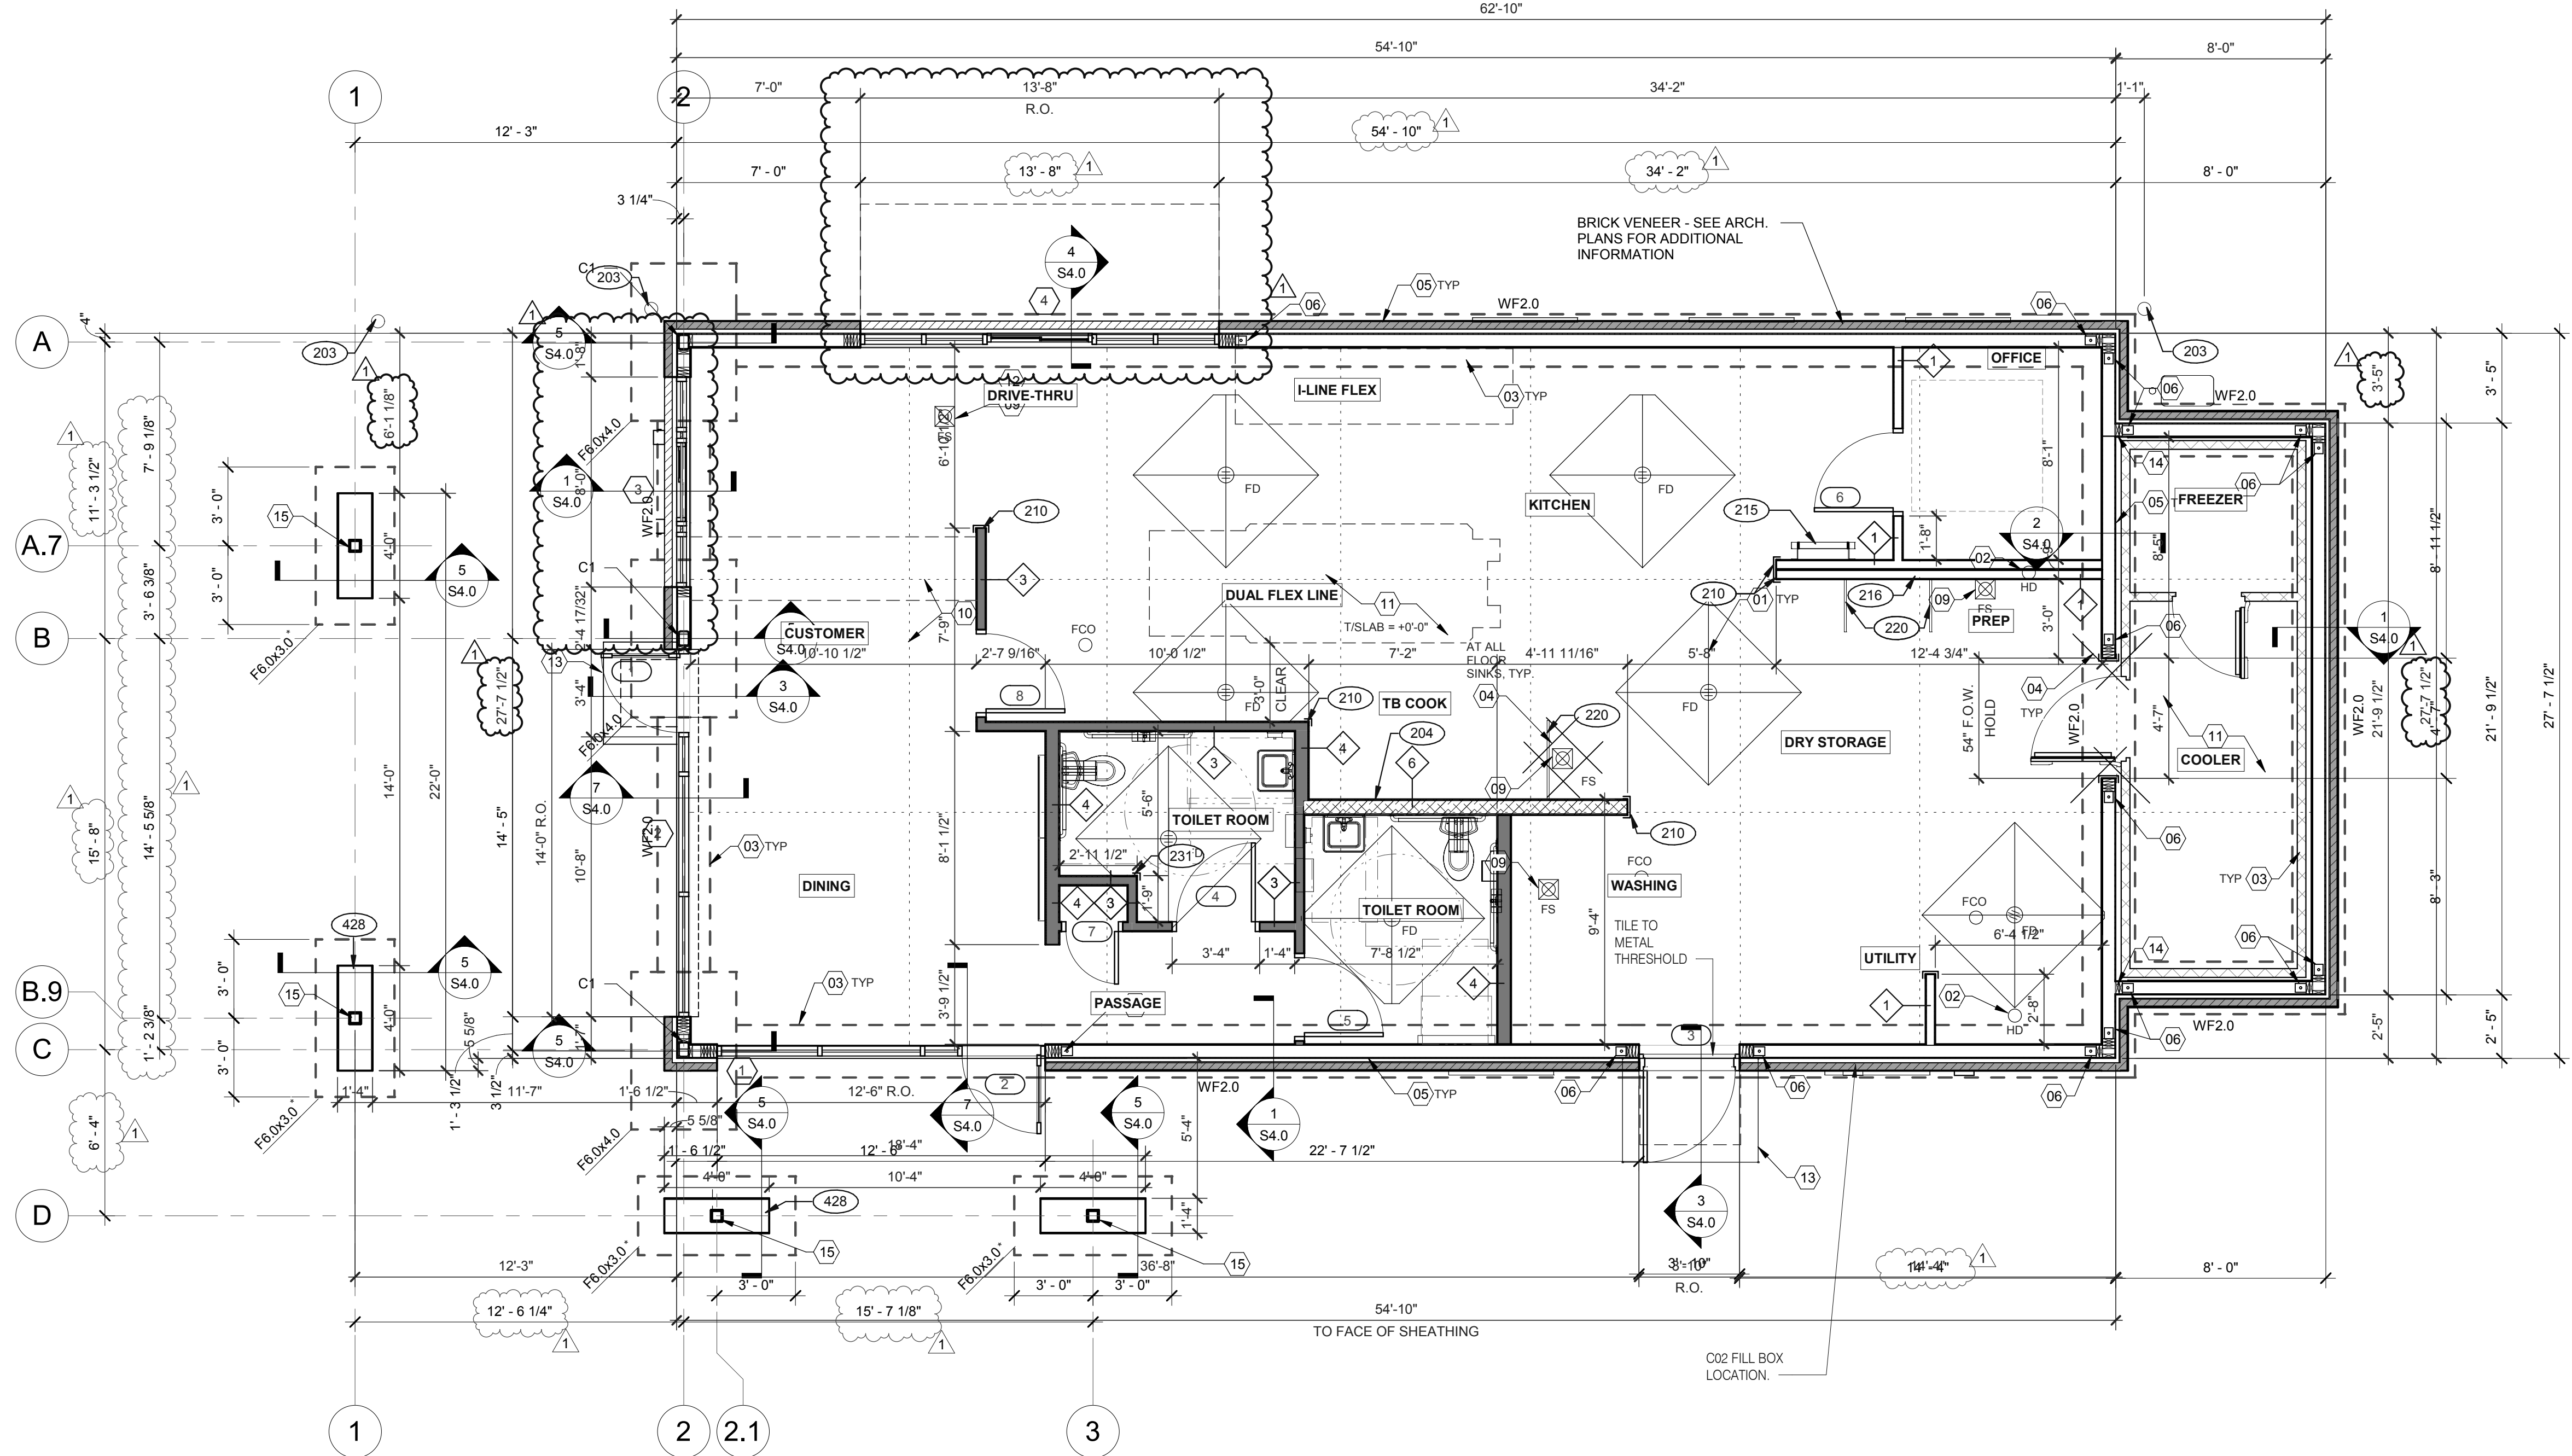

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 04.08.21
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 313354
STORE NUMBER: 449523
PA/PM: JN
DRAWN BY.: DL
JOB NO.: 2018088.03

FOUNDATION PLAN 1/4" = 1'-0" A

COLUMN SCHEDULE				
MARK	COLUMN SIZE	BASE PLATE TYPE	ANCHOR ROD	EMBED.
C1	HSS7x5x3/8	TYPE A	(6) 3/4" DIA.	1'-6"

NOTE:
1. Cx DENOTES STEEL COLUMN.
2. REFER TO DETAIL 9/S4.0 FOR BASE PLATE DETAIL.
3. REFER TO DETAIL 10/S4.0 FOR ANCHOR ROD DETAIL.

FOOTING SCHEDULE				
MARK	FTG. SIZE (WxLxT)	REINFORCEMENT	T/FTG.	REMARKS
WF2.0	2'-0" x CONT. x 2'-10"	(2) #5 CONT. T&B	-0'-8"	REF. 1/S4.0
F6.0x4.0	6'-0" x 4'-0" x 2'-10"	(6) #5 LONG. + (9) #5 TRANS. T&B	-0'-8"	REF. 5/S4.0
F6.0x3.0*	6'-0" x 3'-0" x 2'-0"	(4) #5 LONG. + (7) #5 TRANS. T&B	-1'-6"	REF. 5/S4.0

NOTE:
1. WF2.0 DENOTES CONTINUOUS WALL FOOTING.
2. Fx DENOTES SPREAD FOOTING.
3. T/FTG. DENOTES TOP OF FOOTING ELEVATION REFERENCED FROM TOP OF SLAB ELEVATION = +0'-0"
4. * DENOTES FOUNDATION DESIGN IS BASED ON ASSUMED SCREEN WALL COLUMN REACTIONS. FINAL PRE-ENGINEERED SCREEN WALL DRAWINGS SHALL BE SUBMITTED FOR REVIEW PRIOR TO FABRICATION AND CONSTRUCTION TO VERIFY FOUNDATION DESIGN.

SLAB:
A. DESIGN IS BASED UPON 4" THICK CONCRETE SLAB REINFORCED WITH WWF 6x6-W2.9xW2.9 OVER 10 MIL VISQUEEN MEMBRANE, OVER 4" AGGREGATE BASE, OVER ENGINEERED SUBGRADE.

MISCELLANEOUS:
A. DIMENSIONS NOTED ARE TO FACE OF CONCRETE. REFER TO DWG. A1.0 FOR DIMENSIONS TO FACE OF STUD AND OTHER DIMENSIONS NOT OTHERWISE NOTED.
B. DRAWINGS SHALL NOT BE SCALED. ALL DIMENSIONS AND FIT SHALL BE DETERMINED AND VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCEMENT OF WORK.
C. DETAILS NOT FULLY OR SPECIFICALLY SHOWN SHALL BE OF SAME NATURE AS OTHER SIMILAR CONDITIONS.
D. SEE PLUMB. DWGS. FOR PLUMB. LAYOUT DIMENSIONS, U.O.N.
E. SEE ELECT. DWGS. FOR ELECT. LAYOUT DIMENSIONS, U.O.N.
F. COORD. FOUNDATION AND SLAB LAYOUT WITH OTHER TRADES PRIOR TO POURING SLAB.

- (01) SLAB SHALL BE PITCHED 1/2" FOR 5'-0" x 5'-0" SQUARE AT ALL FLOOR DRAINS U.O.N. REFER TO PLUMBING DRAWINGS FOR LOCATIONS.
- (02) PROVIDE HUB DRAIN (HD) UNLESS REQUIRED BY LOCAL CODE TO HAVE FLOOR SINK (FS).
- (03) INDICATES INSIDE SURFACE OF FOOTING. SEE SHEET S4.0.
- (04) (2) #4 x 3'-0" LONG RE-ENTRANT BARS AT ALL RE-ENTRANT CORNERS. NOT ALL LOCATIONS SHOWN ON PLAN.
- (05) ANCHOR BOLTS LOCATED THROUGHOUT PERIMETER OF BUILDING SHALL BE PROVIDED AS REQUIRED PER THE "PLATE/ANCHOR BOLT" COLUMN OF THE "WALL SHEATHING AND SHEARWALL SCHEDULE." SEE D/SZ.0.
- (06) HDUS HOLD-DOWN ANCHOR AT EACH END OF SHEARWALL. SEE 6/S4.0 FOR HOLD-DOWN EMBEDMENT DETAIL.
- (07) (2) #4x3'-0" LG. RE-ENTRANT BARS (CENTERED IN SLAB) AT ALL RE-ENTRANT CORNERS.
- (08) NOT USED.
- (09) FLOOR SINK REFER TO PLUMBING DRAWINGS FOR LOCATION.
- (10) APPROXIMATE LOCATION OF SLAB CONTROL JOINTS. REFER TO DETAIL 11/S4.0 FOR ADDITIONAL INFORMATION.
- (11) 4" CONCRETE SLAB WITH #4 BARS AT 12" O.C. EACH WAY (CENTERED IN SLAB). MODIFY BASE MATERIAL AS REQUIRED BY GEOTECHNICAL ENGINEER. PROVIDE BOND BREAKER BETWEEN SLAB AND BUILDING FOUNDATIONS.
- (12) FORM FOOTING TO ACCOMMODATE FLOOR SINK AND DRAIN LINE INSTALLATION.
- (13) FROST SLAB - SEE CIVIL PLANS FOR TOP OF CONCRETE ELEVATION.
- (14) SHEAR WALL SHEATHING SHALL BE CONTINUOUS AT COOLER WALL INTERSECTION.
- (15) SCREEN WALL COLUMNS TO BE DESIGNED BY SCREEN WALL DESIGNER/SUPPLIER. REFER TO DELEGATED DESIGN NOTES ON SHEET S0.1 FOR ADDITIONAL INFORMATION. PROVIDE E.O.R. WITH SCREEN WALL COLUMN REACTIONS PRIOR TO ORDERING AND/OR FABRICATION OF MATERIALS TO VERIFY FOUNDATIONS SIZES.

COLUMN SCHEDULE

FOOTING SCHEDULE

FOUNDATION NOTES

FOUNDATION KEYNOTES


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




**ENDEAVOR 2.0
FOUNDATION
PLAN**

S1.0

PLAT DATE: 11/7/2022 4:36:12 PM

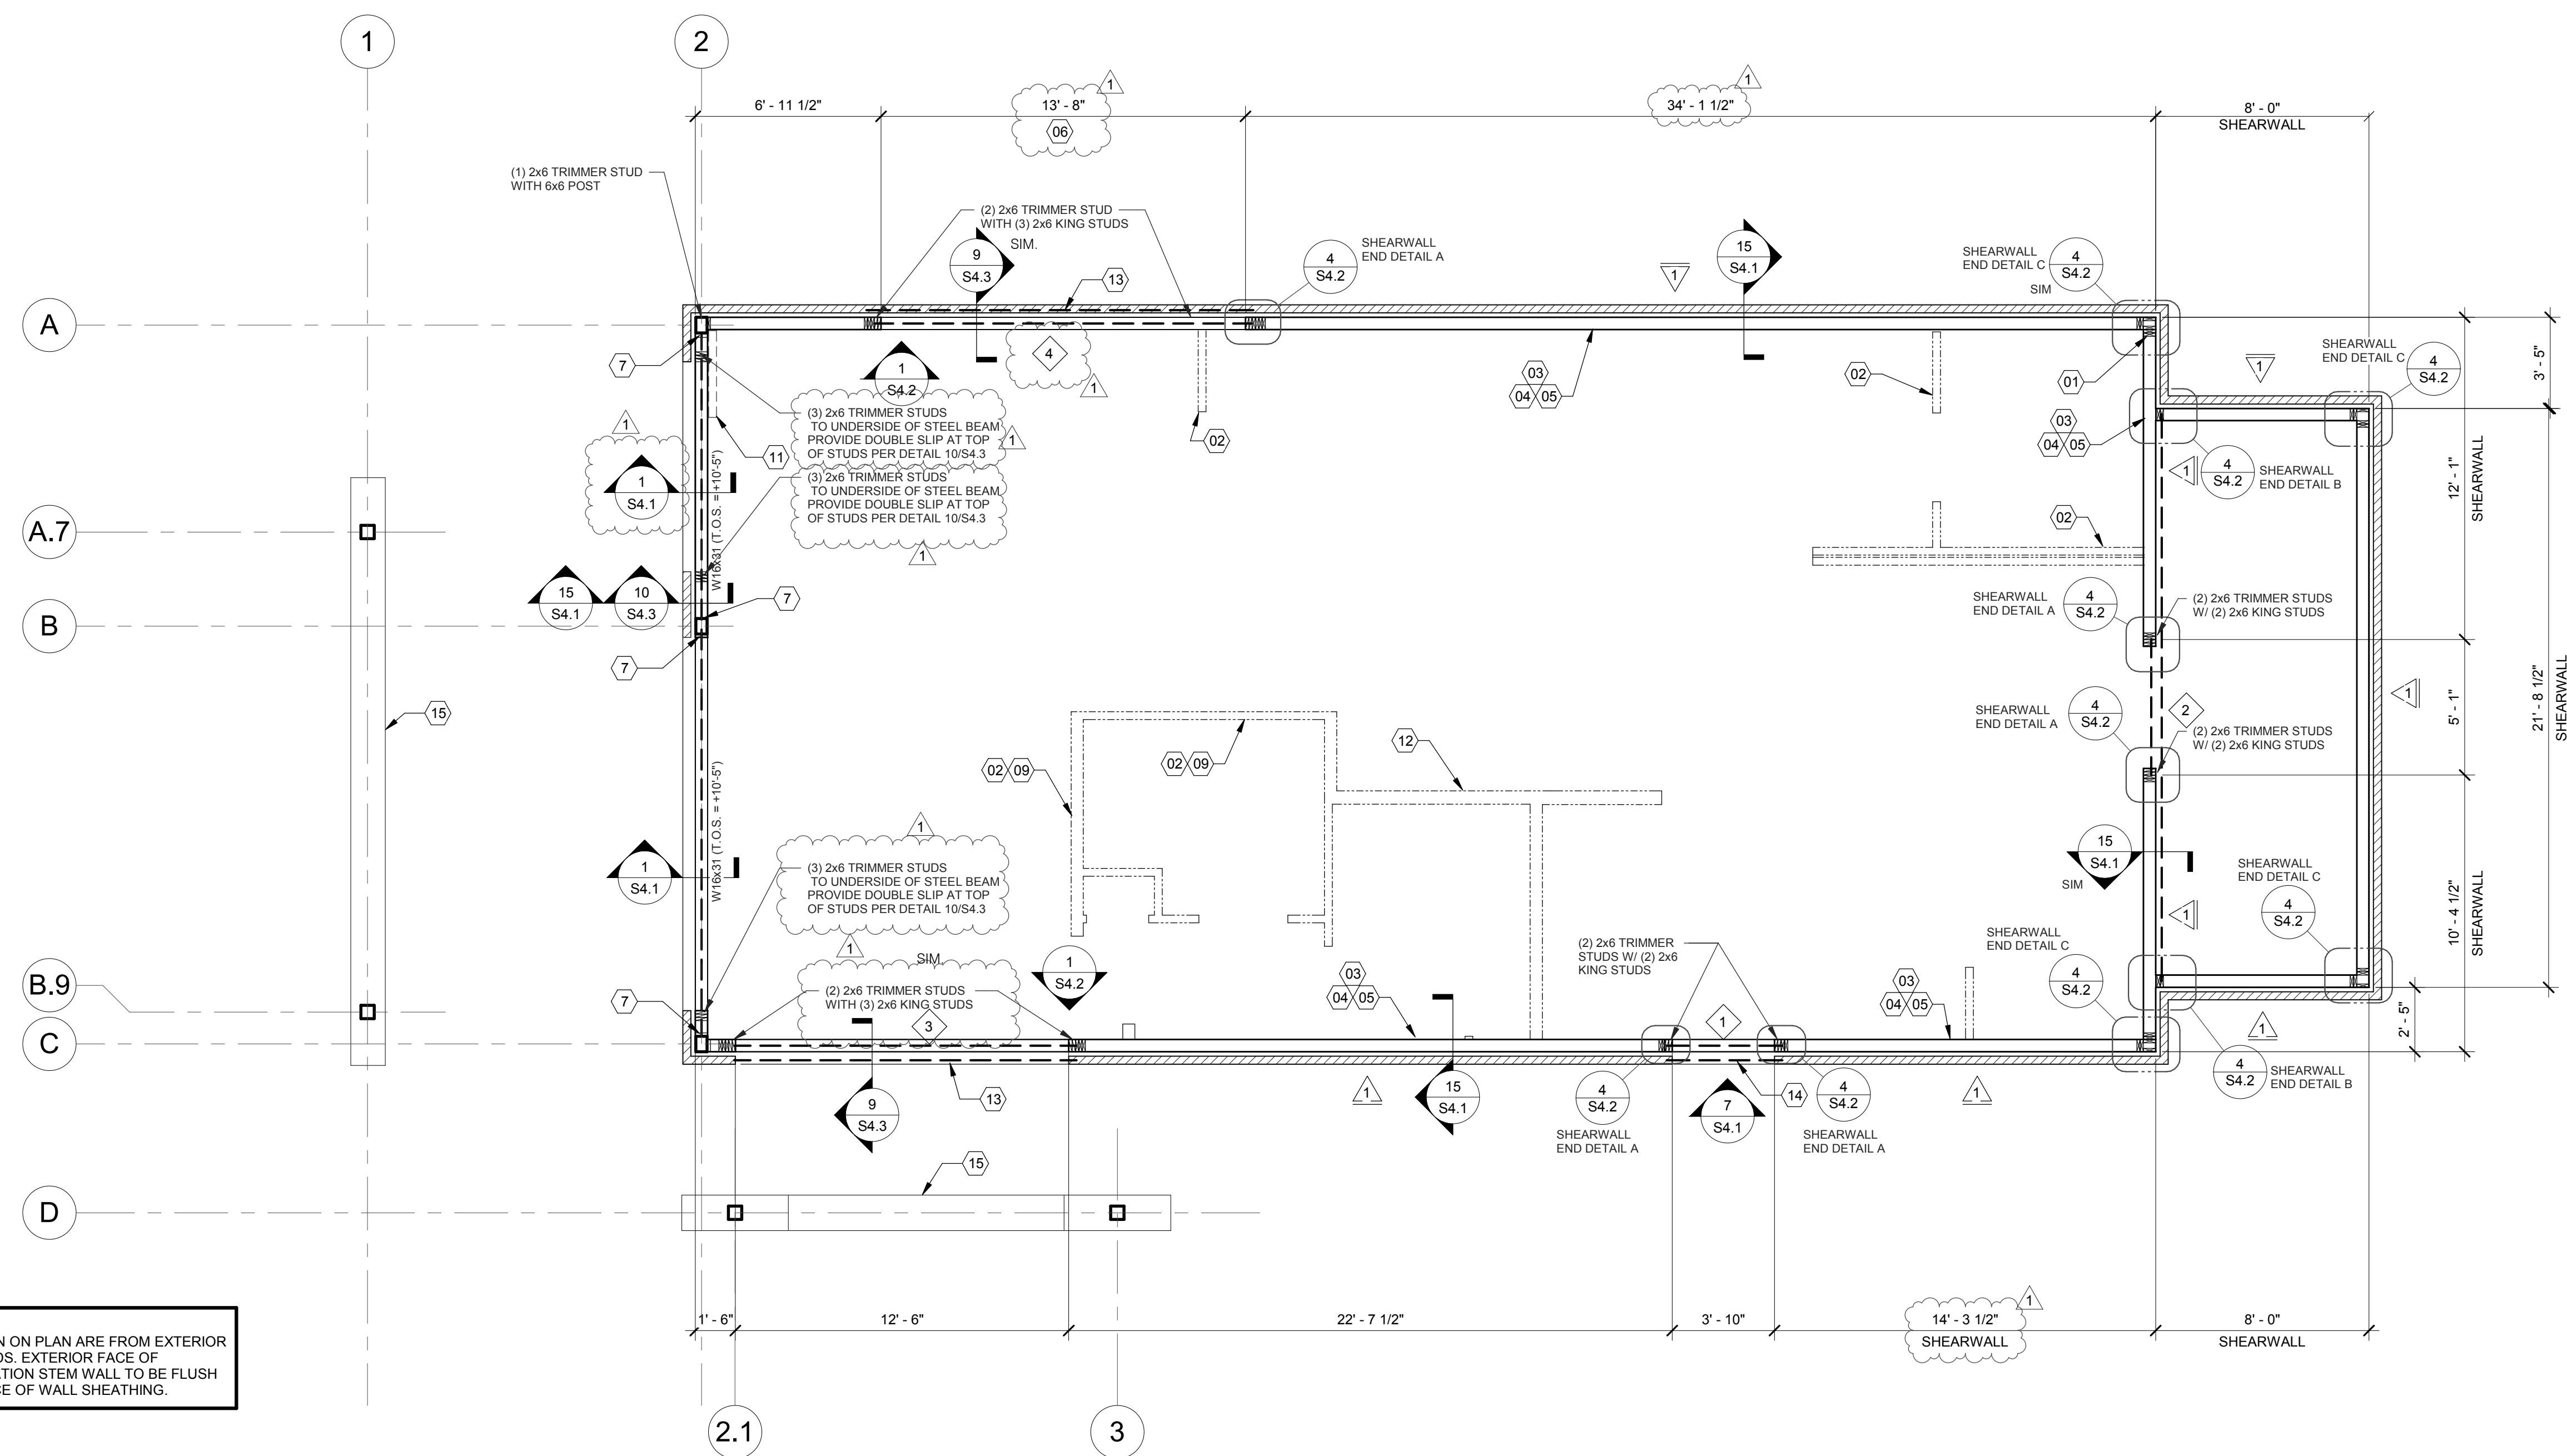

NOTE:
DIMENSIONS SHOWN ON PLAN ARE FROM EXTERIOR FACE OF WALL STUDS. EXTERIOR FACE OF CONCRETE FOUNDATION STEM WALL TO BE FLUSH WITH EXTERIOR FACE OF WALL SHEATHING.



WALL FRAMING PLAN 1/4" = 1'-0" A

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 04.08.21
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 313354
STORE NUMBER: 449523
PA/PM: JN
DRAWN BY.: DL
JOB NO.: 2018088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0 WALL FRAMING PLAN

S2.0

PLOT DATE: 11/7/2022 4:36:12 PM

HEADER SCHEDULE		
MARK	BUILT-UP SECTION	BUILT-UP MANUF. MEMBER
1	(3) 2x8	--
2	(3) 2x10	--
3	--	5 1/4" x 14" PSL
4	--	5 1/4" x 16" PSL

NOTES:
1. BUILT-UP HEADER SECTION SHALL HAVE 1/2" PLYWOOD SANDWICHED PIECES. REF. 14/S4.1

WALL SHEATHING AND SHEARWALL SCHEDULE					
SW	SHEATHING	EDGE	FIELD	PLATE / ANCHOR BOLT	REMARKS
1	1/2" CDX PLYWD (32/16), PS1 RATING	10d @ 6" O.C.	10d @ 12" O.C.	5/8" DIA. F1554 (22x3) @ 32" O.C. W/ WASHER	PLYWOOD ON EXTERIOR FACE OF STUDS
2	1/2" CDX PLYWD (32/16), PS1 RATING	10d @ 4" O.C.	10d @ 12" O.C.	5/8" DIA. F1554 (18x3) @ 16" O.C. W/ WASHER	PLYWOOD ON BOTH SIDES OF STUDS
3	1/2" CDX PLYWD (32/16), PS1 RATING	10d @ 4" O.C.	10d @ 12" O.C.	5/8" DIA. F1554 (22x3) @ 16" O.C. W/ WASHER	PLYWOOD ON EXTERIOR FACE OF WALL
4	1/2" CDX PLYWD (32/16), PS1 RATING	10d @ 6" O.C.	10d @ 12" O.C.	5/8" DIA. F1554 (22x3) @ 48" O.C. W/ WASHER	NAILING AT HEADERS PER 14/S4.1

REQUIREMENTS FOR EXTERIOR NON-SHEARWALL WALLS

- OSB OF COMPARABLE THICKNESS MAY BE USED IN LIEU OF PLYWOOD WHEN APPROVED IN WRITING BY THE PROJECT ENGINEER AND THE LOCAL JURISDICTION OF COMPARABLE THICKNESS MAY BE USED IN LIEU OF PLYWOOD WHEN APPROVED IN WRITING BY THE PROJECT ENGINEER AND THE LOCAL JURISDICTION.
- BLOCK ALL UNSUPPORTED EDGES WITH 2x MATERIAL U.O.N. BLOCK EDGES WITH 3x MATERIAL WHERE 10d NAILING IS 3" O.C. OR LESS AND 8d NAILING IS 2" O.C. OR LESS. ALL UNSUPPORTED EDGES WITH 2x MATERIAL U.O.N. BLOCK EDGES WITH 3x MATERIAL WHERE 10d NAILING IS 3" O.C. OR LESS AND 8d NAILING IS 2" O.C. OR LESS.
- ALL PLYWOOD NAILS SHALL BE COMMON WIRE. SEE SPECIFICATIONS FOR OTHER NAIL REQUIREMENTS.
- EXTERIOR WALLS NOT DESIGNATED AS SHEARWALLS IN THE WALL FRAMING PLAN SHALL MEET REQUIREMENTS INDICATED FOR NON-SHEARWALL WALLS IN THE SCHEDULE ABOVE.
- SHEARWALL LENGTHS WHERE NOTED ARE MINIMUM. DO NOT LOCATE HOLD-DOWNS FROM THESE DIMENSIONS. SEE ARCH DWGS FOR ACTUAL WALL LENGTHS.
- HD REFERS TO SIMPSON STRONGTIE CO. HOLD-DOWNS. INSTALL PER 6/S4.0. POST WIDTH SHALL MATCH STUD WALL WIDTH. SEE FOUNDATION PLAN FOR OTHER REQ'S.
- EDGE NAIL WALL PLY TO STUDS OR POSTS WITH HOLD-DOWNS.
- WHERE PANELS ARE APPLIED TO BOTH FACES OF A WALL AND NAIL SPACING IS LESS THAN 6" O.C. ON EITHER SIDE, PANEL JOINTS SHALL BE OFFSET TO WALL ON DIFFERENT FRAMING MEMBERS OR FRAMING SHALL BE 3x OR THICKER AND NAILS ON EACH SIDE SHALL BE STAGGERED.

WALL FRAMING NOTES - TYP U.O.O.:

WALL FRAMING:

- EXTERIOR WALL NON-BEARING & BEARING STUDS SHALL BE SOUTHERN PINE NO. 2, 6x6 POSTS TO BE SOUTHERN PINE NO. 2. INTERIOR WALL STUDS MAY BE STUD GRADE.
- ALL BEAMS AND JOISTS SHALL BE SEAT CUT FOR FULL UNIFORM BEARING AT SUPPORTS. BEAM SEATS AND COLUMN CAPS.
- SEE SHEET A1.0 FOR DIMENSIONS.
- EXTERIOR STUD WALLS ARE 2x6 AT 16" O.C. U.O.N.
- ALL WOOD IN CONTACT WITH CONC., STEEL OR GRADE SHALL BE PRESSURE TREATED.
- ALL BOLTED OR NAILED STRAP CONNECTIONS SHALL HAVE AN EQUAL NUMBER OF BOLTS OR NAILS EACH SIDE OF THE SPLICE JOINT. THE FIRST BOLT OR NAIL FROM EACH SIDE OF THE SPLICED OR TREATED MEMBER SHALL BE EQUAL DISTANCE FROM THE SPLICE. STRAPS USING 16d NAILS ON 2x MATERIAL SHALL BE INSTALLED ON THE 1-1/2" EDGE OF THE MEMBER.
- THE CONTRACTOR SHALL VERIFY THAT THE MOISTURE CONTENT OF ALL FRAMING LUMBER AND PLYWOOD MEET THE REQUIREMENTS OF THE SPECS. AT THE TIME OF INSTALLATION AND AT CLOSE-IN.
- USE PRESSURE TREATED LUMBER AT WINDOW JAMBS, SILL AND STUDS UNDER SILL AS WELL AS ALL TOILET PLUMBING WALLS.

STUD LAYOUT:

- LAYOUT STUDS ON SIDEWALLS (LONG WALLS) STARTING AT REAR OF BUILDING TOWARDS FRONT.
- LAYOUT STUDS ON ENDWALLS (SHORT WALLS) STARTING AT EACH END AND WORKING TOWARDS CENTER.


- COORDINATE WITH ELECTRICAL POWER PLAN SHEET E3.0.
- INTERIOR NON-BEARING STUD WALL FRAMING; REFER TO SHEET A1.0 FOR DIMENSIONS AND STUD SIZES. SEE DETAIL 10 & 11/S4.1 AND WALL FRAMING NOTES.
- (2) 2x6 TOP PLATES - SPLICE PER 16/S4.1. U.O.N. REF. 1/S4.3 FOR PARAPET CAP DETAIL.
- TOP OF TRUSS BEARING PLATE. SEE DETAIL 2/S4.1.
- TOP OF PARAPET. SEE S3.0.
- ENSURE ROUGH OPENING DIMENSION TO PROVIDE TOLERANCE FOR DRIVE THRU WINDOW INSTALLATION. COORDINATE WITH WINDOW MANUFACTURER.
- BEAM TO COLUMN MOMENT CONNECTION. REFER TO DETAIL 12/S4.3.
- INTERIOR SHEAR WALL FRAMING FOR 2x6 STUDS, BLOCKING, & SILL PLATE SHALL BE SOUTHERN PINE OR DOUGLAS FIR AT THIS WALL. PROVIDE 6x6 POST AT EACH END OF WALL.
- COORDINATE WITH PLUMBING ROUGH IN SHEET P4.0.
- 2x FRAMING ON THICKENED CONCRETE FOUNDATION / PIER; SEE SHEETS S1.0 AND S4.0. DIMENSIONS FOR FRAMING ARE TO FACE OF STUD.
- 2x4 FRAMING FOR ALCOVE. SEE ARCHITECTURAL.
- COLD-FORMED STUD WALL (NON-LOAD BEARING STUD WALL). SEE ARCH.
- PROVIDE 3/8"x5/7" CONT. GALV. STL. BENT PLATE (LLV) BRICK LEDGER ABOVE OPENING. ANCHOR LEDGER TO HEADER PER DETAIL 9/S4.3. EXTEND LEDGER 6" MIN. TO BEAR ON BRICK EACH END.
- PROVIDE L4x3-1/2x3/8 (LLV) GALVANIZED LOOSE LINTEL ABOVE OPENING TO SUPPORT BRICK VENEER. LINTEL TO BEAR ON BRICK 6" MIN EACH END.
- SCREEN WALL TO BE DELEGATED DESIGN. REFER TO DELEGATED DESIGN NOTES ON SHEET S0.1. REF. ARCHT. PLANS FOR ADDITIONAL INFORMATION.

HEADER SCHEDULE E

WALL SHEATHING AND SHEARWALL SCHEDULE D


WALL FRAMING NOTES C

WALL FRAMING KEYNOTES B

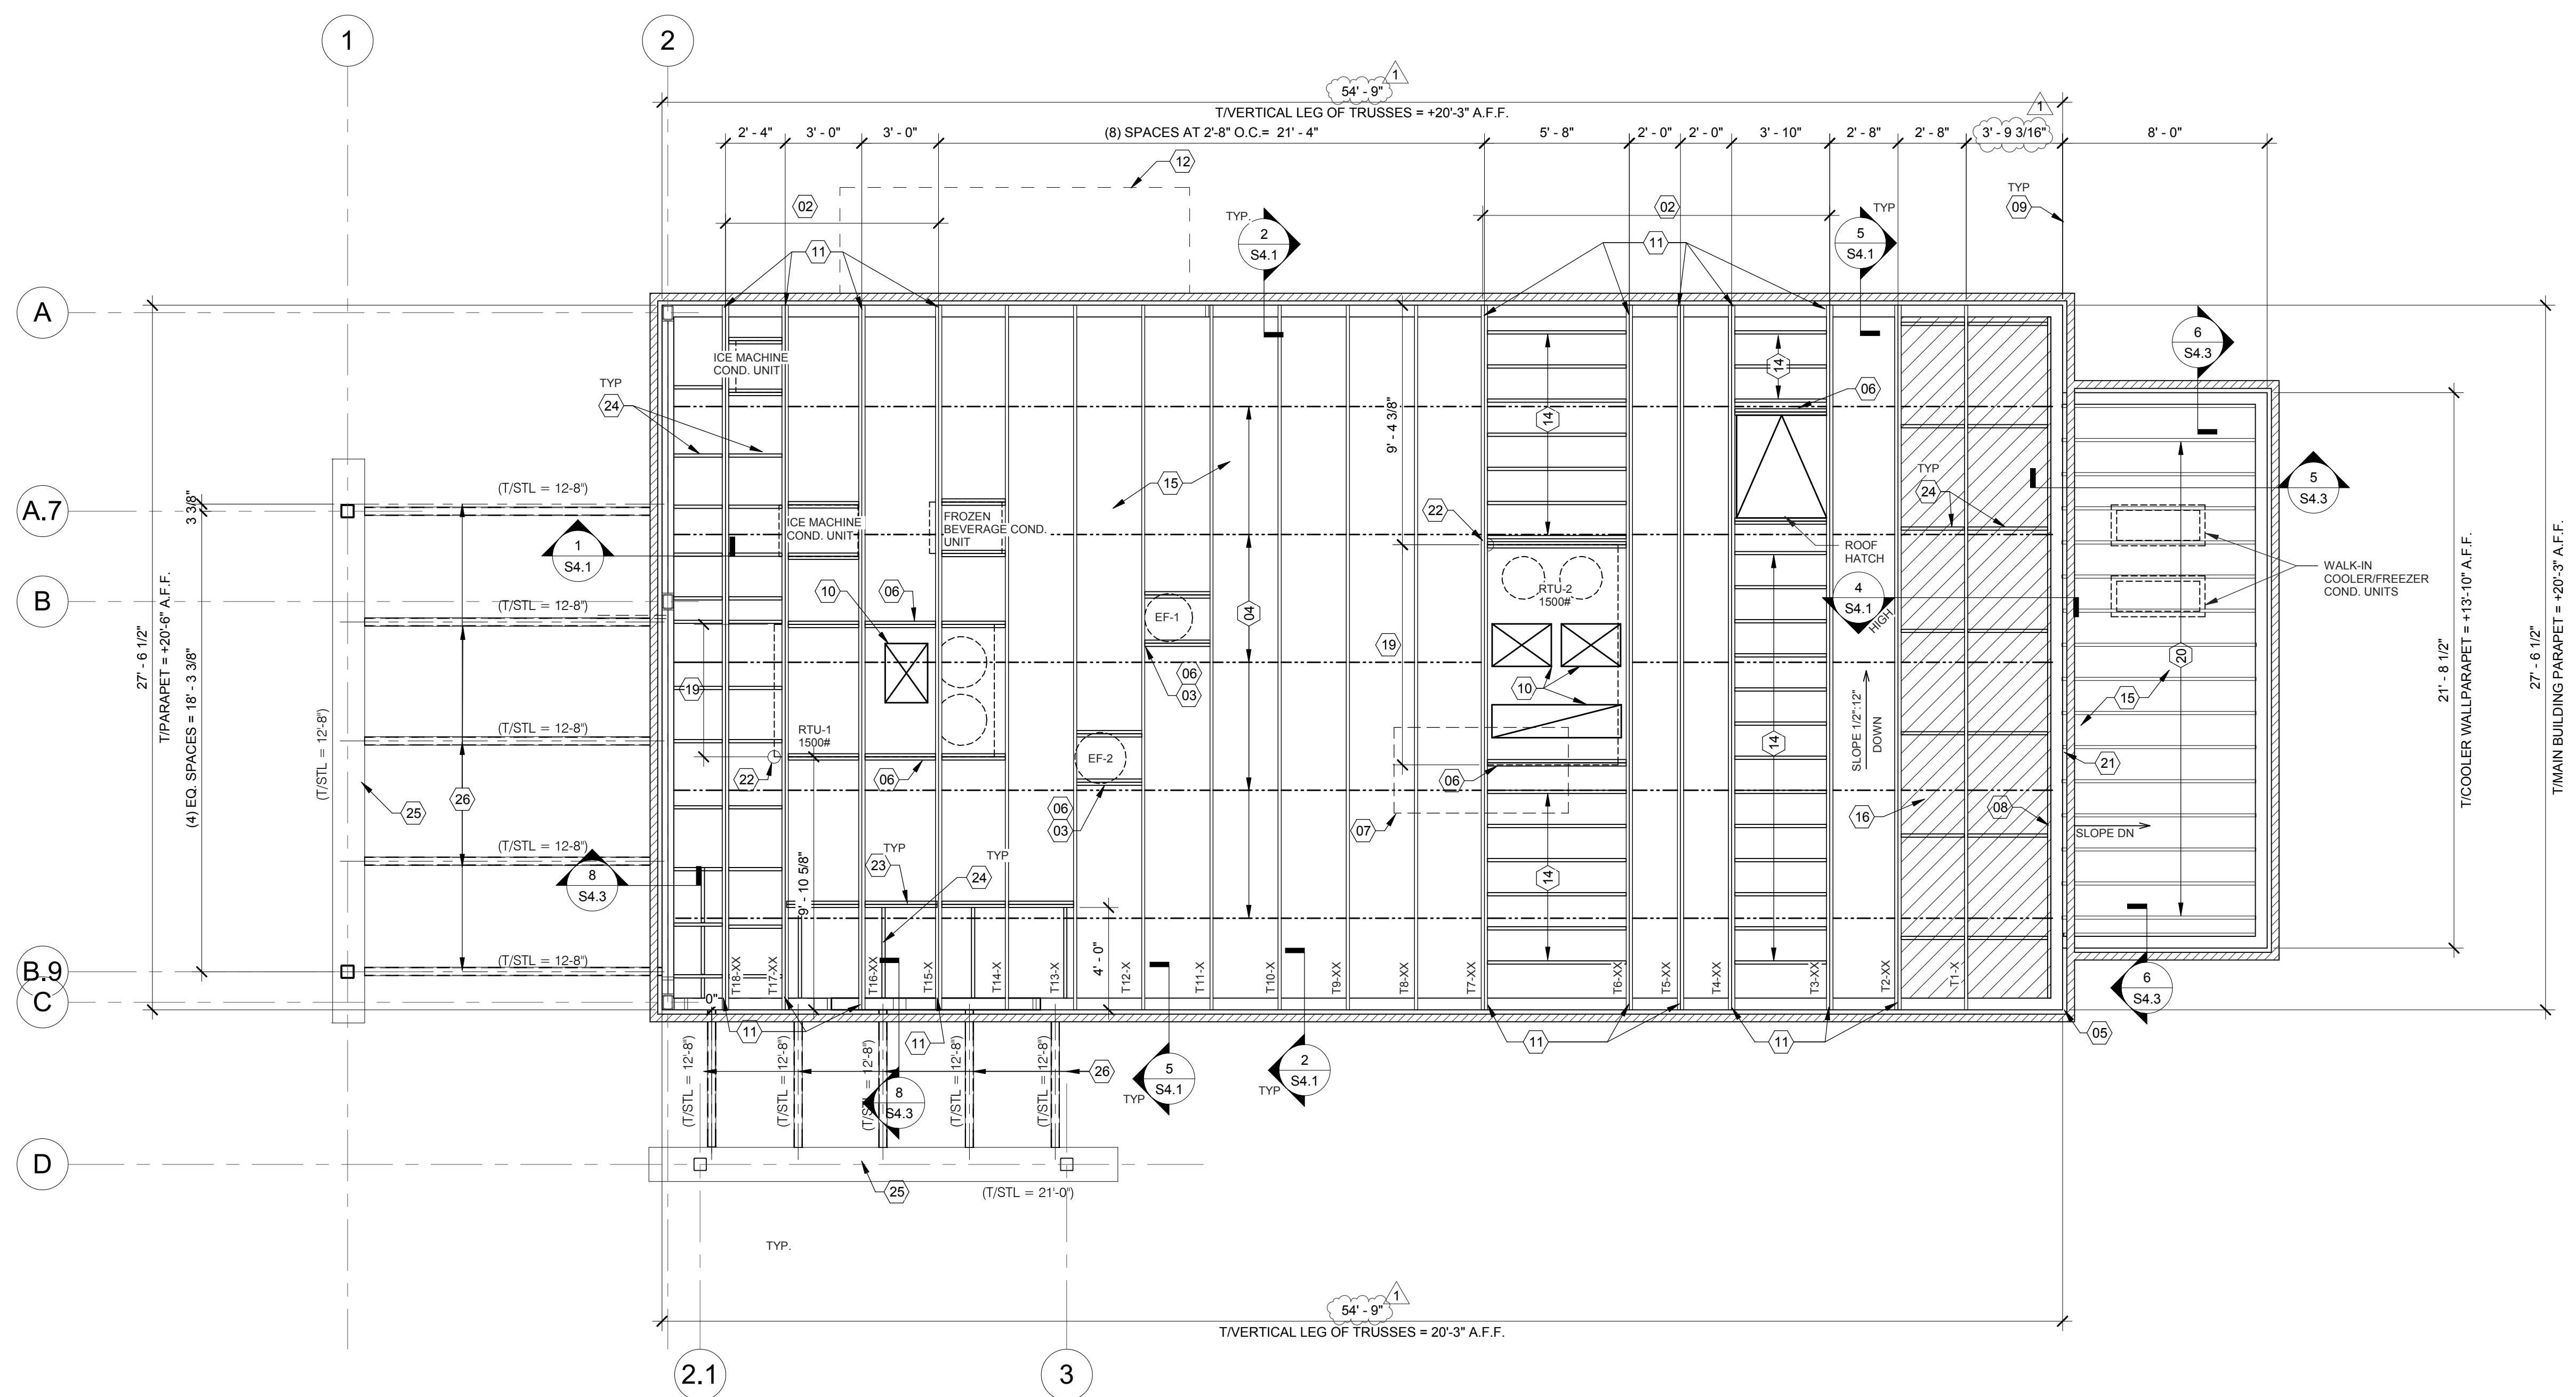

EXTREME CARE SHALL BE USED IN ERECTING ROOF TRUSSES - COMPLY WITH TPI BRACING REQUIREMENTS.

ROOF NOT DESIGNED FOR PONDING. SEE ARCHITECTURAL DRAWINGS FOR DRAIN REQUIREMENTS.



ROOF FRAMING PLAN 1/4" = 1'-0" A

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 04.08.21
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 313354
STORE NUMBER: 449523
PA/PM: JN
DRAWN BY.: DL
JOB NO.: 2018088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



**ENDEAVOR 2.0
ROOF FRAMING
PLAN**

S3.0

PLOT DATE: 11/7/2022 4:36:13 PM

ROOF NAILING SCHEDULE		
TYPE	NAILING / SHEATHING	REMARKS
BN	10d @ 6" O.C.	
EN	10d @ 6" O.C.	
FN	10d @ 12" O.C.	
ROOF SHEATHING	23/32" CDX PLYWOOD (48/24), PS1 RATING	

NOTES:
SEE 8/S4.2 FOR DEFINITIONS AND ROOF NAILING PLAN.
SEE 11/S4.2 FOR TYPICAL NAILING SCHEDULE.


ROOF NAILING SCHEDULE D

ROOF FRAMING NOTES:
A. ALL UNSUPPORTED EDGES OF PLYWOOD SHEATHING SHALL BE SUPPORTED WITH SIMPSON PSC1 CLIPS, PROVIDE (2) CLIPS EQUALLY SPACED BETWEEN EACH TRUSS/SUPPORT. SEE DETAIL 9/S4.2. OSB OF COMPARABLE THICKNESS MAY BE USED IN LIEU OF PLYWOOD WHEN APPROVED IN WRITING BY THE PROJECT ENGINEER AND THE LOCAL JURISDICTION.
B. ALL MECHANICAL SUPPLY AND RETURN OPENINGS SHALL BE BETWEEN FRAMING U.O.N.
C. "T-#F" DENOTES ROOF TRUSS TYPE, REFER TO SCHEDULE 7/S4.2.
D. REFER TO TRUSS ELEVATIONS FOR SHAPE, OVERHANG, SLOPES, SPAN, ETC. LOCATION OF BEARING POINTS ARE AS INDICATED ON THE DRAWINGS. SEE 2/S4.2.
E. MFR'D ROOF TRUSS DESIGN LOADS: SEE TRUSS DESIGN CRITERIA 3/S4.2.


ROOF FRAMING NOTES C

- 01 STARTING POINT OF TRUSS LAYOUT.
- 02 VERIFY NECESSITY OF DOUBLE TRUSSES WITH TRUSS MFR. DUE TO POINT LOADING AND ADDITIONAL UNIFORM LOADING, TYPICAL.
- 03 COORDINATE BLOCKING WITH EXHAUST AND SUPPLY DUCT.
- 04 CONT 2x4 WD BRIDGING ON TOP OF BOTTOM CHORD, ADJUST AS REQUIRED FOR DUCT PLENUMS, MAX SPACING AT 7'-0" O.C. OR TIGHTER SPACING AS REQUIRED BY TRUSS DESIGN. SEE 8 & 9/S4.1 FOR BRIDGING LAP DETAIL.
- 05 SIMPSON MSTA 24 AT CORNER DBL TOP PLATE. CENTER STRAP ON CORNER.
- 06 (2) 2x6 BLOCKING W/ U26-2 HANGERS. TYP. AT EDGES OF ALL ROOF TOP EQUIPMENT AND ALL ROOF OPENINGS - SEE DET. 6 & 10/S4.2.
- 07 LOC. OF HOOD. SEE HOOD DRAWINGS FOR HOOD ATTACHMENT DETAIL 13/S4.1.
- 08 (2) 2x6 LEDGER REF. 6/S4.1.
- 09 DIMENSION IS FROM INSIDE FACE OF WALL FRAMING.
- 10 HVAC ROOF OPENING FOR DUCT. VERIFY SIZE WITH HVAC MFR. & MECHANICAL DWGS.
- 11 (2) 2x6 BUILT-UP COLUMN AT TRUSS BEARING, TYP. AT GIRDER. TRUSS ONLY. REF. DETAIL 12/S4.2.
- 12 CANOPY- SEE ARCH. DWGS.
- 13 CANOPY FRAMING AND COLUMNS PER CANOPY MANUFACTURER. CANOPY SUPPLIER SHALL COORDINATE LOCATION WITH ARCH. PLANS. SEE S1.0 FOR ADD'L INFO.
- 14 2x6 @ 16" O.C. WITH SIMPSON LUS26 HANGER EA. END.
- 15 PLYWOOD ROOF SHEATHING. SEE NAILING SCHEDULE, THIS SHEET.
- 16 HATCH DENOTES LOCATION OF KICKERS. SEE 4/S4.1 FOR ADDITIONAL INFORMATION REGARDING KICKERS.
- 17 INTERIOR SHEAR WALL BELOW. ALIGN DINING SIDE OF WALL WITH SIDE OF TRUSS. SEE DTL. 2/S4.4.
- 18 NOT USED.
- 19 SEE MECHANICAL DRAWINGS FOR SIZE OF SELECTED RTU OPTION.
- 20 2x10 @ 16" O.C. WITH SIMPSON LUS26 HANGER EA. END. PROVIDE CONT. BLOCKING BETWEEN 2x's AT MIDSPAN.
- 21 PORTION OF PARAPET IS ABOVE ROOF OF WALK-IN COOLER. SEE ELEVATION FOR DETAILS.
- 22 RTU LOCATION POINT.
- 23 (2) 2x6 BLOCKING W/ U26-2 HANGERS EACH END.
- 24 2x BLOCKING AT ALL DIAGONAL BRACES AND COLUMNS. SEE 1 & 4/S4.
- 25 SCREEN WALL TO BE DELEGATED DESIGN. REFER TO DELEGATED DESIGN NOTES ON SHEET S0.1. REF. ARCH'L. PLANS FOR ADDITIONAL INFORMATION.
- 26 SCREEN WALL HORIZ. BRACES. BRACES AND ANCHORAGE TO BUILDING TO BE DESIGNED/SUPPLIED BY SCREEN WALL MANUFACTURER. SCREEN WALL REACTIONS AT BUILDING SHALL BE PROVIDED TO E.O.R. FOR REVIEW PRIOR TO ORDERING AND/OR FABRICATION OF MATERIALS FOR THE PROJECT. REFER TO DELEGATED DESIGN NOTES ON SHEET S0.1. REF. ARCH'L. PLANS FOR ADDITIONAL INFORMATION.


ROOF FRAMING KEYNOTES B

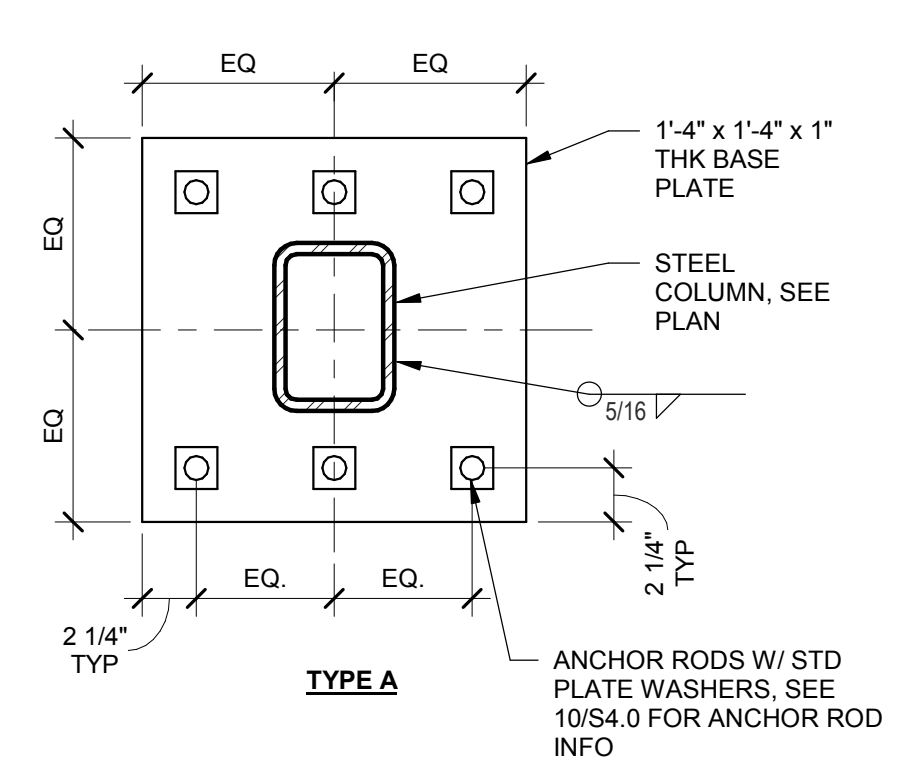


BASE PLATE DETAILS 1 1/2" = 1'-0" **9**

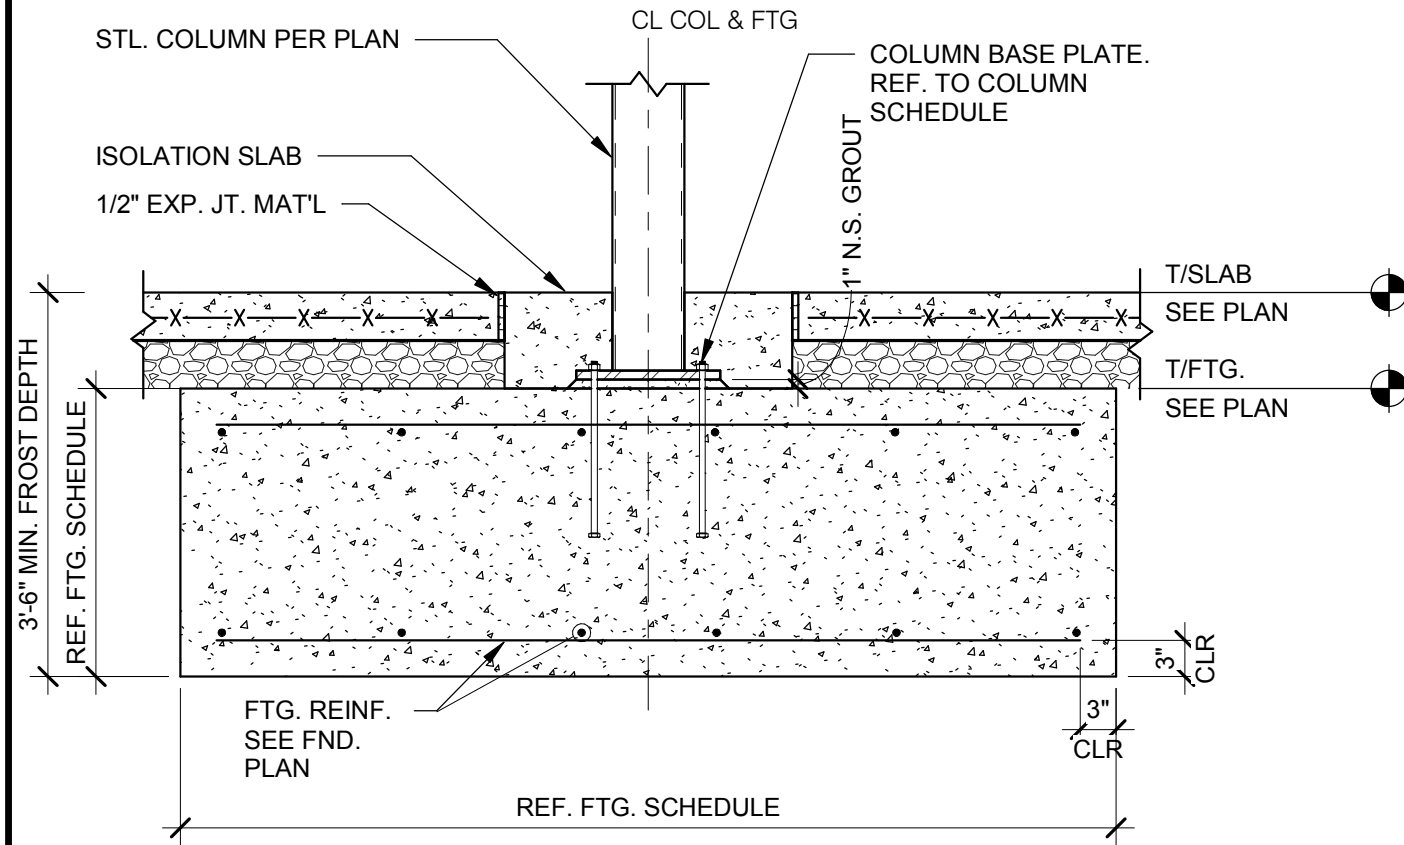


FOOTING AT COLUMN 3/4" = 1'-0" **5**

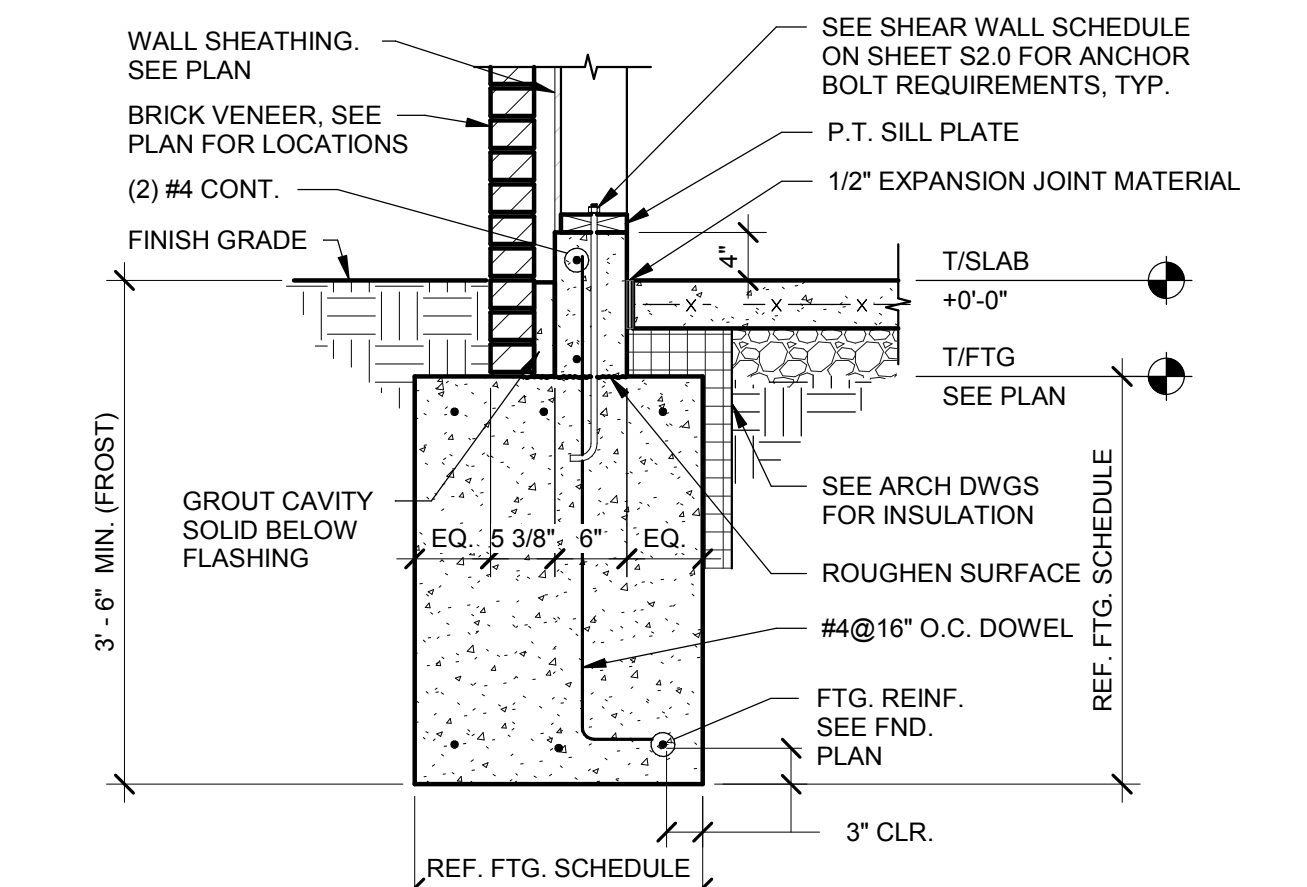


FOOTING AT SIDE AND REAR WALLS 3/4" = 1'-0" **1**

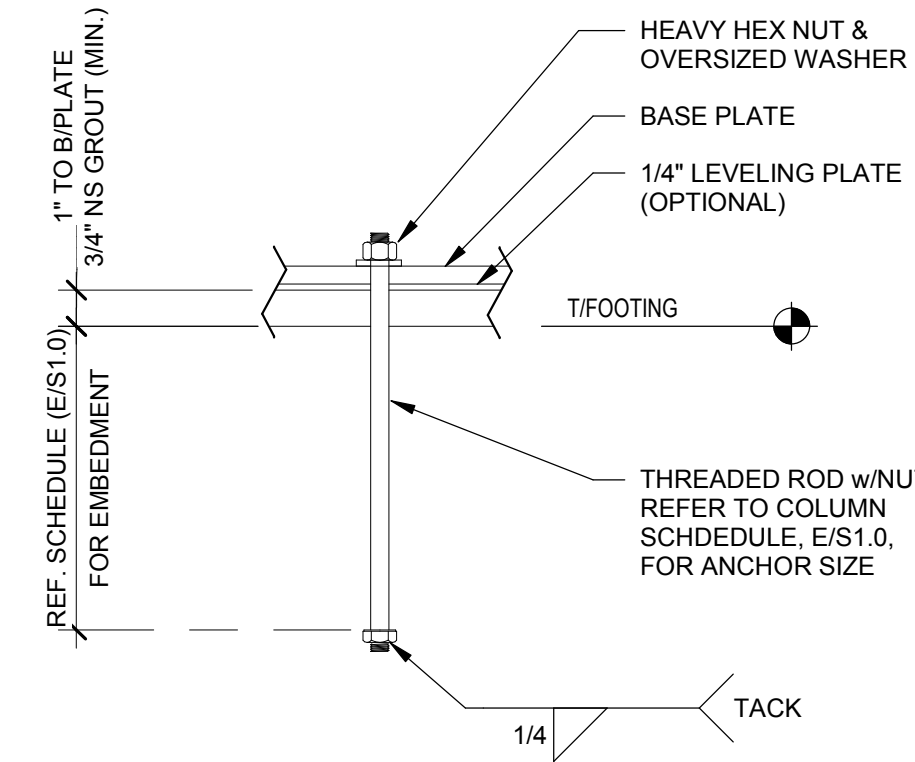


TYP. ANCHOR ROD DETAIL 3/4" = 1'-0" **10**

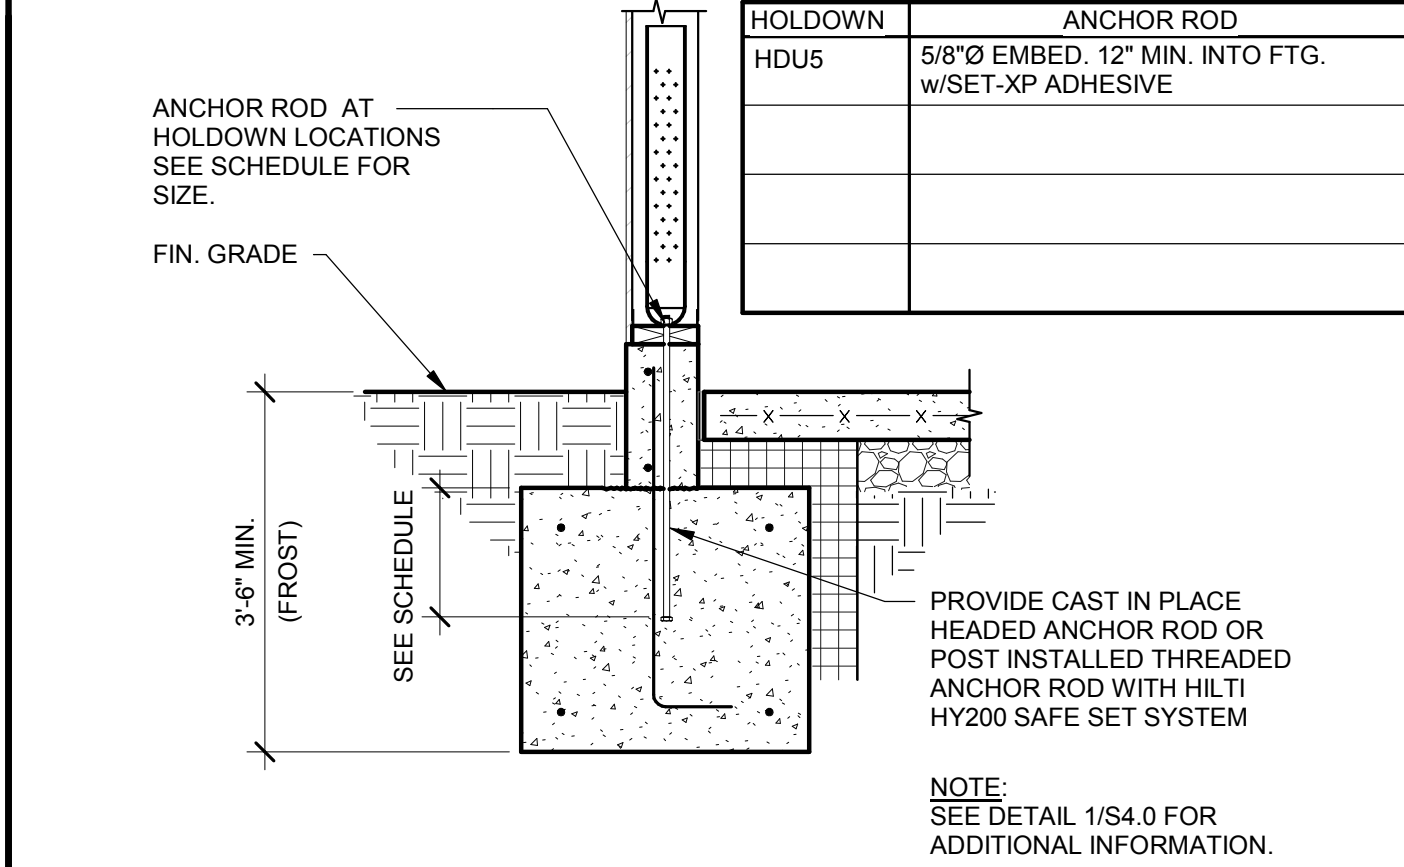


HOLDOWN DETAIL 3/4" = 1'-0" **6**

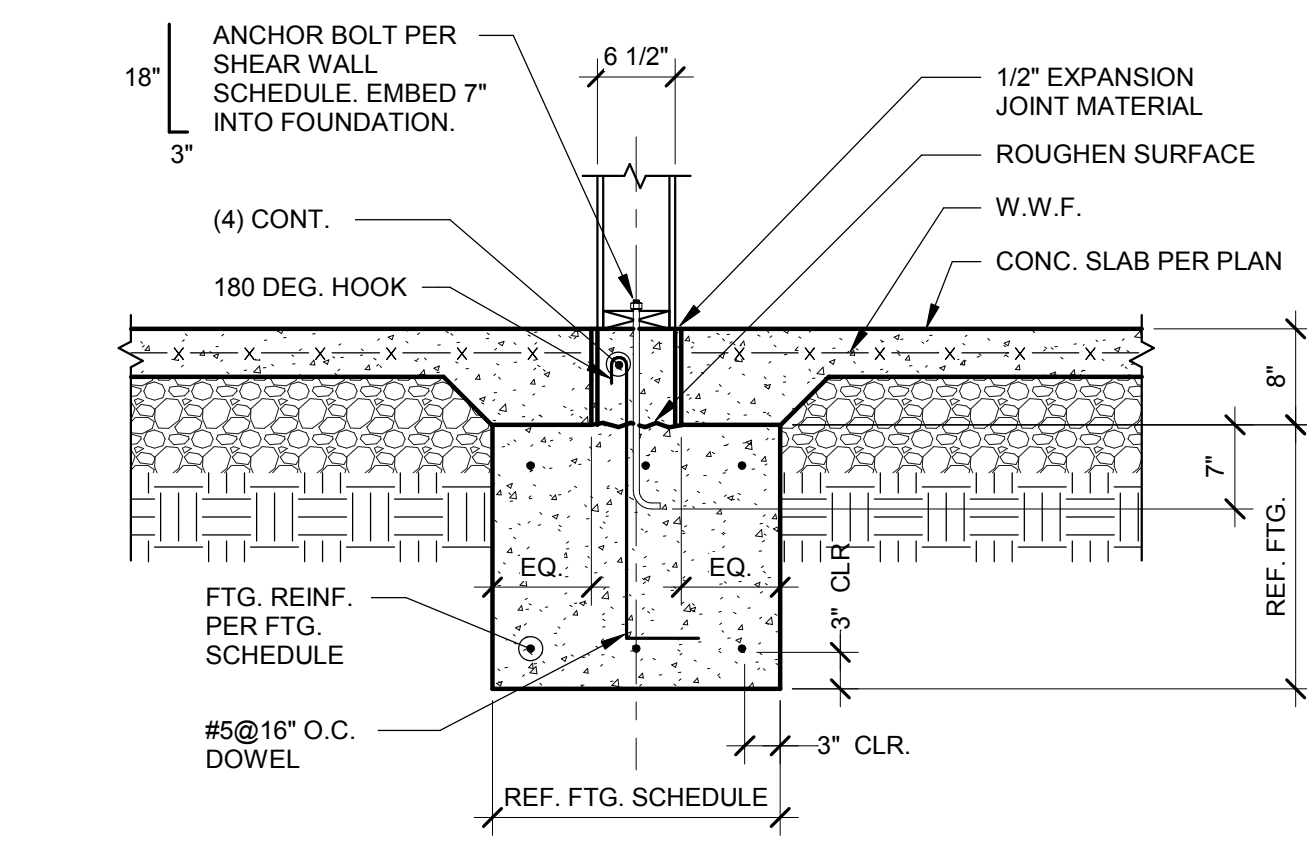


INTERIOR FOOTING AT COOLER 3/4" = 1'-0" **2**

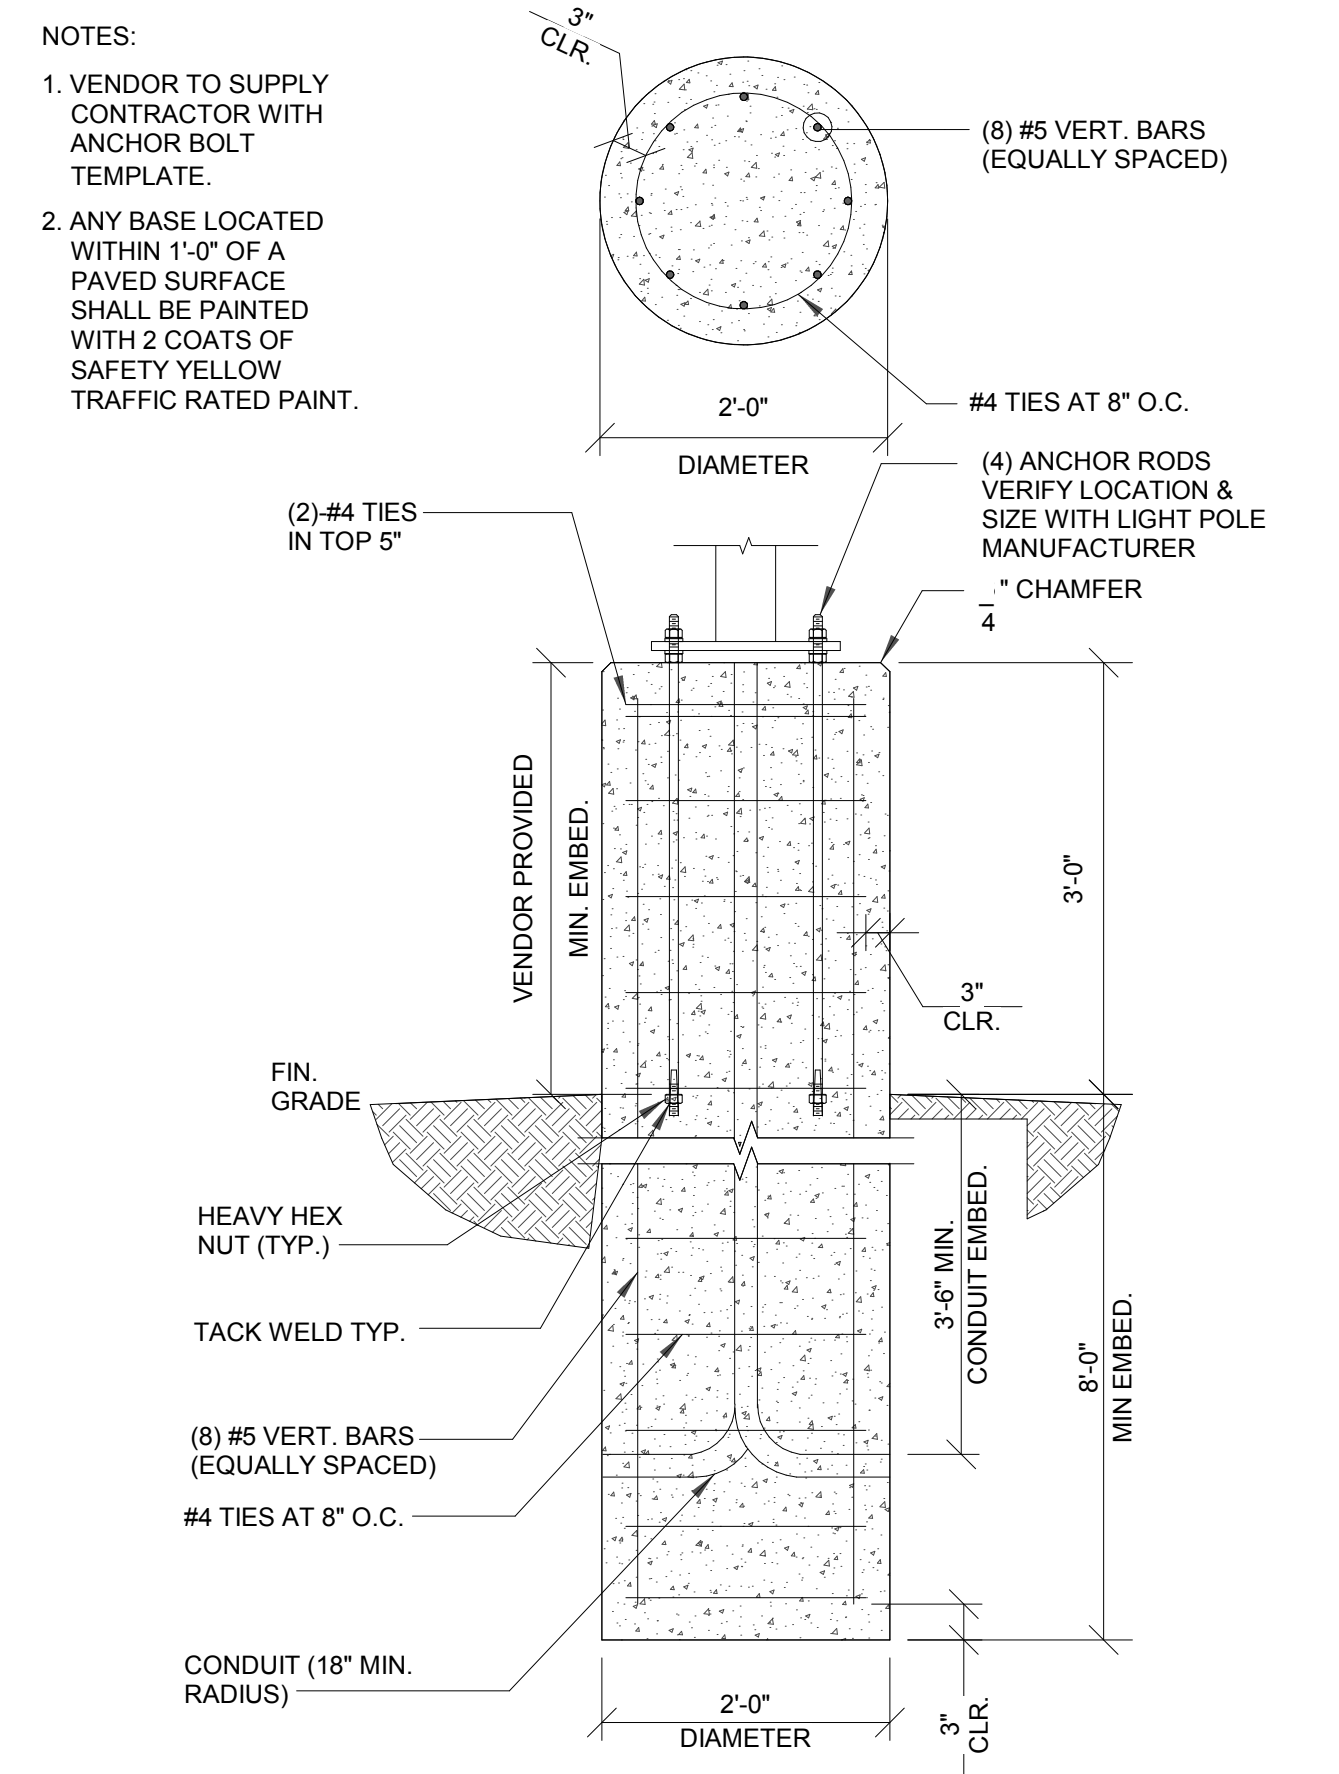


LIGHT POLE FOUNDATION DETAIL 3/4" = 1'-0" **12**

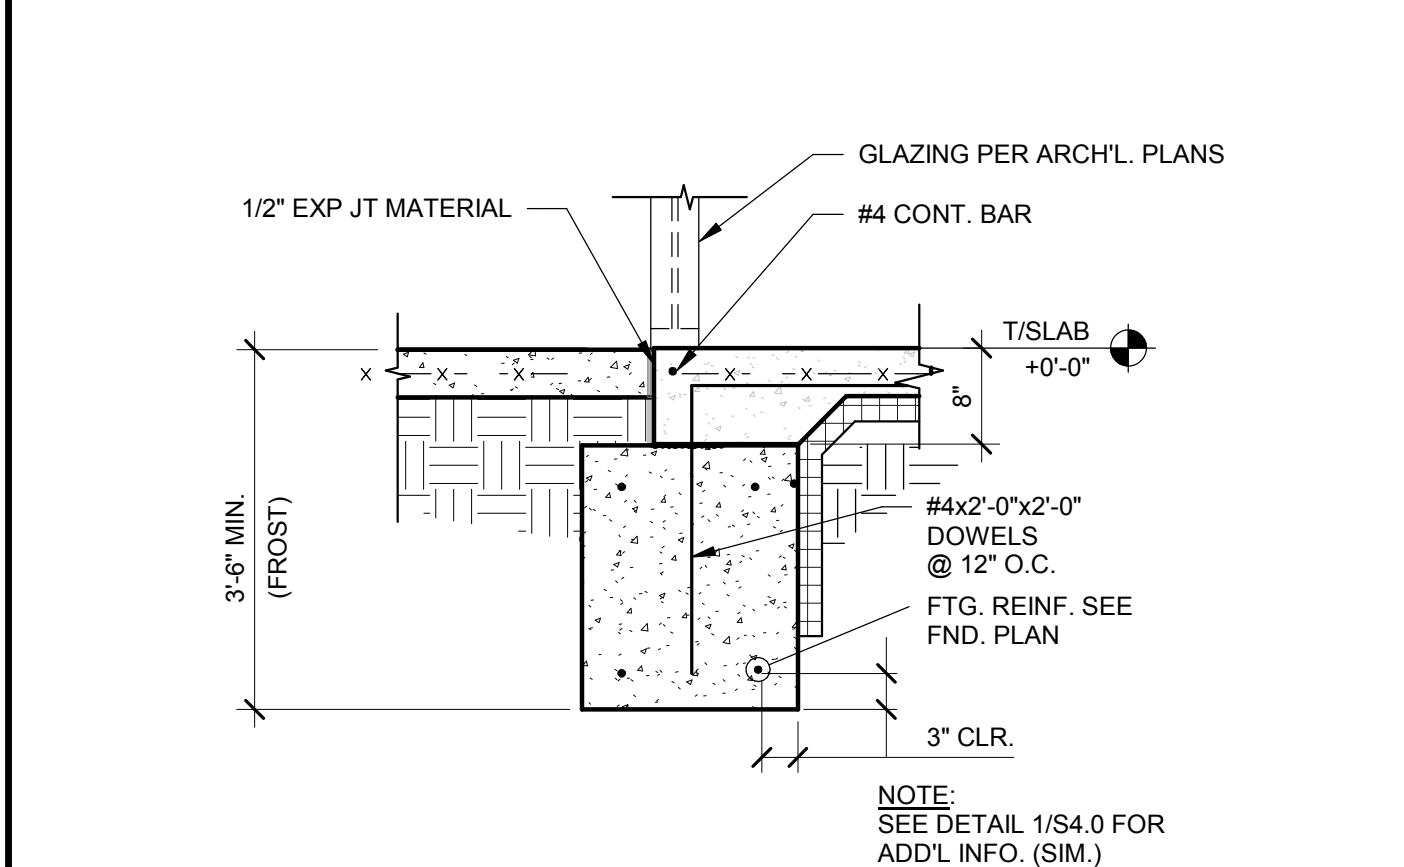


WINDOW SILL BRACING DETAIL 3/4" = 1'-0" **7**

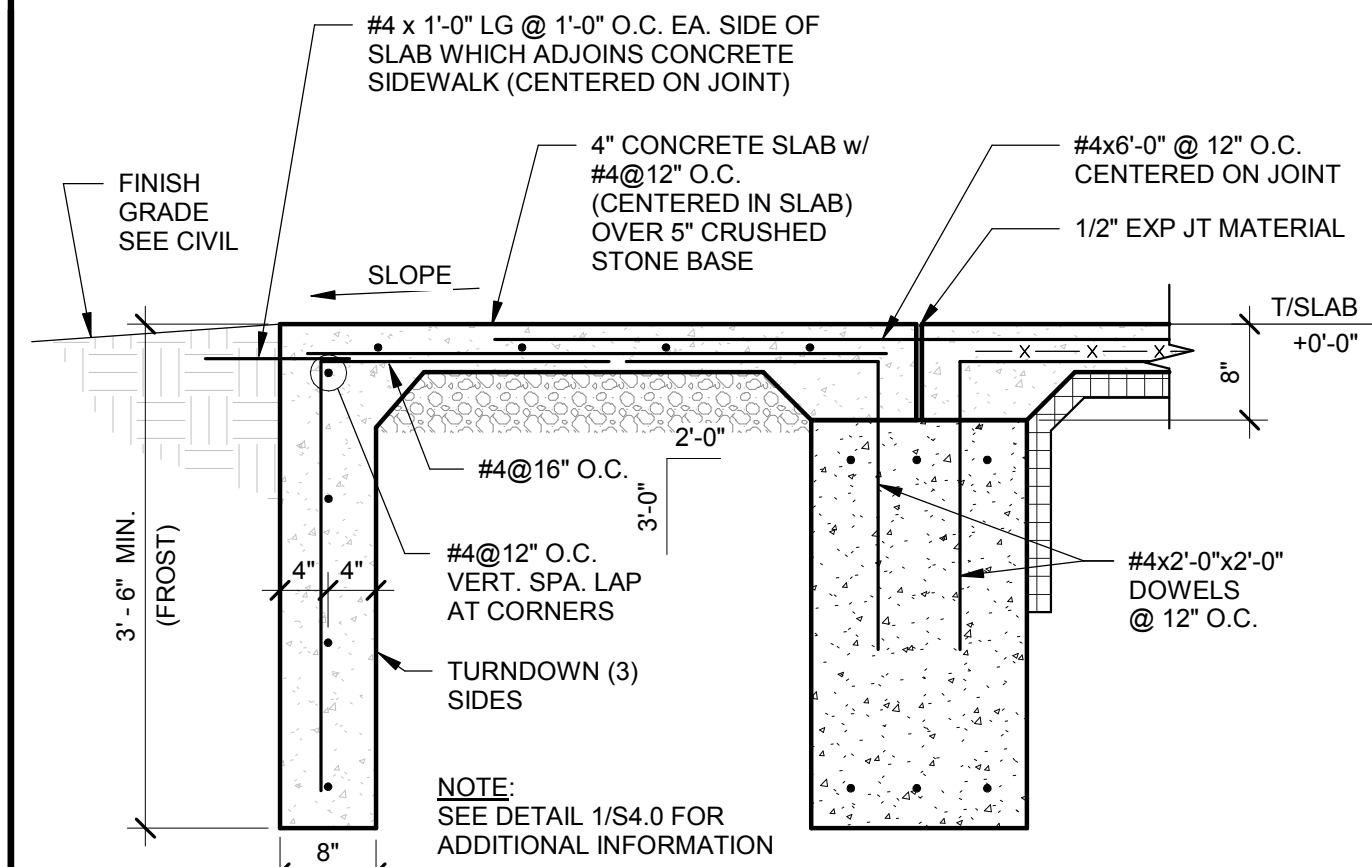

FOOTING AT FULL HEIGHT OPENING 3/4" = 1'-0" **3**

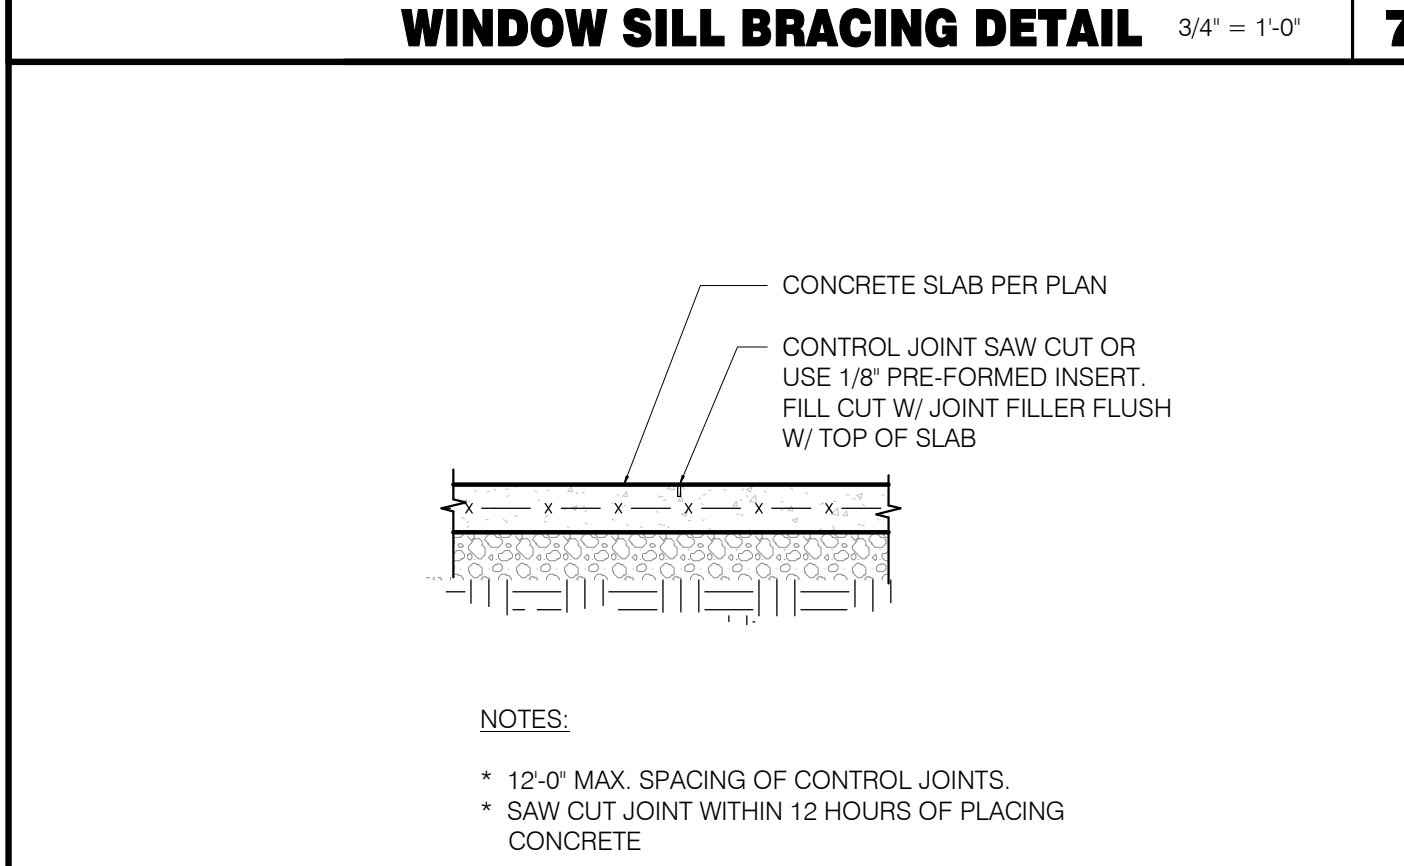

TYP. SLAB JOINT DETAIL 3/4" = 1'-0" **8**

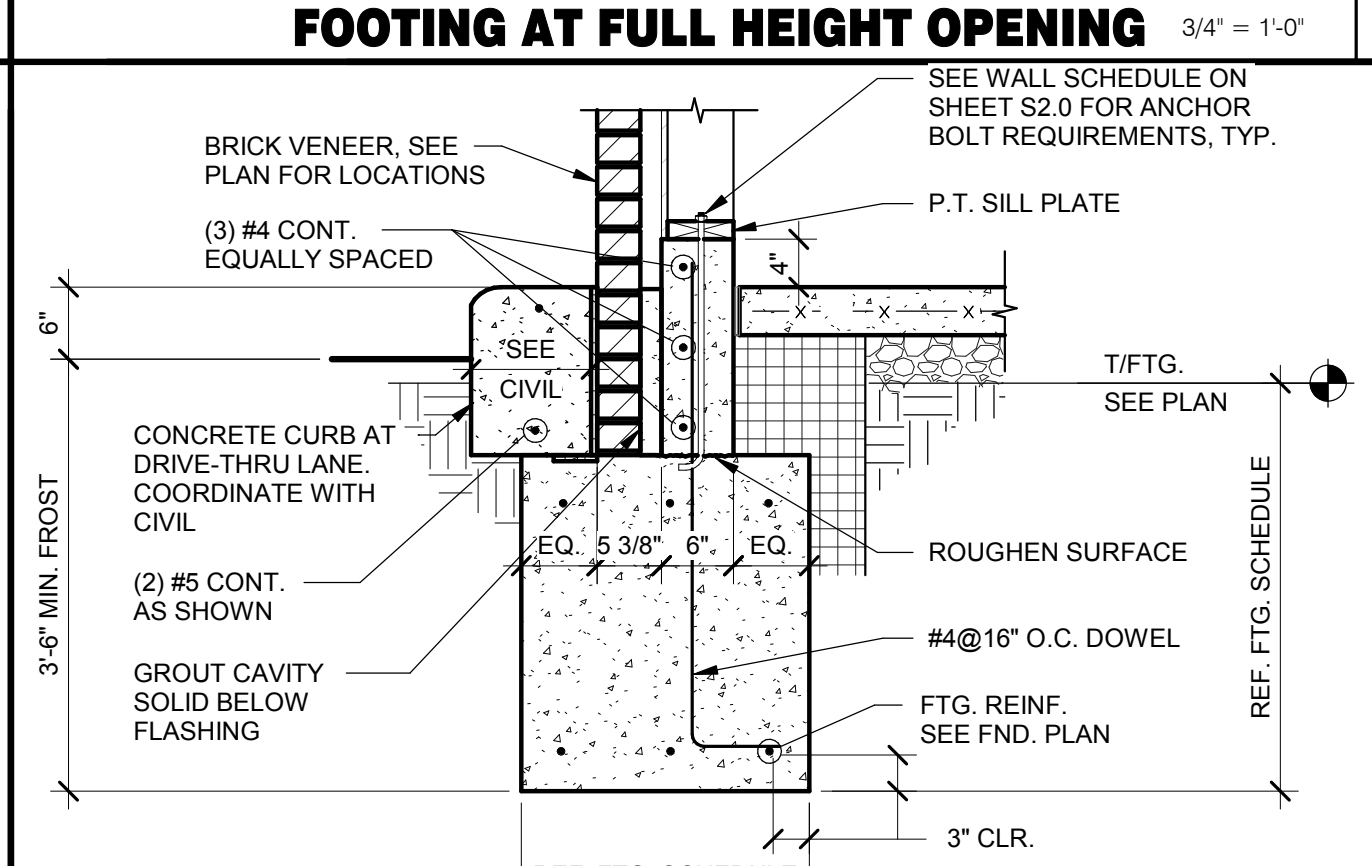

FOOTING AT DRIVE THRU 3/4" = 1'-0" **4**

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 04.08.21
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 313354
STORE NUMBER: 449523
PA/PM: JN
DRAWN BY.: DL
JOB NO.: 2018088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




**ENDEAVOR 2.0
STRUCTURAL
DETAILS**


S4.0

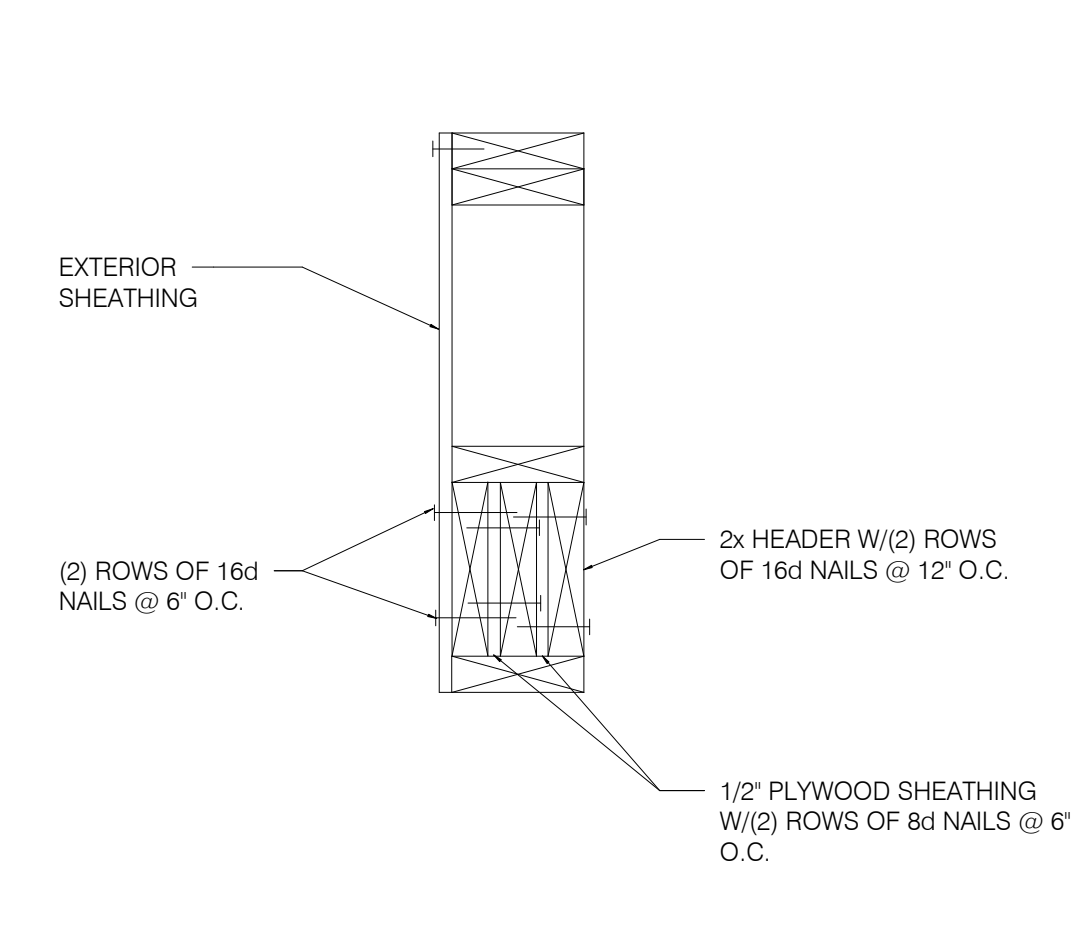


TYP. MULTIPLE HEADER 1-1/2" = 1'-0" **14**

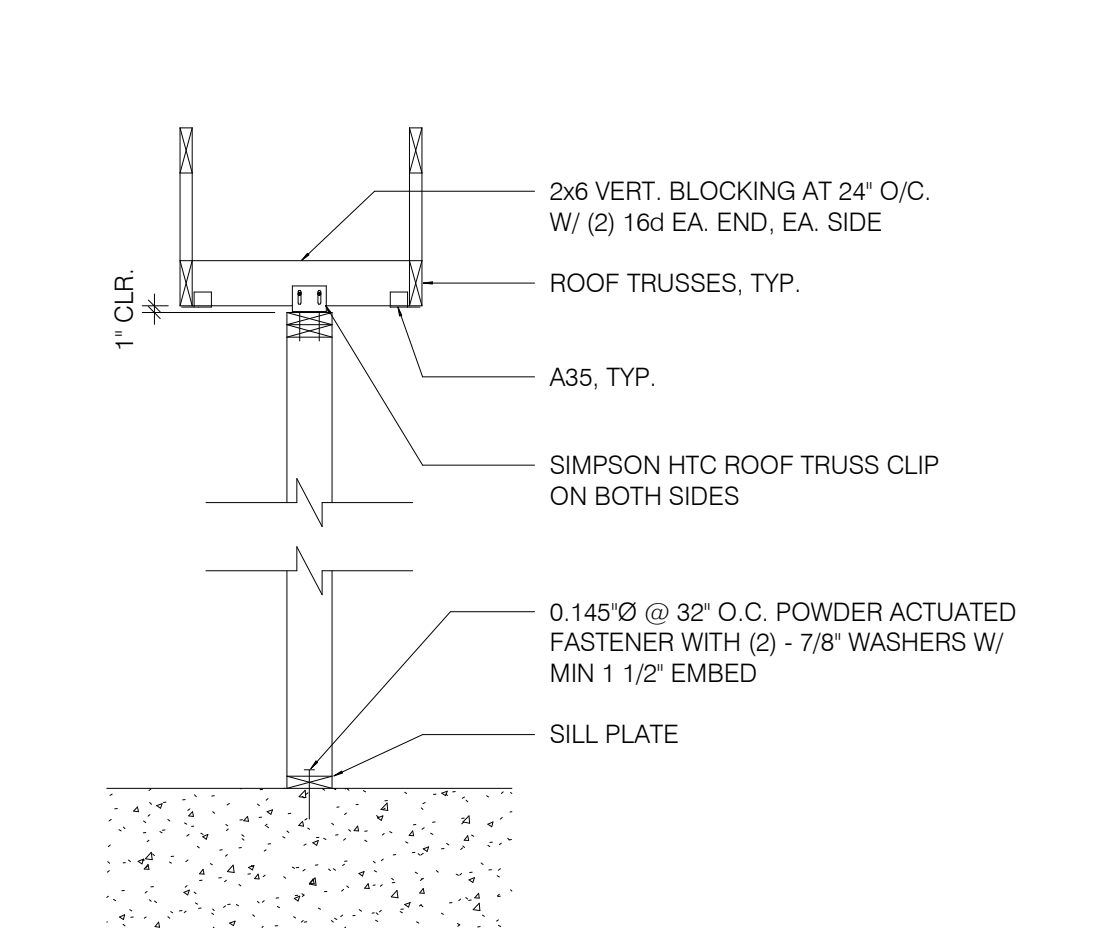


SUPPORT - PARALLEL TO TRUSS 1/2" = 1'-0" **10**

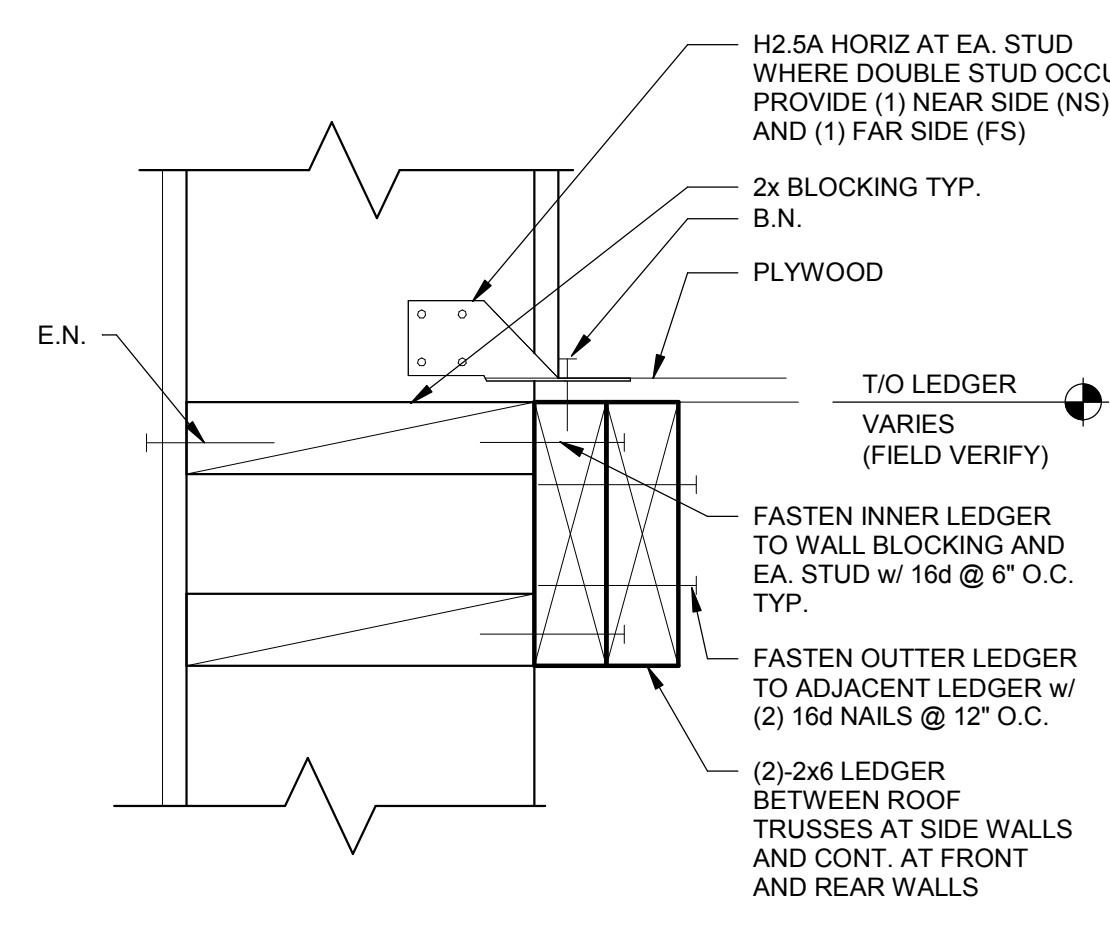


LEDGER DETAIL 3" = 1'-0" **6**

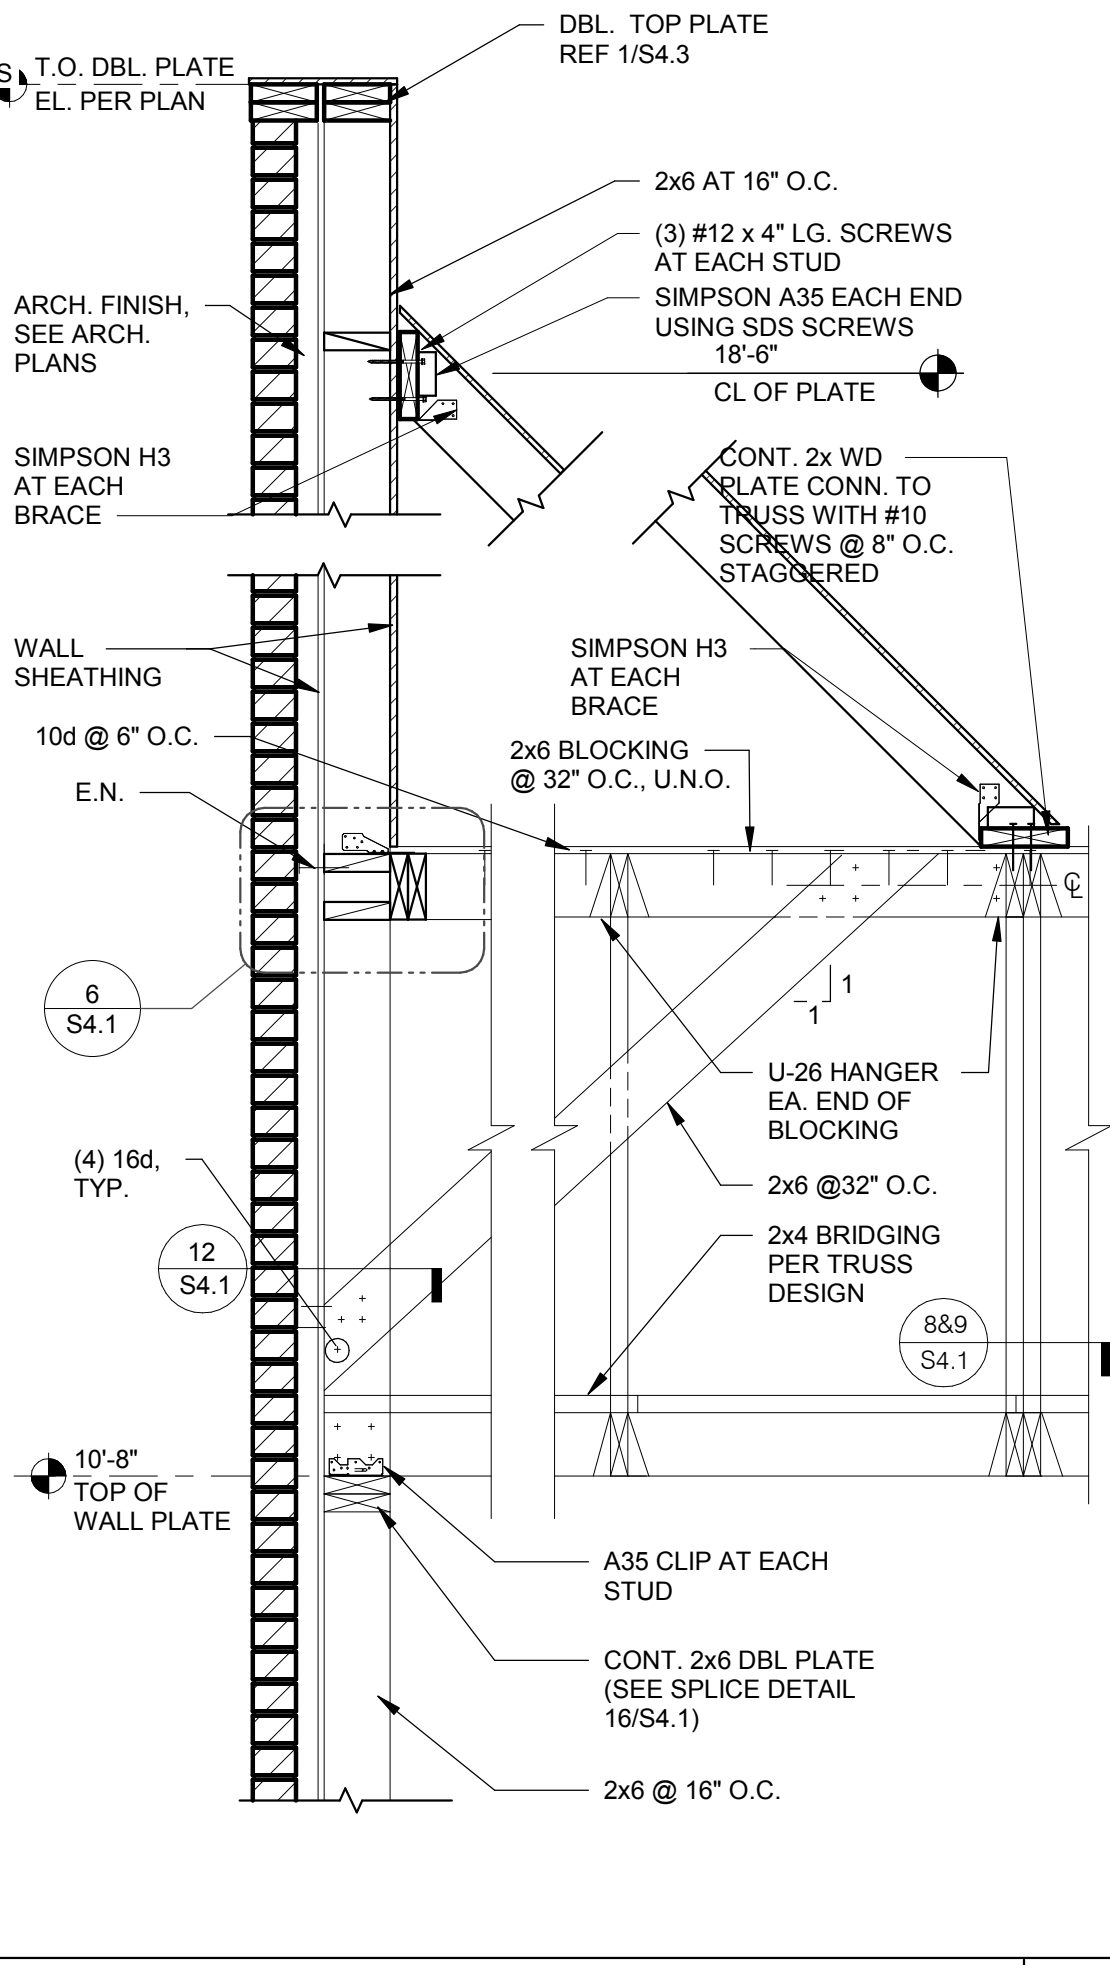


REAR WALL SECTION N.T.S. **4**

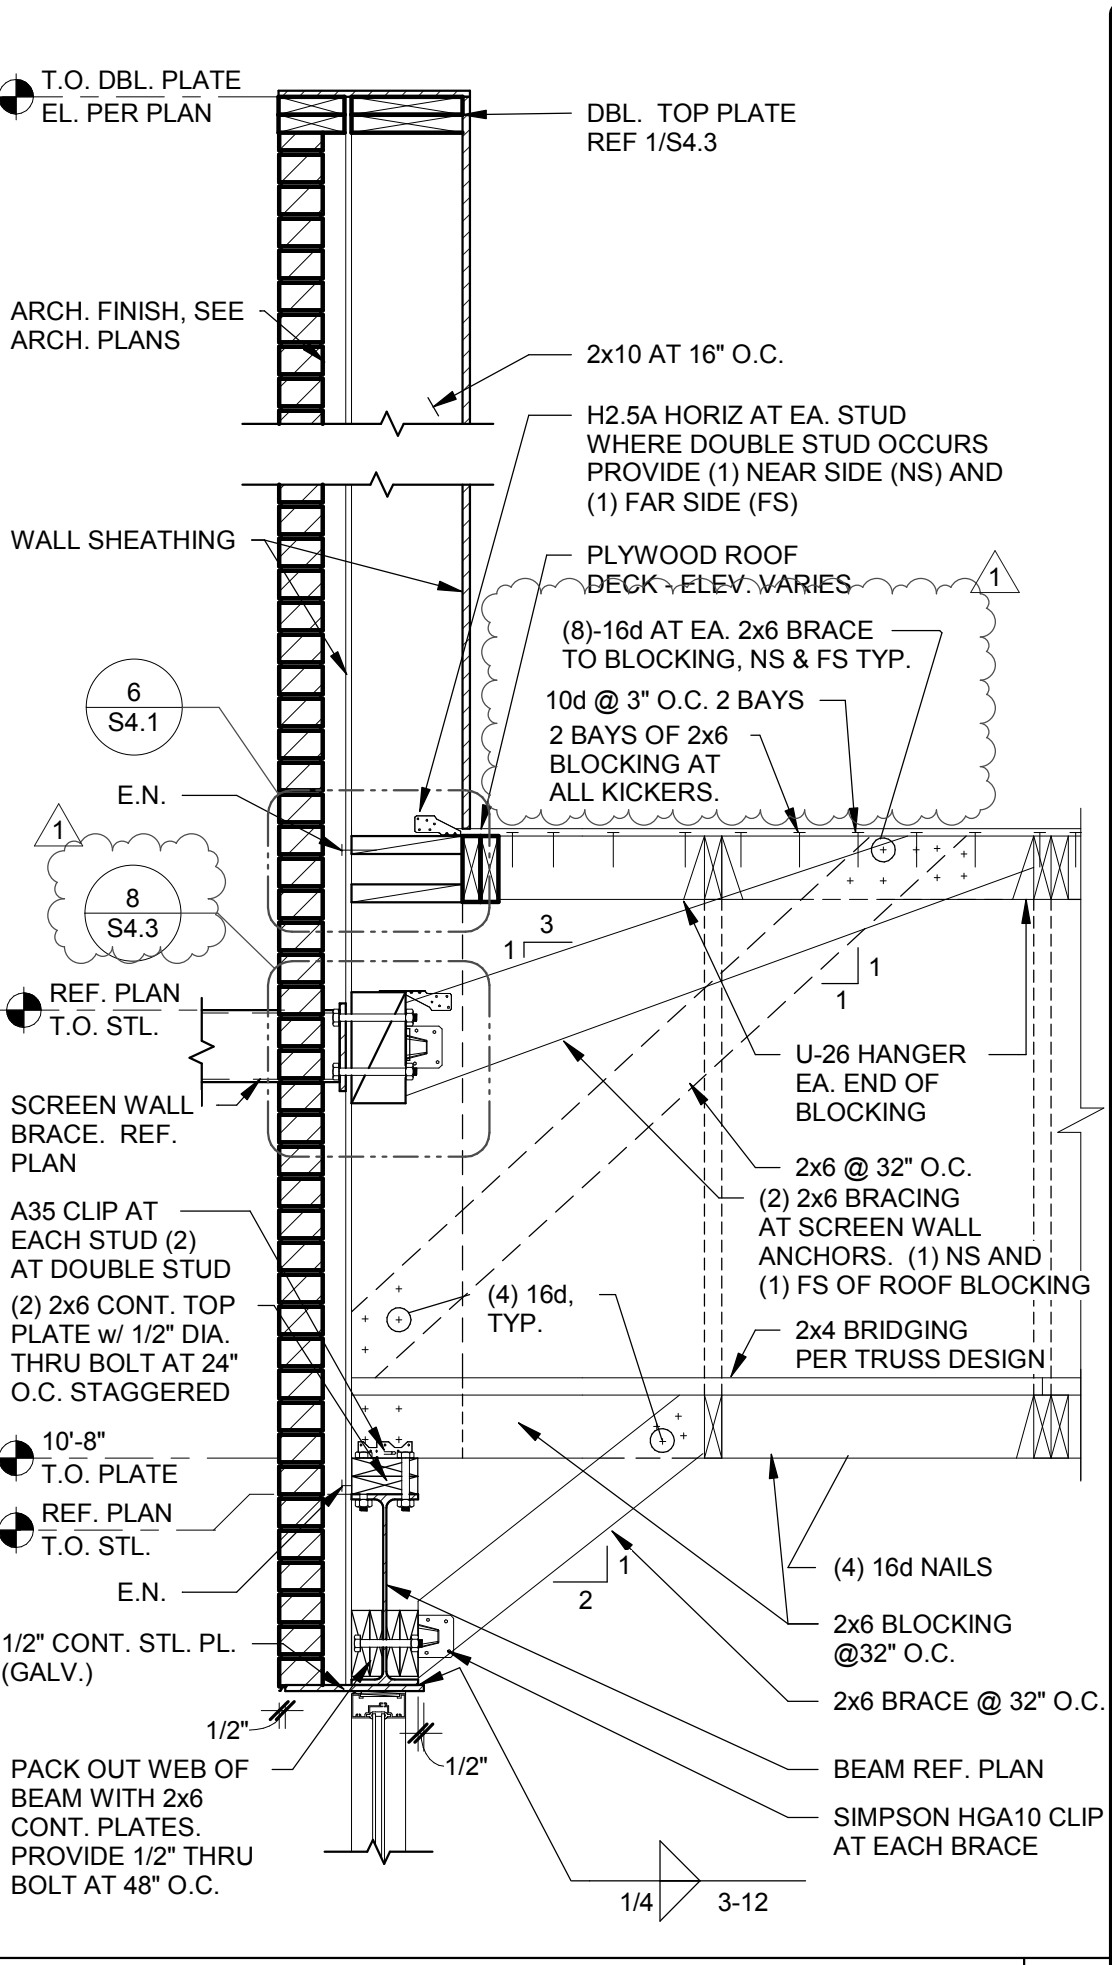


FRONT WALL SECTION N.T.S. **1**

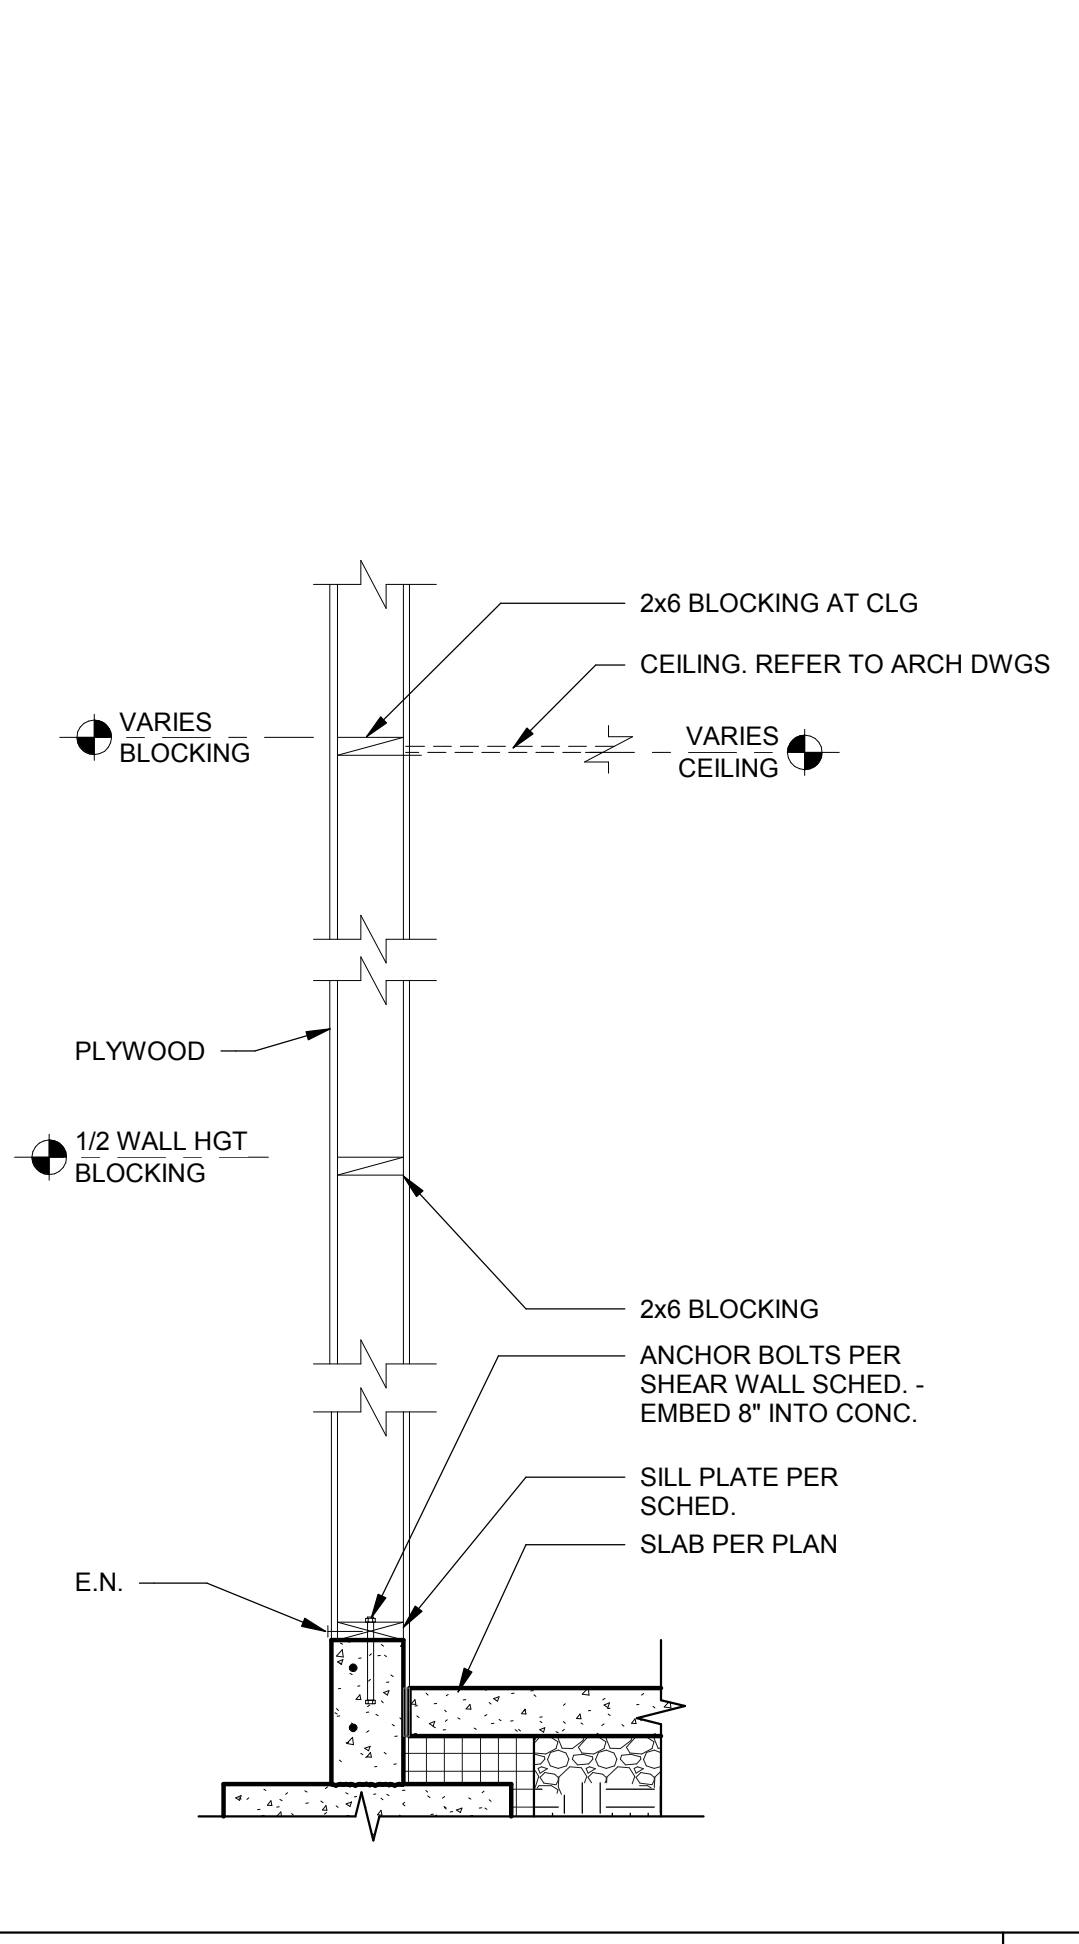


TYPICAL WALL BELOW TRUSS 3/4" = 1'-0" **15**

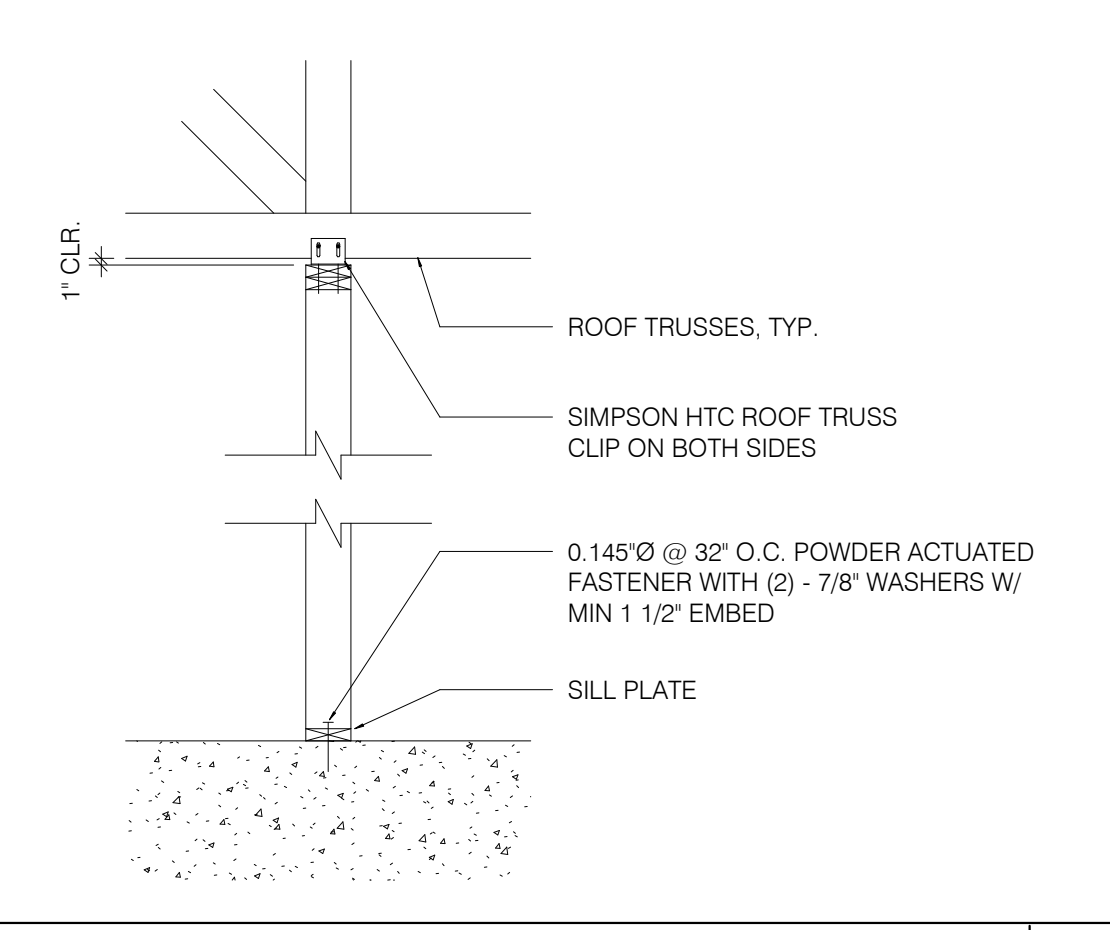


SUPPORT PERP. TO TRUSS 1/2" = 1'-0" **11**

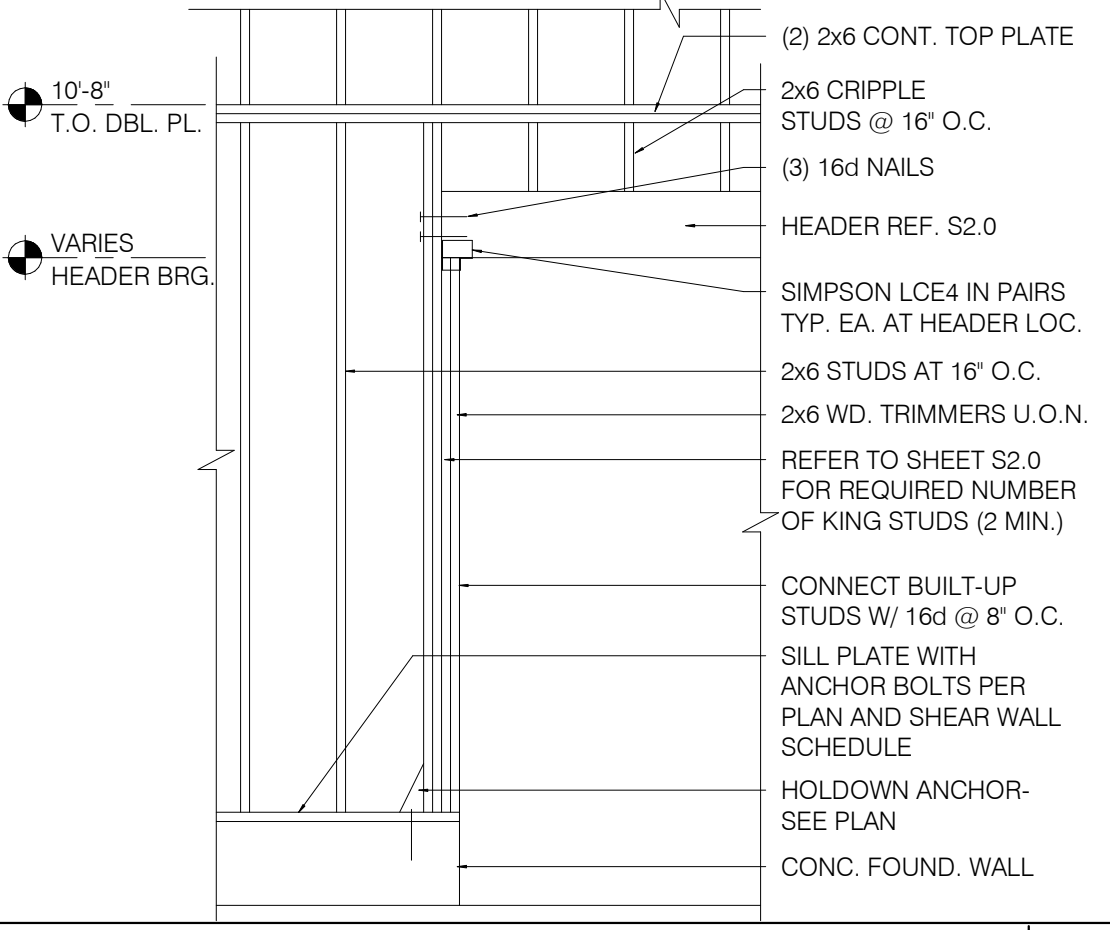

FRAMING ELEVATION AT OPENING N.T.S. **7**

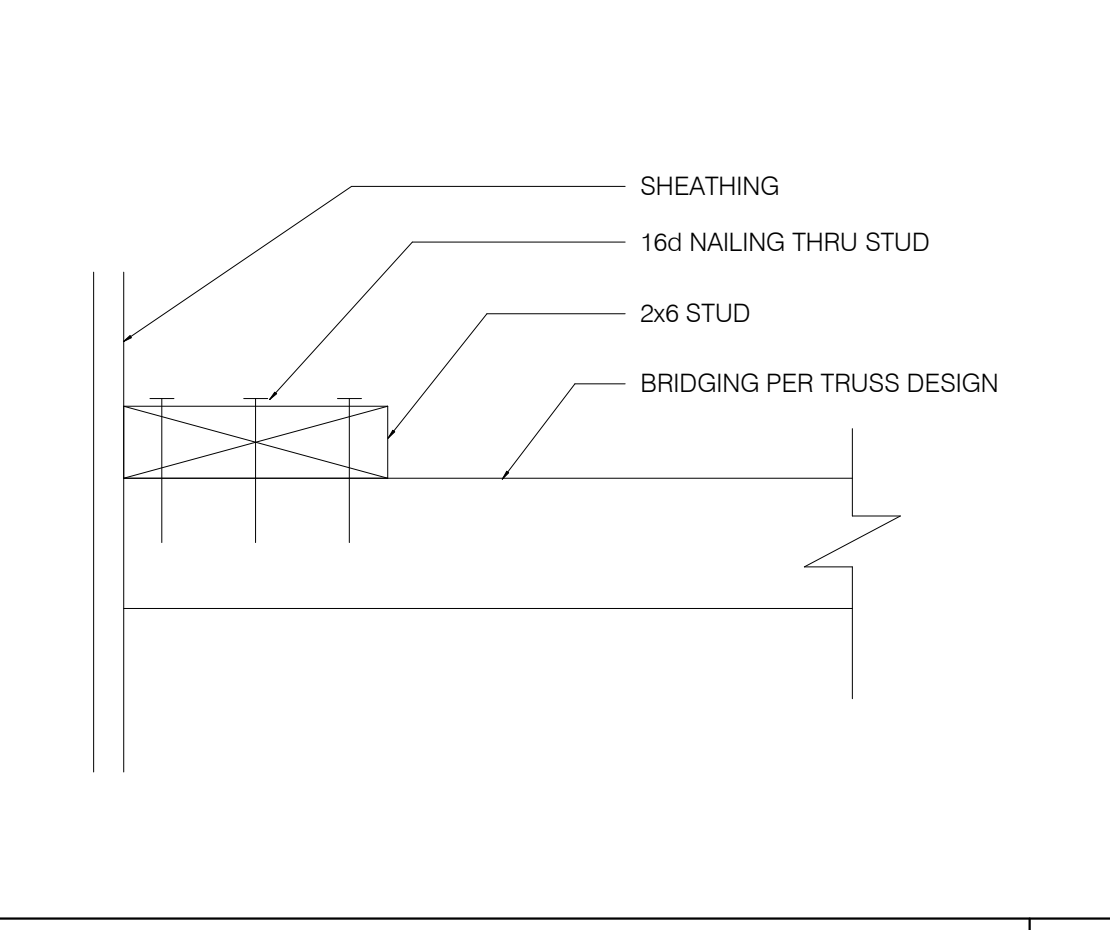

BRIDGING DETAIL 3" = 1'-0" **12**

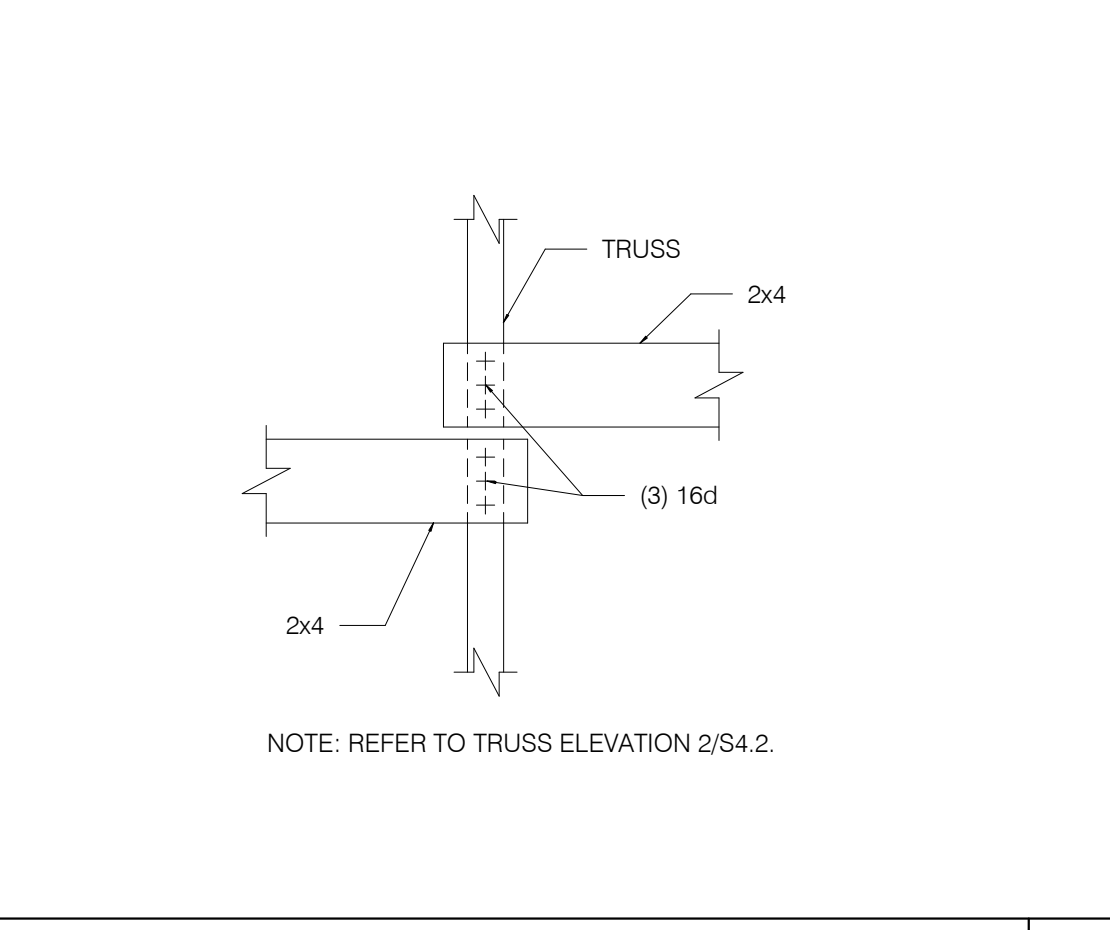

BRIDGING LAP DETAIL 1/4" = 1'-0" **8**



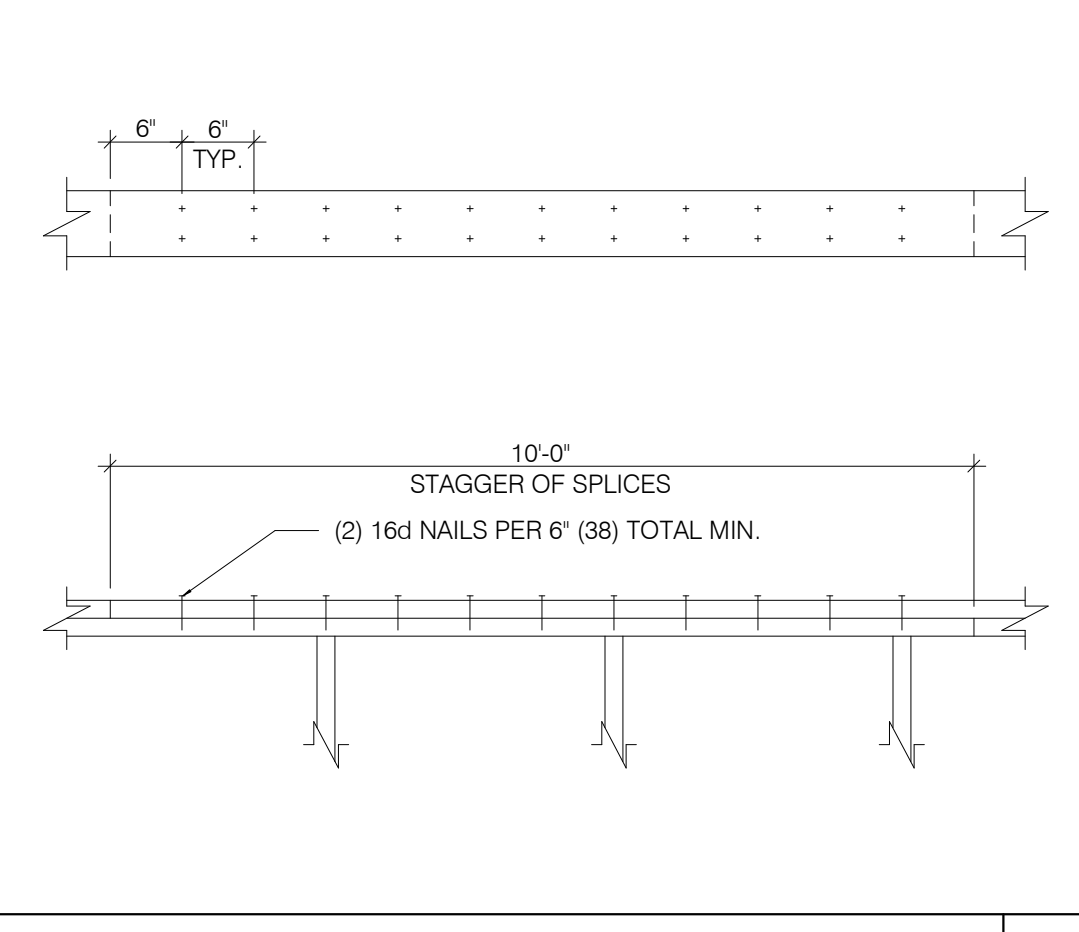



PLATE LAP DETAIL 1" = 1'-0" **16**

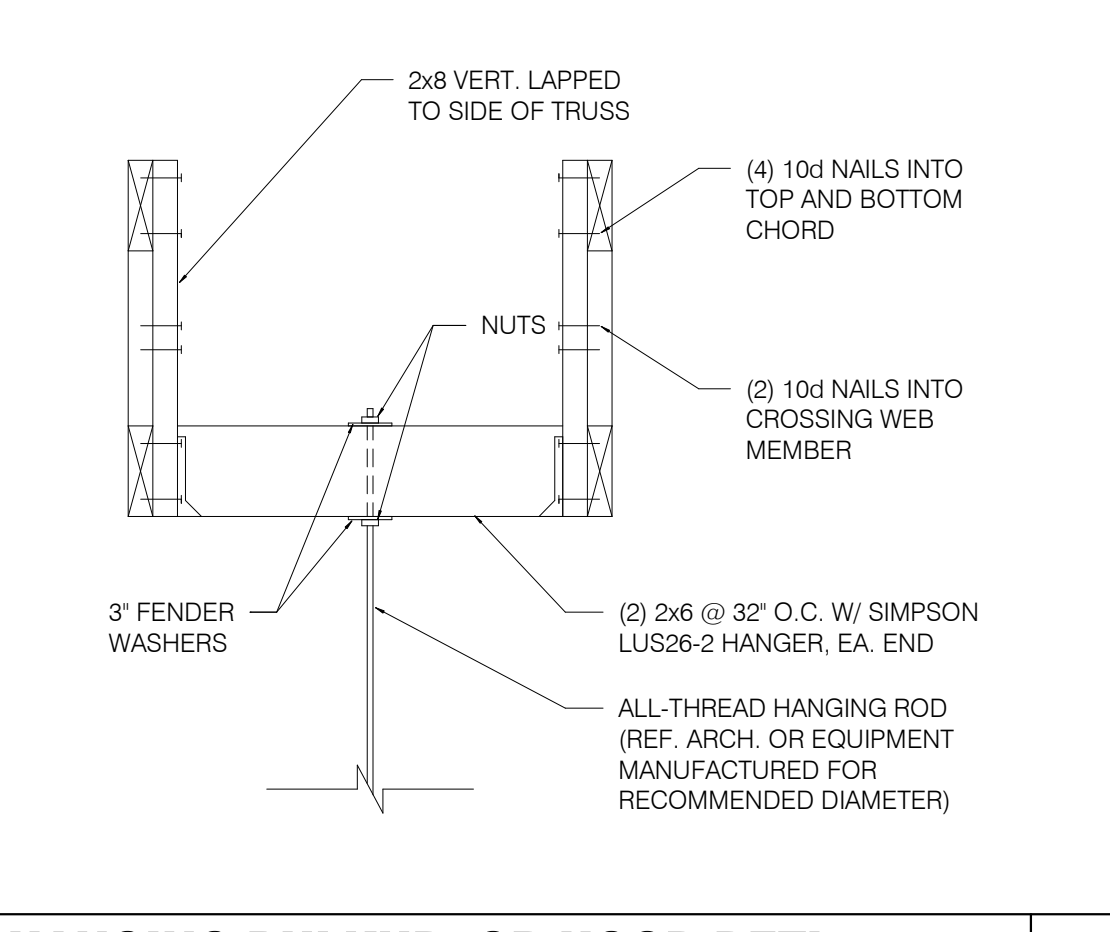


HANGING BULKHD. OR HOOD DETL. N.T.S. **13**

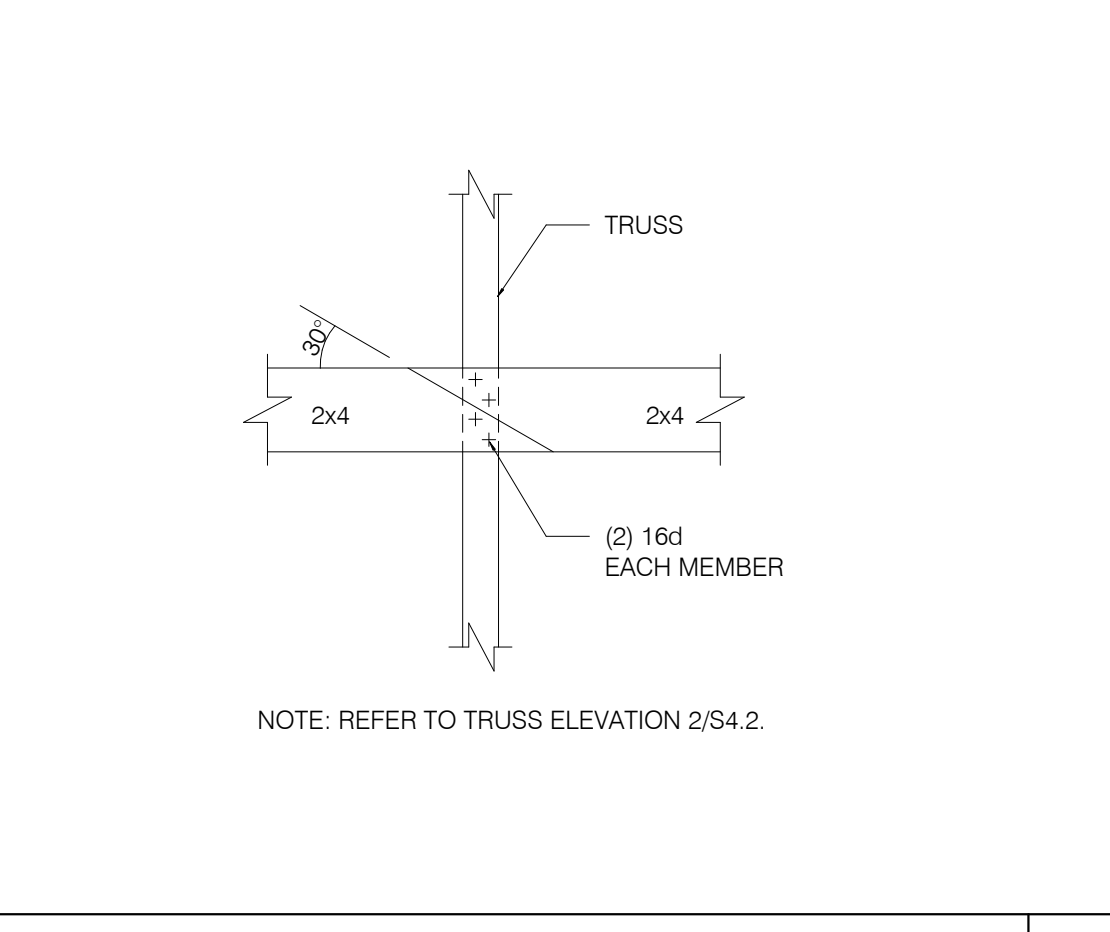

BRIDGING LAP DETAIL AT OPEN CLG. N.T.S. **9**

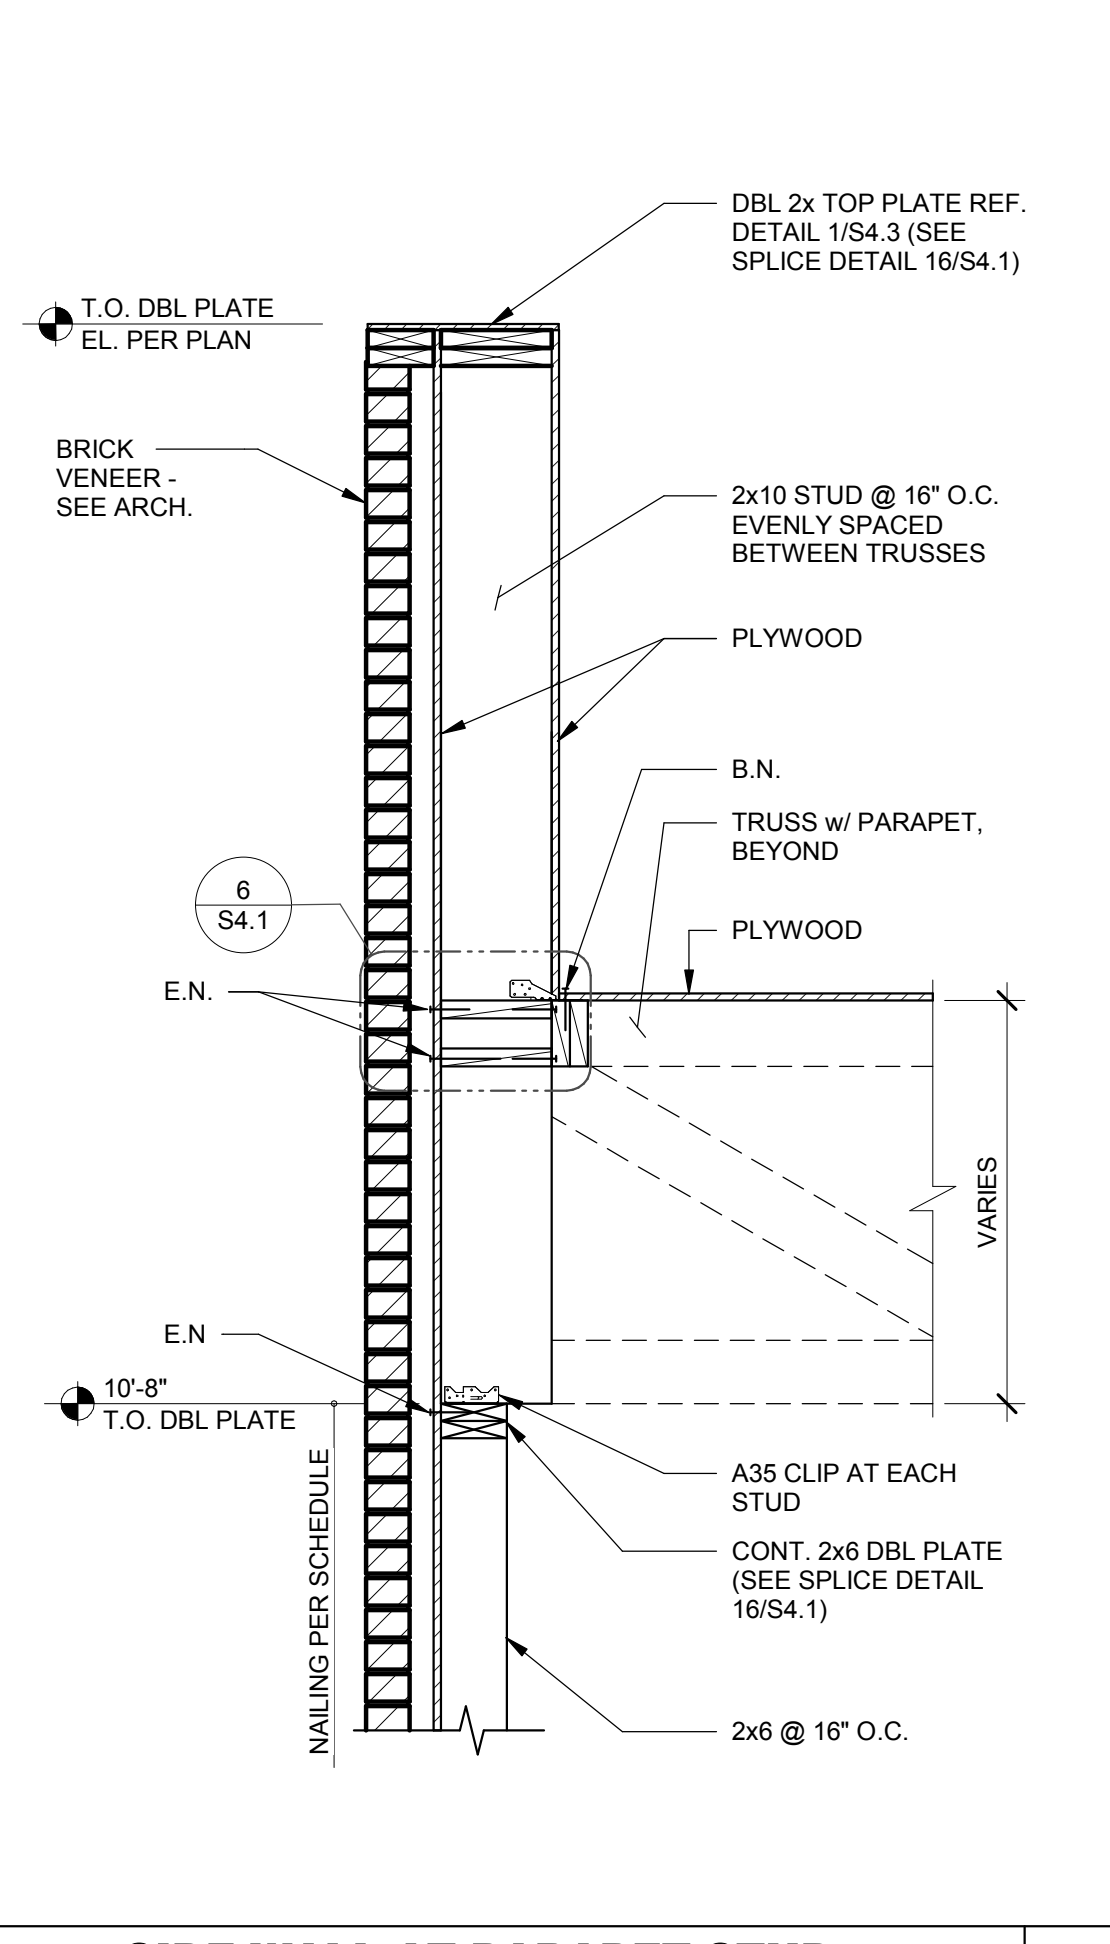

SIDE WALL AT PARAPET STUD 3/4" = 1'-0" **5**

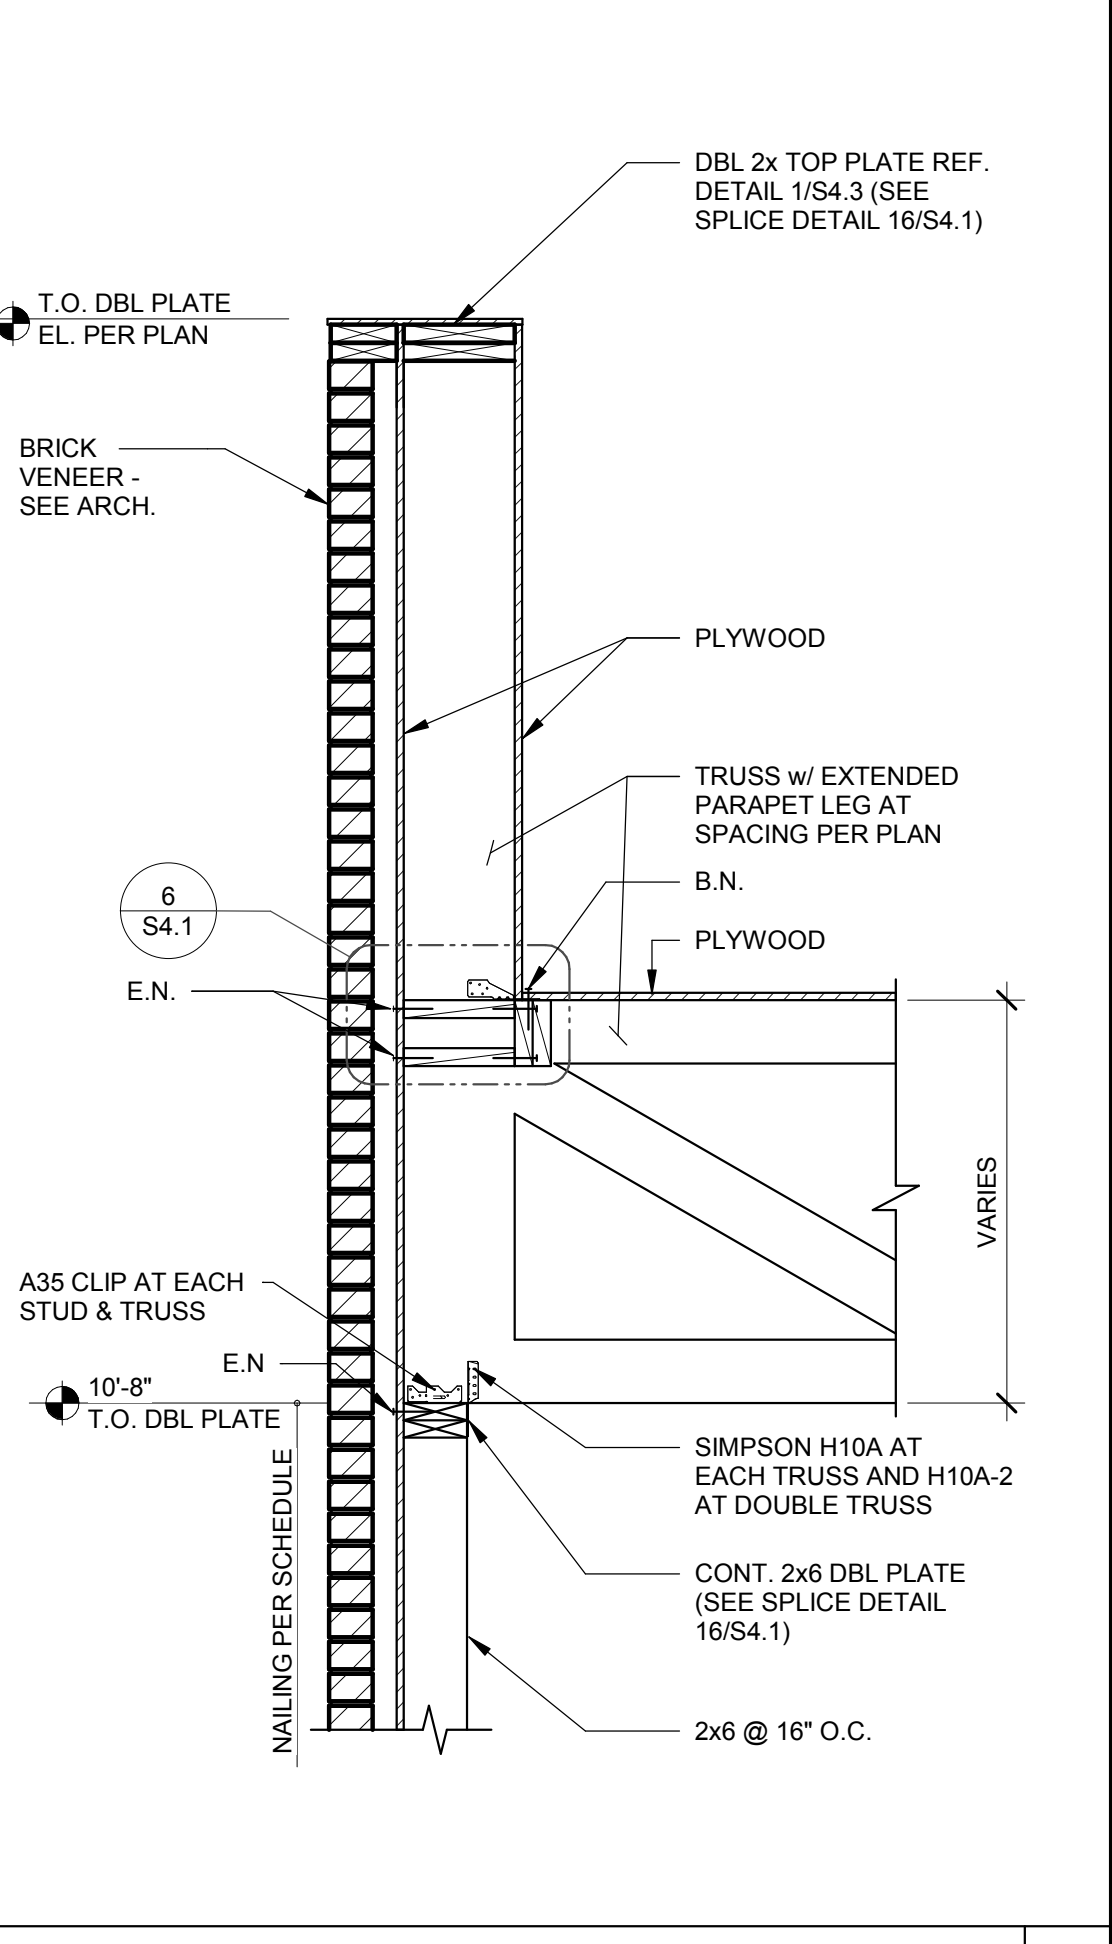

SIDE WALL AT TRUSS N.T.S. **2**

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 04.08.21
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 313354
STORE NUMBER: 449523
PA/PM: JN
DRAWN BY: DL
JOB NO.: 2018088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
STRUCTURAL
DETAILS

S4.1


C:\Users\jcoo\Documents\Taco Bell\STRUC\ENDEAVOR 2.0

CONNECTION:

- JOIST TO SILL OR GIRDER, TOENAIL
- BRIDGING TO JOIST, TOENAIL EACH END
- 1"x6" (25MMx152MM) SUBFLOOR OR LESS TO JOIST, FACE NAIL
- WIDER THAN 1" x 6" (25MMx152MM) SUBFLOOR TO JOIST, FACE NAIL
- 2" (52MM) SUBFLOOR TO GIRDER, BLIND AND FACE NAIL
- SOLE PLATE TO JOIST OR BLOCKING, TYPICAL FACE NAIL
- SOLE PLATE TO JOIST OR BLOCKING, AT BRACED W. PANELS
- TOP PLATE TO STUD, END NAIL
- STUD TO SOLE PLATE
- DOUBLE STUDS, FACE NAIL
- DOUBLE TOP PLATES, TYPICAL FACE NAIL
- DOUBLE TOP PLATES, LAP SPLICE
- BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE, TOENAIL
- RIM JOIST TO TOP PLATE, TOENAIL
- TOP PLATES, LAPS AND INTERSECTIONS, FACE NAIL
- CONTINUOUS HEADER, TWO PIECES
- CEILING JOISTS TO PLATE, TOENAIL
- CONTINUOUS HEADER TO STUD, TOENAIL
- CEILING JOISTS, LAP OVER PARTITIONS, FACE NAIL
- CEILING JOISTS TO PARALLEL RAFTERS, FACE NAIL
- RAFTER TO PLATE, TOENAIL
- 1" (25MM) BRACE TO EACH STUD AND PLATE, FACE NAIL
- 1"x8" SHEATHING OR LESS TO EACH BEARING, FACE NAIL
- WIDER THAN 1"x8" SHEATHING TO EACH BEARING, FACE NAIL
- BUILT-UP CORNER STUDS
- 2" PLANKS
- 2x6 BOX BEAM / HEADER
- BUILT-UP GIRDER AND BEAMS

NAILING:

- (3-10d)
- (2-8d)
- (2-8d)
- (3-8d)
- (2-16d)
- (16d @ 16" O.C.)
- (3-16d PER 16")
- (2-16d)
- (2-16d END NAIL)
- (16d @ 16" O.C.)
- (16d @ 16" O.C.)
- (8-16d)
- (3-8d)
- (8d @ 6" O.C.)
- (2-16d)
- (16d @ 16" O.C. ALONG EDGE)
- (3-8d)
- (4-8d)
- (3-16d)
- (3-16d)
- (3-8d)
- (2-8d)
- (2-8d)
- (3-8d)
- (16d @ 24" O.C.)
- (2-16d AT EACH SPACE)
- (12d @ 12" O.C.)
- (20d @ 32" O.C. AT TOP & BOTTOM AND STAGGERED 2-20d AT ENDS & AT EACH SPACE)



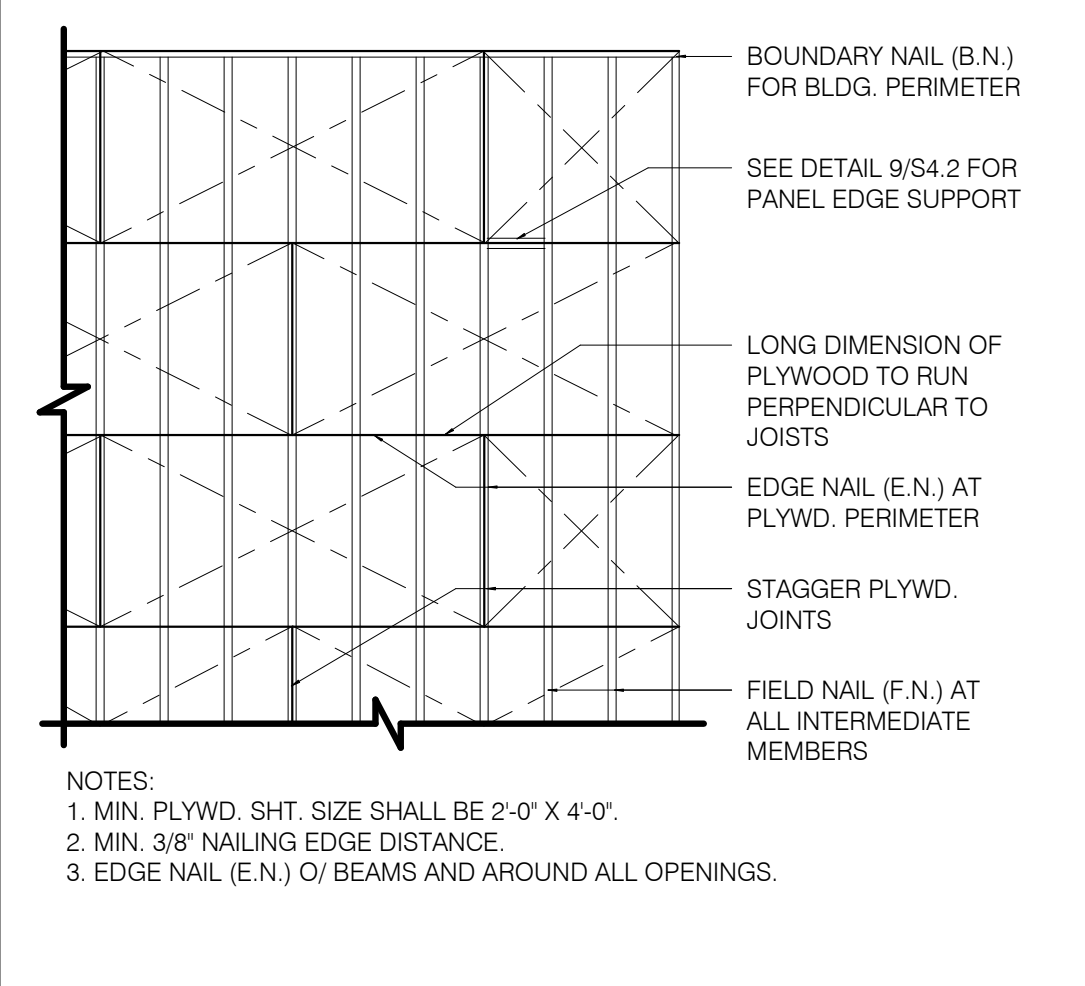


EQUIPMENT



EQUIPMENT	DESIGN WEIGHT
HVAC UNIT - RTU-1	* SEE PLAN
HVAC UNIT - RTU-2	* SEE PLAN
EXHAUST FAN - EF-1	* 200 lbs.
EXHAUST FAN - EF-2	* 70 lbs.
HOOD #1 - TACO BELL	400 lbs.
ICE CONDENSERS	200 lbs.
FREEZER CONDENSER	300 lbs.
COOLER CONDENSER	300 lbs.

* A. ALL DESIGN WEIGHTS INCLUDE CURB.
B. COORDINATE WEIGHTS WITH HVAC UNIT SCHEDULE 1/M 1.0.

ROOF NAILING PLAN N.T.S. 8 **ROOF TOP EQUIPMENT WEIGHTS 1" = 1'-0" 5**

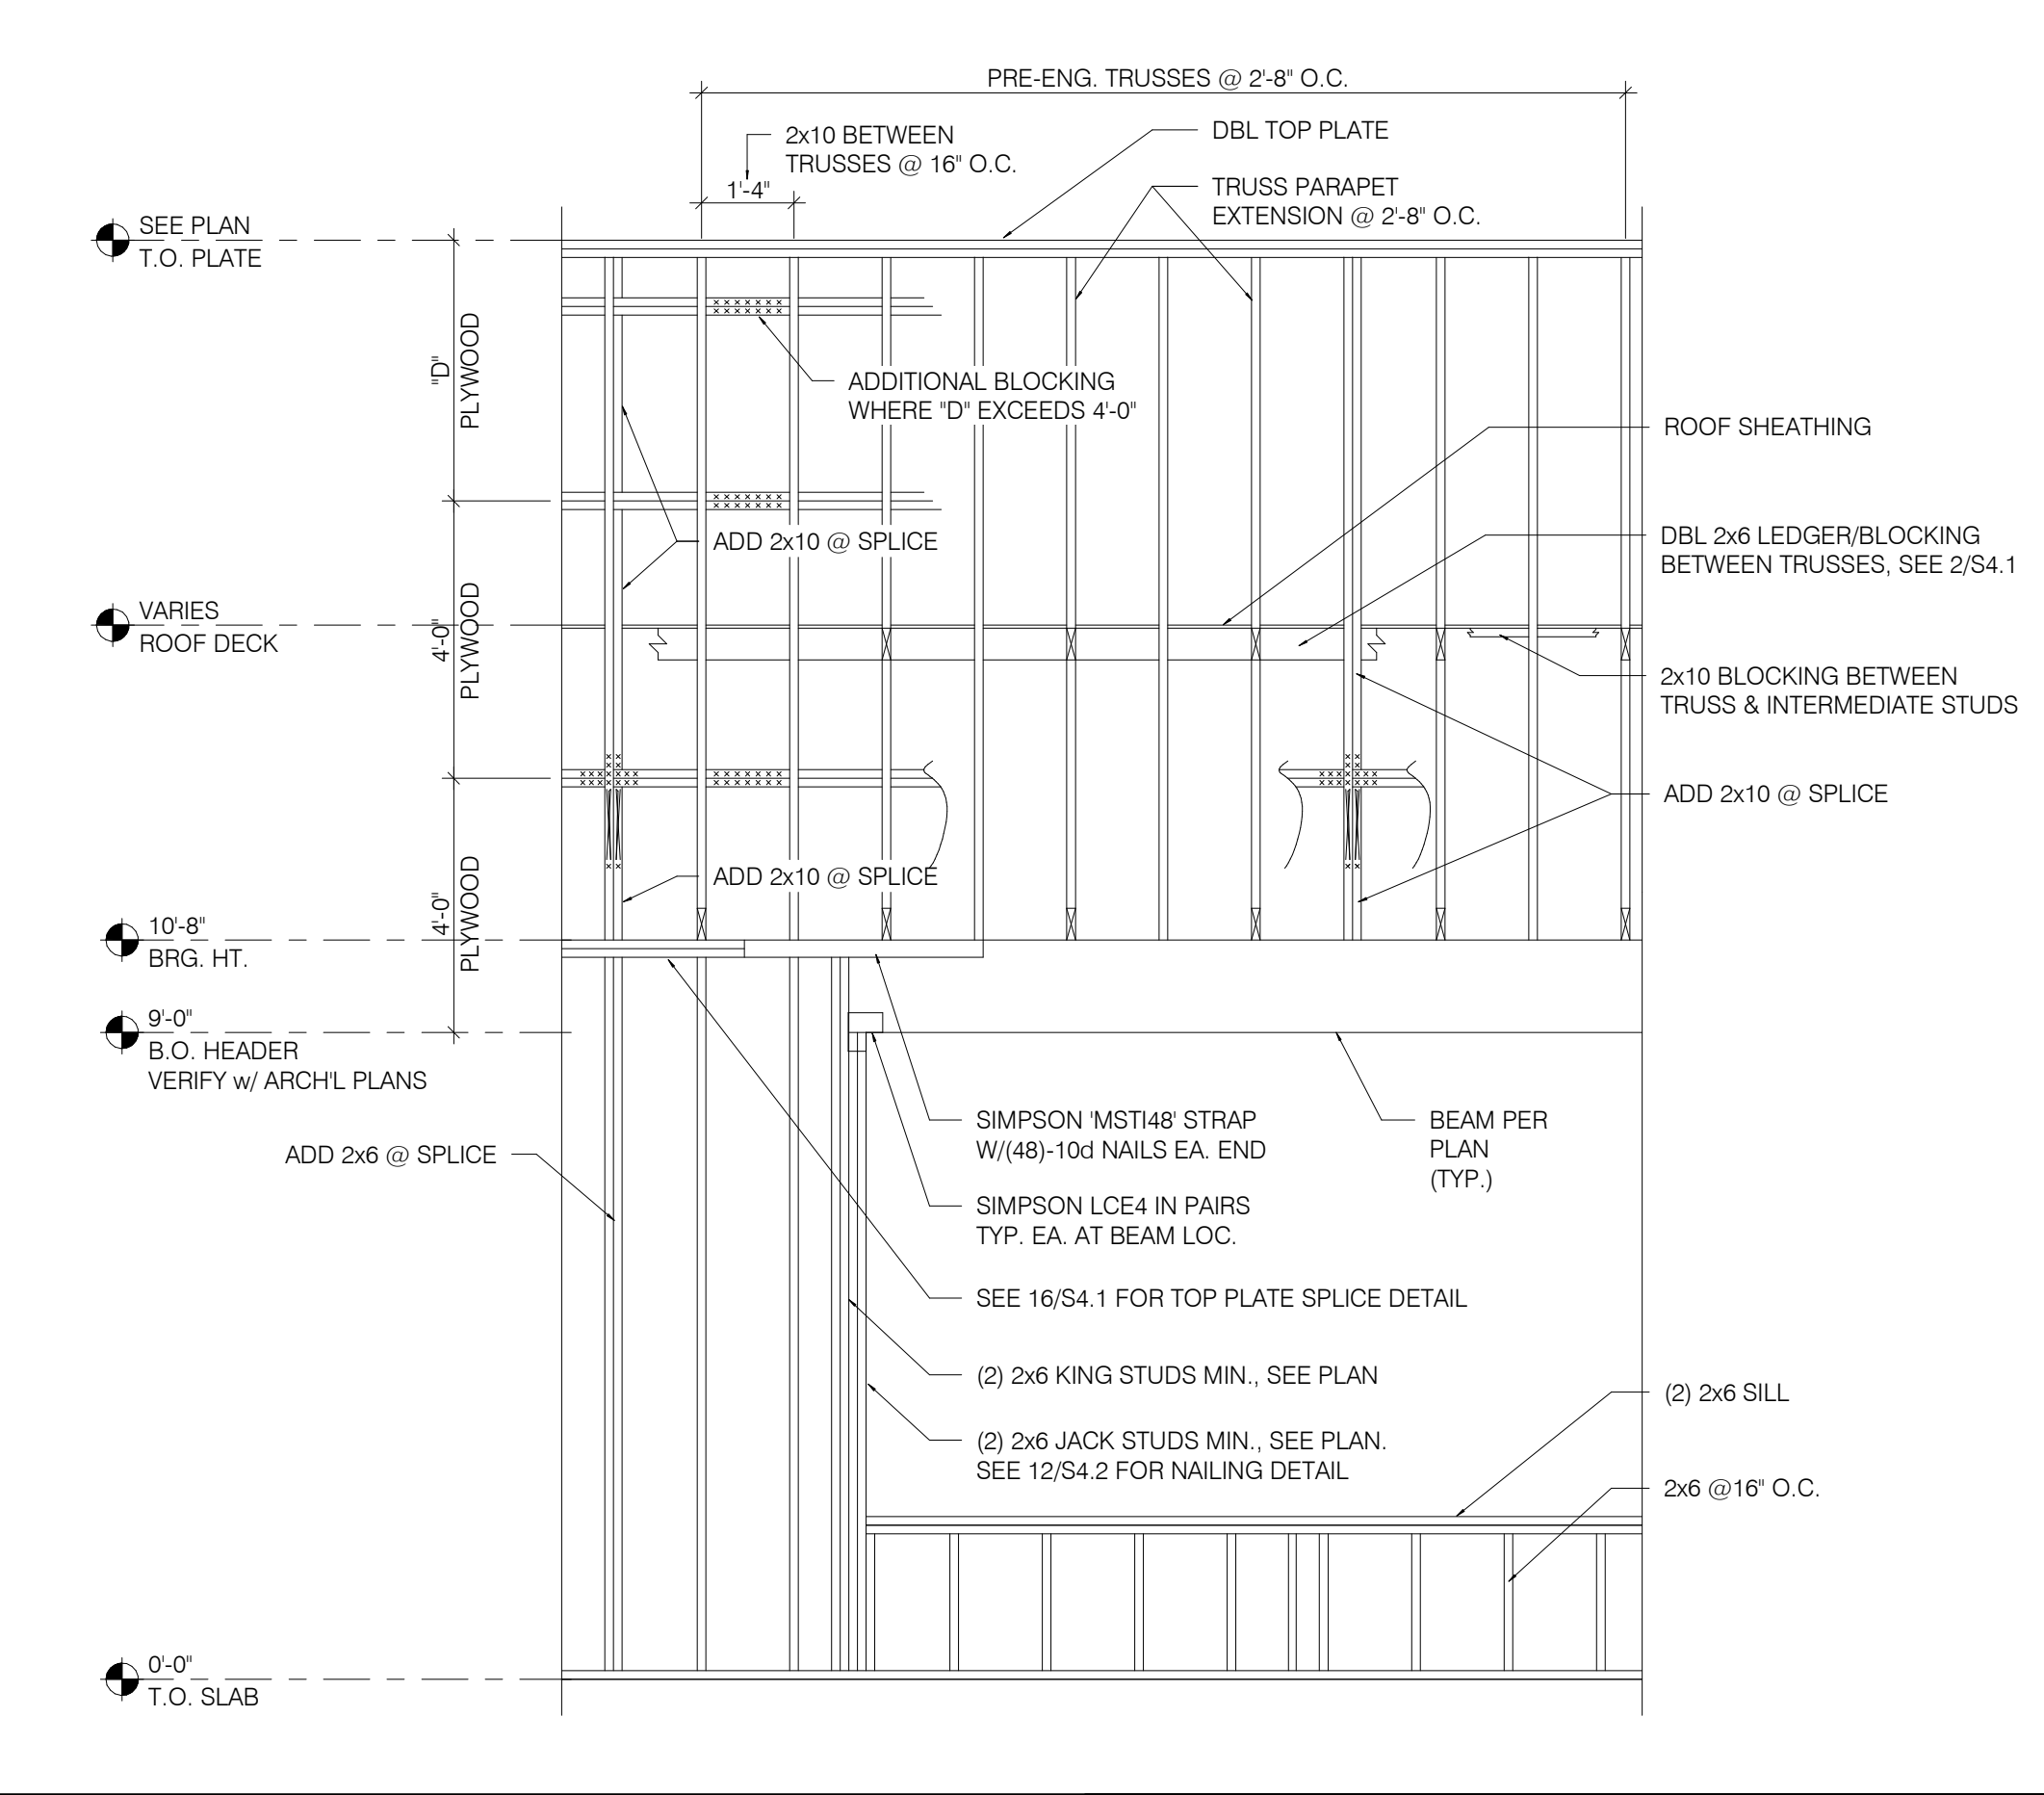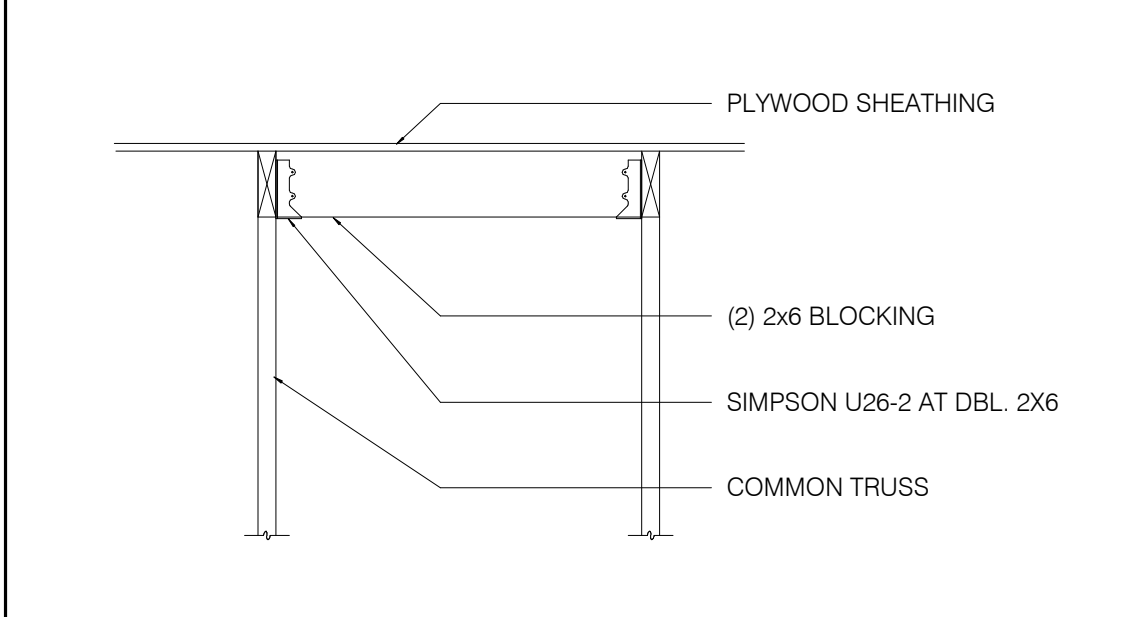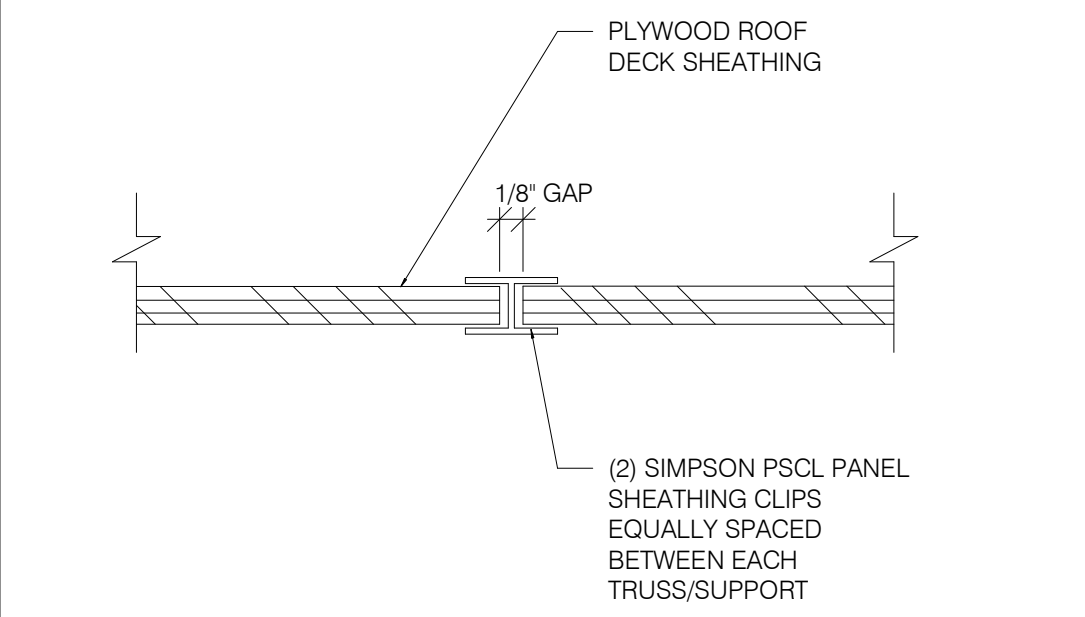


NAILING SCHEDULE N.T.S. 11 **PLYWOOD EDGE BLOCKING 1" = 1'-0" 9** **ROOF OPENING DETAIL 1" = 1'-0" 6** **WALL FRAMING DETAIL 1" = 1'-0" 1**

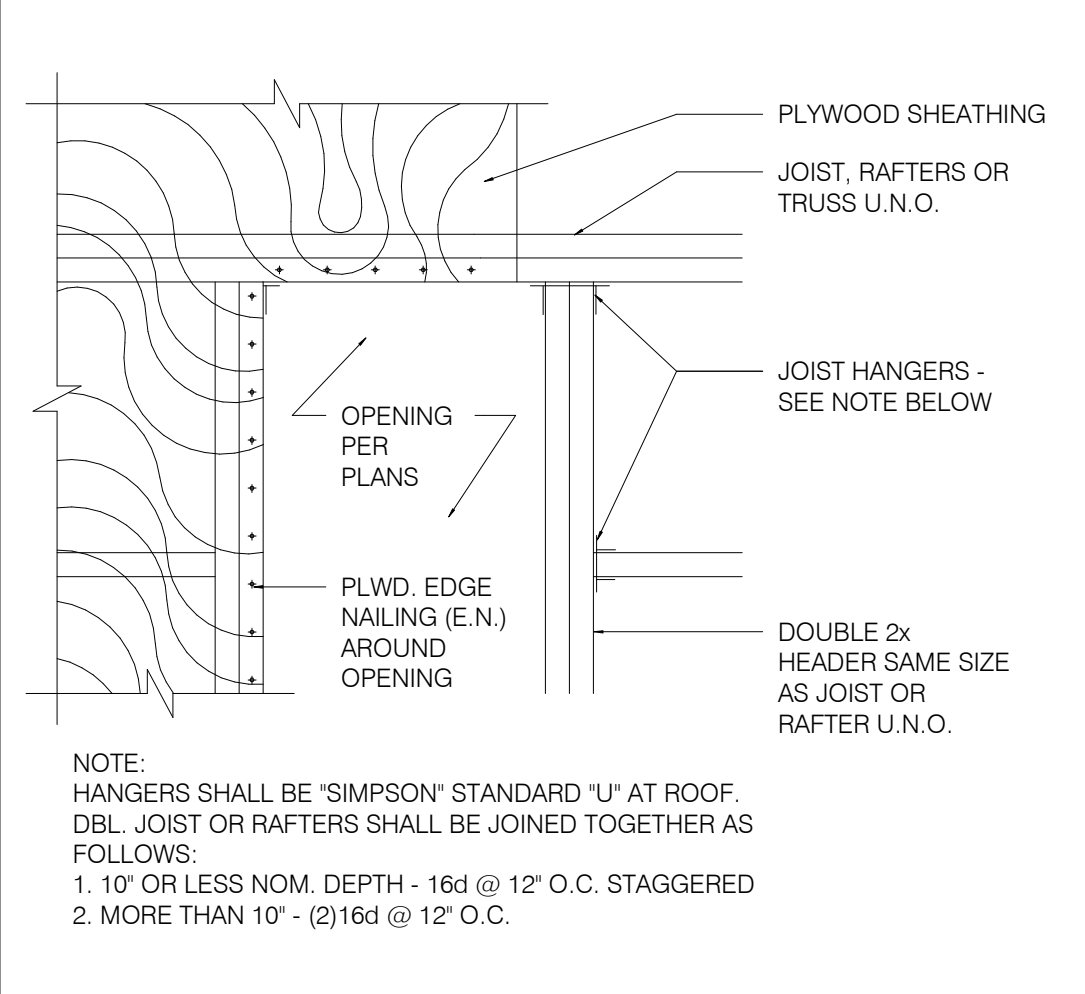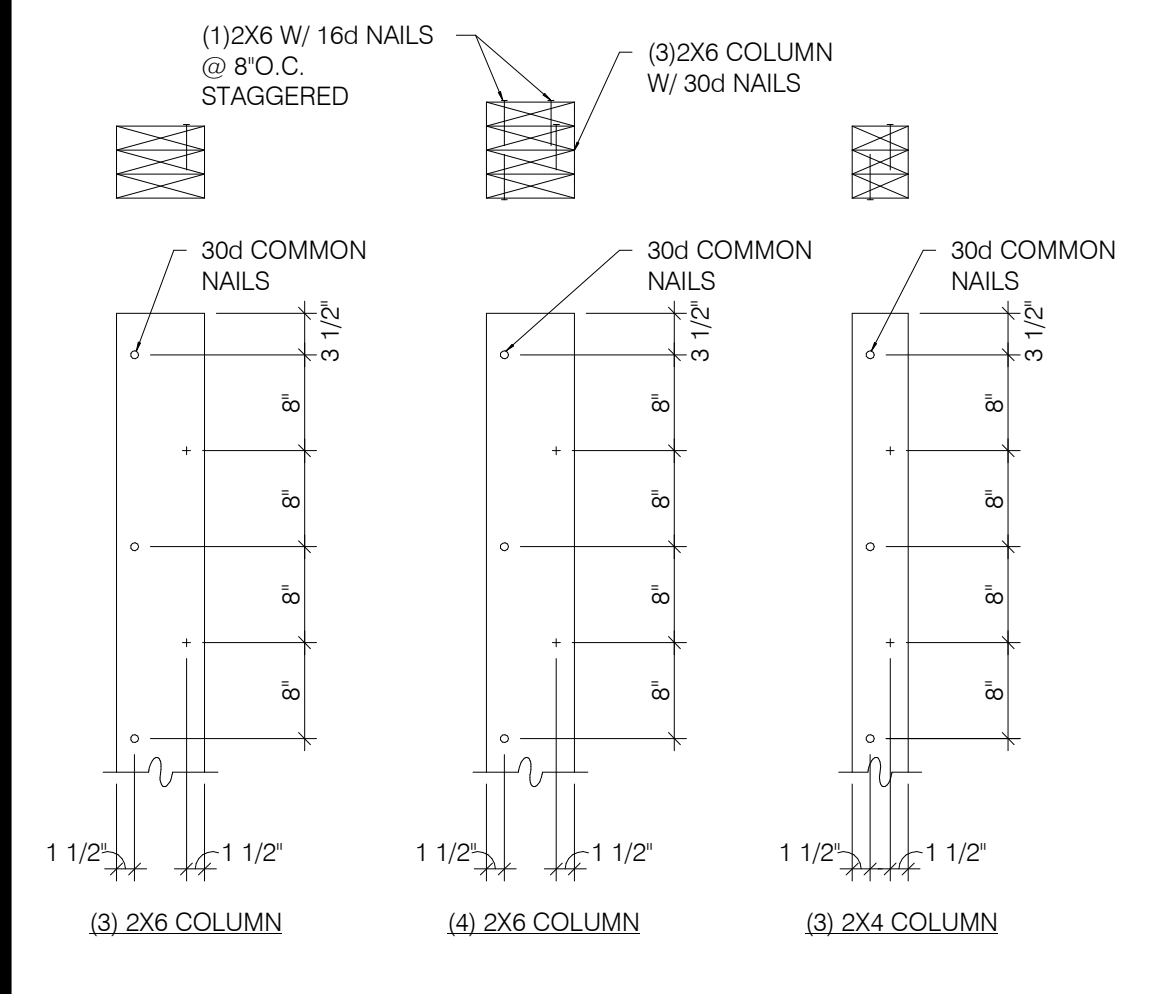

TRUSS SCHEDULE 1" = 1'-0" 7






TRUSS TYPES	SINGLE TRUSS DESIGNATION	DOUBLE TRUSS DESIGNATION	BEARING POINT	COMMENTS
T1 - T23	X	XX		SEE NOTE 1.

NOTES:
1. HOLDOWN CONNECTORS SHALL BE SPECIFIED BY SITE SPECIFIC ARCHITECT/ ENGINEER BASED UPON LOADING DATA PROVIDED BY TRUSS DESIGNER.
2. PROVIDE SHOP DRAWINGS PRIOR TO FABRICATION.
3. TRUSS MEMBER SIZES ARE FOR REFERENCE ONLY. ACTUAL SIZE SHALL BE DETERMINED BY TRUSS MANUFACTURER BASED ON ACTUAL LOAD CONDITIONS AND CODES.

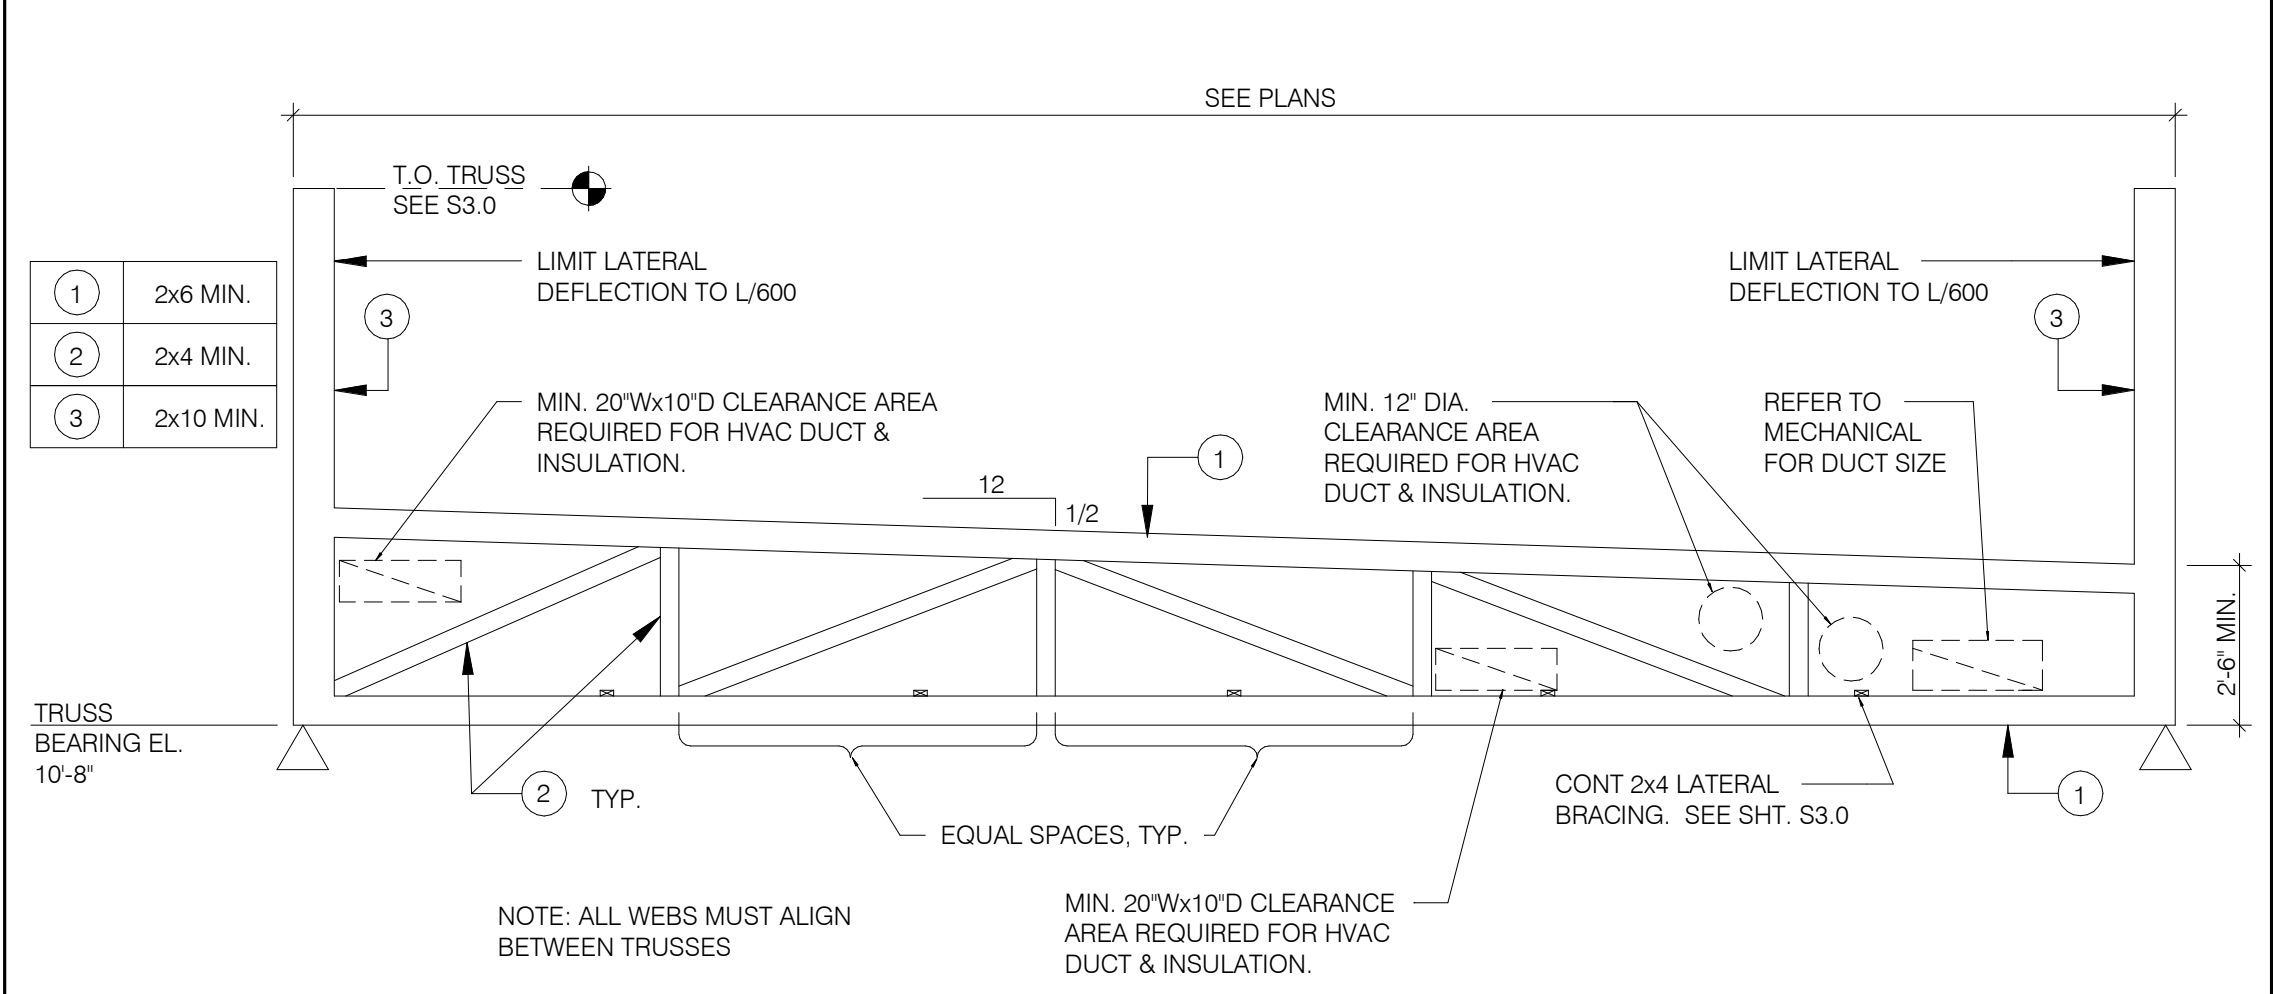

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 04.08.21
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 313354
STORE NUMBER: 449523
PA/PM: JN
DRAWN BY.: DL
JOB NO.: 2018088.03

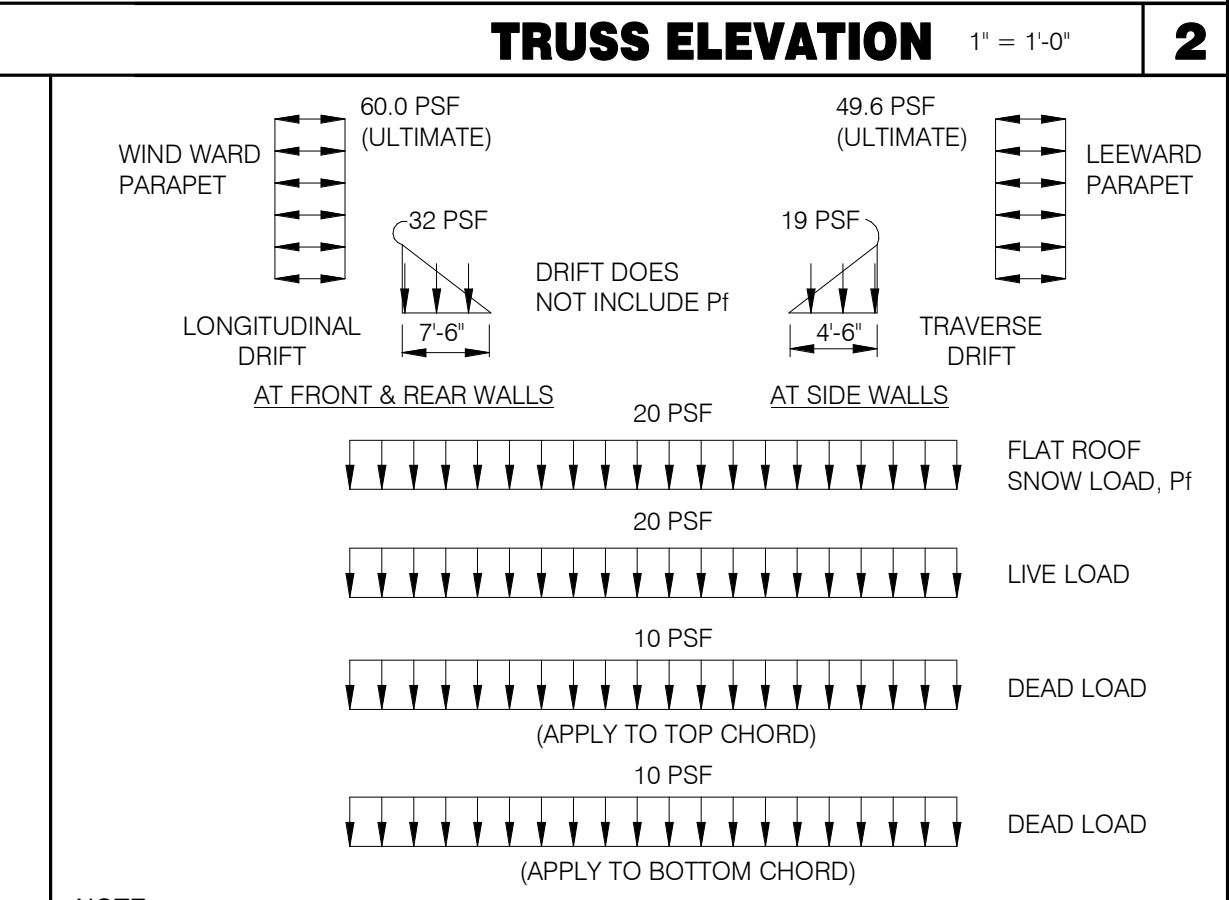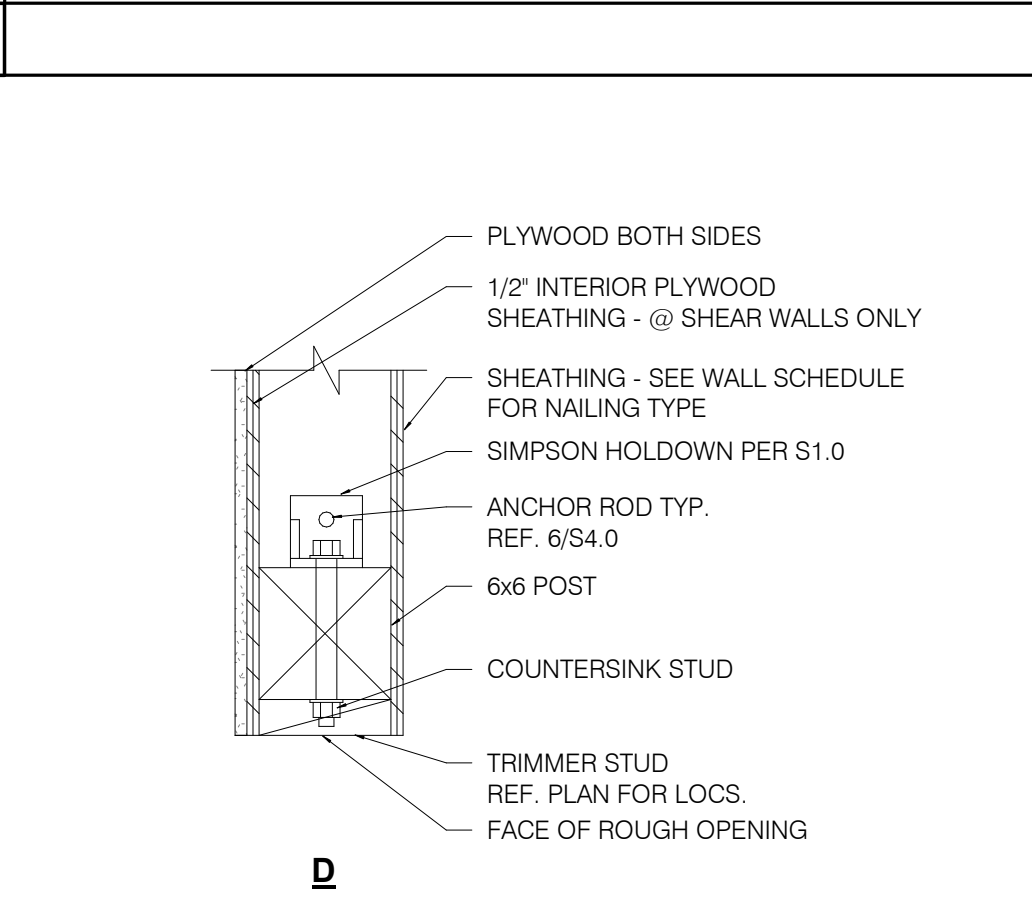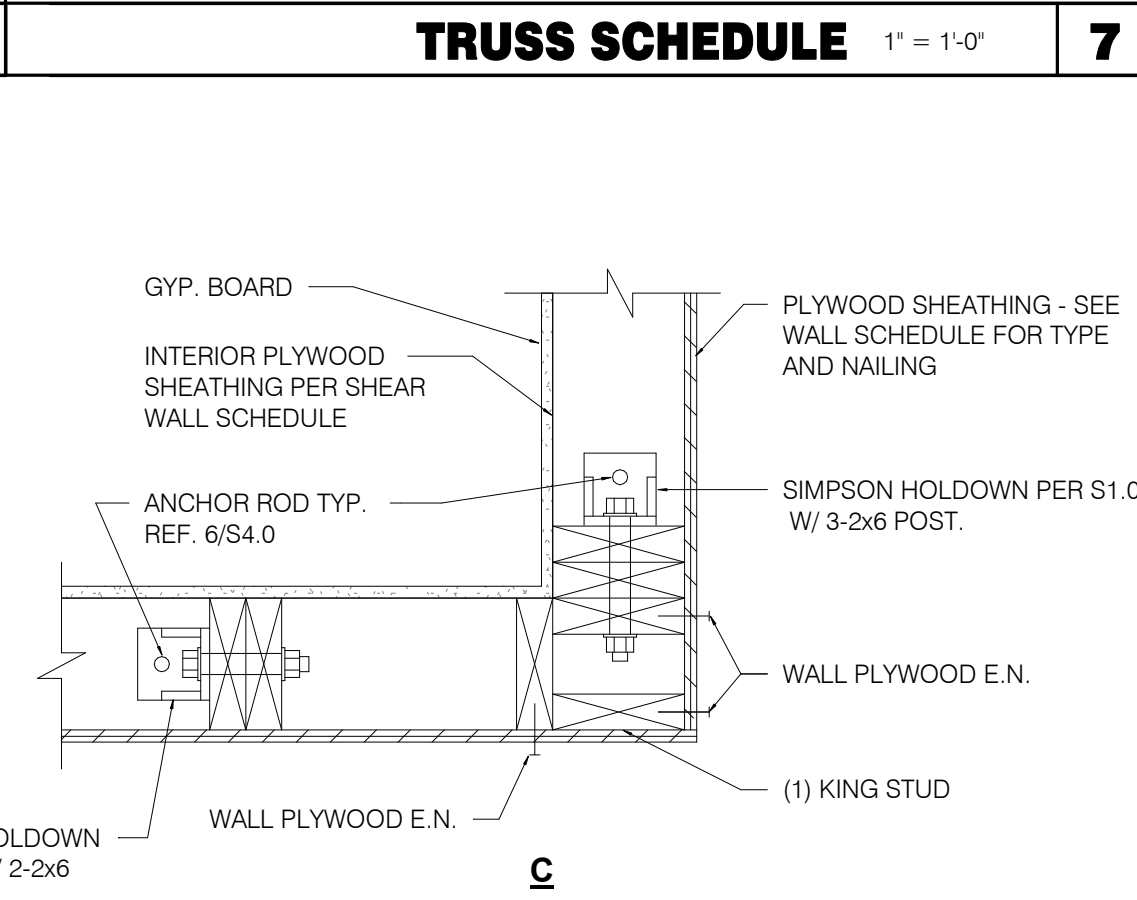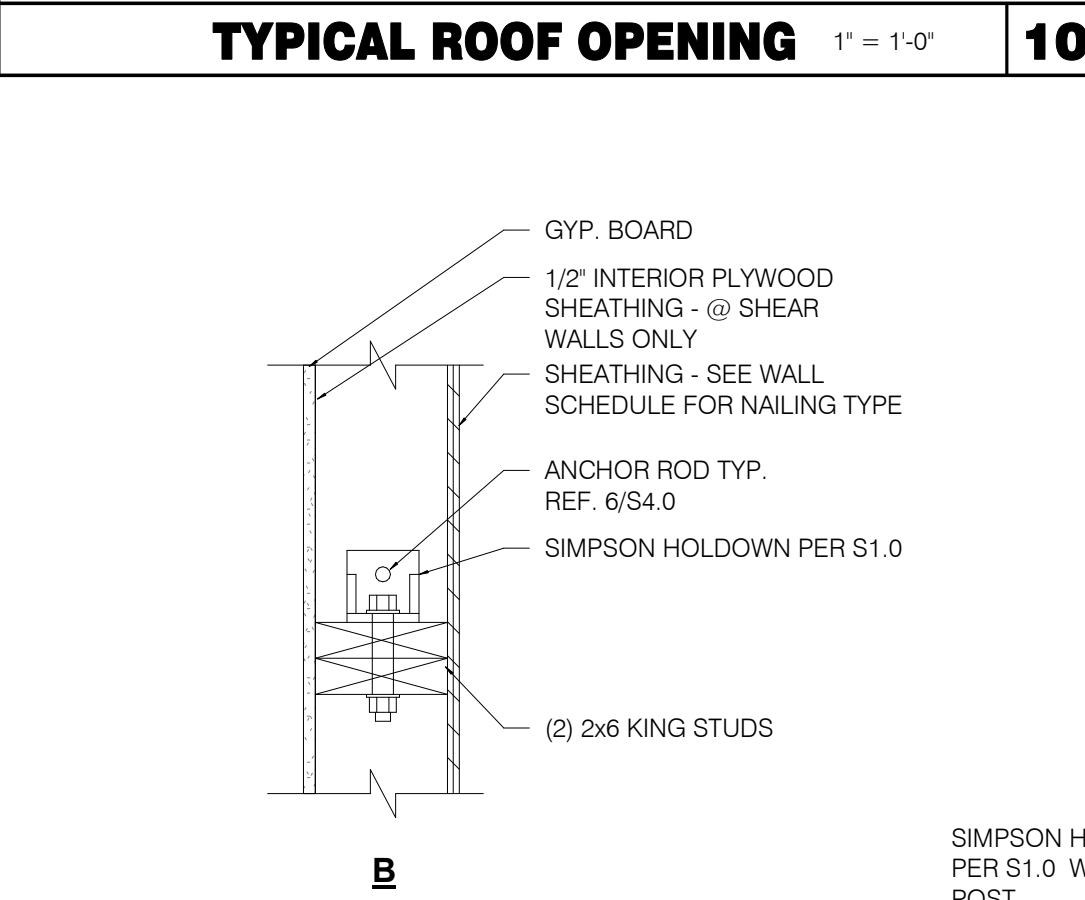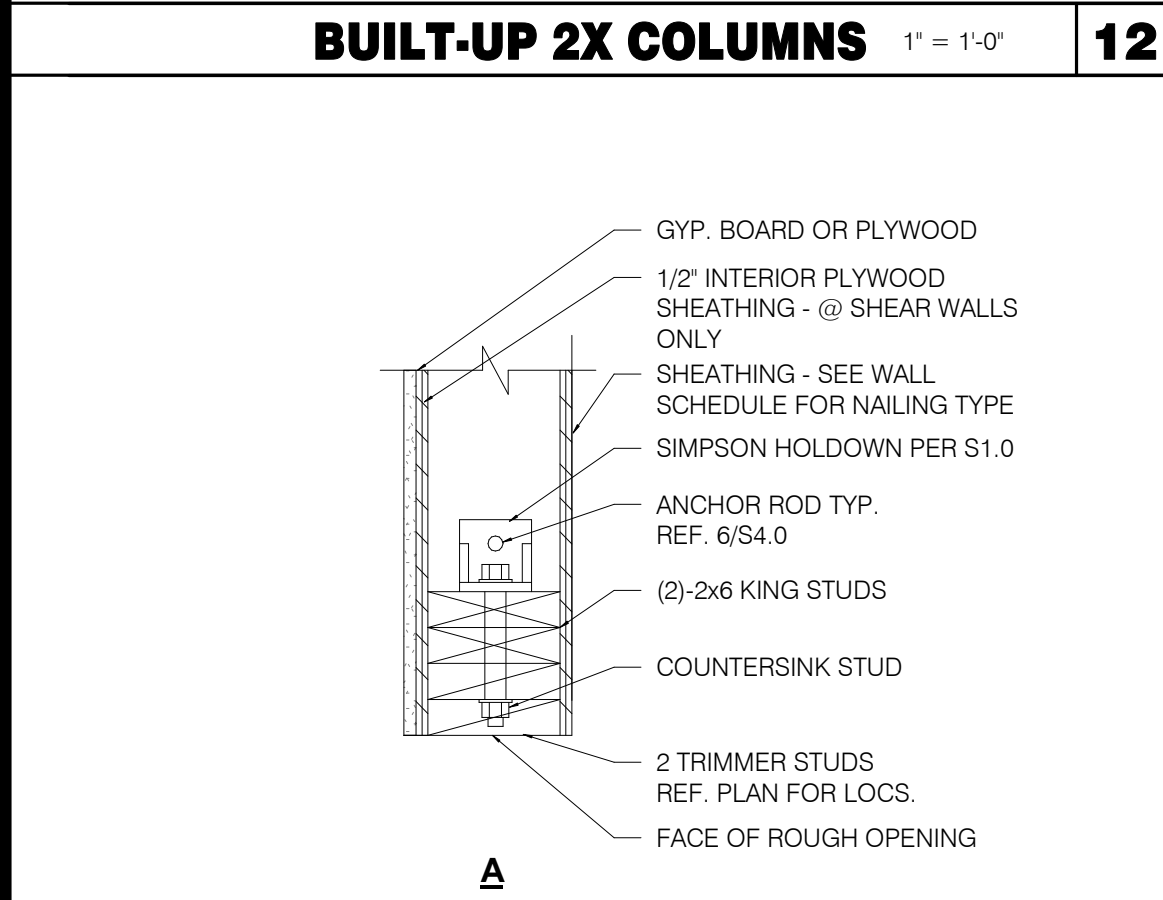

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
STRUCTURAL
DETAILS

S4.2
PLAT DATE: 11/7/2022 4:36:16 PM

BUILT-UP 2X COLUMNS 1" = 1'-0" 12


TYPICAL ROOF OPENING 1" = 1'-0" 10

TRUSS SCHEDULE 1" = 1'-0" 7


HOLDOWN DETAILS 1" = 1'-0" 4

TRUSS ELEVATION 1" = 1'-0" 2


TRUSS LOAD DIAGRAMS 1" = 1'-0" 3

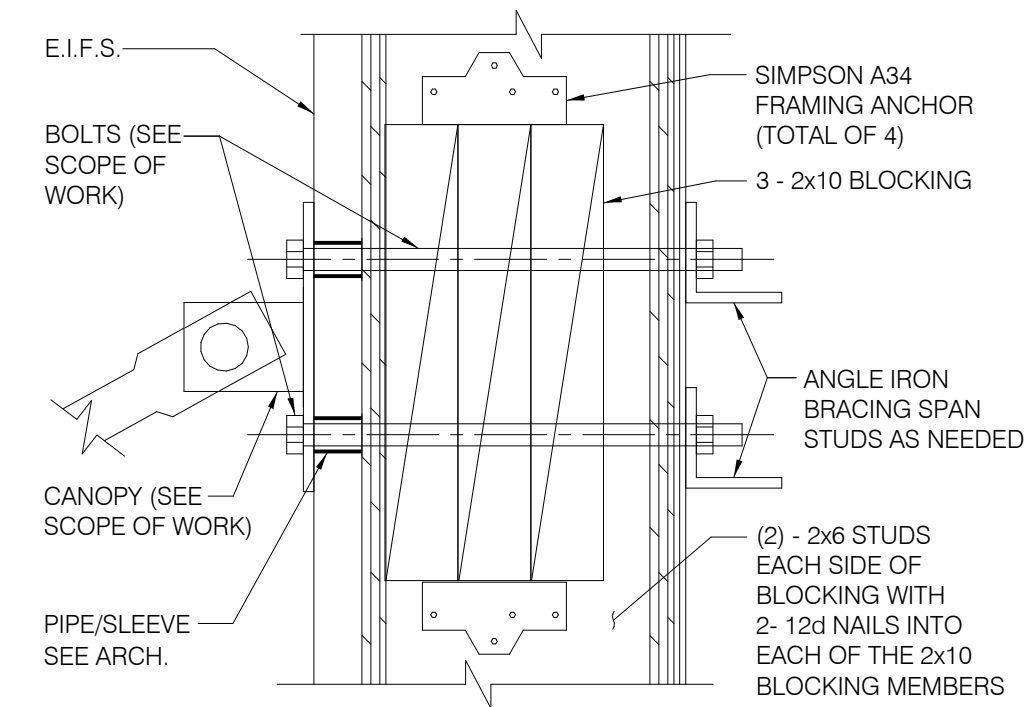


TIE-ROD BLOCKING 3' = 1'-0" **13**

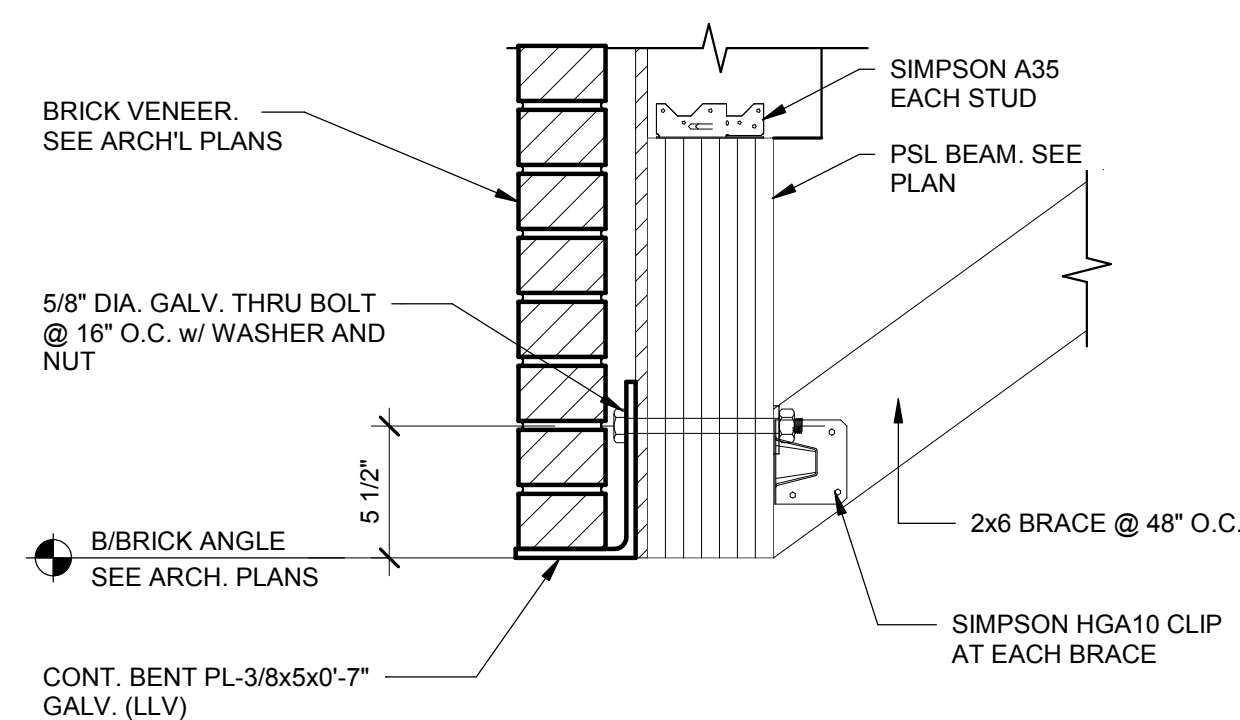


BRICK LEDGER DETAIL 1 1/2' = 1'-0" **9**

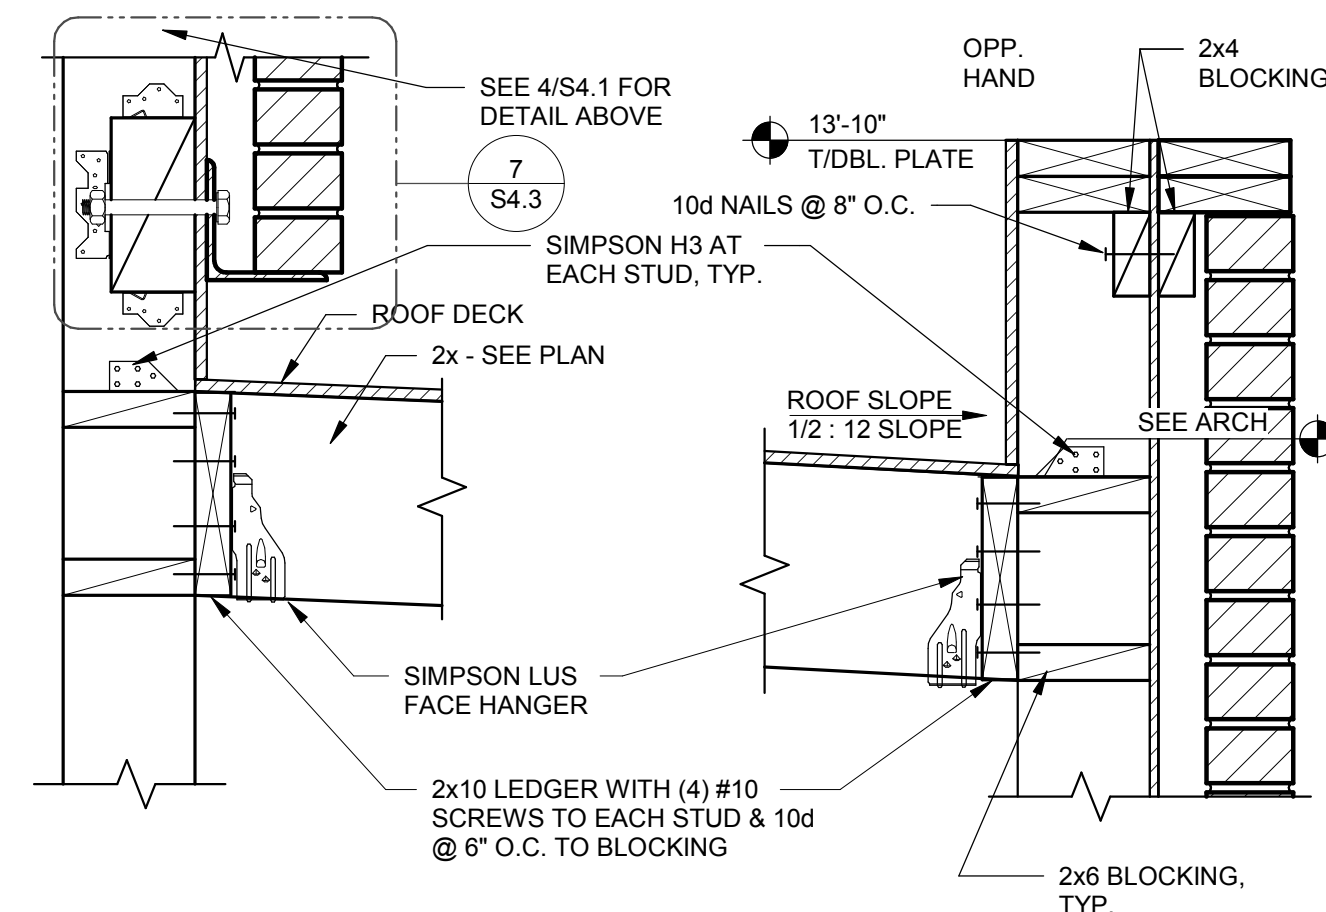


SECTION AT COOLER REAR 1 1/2' = 1'-0" **5**

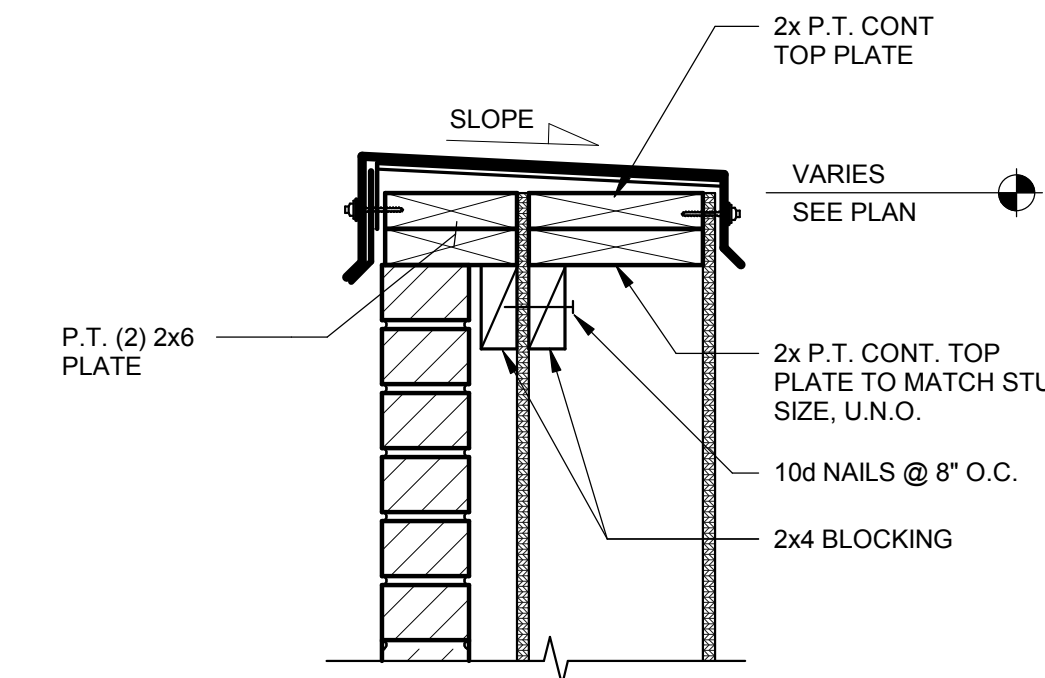


TYPICAL PARAPET CAP 1 1/2' = 1'-0" **1**

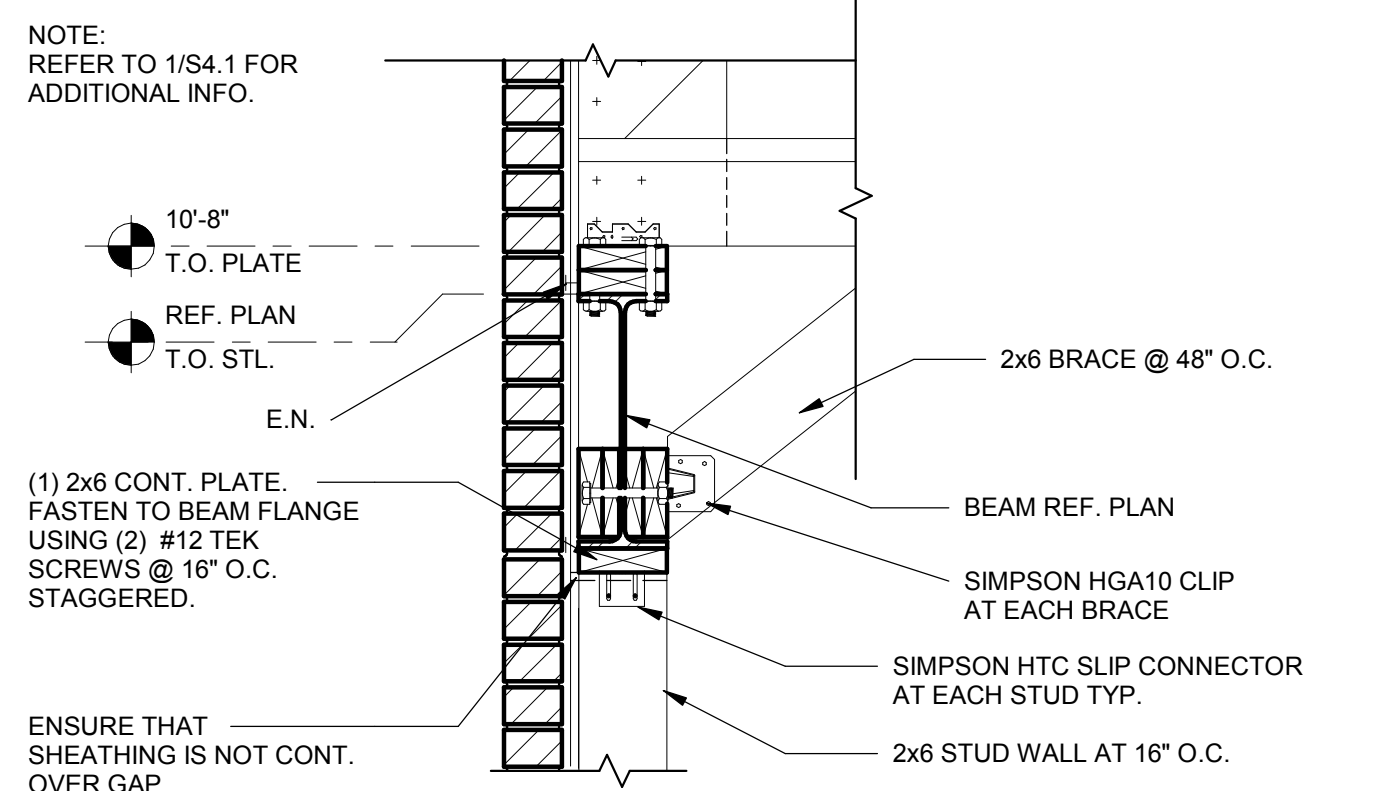




SECTION 1' = 1'-0" **10**

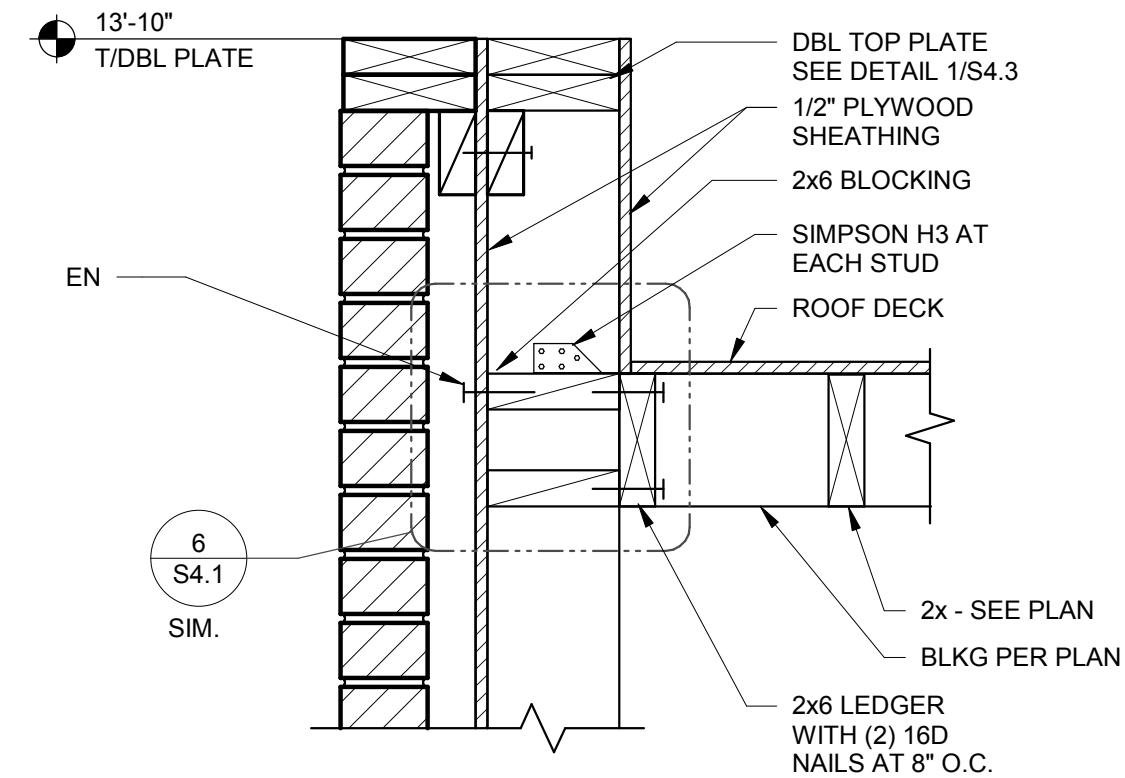


SECTION AT COOLER SIDES 1 1/2' = 1'-0" **6**

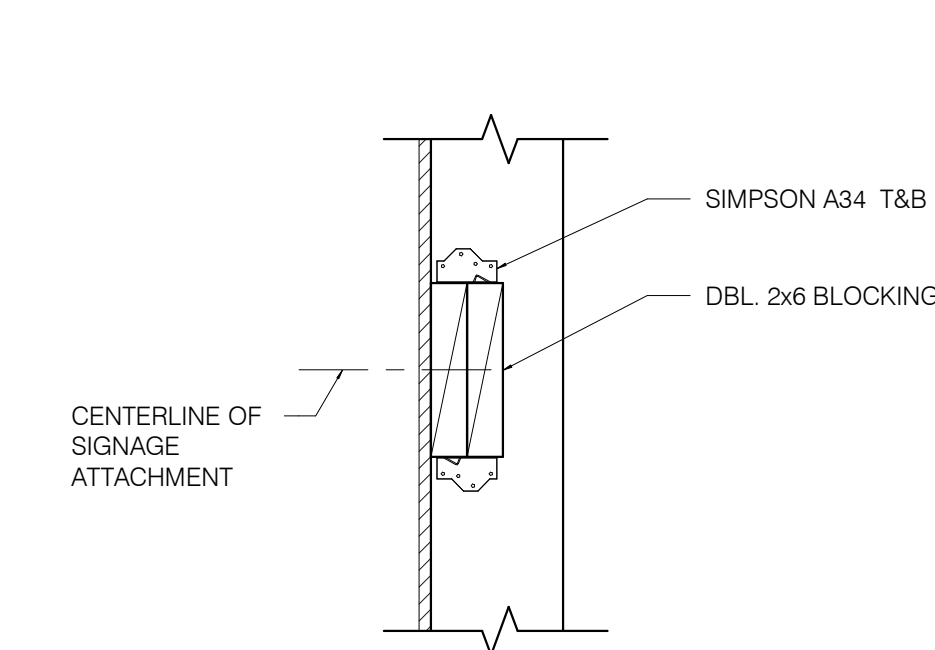





SIGNAGE ATTACHMENT BLOCKING DETAIL 1 1/2' = 1'-0" **2**

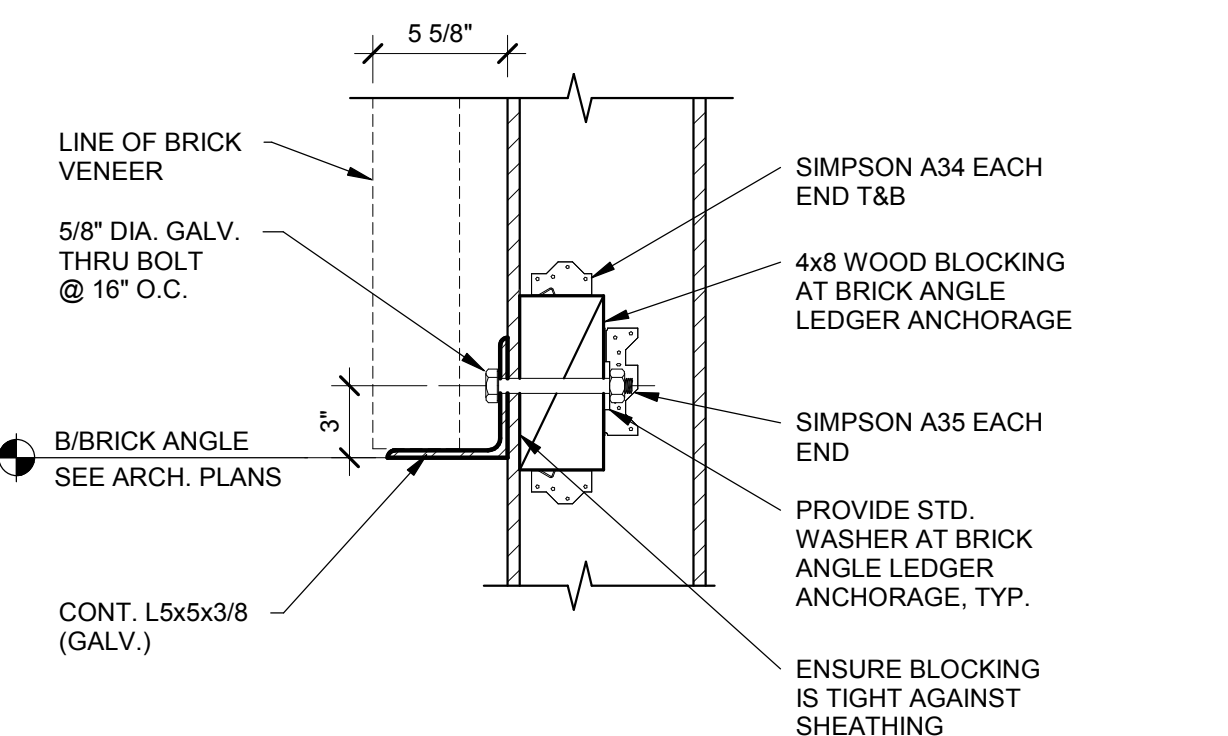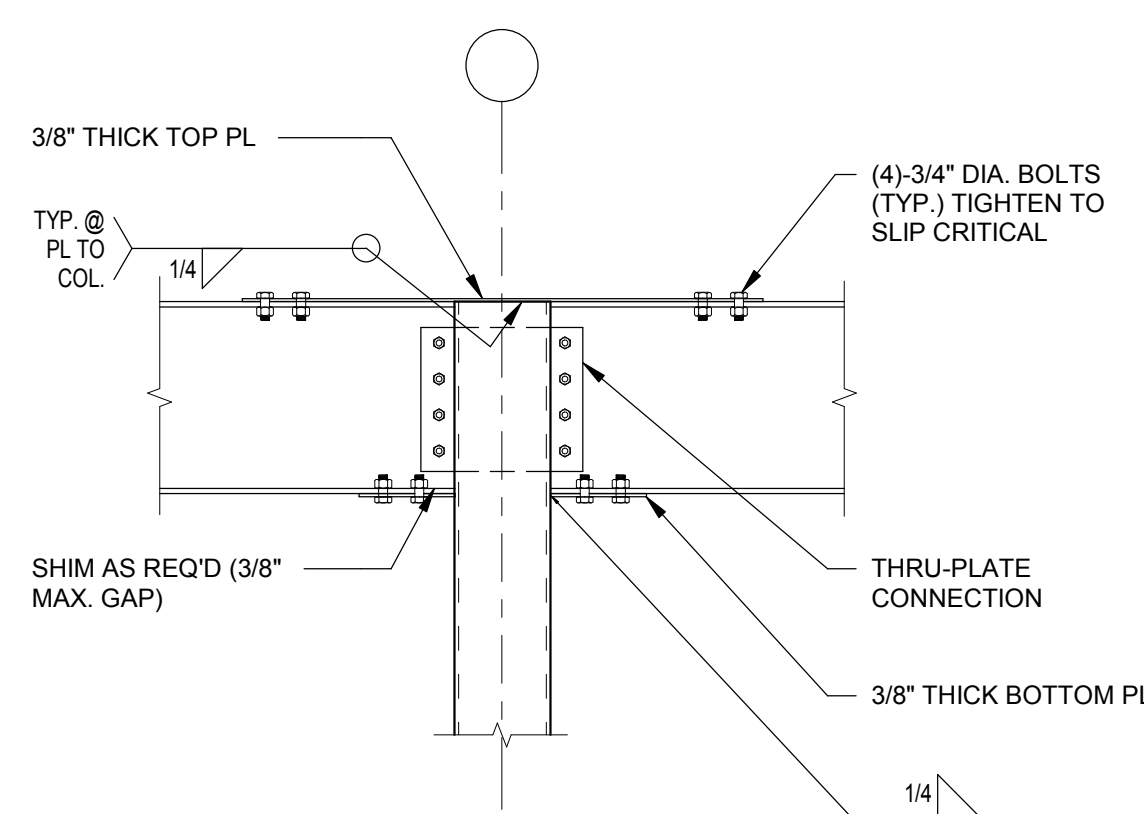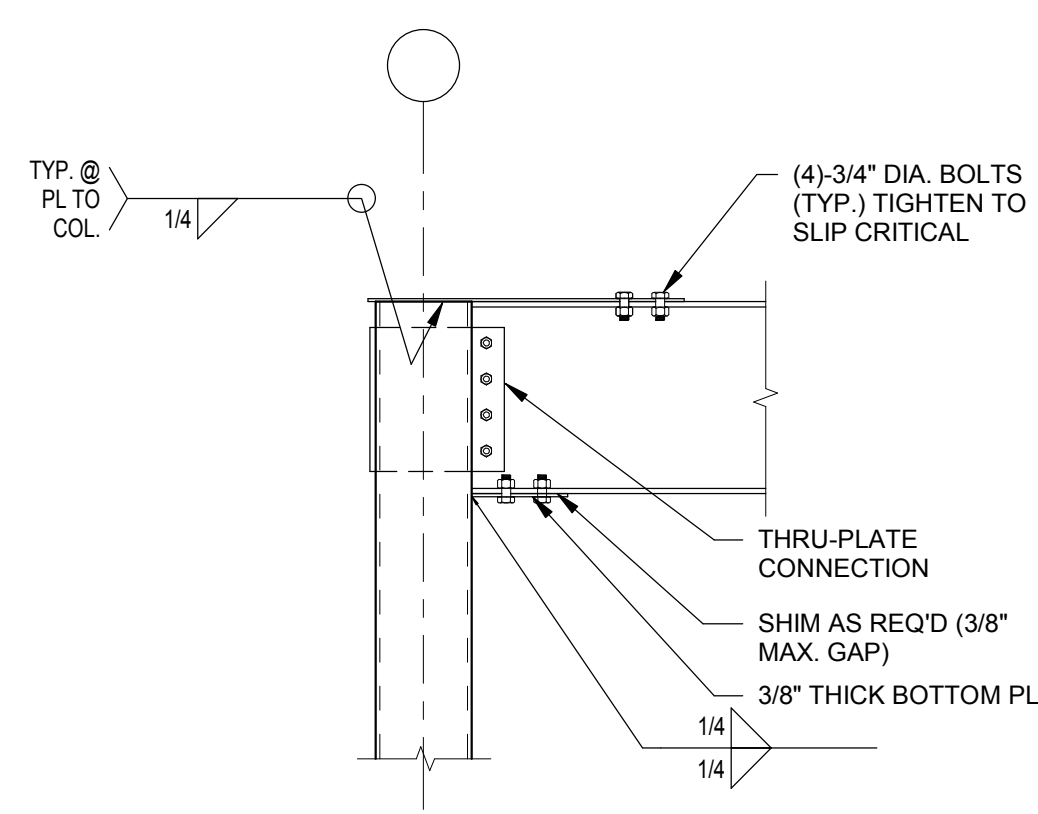


BRICK LEDGER DETAIL 1 1/2' = 1'-0" **7**

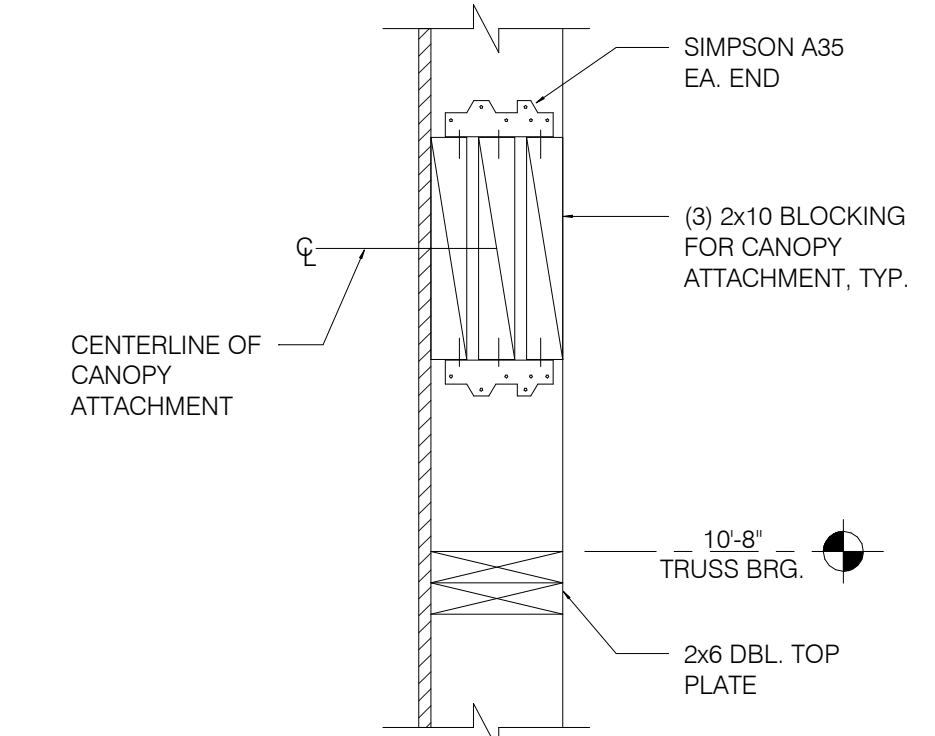


CANOPY TIE BACK BLOCKING DETAIL 12" = 1'-0" **3**

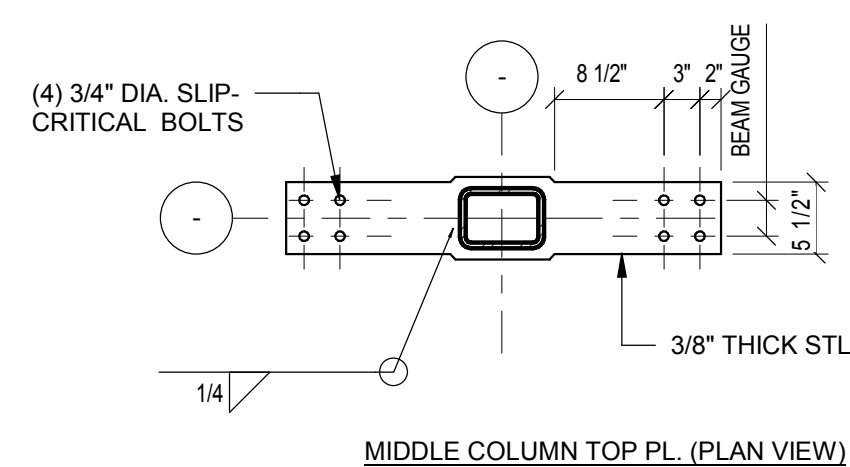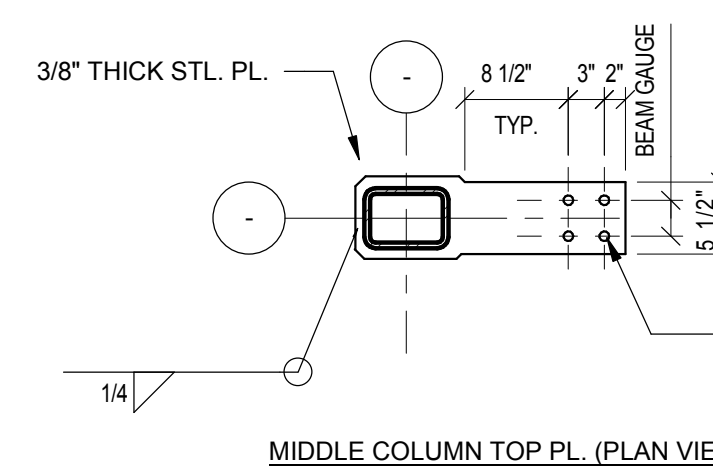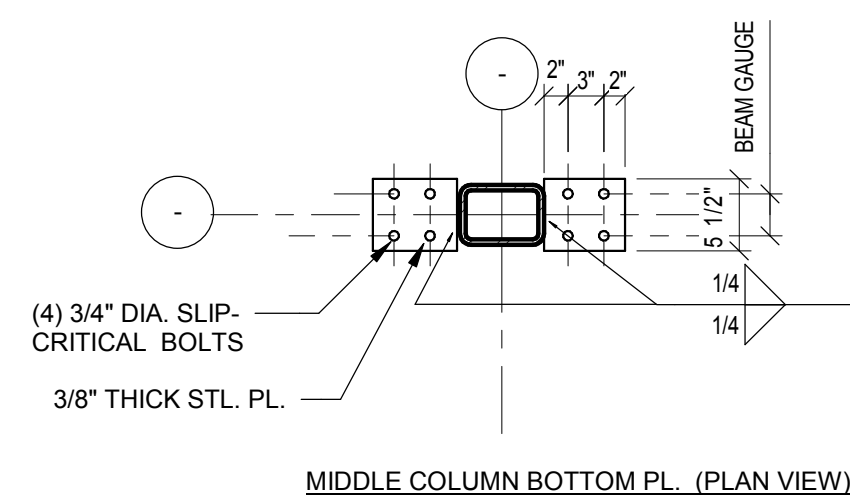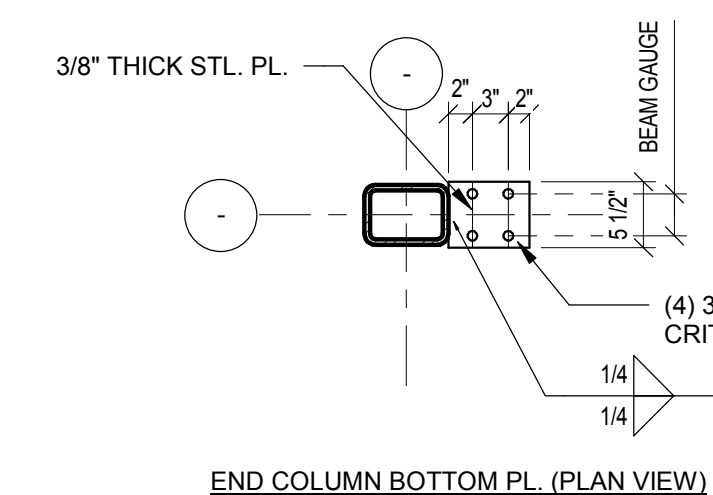

PARTIALLY RESTRAINED MOMENT CONNECTION DETAILS 3/4" = 1'-0" **12**

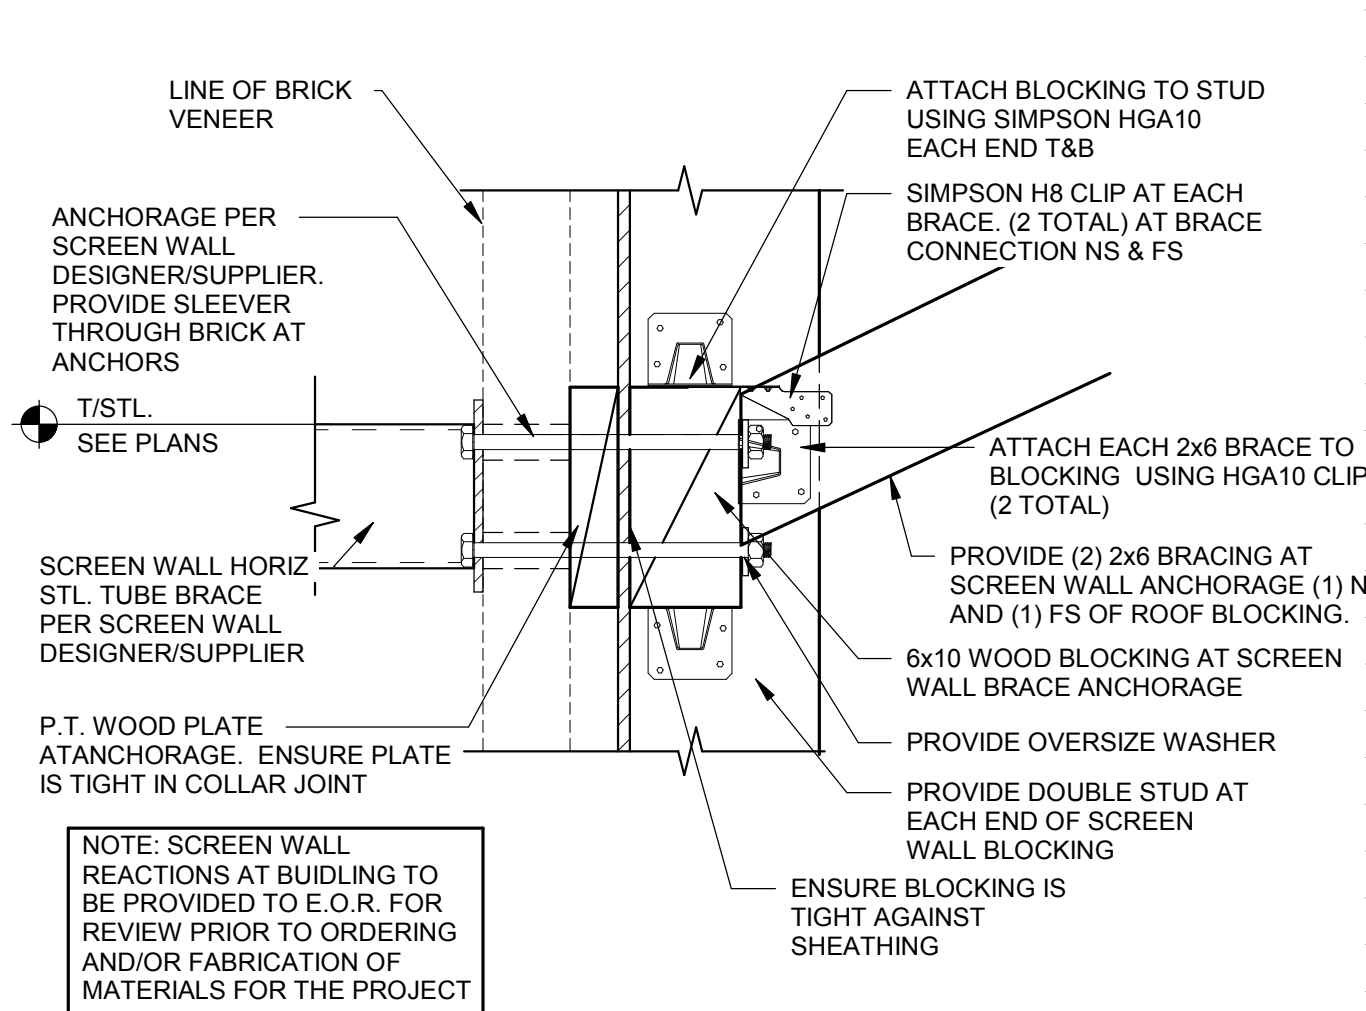

SCREEN WALL BRACE TO BUILDING DETAIL 1 1/2' = 1'-0" **8**

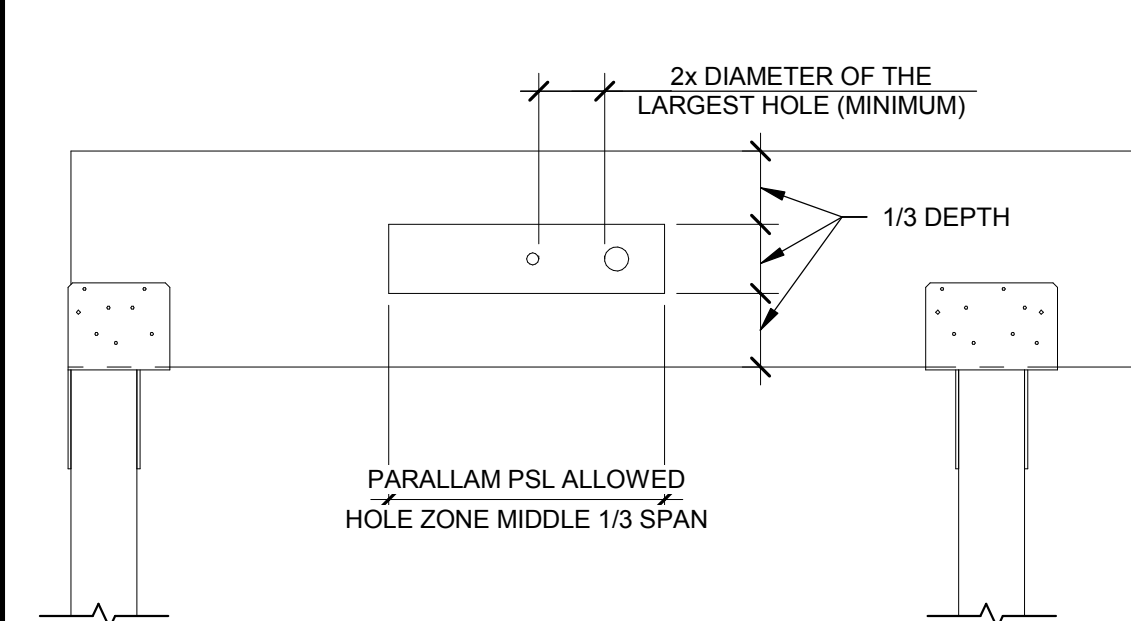

NOTES:
ALLOWED HOLE SIZE SUITABLE FOR HEADERS AND BEAMS WITH UNIFORM LOADS ONLY.
ROUND HOLES ONLY.
NO HOLES IN CANTILEVERS.
NO HOLES IN HEADERS OR BEAMS ORIENTATED FLATWISE.

HEADER OR BEAM DEPTH	MAXIMUM ROUND HOLE SIZE
4 3/8"	1"
5 1/2"	1 3/4"
7 1/4"-20"	2"

PSL BEAM PENETRATION DETAIL 3/4" = 1'-0" **4**

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 04.08.21
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 313354
STORE NUMBER: 449523
PA/PM: JN
DRAWN BY.: DL
JOB NO.: 201808.03

TACO BELL


18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0
STRUCTURAL
DETAILS

S4.3


COORDINATE BLOCKING
REQUIREMENTS WITH
MANUFACTURER

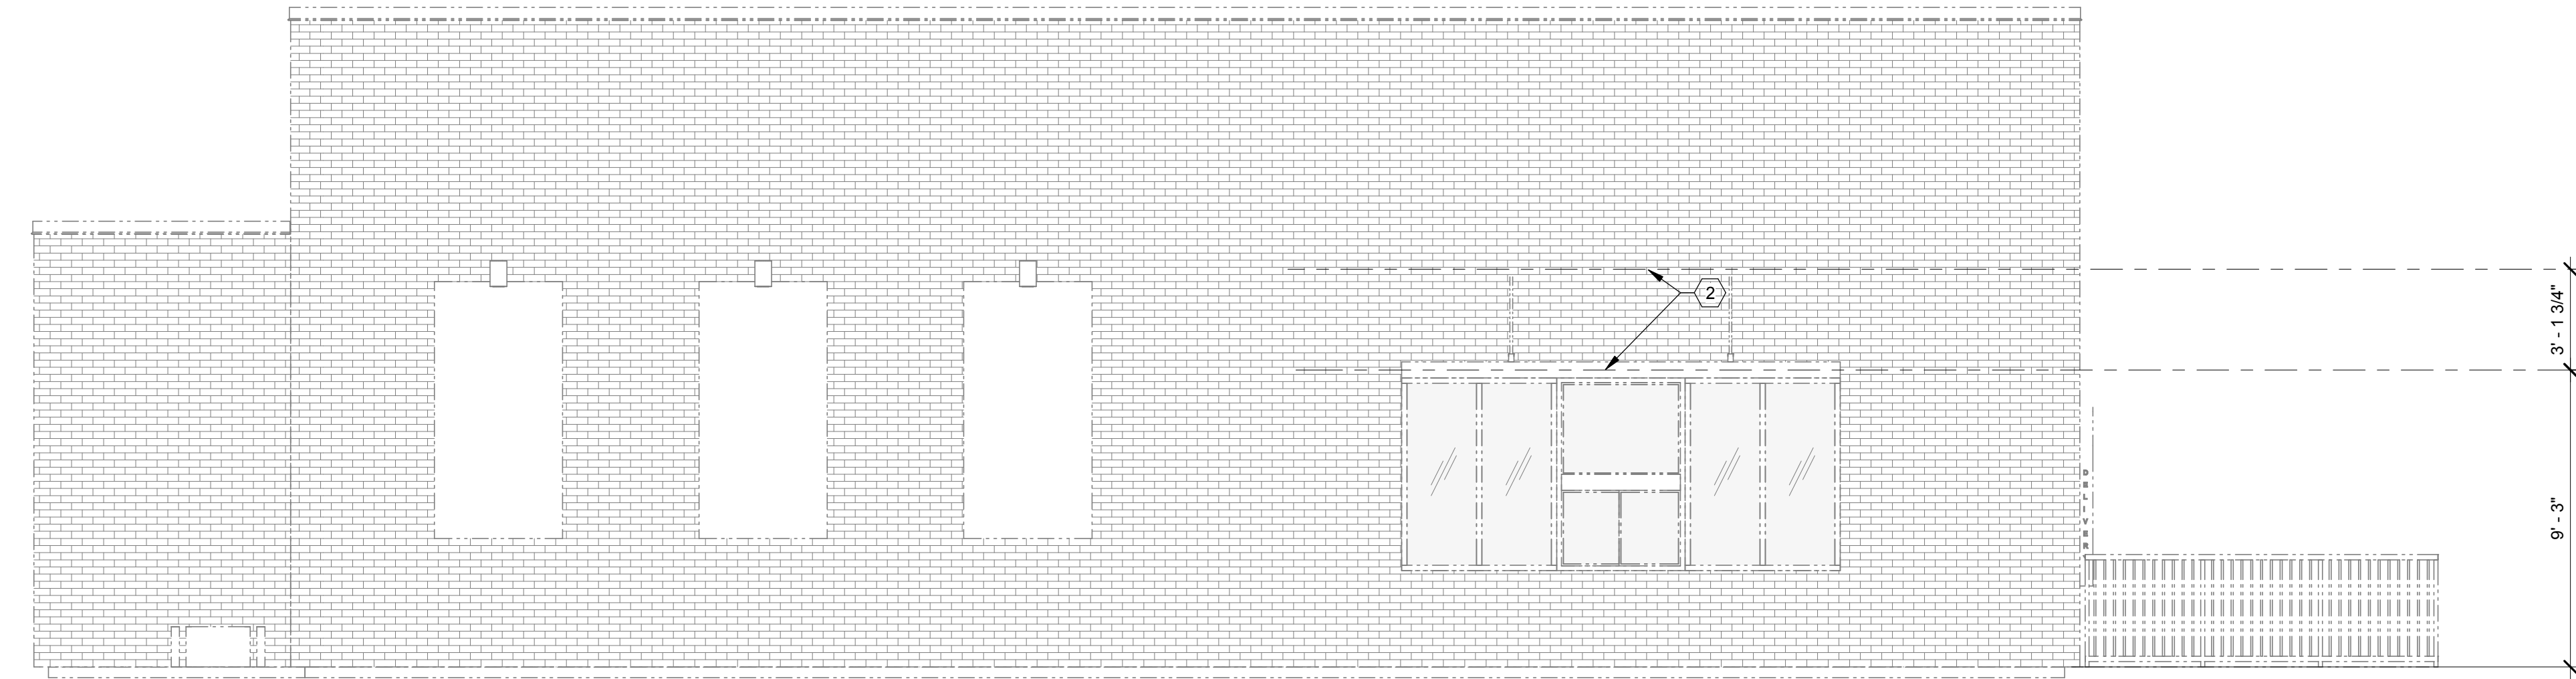

SOUTH ELEVATION 1/4" = 1'-0" **A**

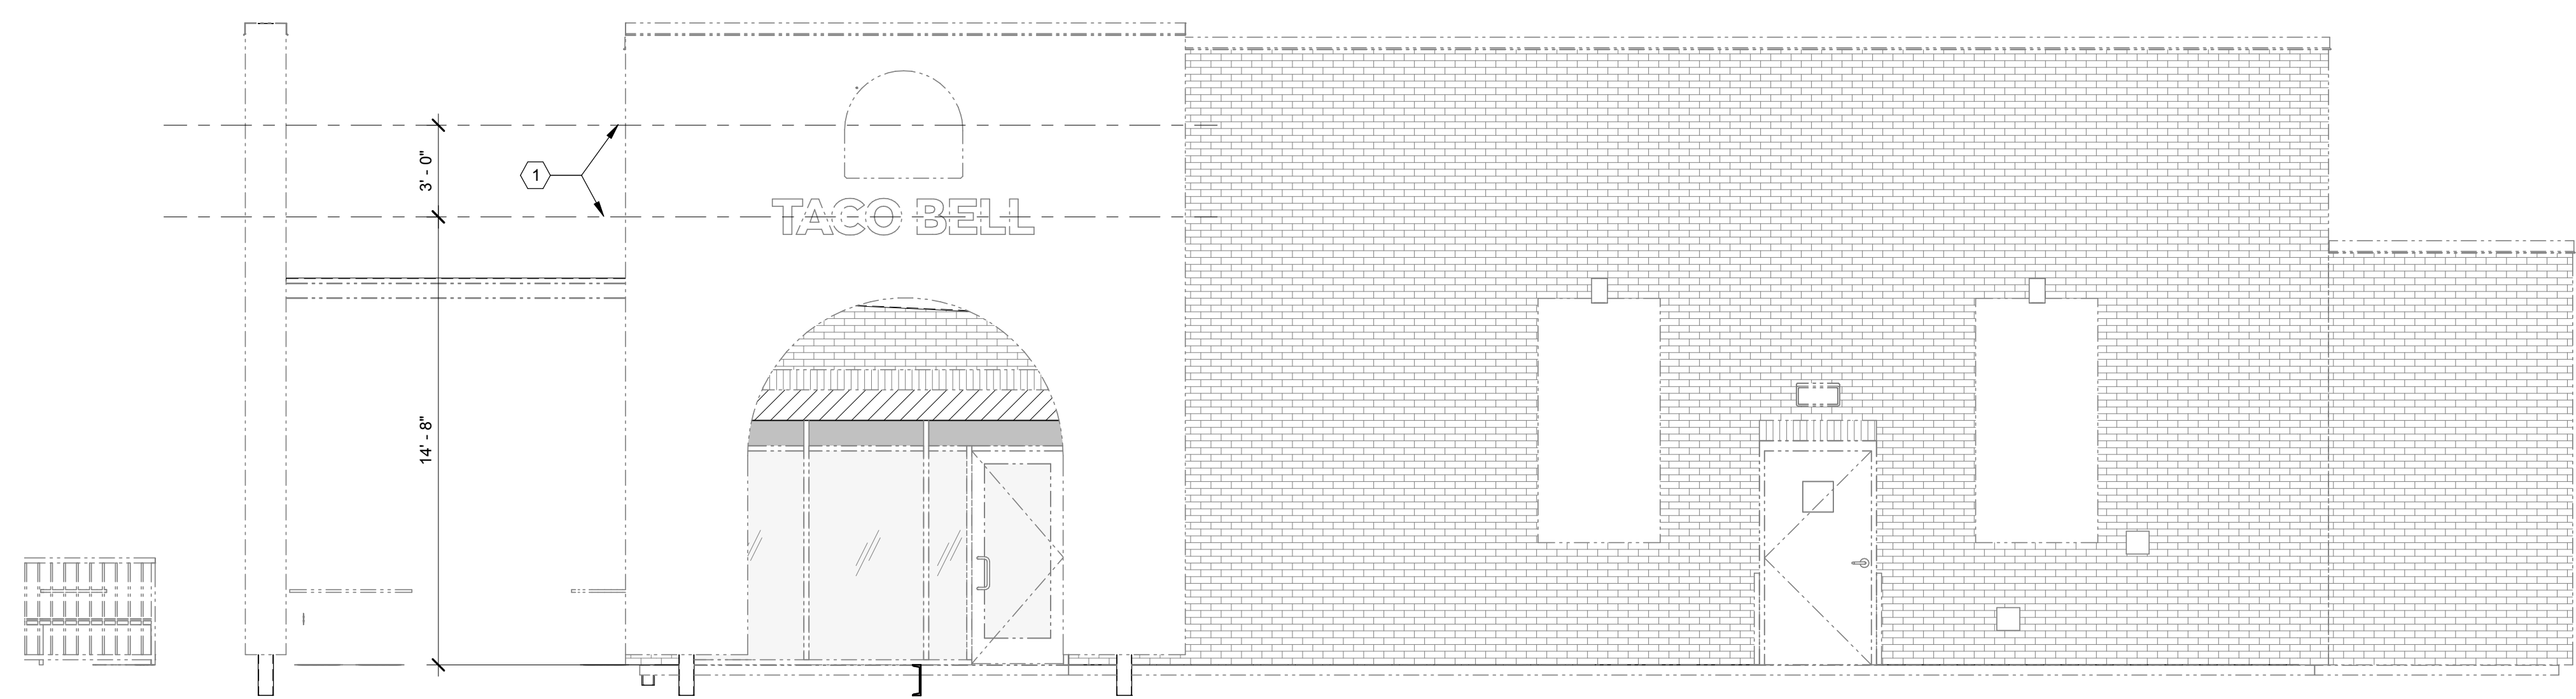

NORTH ELEVATION 1/4" = 1'-0" **B**

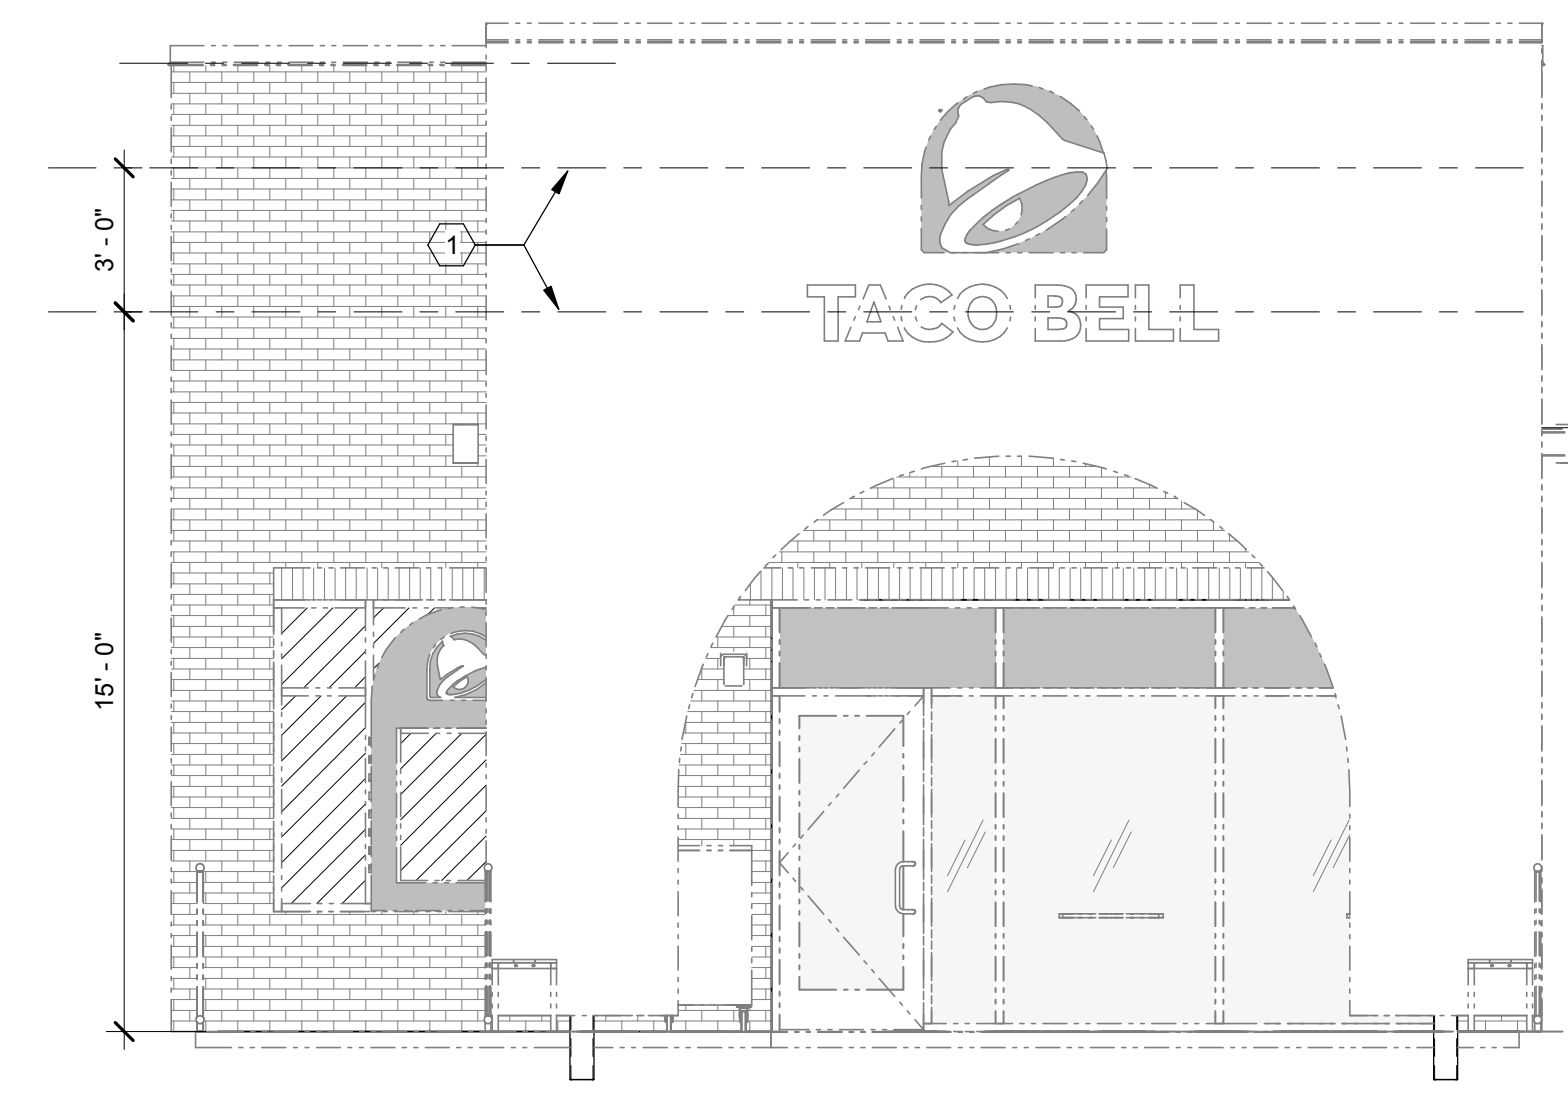

SOUTH ELEVATION **E**

- 1 SOLID BLOCKING FOR FASTENERS AS REQUIRED FOR SIGN MOUNTING.
- 2 PROVIDE BLOCKING FOR CANOPY. SEE DETAILS 3/S4.3 AND 13/S4.3.

KEY NOTES **C**

1. EXTEND BLOCKING AS REQUIRED TO FIT BETWEEN STUDS.
2. ELEVATION AT BOTTOM OF CANOPIES SHALL BE 9'-0" A.F.F. U.N.O.
3. COORDINATE SIGNAGE ELEMENTS AND BLOCKING REQUIREMENTS WITH SIGNAGE VENDOR - SEE SCOPE OF WORK.
4. THIS SHEET IS TO INDICATE BLOCKING REQUIREMENTS FOR SIGNS, AWNINGS, AND CANOPIES. ADDITIONAL BLOCKING IS REQUIRED FOR OTHER ITEMS AS SHOWN ON OTHER DRAWINGS.

GENERAL NOTES **D**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 04.08.21
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 313354
 STORE NUMBER: 449523
 PA/PM: JN
 DRAWN BY.: DL
 JOB NO.: 2018088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236



ENDEAVOR 2.0
**CANOPY/AWNING
 BLOCKING
 ELEVATIONS**

S5.0

PLOT DATE: 11/7/2022 4:36:19 PM

IMPROVEMENT PLANS

TACO BELL

18550 E. WARREN AVE
DETROIT, MI 48236
JULY, 2022


WAYNE COUNTY CONSTRUCTION NOTES:

- PRIOR TO PAVEMENT REMOVAL THE CONTRACTOR SHALL CONTACT WAYNE COUNTY ENGINEER/INSPECTOR TO VERIFY IF THE EXISTING GRADE OF THE GUTTER LINES AND THE TOP OF CURBS ARE NEEDED AND TO BE PROVIDED AS REQUESTED.
- SAW-CUT FULL DEPTH OF THE EXISTING PAVEMENT TO THE NEAREST JOINT WITHIN WAYNE COUNTY ROAD RIGHT-OF-WAY AND REMOVE THE EXISTING PAVEMENT AND CURB OR AS DIRECTED BY WAYNE COUNTY ENGINEER.
- CONSTRUCT THE PRIMARY ROADS AS FOLLOWS:
 - CONSTRUCT WAYNE COUNTY PRIMARY ROAD PAVEMENT PER WAYNE COUNTY PERMIT STANDARDS, "PR-1" OR "PR-2" AS APPLICABLE, OR AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
 - PLACE 9" OF 21AA AGGREGATE COMPACTED TO MINIMUM 95% DENSITY OR MAXIMUM UNIT WEIGHT OR AS DIRECTED BY WAYNE COUNTY ENGINEER.
 - CONSTRUCT WAYNE COUNTY ROAD PAVEMENT REPAIR WITHIN MINIMUM 2" HMA (F) ON MINIMUM OF 10" NON-REINFORCED CONCRETE 35P MIX (3500 PSI AT 28 DAYS) AND INTEGRAL STRAIGHT CURB TYPE "4" AS PER WAYNE COUNTY PERMIT STANDARDS, "RS-3" OR AS DIRECTED BY WAYNE COUNTY ENGINEER.
 - TIE THE NEW PAVEMENT TO THE EXISTING PAVEMENT WITH #5 EPOXY COATED TIE BARS AT MAXIMUM 43-INCH ON CENTER LONGITUDINALLY AND AT 18-INCH ON CENTER TRANSVERSELY AS PER WAYNE COUNTY PERMIT STANDARDS, "RS-2" OR AS DIRECTED BY THE COUNTY ENGINEER.
- PLACE THE CONSTRUCTION JOINTS OF THE NEW PAVEMENT TO MATCH THE EXISTING PAVEMENT JOINTS OR AS DIRECTED BY WAYNE COUNTY ENGINEER.
- ANY DAMAGED UNDERDRAIN AS A RESULT OF THIS PROJECT ACTIVITY SHALL BE RECONSTRUCTED PER WAYNE COUNTY PERMIT STANDARDS, "S-14" OR AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
- ANY DAMAGED SIDEWALK AS A RESULT OF THIS PROJECT ACTIVITY SHALL BE RECONSTRUCTED AS PER WAYNE COUNTY PERMIT STANDARDS, "RS-5" OR AS DIRECTED BY THE WAYNE COUNTY ENGINEER. MAINTAIN 2% MAXIMUM TRANSVERSE SLOPE ON THE SIDEWALK.
- ANY DAMAGED SIDEWALK RAMP AS A RESULT OF THIS PROJECT ACTIVITY SHALL BE RECONSTRUCTED PER MDT STANDARDS, "R-28-J" OR AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
- STRUCTURE ADJUSTMENT SHALL BE DETERMINED ON SITE BY THE WAYNE COUNTY ENGINEER.
- THE CONTRACTOR IS RESPONSIBLE TO RESOLVE ANY WATER PONDING ISSUES AND MAINTAIN A POSITIVE FLOW ALONG THE GUTTER LINE WITHIN THE LIMIT OF THE PROJECT.
- RELOCATE, RESTORE, OR REPLACE ANY TRAFFIC SIGNS THAT ARE AFFECTED BY THIS CONSTRUCTION AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
- ALL EXISTING GAS MAINS TO BE ABANDONED IN-PLACE WITHIN WAYNE COUNTY RIGHT-OF-WAY SHALL BE FILLED WITH FLOWABLE FILL, CUT AND CAP ALL EXISTING GAS MAINS WHEN ABANDONING, TYP.

WAYNE COUNTY DPS GENERAL NOTES:

- ALL WORK WITHIN THE WAYNE COUNTY ROAD RIGHT-OF-WAY (ROW) AND DRAIN EASEMENT SHALL BE IN ACCORDANCE WITH THE CURRENT STANDARDS AND GENERAL SPECIFICATIONS, INCLUDING SOIL EROSION AND SEDIMENTATION CONTROL OF THE WAYNE COUNTY DEPARTMENT OF PUBLIC SERVICES, AND MDT 2012 SPECIFICATIONS FOR CONSTRUCTION.
- THESE PLANS ARE NOT VALID WITHOUT ATTACHMENT OF THE WAYNE COUNTY PERMIT SPECIFICATIONS FOR CONSTRUCTION WITHIN THE ROAD ROW, PARKS, DRAIN EASEMENT OR SANITARY SEWER UNDER JURISDICTION OF THE WAYNE COUNTY (07/01/93) REVISED 12/15/2004
- CONTRACTOR SHALL CONTACT MISS DIG AT 811 TO IDENTIFY AND FLAG / MARK THE LOCATIONS OF ALL UNDERGROUND UTILITIES AT THE PROPOSED CONSTRUCTION AREAS PRIOR TO START OF CONSTRUCTION, AND SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT LOCATIONS AND ELEVATIONS OF ALL UNDERGROUND UTILITIES, AND RESOLVE ANY CONFLICT BETWEEN THE PROPOSED WORK AND THE EXISTING UNDERGROUND OR ABOVEGROUND UTILITIES.
- CONTRACTOR SHALL MAINTAIN 18" MINIMUM VERTICAL CLEARANCE AND 3 FEET MINIMUM HORIZONTAL CLEARANCE BETWEEN THE PROPOSED AND EXISTING UTILITIES. ANY PROPOSED UTILITY PERMITTED TO CROSS UNDER THE ROAD OR DRAIN, MUST BE PLACED A MINIMUM OF 7 FEET BELOW THE LOWEST POINT OF THE ROAD, OR 6 FEET BELOW THE DRAIN BOTTOM. OVERHEAD WIRES/CABLES MUST BE INSTALLED 18 FEET MINIMUM ABOVE THE ROAD CENTERLINE. TO RELOCATE ANY UTILITY WITHIN THE ROAD ROW, THE CONTRACTOR SHALL COORDINATE THE RELOCATION WITH THE UTILITY COMPANY AND AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
- ALL SURVEY MONUMENTS / CORNERS AND BENCH MARKS LOCATED WITHIN THE CONSTRUCTION AREA MUST BE PRESERVED IN ACCORDANCE WITH PUBLIC ACT 74 AS AMENDED (INCLUDING ACT 34, P.A. 2000) AND AS PER WAYNE COUNTY PERMIT RULE 1.5. THE PERMIT HOLDER AND CONTRACTOR SHALL COORDINATE THE WORK WITH A PROFESSIONAL SURVEYOR LICENSED IN THE STATE OF MICHIGAN DURING CONSTRUCTION ACTIVITIES FOR THE PURPOSE OF WITNESSING, PRESERVING OR REPLACING SURVEY MONUMENTS AND MONUMENT BOXES.
- EXPOSURE OF ANY UTILITIES UNDER THE PAVEMENT WILL NOT BE PERMITTED, UNLESS APPROVED BY THE WAYNE COUNTY ENGINEER. PAVEMENT REMOVAL AND REPLACEMENT SHALL BE PERFORMED PER APPLICABLE WAYNE COUNTY STANDARD DETAILS AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
- CONTRACTOR SHALL RESTORE ALL DISTURBED AREAS WITHIN THE WAYNE COUNTY ROAD ROW AND DRAIN EASEMENT WITH 3" TOPSOIL, 3M SEED MIX AND MULCH. SLOPES STEEPER THAN 1 ON 3 SHALL BE RESTORED BY PLACING SOD ON 2" TOPSOIL.
- ALL BACKFILLS UNDER OR WITHIN 3 FEET OF THE PROPOSED OR EXISTING PAVEMENT, CURB OR SIDEWALK SHALL CONFORM TO THE WAYNE COUNTY TRENCH "B" BACKFILL REQUIREMENTS. TRENCH "A" BACKFILL MAY BE USED WITHIN THE ROAD ROW AREAS UNDER CONDITIONS OTHER THAN THOSE SPECIFIED FOR TRENCH "B".
- CONTRACTOR IS RESPONSIBLE FOR RESTORING OR REPLACING ALL DISTURBED LANDSCAPED AREAS, SPRINKLER SYSTEMS, FENCES, SIGNS, MAIL BOXES, ETC. WITHIN THE WAYNE COUNTY ROAD ROW AND / OR AS DIRECTED BY THE COUNTY ENGINEER.
- CONTRACTOR SHALL MAINTAIN TWO-WAY TRAFFIC AT ALL TIMES. OTHERWISE, DETOURING TRAFFIC MUST BE PER APPROVED PLANS. ALL SIGNING AND TRAFFIC CONTROL DEVICES SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF M.M.U.T.C.D.
- MAINTAIN A SAFE AND ADEQUATE TRAVEL ROUTE FOR PEDESTRIANS AT ALL TIMES THROUGHOUT THE PROJECT DURATION.
- TUNNELING, BORING AND JACKING OPERATIONS SHALL BE IN ACCORDANCE WITH THE WAYNE COUNTY SPECIFICATIONS AND DETAILS. BORE PITS SHALL BE PLACED AT MINIMUM 10 FEET FROM THE BACK OF CURB OR EDGE OF PAVEMENT.
- REMOVE ALL ABANDONED CONDUITS FROM THE COUNTY ROADS ROW OR AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
- CONTRACTOR SHALL PROVIDE COLD WEATHER PROTECTION FOR ALL PROPOSED CONCRETE WORK (PAVEMENTS, SIDEWALKS, DRIVE APPROACHES, ETC.) AS DIRECTED BY THE WAYNE COUNTY ENGINEER.
- OVERNIGHT VEHICLE PARKING AND STORAGE OF CONSTRUCTION MATERIALS AND EQUIPMENTS ARE NOT PERMITTED WITHIN THE WAYNE COUNTY ROADS RIGHTS-OF-WAY.
- CONTRACTOR SHOULD OBTAIN SOIL EROSION AND SEDIMENTATION CONTROL PERMIT FROM THE WAYNE COUNTY DPS. CONTACT THE WAYNE COUNTY SOIL EROSION OFFICE AT (734) 326-3936, OR THE COMMUNITY HAVING JURISDICTION OVER THE SOIL EROSION PERMIT.
- CONTRACTOR SHALL NOTIFY THE WAYNE COUNTY TRAFFIC SIGNAL SHOP AT (734) 955-2161 AT LEAST 72 HOURS PRIOR TO START OF WORK AT OR NEAR ANY SIGNALIZED INTERSECTIONS.
- CONTRACTOR SHALL NOTIFY WAYNE COUNTY 72 HOURS PRIOR TO START OF CONSTRUCTION. CONTACT THE PERMIT OFFICE AT (734) 858-2761.

WAYNE COUNTY NOTES AND DETAILS SHALL GOVERN OVER ALL OTHER NOTES AND DETAILS WITHIN THE WAYNE COUNTY RIGHT OF WAY (MACK AVENUE).

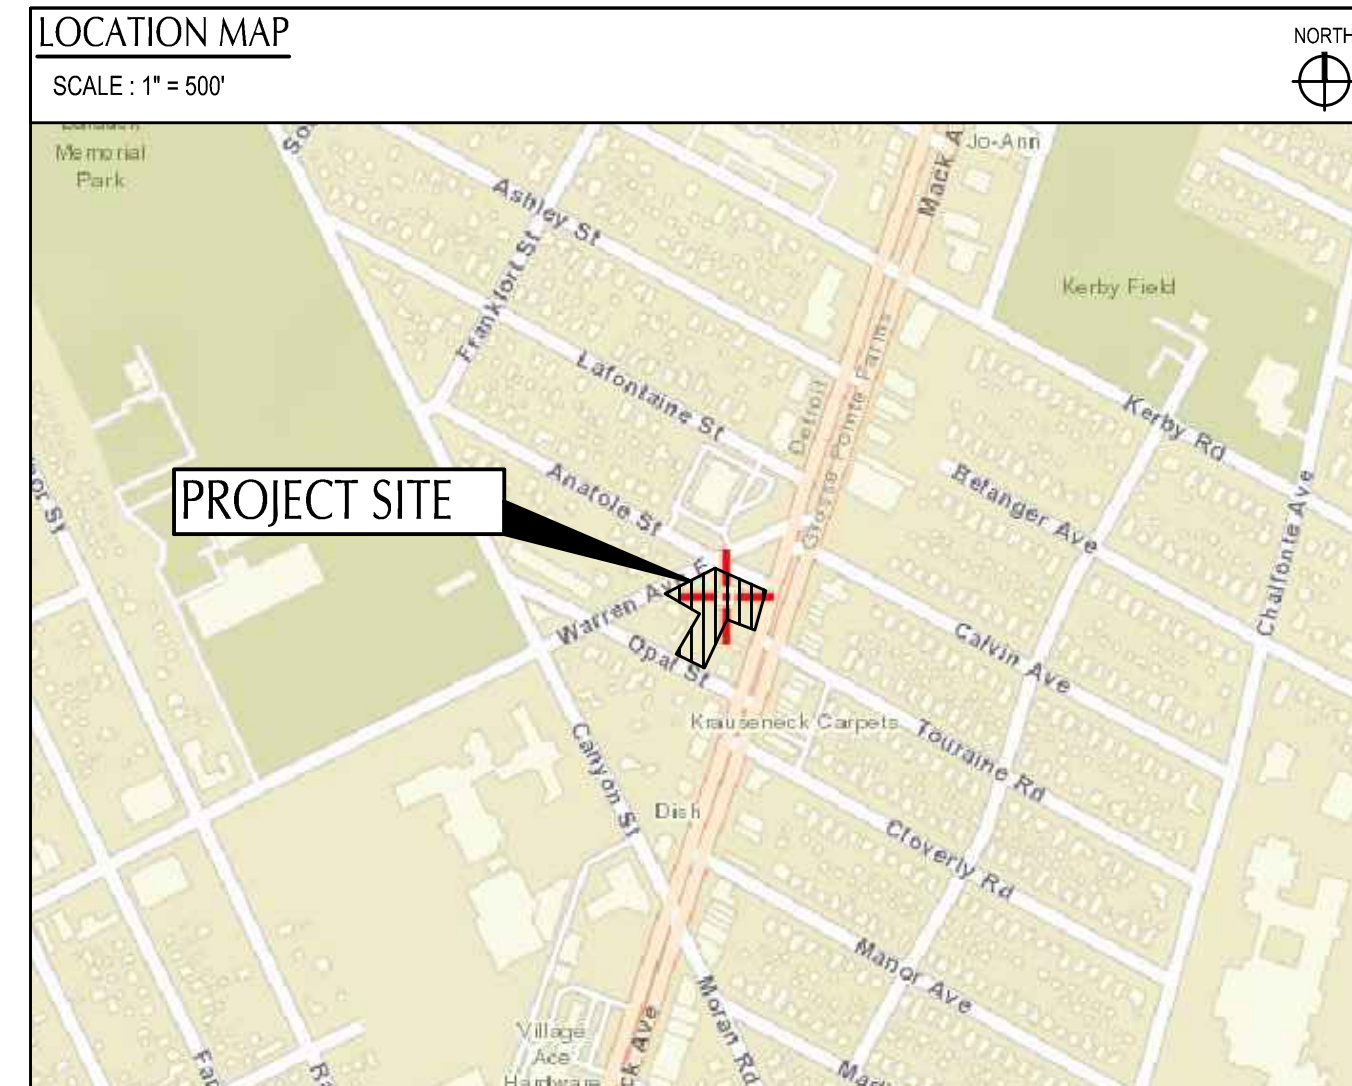

PROPERTY DESCRIPTION

LAND SITUATED IN THE COUNTY OF WAYNE, CITY OF DETROIT, STATE OF MICHIGAN, IS DESCRIBED AS FOLLOWS:

PARCEL ONE:
LOT NO. 56, SUNNY SIDE SITES SUBDIVISION OF A PART OF PRIVATE CLAIMS 122 AND 404, TOWNSHIPS OF GROSSE POINTE AND GRATIOT, WAYNE COUNTY, MICHIGAN, ACCORDING TO THE PLAT THEREOF AS RECORDED IN LIBER 42, PAGE 57 OF PLATS, WAYNE COUNTY RECORDS.

4886 OPAL ST.
TAX ID: 21/078517

PARCEL TWO:
LOT 57, SUNNYSIDE SITES SUBDIVISION, ACCORDING TO THE PLAT THEREOF AS RECORDED IN LIBER 42, PAGE 57 OF PLATS, WAYNE COUNTY RECORDS.

4880 OPAL ST.
TAX ID: 21/078516

PARCEL THREE:
LOTS 64 THROUGH 72 BOTH INCLUSIVE, EXCEPT THAT PART OF LOTS 64 TO 69 TAKEN FOR WIDENING OF MACK AVENUE AND INCLUDING THE ADJOINING ONE-HALF OF THE VACATED PUBLIC ALLEY AT THE REAR OF SAID LOTS AND EXCEPTING THAT PART OF LOTS 70, 71, AND 72 TAKEN FOR OPENING OF AND WIDENING OF WARREN AVENUE AND INCLUDING THE ADJOINING ONE-HALF OF THE VACATED PUBLIC ALLEY LYING EAST OF AND ADJACENT TO LOT 70, SUNNY SIDE SITES SUBDIVISION OF A PART OF PRIVATE CLAIM 122 AND 404, ACCORDING TO THE PLAT THEREOF RECORDED IN LIBER 42, PAGE 57 OF PLATS, WAYNE COUNTY RECORDS.

18550 E. WARREN AVE.
TAX ID: 21/001633-7

PROJECT DESCRIPTION

THIS SITE WAS HOME TO AN EXISTING TWO STORY BANK AND PARKING LOT WHICH WILL BE DEMOLISHED AND REPLACED WITH A NEW TACO BELL BUILDING AND PARKING LOT AS SHOWN ON THESE PLANS.

MICHIGAN SPECIFICATION

THE STANDARD SPECIFICATIONS OF THE STATE OF MICHIGAN DEPARTMENT OF TRANSPORTATION, INCLUDING CHANGES AND SUPPLEMENTAL SPECIFICATIONS LISTED IN THE PROPOSAL SHALL GOVERN THIS IMPROVEMENT.

PLAN REPRODUCTION WARNING

THE PLANS HAVE BEEN PREPARED FOR PRINTING ON ANSI D (22"x34") SHEETS. PRINTING ON OTHER SIZE SHEETS MAY DISTORT SCALES. REFER TO GRAPHIC SCALES.

INDEX OF DRAWINGS

TITLE SHEET	TS-001
ALTA	---
GENERAL NOTES	C-001
SWPPP NOTES	C-010
SWPPP DETAILS	C-011
SWPP PLAN	C-012
DEMOLITION PLAN	C-101
SITE PLAN	C-111
AUTOTURN PLAN	C-112
GRADING PLAN	C-121
UTILITY PLAN	C-131
SITE DETAILS	C-501
SITE DETAILS	C-502
SITE DETAILS	C-503
DETROIT DWP DETAILS (FOR REFERENCE ONLY)	C-504
DETROIT DWSD DETAILS (FOR REFERENCE ONLY)	C-505
DETROIT DWSD DETAILS (FOR REFERENCE ONLY)	C-506
DETROIT DWSD AND TRENCH DETAILS (FOR REFERENCE ONLY)	C-507
WAYNE COUNTY STANDARD DRAWINGS (FOR REFERENCE ONLY)	C-508
LANDSCAPE GENERAL NOTES	L-001
LANDSCAPE PLAN	L-101
LANDSCAPE DETAILS	L-501

OWNER
LGY DEVELOPMENT
CLINT LANGLEY
104 LISA COURT
MC MURRAY, PA 15317
PHONE: 724-263-7757

ENGINEER:
LEONARDO SFERRA
520 SOUTH MAIN STREET, SUITE 2531
AKRON, OHIO 44311
PHONE: 330-572-3506



DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
P/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL

18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0
TITLE SHEET



TS-001

PLOT DATE:

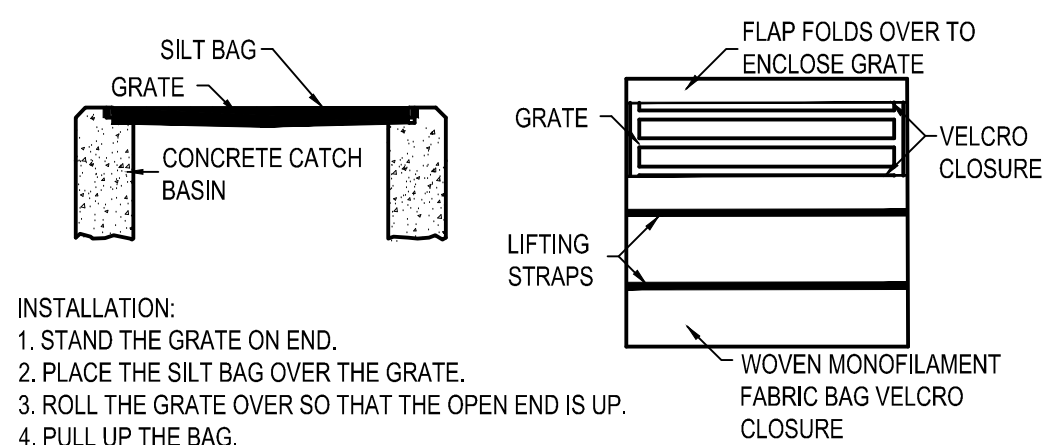

INSTALLATION:

1. STAND THE GRATE ON END.
2. PLACE THE SILT BAG OVER THE GRATE.
3. ROLL THE GRATE OVER SO THAT THE OPEN END IS UP.
4. PULL UP THE BAG.
5. TUCK THE FLAP IN.
6. PRESS THE VELCRO STRAPS TOGETHER.
7. BE SURE THAT THE END OF THE GRATE IS COMPLETELY COVERED BY THE FLAP OR THE SILT BAG WILL NOT WORK PROPERLY.
8. HOLDING THE HANDLES, CAREFULLY PLACE THE SILT BAG WITH THE GRATE INSERTED INTO THE CATCH BASIN FRAME.

MAINTENANCE:

TO ENSURE PROPER OPERATION REMOVE SILT, SEDIMENT, AND DEBRIS FROM THE SURFACE AND THE VICINITY OF THE UNIT WITH A SQUARE POINT SHOVEL OR STIFF BRISTLE BROOM AWAY FROM ENVIRONMENTALLY SENSITIVE AREAS AND WATERWAYS IN MANNER SATISFACTORY TO THE ENGINEER/INSPECTOR. REMOVE FINE MATERIAL FROM INSIDE SILT BAG AS NEEDED. DISPOSE OF SILT BAG NO LONGER IN USE AT AN APPROPRIATE RECYCLING OR SOLID WASTE FACILITY.

INLET INSPECTION:

TO INSPECT INLET, REMOVE SILT BAG WITH GRATE INSIDE, INSPECT CATCH BASIN AND REPLACE SILT BAG BACK INTO GRATE FRAME.

NOTE: PONDING IS LIKELY IF SEDIMENT IS NOT REMOVED REGULARLY. THE SILT BAG MUST NEVER BE USED WHERE OVERFLOW MAY ENDANGER AN EXPOSED SLOPE.

C3 SILT BAG PROTECTION
N.T.S.



COMPOST SOCK FABRIC MINIMUM SPECIFICATIONS

MATERIAL TYPE	3 mil HDPE	5 mil HDPE	5 mil HDPE	MULTI-FILAMENT POLYPROPYLENE (MFPP)	HEAVY DUTY MULTI-FILAMENT POLYPROPYLENE (MFPP)
MATERIAL CHARACTERISTICS	PHOTO-DEGRADABLE	PHOTO-DEGRADABLE	BIO-DEGRADABLE	PHOTO-DEGRADABLE	PHOTO-DEGRADABLE
SOCK DIAMETERS	12" 18"	18" 24"	18" 24" 32"	18" 24" 32"	18" 24" 32"
MESH OPENING	3/8"	3/8"	3/8"	3/8"	1/8"
TENSILE STRENGTH		26 PSI	26 PSI	44 PSI	202 PSI
ULTRAVIOLET STABILITY % ORIGINAL STRENGTH (ASTM G-155)	% AT 1000 HR.	23% AT 1000 HR.		100% AT 1000 HR.	100% AT 1000 HR.
MINIMUM FUNCTIONAL LONGEVITY	6 MONTHS	9 MONTHS	6 MONTHS	1 YEAR	2 YEARS
TWO-PLY SYSTEMS					
INNER CONTAINMENT NETTING	HDPE BIAXIAL NET CONTINUOUSLY WOUND FUSION-WELDED JUNCTURES 3/4" X 3/4" MAX. APERTURE SIZE				
	COMPOSITE POLYPROPYLENE FABRIC (WOVEN LAYER & NON-WOVEN FLEECE MECHANICALLY FUSED VIA NEEDLE PUNCH) 3/16" MAX. APERTURE SIZE				
OUTER FILTRATION MESH					

SOCK FABRICS COMPOSED OF BURLAP MAY BE USED ON PROJECTS LASTING 6 MONTHS OR LESS



COMPOST SHALL MEET THE FOLLOWING STANDARDS:

ORGANIC MATTER CONTENT	80% - 100% (DRY WEIGHT BASIS)
ORGANIC PORTION	FIBROUS AND ELONGATED
pH	5.5 - 8.0
MOISTURE CONTENT	35% - 55%
PARTICLE SIZE	98% PASS THROUGH 1" SCREEN
SOLUBLE SALT CONCENTRATION	5.0 ds MAXIMUM

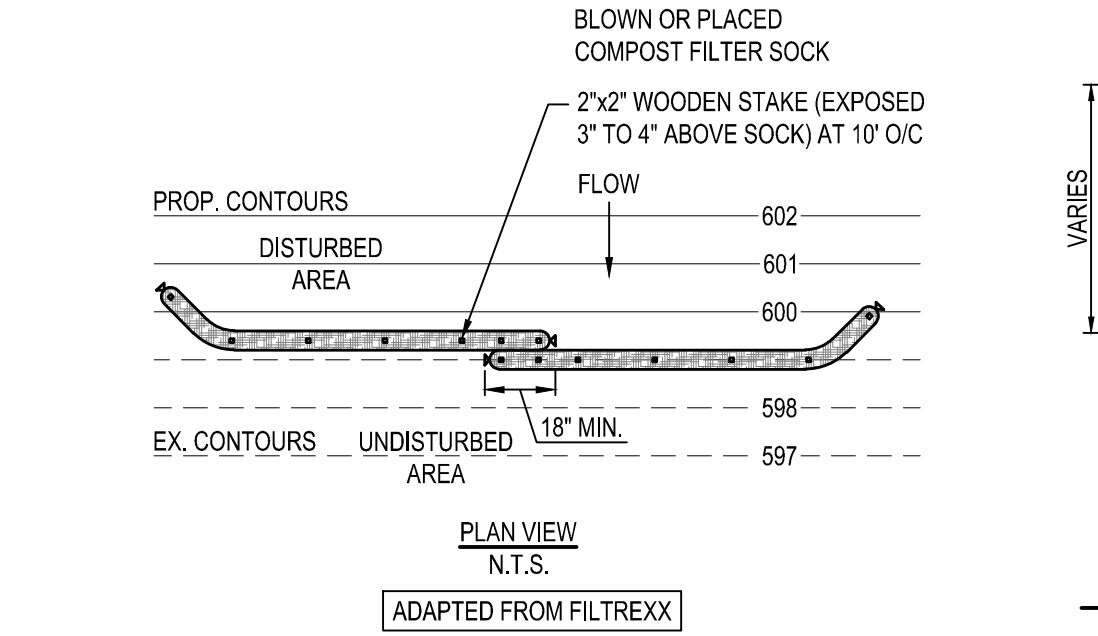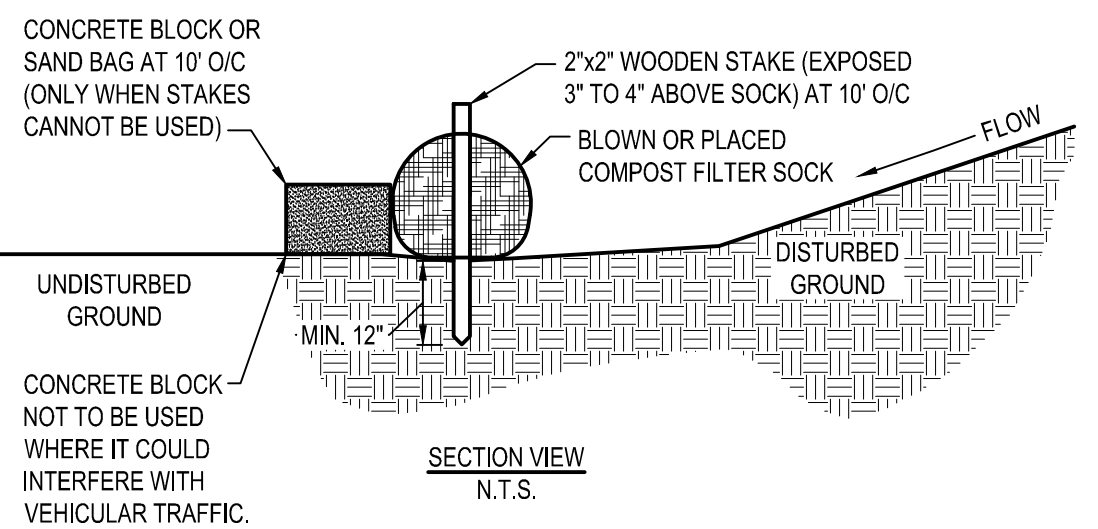


1. COMPOST FILTER SOCK SHALL BE PLACED AT EXISTING LEVEL GRADE. BOTH ENDS OF THE SOCK SHALL BE EXTENDED AT LEAST 8 FEET UP SLOPE AT 45 DEGREES TO THE MAIN SOCK ALIGNMENT.
2. TRAFFIC SHALL NOT BE PERMITTED TO CROSS FILTER SOCKS.
3. ACCUMULATED SEDIMENT SHALL BE REMOVED WHEN IT REACHES 1/2 THE ABOVE GROUND HEIGHT OF THE SOCK AND DISPOSED IN THE MANNER DESCRIBED ELSEWHERE IN THE PLAN. DAMAGED SOCKS SHALL BE REPAIRED ACCORDING TO MANUFACTURER'S SPECIFICATIONS OR REPLACED WITHIN 24 HOURS OF INSPECTION.
5. BIODEGRADABLE FILTER SOCK SHALL BE REPLACED AFTER 6 MONTHS. PHOTODEGRADABLE SOCKS AFTER 1 YEAR. POLYPROPYLENE SOCKS SHALL BE REPLACED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS.
6. UPON STABILIZATION OF THE AREA TRIBUTARY TO THE SOCK, STAKES SHALL BE REMOVED. THE SOCK MAY BE LEFT IN PLACE AND VEGETATED OR REMOVED. IN THE LATTER CASE, THE MESH SHALL BE CUT OPEN AND THE MULCH SPREAD AS A SOIL SUPPLEMENT.

A2 COMPOST FILTER SOCK
N.T.S.

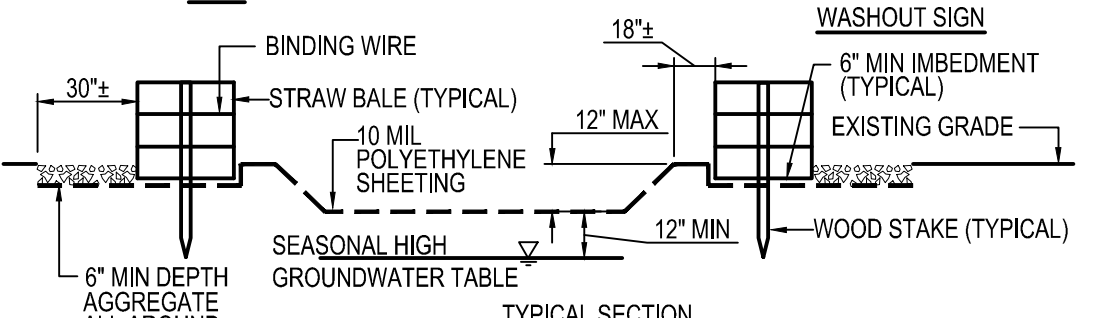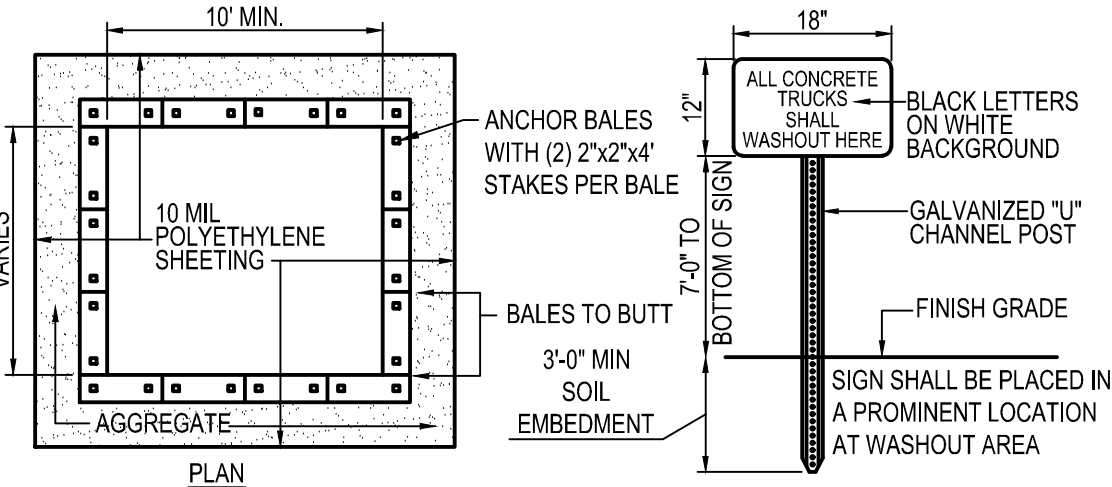

- NOTES:**
1. CONTAINMENT MUST BE STRUCTURALLY SOUND AND LEAK FREE AND CONTAIN ALL LIQUID WASTES.
 2. CONTAINMENT DEVICES MUST BE OF SUFFICIENT QUANTITY OR VOLUME TO COMPLETELY CONTAIN THE LIQUID WASTES GENERATED.
 3. WASHOUT MUST BE CLEANED OR NEW FACILITIES CONSTRUCTED AND READY TO USE ONCE WASHOUT IS 75% FULL.
 4. WASHOUT AREA(S) SHALL BE INSTALLED IN A LOCATION EASILY ACCESSIBLE BY CONCRETE TRUCKS.
 5. ONE OR MORE AREAS MAY BE INSTALLED ON THE CONSTRUCTION SITE AND MAY BE RELOCATED AS CONSTRUCTION PROGRESSES.
 6. AT LEAST WEEKLY REMOVE ACCUMULATION OF SAND AND AGGREGATE AND DISPOSE OF PROPERLY.

A3 CONCRETE WASHOUT AREA
N.T.S.

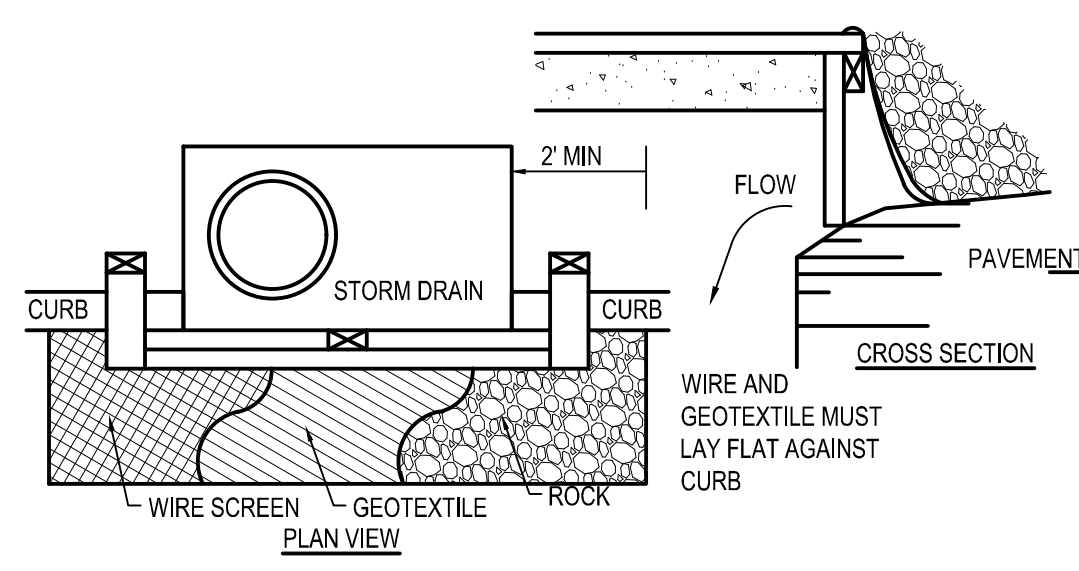


1. INLET PROTECTION SHALL BE CONSTRUCTED EITHER BEFORE UPSLOPE LAND DISTURBANCE BEGINS OR BEFORE THE INLET BECOMES FUNCTIONAL.
2. CONSTRUCT A WOODEN FRAME OF 2-BY-4-IN. CONSTRUCTION-GRADE LUMBER. THE END SPACERS SHALL BE A MINIMUM OF 1 FT. BEYOND BOTH ENDS OF THE THROAT OPENING. THE ANCHORS SHALL BE NAILED TO 2-BY-4-IN. STAKES DRIVEN ON THE OPPOSITE SIDE OF THE CURB.
3. THE WIRE MESH SHALL BE OF SUFFICIENT STRENGTH TO SUPPORT FABRIC AND STONE. IT SHALL BE A CONTINUOUS PIECE WITH A MINIMUM WIDTH OF 30 IN. AND 4 FT. LONGER THAN THE THROAT LENGTH OF THE INLET, 2 FT. ON EACH SIDE.
4. GEOTEXTILE CLOTH SHALL HAVE AN EQUIVALENT OPENING SIZE (EOS) OF 20-40 SIEVE AND BE RESISTANT TO SUNLIGHT. IT SHALL BE AT LEAST THE SAME SIZE AS THE WIRE MESH.
5. THE WIRE MESH AND GEOTEXTILE CLOTH SHALL BE FORMED TO THE CURB AND GUTTER AND AGAINST THE FACE OF THE CURB ON BOTH SIDES OF THE INLET AND SECURELY FASTENED TO THE 2-BY-4-IN. FRAME.
6. TWO-INCH STONE SHALL BE PLACED OVER THE WIRE MESH AND GEOTEXTILE IN SUCH A MANNER AS TO PREVENT WATER FROM ENTERING THE INLET UNDER OR AROUND THE GEOTEXTILE CLOTH. THIS TYPE OF PROTECTION MUST BE INSPECTED FREQUENTLY AND THE STONE AND/OR GEOTEXTILE REPLACED WHEN CLOGGED WITH SEDIMENT.

C4 CURB INLET PROTECTION
N.T.S.

CONSTRUCTION ENTRANCE NOTES


1. STONE SIZE - NO. 2 STONE SHALL BE USED, OR RECYCLED CONCRETE EQUIVALENT.
2. THE CONSTRUCTION ENTRANCE SHALL COINCIDE WITH THE PROPOSED DRIVE AS SHOWN ON THE PLAN.
3. PAVEMENT THICKNESS - STONE LAYER SHALL BE 6" THICK FOR STANDARD DUTY ACTIVITY AND 10" THICK FOR HEAVY DUTY ACTIVITY.
4. DRIVEWAY WIDTH - THE ENTRANCE SHALL BE AT LEAST 20' WIDE. CONTRACTOR SHALL ENSURE ALL VEHICLES UTILIZE THE CONSTRUCTION ENTRANCE UNTIL PAVEMENT IS IN PLACE.
5. BEDDING - GEOTEXTILE SHALL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING STONE. IT SHALL BE COMPOSED OF STRONG ROT-PROOF POLYMERIC FIBERS AND MEET THE SPECIFICATIONS SHOWN BELOW.
6. CULVERT-A PIPE OR CULVERT SHALL BE CONSTRUCTED UNDER THE ENTRANCE IF NEEDED TO PREVENT SURFACE WATER FLOWING ACROSS THE ENTRANCE OR TO PREVENT RUNOFF FROM BEING DIRECTED OUT ONTO PAVED SURFACES.
7. WATER BAR - A WATER BAR SHALL BE CONSTRUCTED AS PART OF THE CONSTRUCTION ENTRANCE IF NEEDED TO PREVENT SURFACE RUNOFF FROM FLOWING THE LENGTH OF THE CONSTRUCTION ENTRANCE AND OUT ONTO PAVED SURFACES.
8. MAINTENANCE - TOP DRESSING OF ADDITIONAL STONE SHALL BE APPLIED AS CONDITIONS DEMAND. MUD SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC ROADS, OR ANY SURFACE WHERE RUNOFF IS NOT CHECKED BY SEDIMENT CONTROLS, SHALL BE REMOVED IMMEDIATELY. REMOVAL SHALL BE ACCOMPLISHED BY SCRAPING OR SWEEPING.
9. CONSTRUCTION ENTRANCES SHALL NOT BE RELIED UPON TO REMOVE MUD FROM VEHICLES AND PREVENT OFF SITE TRACKING. VEHICLES THAT ENTER AND LEAVE THE CONSTRUCTION SHALL BE RESTRICTED FROM MUDDY AREAS.
10. THE ENTRANCE SHALL REMAIN IN PLACE UNTIL THE DISTURBED AREA IS STABILIZED OR REPLACED WITH A PERMANENT ROADWAY OR ENTRANCE.

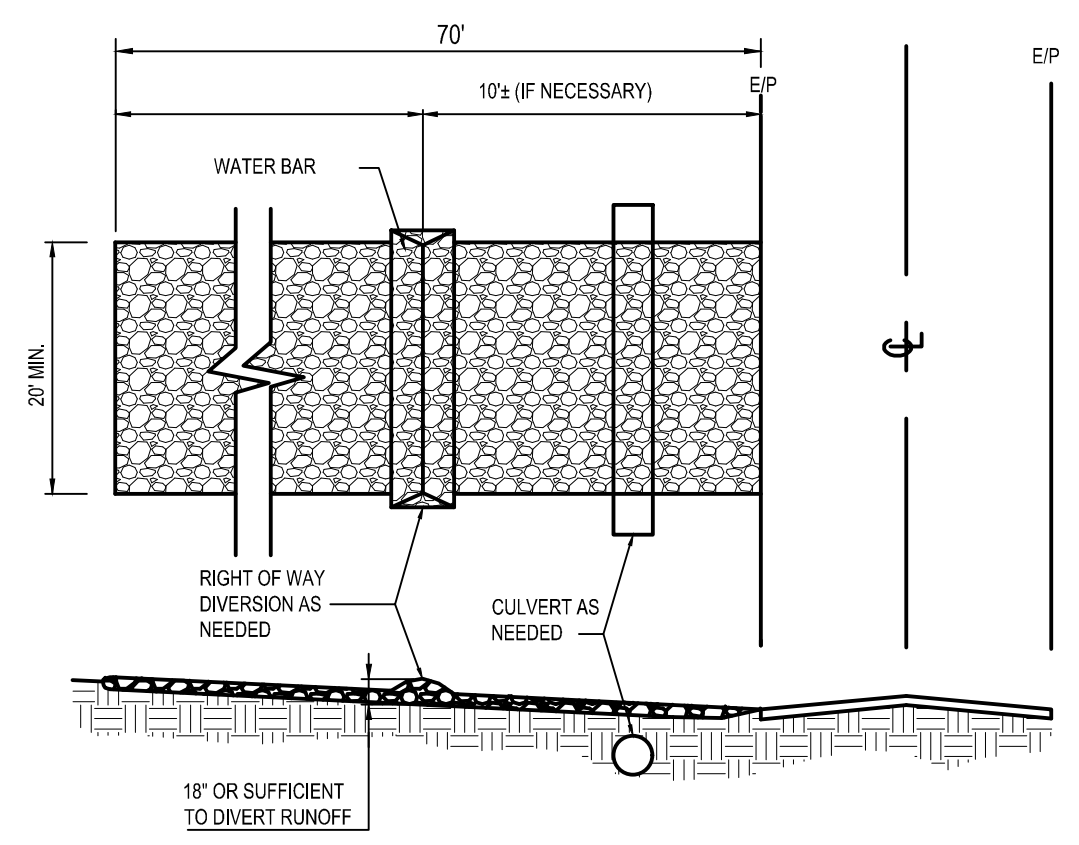

A4 TEMPORARY STABILIZED CONSTRUCTION ENTRANCE
N.T.S.

- NOTES:**
- 1) SILT FENCE SHALL BE CONSTRUCTED BEFORE UPSLOPE LAND DISTURBANCE BEGINS.
 - 2) ALL SILT FENCE SHALL BE PLACED AS CLOSE TO THE CONTOUR AS POSSIBLE SO THAT WATER WILL NOT CONCENTRATE AT LOW POINTS IN THE FENCE AND SO THAT SMALL SWALES OR DEPRESSIONS WHICH MAY CARRY SMALL CONCENTRATED FLOWS TO THE SILT FENCE ARE DISSIPATED ALONG ITS LENGTH.
 - 3) TO PREVENT WATER PONDED BY THE SILT FENCE FROM FLOWING AROUND THE ENDS, EACH END SHALL BE CONSTRUCTED UPSLOPE SO THAT THE ENDS ARE AT A HIGHER ELEVATION.
 - 4) WHERE POSSIBLE, SILT FENCE SHALL BE PLACED ON THE FLATTEST AREA AVAILABLE.
 - 5) WHERE POSSIBLE, VEGETATION SHALL BE PRESERVED FOR 5 FT. (OR AS MUCH AS POSSIBLE) UPSLOPE FROM THE SILT FENCE. IF VEGETATION IS REMOVED, IT SHALL BE REESTABLISHED WITHIN 7 DAYS FROM THE INSTALLATION OF THE SILT FENCE.
 - 6) THE HEIGHT OF THE SILT FENCE SHALL BE A MINIMUM OF 16 IN. ABOVE THE ORIGINAL GROUND SURFACE.
 - 7) THE FILTER FABRIC SHALL BE PURCHASED IN A CONTINUOUS ROLL CUT TO THE LENGTH OF THE BARRIER TO AVOID THE USE OF JOINTS. WHEN JOINTS ARE NECESSARY, FILTER CLOTH SHALL BE SPLICED TOGETHER ONLY AT A SUPPORT POST, WITH A MINIMUM 6 INCH OVERLAP, AND SECURELY SEALED.
 - 8) POSTS SHALL BE A MINIMUM OF 5 FEET LONG, 2 INCHES IN DIAMETER AND SPACED A MAXIMUM OF 10 FEET APART AT THE BARRIER LOCATION AND DRIVEN SECURELY INTO THE GROUND. WHEN EXTRA STRENGTH FABRIC IS USED WITHOUT THE WIRE SUPPORT FENCE, POST SPACING SHALL NOT EXCEED 6 FEET.
 - 9) THE SILT FENCE SHALL BE PLACED IN A TRENCH CUT A MINIMUM OF 6 INCHES DEEP. THE TRENCH SHALL BE CUT WITH A TRENCHER, CABLE LAYING MACHINE, OR OTHER SUITABLE DEVICE WHICH WILL ENSURE AN ADEQUATELY UNIFORM TRENCH DEPTH.
 - 10) THE SILT FENCE SHALL BE PLACED WITH THE STAKES ON THE DOWNSLOPE SIDE OF THE GEOTEXTILE AND SO THAT 8 IN. OF CLOTH ARE BELOW THE GROUND SURFACE. EXCESS MATERIAL SHALL LAY ON THE BOTTOM OF THE 6 IN. DEEP TRENCH. THE TRENCH SHALL BE BACKFILLED AND COMPACTED.
 - 11) WHEN EXTRA STRENGTH FILTER FABRIC AND CLOSER POST SPACING ARE USED, THE WIRE MESH SUPPORT FENCE MAY BE ELIMINATED. IN SUCH A CASE, THE FILTER FABRIC IS STAPLED OR WIRED DIRECTLY TO THE POSTS.
 - 12) THE STANDARD STRENGTH FILTER FABRIC SHALL BE STAPLED OR WIRED TO THE FENCE, AND 8 INCHES OF THE FABRIC SHALL BE EXTENDED INTO THE TRENCH. THE FABRIC SHALL NOT EXTEND MORE THAN 36 INCHES ABOVE THE ORIGINAL GROUND SURFACE. FILTER FABRIC SHALL NOT BE STAPLED TO EXISTING TREES.
 - 13) SEAMS BETWEEN SECTION OF SILT FENCE SHALL BE OVERLAPPED WITH THE END STAKES OF EACH SECTION WRAPPED TOGETHER BEFORE DRIVING INTO THE GROUND.
 - 14) SILT FENCE SHALL ALLOW RUNOFF TO PASS ONLY AS DIFFUSE FLOW THROUGH THE GEOTEXTILE. IF RUNOFF OVERTOPS THE SILT FENCE, FLOWS UNDER OR AROUND THE ENDS, OR IN ANY OTHER WAY BECOMES A CONCENTRATED FLOW, ONE OF THE FOLLOWING SHALL BE PERFORMED, AS APPROPRIATE: A) THE LAYOUT OF THE SILT FENCE SHALL BE CHANGED, B) ACCUMULATED SEDIMENT SHALL BE REMOVED, OR C) OTHER PRACTICES SHALL BE INSTALLED.

MAINTENANCE:
SILT FENCE SHOULD BE INSPECTED REGULARLY AND FREQUENTLY AS WELL AS AFTER EACH RAINFALL EVENT TO ENSURE THAT THEY ARE INTACT AND THERE ARE NO GAPS AT THE FENCE-GROUND INTERFACE OR TEARS ALONG THE LENGTH OF THE FENCE. IF GAPS OR TEARS ARE FOUND, THEY SHOULD BE REPAIRED OR THE FABRIC REPLACED IMMEDIATELY. ACCUMULATED SEDIMENTS SHOULD BE REMOVED FROM THE FENCE BASE WHEN THE SEDIMENT REACHES ONE-THIRD TO ONE-HALF THE HEIGHT OF THE FENCE. SEDIMENT REMOVAL SHOULD OCCUR MORE FREQUENTLY IF ACCUMULATED SEDIMENT IS CREATING NOTICEABLE STRAIN ON THE FABRIC AND THERE IS THE POSSIBILITY OF THE FENCE FALLING FROM A SUDDEN STORM EVENT. WHEN THE SILT FENCE IS REMOVED, THE ACCUMULATED SEDIMENT SHOULD BE REMOVED.

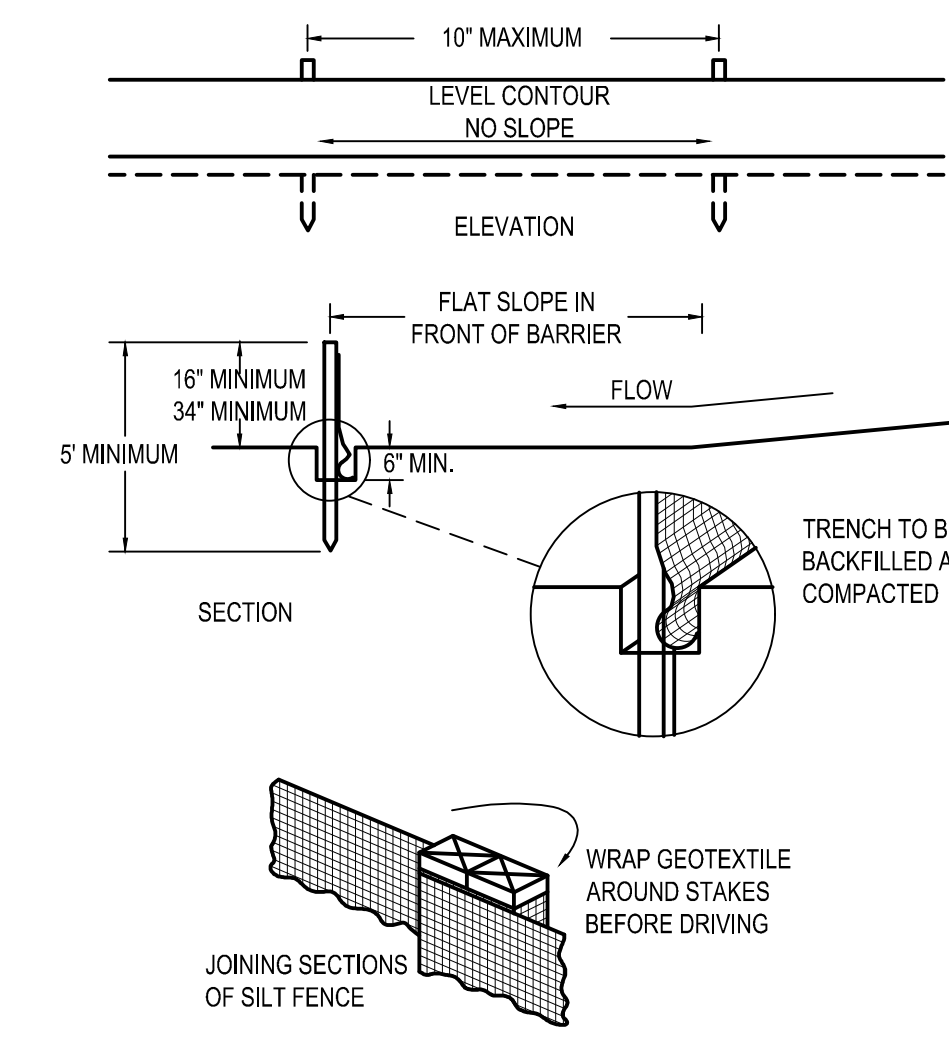

CRITERIA FOR GEOTEXTILE FABRIC SILT FENCE, PER CURRENT STATE'S DOT SPECIFICATIONS.

FABRIC PROPERTIES	VALUES	TEST METHOD
MINIMUM TENSILE STRENGTH	120 LB. MINIMUM	ASTM D 4632
MINIMUM BURST STRENGTH	200 PSI MINIMUM	ASTM D 4491
MINIMUM PERMITTIVITY	1x10 ⁻²³ sec ⁻¹	ASTM D 4751
APPARENT OPENING SIZE	AOS ≤ 0.84 mm	ASTM G 4535
UV EXPOSURE STRENGTH RETENTION	70%	ASTM G 4535
MAXIMUM ELONGATION AT 60 LBS.	50%	ASTM D 4632
MINIMUM PUNCTURE STRENGTH	50 LBS (220N)	ASTM D 4833
MINIMUM TEAR STRENGTH	40 LBS (180N)	ASTM D 4533

A5 SILT FENCE
N.T.S.

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAP/M: SM
DRAWN BY.: RS
JOB NO.: 2020088.03





TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0 SWPP DETAILS

C-011

PLLOT DATE:

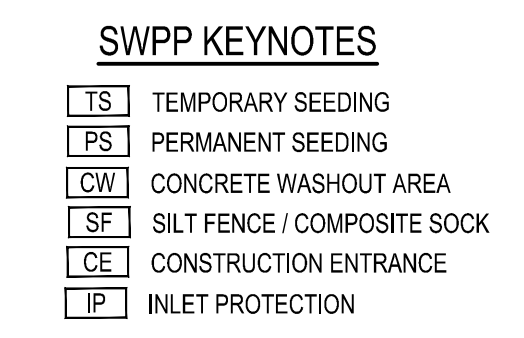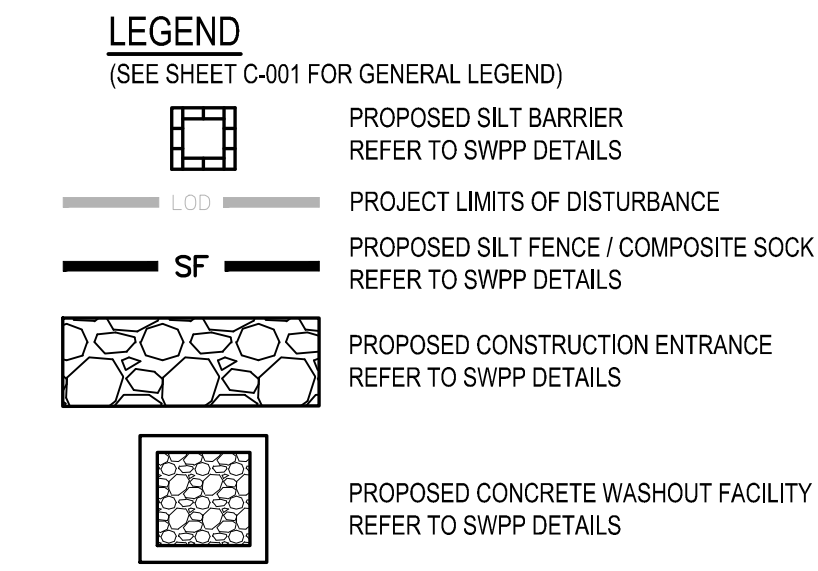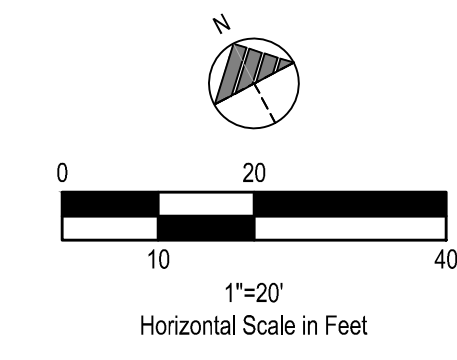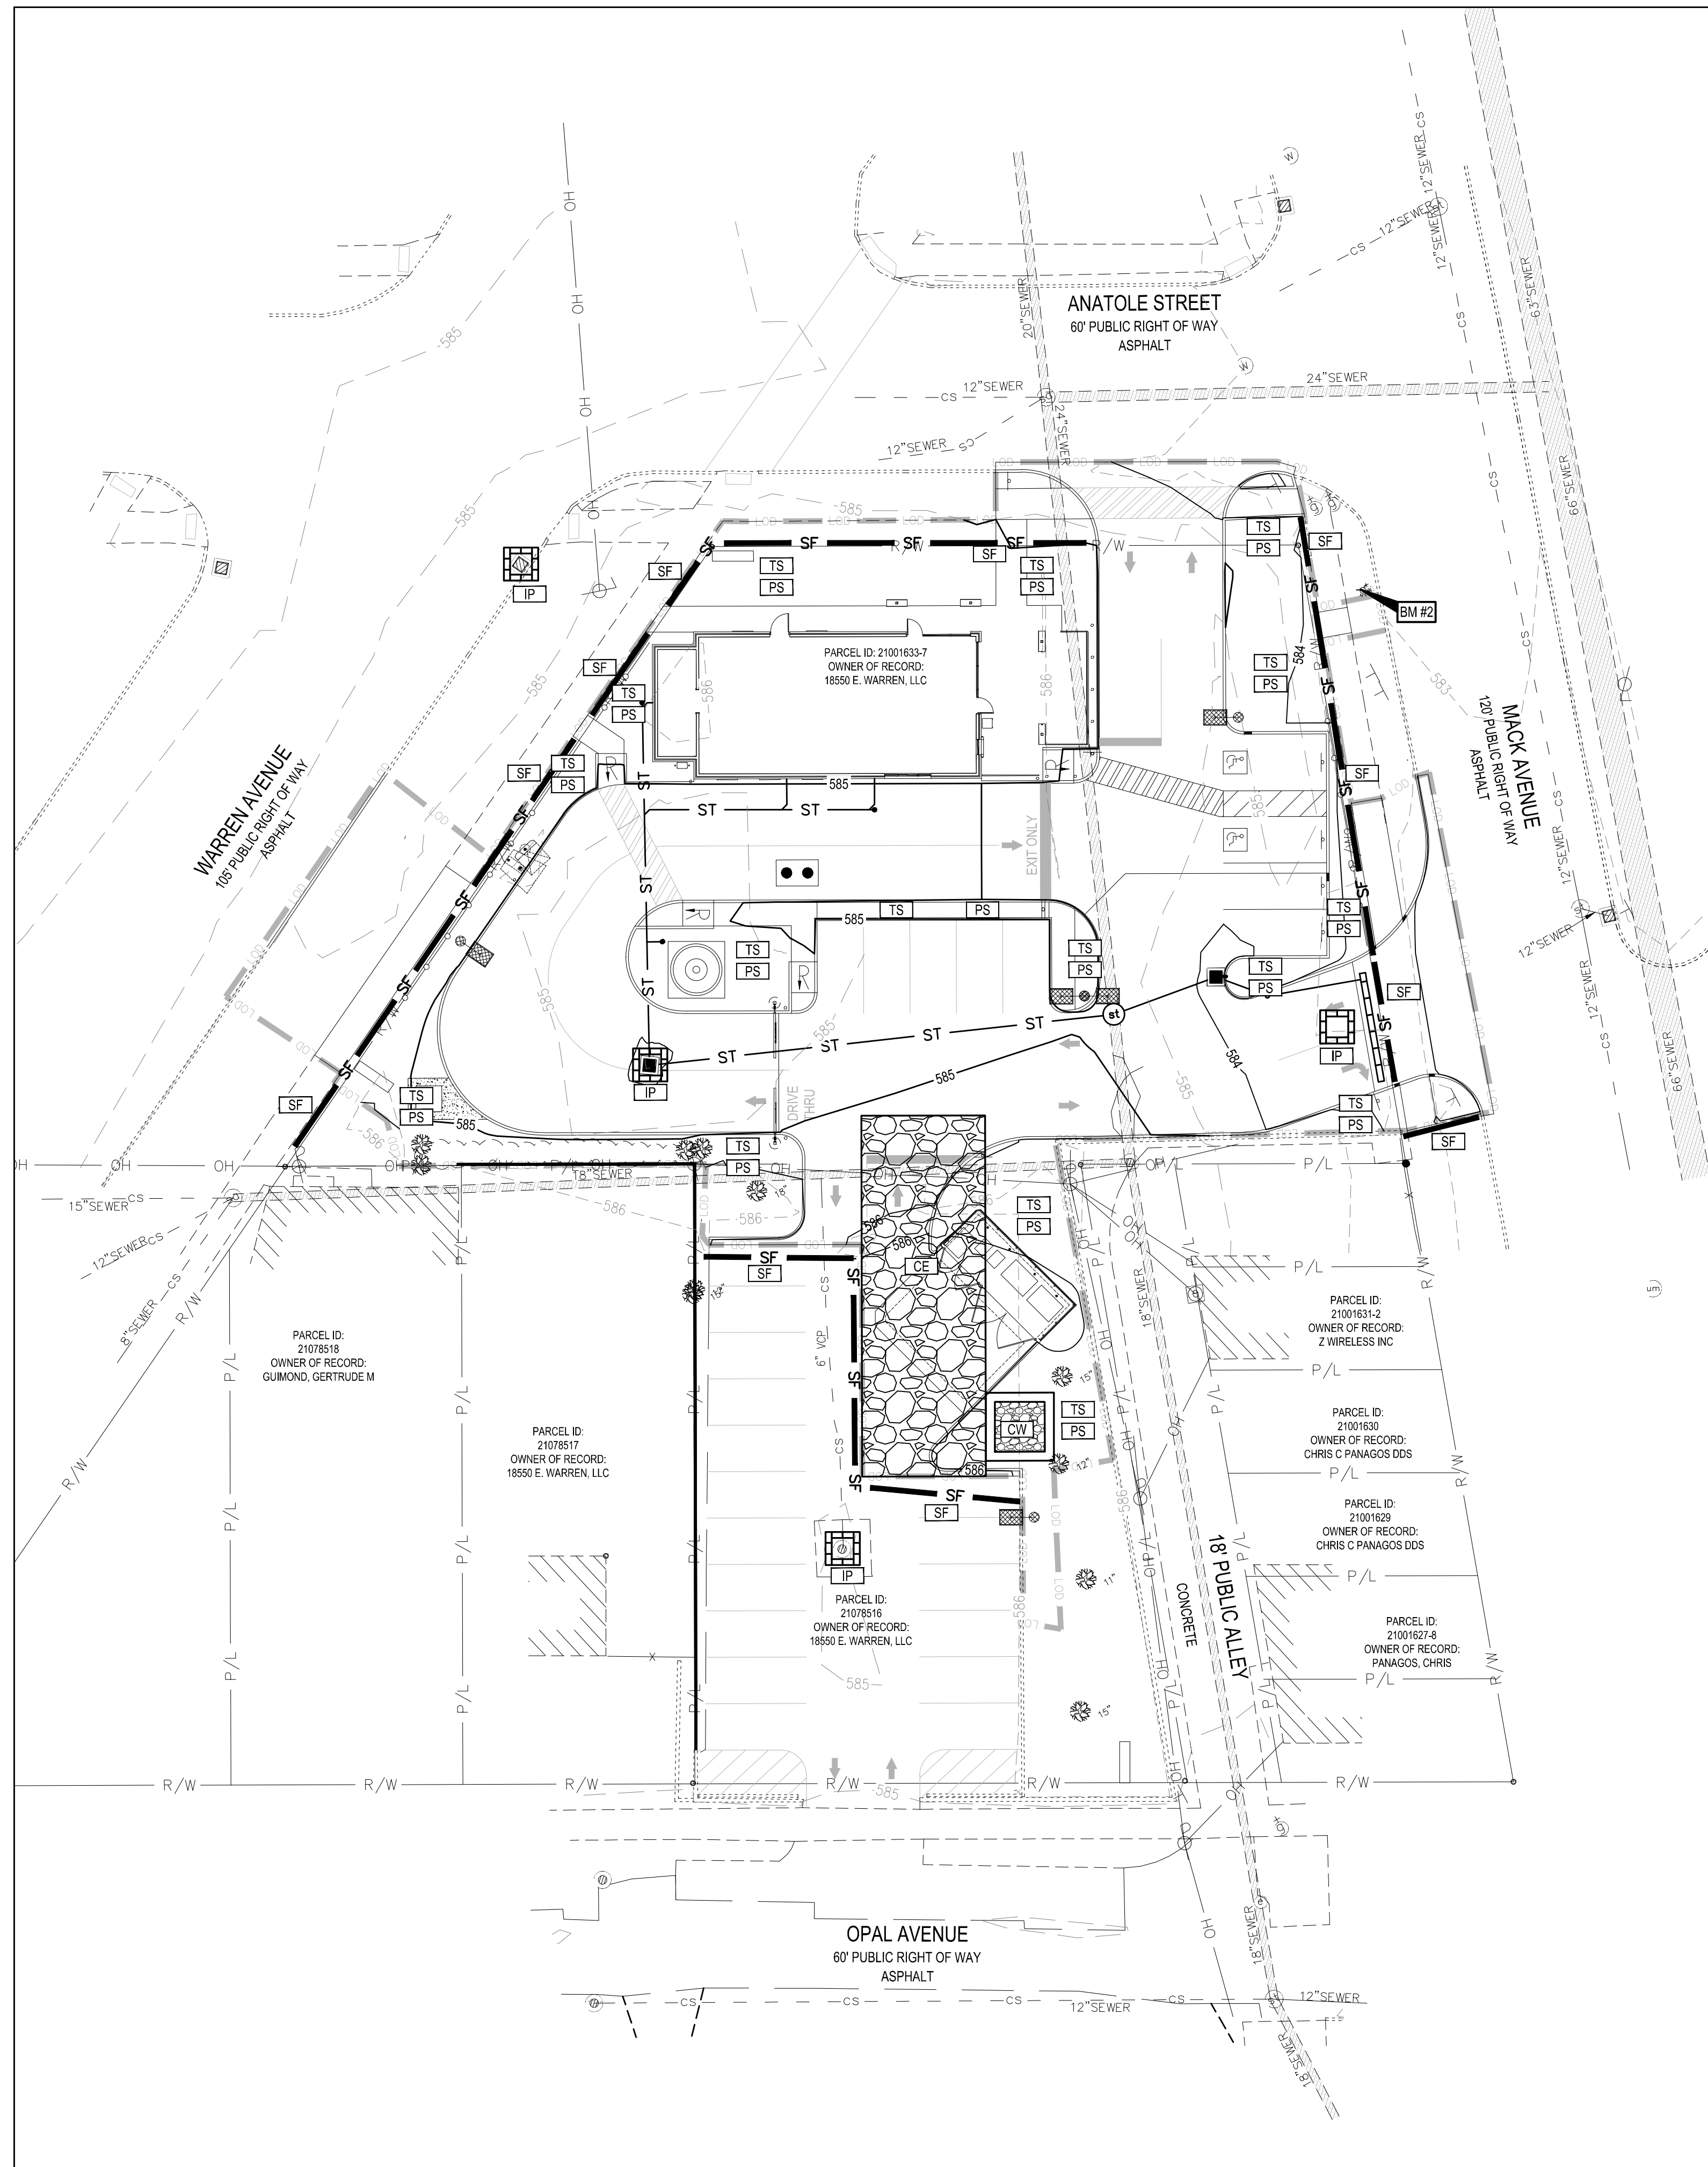

STORM WATER DESIGN		
	% OF SITE AREA	AREA PROVIDED
EXISTING "UNTOUCHED" IMPERVIOUS	16.6%	0.115 AC.
NEW / REPLACED IMPERVIOUS	56.4%	0.390 AC.
LANDSCAPING / PERVIOUS	27.0%	0.186 AC.
TOTAL	100%	0.691 AC.

PER DWSD REGULATIONS SINCE THE NEW / REPLACED IMPERVIOUS IS UNDER 0.50 ACRES, PROPOSED SITE IS UNDER THE THRESHOLD FOR DWSD REGULATIONS TO BE IMPLEMENTED

NOTE:
WAYNE COUNTY PERMIT REVIEW WAS PERFORMED ONLY WITHIN WAYNE COUNTY JURISDICTION AND ONLY RESPONSIBLE FOR WITHIN WAYNE COUNTY RIGHT OF WAY (MACK AVE.). WORK OUTSIDE OF WAYNE COUNTY RIGHT OF WAY MUST BE PERMITTED BY OTHER JURISDICTION AGENCY.

BENCHMARKS:
NORTH 60°00'00" WEST, BEING THE NORTHERLY RIGHT OF WAY LINE OF OPAL AVENUE, AS PLATTED.

BENCHMARK #1 - NORTH BOLT ON LIGHT POLE WEST OF ASPHALT PARKING LOT AND MOST EASTERLY LIGHT POLE. ELEVATION = 589.20' (NAVD 88).

BENCHMARK #2 - ARROW ON TOP OF HYDRANT AT THE SOUTHWEST CORNER OF MACK AVENUE AND ANATOLE STREET. ELEVATION = 585.99' (NAVD 88)



- CONSTRUCTION SEQUENCE**
1. DURING PRECONSTRUCTION MEETING ALL EROSION & SEDIMENT CONTROL FACILITIES & PROCEDURES SHALL BE DISCUSSED. A GENERAL CONSTRUCTION SEQUENCE FOLLOWS AND MAY NEED TO BE UPDATED BY THE CONTRACTOR TO SUIT THE SPECIFICS OF THE SITE AND INTENDED CONTRACTOR SPECIFIC SEQUENCING.
 - 1.1. INSTALL CONSTRUCTION ENTRANCE AS DETAILED ON PLANS. TEMPORARY CONSTRUCTION FENCING SHALL BE INSTALLED AROUND PERIMETER OF CONSTRUCTION SITE. WHERE THERE IS EXISTING FENCE ALONG THE PERIMETER OF THE SITE, IT CAN BE UTILIZED. FENCING SHALL BE USED TO RESTRICT OUTSIDE TRAFFIC TO SITE.
 - 1.2. DELIVER CONSTRUCTION TRAILER TO SITE AND INSTALL TEMPORARY POWER AND TELEPHONE, IF REQUIRED. TEMPORARY UTILITY SERVICES ARE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
 - 1.3. STAKE AND/OR FLAG LIMITS OF CLEARING.
 - 1.4. CLEAR & GRUB, AS NECESSARY, FOR INSTALLATION OF PERIMETER CONTROLS. INSTALL SILT PERIMETER CONTROLS AS SHOWN ON PLANS. SILT PERIMETER CONTROLS SHALL BE INSTALLED LEVEL, ALONG THE CONTOURS, WITH ENDS TURNED UPSLOPE TO PREVENT CONCENTRATED FLOW AT THE SILT PERIMETER CONTROLS.
 - 1.5. INSTALL TEMPORARY SILT INLET PROTECTION ON ALL EXISTING CATCH BASINS AND INLETS, AS DESIGNATED IN THE PLANS. REMOVAL OF SILT INLET PROTECTION FROM DESIGNATED INLETS CAN ONLY OCCUR WHEN A STRUCTURE IS REMOVED, AND AS REQUIRED BY THE PROGRESSION OF THE DEMOLITION AND CONSTRUCTION.
 - 1.6. CLEAR & GRUB, AS NECESSARY, FOR INSTALLATION OF TEMPORARY SEDIMENT TRAP/BASIN. INSTALL TEMPORARY SEDIMENT TRAP/BASIN, IF REQUIRED, AS DETAILED IN THE PLANS. CONSTRUCT AND MAINTAIN TEMPORARY DIVERSION SWALE AND / OR DIVERSION BERM DURING FILLING & GRADING ACTIVITIES.
 - 1.7. CLEAR & GRUB THE REMAINING SITE AS NECESSARY. TOPSOIL SHALL BE STRIPPED AND STOCKPILED ON SITE FOR REUSE, OR REMOVED TO AN APPROVED OFFSITE SPOIL AREA. UTILIZE DUST CONTROL MEASURES AS REQUIRED TO MINIMIZE AIR-BORNE POLLUTION BY METHODS APPROVED BY THE AUTHORIZING EPA OFFICE.
 - 1.9. BEGIN FILLING & GRADING AS REQUIRED TO REACH SUBGRADE.
 - 1.10. ONCE PAVEMENT GRADES HAVE BEEN ESTABLISHED, AS DESIGNATED ON THE PLANS, THE CONTRACTOR SHALL UTILIZE THESE AREAS FOR STRUCTURE CONSTRUCTION. CONSTRUCT UNDERGROUND UTILITY WORK INCLUDING STORM DRAINAGE FACILITIES. UPON INSTALLATION OF STORM DRAINAGE CATCH BASINS, YARD DRAINS AND INLETS, INSTALL REQUIRED INLET PROTECTION.
 - 1.12. DO NOT REPLACE ANY TOPSOIL. SEED OR INSTALL FINAL PAVEMENT PRIOR TO COMPLETION OF BUILDING SHELL. SHOULD SITEWORK BE COMPLETED PRIOR TO THIS DATE, MULCH DISTURBED AREAS TO BE PLANTED AND INSTALL STONE SUBBASE IN DISTURBED AREAS TO BE PAVED.
 - 1.13. FOLLOWING COMPLETION OF BUILDING SHELL AND PAVEMENT INSTALLATION, BEGIN LANDSCAPE INSTALLATION.
 - 1.14. COMPLETE SITEWORK, PAVEMENT MARKINGS AND FINAL CLEAN-UP. RESEED ANY AREAS THAT MAY REQUIRE ATTENTION IMMEDIATELY. NOTE THAT LAWN AREAS WILL NOT BE DEEMED STABLE UNTIL A MINIMUM 80% VEGETATIVE DENSITY HAS BEEN ACHIEVED.
 - 1.15. MAINTAIN EROSION & SEDIMENTATION CONTROL MEASURES UNTIL THE SITE HAS BEEN COMPLETELY STABILIZED. ALL AREAS OF VEGETATIVE SURFACE, WHETHER PERMANENT OR TEMPORARY, SHALL BE CONSIDERED TO BE IN PLACE AND FUNCTIONAL WHEN THE REQUIRED UNIFORM RATE OF COVERAGE (80%) IS OBTAINED.
 - 1.16. REMOVE SEDIMENT CONTROLS.

PROJECT DESCRIPTION
THIS SITE WAS HOME TO AN EXISTING TWO STORY BANK AND PARKING LOT WHICH WILL BE DEMOLISHED AND REPLACED WITH A NEW TACO BELL BUILDING AND PARKING LOT AS SHOWN ON THESE PLANS.

PROJECT COMPLETION STATISTICS

PARCEL SIZE :	0.69 ACRES
TOTAL DISTURBED AREA:	0.61 ACRES

EXISTING LAND USE FOR THE SITE IS A TWO STORY BUILDING WITH PARKING LOT.
ESTIMATED PRE-CONSTRUCTION IMPERVIOUS AREA: 0.54 ACRES
ESTIMATED PRE-CONSTRUCTION IMPERVIOUS PERCENT: 78.4%
PRE-CONSTRUCTION RUN-OFF COEFFICIENT: 0.777

PROPOSED LAND USE WILL BE NEW TACO BELL WITH PARKING LOT.
ESTIMATED POST-CONSTRUCTION IMPERVIOUS AREA: 0.52 ACRES
ESTIMATED POST-CONSTRUCTION IMPERVIOUS PERCENT: 75%
POST-CONSTRUCTION RUN-OFF COEFFICIENT: 0.749

PROJECT LOCATION:
LATITUDE: 42° 24' 42" N
LONGITUDE: 82° 54' 48" W

EXISTING SITE SOIL TYPES:
UrbanB: URBAN LAND - FORTRESS FAMILY COMPLEX, DENSE SUBSTRATUM, HSG = D.
REFERENCE: USDA NATIONAL RESOURCES CONSERVATION SERVICE WEB SOIL SURVEY.

WETLAND INFORMATION:
THERE ARE NO WETLANDS ON THIS SITE.

FIRST AND SUBSEQUENT RECEIVING STREAM:
INITIAL RECEIVING WATER IS PIPED TO AN EXISTING COMBINED SEWER SYSTEM AND THE SUBSEQUENT RECEIVING WATER IS THE LAKE ST. CLAIR

OWNER CONTACT:
LGY DEVELOPMENT
CLINT LANGLEY
104 LISA COURT
MCMURRAY, PA 15317
PHONE: 724-263-7757
CLINT.LANGLEY@LGYDEVELOPMENT.COM

ANTICIPATED TIMING:
CONSTRUCTION BEGIN: TBD, 2022
CONSTRUCTION COMPLETE: TBD, 2022

CONTRACTOR: T.B.D.
CONTACT: _____
PHONE NUMBER: _____

CONTRACTOR SHALL MAINTAIN A CONSTRUCTION LOG DOCUMENTING ALL GRADING AND STABILIZATION ACTIVITIES.



DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAPM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03



TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
SWPP PLAN

C-012

PLLOT DATE:

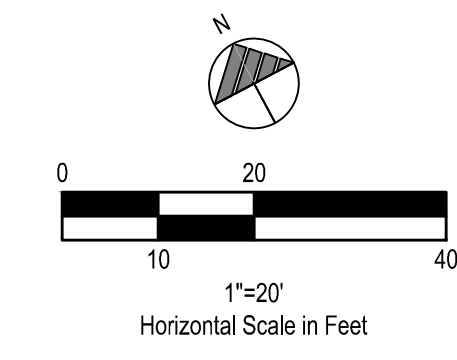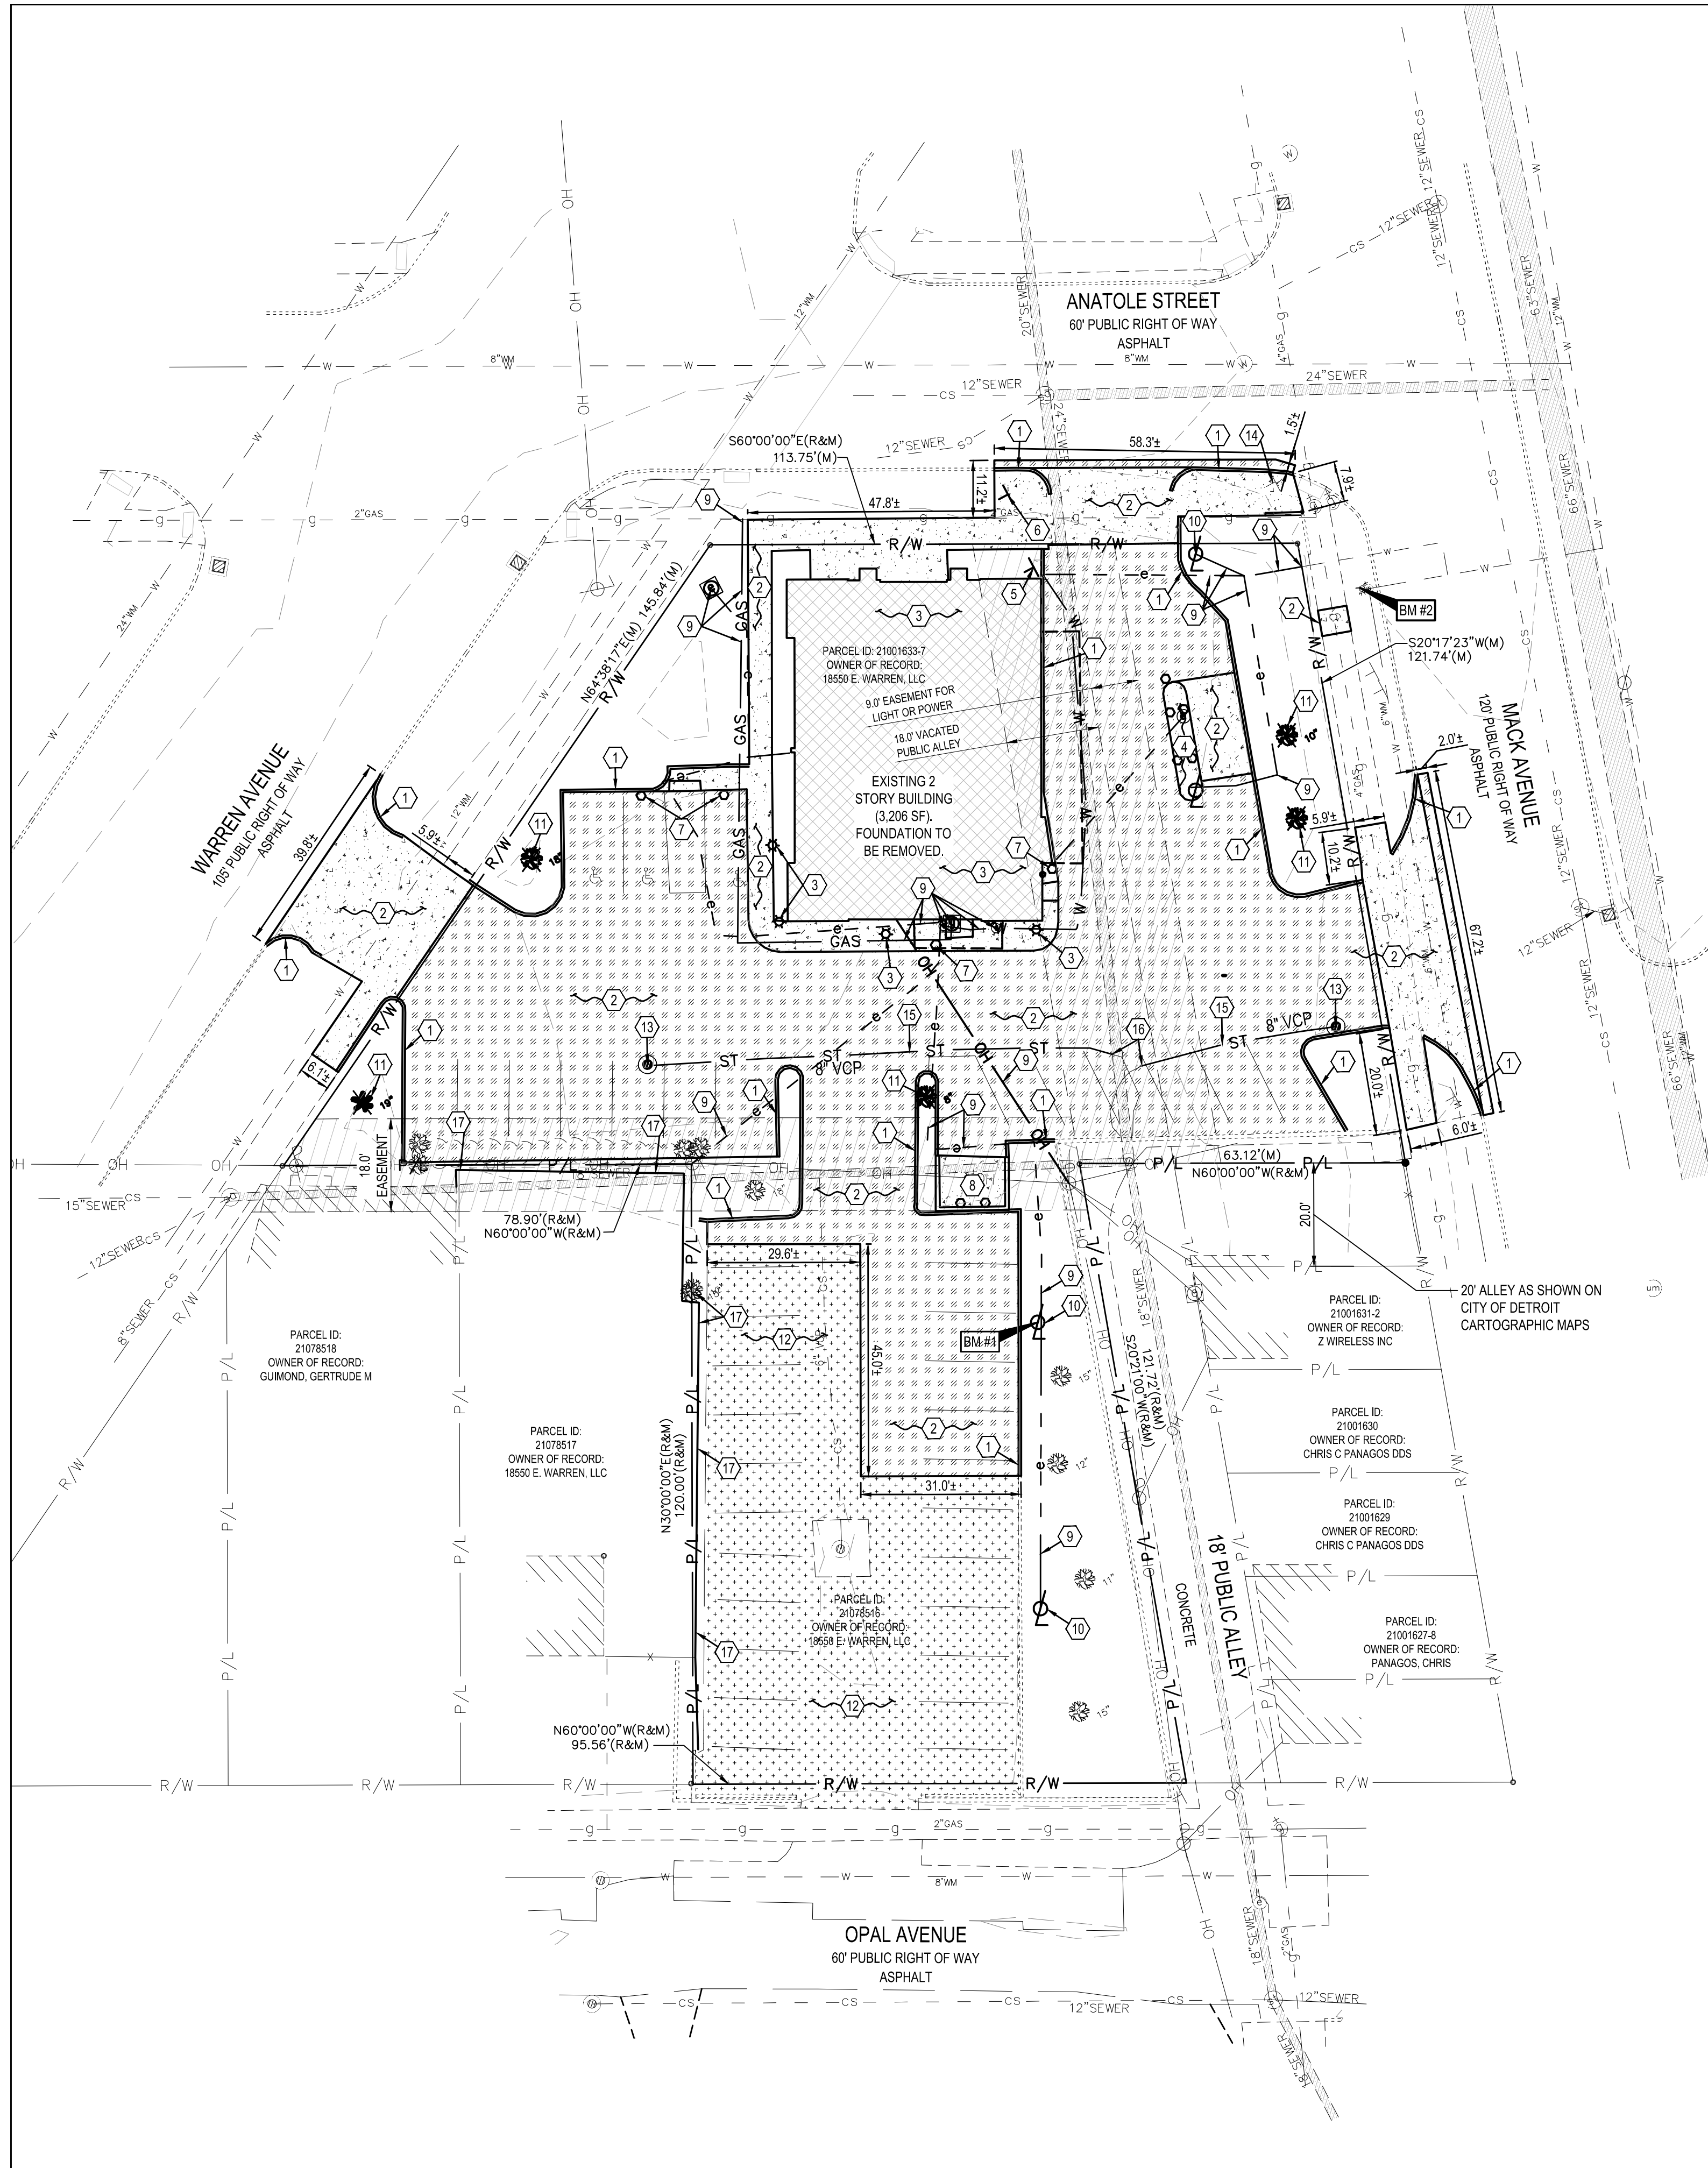

- LEGEND**
(SEE SHEET C-001 FOR GENERAL LEGEND)
- EXISTING ASPHALT TO BE REMOVED
 - EXISTING CONCRETE TO BE REMOVED
 - EXISTING ASPHALT TO BE MILLED 2.0"
 - EXISTING BUILDING/STRUCTURE TO BE REMOVED
 - DENOTES LIMITS OF SAWCUT
 - DEMOLITION KEYNOTE

- PLAN KEYNOTES** (A)
1. EXISTING CURB TO BE REMOVED.
 2. EXISTING PAVEMENT TO BE REMOVED.
 3. EXISTING 2 STORY BUILDING (3,206 SF), FOUNDATION, FIRE ESCAPE STAIRS, BUILDING LIGHT, AND APPURTENANCES TO BE REMOVED.
 4. EXISTING CONCRETE ISLAND, BOLLARDS, CLEARANCE BAR, LIGHT POLE, AN APPURTENANCES TO BE REMOVED.
 5. EXISTING SIGNAGE TO BE REMOVED.
 6. EXISTING "NO STANDING" TRAFFIC SIGN TO BE REMOVED AND RELOCATED.
 7. EXISTING BOLLARDS / POST TO BE REMOVED.
 8. EXISTING TRASH ENCLOSURE AND BOLLARDS TO BE REMOVED.
 9. EXISTING UTILITIES TO BE REMOVED. CONTRACTOR SHALL CAP UTILITIES AT MAIN / RIGHT OF WAY PER UTILITY COMPANY STANDARDS.
 10. EXISTING LIGHT POLE TO BE REMOVED.
 11. EXISTING LANDSCAPING (INCLUDING BUSHES, TREES, ETC.) TO BE REMOVED.
 12. EXISTING ASPHALT PAVEMENT TO BE MILLED 1.5" PER MDOT STANDARDS.
 13. EXISTING CATCH BASIN TO BE REMOVED.
 14. EXISTING ROADWAY STOP AND STREET SIGNS TO BE REMOVED AND RESET ON NEW POST PER MDOT SPECIFICATIONS. CONTRACTOR SHALL INSTALL PER MDOT SPECIFICATIONS.
 15. EXISTING 8" STORM SEWER TO BE REMOVED.
 16. CONTRACTOR SHALL CUT AND CAP EXISTING 8" SEWER WITH A WATERTIGHT CONNECTION.
 17. EXISTING WOODEN FENCE TO BE REMOVED WITH ASSOCIATED FOUNDATION. CONTRACTOR TO COORDINATE WITH THE ADJACENT OWNER/S FOR ANY FENCE DEMOLITION/TREE REMOVAL WORK OUTSIDE THE PROPERTY LINE. ALL DISTURBED AREA SHALL BE RESTORED TO BETTER THAN EXISTING CONDITIONS. CONTRACTOR TO TAKE EXTRA MEASURES NOT TO HARM EXISTING TREES, IF NOT ABLE TO MAINTAIN THEN TREES SHALL BE REMOVED.

DEMOLITION NOTE:
ALL EXISTING SITE AND SURROUNDING FEATURES SUCH AS UTILITIES, PAVEMENT, CURB, LANDSCAPING, ETC. SHALL REMAIN AND BE PROTECTED THROUGHOUT CONSTRUCTION UNLESS NOTED OTHERWISE, OR ARE REQUIRED TO BE MODIFIED OR REMOVED FOR THE INSTALLATION OF PROPOSED IMPROVEMENTS. ALL DISTURBED FEATURES SHALL BE RESTORED OR RELOCATED AS REQUIRED TO THE SATISFACTION OF THE OWNER. CONTRACTOR SHALL REPAIR/REPLACE ANY SURROUNDING FEATURES DAMAGED AS A RESULT OF CONSTRUCTION ACTIVITIES AT NO ADDITIONAL COST AND TO THE SATISFACTION OF THE OWNER.

EXISTING BUILDING:
SEPARATE DEMOTION PERMIT IS REQUIRED FOR THE EXISTING BUILDING.

NOTE:
SIDEWALK REMOVAL/REPAIR SHALL BE FULL PANEL OR AS DIRECTED BY THE WAYNE COUNTY ENGINEER.

NOTE:
WAYNE COUNTY PERMIT REVIEW WAS PERFORMED ONLY WITHIN WAYNE COUNTY JURISDICTION AND ONLY RESPONSIBLE FOR WITHIN WAYNE COUNTY RIGHT OF WAY (MACK AVE.). WORK OUTSIDE OF WAYNE COUNTY RIGHT OF WAY MUST BE PERMITTED BY OTHER JURISDICTION AGENCY.

NOTE:
IF A LANE CLOSURE IS REQUIRED, THE CONTRACTOR SHALL CONTACT THE WAYNE COUNTY TRAFFIC OFFICE 72 HOURS PRIOR TO CLOSURE. CONTRACTOR(S) ARE TO MAINTAIN TWO-WAY TRAFFIC AT ALL TIMES AND WILL FLAG TRAFFIC AS NEEDED.



DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 P/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
DEMOLITION
PLAN


C-101

PLOT DATE:


BENCHMARKS:
NORTH 60°00'00" WEST, BEING THE NORTHERLY RIGHT OF WAY LINE OF OPAL AVENUE, AS PLATTED.

BENCHMARK #1 - NORTH BOLT ON LIGHT POLE WEST OF ASPHALT PARKING LOT AND MOST EASTERLY LIGHT POLE. ELEVATION = 589.20' (NAVD 88).


BENCHMARK #2 - ARROW ON TOP OF HYDRANT AT THE SOUTHWEST CORNER OF MACK AVENUE AND ANATOLE STREET. ELEVATION = 585.99' (NAVD 88)

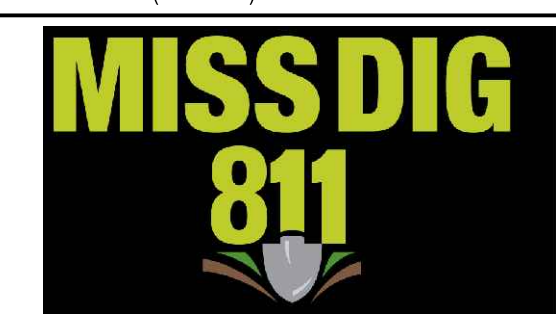

LEGEND
(SEE SHEET C-001 FOR GENERAL LEGEND)

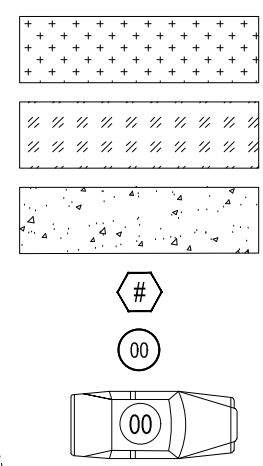

PROPOSED 2" ASPHALT OVERLAY, SHEET C-501.
PROPOSED HEAVY DUTY ASPHALT PER ASPHALT PAVEMENT TABLE THIS SHEET AND SHEET C-501.
PROPOSED CONCRETE
CONSTRUCTION KEYNOTE
PROPOSED PARKING SPACE NUMBER
PROPOSED DRIVE THRU STACK CAR AND NUMBER

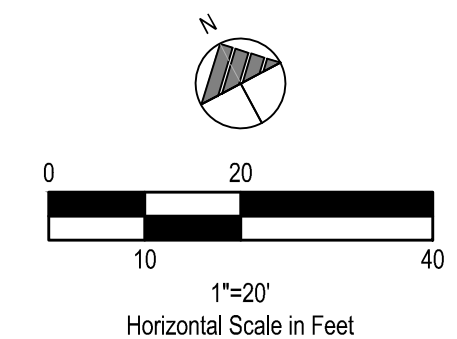

PLAN KEYNOTES

- PROPOSED CONCRETE CURB, SEE SHEET C-501.
- PROPOSED CURB AT DRIVE THRU, SEE SHEET C-501.
- PROPOSED CONCRETE CURBED WALK, SEE SHEET C-501.
- PROPOSED CONCRETE WALK, SEE SHEET C-501.
- PROPOSED 8" P.C.C. PAVEMENT OVER 6" DENSE AGGREGATE BASE STONE MDOT 21AA. APPLY LIQUID ASPHALT AT ALL JOINTS BETWEEN CONCRETE AND ASPHALT. SEE SHEET C-001 FOR FIBER REINFORCEMENT NOTES.
- PROPOSED DETERRENT BOLLARD IN CURB, SEE SHEET C-501.
- PROPOSED STAINLESS STEEL CRASH-RATED BOLLARD, SEE SHEET C-501.
- PROPOSED ADA PARKING SIGN IN CRASH-RATED BOLLARD, SEE SHEET C-501.
- PROPOSED LANDSCAPING AREA. SOD ALL DISTURBED AREAS EXCEPT WHERE PLANTING BEDS ARE INDICATED. SEE SHEET L-101.
- PROPOSED "DO NOT ENTER" AND "STOP" SIGN PER MDOT STANDARDS AND SHEET C-501.
- PROPOSED PAINTED TRANSVERSE STRIPING, SEE SHEET C-501.
- PROPOSED PAINTED 4" WIDE SOLID STRIPE - WHITE ON ASPHALT, YELLOW ON CONCRETE.
- PROPOSED DIRECTIONAL PAVEMENT MARKINGS - WHITE ON ASPHALT, YELLOW ON CONCRETE, BLUE FOR ADA - SEE SHEET C-601.
- PROPOSED PAINTED INTERNATIONAL ADA SYMBOL PER ADA SPECIFICATIONS AND SHEET C-501.
- PROPOSED LIGHT POLE AND FOUNDATION. SEE ELECTRICAL DRAWINGS AND STRUCTURAL PLANS FOR SPECIFICATIONS AND DETAILS.
- PROPOSED ADA ACCESSIBLE RAMP PER ADA SPECIFICATIONS AND SHEET C-502.
- PROPOSED 5X5' FROST SLAB AT DOOR. SEE STRUCTURAL DRAWINGS FOR DETAIL.
- PROPOSED PATIO, DECORATIVE FENCE AND CANOPY WALLS. SEE ARCHITECTURAL DRAWINGS.
- PROPOSED UTILITY STRUCTURE, SEE SHEET C-131.
- PROPOSED GAS METER PER GAS COMPANY SPECIFICATIONS. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATION.
- PROPOSED ELECTRICAL TRANSFORMER PER ELECTRICAL COMPANY SPECIFICATIONS. G.C. TO VERIFY EXACT LOCATION AND SIZE WITH UTILITY ENGINEER.
- PROPOSED ELECTRIC METER PER ELECTRIC COMPANY SPECIFICATIONS. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATION.
- PROPOSED MENU BOARD, CANOPY, AND SPEAKER POST PER SIGN SUPPLIER SPECIFICATIONS AND SHEET C-502. SIGN SUPPLIER TO PROVIDE A TEMPLATE FOR G.C. TO COORDINATE A MEETING WITH THE CONSTRUCTION PROJECT MANAGER AND OPERATIONS TO VERIFY LOCATION AND PLACEMENT OF MENU BOARD, CANOPY, AND SPEAKER POST PRIOR TO ANY CONSTRUCTION. SIGN SUPPLIER SHALL PROVIDE G.C. WITH FOUNDATION DETAILS. G.C. RESPONSIBLE FOR SIGN FOUNDATIONS/ELECTRICAL.
- PROPOSED STANDARD CLEARANCE BAR. SEE SHEET C-502.
- PROPOSED 6'-0" TALL MASONRY DUMPSTER ENCLOSURE ON P.C.C. PAD OVER CRUSHED AGGREGATE OR GRAVEL BASE. SEE ARCHITECTURAL PLANS. APPLY LIQUID ASPHALT AT ALL JOINTS BETWEEN CONCRETE AND ASPHALT.
- PROPOSED "STOP" SIGN PER MDOT SPECIFICATIONS INCLUDE ATTACHING MOUNTING HARDWARE. CONTRACTOR SHALL INSTALL SIGN IN A STAINLESS STEEL CRASH-RATED BOLLARD PER THE MANUFACTURER SPECIFICATIONS.
- PROPOSED "STOP" AND "RIGHT TURN ONLY" SIGN PER MDOT SPECIFICATIONS. SEE SHEET C-501.
- PROPOSED 6'-0" O.A.H., 12 S.F. MONUMENT SIGN PER SIGN SUPPLIER SPECIFICATIONS. SIGN SUPPLIER SHALL DESIGN AND INSTALL FOUNDATION.
- PROPOSED 1,000 GALLON EXTERIOR GREASE INTERCEPTOR, SEE SHEET C-131.
- PROPOSED 1' CURB TAPER, SEE SHEET C-501.
- PROPOSED 3' TALL DECORATIVE FENCE BY CONTRACTOR. CONTRACTOR SHALL COORDINATE A MEETING WITH THE CONSTRUCTION MANAGER TO VERIFY TYPE, LOCATION AND PLACEMENT OF FENCE PRIOR TO ANY CONSTRUCTION. FINAL PRODUCT SHALL BE APPROVED BY THE CITY.
- PROPOSED "MOBILE PICK UP" PARKING SIGNS IN CRASH-RATED BOLLARD. CONTRACTOR TO INSTALL SIGN POST AND BOLLARD PER THE HANDICAP SIGN DETAIL. SIGN TO BE BY SIGN VENDOR.
- PROPOSED 5' WIDE CROSSWALK STRIPING, SEE SHEET C-501.
- PROPOSED "STOP" SIGN, SEE SHEET C-501.
- PROPOSED 18" WIDE SOLID STRIPE STOP BAR.
- RELOCATED "NO STANDING" SIGN TO BE INSTALLED PER MDOT SPECIFICATIONS.
- PROPOSED CURB PER CITY OF DETROIT DEPARTMENT OF PUBLIC WORKS STANDARD DRAWING C-4380, SEE SHEET C-504.
- PROPOSED DRIVE APRON PER CITY OF DETROIT DEPARTMENT OF PUBLIC WORKS STANDARD DRAWING C-4384, SEE SHEET C-504.
- PROPOSED FREE STANDING CURBING, SEE SHEET C-501. CONTRACTOR SHALL SEE GRADING PLAN FOR TRANSITION LOCATION.
- CONTRACTOR SHALL CAREFULLY INSTALL CURB ALONG EXISTING WALL. CONTRACTOR SHALL REPLACE ANY DAMAGE OCCURRED TO THE WALL DURING CONSTRUCTION IN KIND AND TO THE OWNER'S SATISFACTION. CONTRACTOR SHALL INSTALL A 1/2" EXPANSION JOINT PER THE CURBING DETAIL. CONTRACTOR SHALL FIELD VERIFY DEPTH OF EXISTING WALL FOUNDATION PRIOR TO CONSTRUCTION AND NOTIFY CONSTRUCTION MANAGER IMMEDIATELY IF CURBING IS NOT ABLE TO BE INSTALLED CORRECTLY.
- PROPOSED WATER FOUNTAIN, SEE LANDSCAPE PLANS. CONTRACTOR SHALL PLACE FOUNTAIN ON A CONCRETE PAD PER THE CONCRETE WALK DETAIL ON SHEET C-501. PAD SHALL BE 6" WIDER THAN THE OUTSIDE DIMENSION OF THE FOUNTAIN.
- PROPOSED WALK PER CITY OF DETROIT STANDARD C-4462, SEE SHEET C-504.
- PROPOSED 6'-0" TALL MASONRY WALL, SEE STRUCTURAL PLANS FOR DETAILS.
- PROPOSED CURB PER WAYNE COUNTY PERMIT STANDARD RS-3, SEE SHEET C-508.
- PROPOSED DRIVE APRON PER WAYNE COUNTY PERMIT STANDARD D-6, SEE SHEET C-508.
- PROPOSED WALK PER WAYNE COUNTY PERMIT STANDARD RS-5, SEE SHEET C-508.

ASPHALT PAVEMENT

MATERIAL	DEPTH (HVY. DUTY)	MDOT SPECIFICATIONS ITEM
A.C. SURFACE COURSE	2"	ASPHALTIC CONCRETE SURFACE COURSE MDOT LVSP
A.C. INTERMEDIATE COURSE	2.5"	ASPHALTIC CONCRETE BINDER COURSE MDOT LVSP
AGG. BASE COURSE	6"	DENSE AGGREGATE BASE STONE MDOT 21AA
SUBGRADE COMPACTION	PER SOILS REPORT	PER SOILS REPORT

SOILS REPORT GOVERNS IF ANY DISCREPANCIES OCCUR. SEE TYPICAL SECTION SHEET C-501.

BUILDING SETBACKS

	REQUIRED	PROVIDED
FRONT: SOUTHEAST	0'	46'
REAR: NORTHWEST	0'	1.5'
SIDE: SOUTHWEST	0'	195'
SIDE: NORTHEAST	0'	16.5'

PARKING SETBACKS

	REQUIRED	PROVIDED
FRONT: SOUTHEAST	0'	0.5'
REAR: NORTHWEST	0'	2.0'
SIDE: SOUTHWEST	0'	0'
SIDE: NORTHEAST	0'	36'

LANDSCAPE SETBACKS

	REQUIRED	PROVIDED
FRONT: SOUTHEAST	0'	0'
REAR: NORTHWEST	0'	0'
SIDE: SOUTHWEST	0'	0'
SIDE: NORTHEAST	0'	0'

PARKING SPACES


	REQUIRED	PROVIDED
NUMBER OF SPACES	23	26
PARKING REQUIREMENTS		
1 SPACE PER 100 SF OF BUILDING		
THEREFORE: 2,300 / 100 = 23 SPACES REQUIRED.		

LAND USE DATA


	% OF SITE AREA	AREA
EXISTING "UNTOUCHED" IMPERVIOUS	16.6%	0.115 AC.
NEW / REPLACED IMPERVIOUS	56.4%	0.390 AC.
LANDSCAPING / PERVIOUS	27.0%	0.186 AC.
TOTAL	100%	0.691 AC.

CURRENT ZONING: B2, B4, AND R1 - LOCAL BUSINESS AND RESIDENTIAL DISTRICT
PROPOSED ZONING: B4 AND R1

NOTE:
WAYNE COUNTY PERMIT REVIEW WAS PERFORMED ONLY WITHIN WAYNE COUNTY JURISDICTION AND ONLY RESPONSIBLE FOR WITHIN WAYNE COUNTY RIGHT OF WAY (MACK AVE.), WORK OUTSIDE OF WAYNE COUNTY RIGHT OF WAY MUST BE PERMITTED BY OTHER JURISDICTION AGENCY.

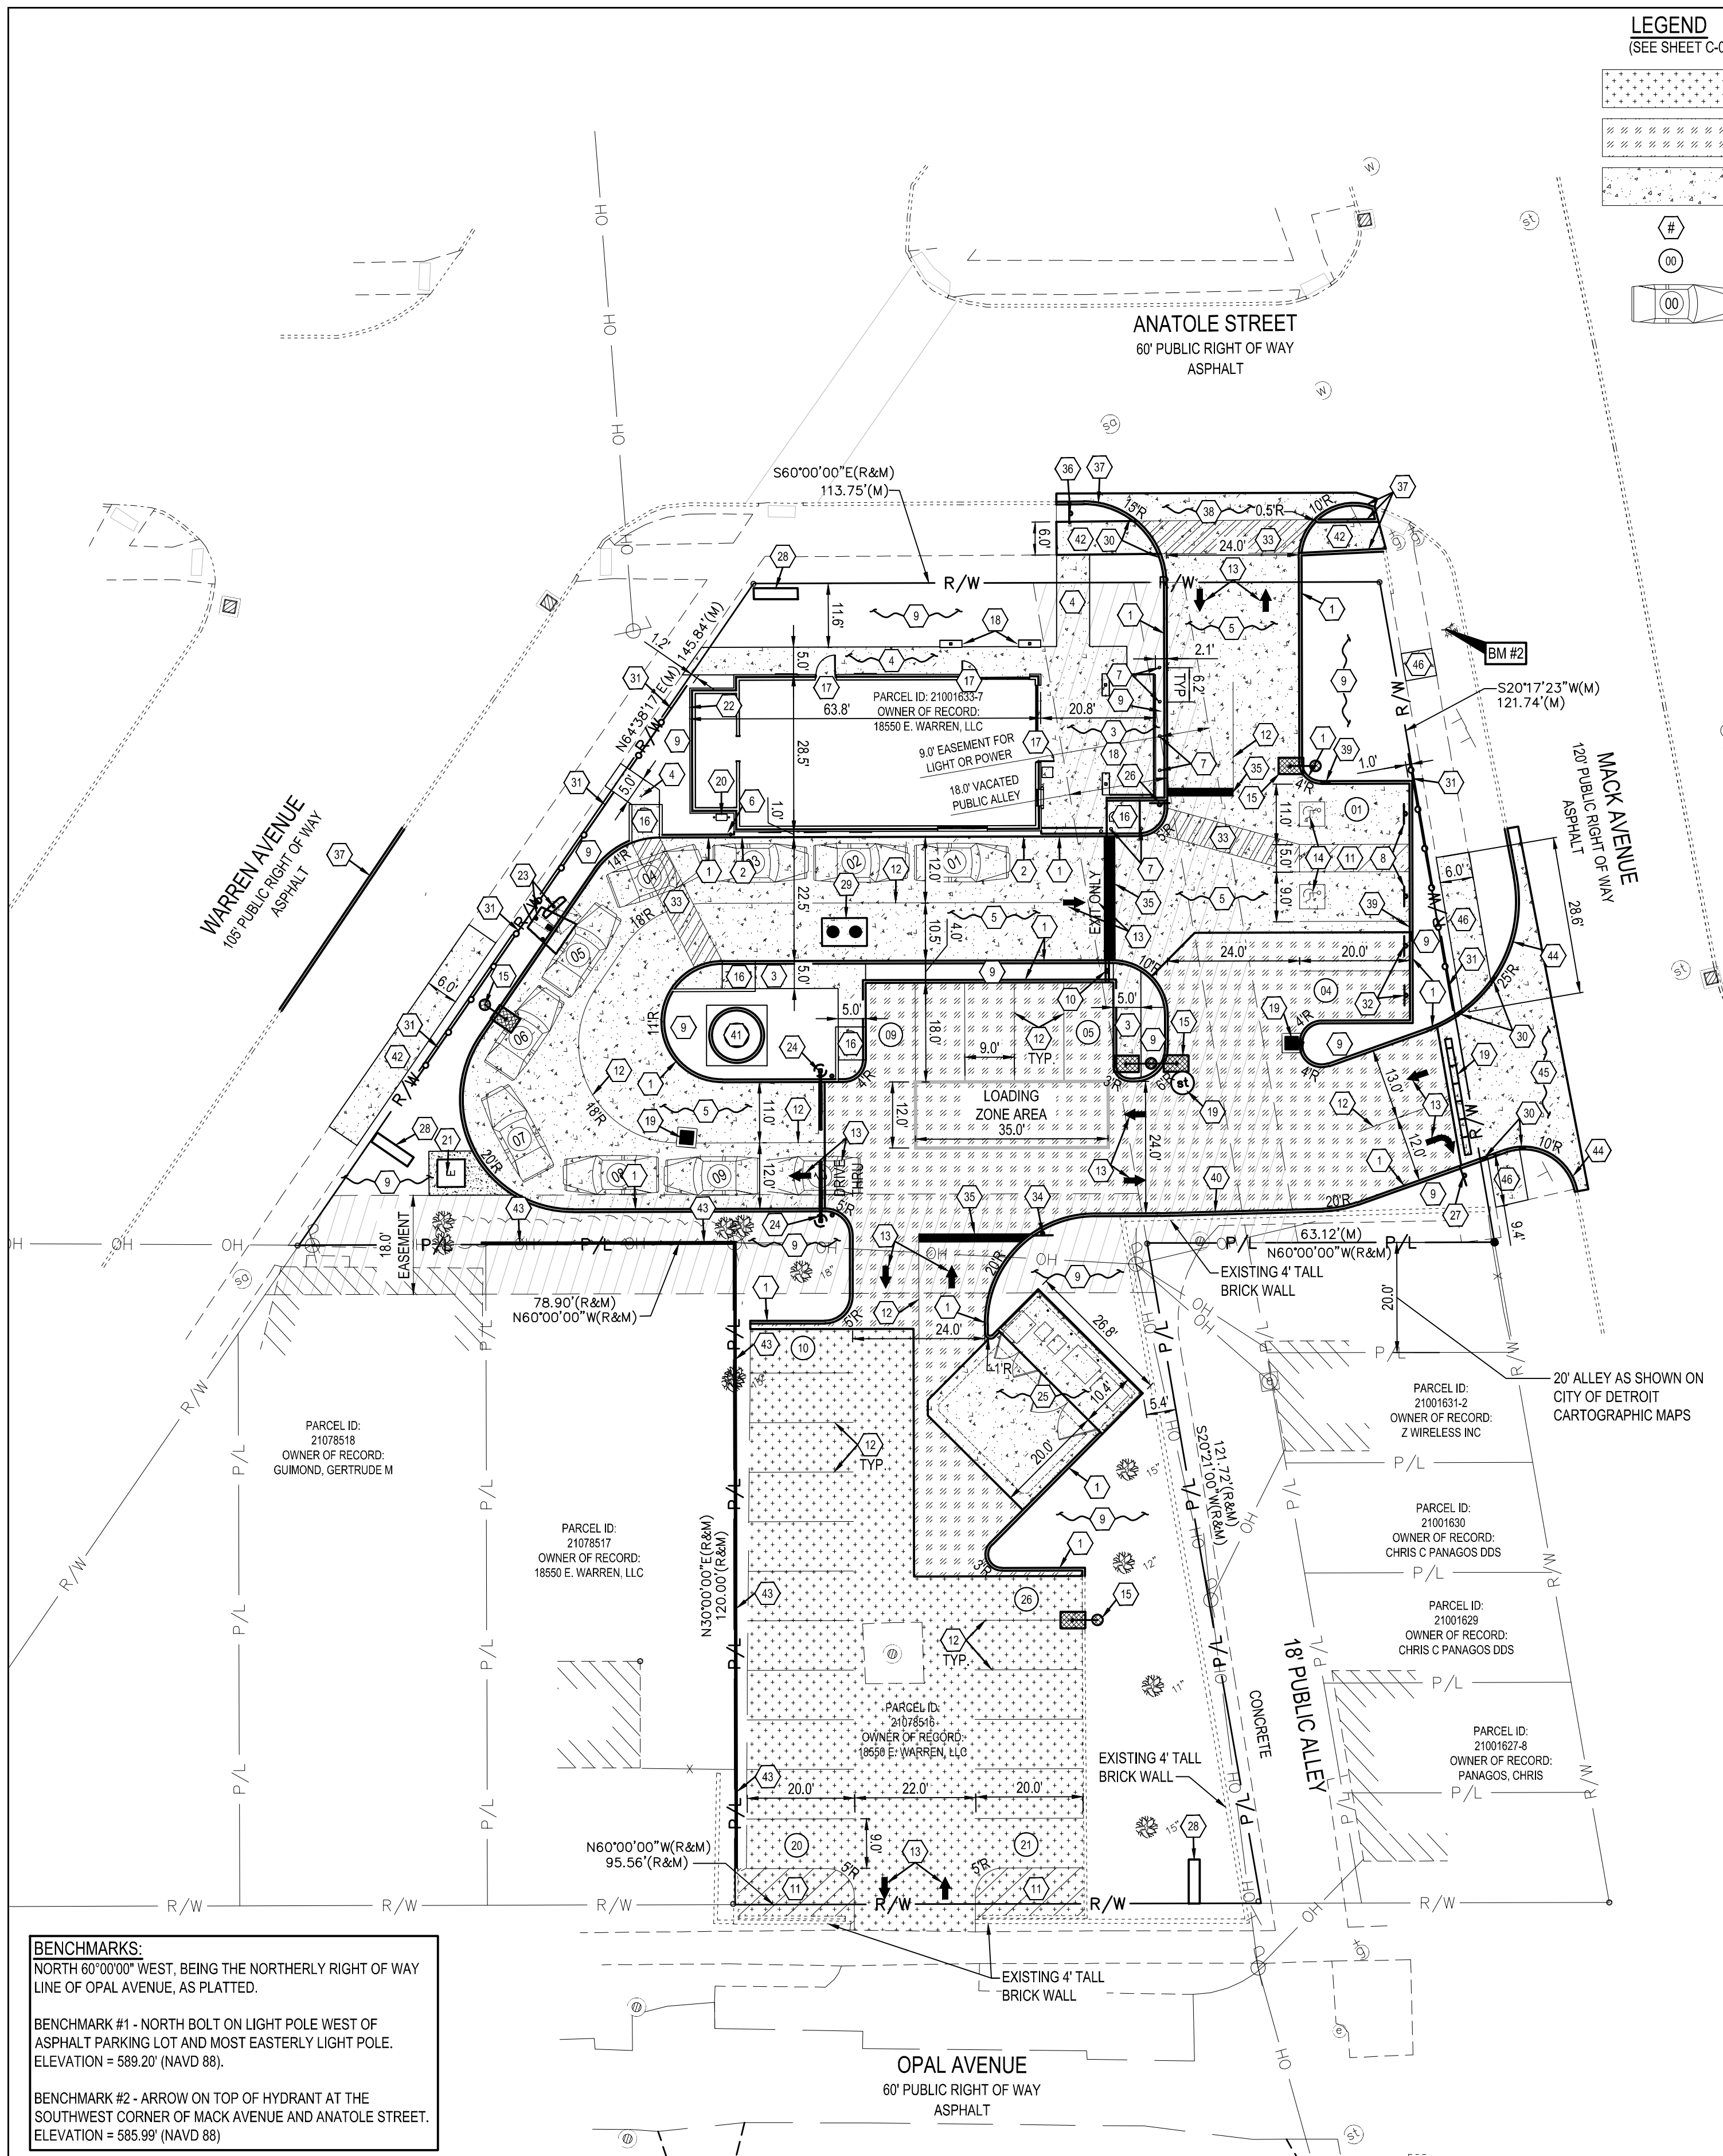

BENCHMARKS:
NORTH 60°00'00" WEST, BEING THE NORTHERLY RIGHT OF WAY LINE OF OPAL AVENUE, AS PLATTED.
BENCHMARK #1 - NORTH BOLT ON LIGHT POLE WEST OF ASPHALT PARKING LOT AND MOST EASTERLY LIGHT POLE. ELEVATION = 589.20' (NAVD 88).
BENCHMARK #2 - ARROW ON TOP OF HYDRANT AT THE SOUTHWEST CORNER OF MACK AVENUE AND ANATOLE STREET. ELEVATION = 585.99' (NAVD 88)

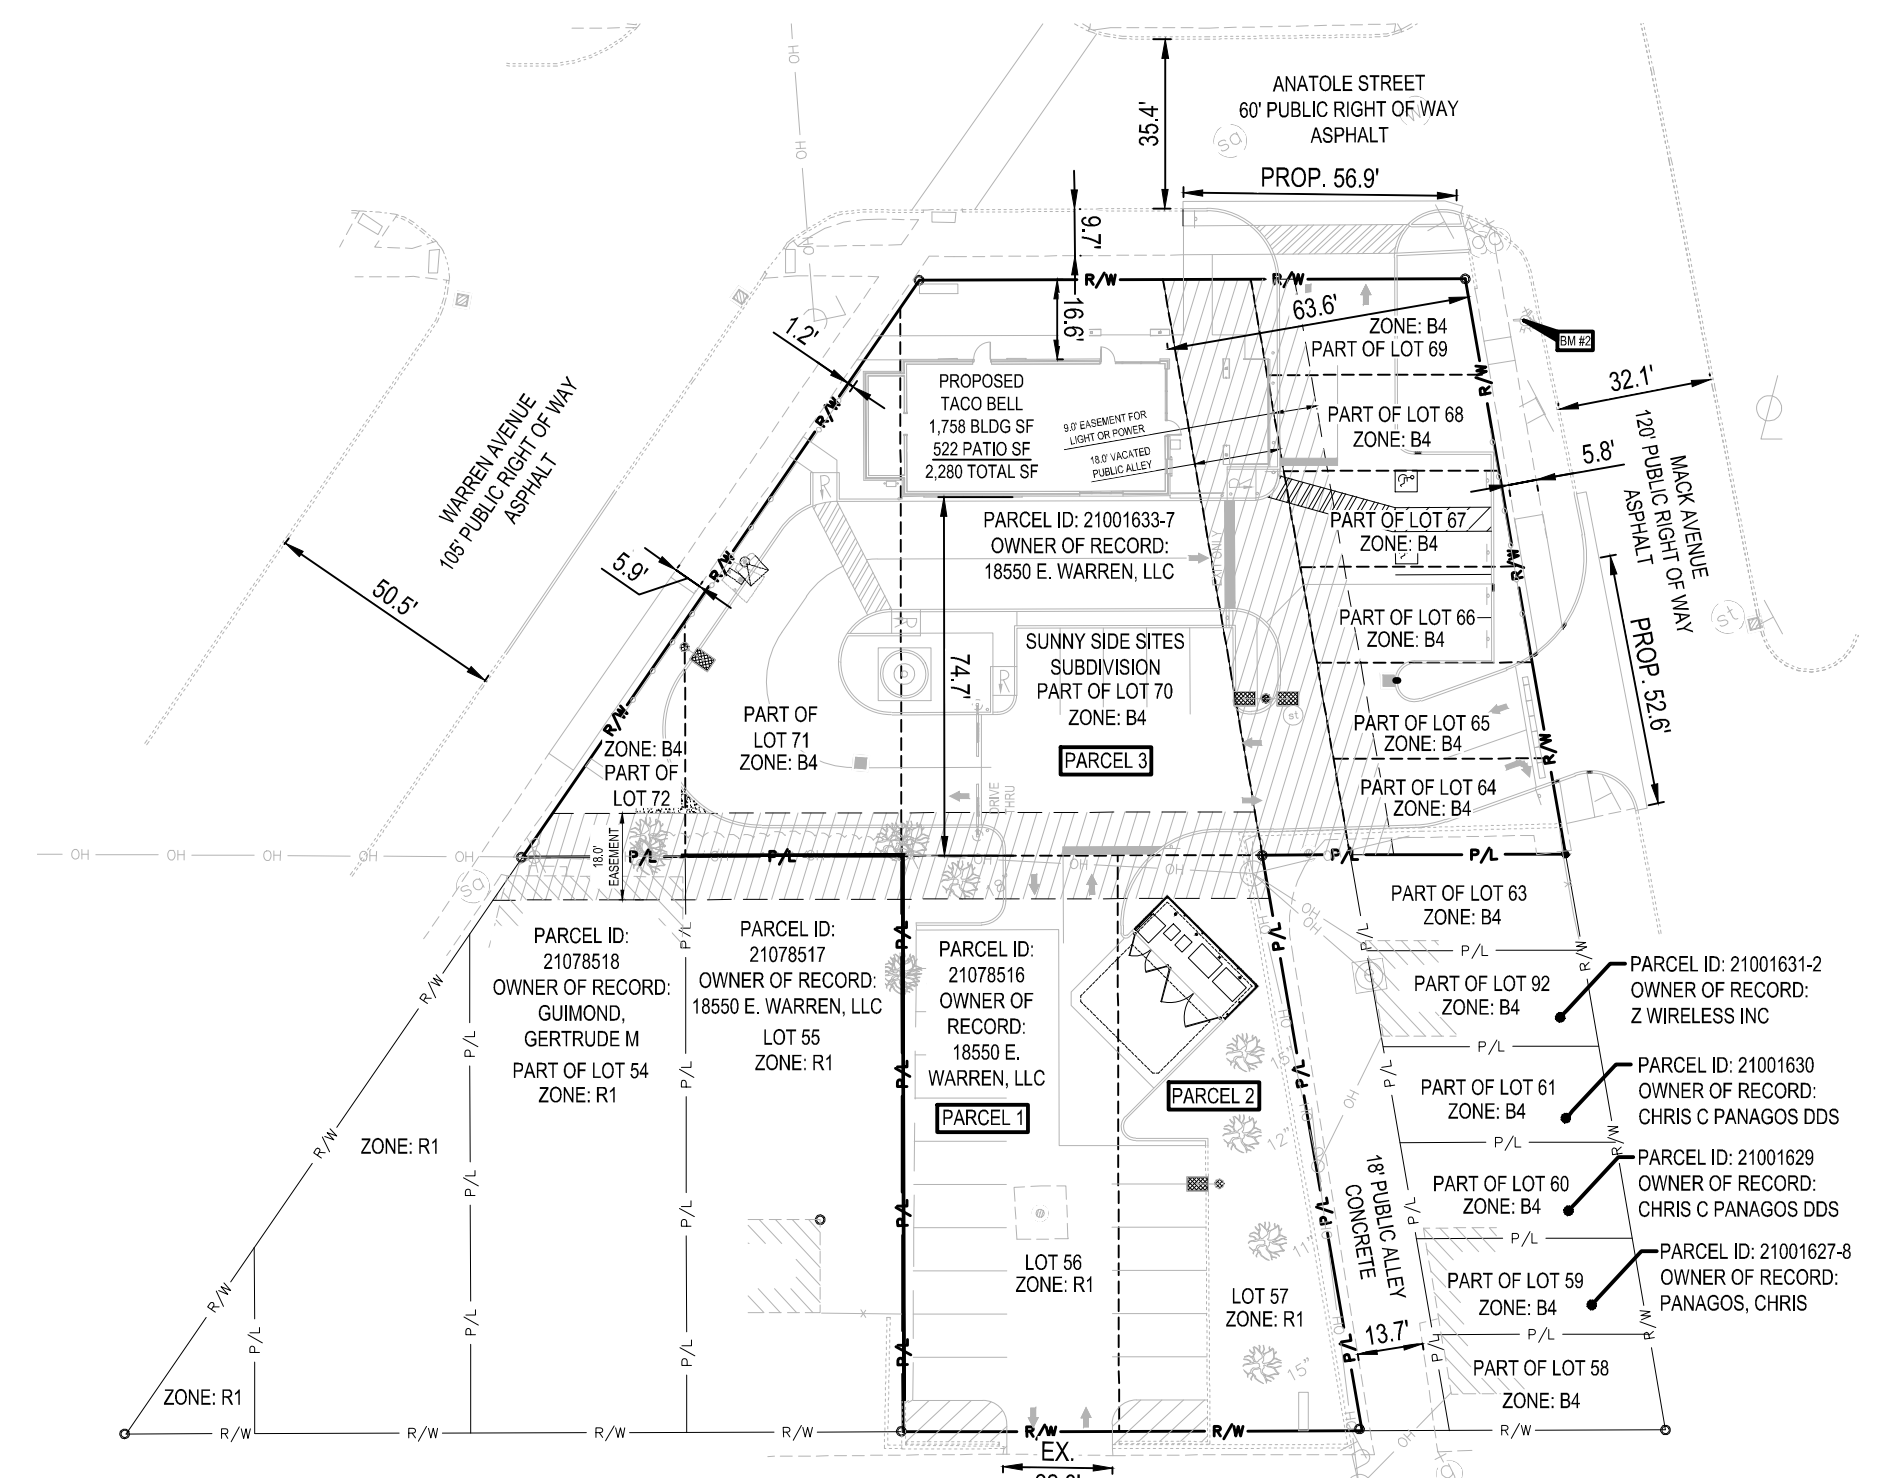

NOTE:
SEE MAIN PLAN FOR EXISTING EASEMENT CALLOUTS AND DIMENSIONS.

A4 ZONING PLAN
1" = 40'

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAP/M: SM
DRAWN BY.: RS
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0
SITE PLAN

C-111


PLOT DATE:

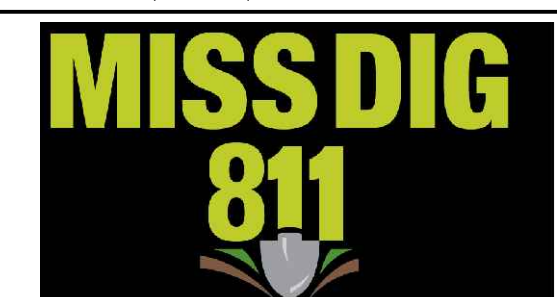

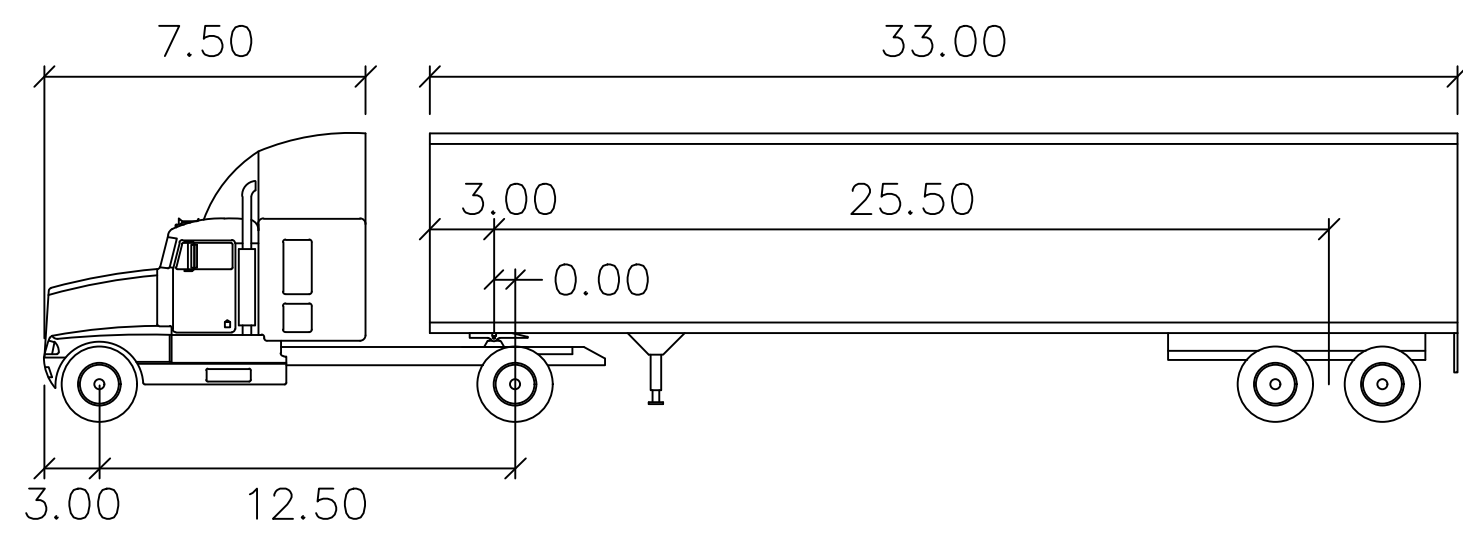


WB-40

	feet		
Tractor Width	: 8.00	Lock to Lock Time	: 6.0
Trailer Width	: 8.00	Steering Angle	: 20.3
Tractor Track	: 8.00	Articulating Angle	: 70.0
Trailer Track	: 8.00		

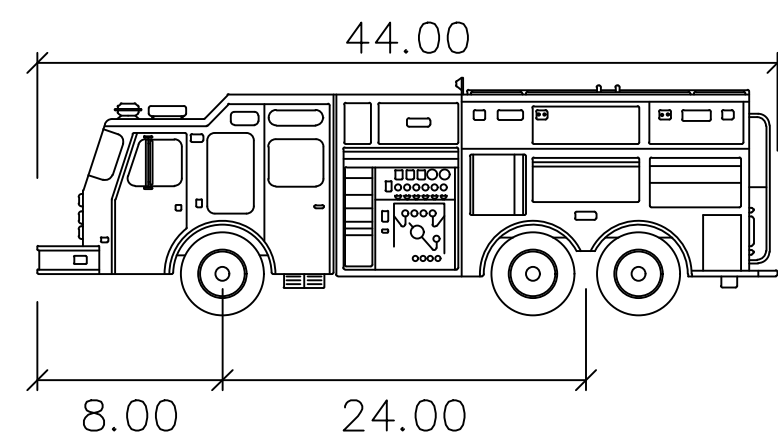





Pumper Fire Truck

	feet
Width	: 8.50
Track	: 8.50
Lock to Lock Time	: 6.0
Steering Angle	: 37.8

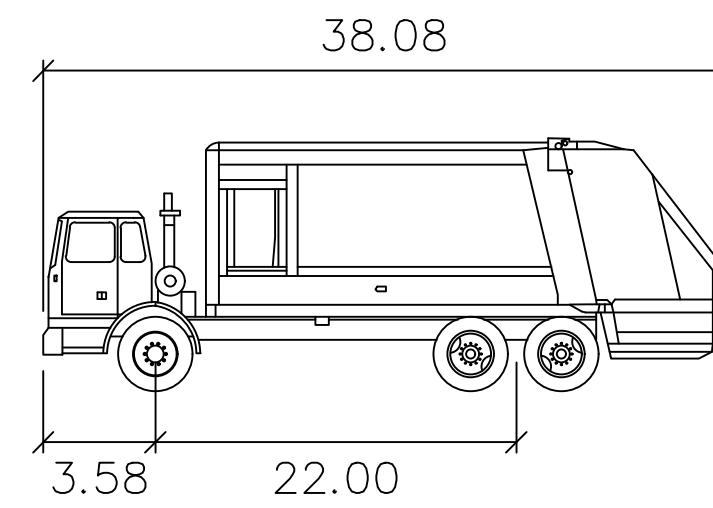


Rear-Load Garbage Truck

	feet
Width	: 8.00
Track	: 8.00
Lock to Lock Time	: 6.0
Steering Angle	: 27.4

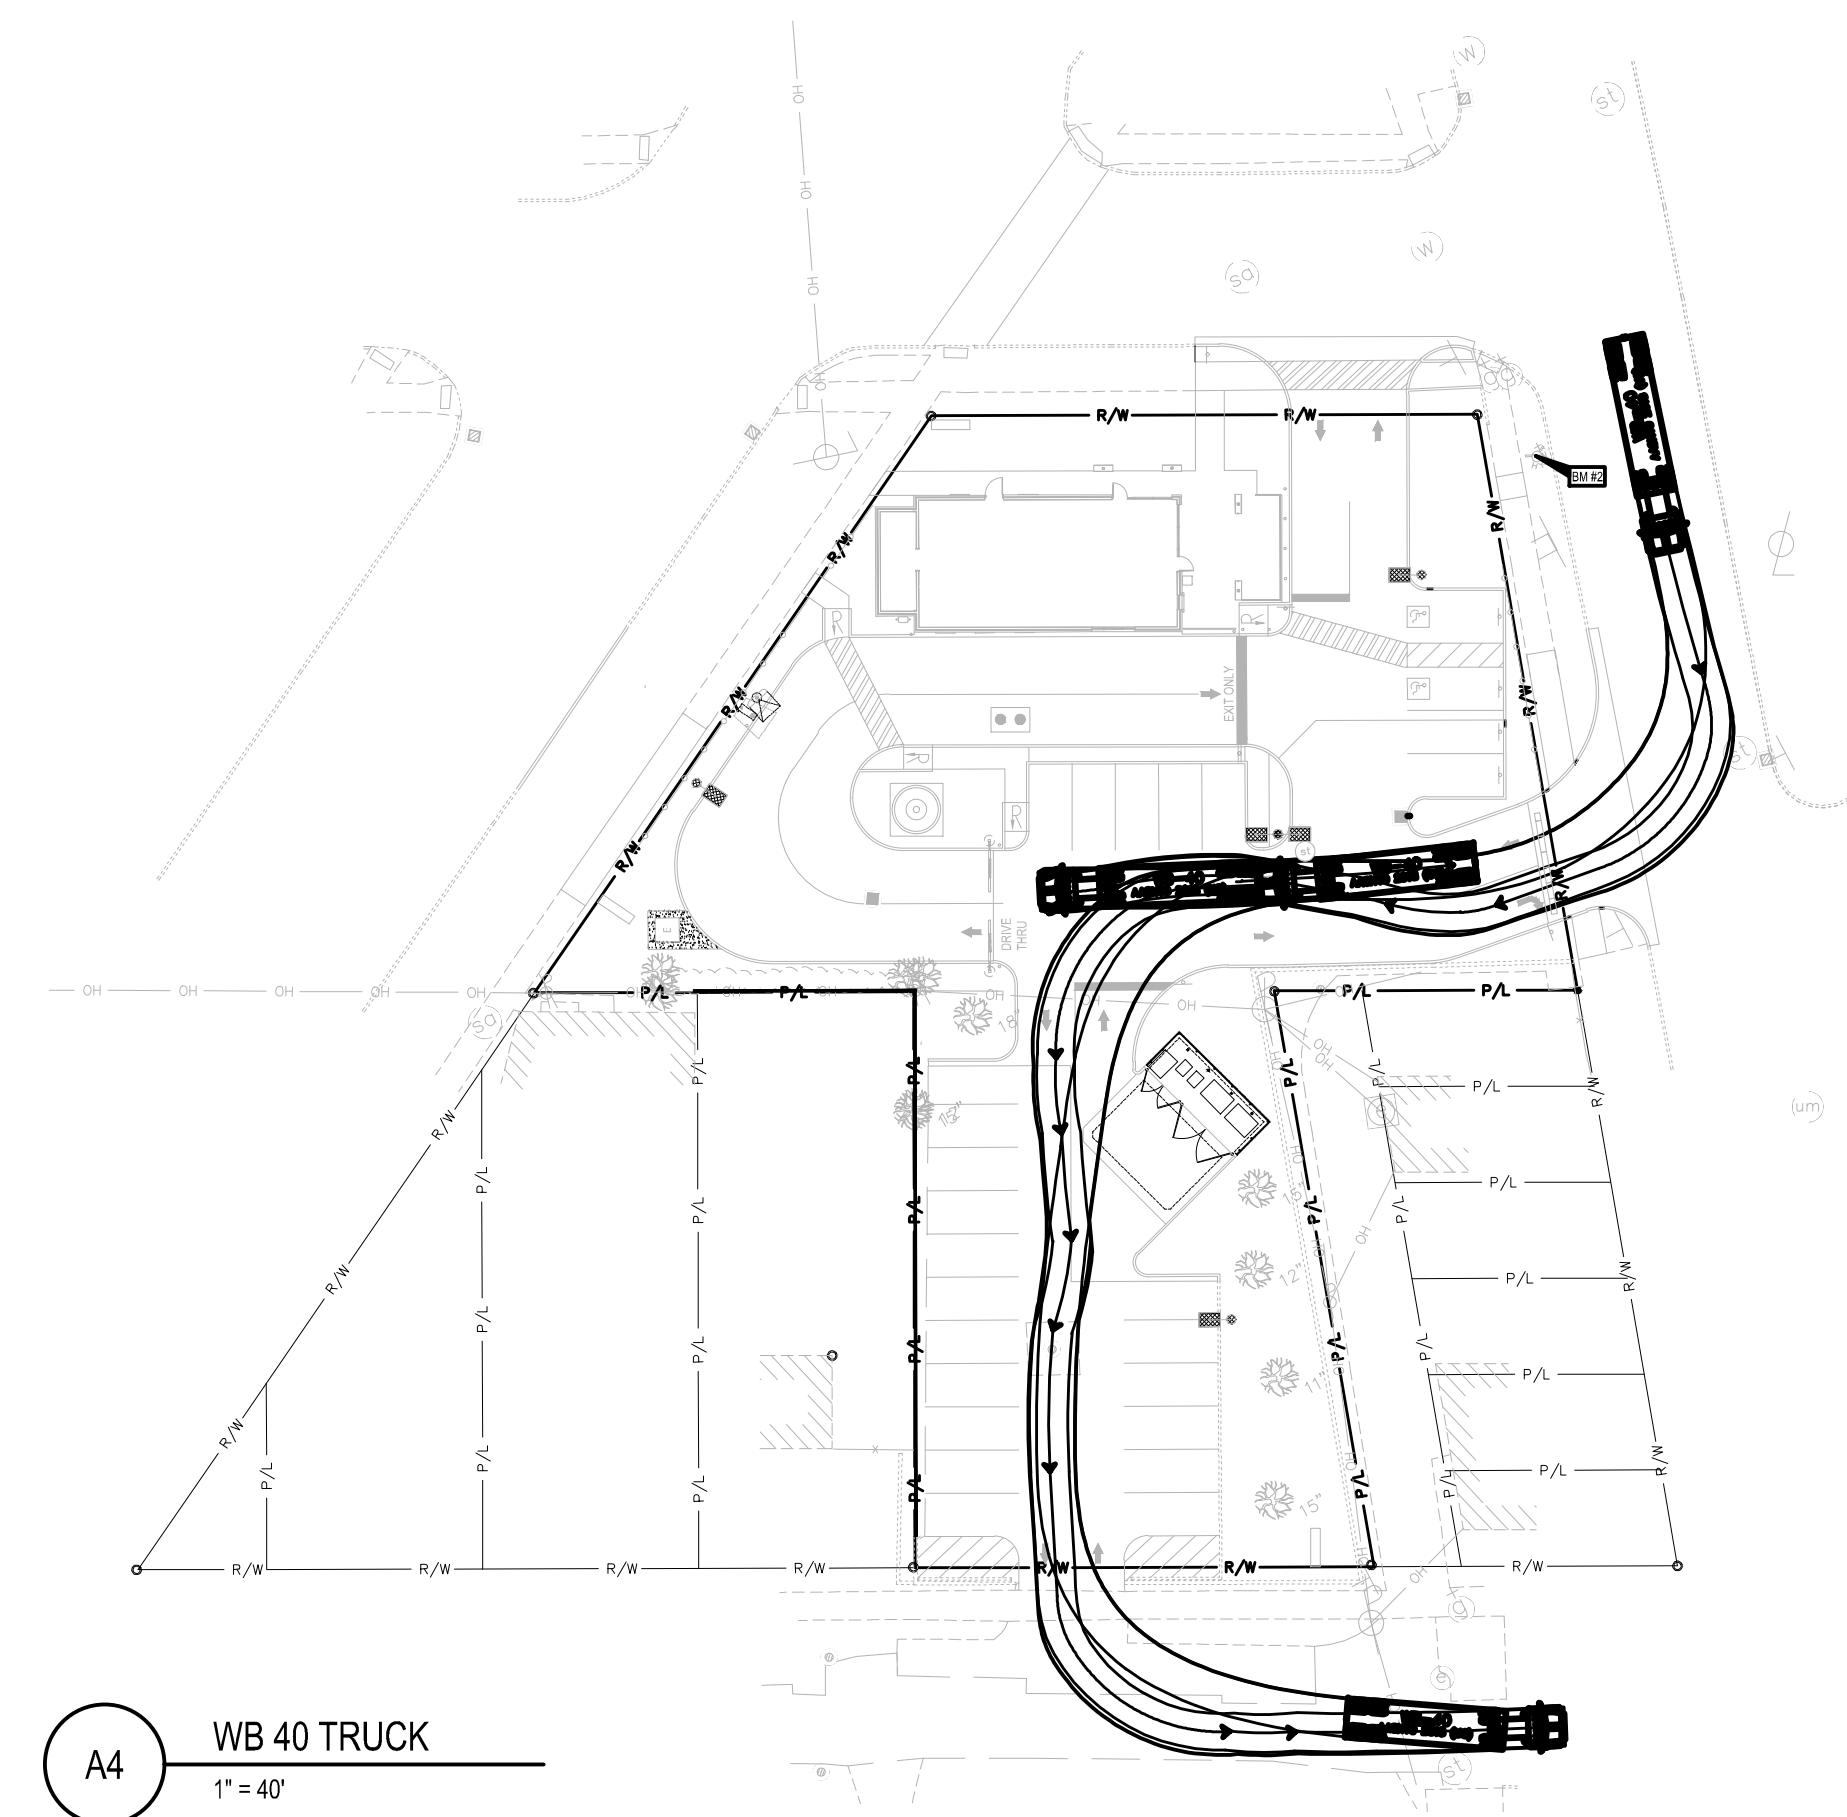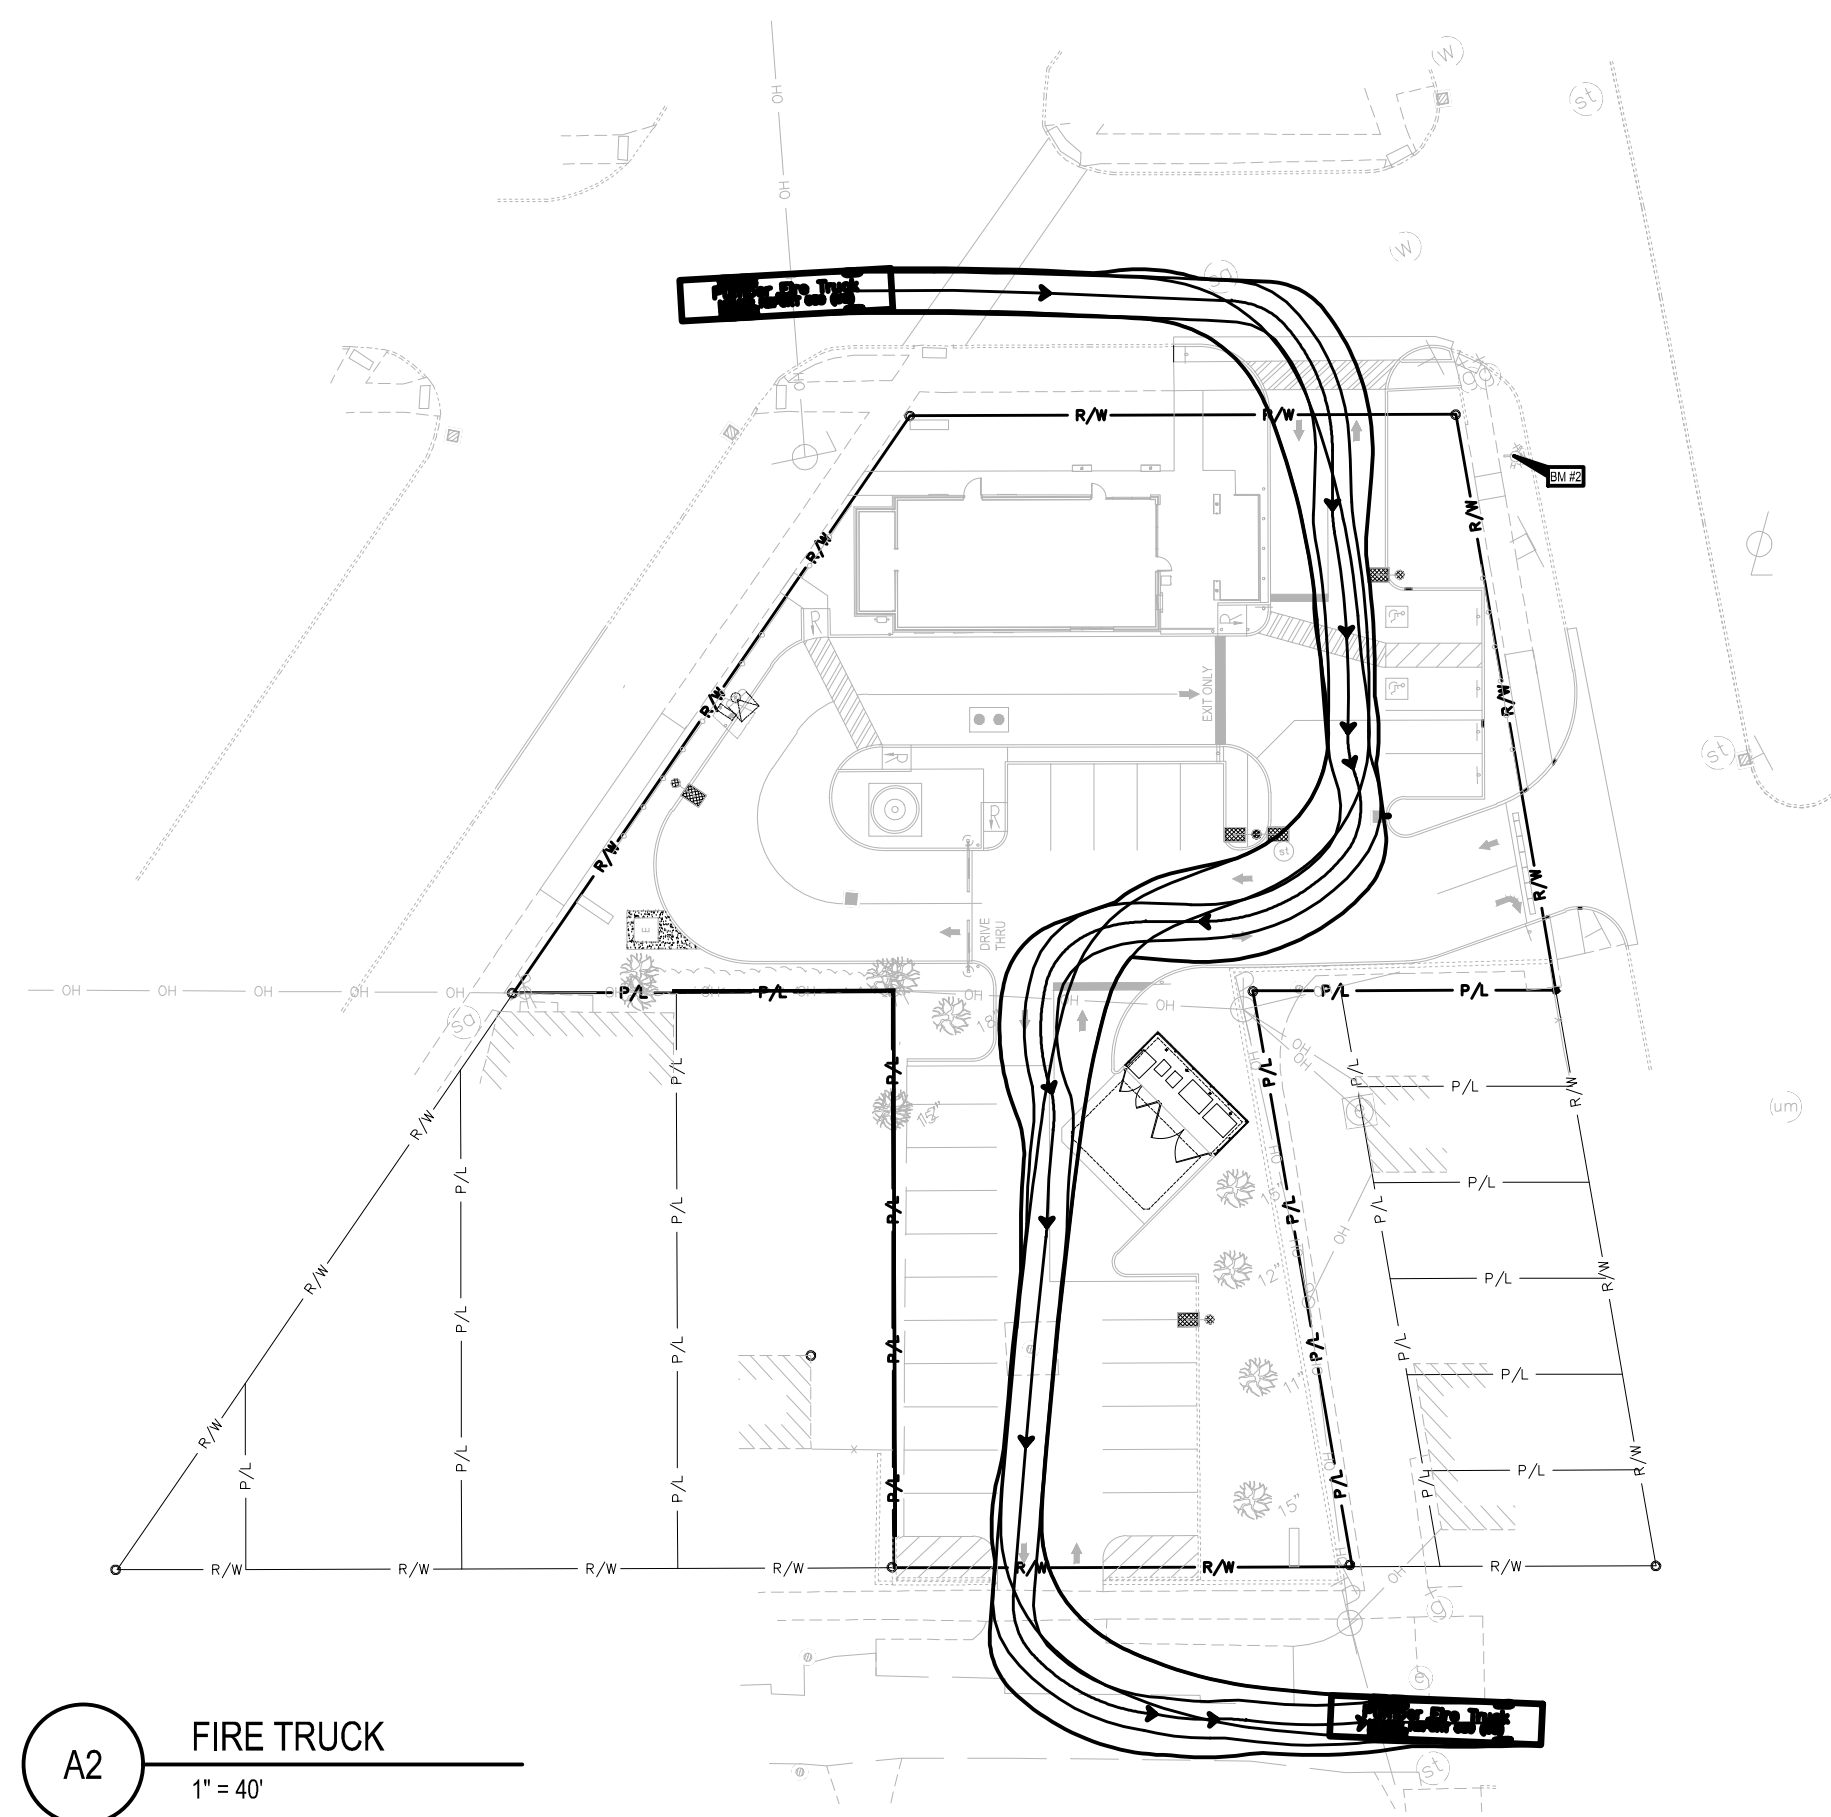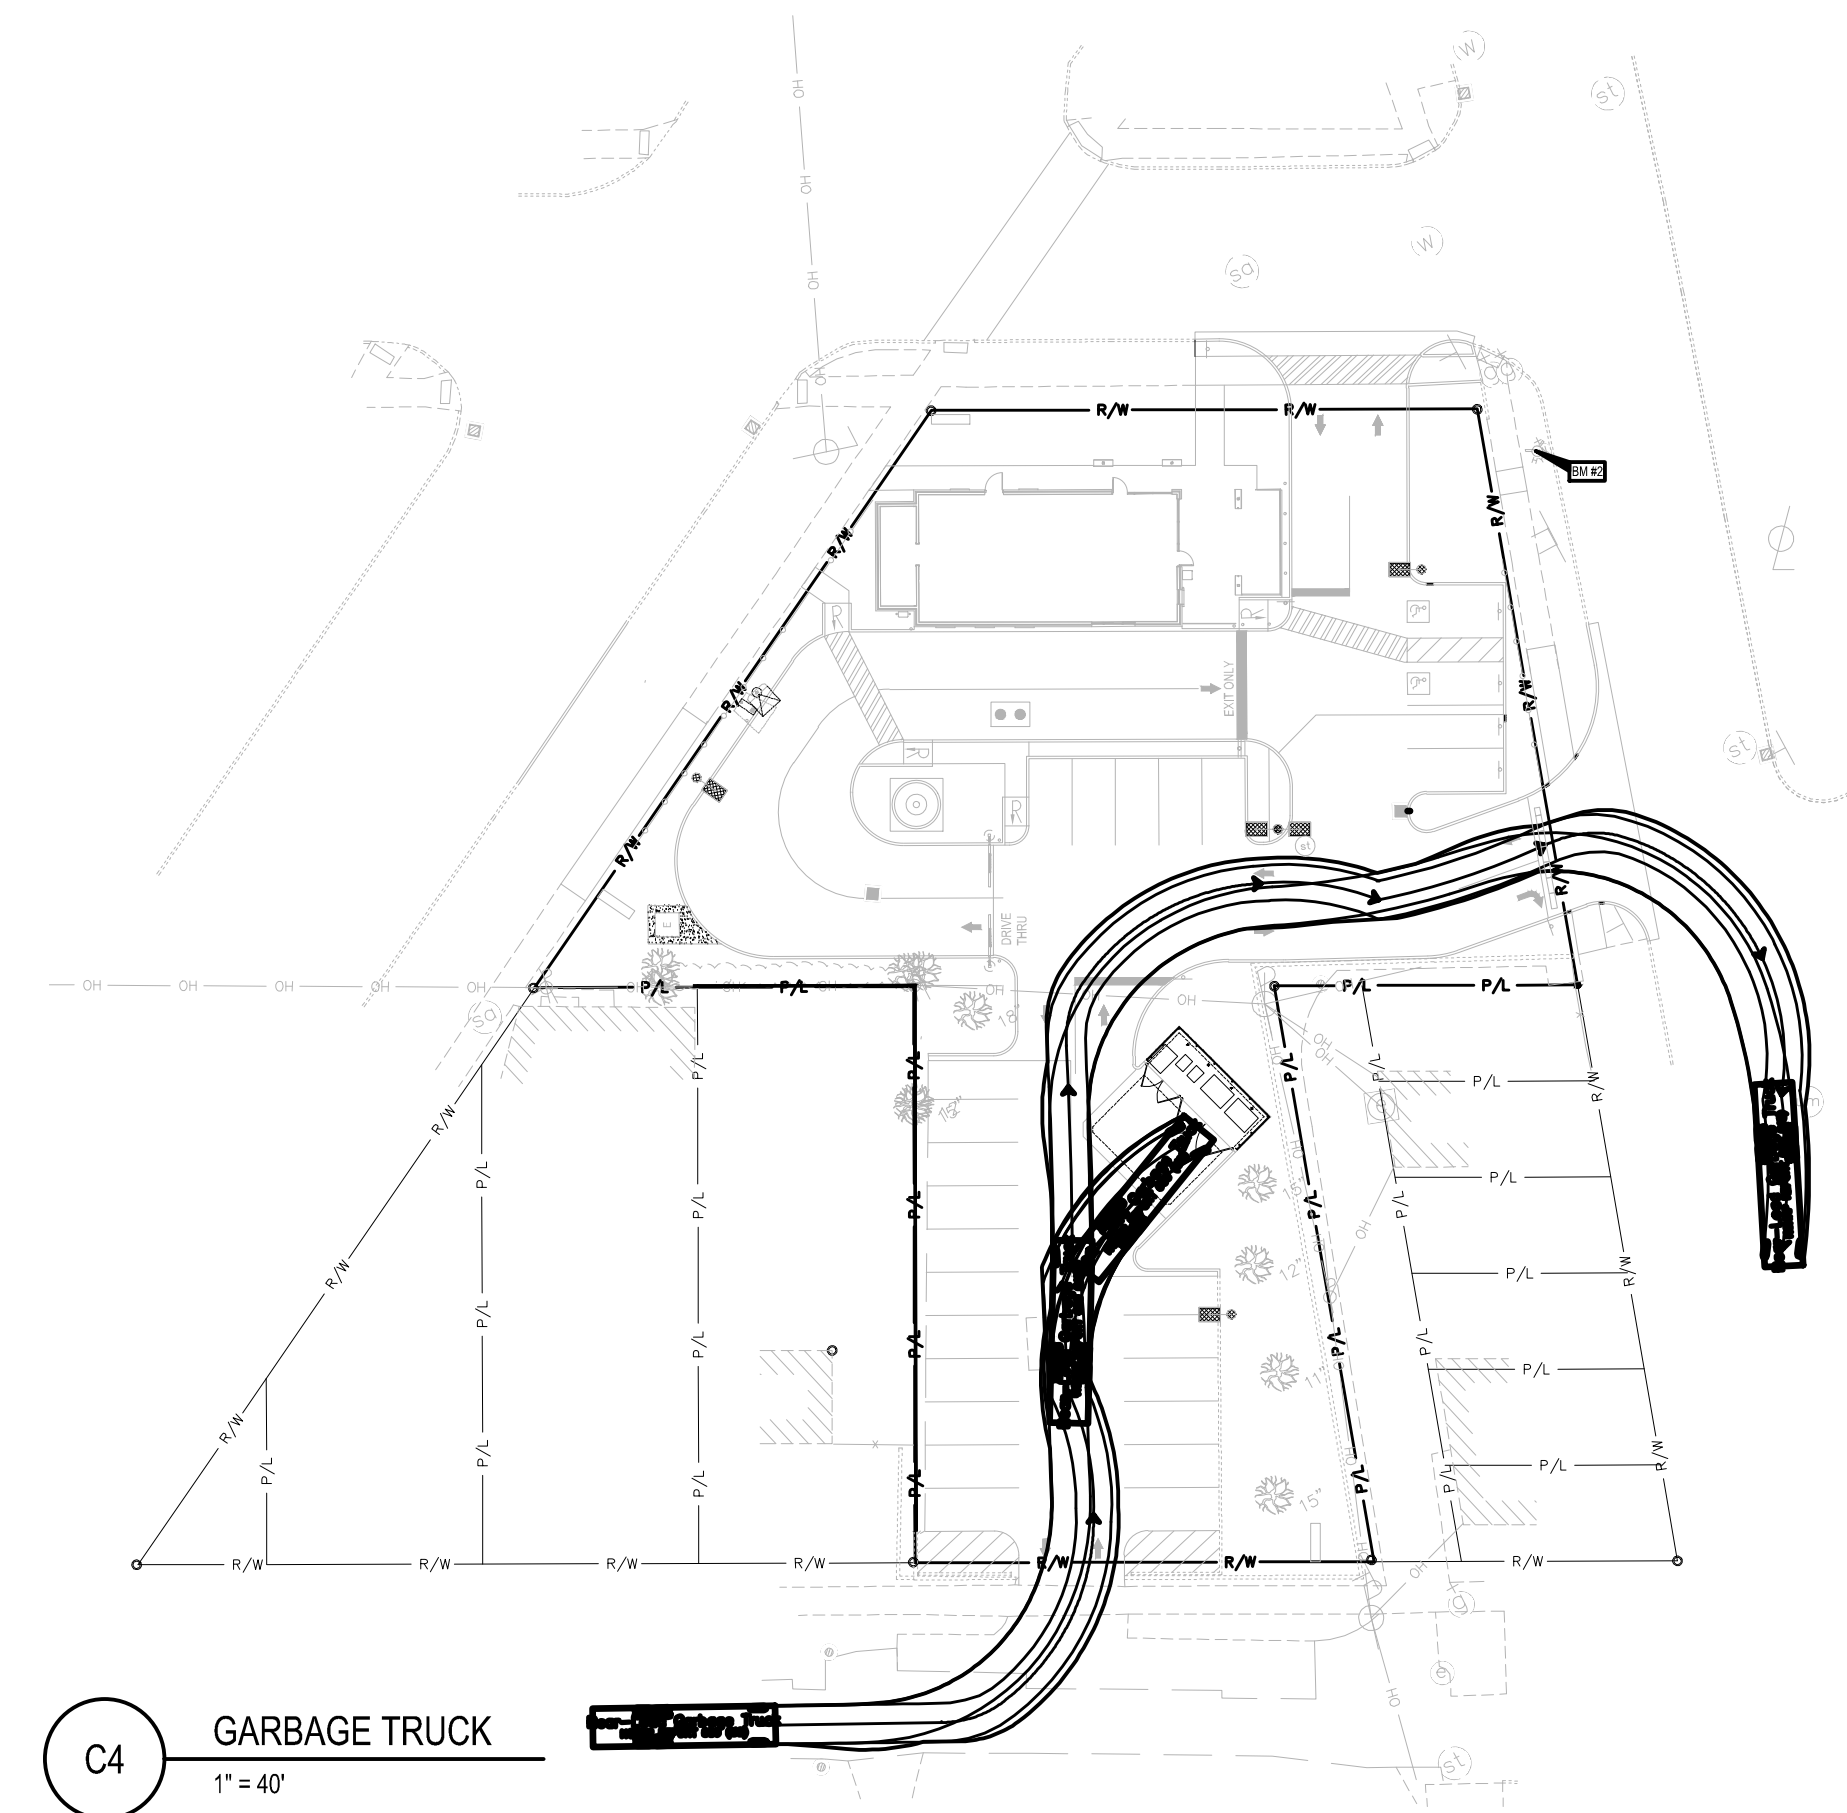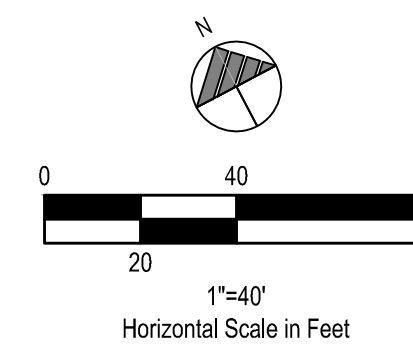

BENCHMARKS:
 NORTH 80°00'00" WEST, BEING THE NORTHERLY RIGHT OF WAY LINE OF OPAL AVENUE, AS PLATTED.
 BENCHMARK #1 - NORTH BOLT ON LIGHT POLE WEST OF ASPHALT PARKING LOT AND MOST EASTERLY LIGHT POLE. ELEVATION = 589.20' (NAVD 88).
 BENCHMARK #2 - ARROW ON TOP OF HYDRANT AT THE SOUTHWEST CORNER OF MACK AVENUE AND ANATOLE STREET. ELEVATION = 585.99' (NAVD 88)

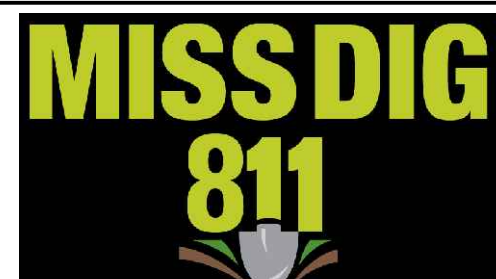

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 P/A/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL



18550 E. WARREN AVE
 DETROIT, MI 48236



**ENDEAVOR 2.0
 AUTOTURN PLAN**

C-112

PLOT DATE:

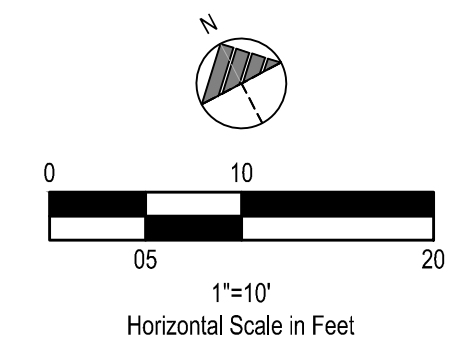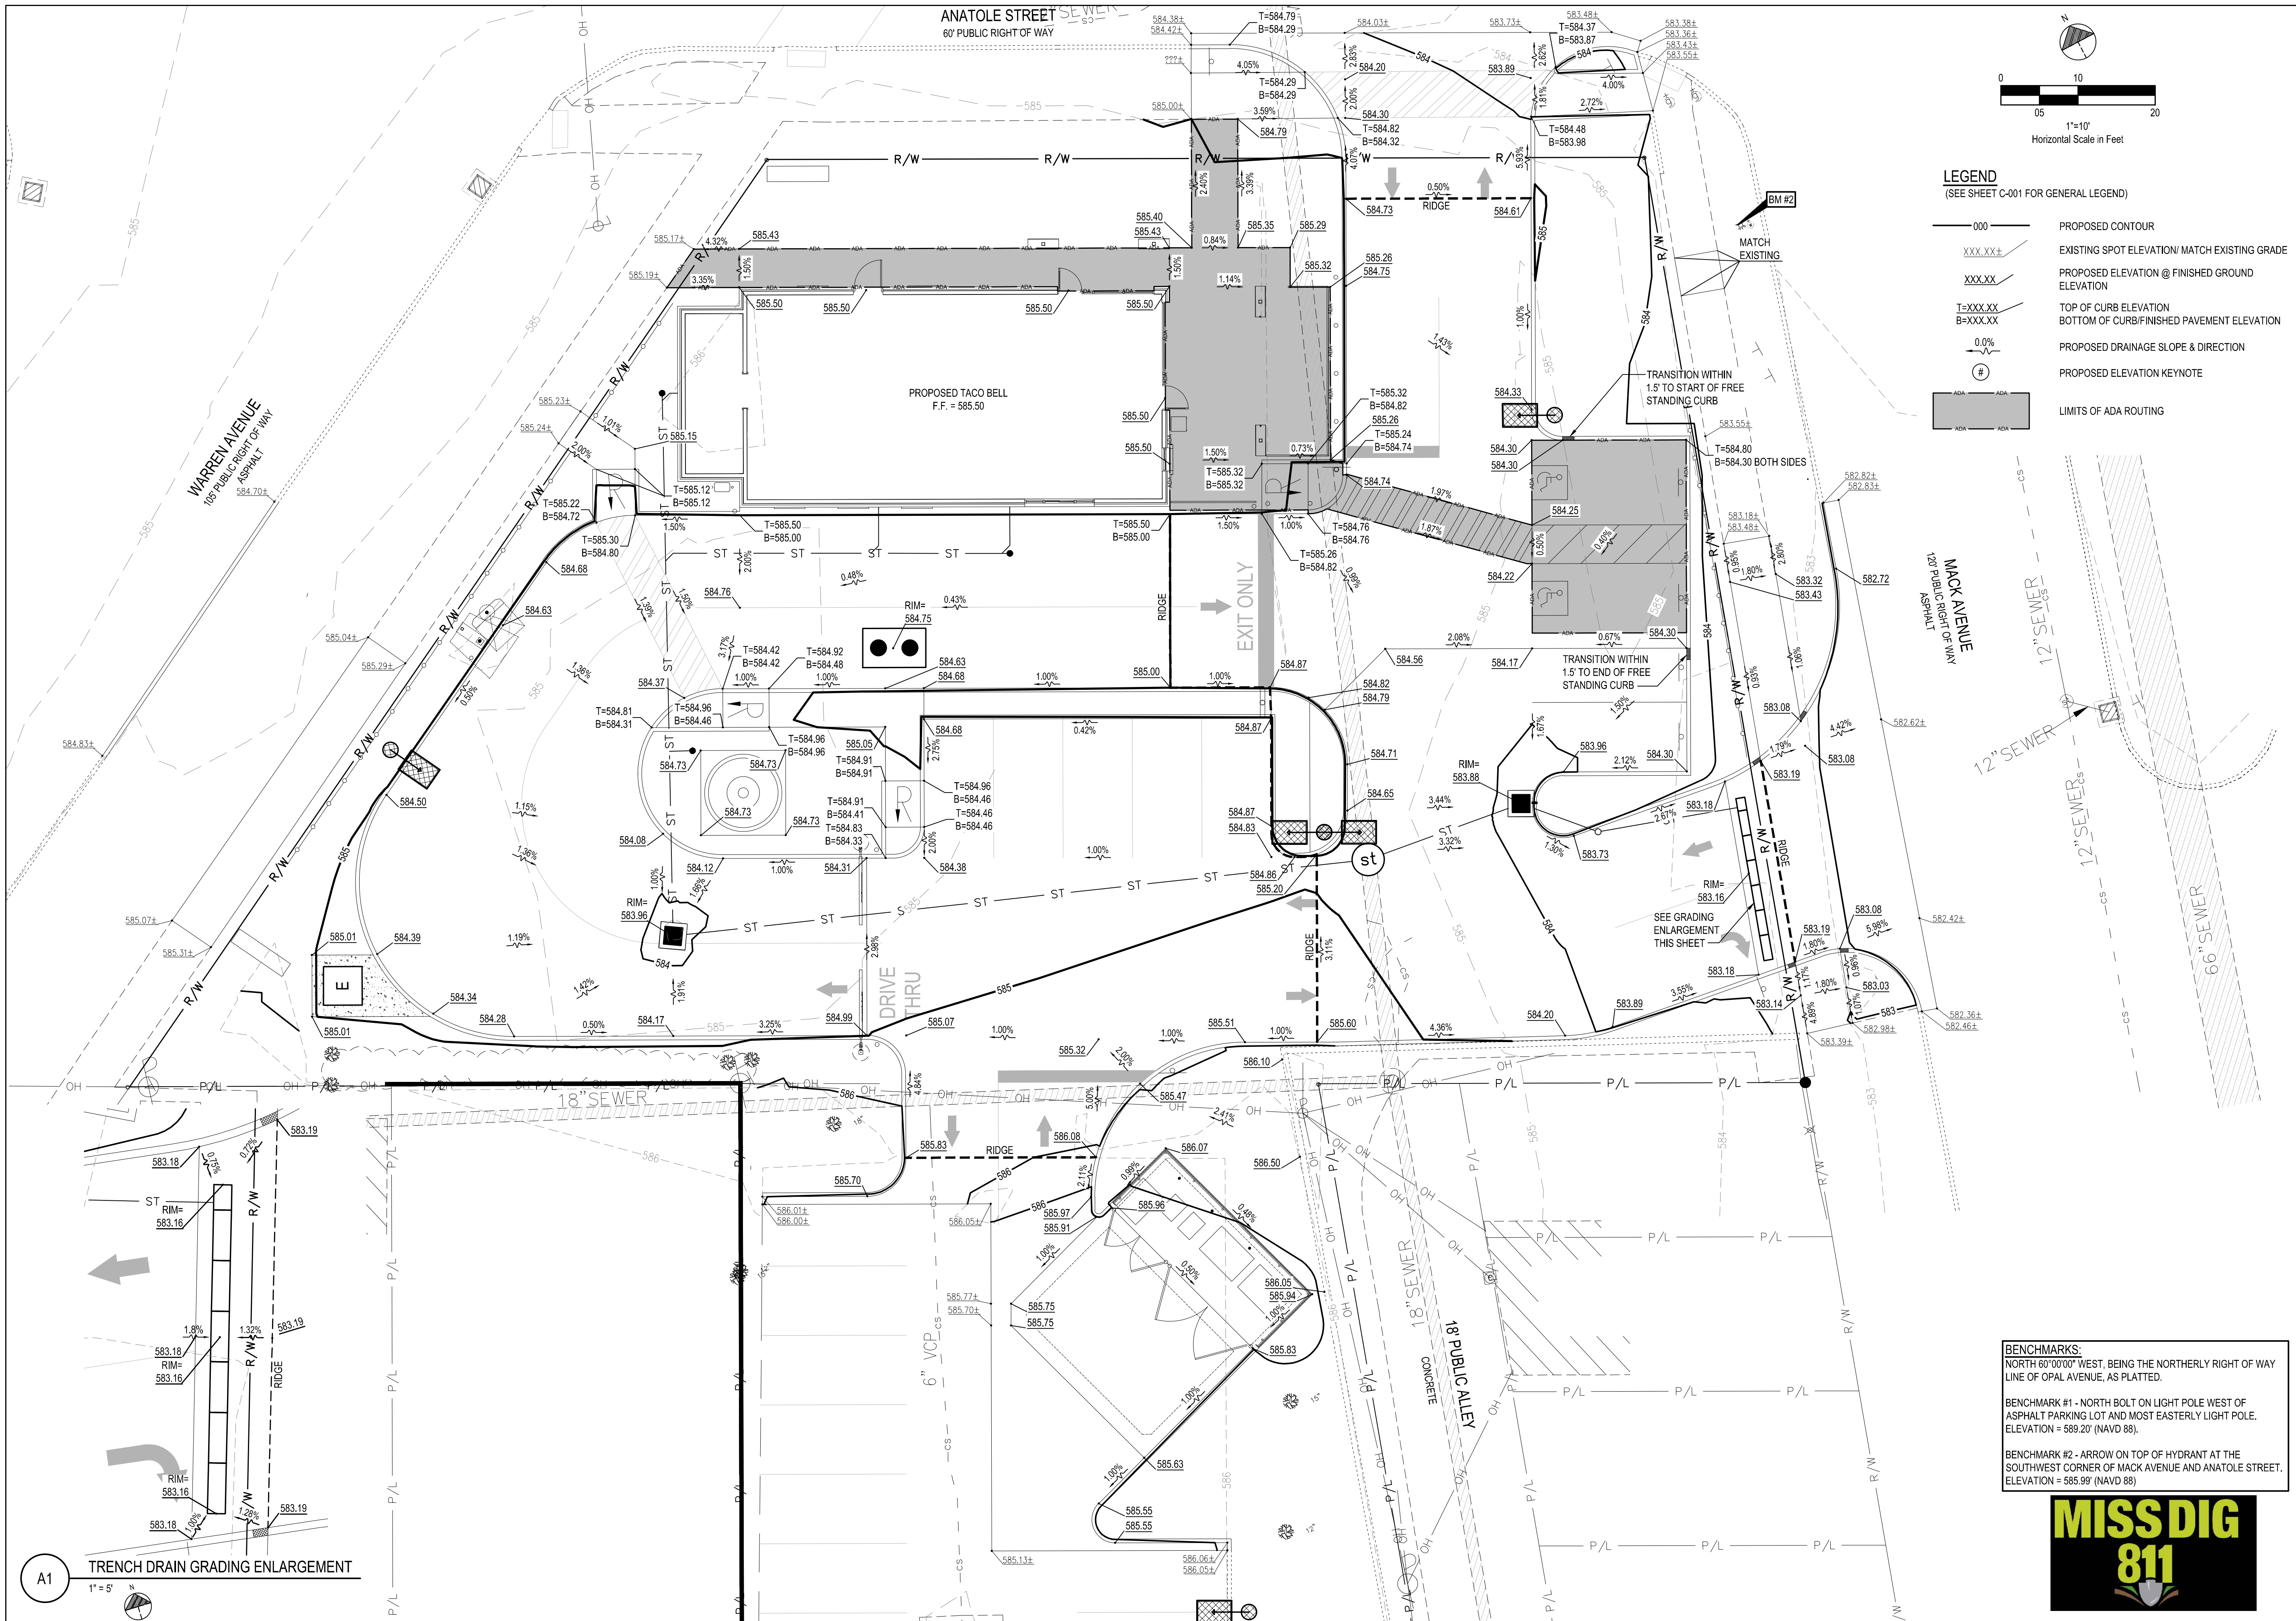

- LEGEND**
(SEE SHEET C-001 FOR GENERAL LEGEND)
- 000— PROPOSED CONTOUR
 - XXX.XX± EXISTING SPOT ELEVATION/ MATCH EXISTING GRADE
 - XXX.XX PROPOSED ELEVATION @ FINISHED GROUND ELEVATION
 - T=XXX.XX TOP OF CURB ELEVATION
 - B=XXX.XX BOTTOM OF CURB/FINISHED PAVEMENT ELEVATION
 - 0.0% PROPOSED DRAINAGE SLOPE & DIRECTION
 - # PROPOSED ELEVATION KEYNOTE
 - ADA ROUTING LIMITS OF ADA ROUTING



DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PAVPM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236





ENDEAVOR 2.0
 GRADING PLAN

C-121

PLOT DATE:

BENCHMARKS:
 NORTH 60°00'00" WEST, BEING THE NORTHERLY RIGHT OF WAY LINE OF OPAL AVENUE, AS PLATTED.
 BENCHMARK #1 - NORTH BOLT ON LIGHT POLE WEST OF ASPHALT PARKING LOT AND MOST EASTERLY LIGHT POLE. ELEVATION = 589.20' (NAVD 88).
 BENCHMARK #2 - ARROW ON TOP OF HYDRANT AT THE SOUTHWEST CORNER OF MACK AVENUE AND ANATOLE STREET. ELEVATION = 585.99' (NAVD 88)

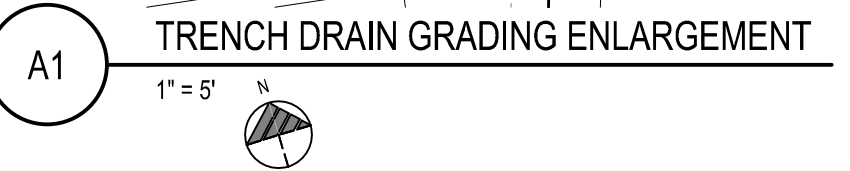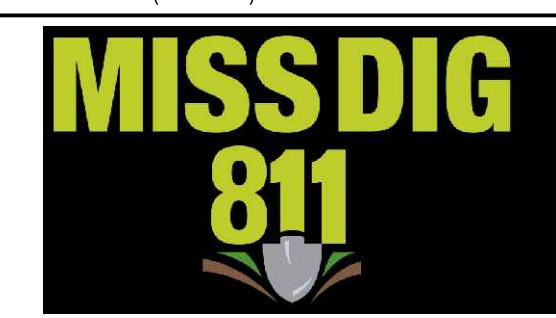



PLAN KEYNOTES (#)

STORM

- 100. PROPOSED 28 LF OF 8" PVC @ 2.00%.
- 101. PROPOSED WYE CONNECTION, SEE SHEET C-503. 8" INV. = 578.76.
- 102. PROPOSED 70 LF OF 6" PVC @ 4.45%.
- 103. PROPOSED WYE CONNECTION, SEE SHEET C-503. 8" INV. = 581.99.
- 104. PROPOSED CLEANOUT, SEE SHEET C-506. RIM = 585.37, 6" INV. = 582.91
- 105. PROPOSED 2 LF OF 6" PVC @ 4.45%.
- 106. PROPOSED 45 LF OF 6" PVC @ 2.00%.
- 107. PROPOSED CLEANOUT, SEE SHEET C-506. RIM = 584.91, 6" INV. = 582.88.
- 108. PROPOSED 6" PVC DOWNSPOUT COLLECTOR LINE @ 2% MINIMUM.
- 109. PROPOSED 6" INV. AT BUILDING = 583.00.
- 110. CONTRACTOR SHALL COORDINATE FINAL CONNECTION WITH THE CITY OF DETROIT DWSD.
- 111. PROPOSED 3 LF OF 6" PVC @ 2.00%. 6" INV. = 580.85
- 112. PROPOSED CLEANOUT, SEE SHEET C-506. RIM = 580.91, 6" INV. = 584.69.

SANITARY

- 200. PROPOSED SANITARY CONNECTION PER SHEET C-506. EXISTING 18" INV. = 572.58.
PROPOSED 6" INV. = 573.58.
- 201. PROPOSED 45" RISER PER SHEET C-506. 6" INV. = 579.10.
- 202. PROPOSED 51 L.F. OF 6" PVC SANITARY SEWER @ 1.00%.
- 203. PROPOSED SANITARY CLEANOUT SEE SHEET C-506 AND WYE CONNECTION SHEET C-503.
RIM = 584.88, 6" PVC INV. = 579.81.
- 204. PROPOSED 18 L.F. OF 6" PVC SANITARY SEWER @ 1.00%.
- 205. PROPOSED SANITARY WYE CONNECTION, SEE SHEET C-503. 6" INV. = 579.70.
- 206. PROPOSED 6 L.F. OF 6" PVC SANITARY SEWER @ 1.00%.
- 207. PROPOSED SANITARY CLEANOUT SEE SHEET C-506 AND WYE CONNECTION SHEET C-503.
RIM = 584.65, 6" PVC INV. = 580.08.
- 208. PROPOSED 18 L.F. OF 6" PVC SANITARY SEWER @ 1.00%.
- 209. PROPOSED SANITARY CLEANOUT AT BUILDING, SEE SHEET C-506.
RIM = 584.98, 6" PVC INV. AT BUILDING = 580.25.
- 210. PROPOSED 18 L.F. OF 6" PVC SANITARY SEWER @ 3.00%.
- 211. PROPOSED SANITARY CLEANOUT AT BUILDING, SEE SHEET C-506.
RIM = 584.98, 6" PVC INV. AT BUILDING = 580.25.
- 212. PROPOSED 3" SANITARY VENT LINE, SEE MECHANICAL PLANS.

WATER

- 300. PROPOSED WATER CONNECTION. COORDINATE WITH PLUMBING PLANS.
- 301. PROPOSED WATER METER AND BACKFLOW PREVENTOR INSIDE BUILDING PER CITY OF DETROIT DWSD STANDARDS AND SPECIFICATIONS. BACKFLOW PREVENTOR SHALL BE LOCATED AFTER THE METER.
- 302. PROPOSED 138 L.F. 1.5" COPPER TYPE 'K' WATER SERVICE LINE, SEE SHEET C-504. WATER LINE TO BE INSTALLED 5' MIN. TO TOP OF PIPE WITH OPEN CUT BORE PIT.
- 303. PROPOSED WATER SERVICE TAP PER CITY OF DETROIT DWSD STANDARDS AND SPECIFICATIONS, SEE SHEET C-504.
- 304. PROPOSED 1" IRRIGATION CONNECTION, UNDER SEPARATE CONTRACT.
- 305. PROPOSED WATER SERVICE STOP BOX. CONTRACTOR SHALL INSTALL PER DWSD STANDARDS AND SPECIFICATIONS.
- 306. PROPOSED 1/2" WATER LINE FOR THE WATER FOUNTAIN. CONTRACTOR SHALL TAP LINE INTO THE IRRIGATION LINE AT THE BUILDING.
- 307. PROPOSED 5' X 14' OPEN TRENCH BORE PIT FOR WATER LINE INSTALLATION.

ELECTRIC AND COMMUNICATIONS

- 400. PROPOSED ELECTRIC METER PER ELECTRIC COMPANY SPECIFICATIONS. SEE BUILDING DRAWINGS FOR EXACT LOCATION. ELECTRIC SERVICE LINE TO BE COORDINATED WITH THE ELECTRIC COMPANY.
- 401. PROPOSED ELECTRIC AND TELECOMMUNICATIONS SERVICE CONNECTION TO BE COORDINATED WITH THE UTILITY COMPANIES.
- 402. PROPOSED LIGHT POLE. SEE ELECTRICAL AND STRUCTURAL DRAWINGS FOR SPECIFICATIONS AND FOUNDATION DETAIL.
- 403. PROPOSED ELECTRICAL TRANSFORMER PER ELECTRICAL COMPANY SPECIFICATIONS. G.C. TO VERIFY EXACT LOCATION AND SIZE WITH UTILITY ENGINEER.
- 404. PROPOSED SENSOR LOOP. SEE ELECTRICAL DRAWINGS FOR DETAIL.

GAS

- 500. PROPOSED GAS METER PER GAS COMPANY SPECIFICATIONS. SEE BUILDING DRAWINGS FOR EXACT LOCATION. GAS SERVICE LINE TO BE COORDINATED WITH THE GAS COMPANY.
- 501. PROPOSED 147 L.F. GAS SERVICE CONNECTION TO BE COORDINATED WITH THE GAS COMPANY.

UTILITY CROSSINGS

GENERAL UTILITY CROSSING NOTES:

1. CONTRACTOR SHALL COORDINATE ALL CROSSINGS/RELOCATIONS WITH THE RESPECTIVE UTILITY COMPANIES.
2. EXISTING AND PROPOSED PRESSURIZED (WATER & GAS) AND SECONDARY (ELECTRIC & COMMUNICATIONS) UTILITIES SHALL DEFLECT TO MAINTAIN 18" CLEAR AT SANITARY OR STORM SEWER CROSSINGS WHEN CONFLICTS OCCUR.
3. WHEN A PROPOSED PRESSURIZED/SECONDARY UTILITY IS IN CROSSING CONFLICT WITH AN EXISTING PRESSURIZED/SECONDARY UTILITY, THE PROPOSED UTILITY SHALL DEFLECT TO OBTAIN MINIMUM CLEARANCE.
4. CONTRACTOR SHALL FIELD LOCATE EXISTING PRESSURIZED/SECONDARY UTILITIES AT PROPOSED CROSSINGS.
5. FOR CLEARANCE BETWEEN PIPES OF LESS THAN 18", THE CONTRACTOR SHALL PROVIDE CONCRETE ENCASEMENT PER SHEET C-503.

- (1) PROP. 6" STORM INV. = 582.38
- (2) PROP. 6" SANITARY INV. = 580.20
- (3) PROP. GAS (SEE NOTES ABOVE)
- (4) PROP. 6" SANITARY INV. = 580.15
- (5) PROP. 6" STORM INV. = 582.78
- (6) PROP. 6" SANITARY INV. = 580.10
- (7) PROP. GAS (SEE NOTES ABOVE)
- (8) PROP. 6" SANITARY INV. = 579.94
- (9) PROP. ELECTRIC (SEE NOTES ABOVE)
- (10) PROP. 0.5" WATER (SEE NOTES ABOVE)
- (11) PROP. TELEPHONE (SEE NOTES ABOVE)
- (12) PROP. 6" STORM INV. = 580.55
- (13) PROP. GAS (SEE NOTES ABOVE)
- (14) PROP. 6" STORM INV. = 582.13
- (15) PROP. GAS (SEE NOTES ABOVE)
- (16) EX. 24" STORM INV. = 570.75
- (17) PROP. 1.5" WATER (SEE NOTES ABOVE)
- (18) EX. 24" STORM INV. = 570.70
- (19) PROP. 1.5" WATER (SEE NOTES ABOVE)
- (20) EX. GAS (SEE NOTES ABOVE)
- (21) PROP. 6" SANITARY INV. = 579.25
- (22) PROP. 6" STORM INV. = 577.00

VIDEO RECORDING


CONTRACTOR SHALL CLEAN EXISTING SEWER AND VIDEO RECORD EXISTING LINE PRIOR TO CONSTRUCTION FOR CONDITION. CONTRACTOR SHALL NOTIFY CONSTRUCTION MANAGER IMMEDIATELY IF CONDITION OF EXISTING SEWER IS IN POOR CONDITION.

FLOOD NOTE

SUBJECT PARCEL LIES WITHIN:
OTHER AREA (ZONE X): AREAS DETERMINED TO BE OUTSIDE OF THE 0.2% ANNUAL CHANCE FLOODPLAIN.
AS SHOWN ON FLOOD INSURANCE RATE MAP: MAP NUMBER 2616300145E, DATED 2/2/2012, PUBLISHED BY THE FEDERAL EMERGENCY MANAGEMENT AGENCY.

LEGEND

- (SEE SHEET C-001 FOR GENERAL LEGEND)
- ST PROPOSED STORM SEWER (12" AND SMALLER)
 - ST PROPOSED STORM SEWER (LARGER THAN 12")
 - SAN PROPOSED SANITARY SEWER
 - W PROPOSED WATER SERVICE
 - GAS PROPOSED GAS SERVICE
 - E PROPOSED UNDERGROUND ELECTRIC SERVICE
 - T&C PROPOSED UNDERGROUND TELEPHONE & CABLE SERVICE
 - D.S. ■ PROPOSED DOWNSPOUT
 - # APPURTENANCES
 - # UTILITY CONSTRUCTION KEYNOTE

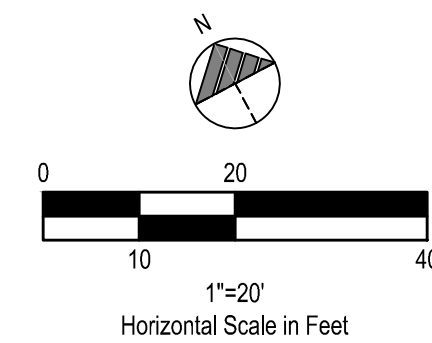

PROPOSED STRUCTURE TABLE

Structure Name	Structure Details
CB-1	PROP. CATCH BASIN (SEE SHEET C-503) 4" FINGER DRAIN (ALL DIRECTIONS IN PVMT) RIM = 583.96 12" HDPE INV (E)=579.28 6" PVC Pipe INV (NE)=579.78
CB-2	PROP. CATCH BASIN (SEE SHEET C-503) 4" FINGER DRAIN (ALL DIRECTIONS IN PVMT) RIM = 583.88 12" HDPE INV (W)=578.21 8" PVC Pipe INV (SE)=578.55
MH-1	PROP. DWSD MANHOLE EXTERIOR DROP (SEE SHEET C-507) RIM = 584.64 12" HDPE INV (W)=575.20 24" EXISTING INV (S)=570.79 12" HDPE INV (E)=577.79 24" EXISTING INV (N)=570.79
TD 1	PROPOSED ACO S300K 12" TRENCH DRAIN WITH SK-3 TYPE 9040 WIDE IN-LINE CATCH BASIN (WITH RISER) AND CLASS F (EN 1433) SLOTTED IRON GRATE (SEE SHEET C-507) RIM = 583.16 START INV. = 583.16 (PART SK3-1)" END INV. = 583.08 (PART SK3-6)" 8" OUTLET INV. = 579.13" ** CONTRACTOR SHALL COORDINATE FINAL TRENCH DRAIN INVERTS AND REQUIRED PARTS WITH MANUFACTURER
GI A	PROPOSED 1,000 GALLON EXTERIOR GREASE INTERCEPTOR (SEE SHEET C-503) RIM=584.75 INV. 6" PVC (W) = 580.02 INV. 6" PVC (E) = 579.77

* FINGER DRAIN INVERT SHALL MATCH THE BOTTOM OF THE PAVEMENT AGGREGATE BASE

Pipe Table

Pipe Name	Design
ST-1	91 LF OF 12" HDPE @ 4.50%
ST-2	21 LF OF 12" HDPE @ 2.00%



EXISTING STRUCTURES

STRUCT. ID	STRUCTURE DETAILS
EX 10002	EXISTING CATCH BASIN RIM=583.93 BOTTOM STRUCTURE=
EX 10015	EXISTING SEWER MANHOLE RIM=584.19 INV. 18" (NNE) = 571.55 INV. 18" (S) = FIELD VERIFY INV. 12" (SE) = 572.22 INV. 12" (NW) = 572.22
EX 10056	EXISTING CATCH BASIN RIM=584.52 BOTTOM STRUCTURE=580.32
EX 10156	EXISTING CATCH BASIN RIM=584.81 INV. 6" (N) = 581.21
EX 10284	EXISTING SEWER MANHOLE RIM=585.09 INV. 15" (NW) = 573.23 INV. 12" (W) = 578.53 INV. 18" (ESE) = 573.12 INV. 8" (SW) = 579.43
EX 10447	EXISTING STORM CATCH BASIN RIM=585.20 INV. 24" (NNE) = 570.82 INV. 18" (SSW) = 570.82 INV. 18" (WNW) = 572.40
EX 10496	EXISTING STORM CATCH BASIN RIM=584.39 BOTTOM STRUCTURE = 579.39
EX 10574	EXISTING STORM CATCH BASIN RIM=584.12 BOTTOM STRUCTURE=580.87
EX 10665	EXISTING STORM CATCH BASIN RIM=583.46 BOTTOM STRUCTURE = 575.66
EX 10685	EXISTING SEWER MANHOLE RIM=583.47 INV. 12" (N) = 574.86 INV. 12" (S) = 575.15 INV. 12" (W) = 576.61
EX 10695	EXISTING STORM CATCH BASIN RIM=582.35 INV. 12" (NW) = NOT VISIBLE BOTTOM STRUCTURE = 574.85
EX 10696	EXISTING SEWER MANHOLE RIM=582.56 INV. 12" (NE, SW) = 575.42 INV. 12" (SE) = 576.36
EX 10709	EXISTING SEWER MANHOLE RIM=584.68 INV. 18" (NNE) = 570.02 INV. 24" (SSW) = 570.66 INV. 24" (SE) = 570.75 INV. 12" (NW) = 579.54 INV. 12" (W) = 578.22


NOTE:
WAYNE COUNTY PERMIT REVIEW WAS PERFORMED ONLY WITHIN WAYNE COUNTY JURISDICTION AND ONLY RESPONSIBLE FOR WITHIN WAYNE COUNTY RIGHT OF WAY (MACK AVE.). WORK OUTSIDE OF WAYNE COUNTY RIGHT OF WAY MUST BE PERMITTED BY OTHER JURISDICTION AGENCY.

NOTE:
UTILITY WORK OUTSIDE THE ROADWAY, WITHIN THE WAYNE COUNTY RIGHT OF WAY, SHALL REQUIRE W20-1 "ROAD WORK AHEAD" (48"x48") 350' IN ADVANCE OF THE WORK ZONE IN ALL DIRECTIONS OF INCOMING TRAFFIC. IF THE WORK ZONE IS ON A LOW-SPEED RESIDENTIAL STREET, THEN THE DISTANCE FROM THE SIGNS TO THE WORK ZONE CAN BE REDUCED TO 100'.


BENCHMARKS:
NORTH 60°00'00" WEST, BEING THE NORTHERLY RIGHT OF WAY LINE OF OPAL AVENUE, AS PLATTED.
BENCHMARK #1 - NORTH BOLT ON LIGHT POLE WEST OF ASPHALT PARKING LOT AND MOST EASTERLY LIGHT POLE. ELEVATION = 589.20' (NAVD 88).
BENCHMARK #2 - ARROW ON TOP OF HYDRANT AT THE SOUTHWEST CORNER OF MACK AVENUE AND ANATOLE STREET. ELEVATION = 585.99' (NAVD 88)

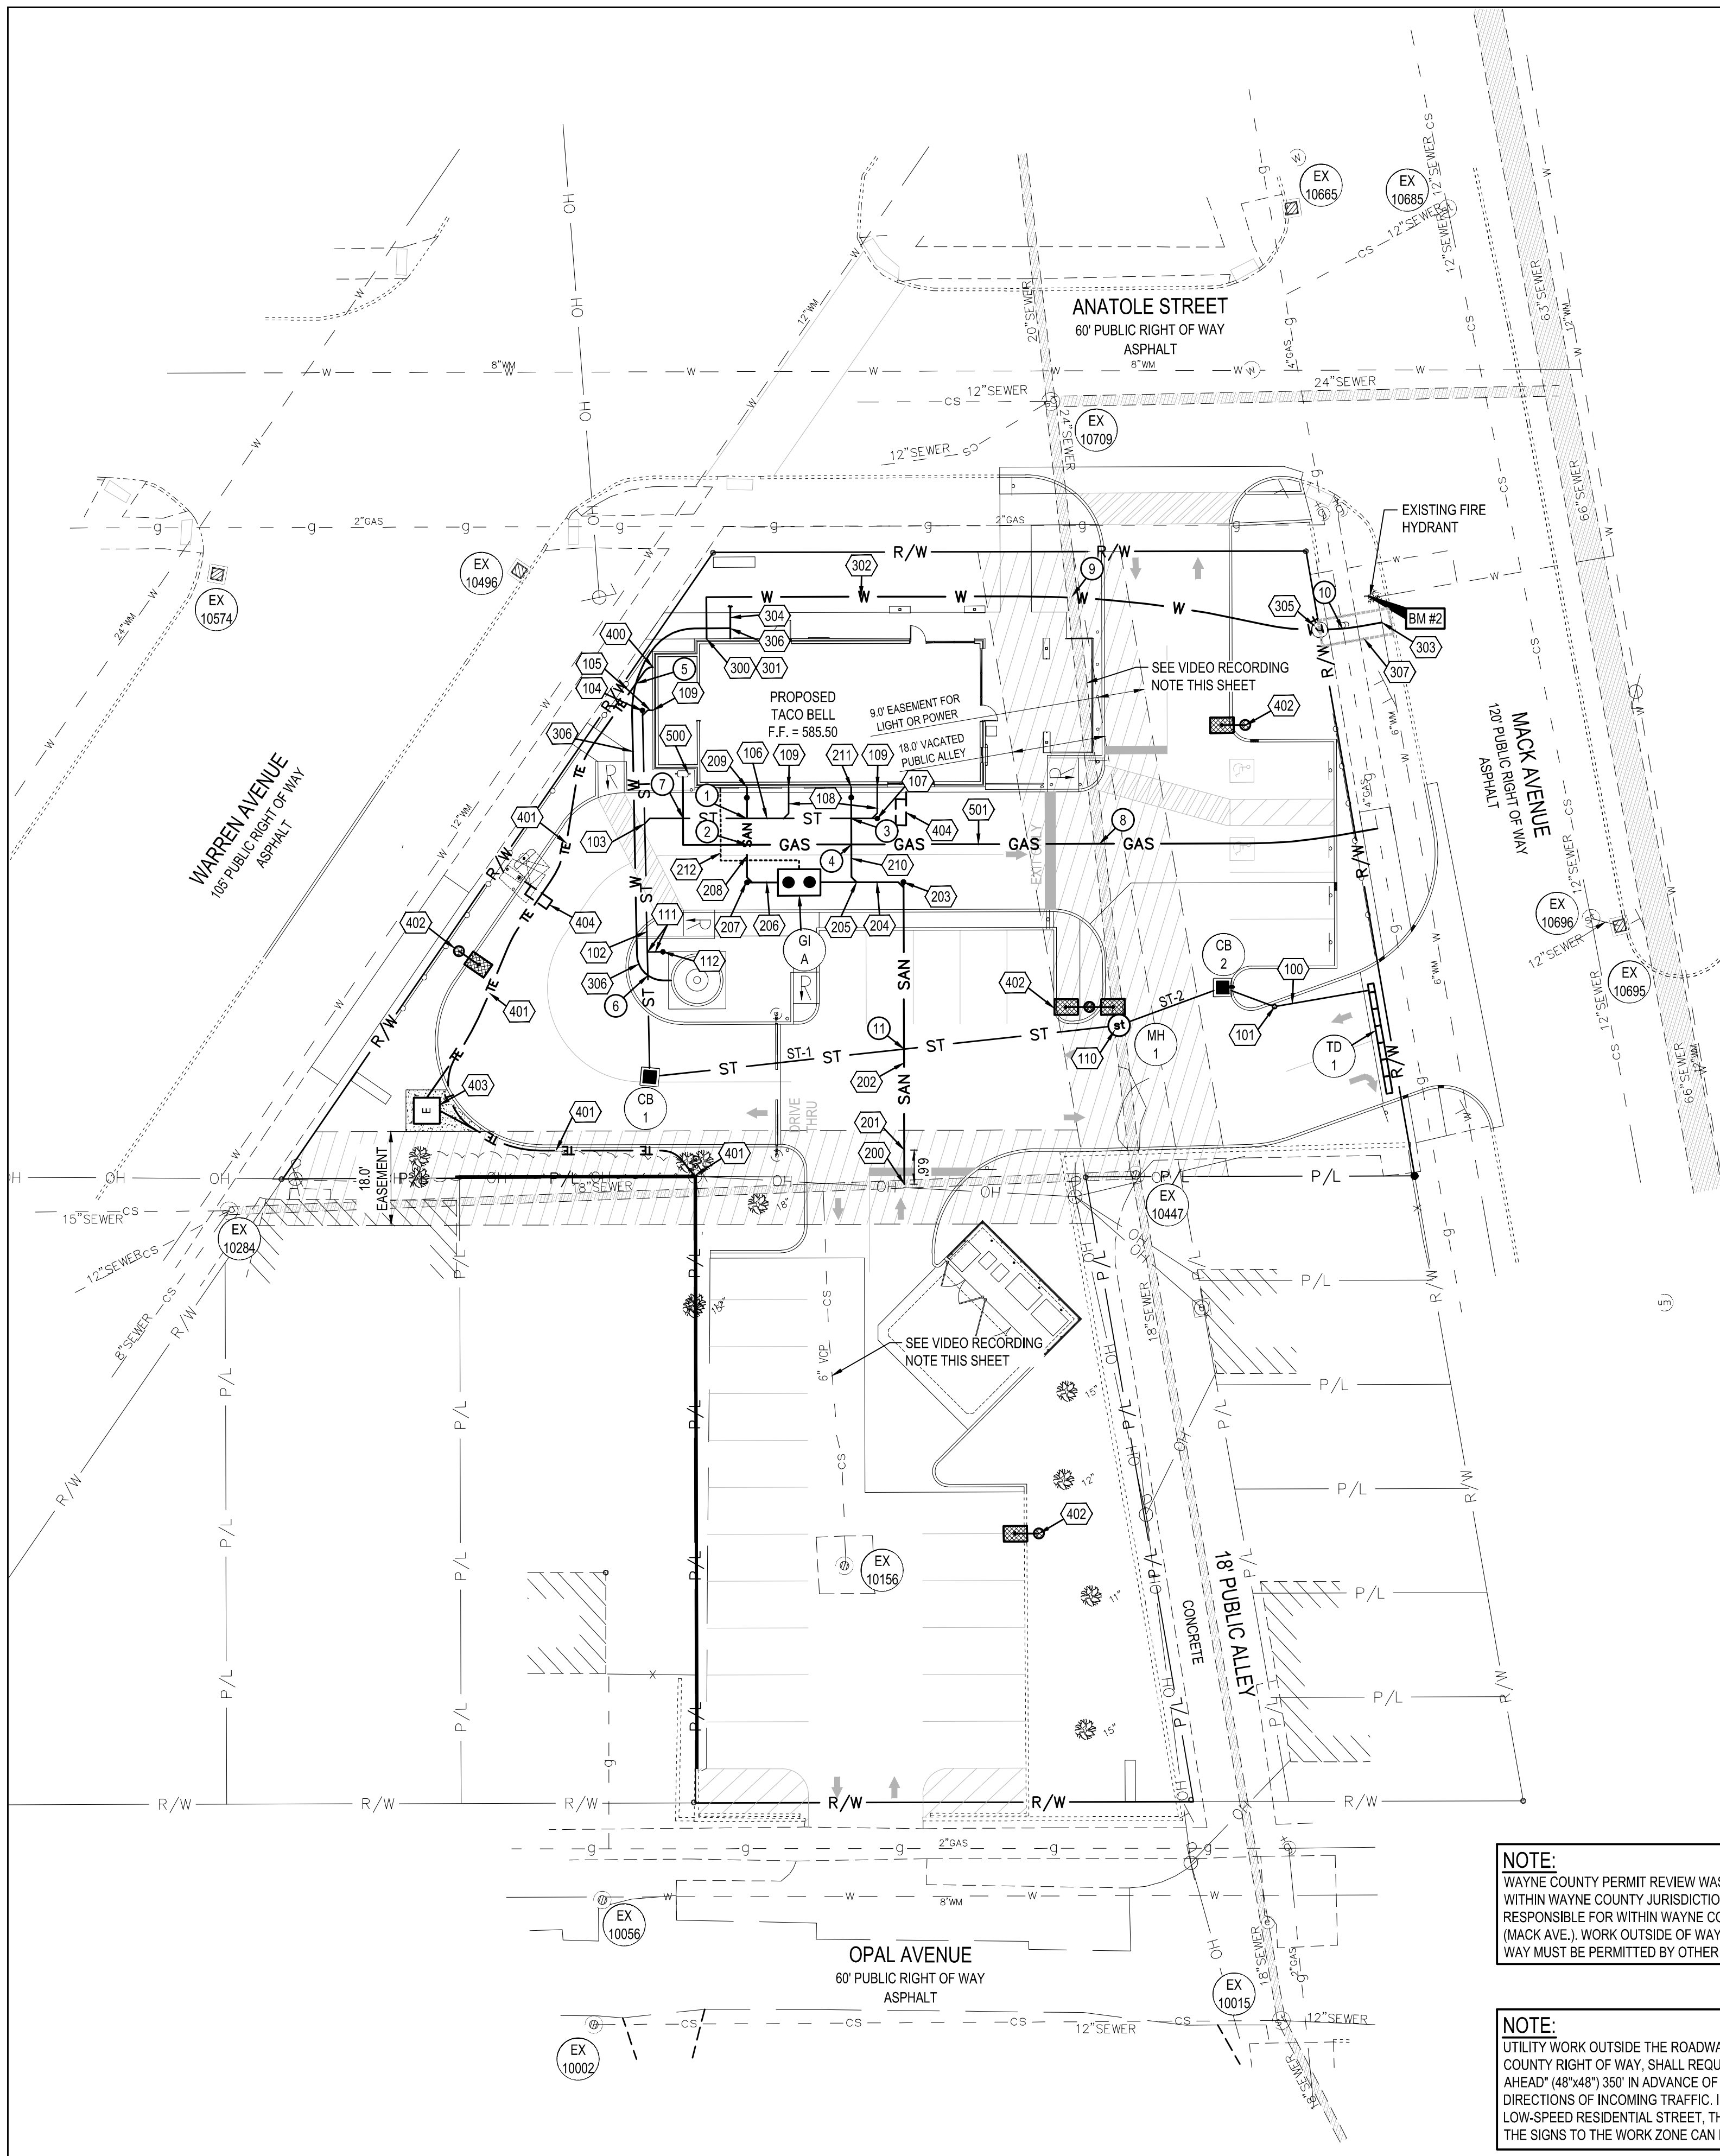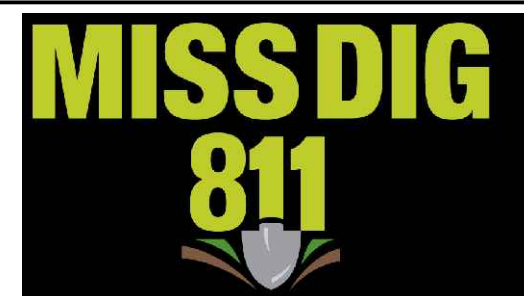


CONTRACTOR SHALL CLEAN EXISTING SEWER AND VIDEO RECORD EXISTING LINE PRIOR TO CONSTRUCTION FOR CONDITION. CONTRACTOR SHALL NOTIFY CONSTRUCTION MANAGER IMMEDIATELY IF CONDITION OF EXISTING SEWER IS IN POOR CONDITION.

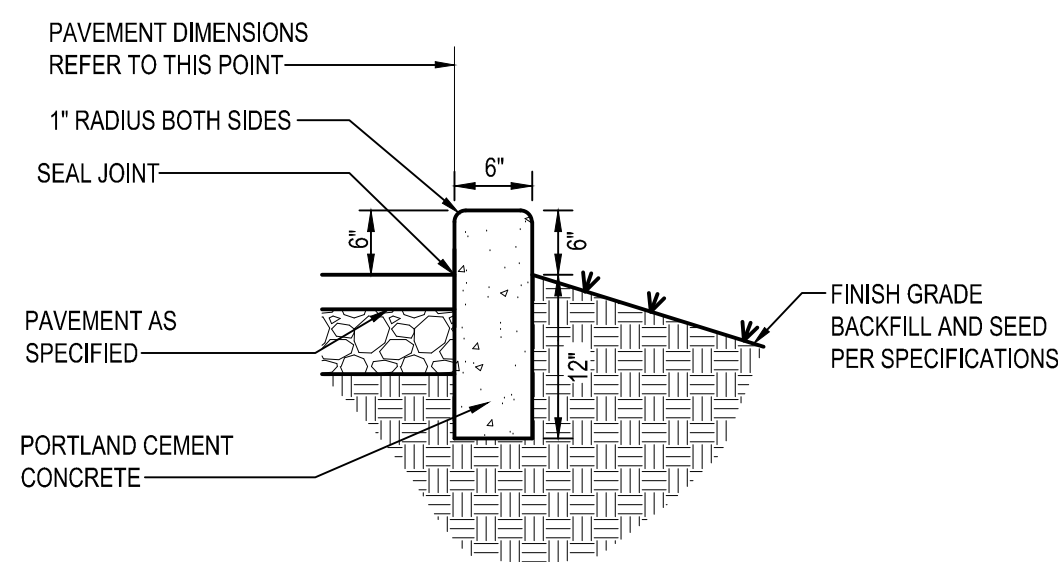

D1 FREESTANDING CONCRETE CURB
N.T.S.

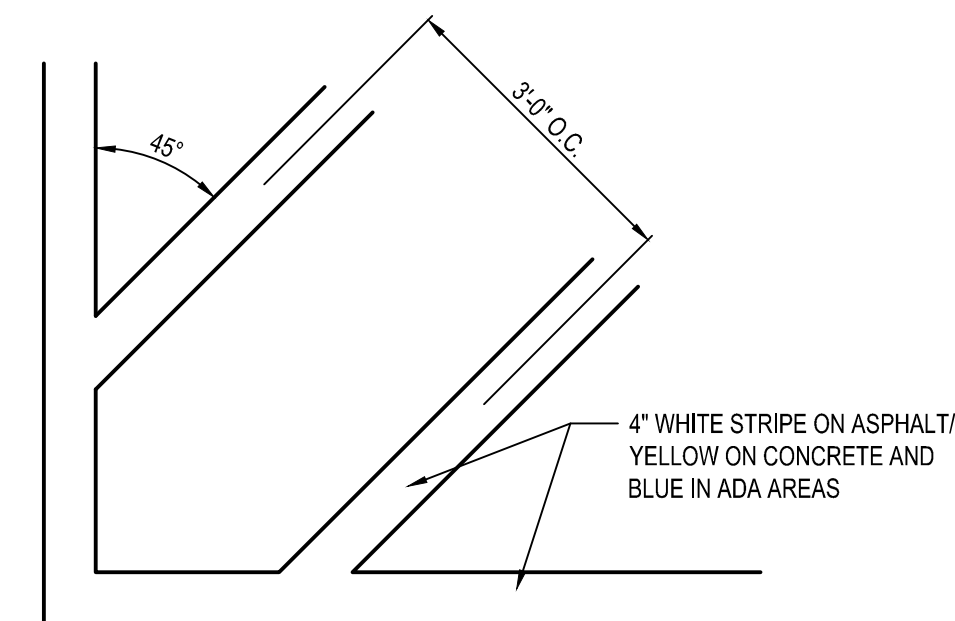

D2 TRANSVERSE STRIPING
N.T.S.

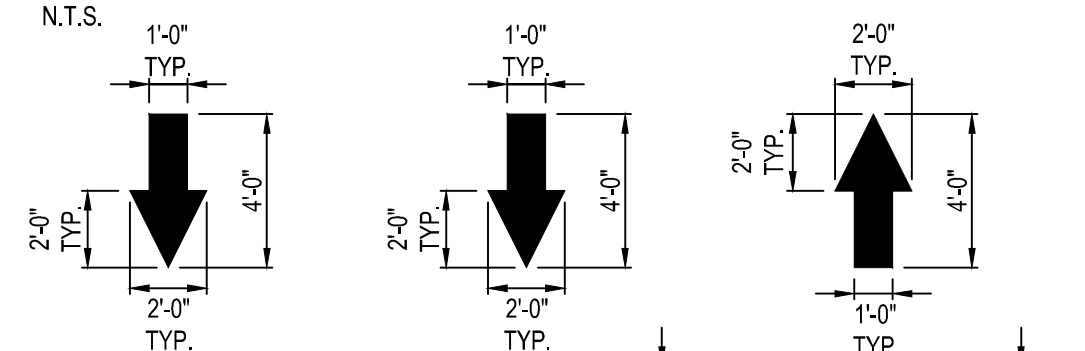

NOTES:
ALL PAVEMENT MARKINGS TO BE WHITE PAVEMENT PAINT, UNLESS STATED OTHERWISE. ALL PAVEMENT MARKINGS WITHIN ADA AREAS SHALL BE PAINTED BLUE EXCEPT FOR COLORS DEFINED ON THE ADA PAVEMENT SYMBOL.

MARKING (STRIPING) PAINT FOR PARKING SPACES, TRAFFIC ARROWS, ADA PARKING AND SYMBOLS, ETC., PER LOCAL REQUIREMENTS AND AS FOLLOWS:

PAVEMENT MARKINGS PAINT SHALL BE WATER BASE FAST DRYING 100% ACRYLIC TYPE. WATER BASE TO MEET FEDERAL SPECIFICATION TTP-01952B. FOR COLD WEATHER APPLICATION PAINT PRODUCT SHALL BE IN ACCORDANCE WITH ASTM-D2389, D1394, D3723, D1475, D562 AND D711


PROVIDE A NON-SLIP AGGREGATE ADDITIVE TO MARKING PAINT USED AT ADA ACCESS RAMPS.

APPLY 2 COATS WITH STRAIGHT EDGES, YELLOW ON CONCRETE/WHITE ON ASPHALT EXCEPT WHEN MATCHING ADJACENT OR EXISTING COLOR WHEN THE PAVING IS AN EXPANSION OR SEGMENT OF A LARGER LOT. CONTRACTOR SHALL APPLY THE SECOND COAT NO SOONER THAN 30 DAYS OF APPLYING THE FIRST COAT.


C2 PAVEMENT MARKINGS & NOTES
N.T.S.

KEYED NOTES


- 1 PAINT BACKGROUND BENJAMIN MOORE M58 SAFETY & ZONE MARKING LATEX M58-30 - BLUE
- 2 PAINT SYMBOL BENJAMIN MOORE M58 SAFETY & ZONE MARKING LATEX M58-01 - WHITE 4" WIDTH
- 3 BOTTOM EDGE OF SYMBOL BOX SHALL MATCH END OF STALL STRIPE AT DRIVE AISLE END OF STALL.

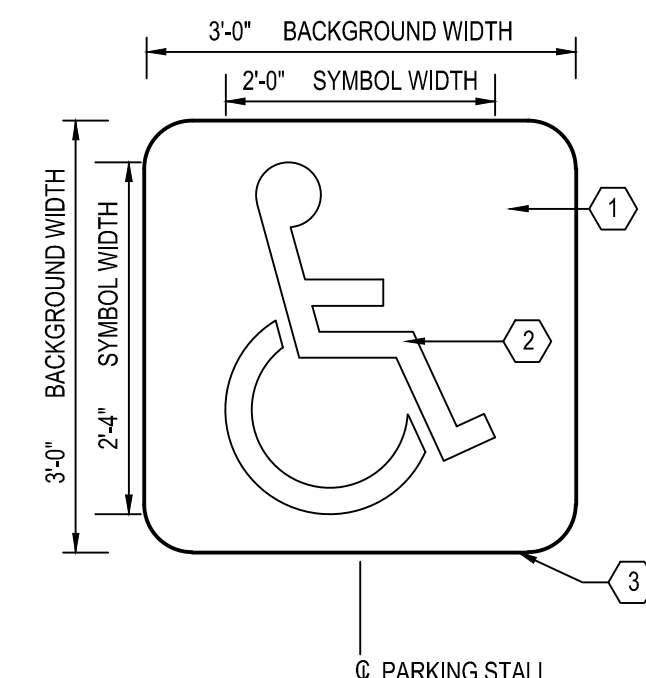

B2 ADA PAVEMENT SYMBOL
N.T.S.

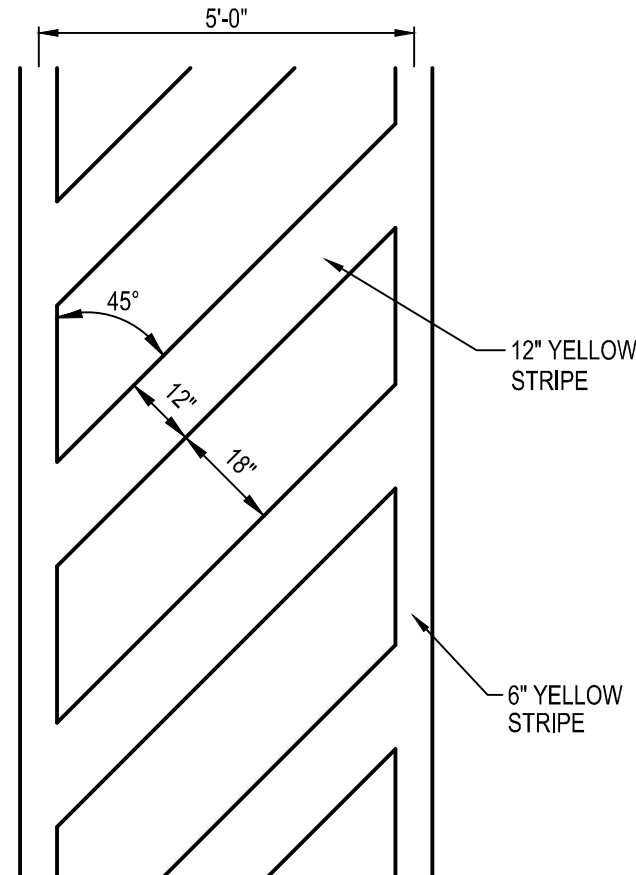


A2 CROSSWALK STRIPING
N.T.S.

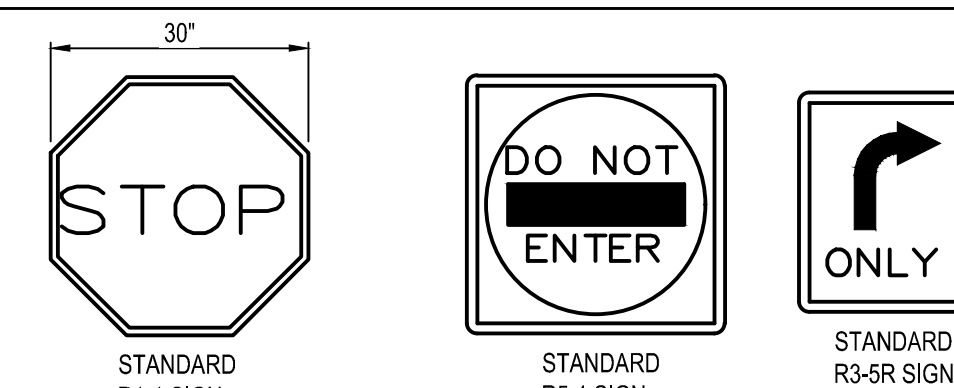


CONTRACTOR SHALL INSTALL SIGN PER MDT SPECIFICATIONS UNLESS NOTED OTHERWISE.

NOTE
1. ALL SIGNS NOTED SHALL CONFORM TO THE LATEST MDT SPECIFICATIONS.

D3 TRAFFIC SIGNS
N.T.S.

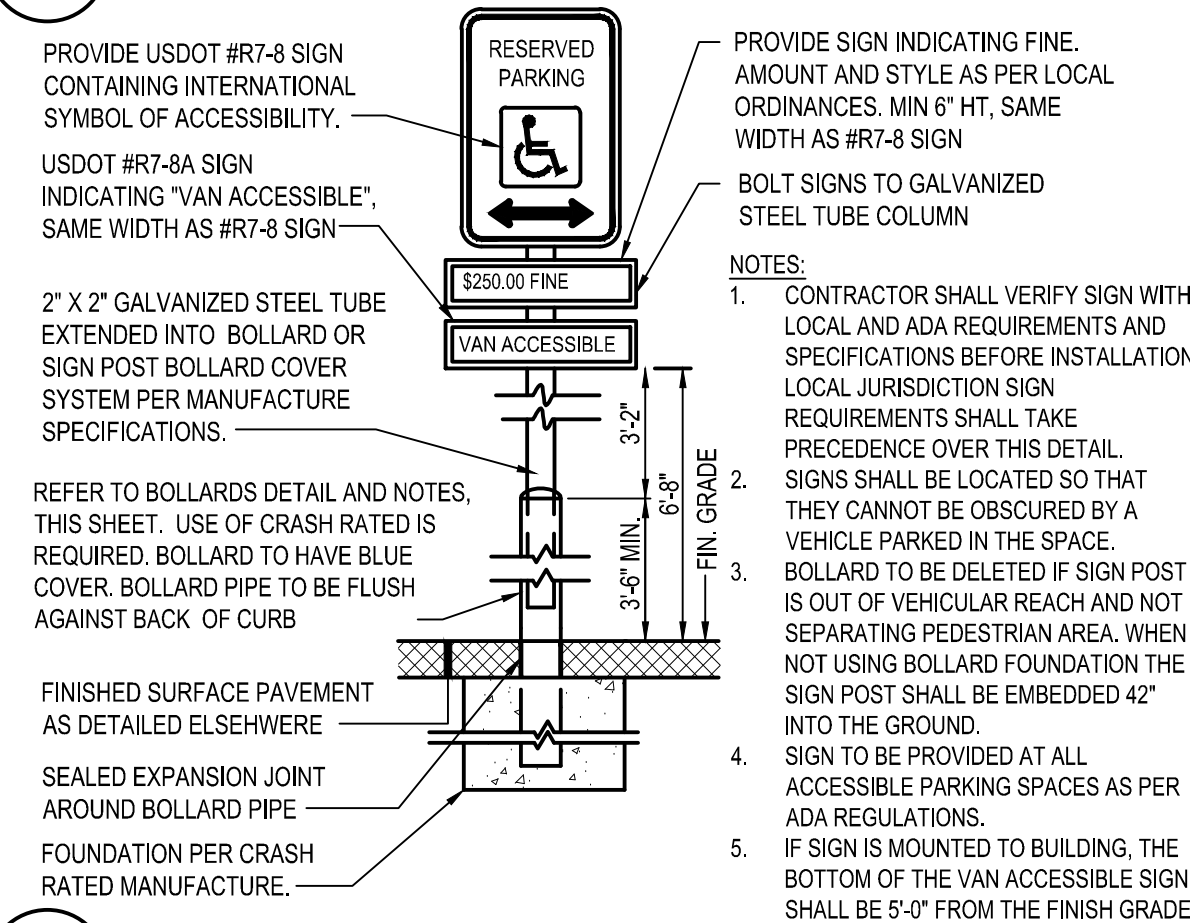

C3 HANDICAPPED PARKING SIGN
N.T.S.

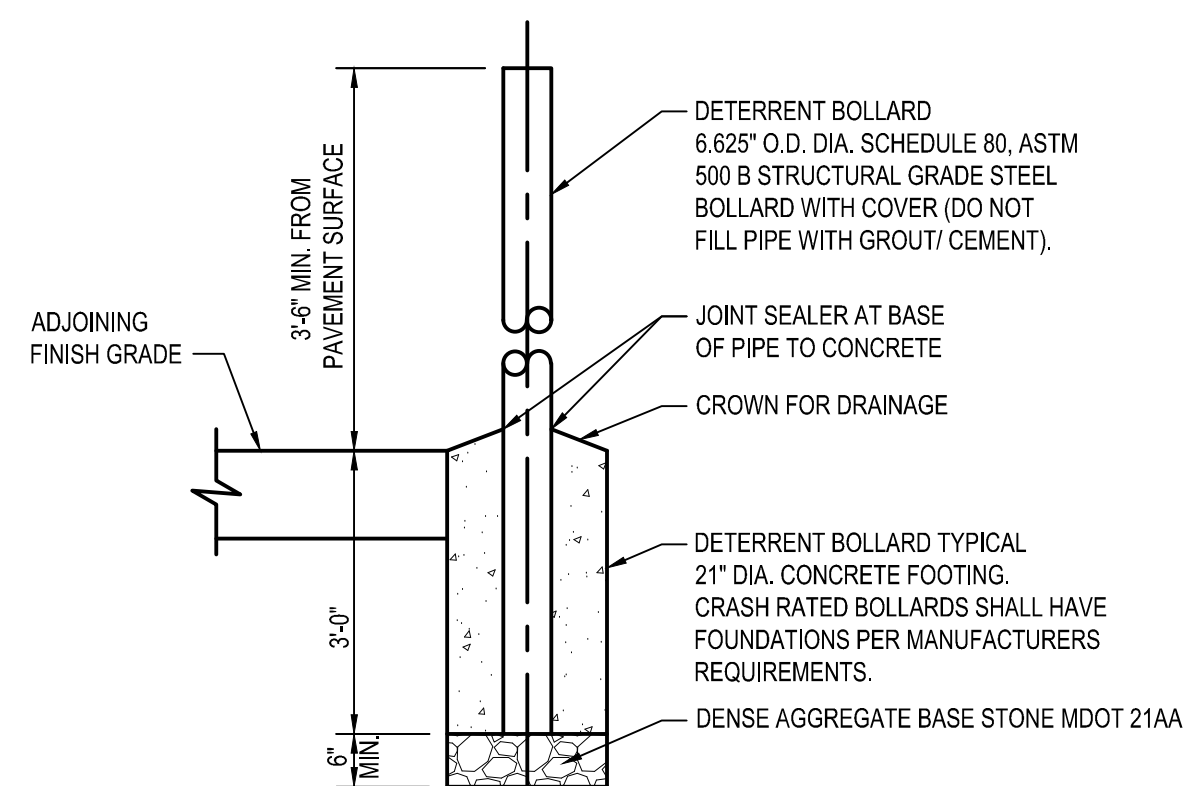


DETERRENT BOLLARD NOTES:
1. CONTRACTOR SHALL UTILIZE GALVANIZED COATED OR FULLY PAINT STEEL PIPE WITH AN EXTERIOR RUST INHIBITIVE PAINT PRIOR TO INSTALLATION AND TOUCH UP AFTER INSTALLATION SUCH AS SHERWIN-WILLIAMS MACROPOXY 646 FAST CURE (SS8W610), IN ACCORDANCE WITH MANUFACTURERS PREPARATION REQUIREMENTS. PROVIDE A YELLOW (BLUE FOR ADA) BOLLARD COVER SUCH AS A STREET SMART SOLUTIONS POST GUARD, DOME-TOP COVER BY US-POSTMAN.COM OR APPROVED EQUAL.

CRASH-RATED BOLLARD NOTES
2. WHERE BOLLARDS ARE SEPARATING PEDESTRIANS / STOREFRONTS AND VEHICLES THE CONTRACTOR SHALL INSTALL A CRASH RATED BOLLARD AND FOOTING PER ASTM F3018/3018M. TYPICAL CLEAR SPACING OF 60" WITH AN ANTICIPATED S20 RATINGS FOR BIDDING PURPOSES - FINAL SPACING AND RATING SHALL BE IN ACCORDANCE WITH ASTM AND THE MANUFACTURERS REQUIREMENTS FOR PROPOSED LOCATIONS AND POSSIBLE VEHICLE APPROACH SPEED. THE NOTED ASTM CRASH RATED PRODUCT SUCH AS, BUT NOT LIMITED TO, CRASHCORE BOLLARD BY MCCUE.COM OR APPROVED CRASH RATED EQUIVALENT SHALL BE UTILIZED IN ACCORDANCE WITH MANUFACTURE SPECIFICATIONS. INSTALLER / CONTRACTOR SHALL BE OR BECOME CERTIFIED INSTALLERS, CONTACT MANUFACTURER(S) FOR DETAILS.


3. CRASH RATED BOLLARDS NEXT TO PATIO AREA SHALL BE STAINLESS STEEL. CONTRACTOR SHALL COORDINATE WITH CONSTRUCTION MANAGER PRIOR TO PURCHASING.

A3 BOLLARDS
N.T.S.

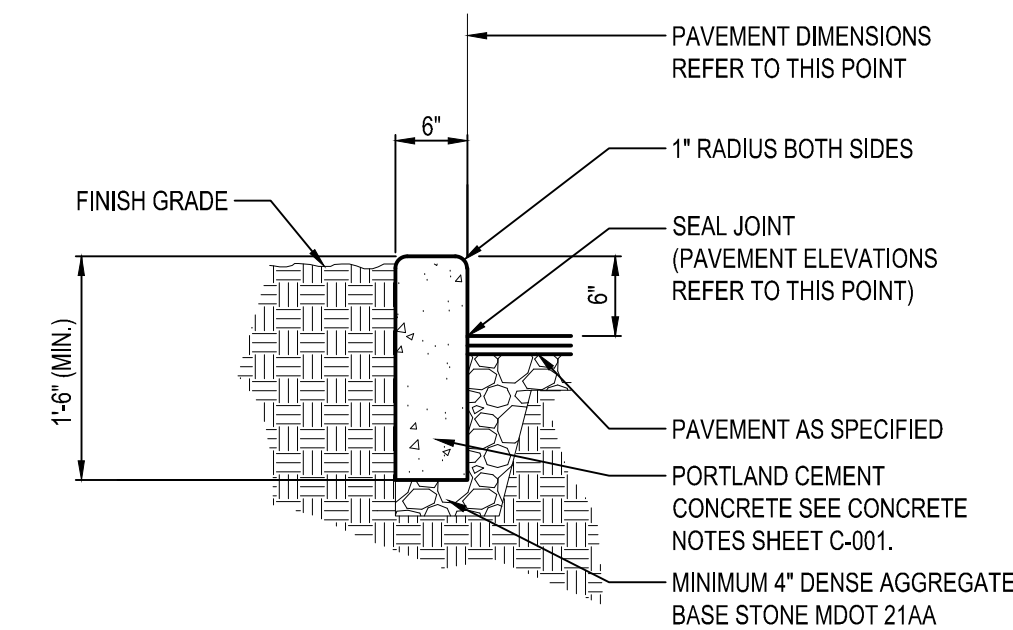


NOTE:
1. CONTRACTOR SHALL INSTALL 1/2" PRE-FORMED EXPANSION JOINT MATERIAL AND JOINT SEALER WHERE CURBING ABUTS THE EXISTING WALL.

D4 CONCRETE CURB
N.T.S.

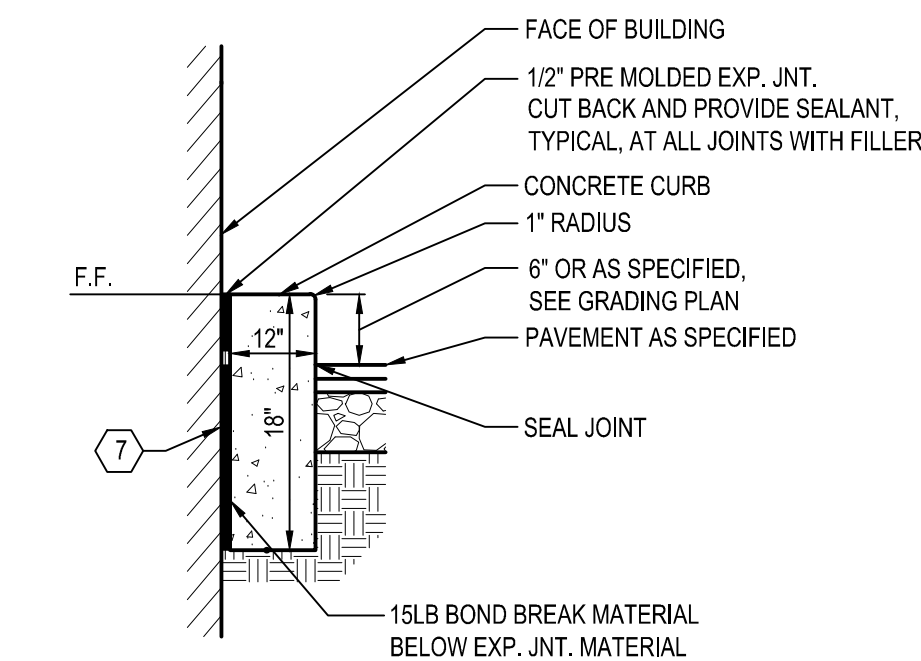


C4 CONCRETE CURB AT DRIVE THRU
N.T.S.

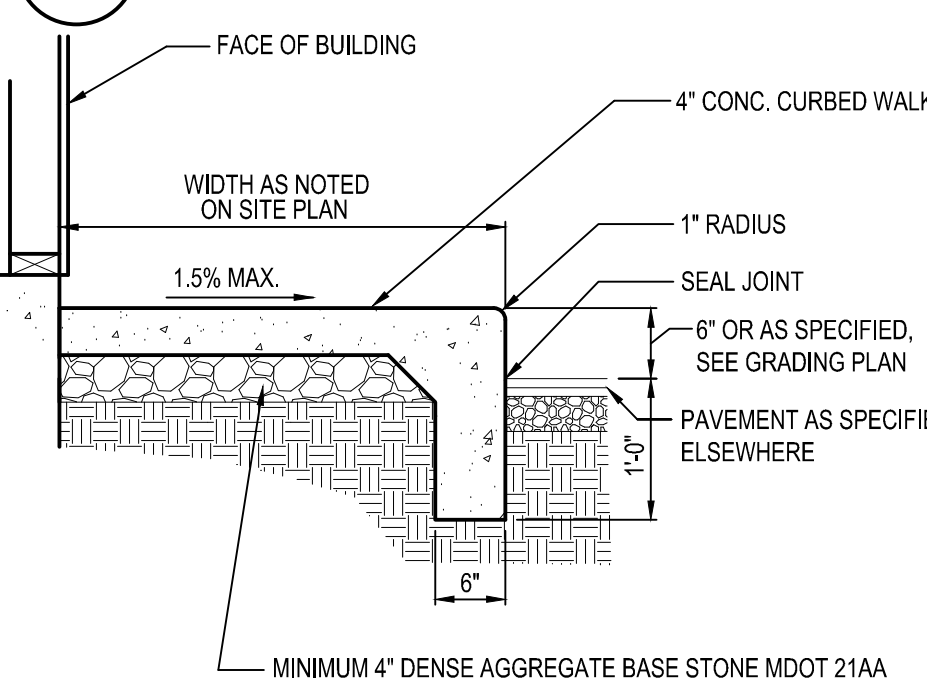

NOTES:
1. CONTRACTOR SHALL INSTALL 1/2" PRE-FORMED EXPANSION JOINT MATERIAL AND JOINT SEALER WHERE PAVEMENT ABUTS BUILDING.
2. SEE CONCRETE NOTES SHEET C-001 FOR FIBER REINFORCEMENT NOTES.


B4 CONCRETE CURBED WALK
N.T.S.

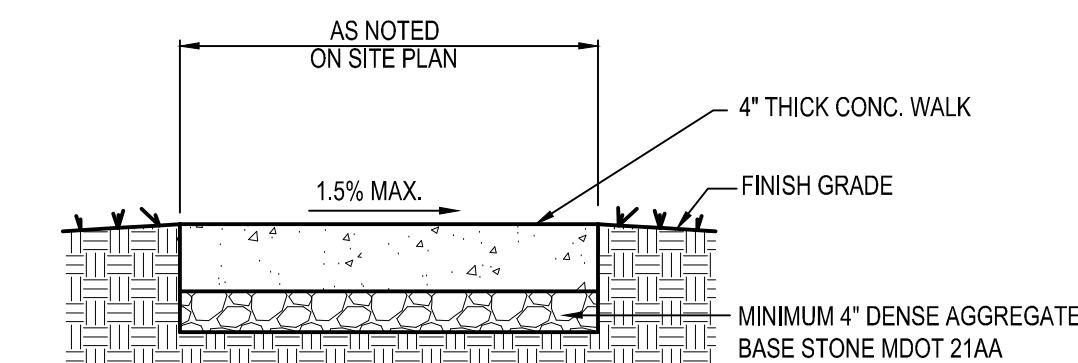

NOTES:
1. CONTRACTOR SHALL INSTALL 1/2" PRE-FORMED EXPANSION JOINT MATERIAL AND JOINT SEALER WHERE PAVEMENT ABUTS BUILDING.
2. SEE CONCRETE NOTES SHEET C-001 FOR FIBER REINFORCEMENT NOTES.


A4 CONCRETE WALK
N.T.S.

A3 1' CURB TAPER
N.T.S.

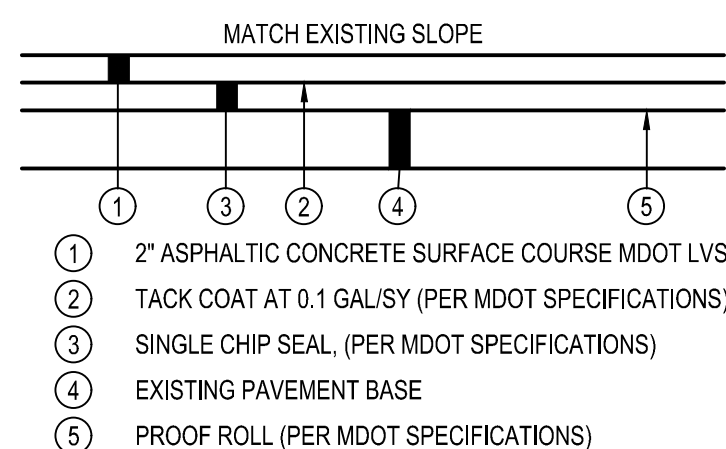

NOTES:
1. CONTRACTOR SHALL MILL DOWN EXISTING ASPHALT PAVEMENT 2" PER MDT SPECIFICATIONS BEFORE CONSTRUCTION OF RESURFACED TYPICAL SECTION.
2. PREPARED BASE SURFACE SHALL BE CLEAN AND FREE OF ANY LOOSE DEBRIS.
3. USE AIR COMPRESSOR (100 PSI MIN.) TO THOROUGHLY CLEAN ALL CRACKS PRIOR TO CHIP SEAL. PAVEMENT SHALL BE SWEEPED AFTER CRACKS HAVE BEEN CLEAN OUT.
4. APPLY LIQUID ASPHALT AT ALL JOINTS BETWEEN CONCRETE AND ASPHALT AND WHERE PROPOSED ASPHALT MEETS EXISTING ASPHALT INCLUDING SAW CUT JOINTS PER MDT SPECIFICATIONS.
5. CONTRACTOR SHALL MILL ALL PAVEMENT EDGES TO PROVIDE SMOOTH BUTT JOINT TRANSITIONS TO EXISTING PAVEMENT.
6. NO RECYCLE MATERIAL SHALL BE PERMITTED IN ASPHALT SURFACE COURSE. SHALL BE 100% VIRGIN LIMESTONE MIX.

A2 TYPICAL ASPHALT OVERLAY SECTION
N.T.S.

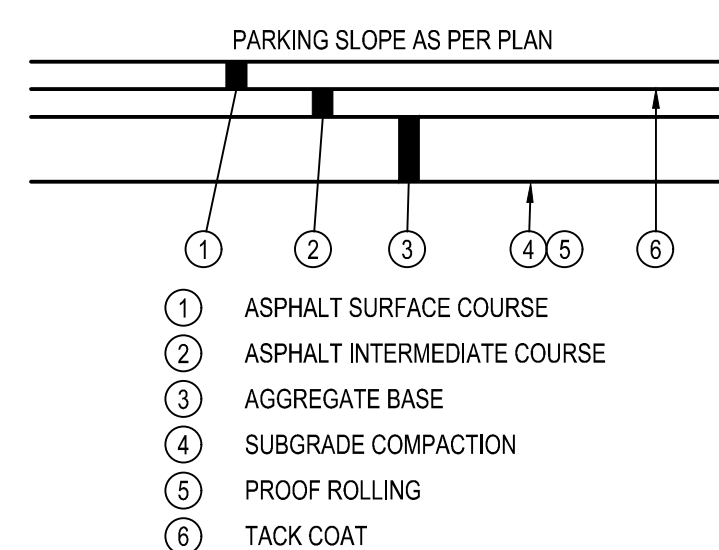

NOTES:
1. APPLY LIQUID ASPHALT AT ALL JOINTS BETWEEN CONCRETE AND ASPHALT AND WHERE PROPOSED ASPHALT MEETS EXISTING ASPHALT INCLUDING SAW CUT JOINTS.
2. SEE SITE PLAN FOR PAVEMENT THICKNESSES.
3. NO RAP SHALL BE PERMITTED IN ASPHALT SURFACE COURSE.

A1 TYPICAL ASPHALT PAVEMENT SECTION
N.T.S.

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAP/M: SM
DRAWN BY.: RS
JOB NO.: 2020088.03




TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
SITE DETAILS

C-501




PLOT DATE:

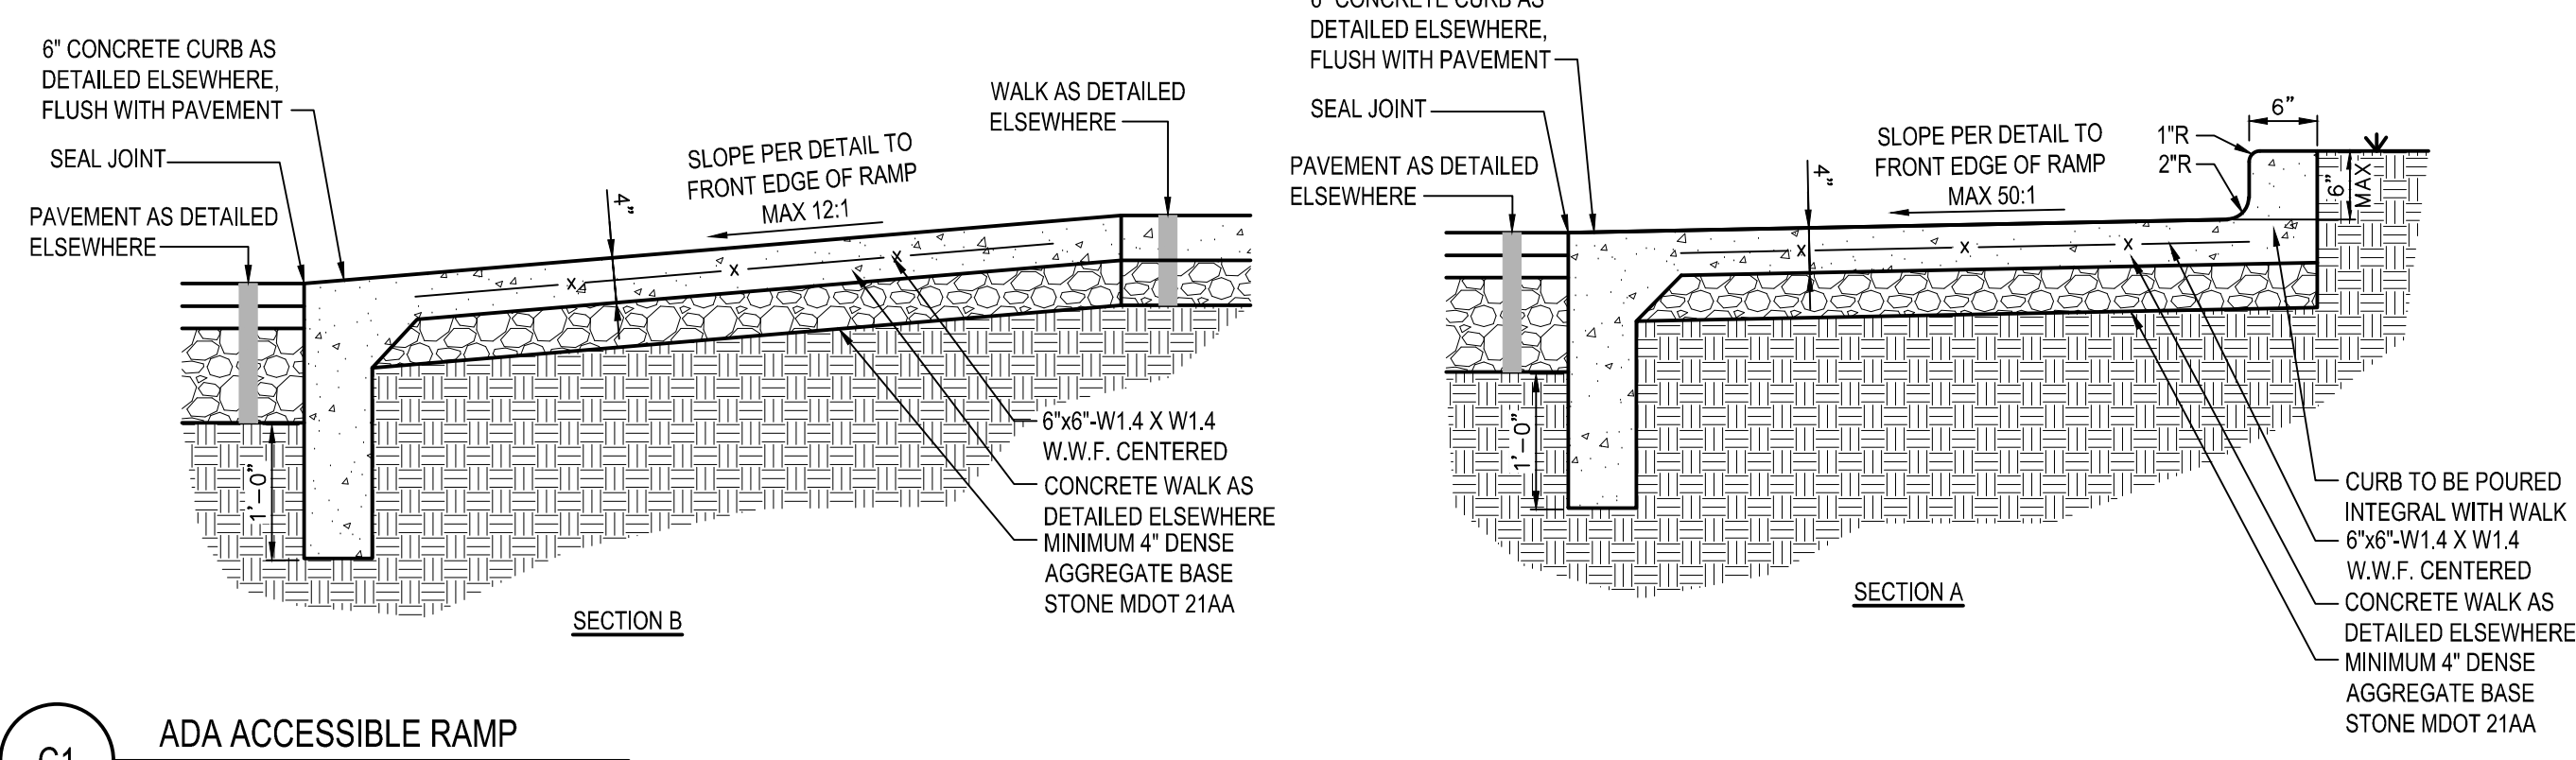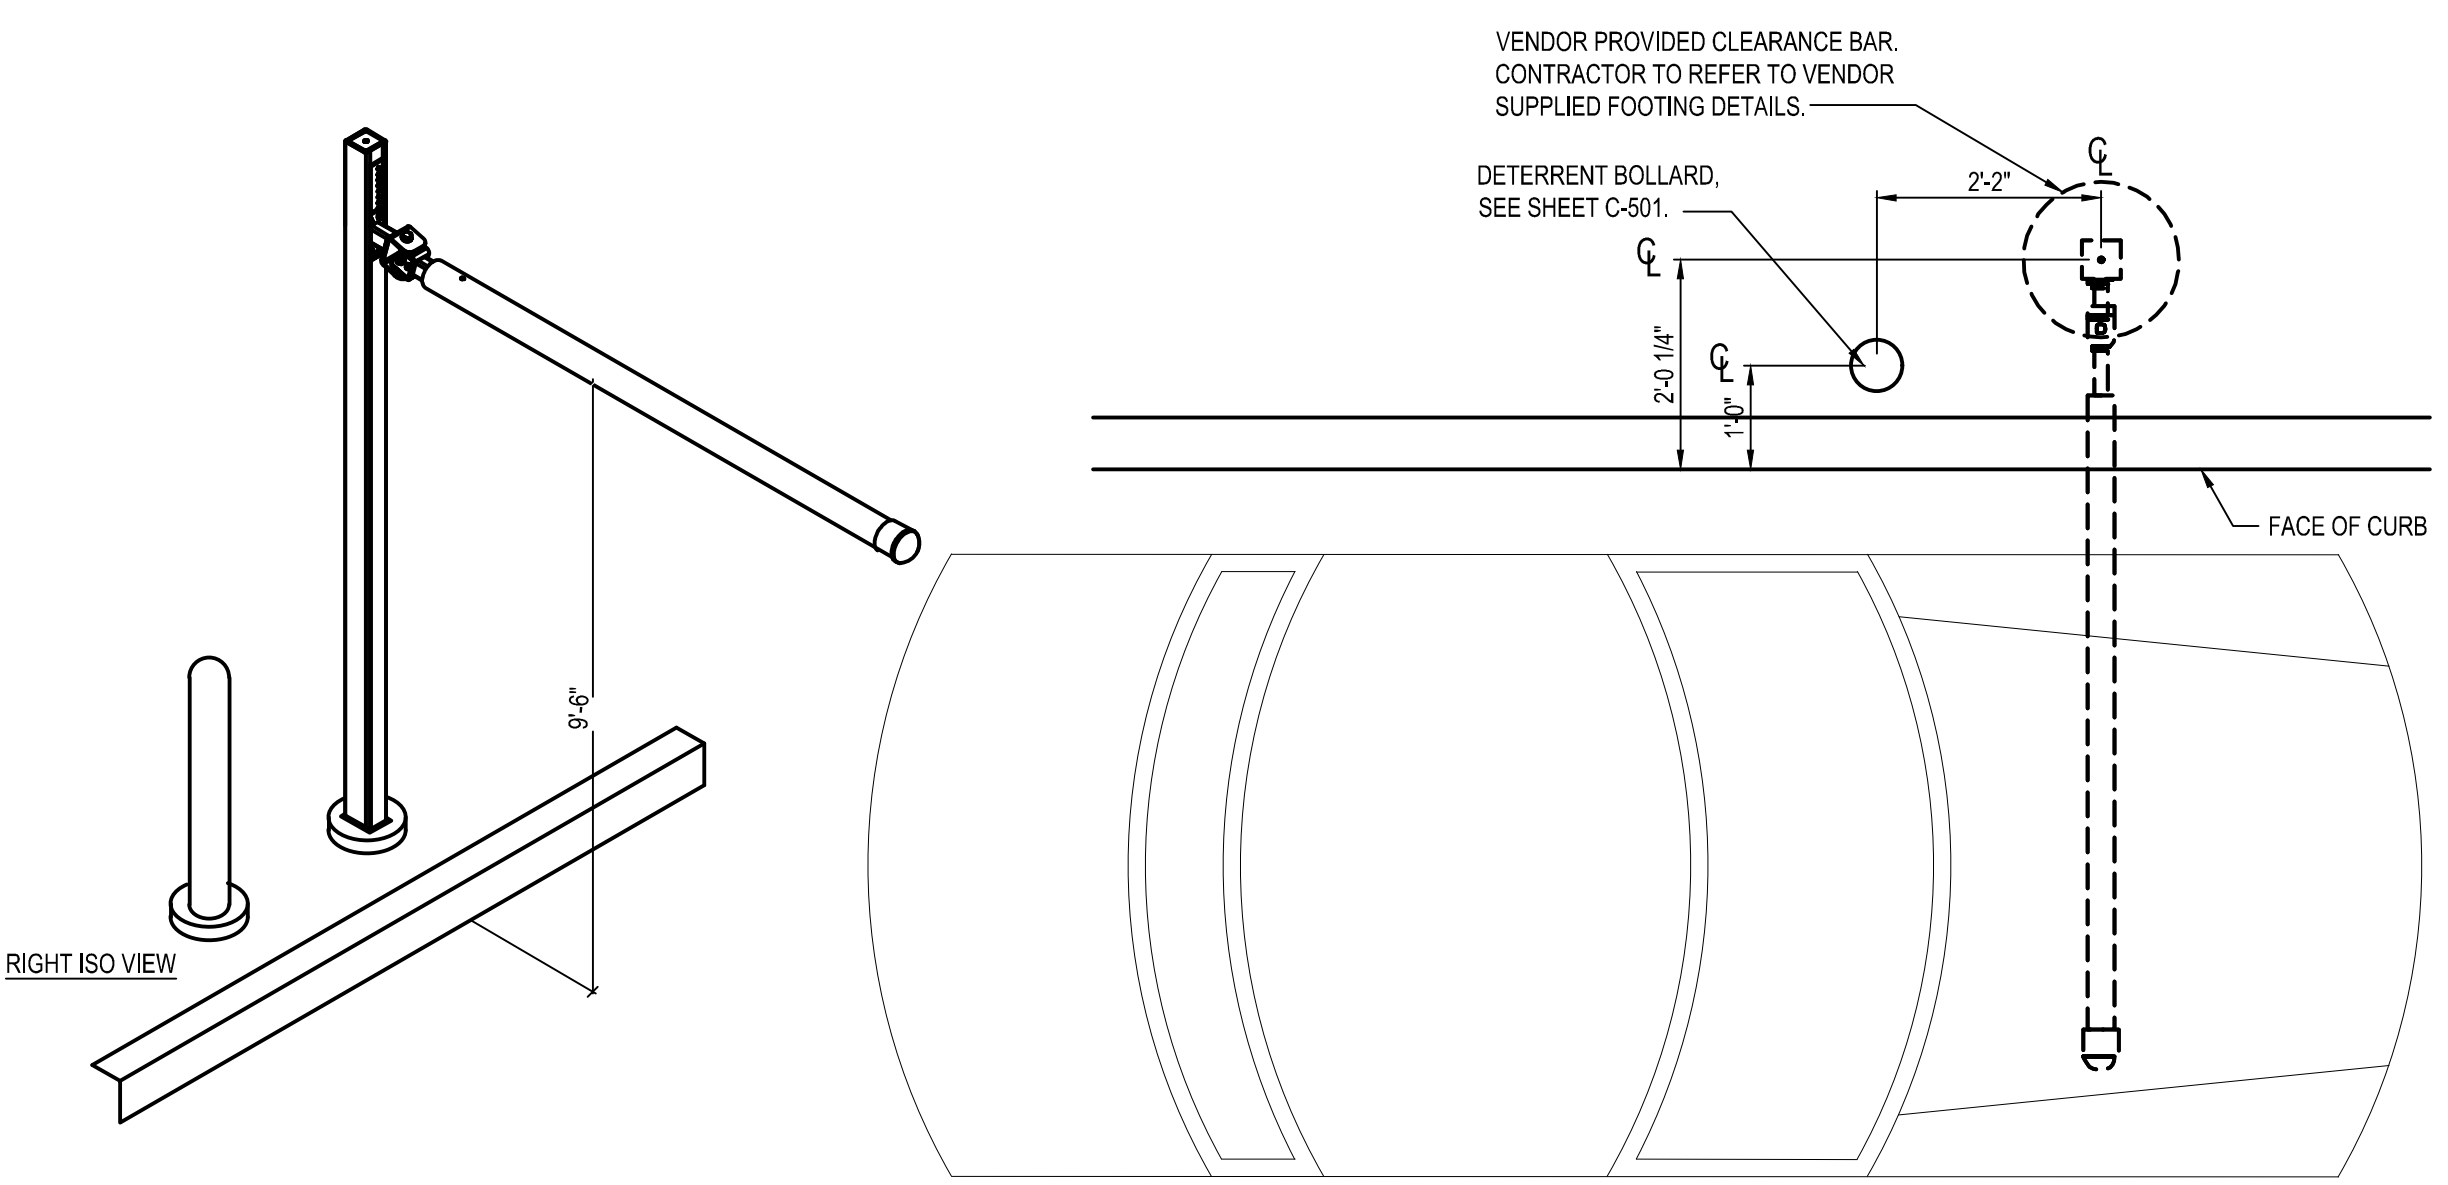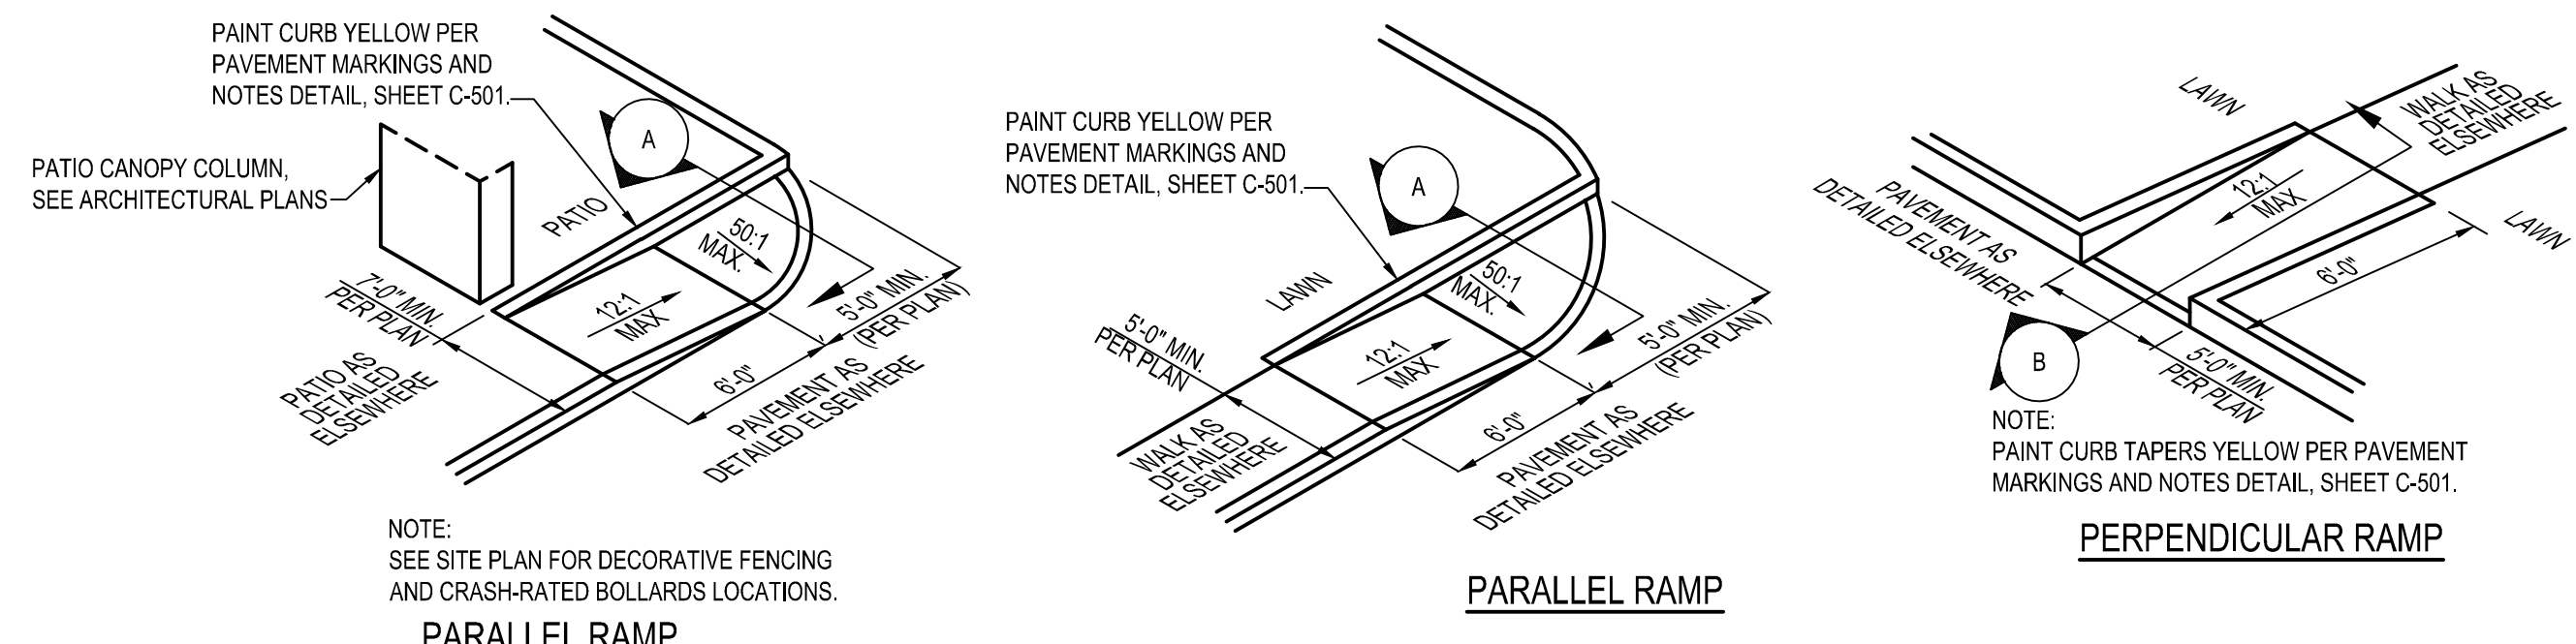

- SOW FOR DMB INSTALL AND VENDORS**
- RSCS TO SUPPLY DMB AND CABLE.
 - SIGN VENDOR TO SUPPLY ANCHOR BOLTS AND BOLT PATTERN TO GC.
 - SITE SURVEY - SIGN VENDOR.
- REMODEL (SUCCESSOR MANDATORY - MIDTERM OPTIONAL FOR FZ)**
- TRENCHING/ CONDUIT - GC.
 - FORMING/ FOUNDATION/ ANCHOR BOLTS - GC.
 - DMB INSTALL - SIGN VENDOR.
 - DMB CABLE PULL - SIGN VENDOR.
 - DMB FINAL CONNECTION AND SYSTEM CHECK - SIGN VENDOR.
 - ELECTRICAL - PULL BY GC - DEDICATED CIRCUIT.
- JUST DMB INSTALL**
- PERMITTING - SIGN VENDOR.
 - EXISTING FOOTING (SKIP TO STEP 4) - SIGN VENDOR.
 - TRENCHING/ CONDUIT - SIGN VENDOR.
 - FORMING/ FOUNDATION/ ANCHOR BOLTS (SKIP TO STEP 5) - SIGN VENDOR.
 - ANCHOR BOLTS - SIGN VENDOR.
 - DIGITAL MD INSTALL - SIGN VENDOR.
 - DMB CABLE PULL - SIGN VENDOR.
 - DMB FINAL CONNECTION AND SYSTEM CHECK - SIGN VENDOR.

	REMODEL	NEW BUILDING	RETROFIT
FOUNDATION IS FURTHER THAN 6'	RECOMMEND NEW FOUNDATION WORK FOUNDATION PERFORMED BY GC	N/A	RECOMMEND NEW FOUNDATION WORK PERFORMED BY GC
USING EXISTING FOUNDATION (ALTHOUGH NOT RECOMMENDED)	-	N/A	-
INTEGRATED CANOPY EXISTS	-	N/A	-
BOLLARDS NEEDED - DO NOT PLACE IN FRONT OF MENUBOARD	WORK PERFORMED BY SIGNAGE INSTALLER	WORK PERFORMED BY SIGNAGE INSTALLER	WORK PERFORMED BY SIGNAGE INSTALLER

B3 MENU BOARD SOW
N.T.S.

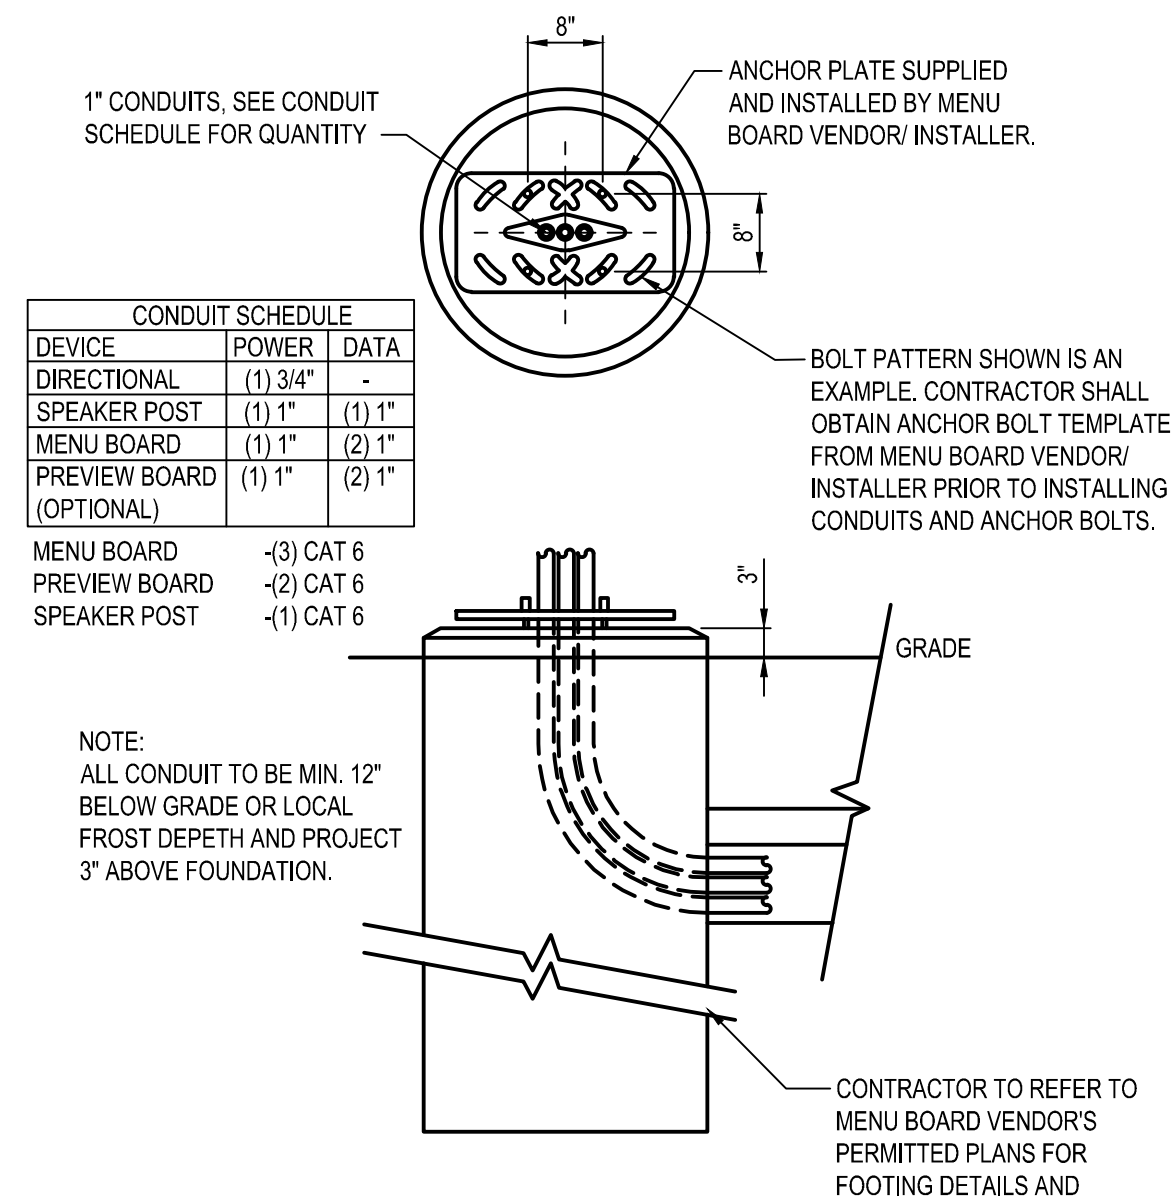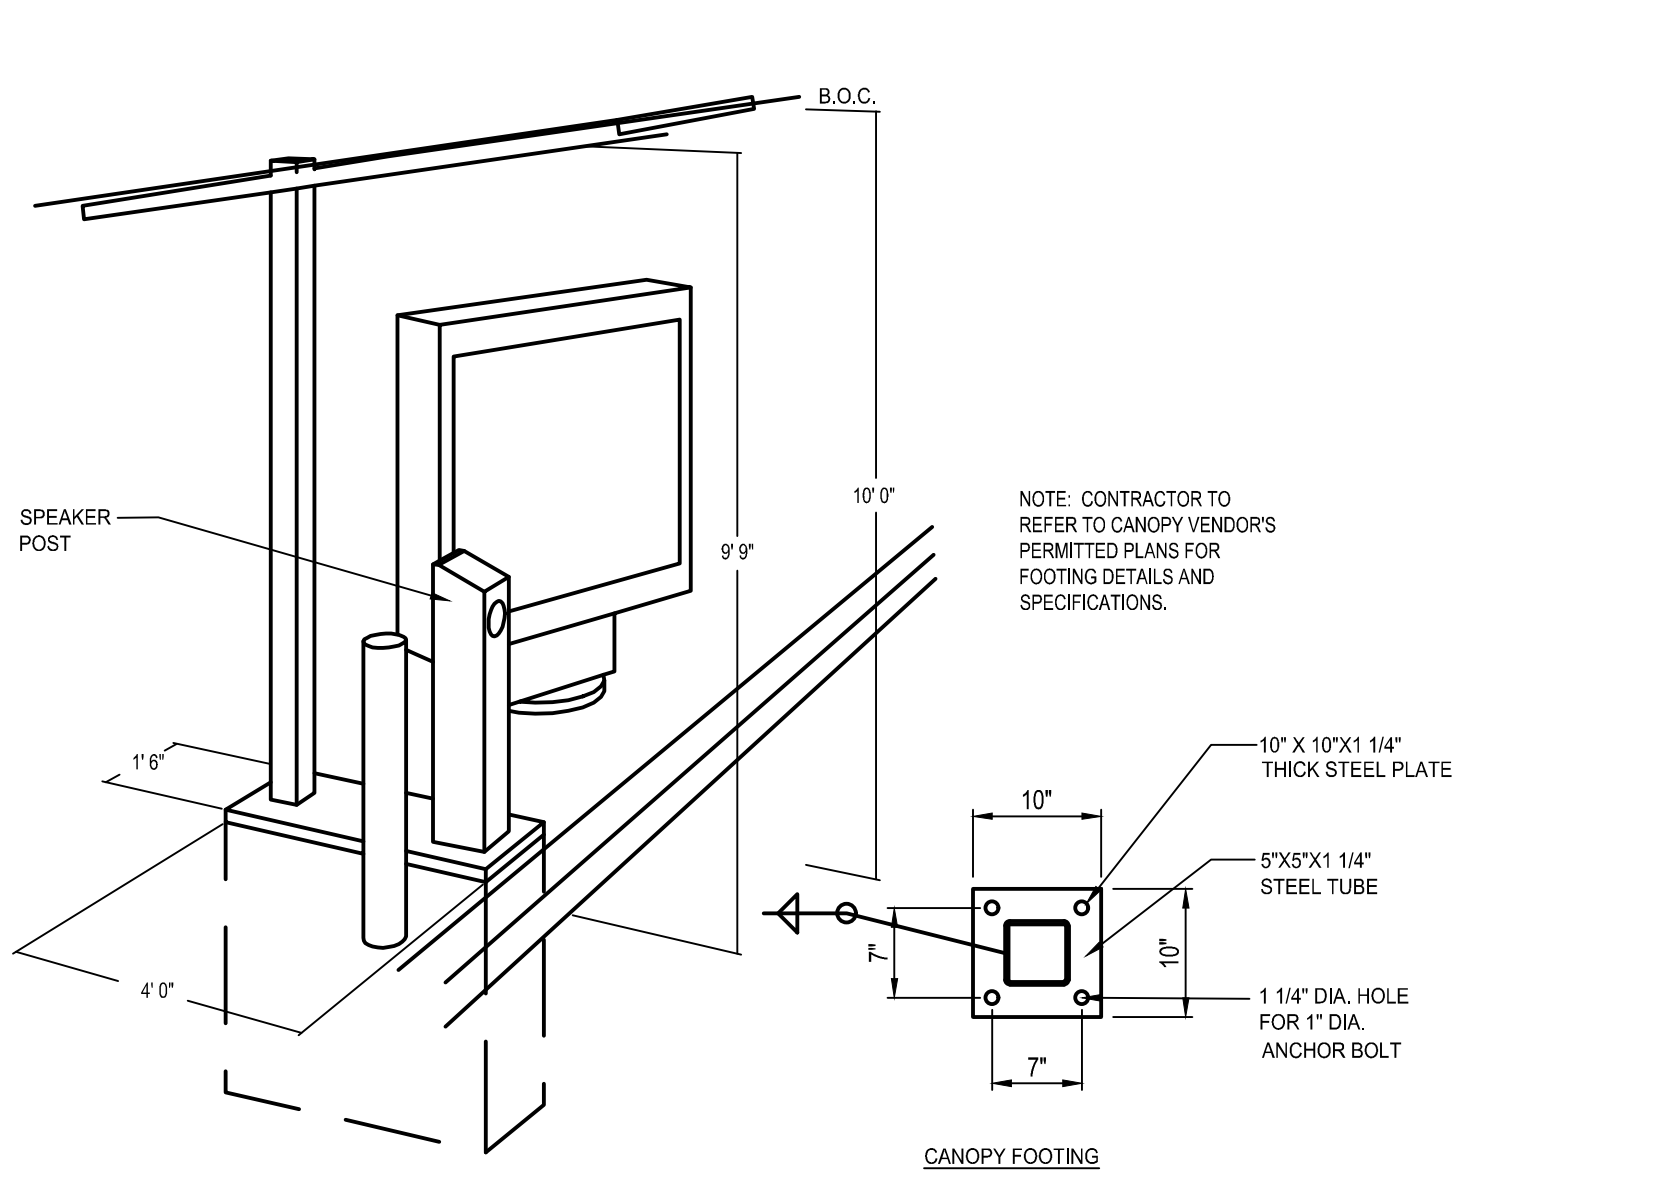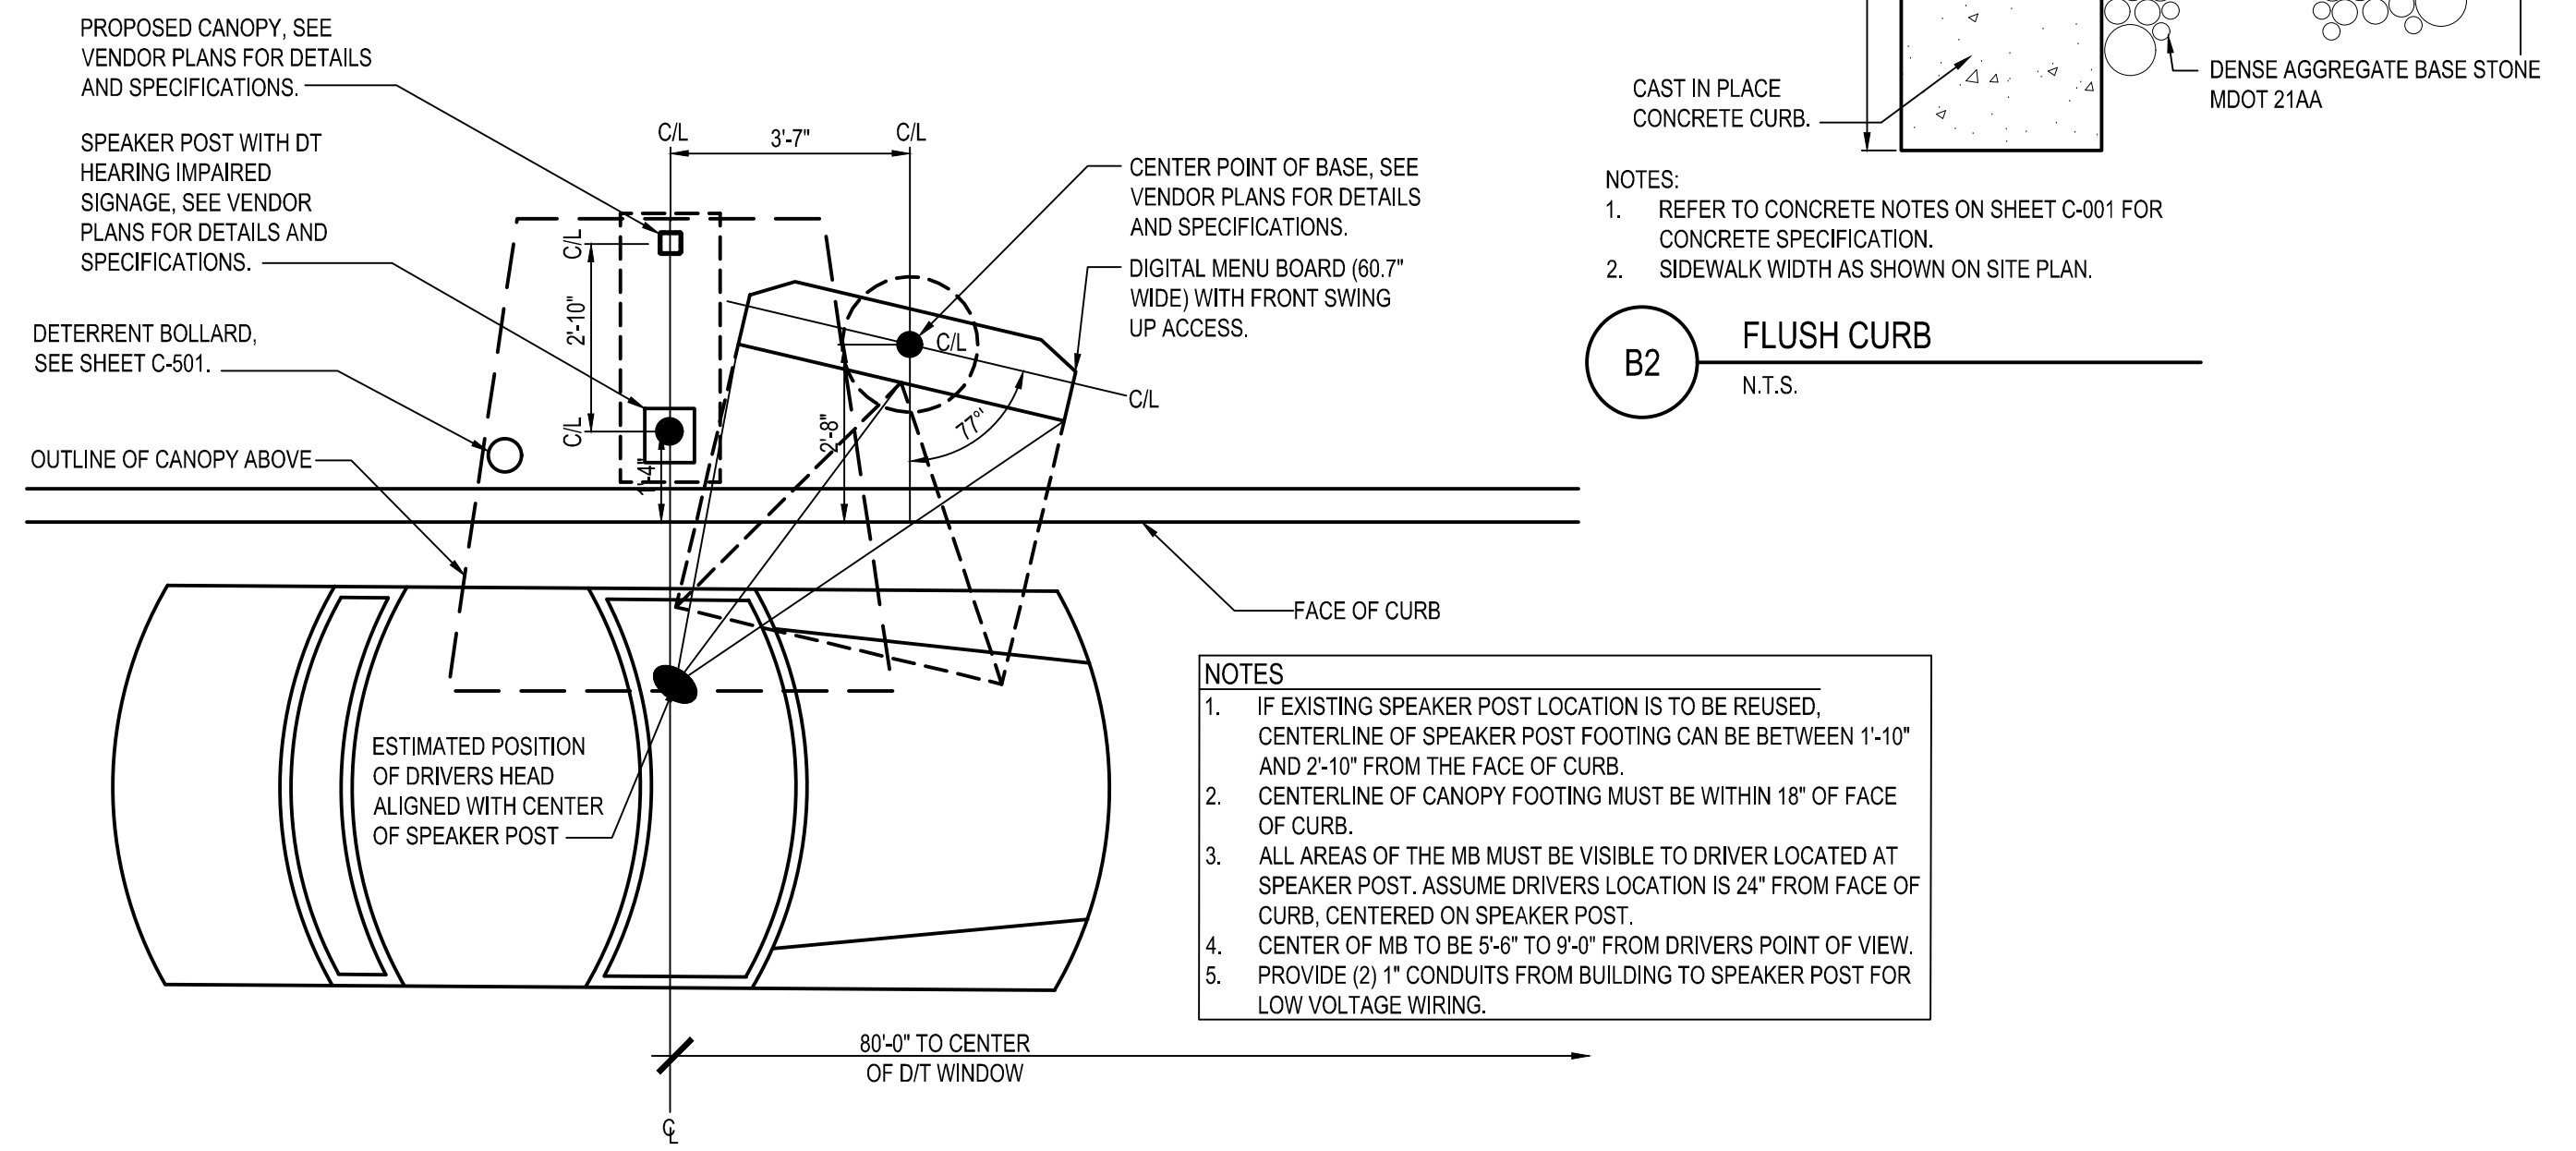

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAP/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0
SITE DETAILS

C-502

PLOT DATE:

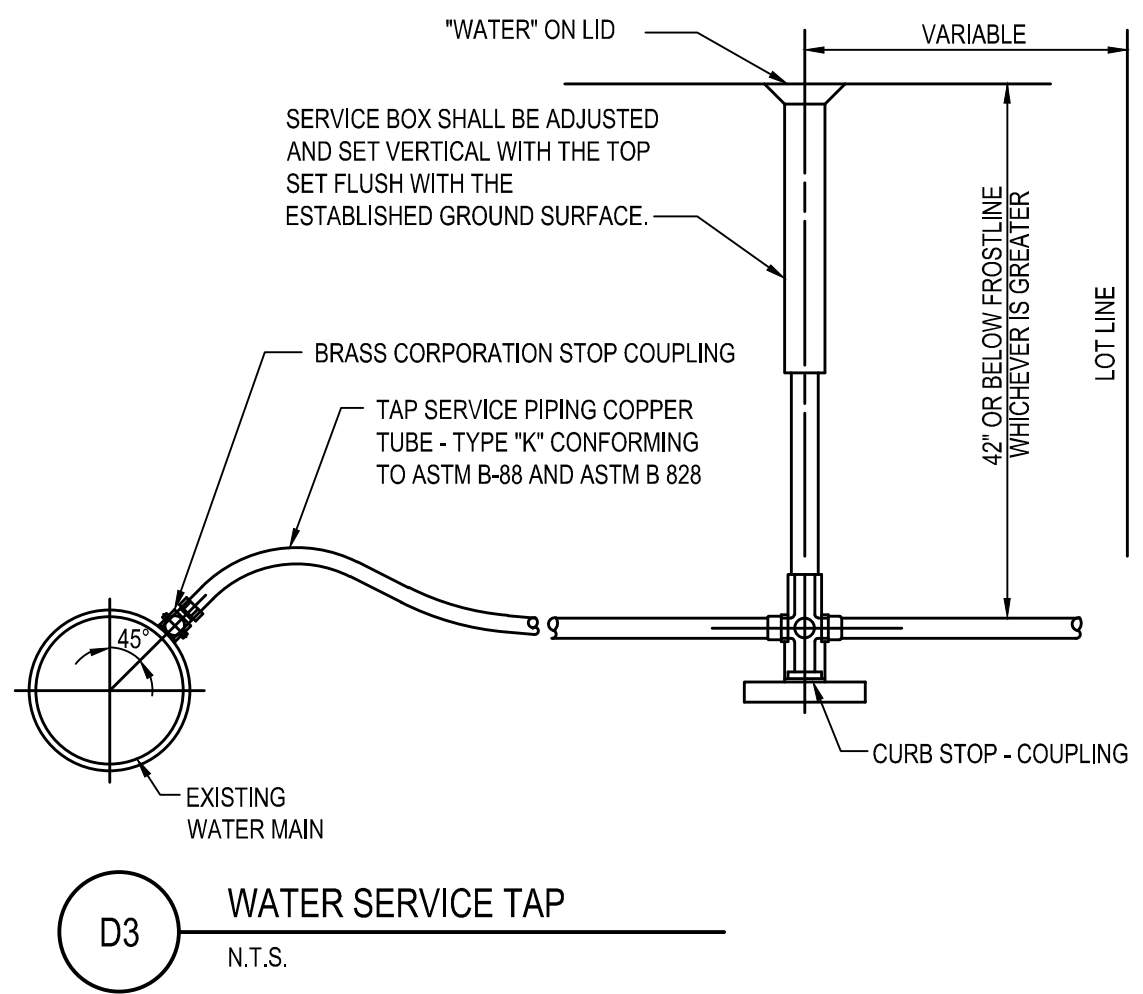


D3 WATER SERVICE TAP
N.T.S.

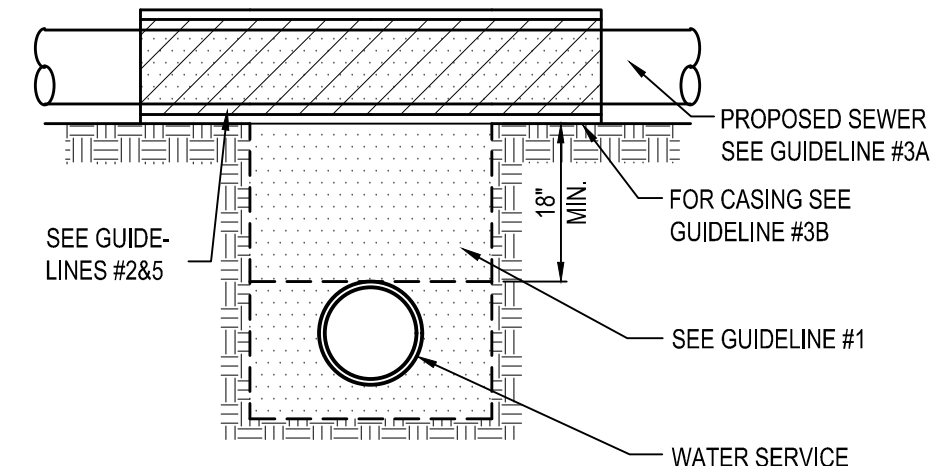


NOTES:
PROPOSED WATER SERVICE BELOW PROPOSED SEWER LINE WITH 18" MINIMUM SEPARATION. GRANULAR MATERIAL TO BE COMPACTED TO 75% OF RELATIVE DENSITY. GUIDELINES:
1. IF SELECT GRANULAR BACKFILL EXISTS, REMOVE WITHIN WIDTH OF PROPOSED SEWER TRENCH AND REPLACE WITH SELECT EXCAVATED MATERIAL AND COMPACT.
2. OMIT SELECT GRANULAR CRADLE AND GRANULAR BACKFILL TO ONE (1) FOOT OVER TOP OF PIPE AND USE SELECT EXCAVATED MATERIAL AND COMPACT FOR 10 FEET ON EITHER SIDE OF WATER MAIN
3. A. CONSTRUCT 10 FEET OF PROPOSED SEWER OF WATER MAIN MATERIAL AND PRESSURE TEST, OR; B. USE 10 FEET OF CASING FOR PROPOSED SEWER AND SEAL ENDS OF CASING.
4. POINT LOADS SHALL NOT BE ALLOWED BETWEEN SEWER OR SEWER CASING AND WATER MAIN.
5. PROVIDE ADEQUATE SUPPORT FOR EXISTING WATER MAIN TO PREVENT DAMAGE DUE TO SETTLEMENT OF SEWER TRENCH.

D4 WATER & SEWER TRENCH SEPARATOR
N.T.S.

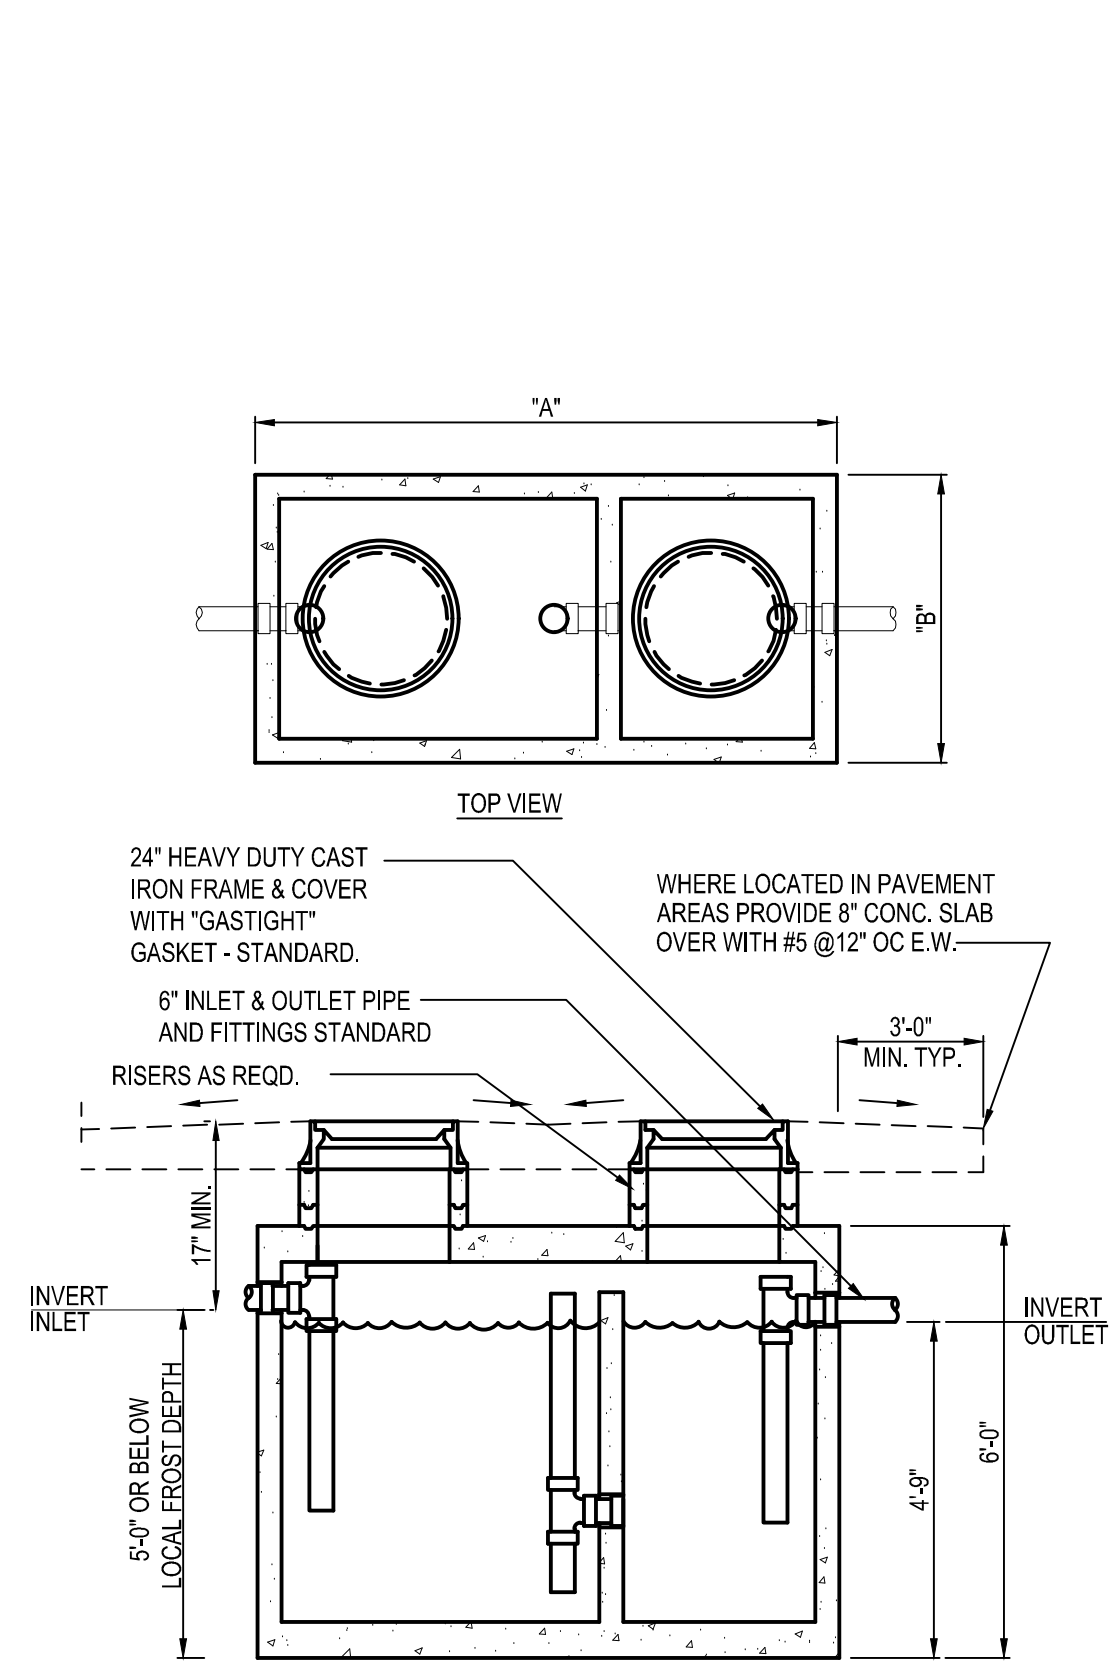


G.T. SIZE	DIM. "A"	DIM. "B"
500 GALLON	6'-2"	4'-2"
750 GALLON	8'-1"	4'-0"
1000 GALLON	8'-2"	5'-1"
1250 GALLON	8'-6"	5'-9"
1500 GALLON	*	*

A2 EXTERIOR GREASE INTERCEPTOR
N.T.S.

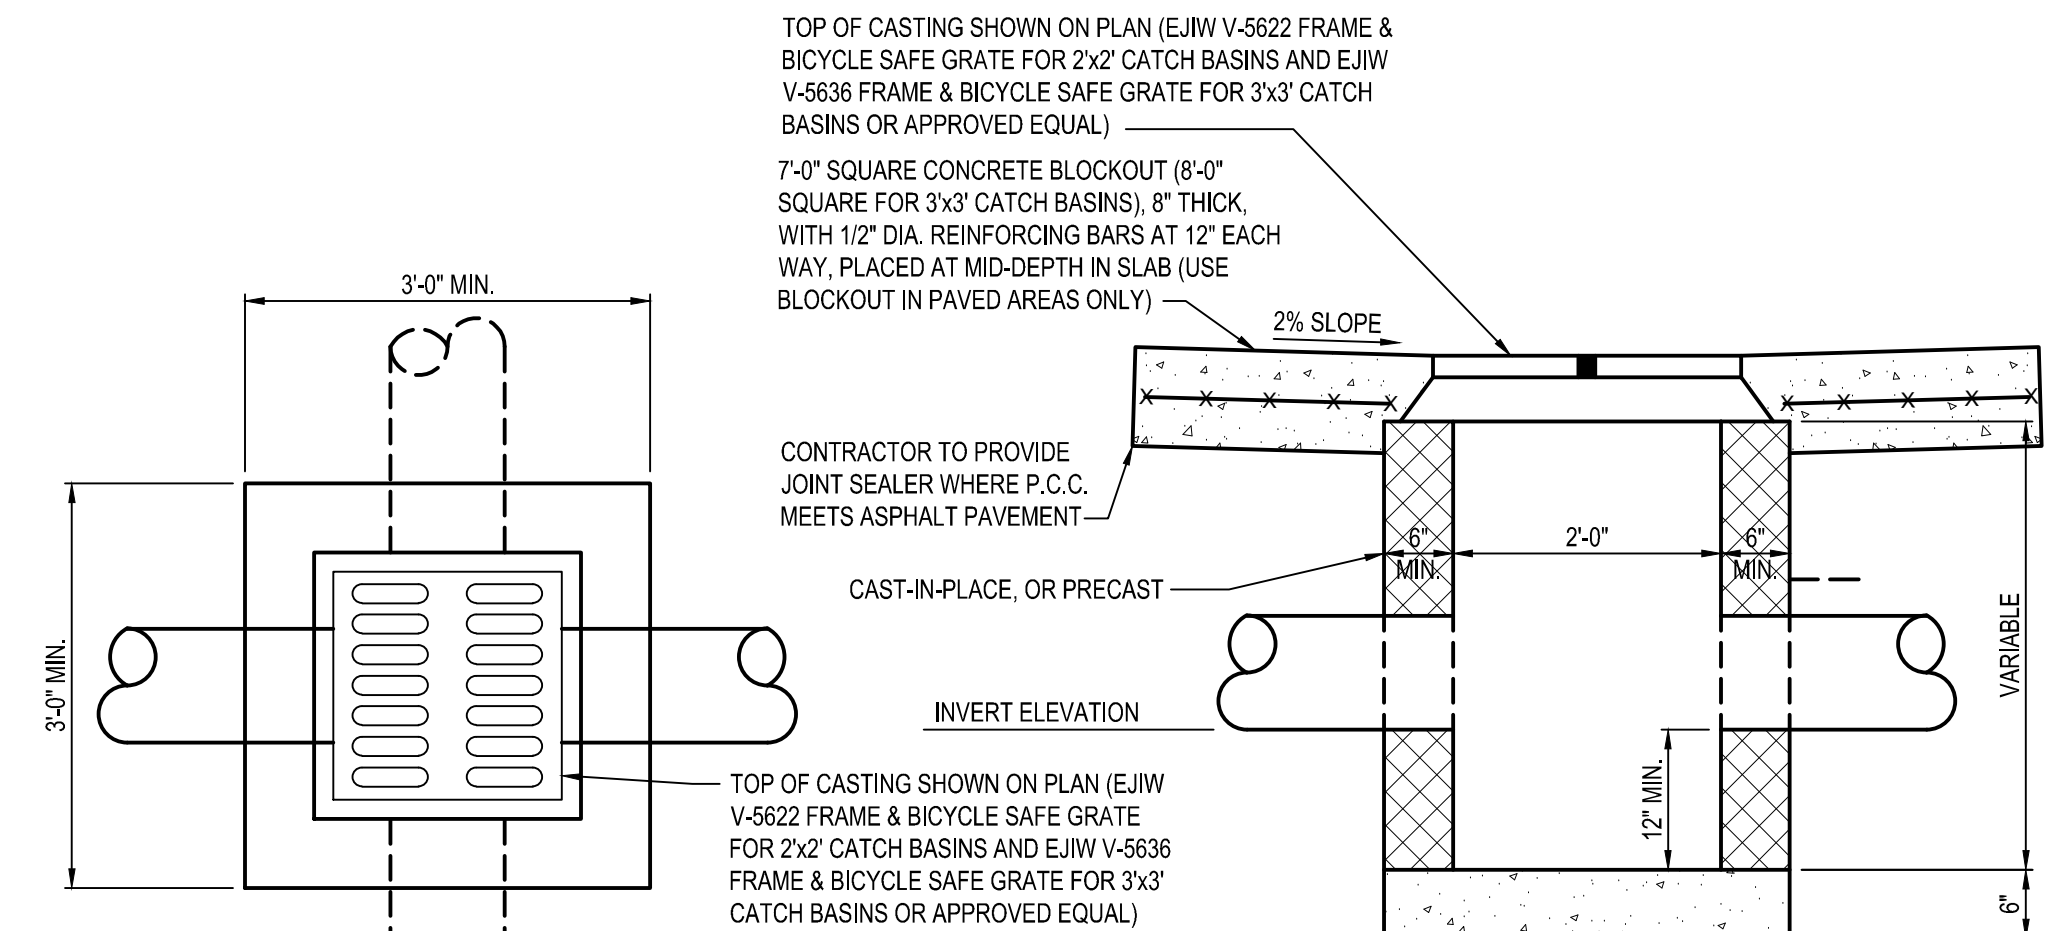


NOTE:
1. PRECAST WALLS SHALL BE REINFORCED SUFFICIENTLY TO PERMIT SHIPPING AND HANDLING WITHOUT DAMAGE.
2. CAST-IN-PLACE CONCRETE SHALL BE 4,000 PSI @ 28 DAY. ALL PRECAST CONCRETE SHALL MEET STATE REQUIREMENTS WITH 6% +/- 2% AIR VOID CONTENT IN THE CURED CONCRETE.
3. ALL STORM SEWER GRATES TO HAVE NOTATION: 'DUMP NO WASTE, DRAINS TO WATERWAY'. CONTRACTOR TO VERIFY WITH LOCAL JURISDICTION EXACT WORDING.

B3 CATCH BASIN
N.T.S.

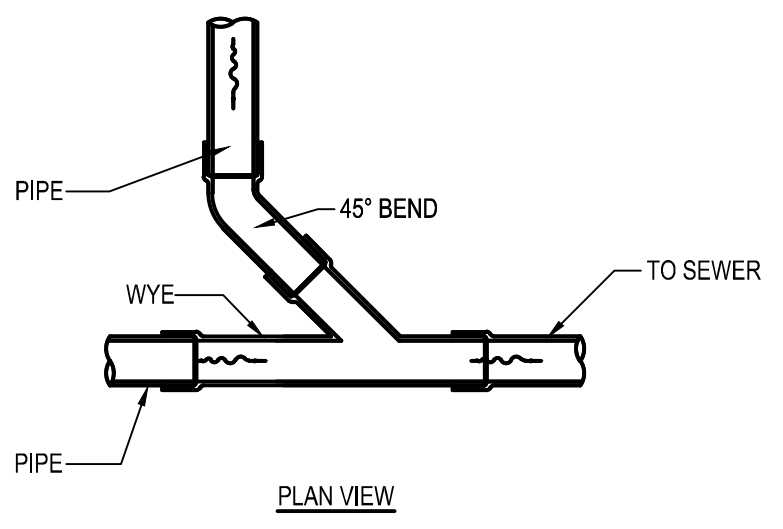

A3 WYE CONNECTION
N.T.S.

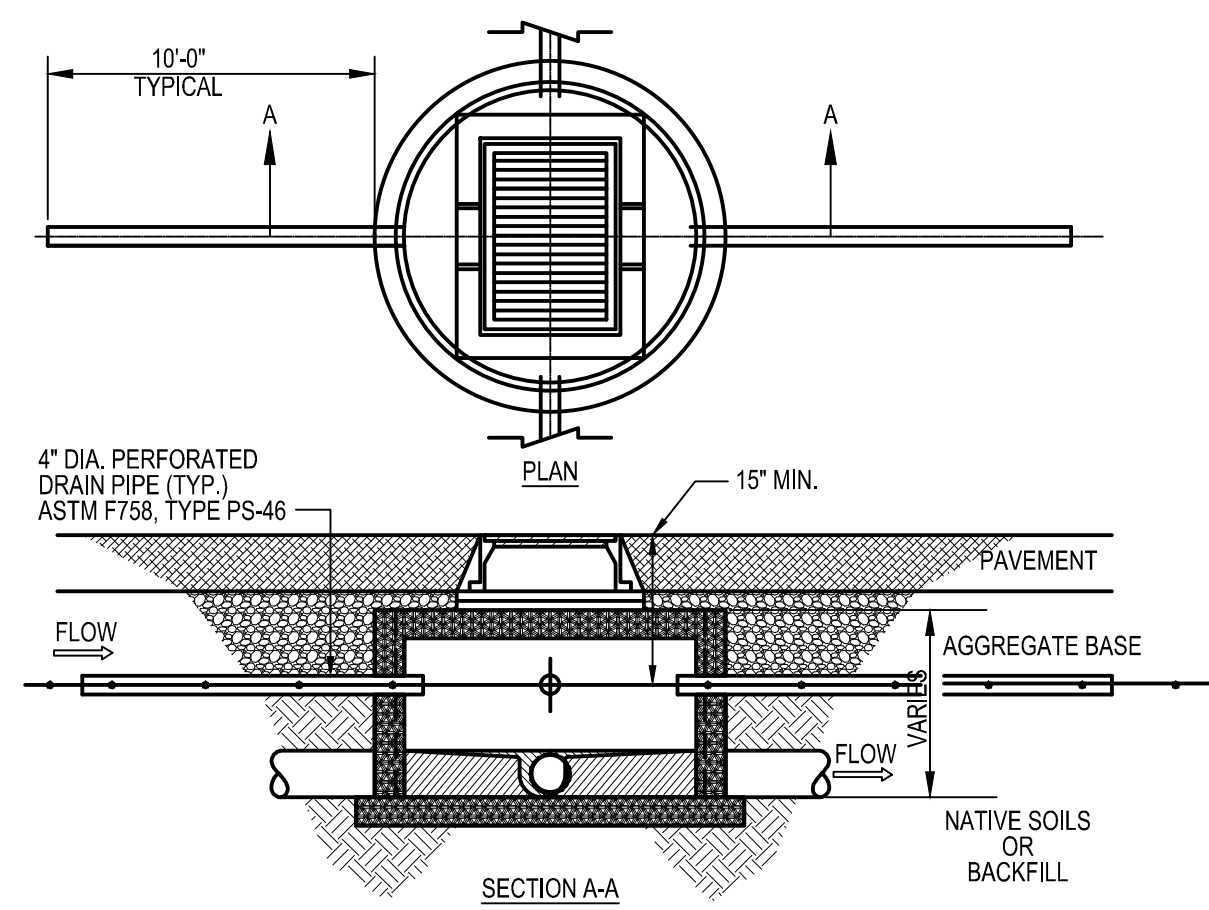

A4 FINGER DRAIN DETAIL
N.T.S.

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
P/VP/M: SM
DRAWN BY.: RS
JOB NO.: 2020088.03




TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
SITE DETAILS

C-503




PLOT DATE:

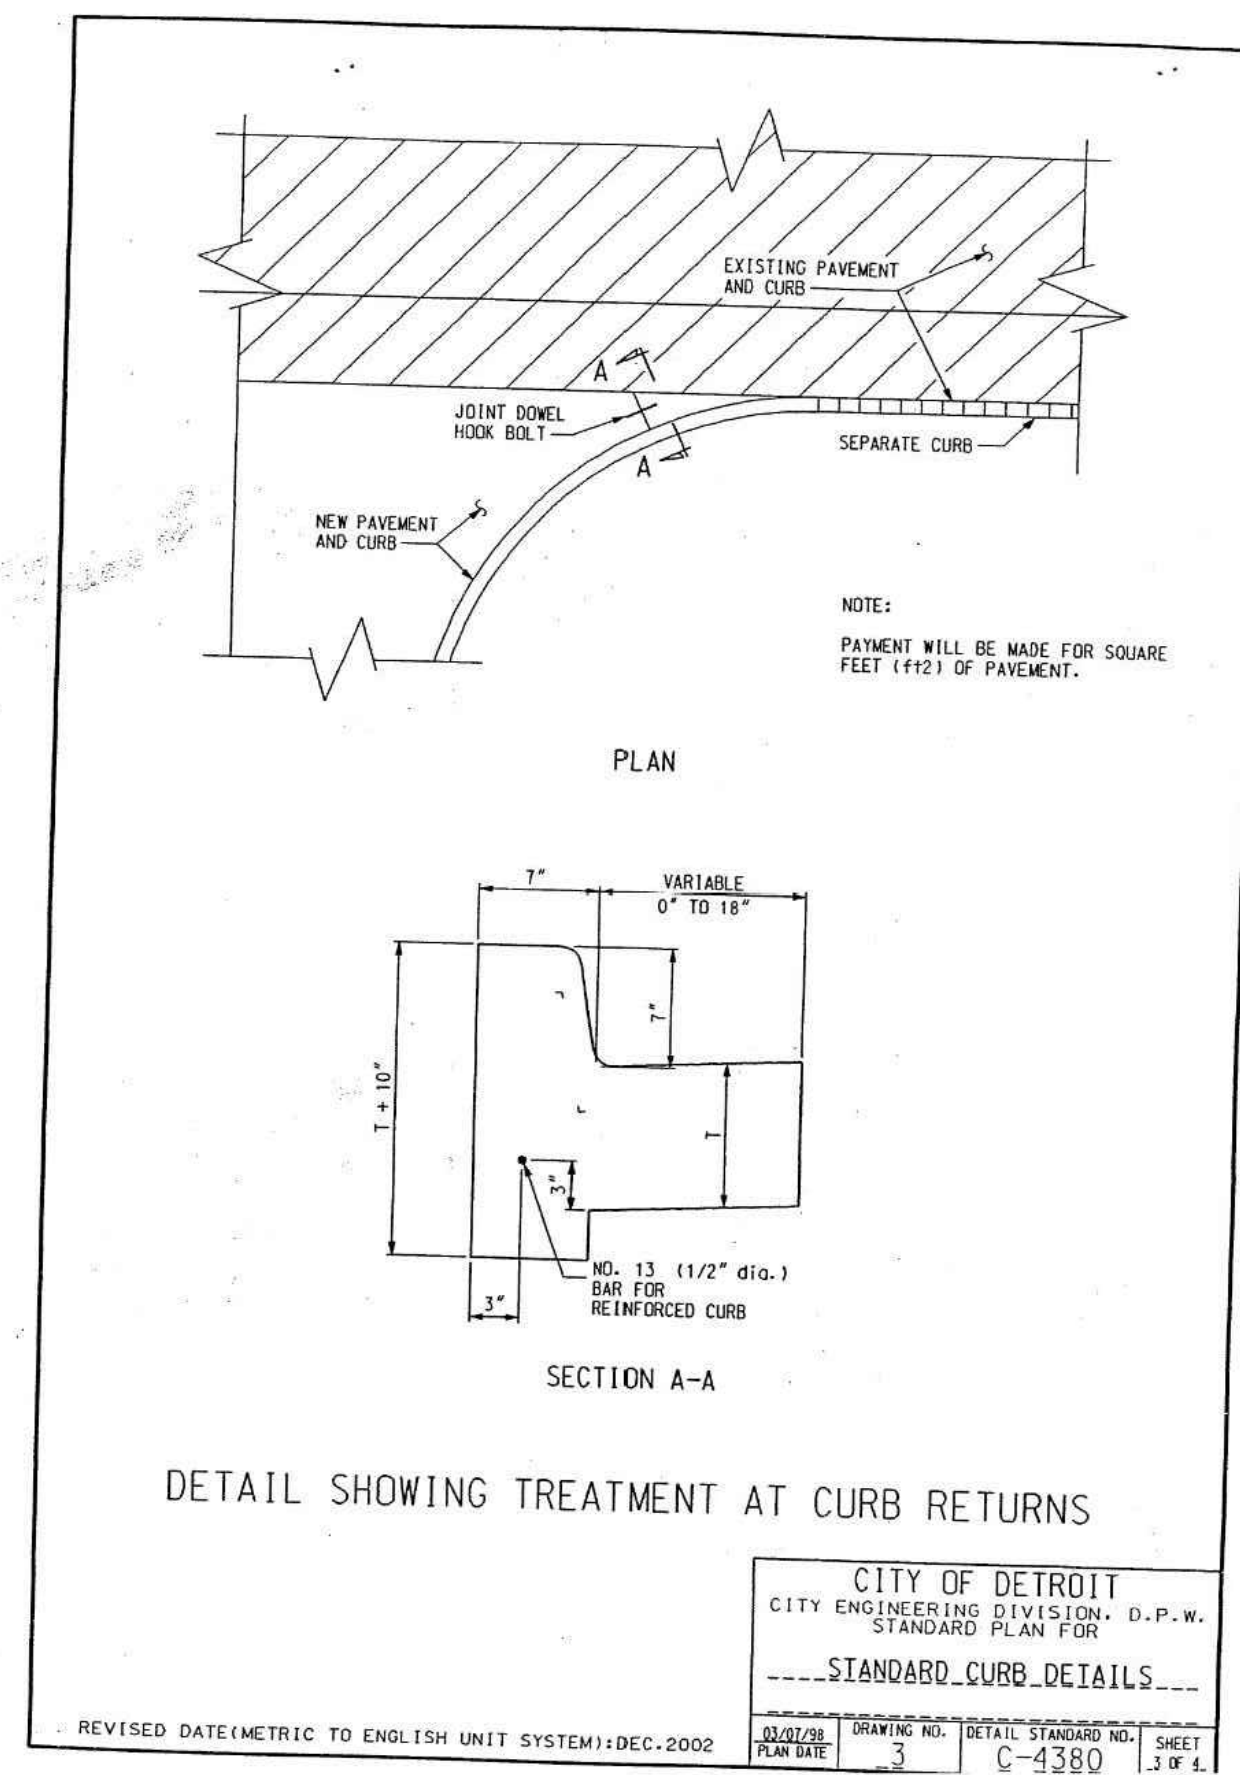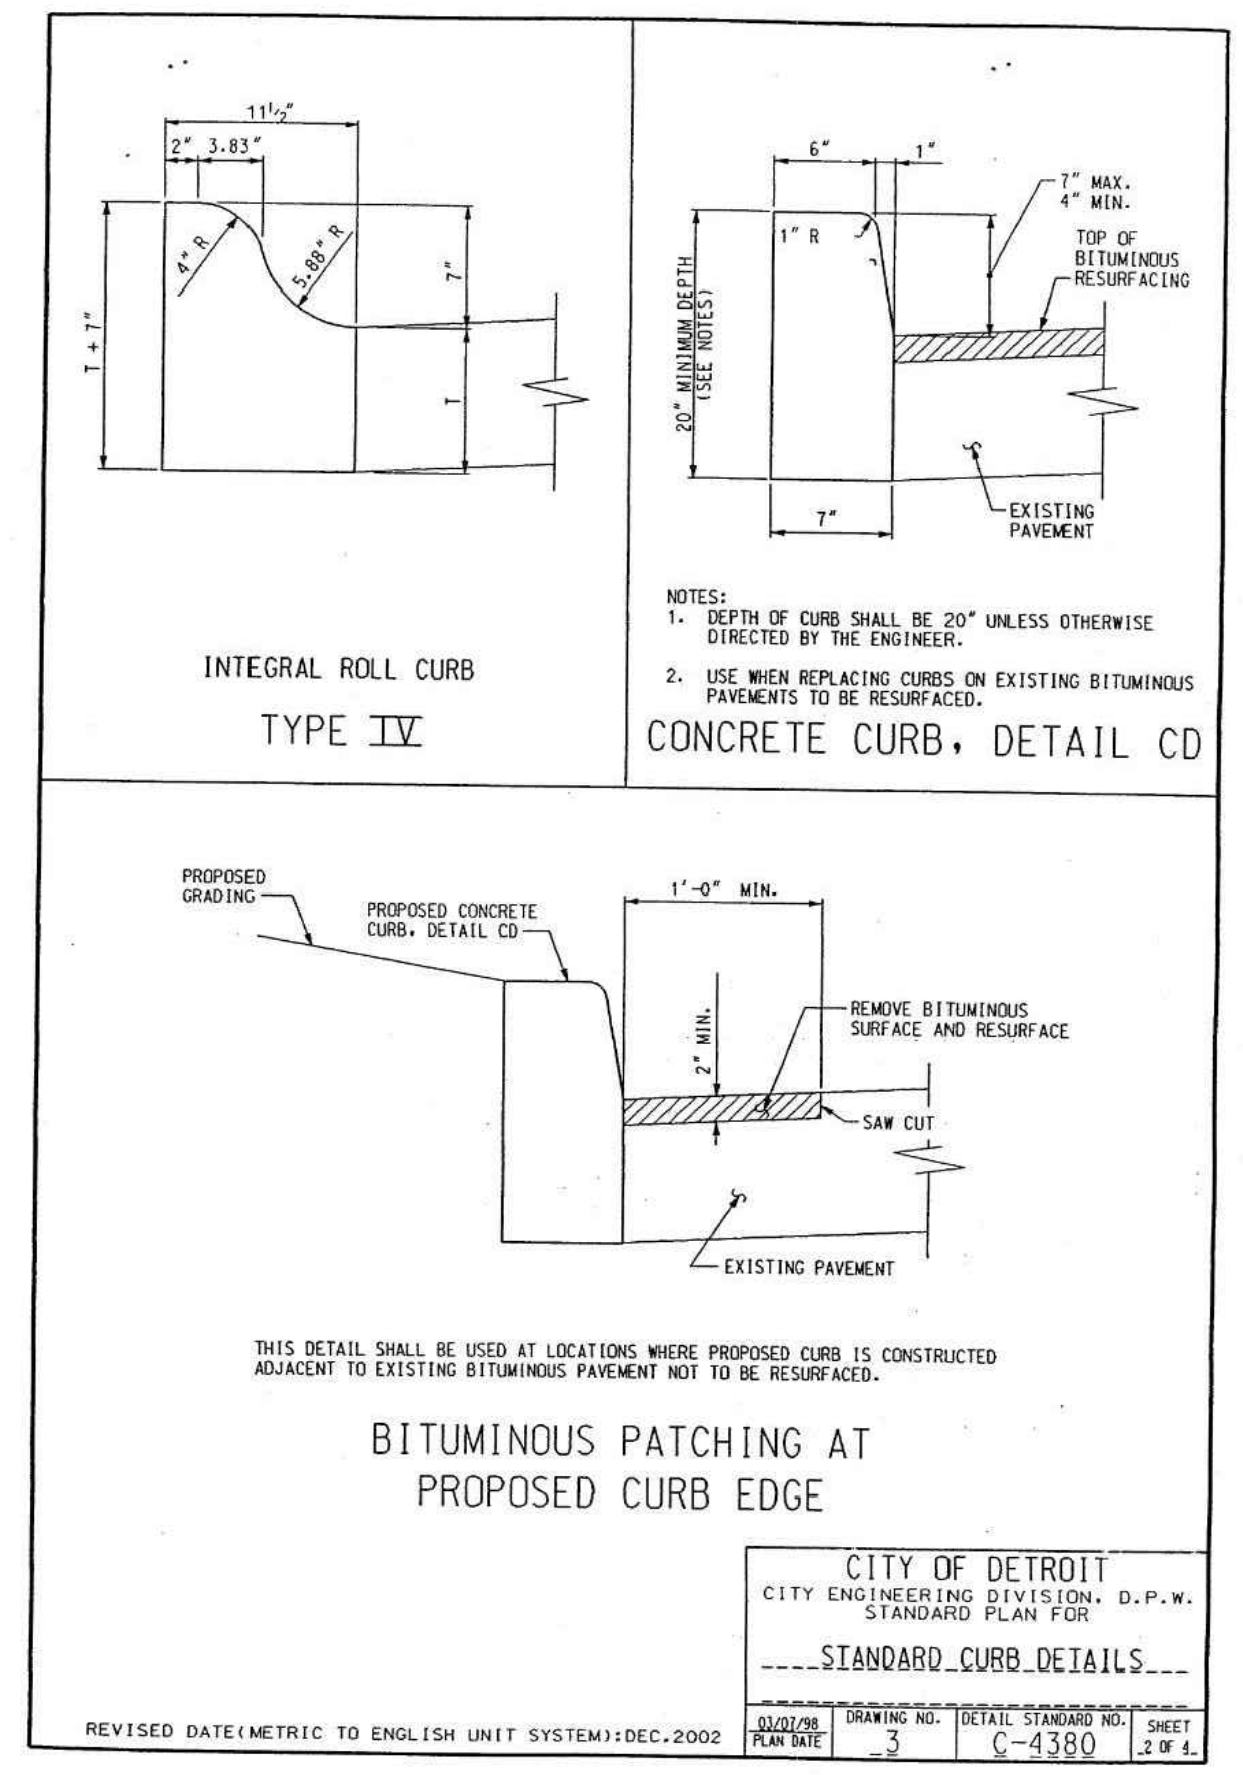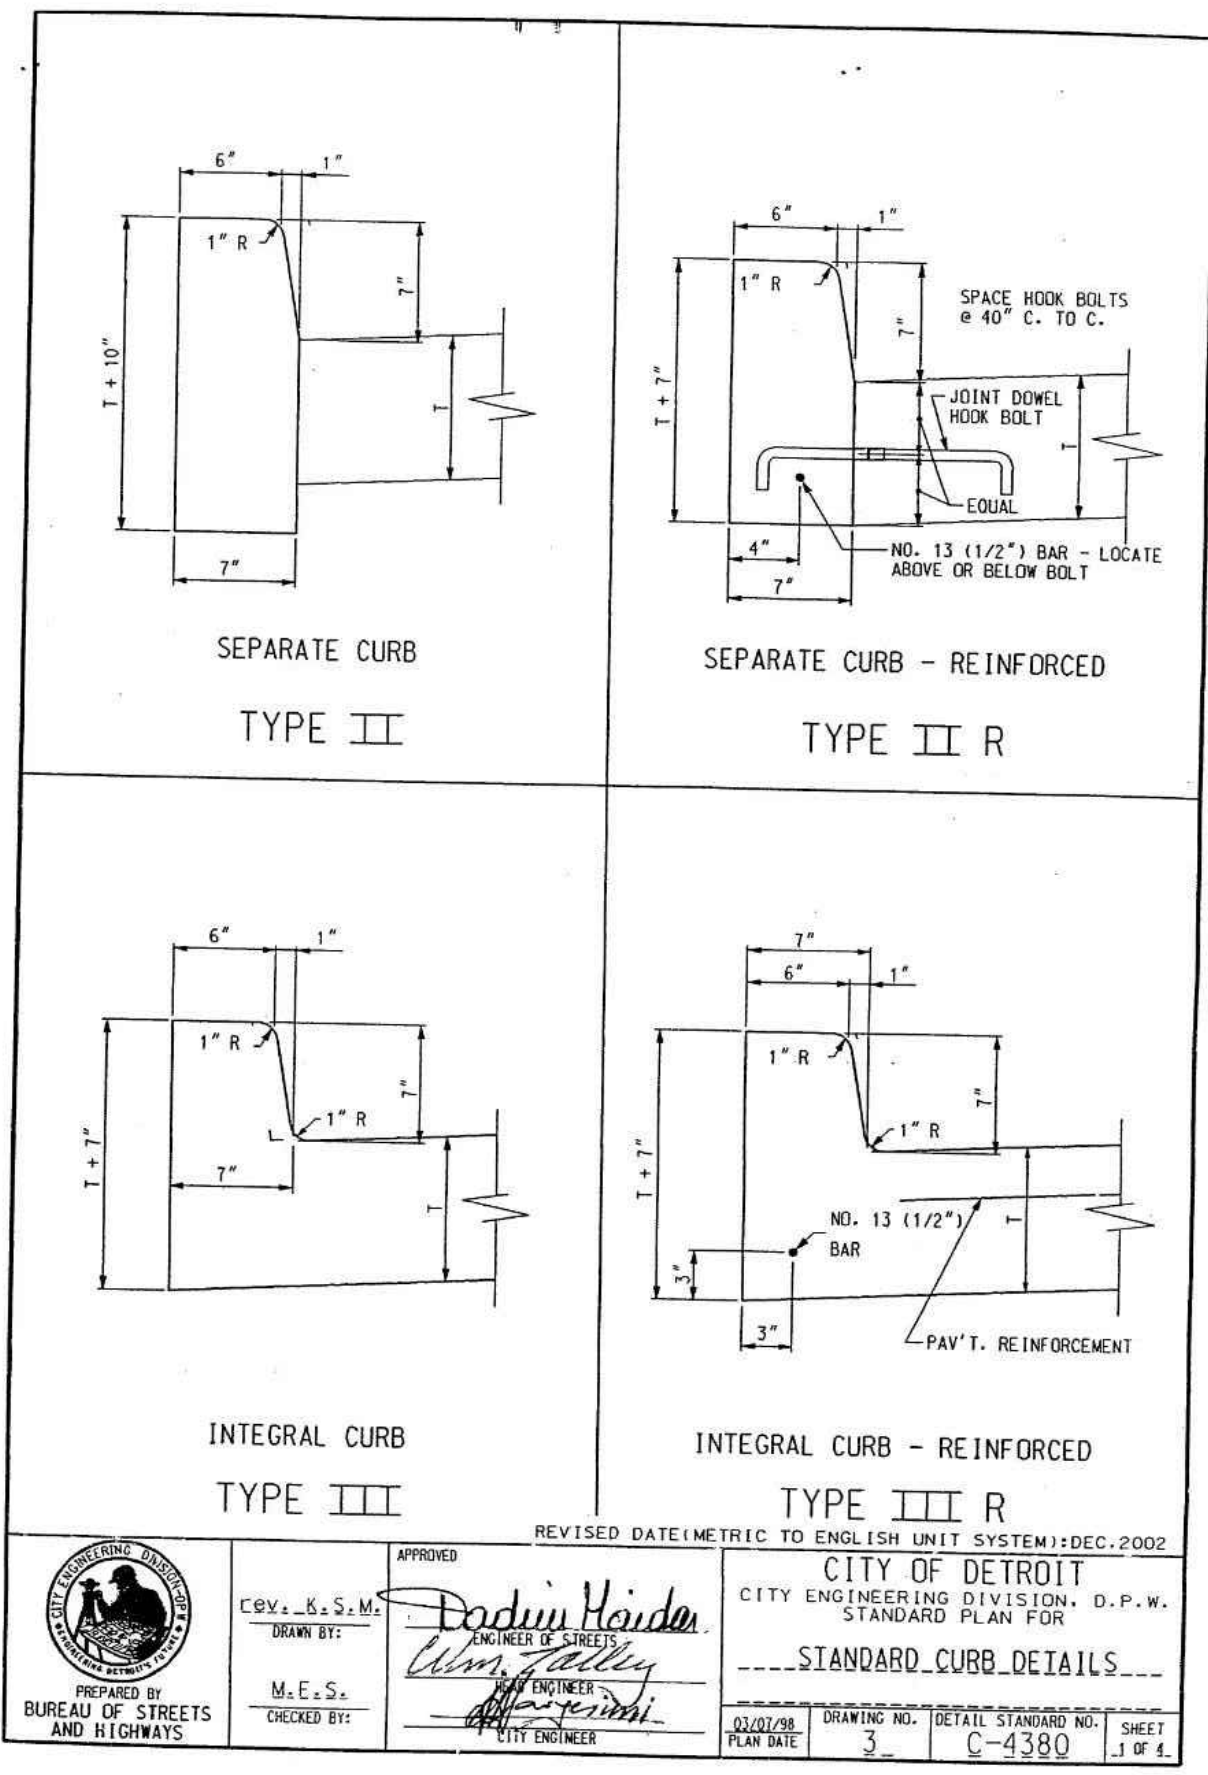

This document has not been reviewed by the stamping party. Therefore, the stamping party makes no representation(s) with respect to its contents, and shall not be liable for such. Any reliance on this stamp shall be at the relying party(ies)'s own risk and hereby waives any and all claim(s) related to the existence of the stamp or otherwise.

FOR REFERENCE ONLY

THE OMISSION OF ANY CURRENT STANDARD DETAIL DOES NOT RELIEVE THE CONTRACTOR FROM THIS REQUIREMENT. THE WORK SHALL BE PERFORMED IN COMPLETE CONFORMANCE WITH THE CURRENT DWSD STANDARD SPECIFICATIONS AND DETAILS

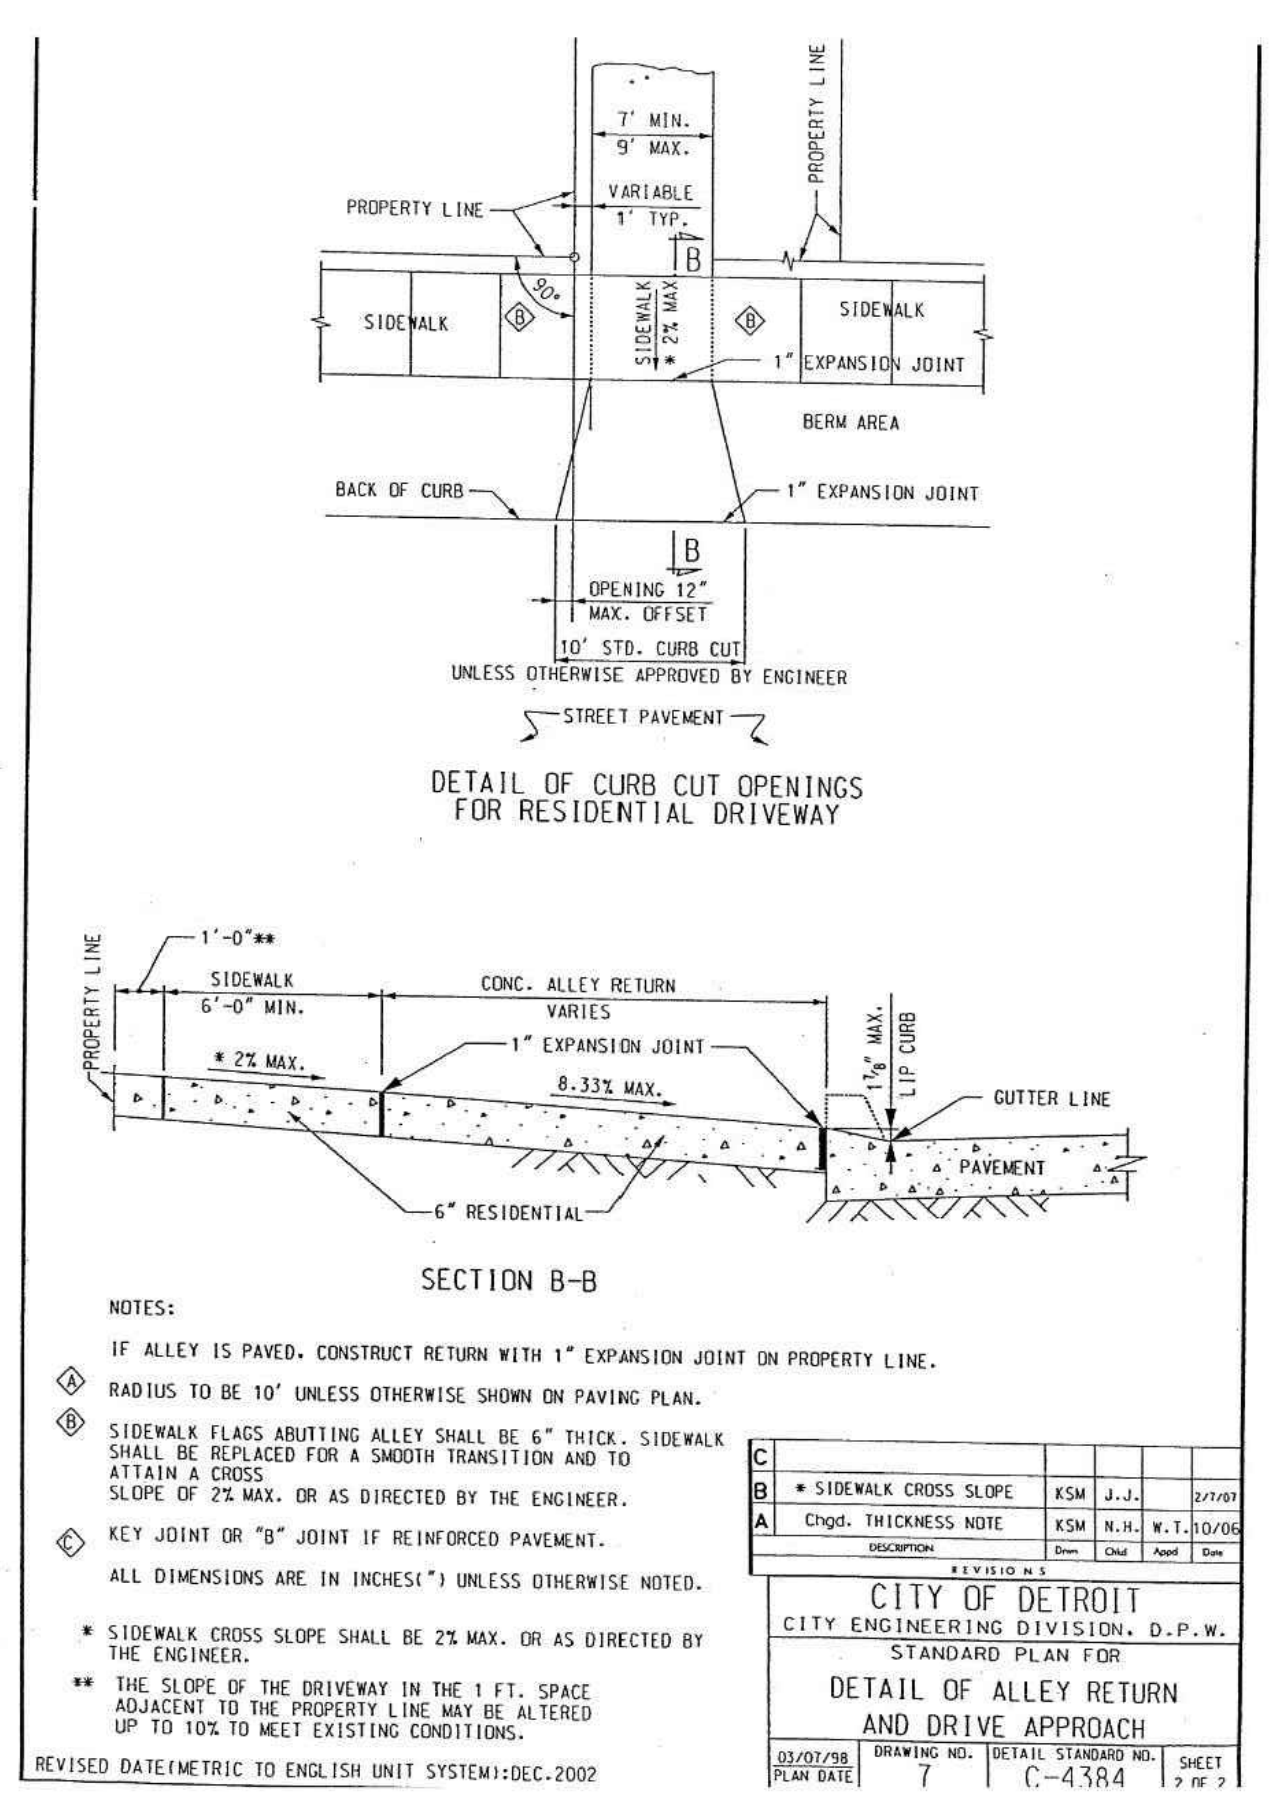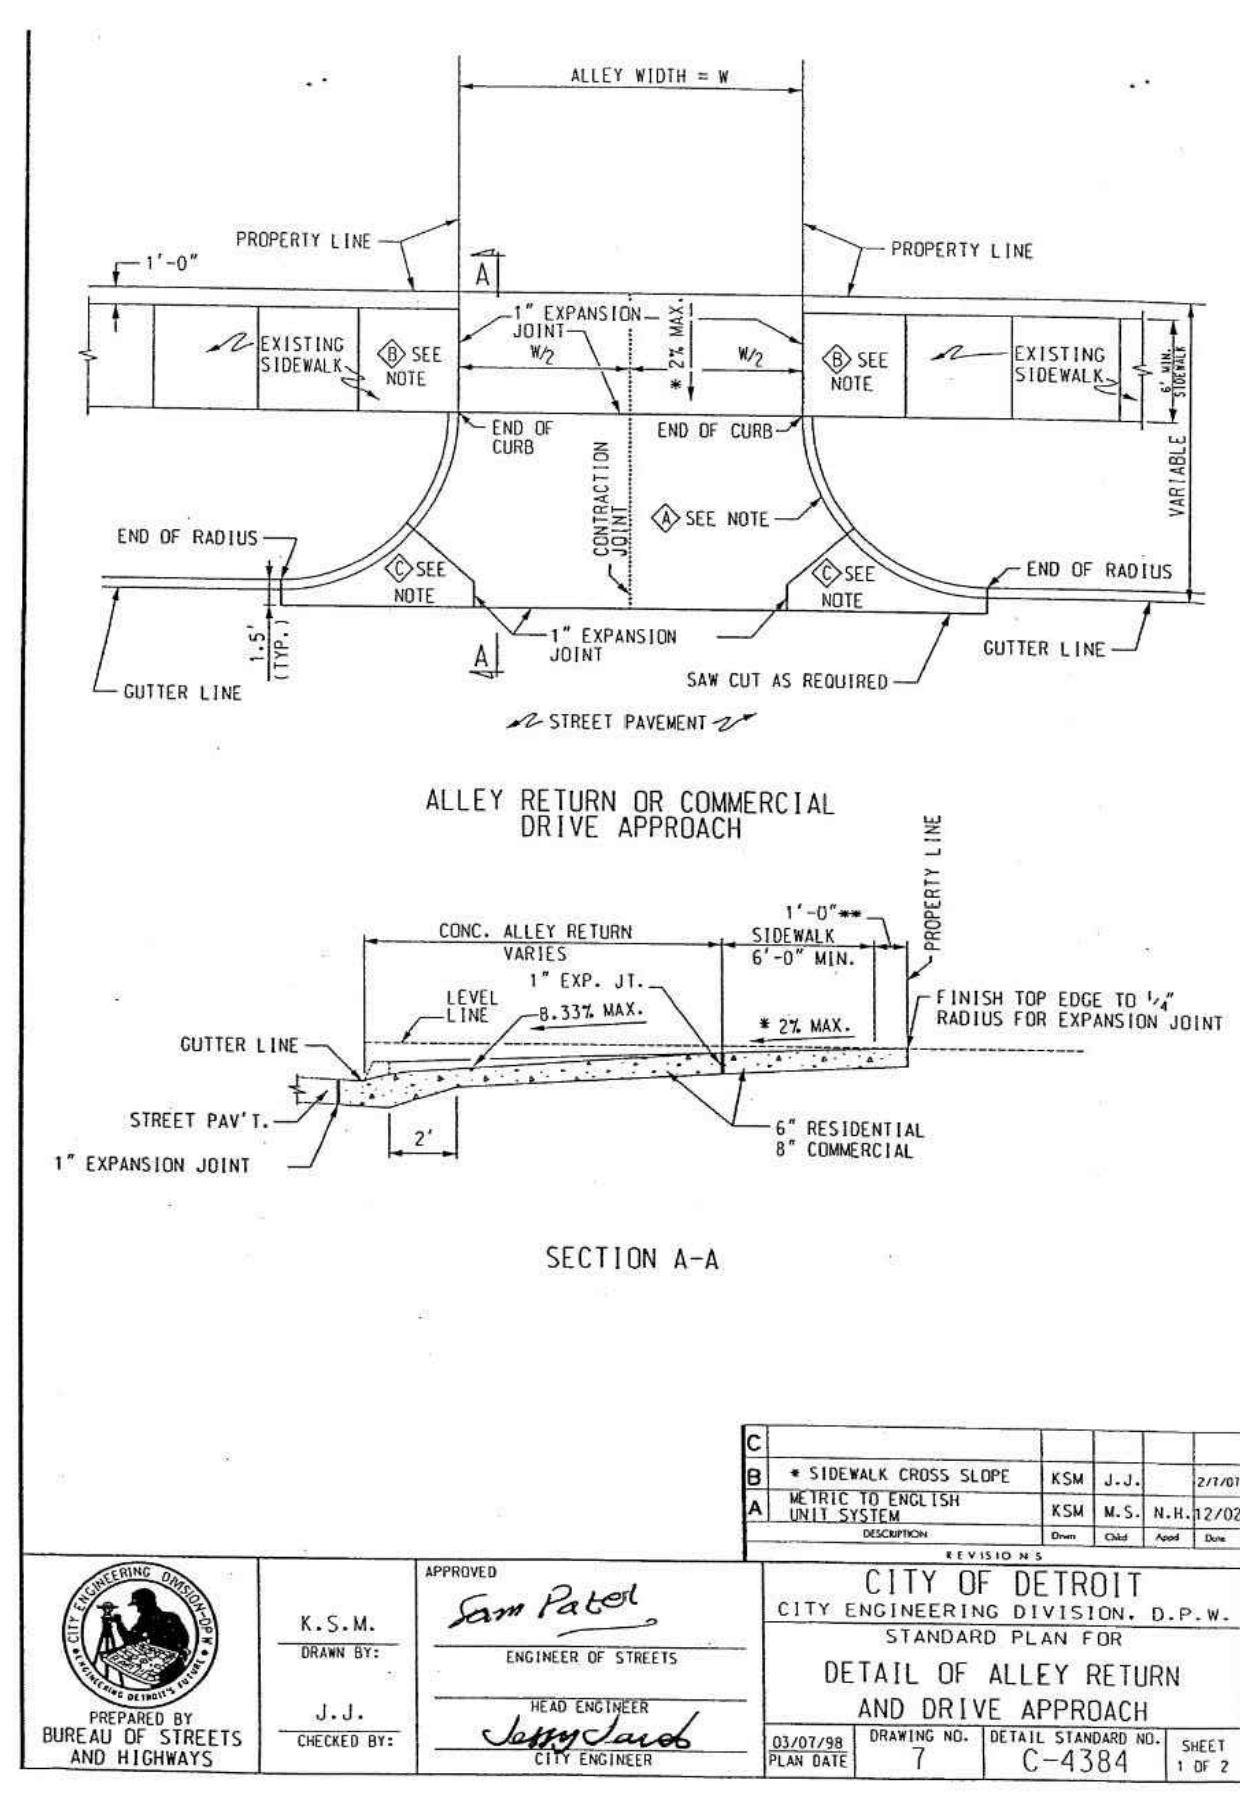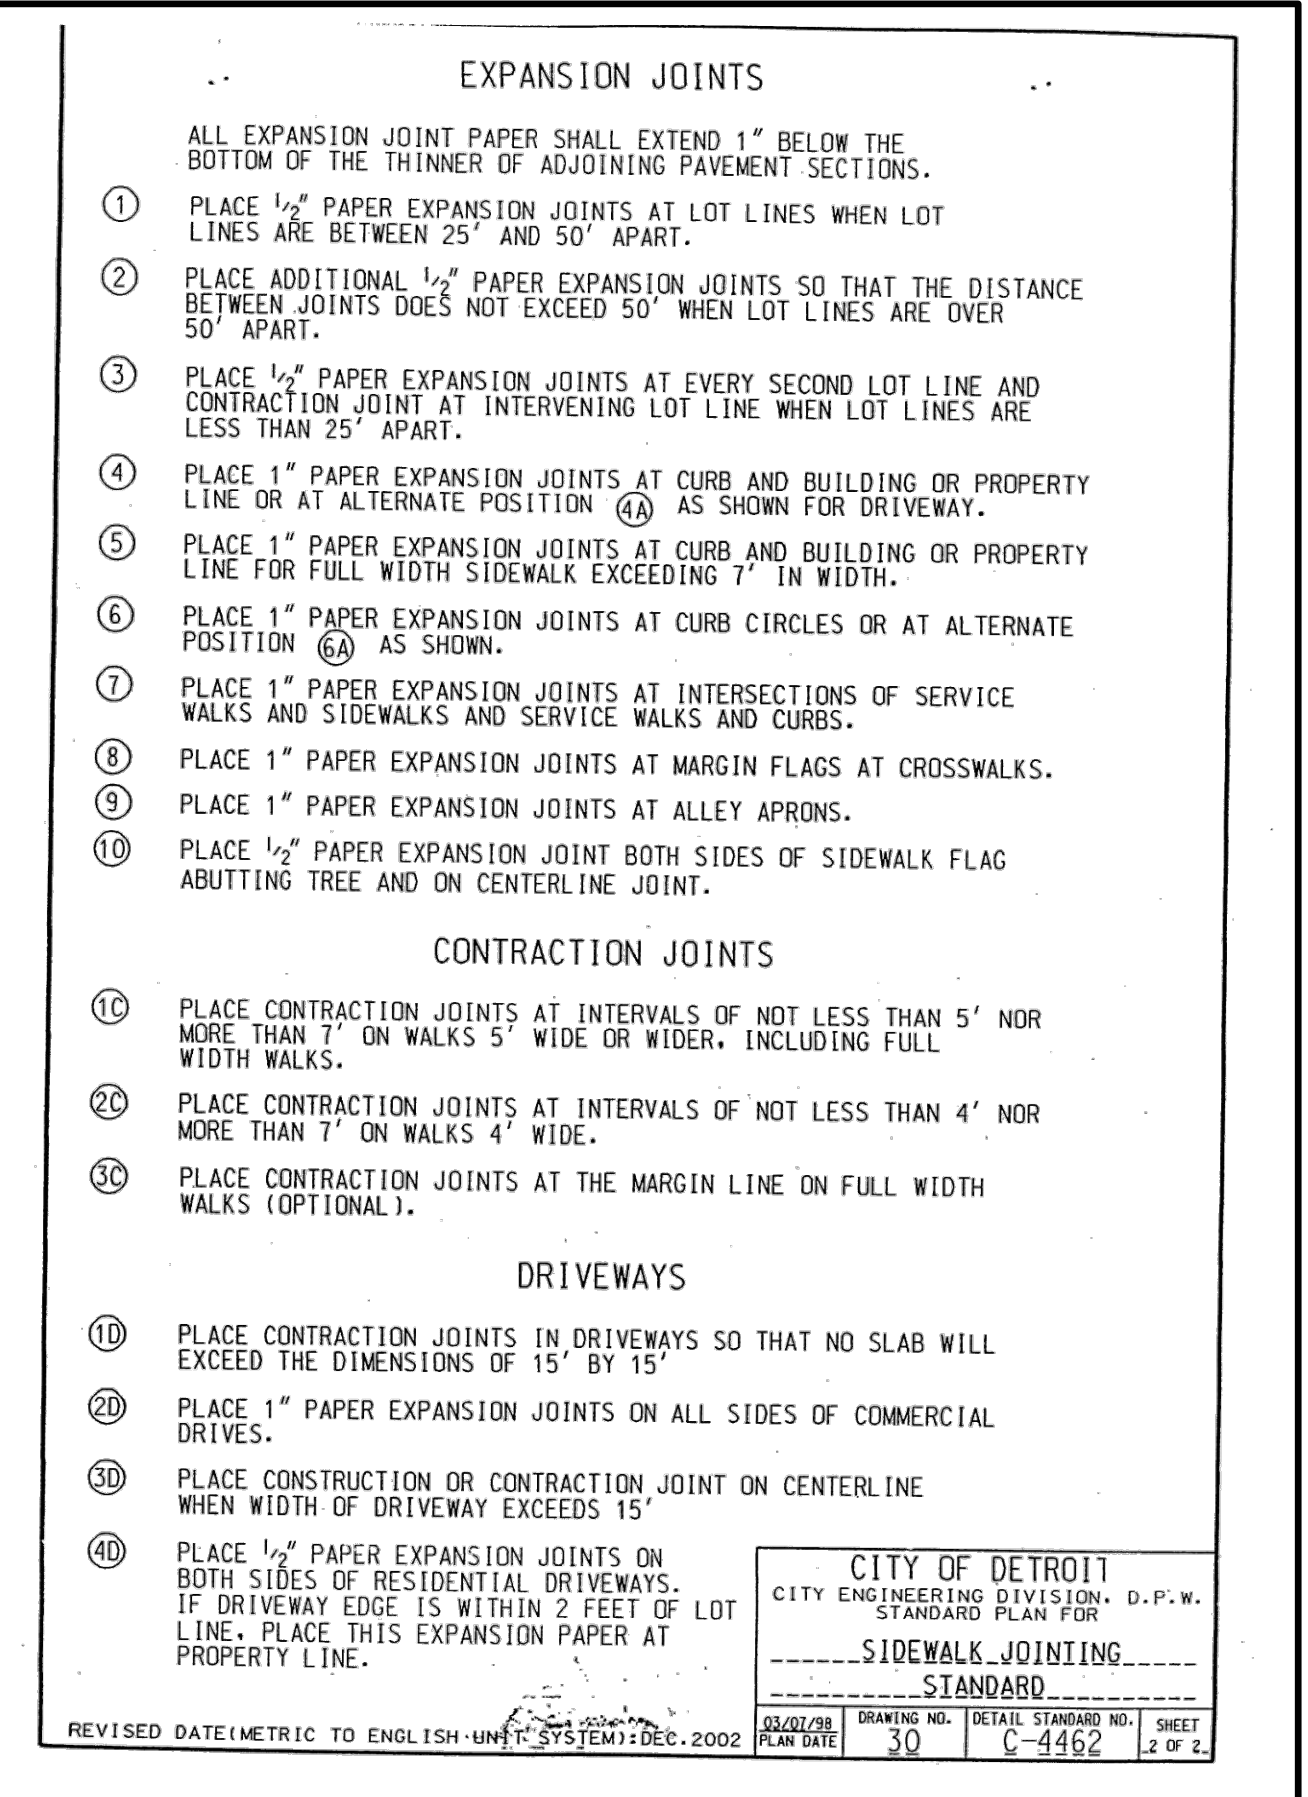

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAPM: SM
DRAWN BY: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
DETROIT DPW
DETAILS

C-504

PLOT DATE:

NOMINAL PIPE DIAMETER	MAXIMUM TRENCH WIDTH
LESS THAN 18"	30"
18" TO 24"	PIPE DIAMETER PLUS 18"
GREATER THAN 24"	PIPE DIAMETER PLUS 24"

NOTES:

- NO EXTRA PAYMENT WILL BE MADE FOR BASE AND PAVEMENT RESTORATION ITEMS DUE TO ADDITIONAL EXCAVATION BEYOND THE MAXIMUM TRENCH WIDTH LISTED ABOVE.
- REFER TO PAVEMENT RESTORATION DETAILS FOR BASE AND PAVEMENT WIDTH.
- TRENCHING SHALL BE PER OSHA 29 CFR, SUBPART P AND SHALL BE PERFORMED TO MINIMIZE THE SURFACE DISRUPTION.

STANDARD TRENCH DETAIL FOR WATER MAIN UNDER ROAD BED, PARKING LOTS, SIDEWALKS, DRIVEWAYS, CURBS, GRAVEL ROADS AND ALLEYS

UTILITY TRENCH, WATER MAIN	CITY OF DETROIT WATER AND SEWERAGE DEPARTMENT ENGINEERING DIVISION
SCALE NONE	SHEET 1 OF 3
DATE 9/2018	DWG. No. 312333-04

NOMINAL PIPE DIAMETER	MAXIMUM TRENCH WIDTH
LESS THAN 18"	30"
18" TO 24"	PIPE DIAMETER PLUS 18"
GREATER THAN 24"	PIPE DIAMETER PLUS 24"

NOTES:

- NO EXTRA PAYMENT WILL BE MADE FOR BASE AND PAVEMENT RESTORATION ITEMS DUE TO ADDITIONAL EXCAVATION BEYOND THE MAXIMUM TRENCH WIDTH LISTED ABOVE.
- TRENCHING SHALL BE PER OSHA 29 CFR, SUBPART P AND SHALL BE PERFORMED TO MINIMIZE THE SURFACE DISRUPTION.

STANDARD TRENCH DETAIL FOR WATER MAIN WITHIN INFLUENCE OF ROAD BED

UTILITY TRENCH, WATER MAIN	CITY OF DETROIT WATER AND SEWERAGE DEPARTMENT ENGINEERING DIVISION
SCALE NONE	SHEET 2 OF 3
DATE 9/2018	DWG. No. 312333-05

NOMINAL PIPE DIAMETER	MAXIMUM TRENCH WIDTH
LESS THAN 18"	30"
18" TO 24"	PIPE DIAMETER PLUS 18"
GREATER THAN 24"	PIPE DIAMETER PLUS 24"

NOTES:

- NO EXTRA PAYMENT WILL BE MADE FOR BASE AND PAVEMENT RESTORATION ITEMS DUE TO ADDITIONAL EXCAVATION BEYOND THE MAXIMUM TRENCH WIDTH LISTED ABOVE.
- TRENCHING SHALL BE PER OSHA 29 CFR, SUBPART P AND SHALL BE PERFORMED TO MINIMIZE THE SURFACE DISRUPTION.

STANDARD TRENCH DETAIL FOR WATER MAIN UNDER BERMS, LAWNS, GRASSY AREAS, (OUTSIDE PAVEMENT INFLUENCE)

UTILITY TRENCH, WATER MAIN	CITY OF DETROIT WATER AND SEWERAGE DEPARTMENT ENGINEERING DIVISION
SCALE NONE	SHEET 3 OF 3
DATE 9/2018	DWG. No. 312333-06

FOR REFERENCE ONLY

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
DETROIT DWSD
DETAILS

C-505

PLOT DATE:

CODED NOTES:

- BACKFILL ACCORDING TO SPECIFICATIONS AND TYPICAL TRENCH SECTION.
- EXISTING CATCH BASIN DRAIN, SEWER OR OTHER UNDERGROUND UTILITY CROSSING NEW OPEN CUT CONSTRUCTION.
- BACKFILL WITH A DRY MIX OF ONE BAG CEMENT PER ONE BAG OF GRANULAR MATERIAL CLASS II.

NOMINAL PIPE DIAMETER	MAXIMUM TRENCH WIDTH
LESS THAN 18"	30"
18" TO 24"	PIPE DIAMETER PLUS 18"
GREATER THAN 24"	PIPE DIAMETER PLUS 24"

NOTES:






- ALL MDOT CLASS II GRANULAR MATERIAL, PLACE AND COMPACT (IN MAX. 12" LIFTS) BY "CONTROLLED DENSITY METHOD" TO 96% PER SPECIFICATION 31 23 33, 3.10 B OF MAXIMUM UNIT WEIGHT.
- WATERMANS CROSSING UNDER SEWERS - WHEN IT IS IMPOSSIBLE TO OBTAIN THE MINIMUM 18-INCH CLEARANCE, REPLACE THE SEWER PIPE (MINIMUM OF 10 FT. ON BOTH SIDES OF WATERMAIN) WITH WATER WORKS GRADE 150PSI PRESSURE TESTED TO ENSURE WATER TIGHTNESS.
- "W" - SEE TRENCH DETAILS FOR TRENCH WIDTH.
- TRENCHING SHALL BE PER OSHA 29 CFR, SUBPART P

TYPICAL DETAIL AT CROSSING UNDER EXISTING UTILITIES

UTILITY CROSSING	CITY OF DETROIT WATER AND SEWERAGE DEPARTMENT ENGINEERING DIVISION
SCALE NONE	SHEET 1 OF 1
DATE 09/2018	DWG. No. 312333-07

THE OMISSION OF ANY CURRENT STANDARD DETAIL DOES NOT RELIEVE THE CONTRACTOR FROM THIS REQUIREMENT. THE WORK SHALL BE PERFORMED IN COMPLETE CONFORMANCE WITH THE CURRENT DWSD STANDARD SPECIFICATIONS AND DETAILS

This document has not been reviewed by the stamping party. Therefore, the stamping party makes no representation(s) with respect to its contents, and shall not be liable for such. Any reliance on this stamp shall be at the relying party(ies)'s own risk and hereby waives any and all claim(s) related to the existence of the stamp or otherwise.

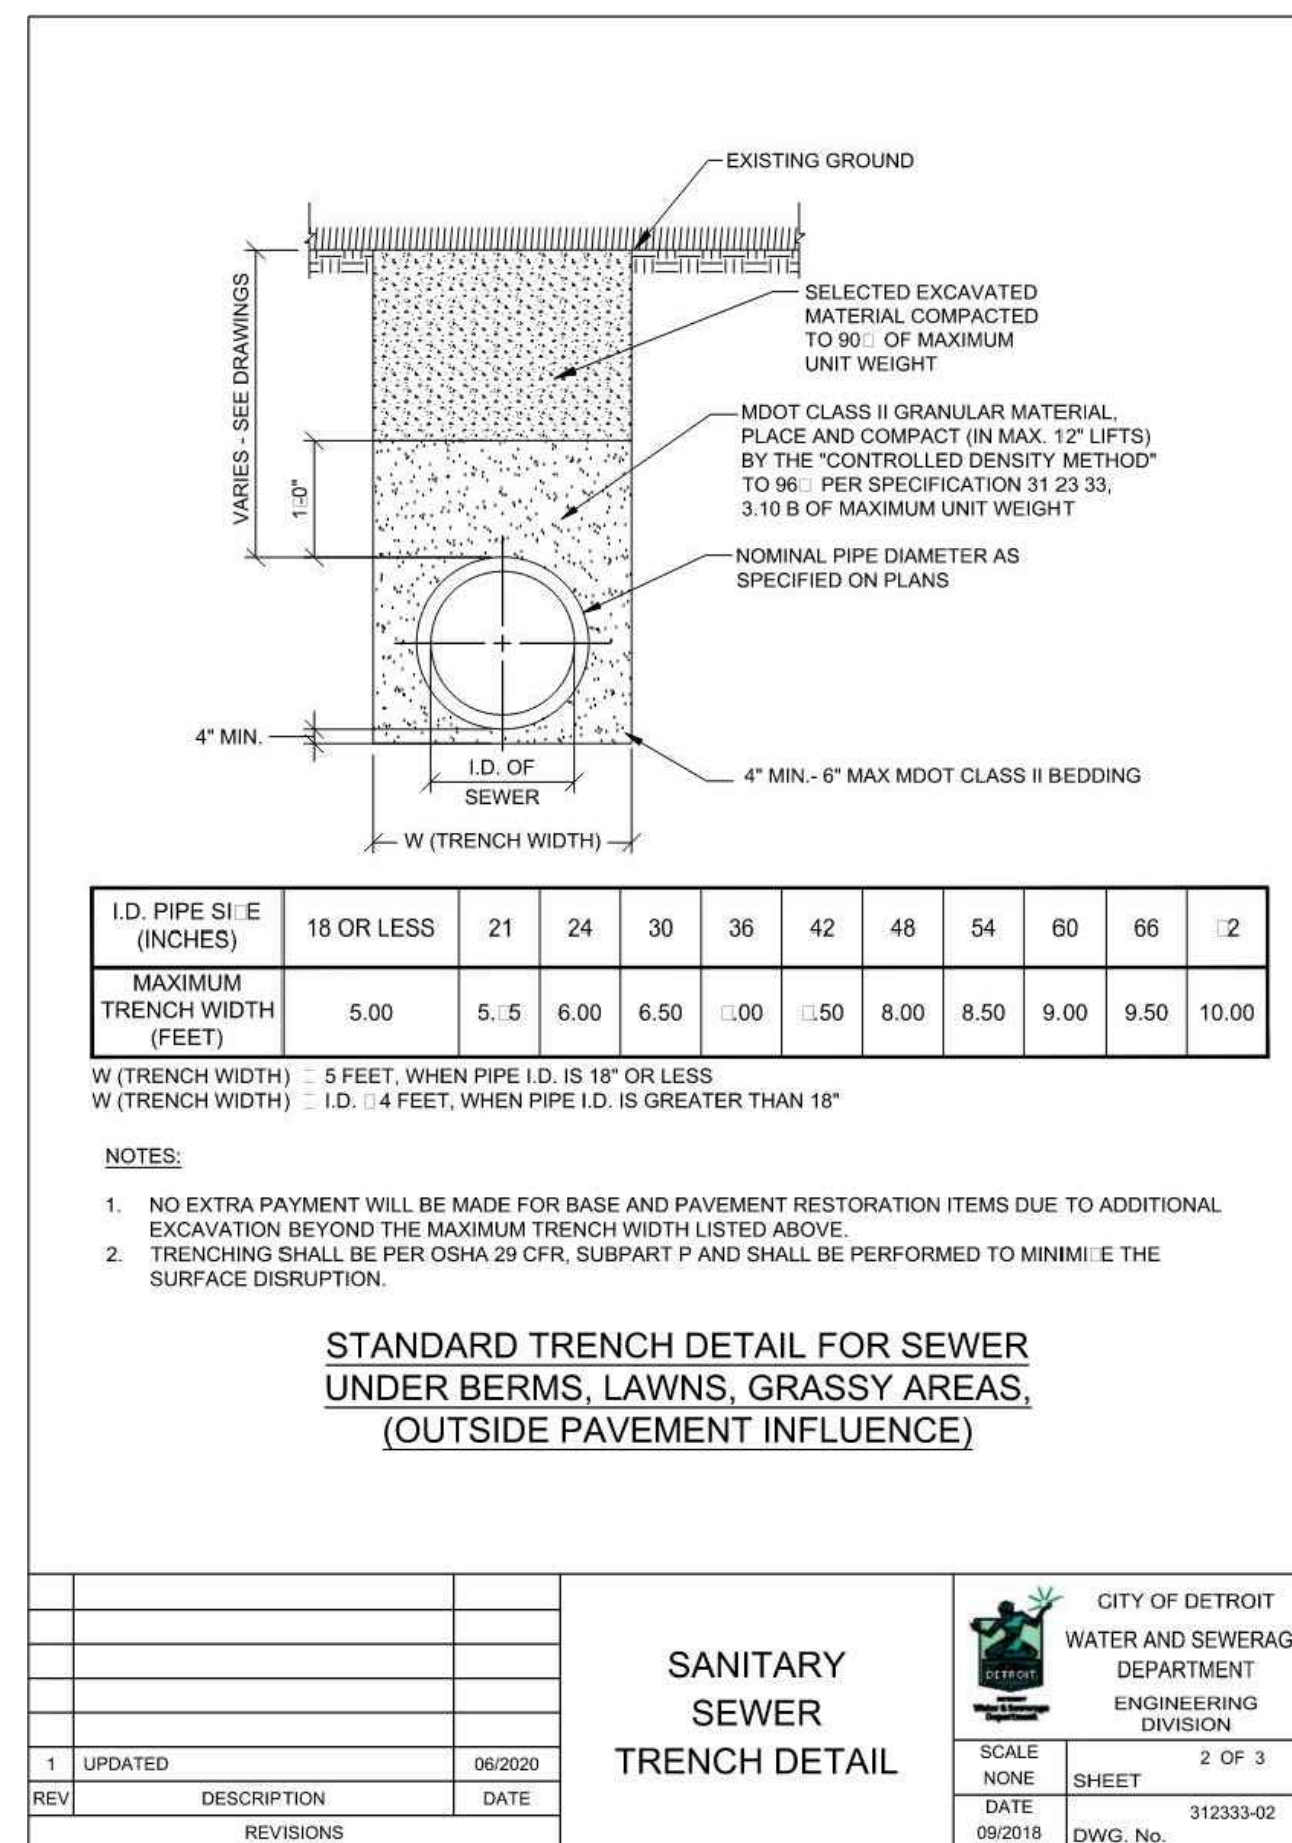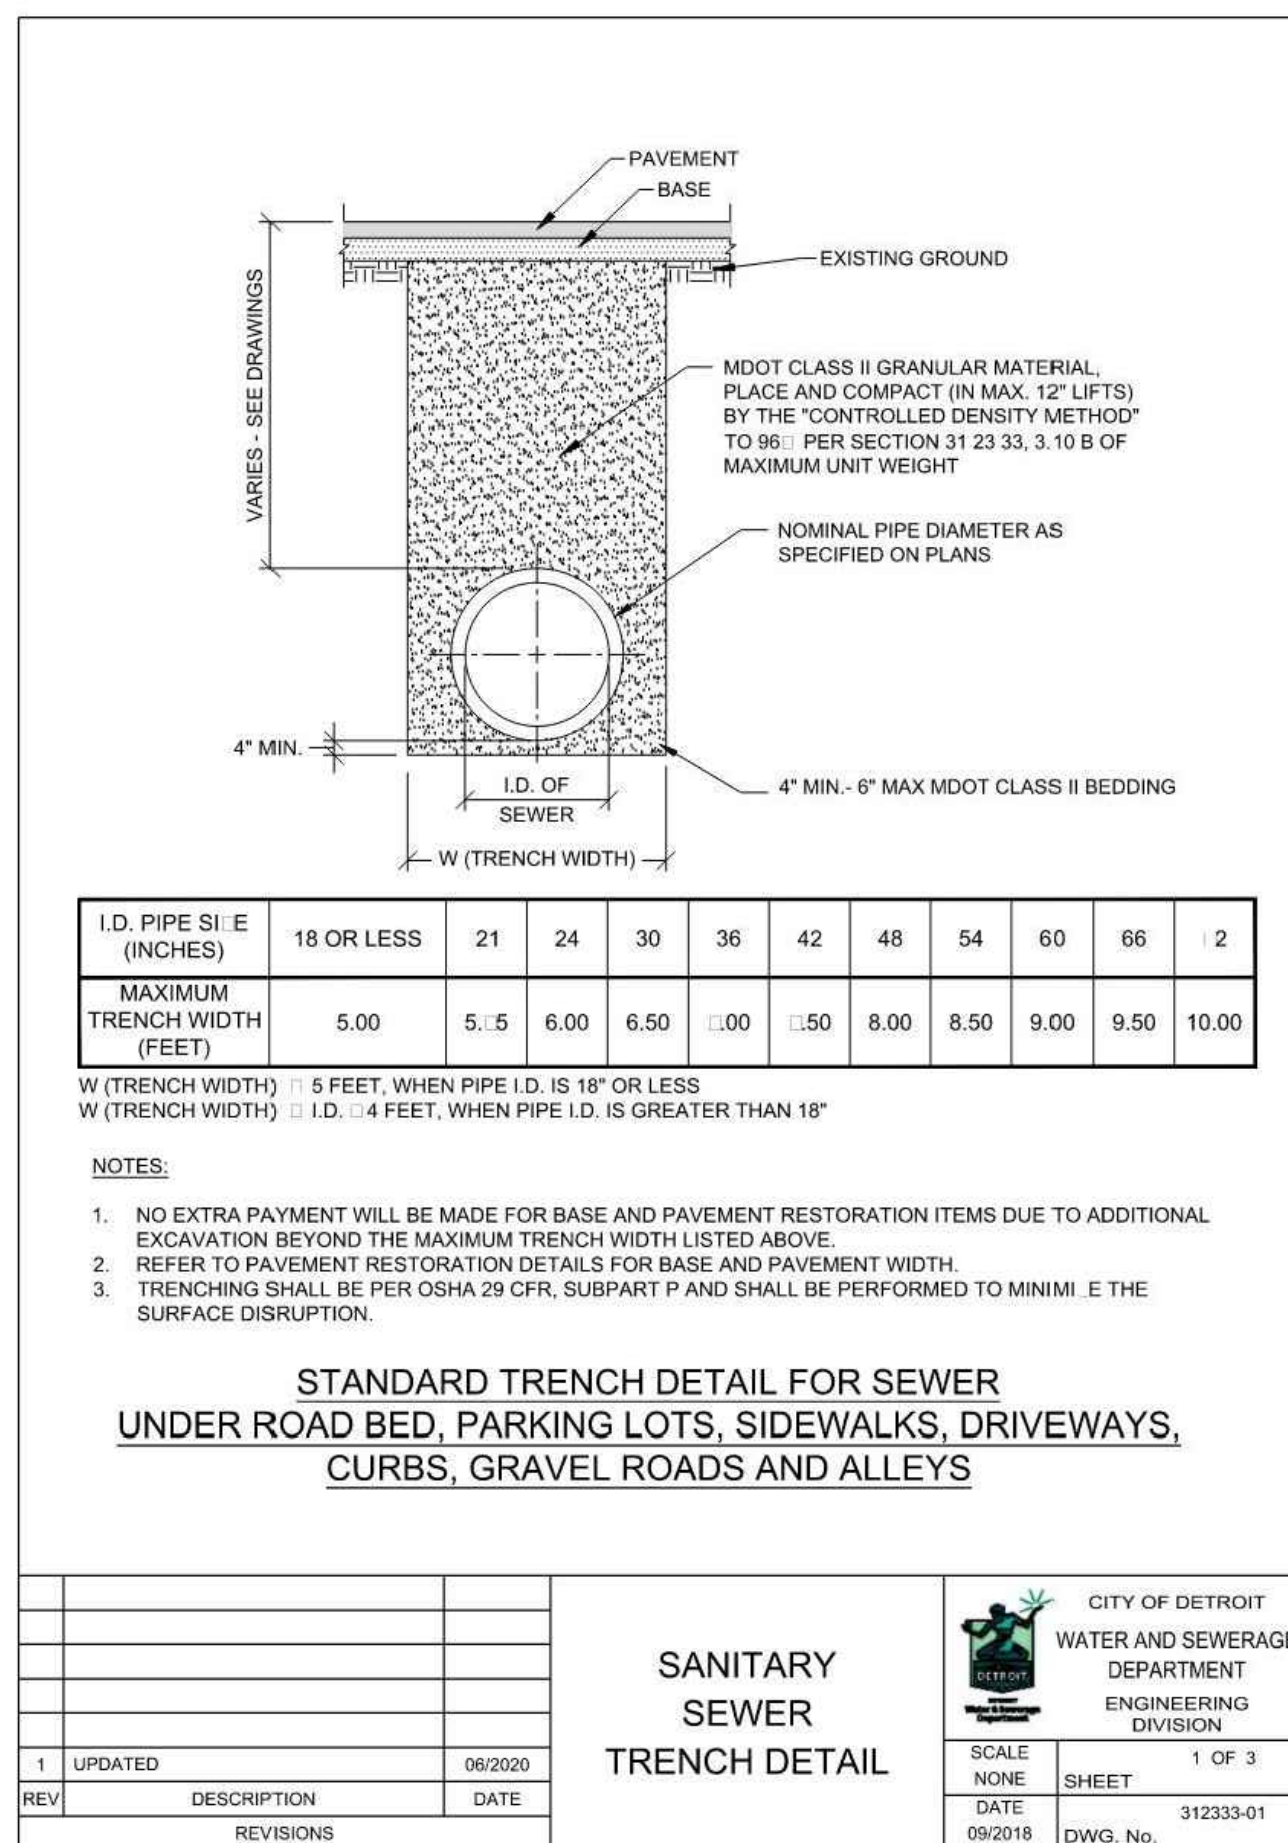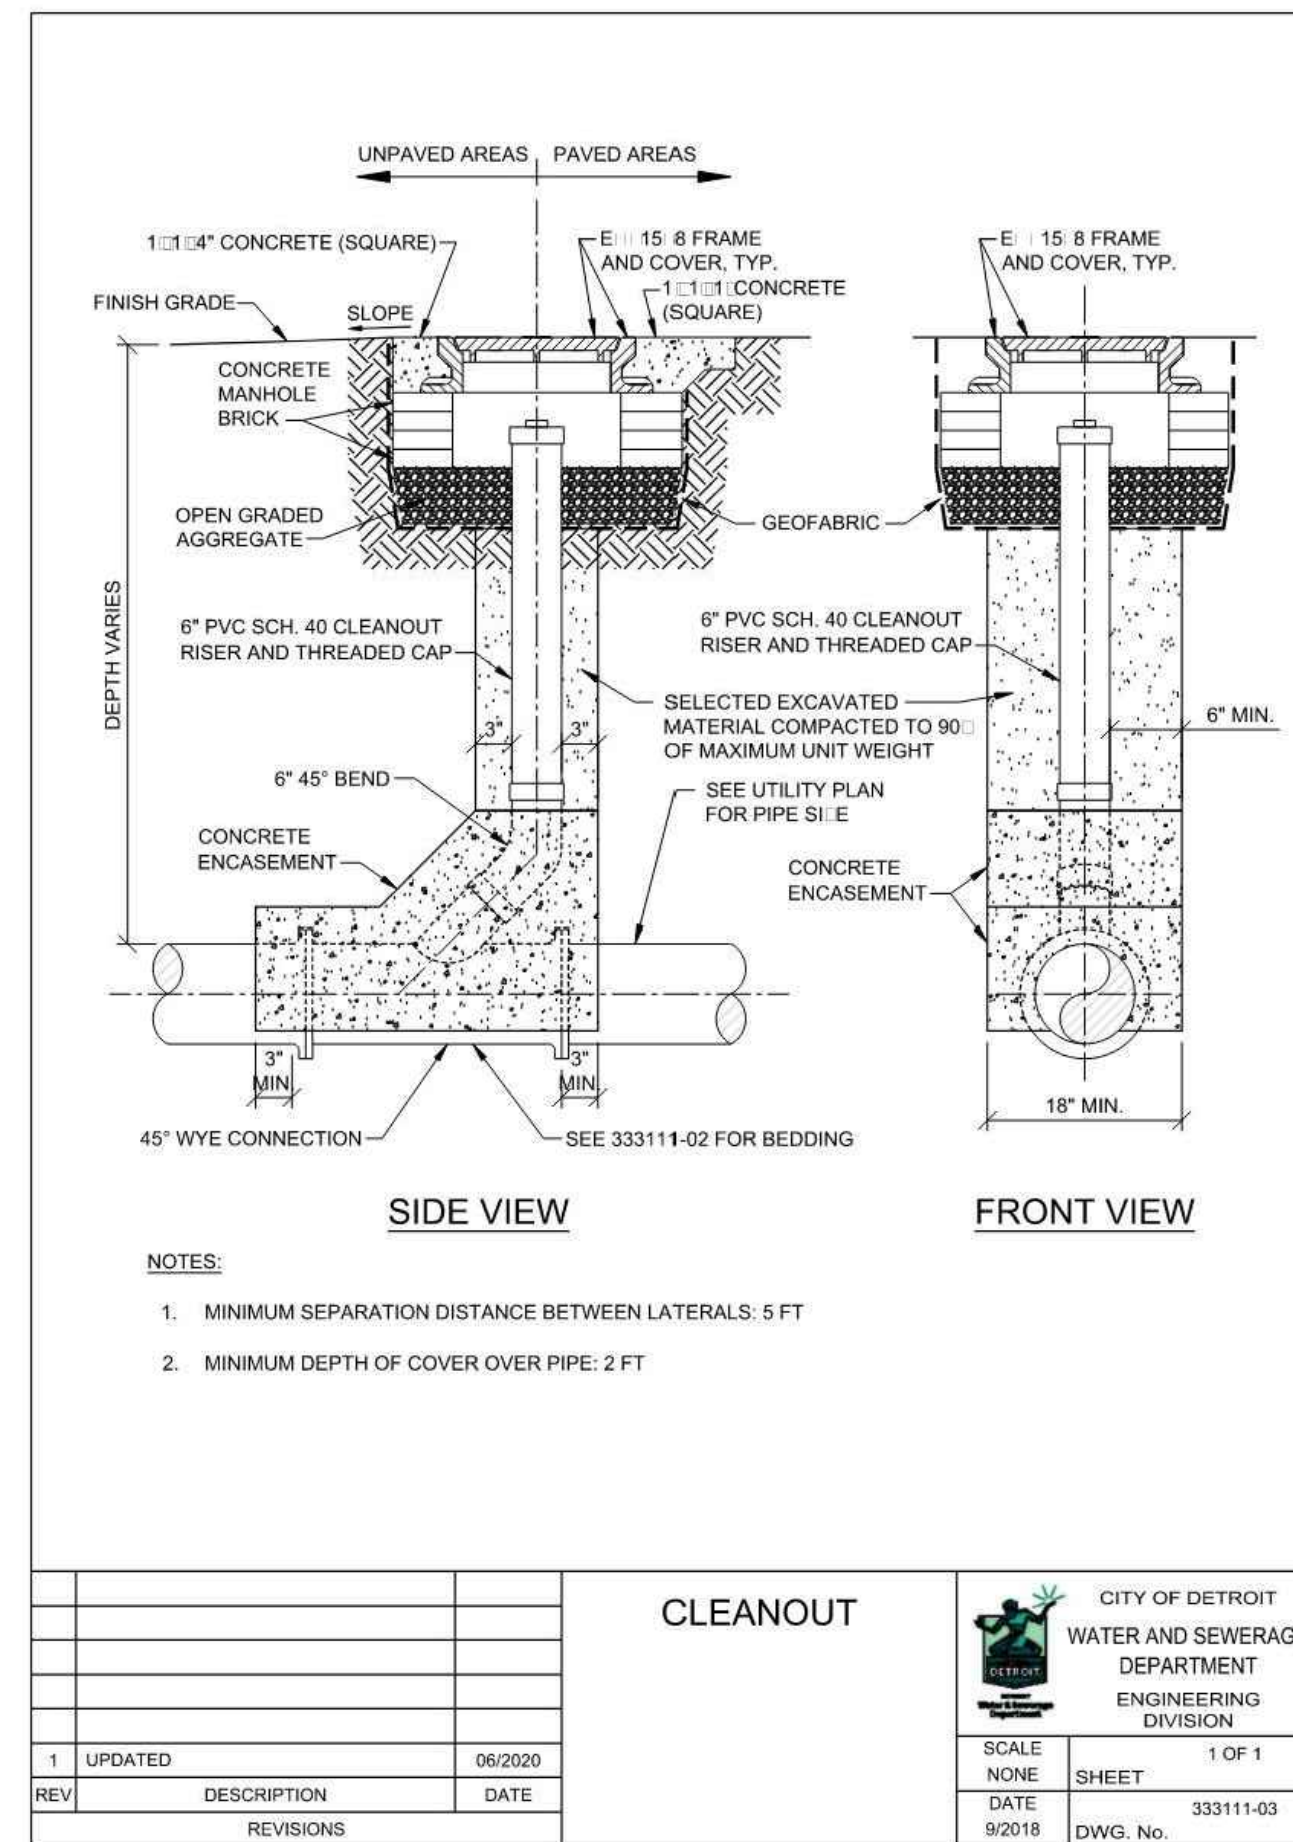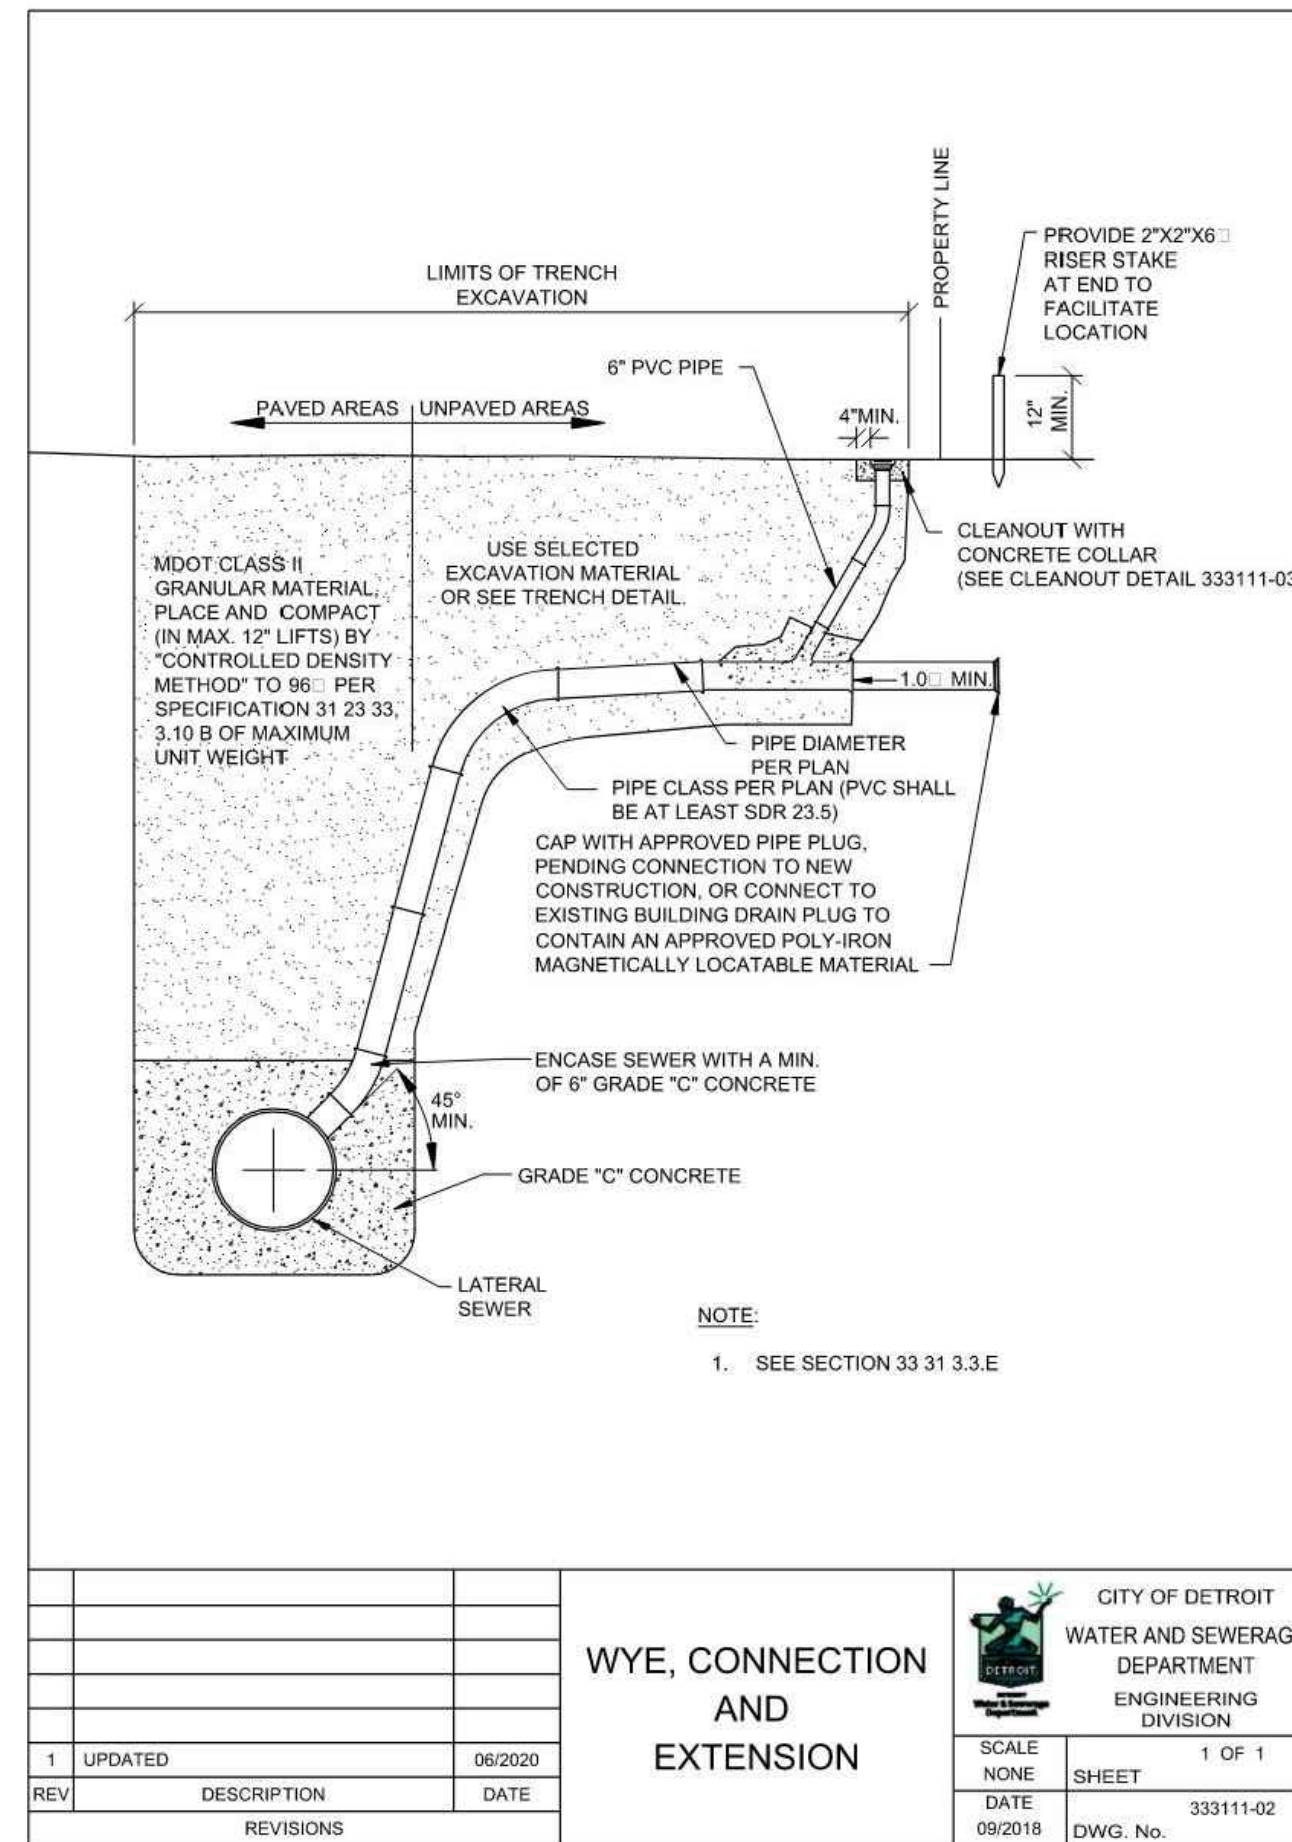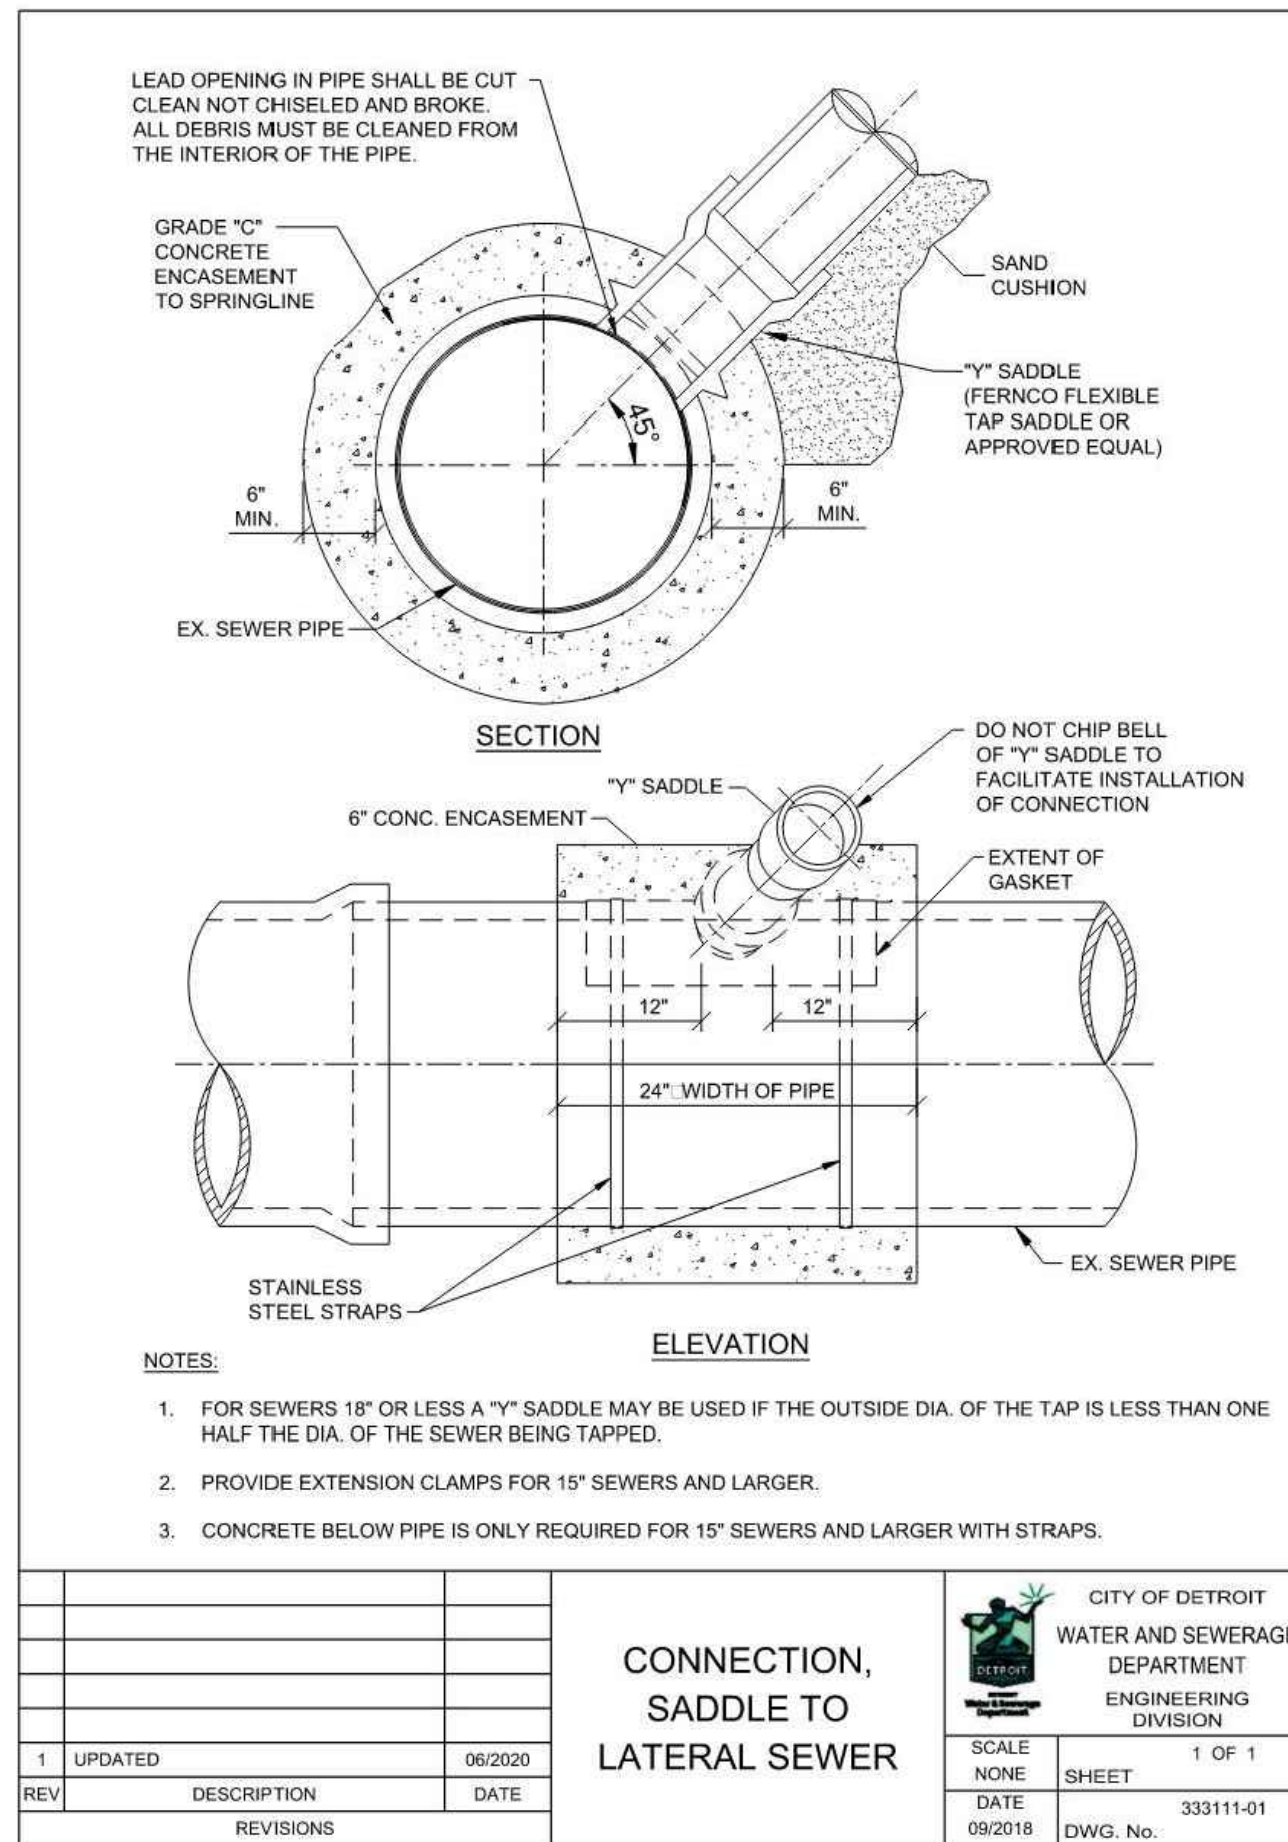

THE OMISSION OF ANY CURRENT STANDARD DETAIL DOES NOT RELIEVE THE CONTRACTOR FROM THIS REQUIREMENT. THE WORK SHALL BE PERFORMED IN COMPLETE CONFORMANCE WITH THE CURRENT DWSD STANDARD SPECIFICATIONS AND DETAILS

This document has not been reviewed by the stamping party. Therefore, the stamping party makes no representation(s) with respect to its contents, and shall not be liable for such. Any reliance on this stamp shall be at the relying party(ies)'s own risk and hereby waives any and all claim(s) related to the existence of the stamp or otherwise.

FOR REFERENCE ONLY

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAP/M: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
DETROIT DWSD
DETAILS

C-506

PLOT DATE:

CURB RETURN JOINING EXISTING PAVEMENT

* 4" FOR ASPHALT DRIVE PAVEMENT

NOTES:
CONSTRUCT THE DRIVE APPROACH WITH 8" NON-REINFORCED CONCRETE ON 6" OF 21AA AGGREGATE BASE COURSE COMPACTED IN PLACE (CIP) OR 6" HMA LEVELING ON 9" OF 21AA AGGREGATE BASE COURSE (CIP).
CURBS SHALL BE CONSTRUCTED WITH HEIGHT VARYING FROM 6" AT BACK OF CURB TO 0" HEIGHT AT FACE OF SIDEWALK OR RIGHT-OF-WAY LINE.
AT ALL CONCRETE DRIVES, PLACE A 1" EXPANSION JOINT AT BACK OF CURB AND 1/2" EXPANSION JOINT AT FACE OF SIDEWALK OR RIGHT-OF-WAY LINE. MAINTAIN NORMAL SIDEWALK GRADE ACROSS DRIVE, 2% SLOPE UP FROM FACE OF SIDEWALK.
INBOUND OR OUTBOUND RADIUS SHALL BE REDUCED TO 5' FOR ONE-WAY TRAFFIC DRIVE APPROACH.
DRIVE APPROACH SHALL NOT ENDOACH ACROSS PROPERTY LINE EXTENDED WITHOUT WRITTEN APPROVAL FROM THE ADJOINING PROPERTY OWNER.

WORK THIS SHEET WITH THE GENERAL NOTES ON RS-1 AND D-6 SHEET 2-2.

REVISION DATE: 08/01/07	WAYNE COUNTY DEPARTMENT OF PUBLIC SERVICES ENGINEERING DIVISION/PERMIT OFFICE PERMIT STANDARDS	SCALE NOT TO SCALE D-6
DIRECTOR OF ENGINEERING	COMMERCIAL DRIVE APPROACH	SHEET 1 OF 2

CURB RETURN JOINING EXISTING PAVEMENT

* 4" FOR HMA DRIVE PAVEMENT. NO EXPANSION JOINT REQUIRED.

NOTES:
CONSTRUCT THE DRIVE APPROACH WITH 8" NON-REINFORCED CONCRETE ON 6" OF 21AA AGGREGATE BASE COURSE COMPACTED IN PLACE (CIP) OR 6" HMA LEVELING ON 9" OF 21AA AGGREGATE BASE COURSE (CIP).
CURBS SHALL BE CONSTRUCTED WITH HEIGHT VARYING FROM 6" AT BACK OF CURB TO 0" HEIGHT AT FACE OF SIDEWALK OR RIGHT-OF-WAY LINE.
AT ALL CONCRETE DRIVES, PLACE A 1" EXPANSION JOINT AT BACK OF CURB AND 1/2" EXPANSION JOINT AT FACE OF SIDEWALK OR RIGHT-OF-WAY LINE. MAINTAIN NORMAL SIDEWALK GRADE ACROSS DRIVE, 2% SLOPE UP FROM FACE OF SIDEWALK.
INBOUND OR OUTBOUND RADIUS SHALL BE REDUCED TO 5' FOR ONE-WAY TRAFFIC DRIVE APPROACH.
DRIVE APPROACH SHALL NOT ENDOACH ACROSS PROPERTY LINE EXTENDED WITHOUT WRITTEN APPROVAL FROM THE ADJOINING PROPERTY OWNER.

WORK THIS SHEET WITH THE GENERAL NOTES ON RS-1.

REVISION DATE: 08/01/07	WAYNE COUNTY DEPARTMENT OF PUBLIC SERVICES ENGINEERING DIVISION/PERMIT OFFICE PERMIT STANDARDS	SCALE NOT TO SCALE D-6
DIRECTOR OF ENGINEERING	COMMERCIAL DRIVE APPROACH	SHEET 2 OF 2

CONCRETE SIDEWALK

Work this Sheet with the General Notes on RS-1

REVISION DATE: 08/01/07	WAYNE COUNTY DEPARTMENT OF PUBLIC SERVICES ENGINEERING DIVISION/PERMIT OFFICE PERMIT STANDARDS	SCALE NOT TO SCALE RS-5
DIRECTOR OF ENGINEERING	CONCRETE SIDEWALK	SHEET 1 OF 1

All transverse joints in the concrete pavement shall extend entirely through the integral curb and be of the same kind and thickness as provided for the pavement. The joint material shall be pre-cut so as to conform to the geometric shape and cross sectional area of the curb, and shall be placed in contact with the filler material in the pavement.

Integral curbs, which are placed as part of a concrete base course pavement shall have transverse plane of weakness joints, formed by placing a pre-molded bituminous filler 1/4 inch thick, entirely through the curb, in exact alignment with all joints in the base course pavement. The joint material shall be pre-cut so as to conform to the geometric shape and cross sectional area of the curb.

The edges of all transverse joints in the integral curb shall be rounded with an approved finishing tool having a radius of 1/4 inch.

INTEGRAL STRAIGHT CURB

CONCRETE PAVEMENT TYPE 3 CONCRETE BASE COURSE TYPE 4

INTEGRAL STRAIGHT CURB W/REVERSE GUTTER PAN

Notes:
Reverse Gutter Pan to be used on island within Cul-De-Sacs and Eyebrows as indicated on Intersection details.

Work This Sheet with the General Notes on RS-1

REVISION DATE: 08/01/07	WAYNE COUNTY DEPARTMENT OF PUBLIC SERVICES ENGINEERING DIVISION/PERMIT OFFICE PERMIT STANDARDS	SCALE NOT TO SCALE RS-3
DIRECTOR OF ENGINEERING	CURB AND CURB & GUTTER DETAILS	SHEET 1 OF 3

MOUNTABLE CURB AND GUTTER

STRAIGHT CURB AND GUTTER

NOTES:
PLANE OF WEAKNESS JOINTS SHALL BE PLACED BETWEEN EXPANSION JOINTS AT APPROXIMATELY 10' INTERVALS.
EXPANSION JOINTS SHALL BE PLACED 10' EACH SIDE OF ALL CATCH BASINS AND AT THE ENDS OF RADII AT ALL STREET RETURNS AND SEALED WITH HOT-POURED RUBBER ASPHALT COMPOUND.
MATCH CONCRETE PAVEMENT JOINTS NOT TO EXCEED 25' SPACINGS.
"T" IS THE DEPTH OF PROPOSED CURB AND GUTTER SECTION THAT SHALL MATCH THE THICKNESS OF PROPOSED PAVEMENT, UNLESS OTHERWISE DIRECTED BY THE WAYNE COUNTY ENGINEER OR AS SHOWN ON APPROVED PLANS.
OMIT LANE TIES WHEN PLACING CURB NEXT TO HMA PAVEMENT.
PLACE 1" FIBER JOINT FILLER AT 400' MAXIMUM INTERVALS.

WORK THIS SHEET WITH THE GENERAL NOTES ON RS-1

REVISION DATE: 08/01/07	WAYNE COUNTY DEPARTMENT OF PUBLIC SERVICES ENGINEERING DIVISION/PERMIT OFFICE PERMIT STANDARDS	SCALE NO SCALE RS-3
DIRECTOR OF ENGINEERING	CURB AND CURB & GUTTER DETAILS	SHEET 2 OF 3

STRAIGHT CURB & GUTTER

MOUNTABLE CURB & GUTTER

WORK THIS SHEET WITH "S" SERIES STANDARDS.

REVISION DATE: 08/01/07	WAYNE COUNTY DEPARTMENT OF PUBLIC SERVICES ENGINEERING DIVISION/PERMIT OFFICE PERMIT STANDARDS	SCALE NO SCALE RS-3
DIRECTOR OF ENGINEERING	CURB AND CURB & GUTTER DETAILS	SHEET 3 OF 3

FOR
REFERENCE
ONLY

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAP/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236





ENDEAVOR 2.0
WAYNE COUNTY
STANDARD
DRAWINGS

C-508

PLOT DATE:


This document has not been reviewed by the stamping party. Therefore, the stamping party makes no representation(s) with respect to its contents, and shall not be liable for such. Any reliance on this stamp shall be at the relying party(ies)'s own risk and hereby waives any and all claim(s) related to the existence of the stamp or otherwise.

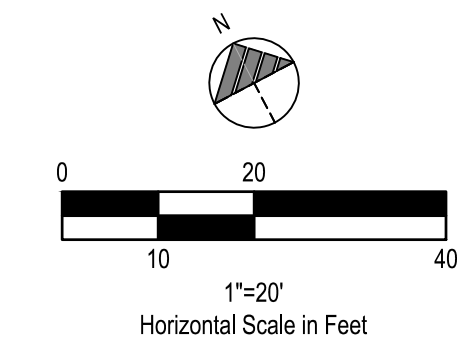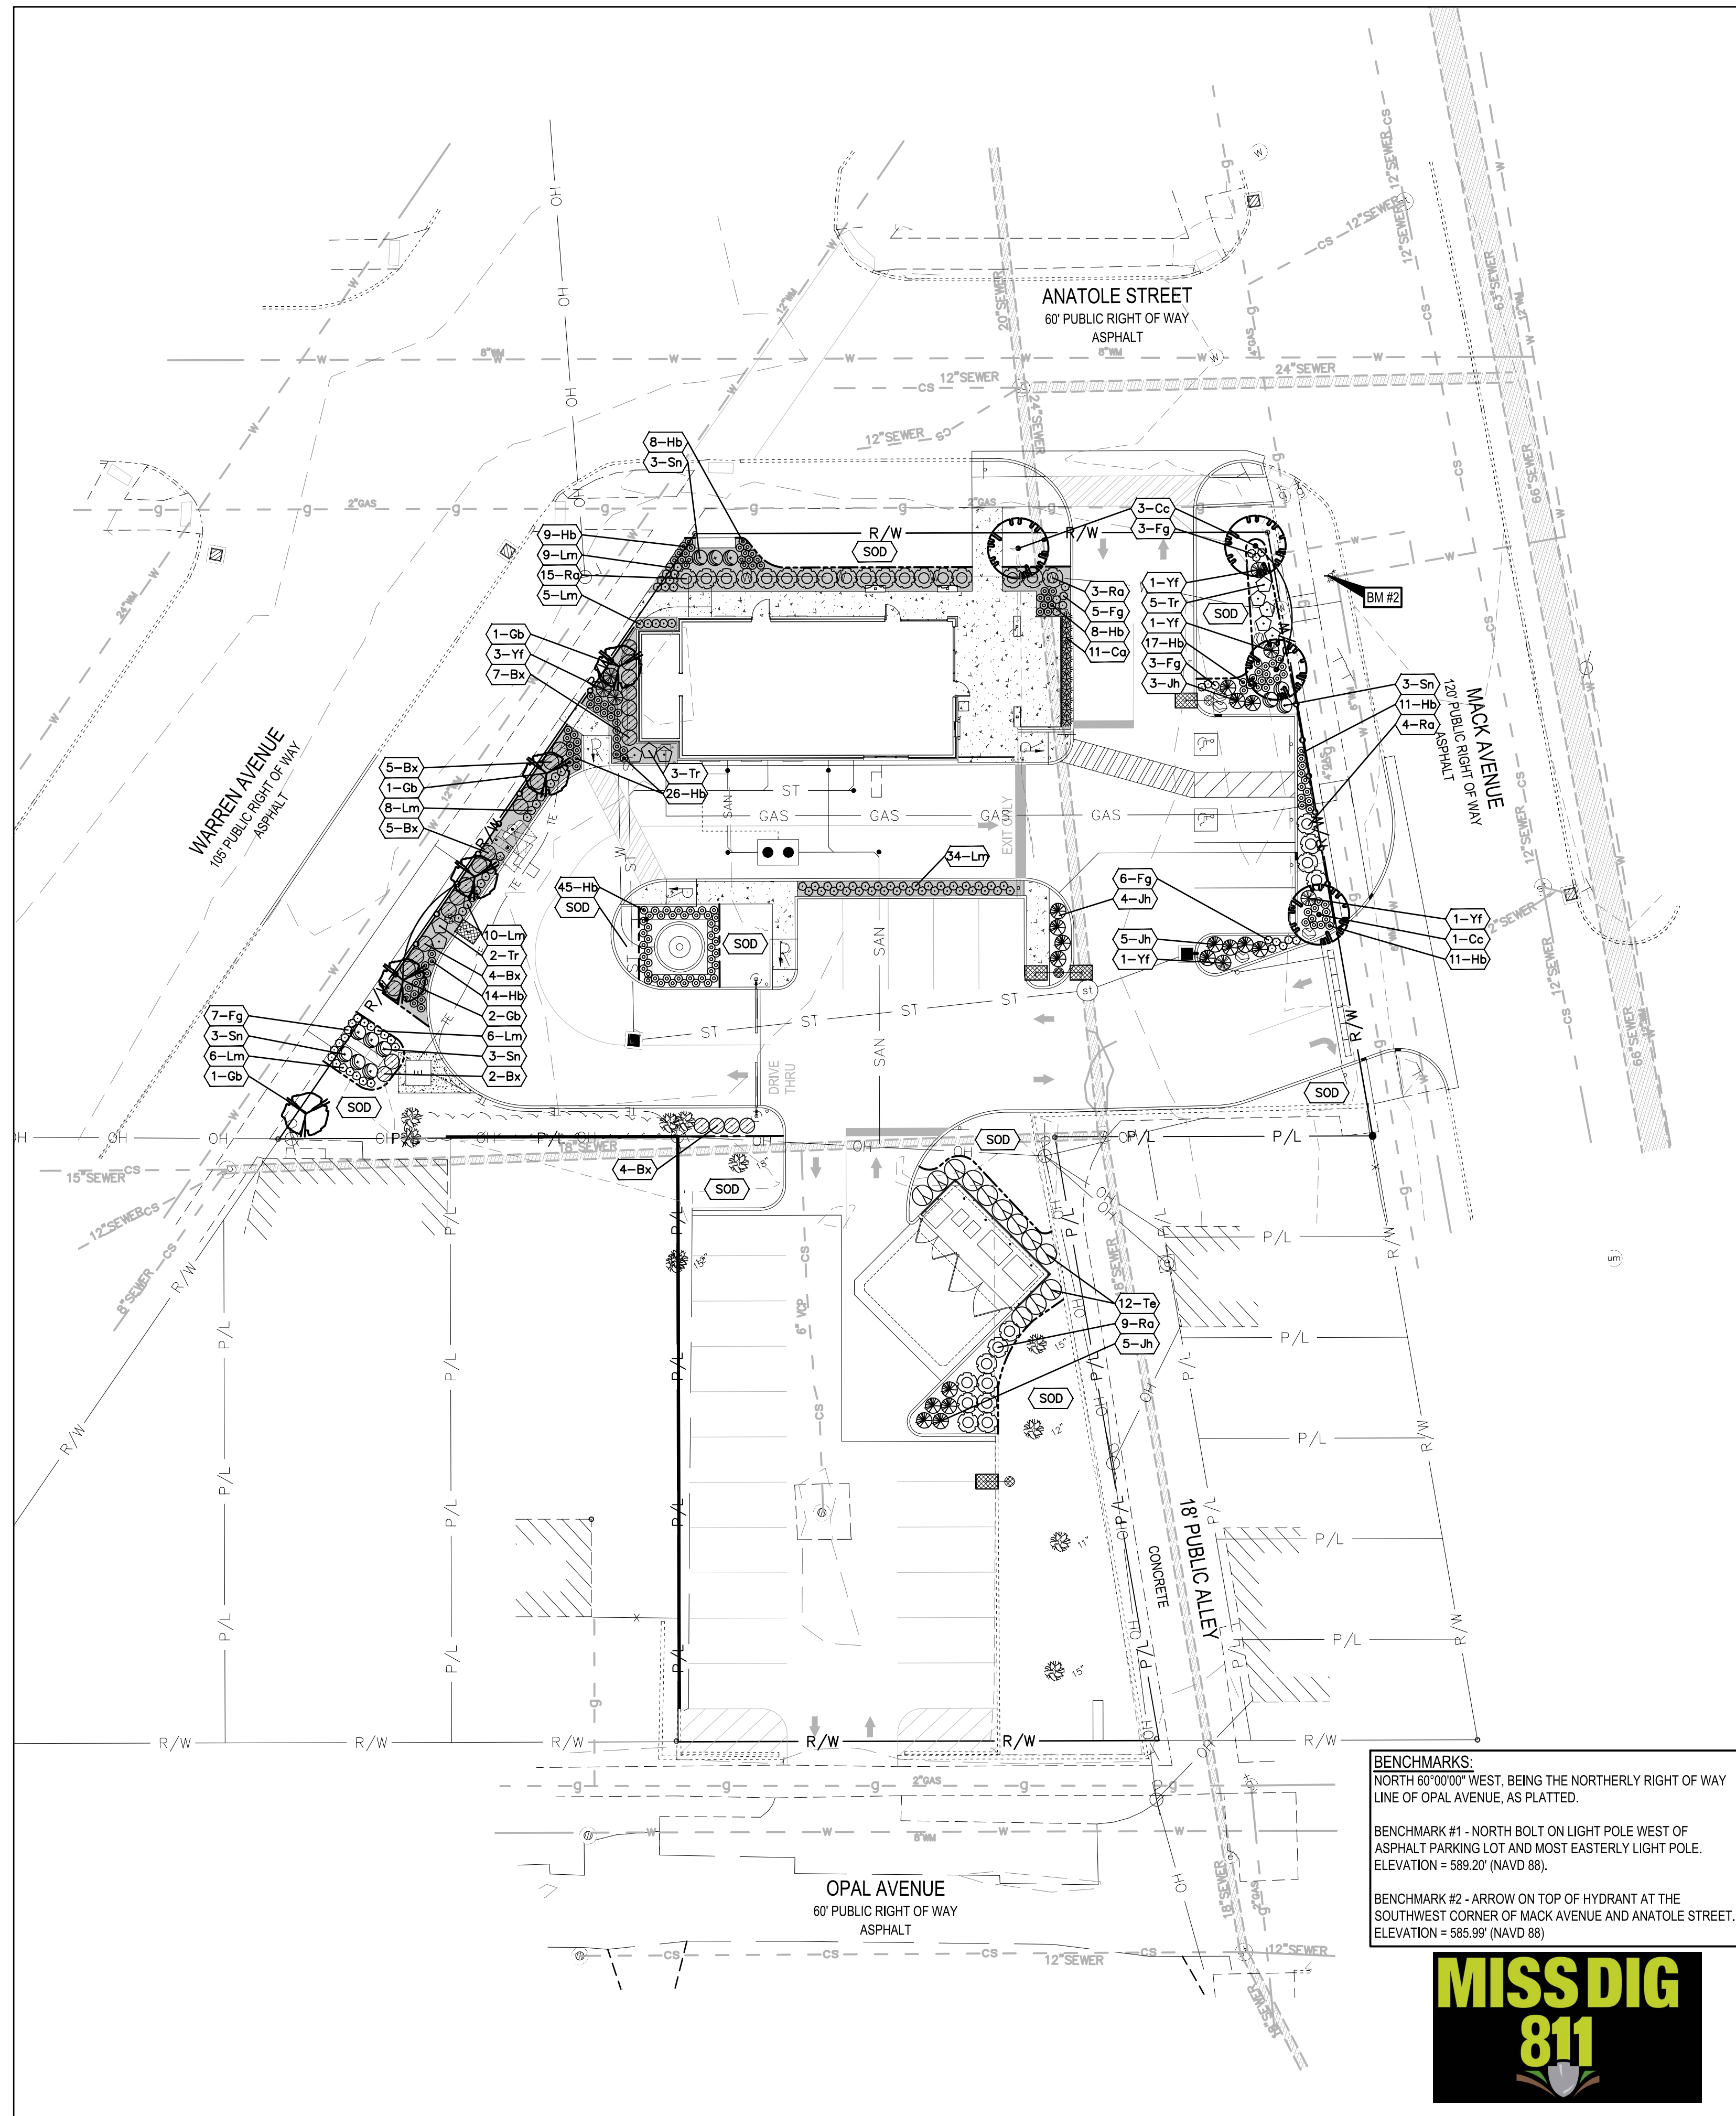

LANDSCAPE NOTES

- MULCH PER LANDSCAPE SPECIFICATIONS.
- ALL DISTURBED AREAS NOT TO BE PAVED OR MULCHED SHALL BE SODDED PER SPECIFICATIONS.
- ALL DISTURBED AREAS WITHIN THE R.O.W. NOT TO BE PAVED, SHALL BE SEEDED PER THE SPECIFICATIONS.

LANDSCAPE LEGEND

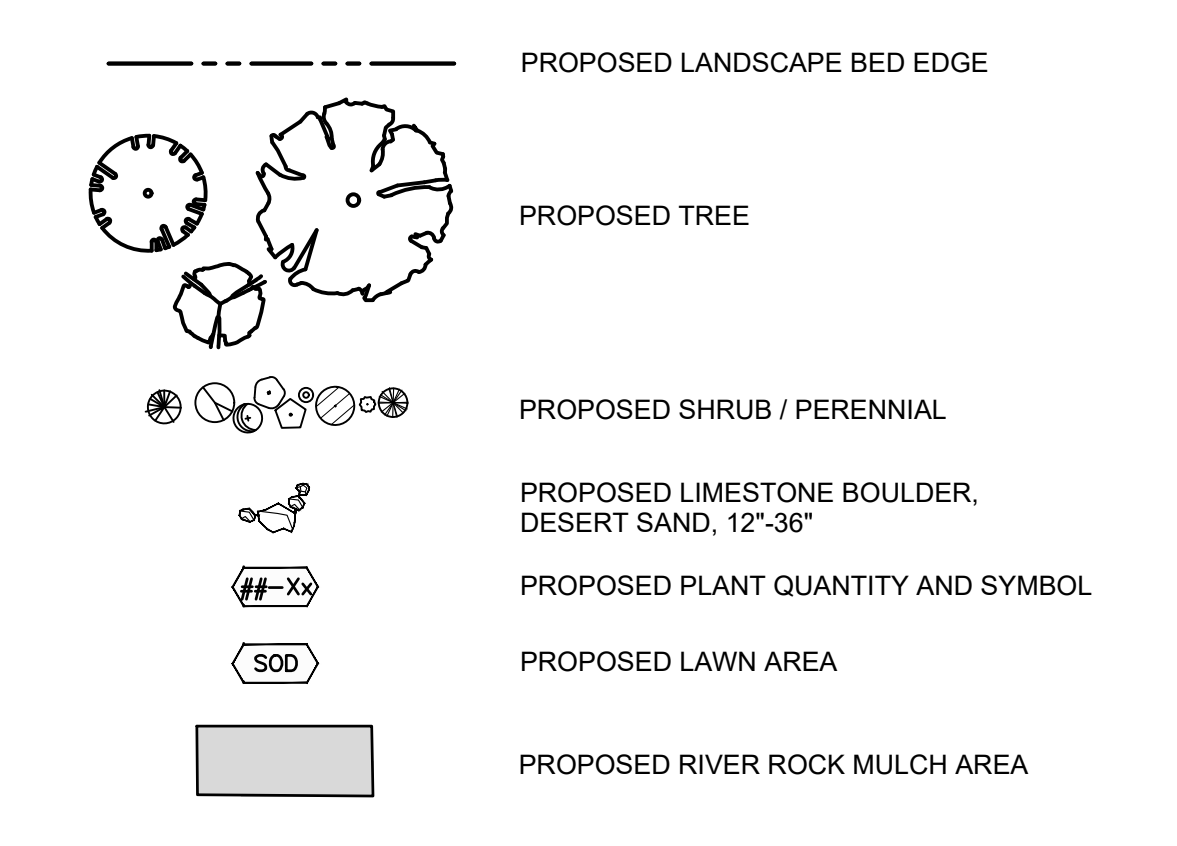

LANDSCAPE CALCULATIONS

ROW SCREENING:
REQUIRED: ONE TREE PER 30 LF OF LANDSCAPE BUFFER & 75% OPACITY VEG SCREENING @ 30" HT.
WARREN AVE - 140.9 LF / 30 = 4.69 = 5 TREES REQUIRED 5 TREE PROPOSED
ANATOLE ST - 58 LF / 30 = 1.9 = 2 TREES REQUIRED 2 TREES PROPOSED
MACK AVE - 81.4 LF / 30 = 2.7 = 3 TREES REQUIRED 3 TREES PROPOSED

MIX OF WROUGHT IRON FENCING AND SHRUB ROW ALONG ALL ROWS.

INTERIOR LANDSCAPE:
REQUIRED: 18 SF OF LANDSCAPE AREA PER PARKING SPACE & ONE TREE FOR EACH 250 SF
25 PROPOSED PARKING SPACES
450 SF OF REQUIRED LANDSCAPE AREA
1.8 = 2 TREES REQUIRED

1,428 SF OF PROPOSED LANDSCAPE AREA
2 TREES (1 EXISTING TREE, 1 PROPOSED TREE)



DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PAP/M: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



**ENDEAVOR 2.0
LANDSCAPE
PLAN**







L-101

PLOT DATE:

PLANT LIST

Symbol	Botanical Name	Common Name	Qty.	Min. Size	Condition	Remarks
Bx	Buxus 'Green Velvet'	Green Velvet Boxwood	27	24" H Min.	B&B	3' o/c
Ca	Calamagrostis acutiflora 'Karl Foerster'	Feather Reedgrass	11	No. 2	Cont.	2' o/c
Cc	Crataegus crus-galli f. inermis 'Crusader'	Crusader Hawthorn	4	2" Cal.	B&B	Specimen
Gb	Ginkgo biloba 'Princeton Sentry'	Princeton Sentry Ginkgo	5	2" Cal.	B&B	Specimen
Fg	Festuca glauca	Blue Fescue	24	No. 2	Cont.	Per Plan
Hb	Hemerocallis 'Going Bananas'	Going Bananas Daylily	152	No. 1	Cont.	1.5' o/c
Jh	Juniperus horizontalis 'Blue Chip'	Blue Chip Juniper	17	24" Spread, No. 3	Cont.	3' o/c
Lm	Liriope muscari 'Variegata'	Variegated Lily Turf	78	No. 1	Cont.	1.5' o/c
Ra	Rhus aromatica 'Gro-Low'	Gro-Low Fragrant Sumac	31	18" H, No. 3	Cont.	4.5' o/c
Sn	Spiraea nipponica 'Wedding Cake'	Wedding Cake Spirea	12	24" H Min.	Cont.	3.5' o/c
Te	Thuja occidentalis 'Smaragd'	Emerald Arborvitae	12	5' H	B&B	4' o/c
Tr	Thuja occidentalis 'Rheingold'	Rheingold Arborvitae	10	24" H Min.	B&B	3' o/c
Yf	Yucca filamentosa 'Color Guard'	Color Guard Yucca	7	No. 5	Cont.	Per Plan



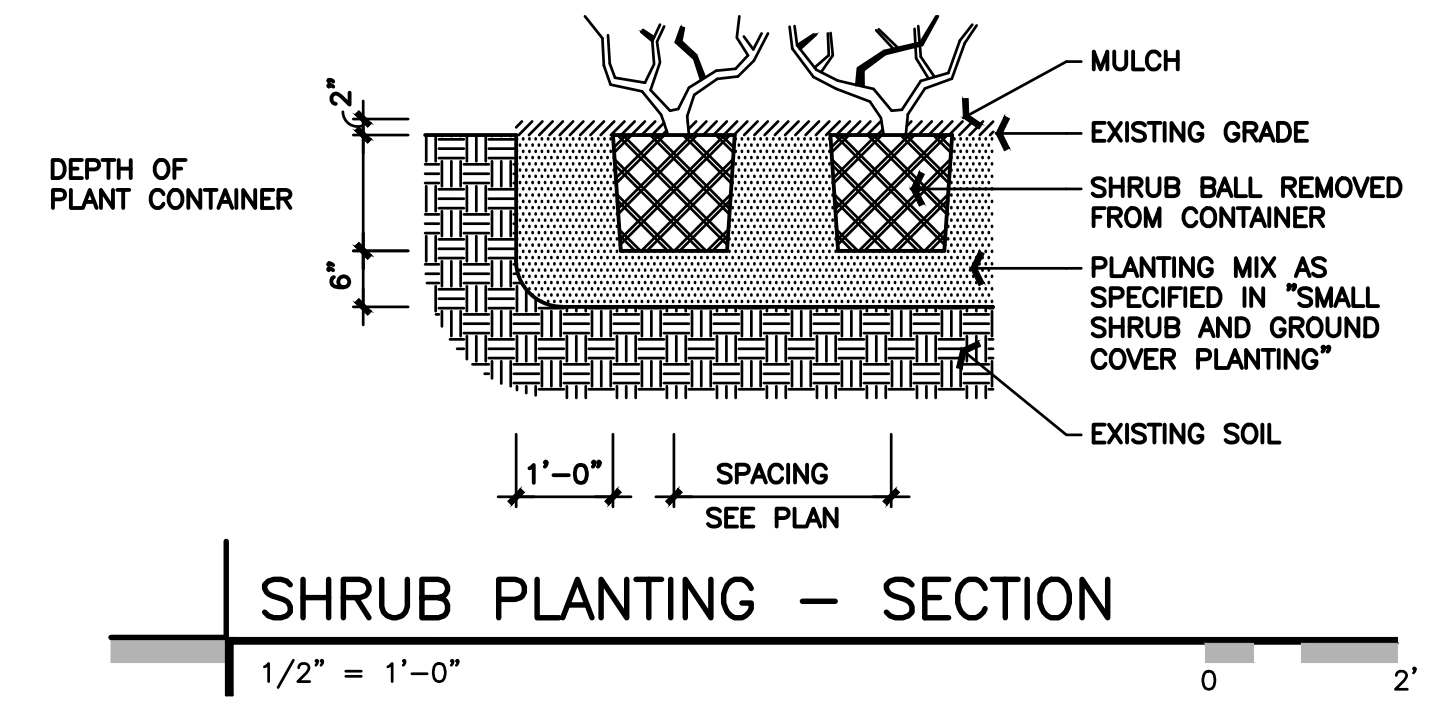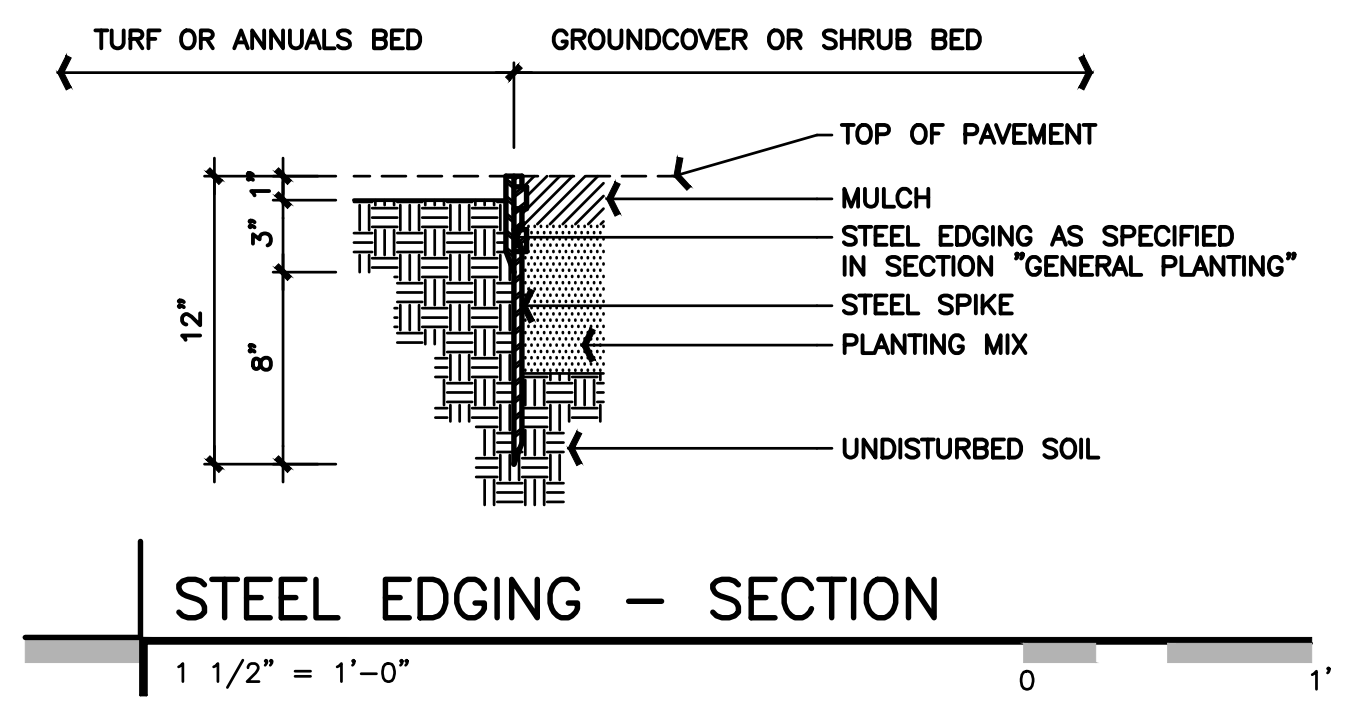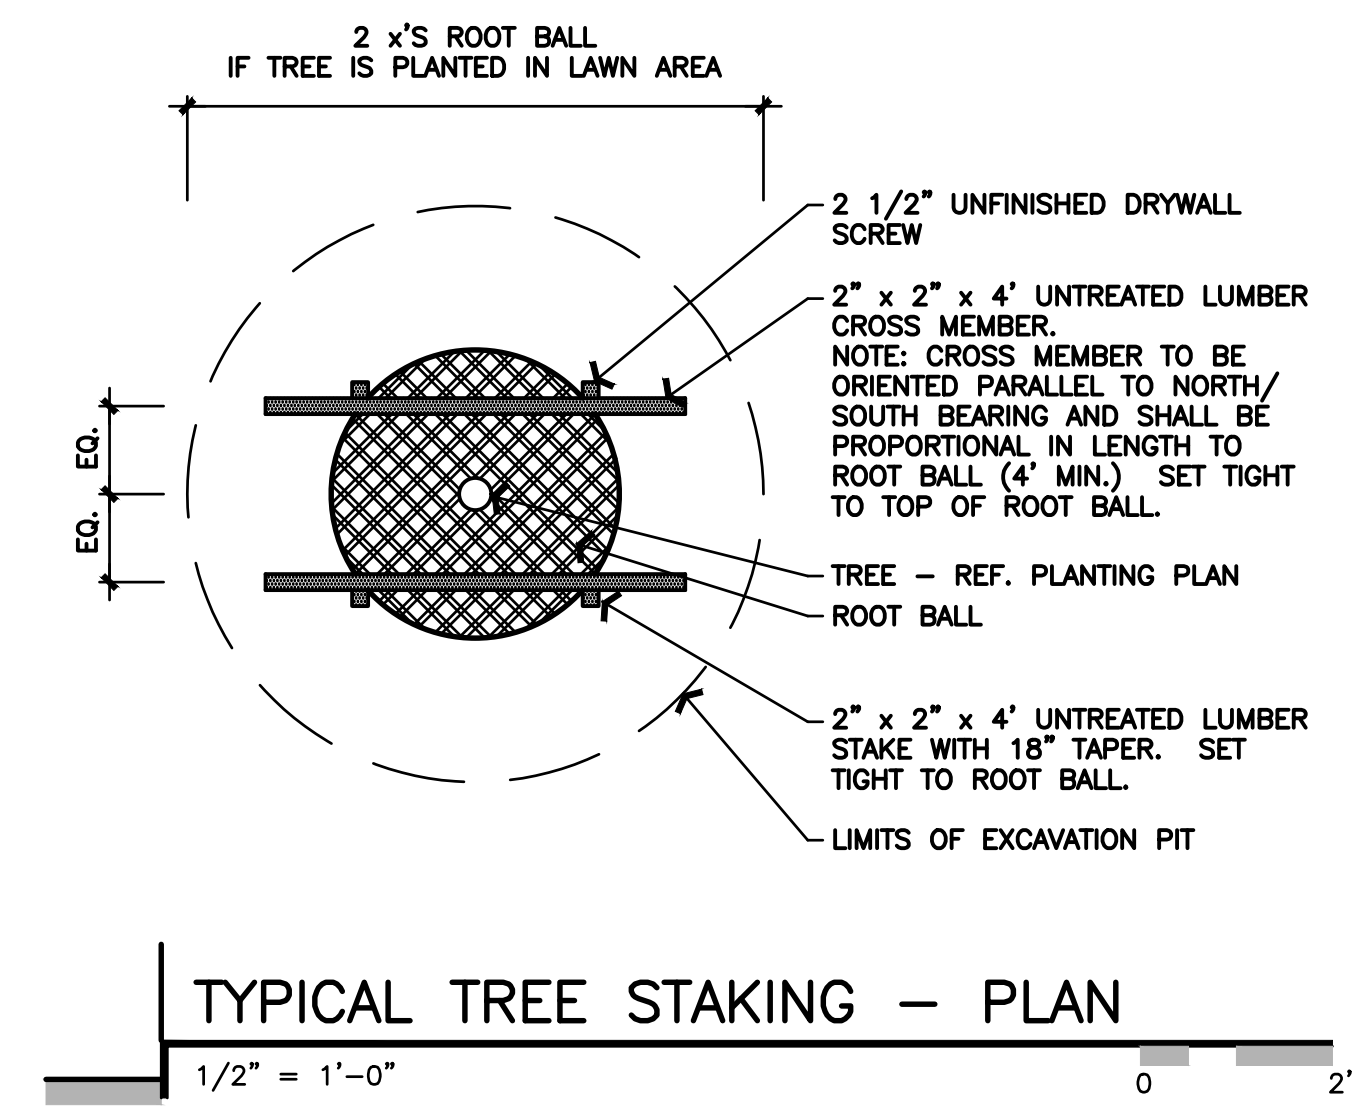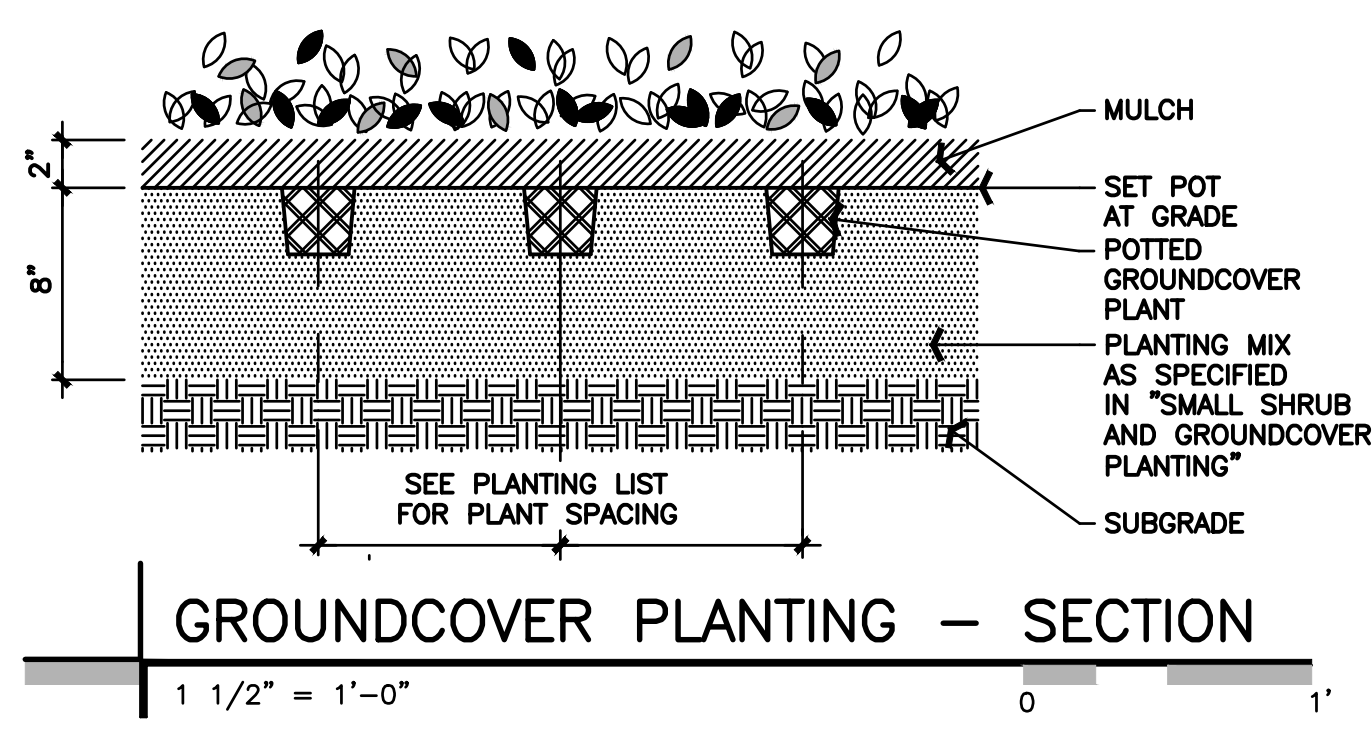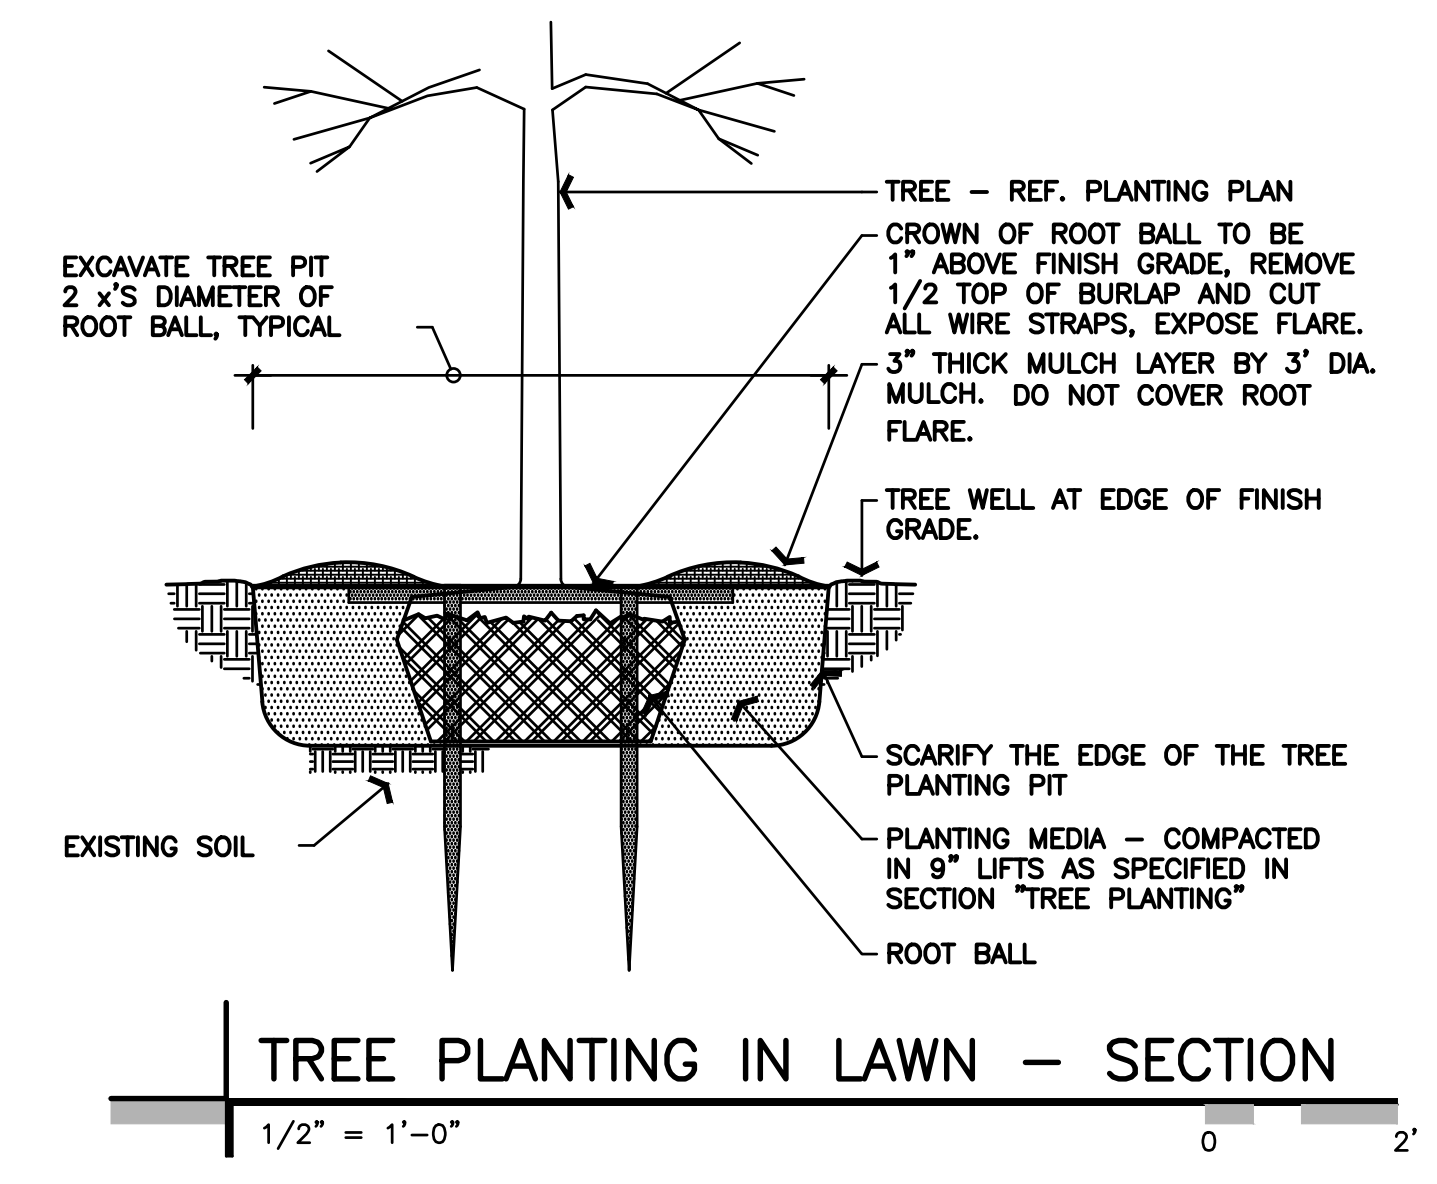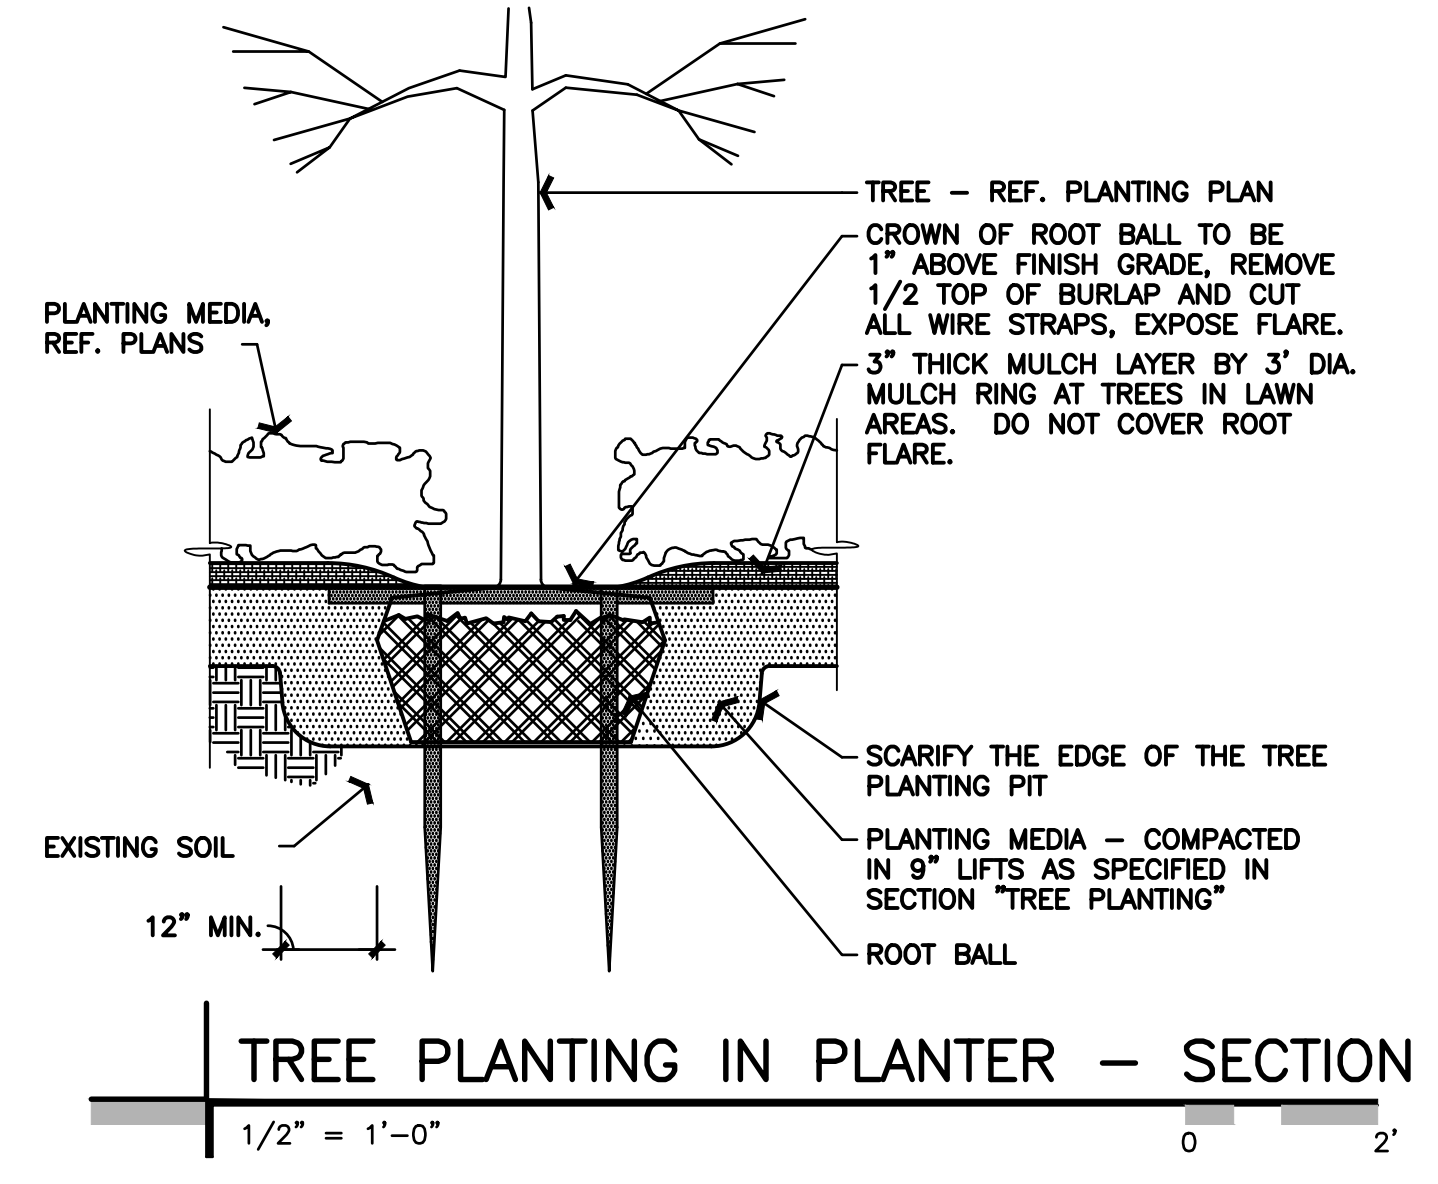

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
P/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0
LANDSCAPE
DETAILS

L-501

PLOT DATE:

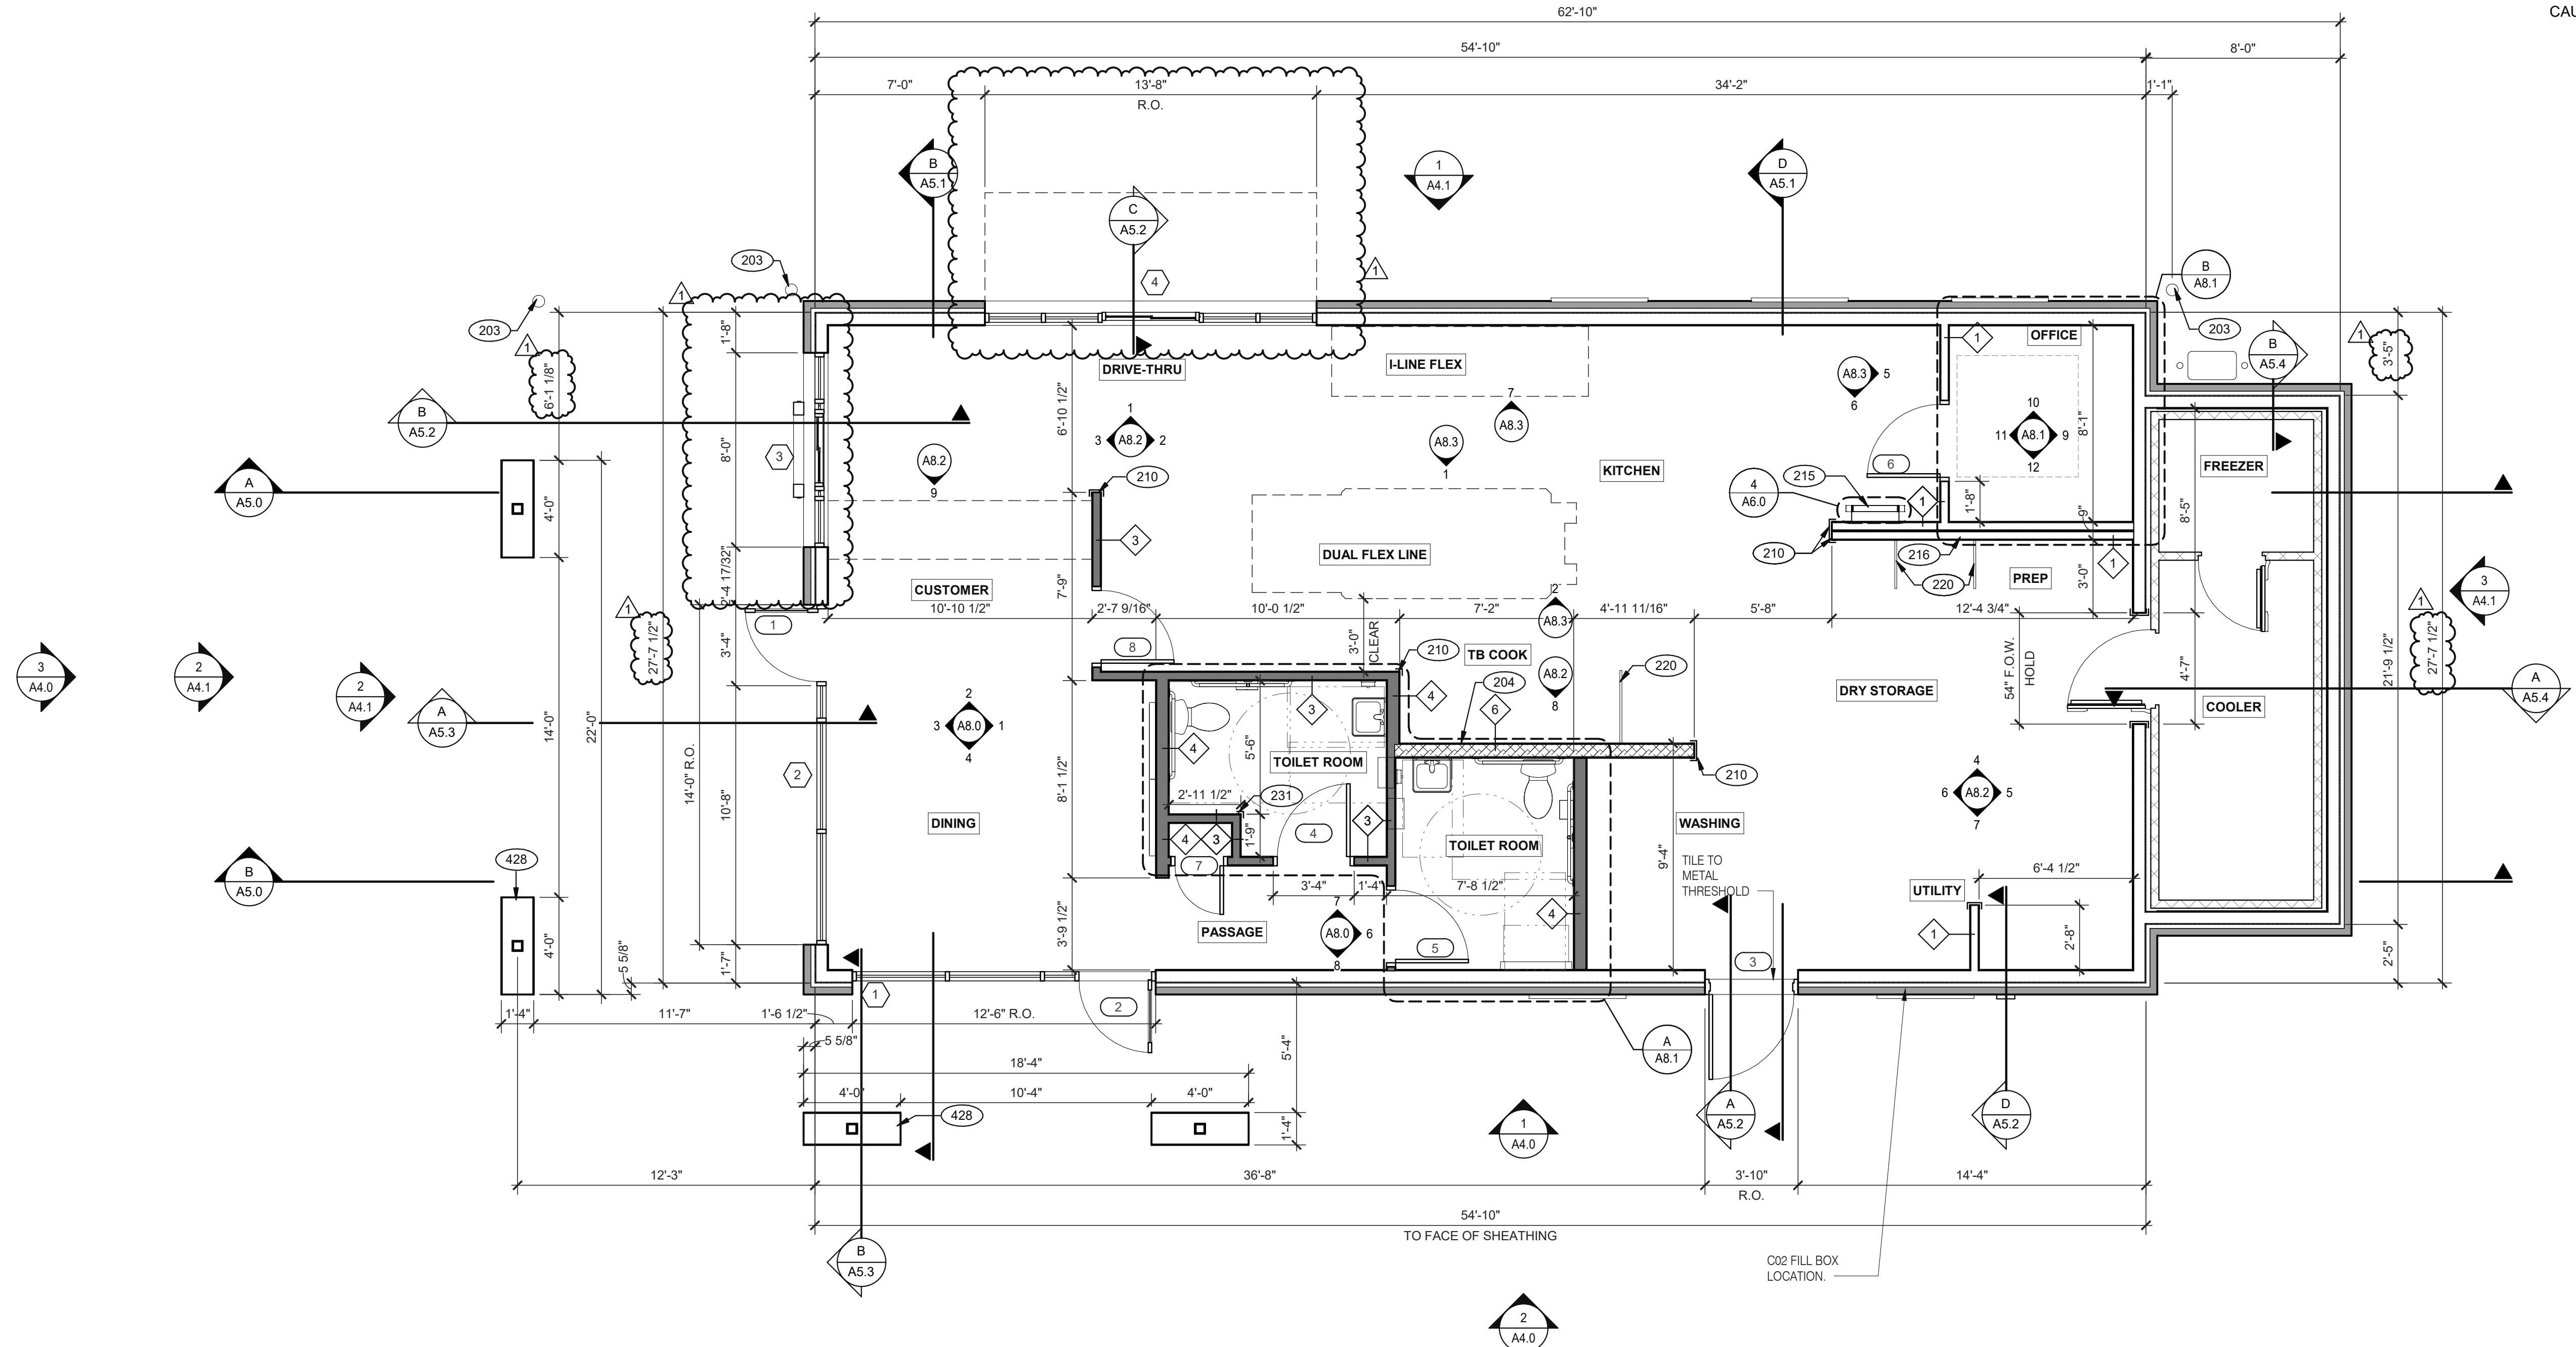

FLOOR PLAN 1/4" = 1'-0" **1**

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: Dickson
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0 FLOOR PLAN

A1.0


PLOT DATE: 11/3/2022 11:19:26 AM

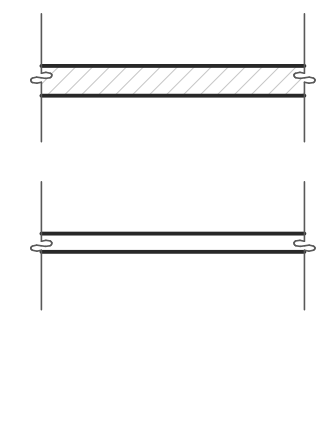

TYPICAL EXTERIOR WALL:
2X6 WD STUDS AT 16" O.C. W/ SHEATHING AS SCHEDULED (SEE STRUCT. DWGS.) AND R-19 KRAFT-FACED FIBERGLASS BATT INSULATION U.O.N. GC SHALL PROVIDE 2 LAYERS OF GRADE 'D' 60 lb BUILDING PAPER.

TYPICAL INTERIOR WALL:
WD STUDS AT 16" O.C. AS INDICATED

1 2X4 WOOD STUDS
2 2X6 WOOD STUDS

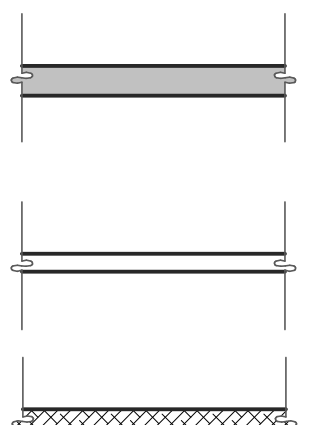

INTERIOR SOUND-RATED WALL:
TYPICAL INTERIOR WALL W/ 3-1/2" UNFACED FIBERGLASS BATT INSULATION.

3 2X4 WOOD STUDS 4 2X6 WOOD STUDS

LOW WALL:
2X4 WD STUDS AT 16" O.C. AS SCHEDULED (SEE DETAIL 15/A6.6)

5 2X6 WOOD STUDS

HOOD WALL:
INTERIOR NON-COMBUSTIBLE WALL WITH 20 GA. S.S. PANEL BEHIND HOOD. EXTEND MIN. 18" BEYOND END OF HOOD. M. STUD FRAMING. REFER TO DETAIL 2/M3.0 FOR EXTENT OF S.S. PANEL.

6 6" METAL STUD 7 3.5/8" METAL STUD

DASHED LINE INDICATES INTERIOR SUBSTRATE LOCATION.

WALL HEIGHTS:
ALL INTERIOR NON-BEARING WALLS GO TO BOTTOM OF TRUSS, U.O.N. REFER TO STRUCTURE.

WALL SUBSTRATES:
- DINING ROOM:
1/2" GYPSUM WALLBOARD FROM FLOOR SLAB TO 6" ABOVE CEILING HEIGHT U.O.N. SEE 6 & 8/A6.3 (NOTE: THE CEMENT BOARD SPECIFICATION IS DESIGNED TO ALLOW THE G.C. FLEXIBILITY.)
- KITCHEN WALLS AND DINING ROOM CLOSET:
1/2" CEMENT WALLBOARD FROM T.O. SLAB TO 12" A.F.F. AT 12" A.F.F., USE 1/2" CDX PLYWOOD W/FRP SURFACE FINISH TO 6" ABOVE CEILING HEIGHT U.O.N. IF DOUBLE SIDE SHEAR WALL PLYWOOD IS SPECIFIED THE PLYWOOD SHALL BE CONTINUOUS FROM SILL PLATE TO TOP PLATE. SEE 4/A6.3.
- RESTROOM WALLS:
5/8" CEMENT WALLBOARD FROM T.O. SLAB OR T.O. CONCRETE CURB TO 48" A.F.F., WITH 5/8" HI-IMPACT BRAND XP WALLBOARD, TYPE X CORE FROM T.O. CEMENT BOARD TO 6" ABOVE CEILING HEIGHT U.O.N. NO SUBSTITUTIONS ALLOWED. FINISH AS SCHEDULED.
- ALL OTHER FRAME WALL CONDITIONS:
1/2" CEMENT WALLBOARD FROM T.O. SLAB OR T.O. CONCRETE CURB TO 48" A.F.F., WITH 1/2" GYPSUM WALLBOARD FROM T.O. CEMENT BOARD TO 6" ABOVE CEILING HEIGHT U.O.N. FINISH AS SCHEDULE

WALL LEGEND **E**

DIMENSIONS:
A. ALL DIMENSIONS NOTED ARE TO FACE OF CONCRETE FOUNDATION, FACE OF SHEATHING ON EXTERIOR WALLS, AND FACE OF FINISH ON INTERIOR WALLS U.N.O.
B. DIMENSIONS NOTED AS "CLEAR" OR "HOLD" ARE MIN. REQUIRED. NET CLEARANCE FROM FACE OF WALL / WAINSCOT FINISH. VERIFY FINAL EQUIPMENT SIZES W/ VENDOR PRIOR TO INT. WALL FRAMING.

WINDOWS / DOORS:
A. SEE SHEET A1.1 FOR WINDOW TYPES AND DOOR SCHEDULE.
B. ALL DOOR AND WINDOW OPENING DIMENSIONS ARE TO ROUGH OPENING.

FINISH SUBSTRATES:
A. PROVIDE 1/2" THICK CEMENTITIOUS BD. FROM FLOOR SLAB TO 12" A.F.F. MIN. IN LIEU OF GYP. BD. AT ALL WALLS EXCEPT SHEARWALL SURFACES, U.O.N.
B. ALL JOINTS, GAPS OR SPACES LEADING TO ALL HOLLOW OR INACCESSIBLE SPACES SHALL BE SEALED WITH 'NSF INTERNATIONAL' APPROVED SEALANTS.
C. ALL BACK OF HOUSE AND OFFICE WALLS SHALL HAVE 1/2" CDX PLYWOOD SUBSTRATE, U.O.N.

DECOR:
A. SEE A2.0 FOR SEATING PLAN AND DETAILS.
B. SEE A7.0 FOR FLOOR FINISHES.
C. SEE A8.0, A8.3 FOR WALL FINISHES.
D. SEE A7.1 FOR CEILING FINISHES.


GENERAL:
A. PROVIDE THREE FIRE EXTINGUISHERS - (2) 10 lb. BC AND (1) 10 lb. ABC - TO COMPLY WITH LOCAL FIRE CODE. LOCATE PER DIRECTION OF FIRE MARSHALL OR LOCAL AUTHORIZING AGENT. FOR ADDITIONAL INFORMATION SEE SHEET A2.0
B. DRAWINGS ARE BASED UPON WOOD FRAMING. UTILIZATION OF METAL STUDS ON NON-BEARING INTERIOR PARTITIONS, BULKHEADS AND SOFFITS IS ACCEPTABLE.

FLOOR PLAN NOTES **D**

203 PIPE BOLLARD. SEE CIVIL DRAWINGS.
204 HOOD WALL. SEE WALL LEGEND.
210 S.S. CORNER GUARD/WALL CAP [TM-2]. TYP. ALL CORNERS IN BACK OF HOUSE FROM REAR WALL TO THE KITCHEN SIDE OF THE SERVICE COUNTER. SEE DETAIL 14/A6.3.
215 ROOF LADDER.
216 ADD SECOND 2X4 WALL ON KITCHEN SIDE.
220 SPLASH GUARD. SEE DETAIL 9/A6.3.
231 CORNER GUARD TILE SCHLUTER. SEE DETAIL 15/A6.3.
428 SCREEN WALL AND BUILDING TIE BACKS BY SIGNAGE VENDOR. SEE VENDOR DRAWINGS FOR MORE INFORMATION.

KEY NOTES **B**

C:\Users\mtd\Documents\Taco_Bell\Endeavor_2.0\Floor_Plan_A1.0.dwg, 11/3/2022, 11:19:26 AM

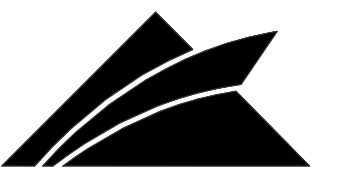

GPD GROUP Professional Corporation

520 S. MAIN STREET, SUIT 2531 AKRON, OH 44311 330.572.2100 FAX: 330.572.2102

- 1. DIMENSIONS ON THIS DRAWING ARE TO FRAME EDGE. REFER TO SHEETS A1.0 FOR ROUGH OPENING DIMENSION
2. SEE SCHEDULE FOR GLASS TYPES.
3. REFER TO FLOOR PLAN, ELEVATIONS AND WALL SECTIONS FOR ROUGH OPENING DIMENSIONS.
4. ALL STOREFRONT MATERIAL AND GLAZING SHALL BE SUPPLIED AND INSTALLED BY G.C., U.O.N.

NATIONAL ACCOUNTS SUPPLIER INTERIOR DOORS, FRAMES & HARDWARE HAMILTON PARKER LOCKNET CONSTRUCTION@LOCKNET.COM 800 JOHN C. WATTS DR. NICHOLASVILLE, KY 40356 855-432-4613 FAX: 877-887 JIM CAMPBELL D. 614-358-7808 E-MAIL: JIM.CAMPBELL@HAMILTON.PARKER.COM

STOREFRONT SPECIFICATION STOREFRONT OLD CASTLE FG-3000 GLAZING VITROGLAZINGS SOLARBAN 70 SOLAR CONTROL LOW-E GLASS SEE EXTERIOR ELEVATIONS FOR STOREFRONT COLOR

GLASS SCHEDULE Table with columns A-E and descriptions for glass types: 1" INSULATED GLASS, 1" INSULATED TEMPERED GLASS, 1/4" TEMPERED GLASS, SAFETY GLASS BY MFR., 1" INSULATE ACM PANEL, BLACK TO MATCH CANOPIES.

- 1. LAMINATE DOORS 4, 5, 6, 7 & 8 AND PAINT FRAMES 3, 4, 5, 6, 7 & 8. SEE INTERIOR ELEVATION, SHEET A8.0, A8.1 & A8.2.
2. ALL HARDWARE SHALL BE US32D U.O.N.
3. ALL HM FRAMES SHALL BE 16 GA. STEEL U.O.N.
4. ALL LOCKS SHALL BE FALCON 6 PIN INTERCHANGEABLE CORE SUPPLIED AND INSTALLED BY THE G.C. ALL EXTERIOR LOCKS SHALL BE PROVIDED WITH CONSTRUCTION CORES. ALL PERMANENT CORES SHALL BE KEYED ALIKE.
5. PERMANENT CORES SHALL BE SHIPPED TO THE RESTAURANT GENERAL MANAGER.
6. MOUNT DOOR CLOSERS ON RESTROOM OR KITCHEN SIDE ONLY.
7. LOCKNET SECURITY DOOR. COMPLETE DOOR, FRAME, AND HARDWARE PACKAGE PROVIDED BY RSCS FACILITIES CONNECTIONS.
8. PROVIDE PUSH/PULL PLATES. IF REQUIRED BY LOCAL CODE, STOREFRONT DOOR PANIC HARDWARE SHALL BE: DOOR-O-MATIC 2092 RIM PANIC HARDWARE AND EXTERIOR PULLS WITH QUALITY #520 DOOR PULL.
9. MOUNT KICKPLATE ON PUSH SIDE ONLY.
10. MAXIMUM DOOR OPERATING PRESSURE: 5 LBS INTERIOR, 8.5 LBS EXTERIOR.
11. ADA COMPLIANT ACCESSIBILITY SIGNAGE, INCLUDE BRAILLE AS REQUIRED BY LOCAL JURISDICTION - (1) MEN, (1) WOMEN. SEE G4.0.
12. RESTROOM SIGN REQUIRED. SEE G4.0.
13. INSTALL WITH APPLIED DOORS STOPS AND WEATHER STRIPS.
14. FRAMES SHALL BE PAINTED. SEE INTERIOR OR EXTERIOR ELEVATIONS.
15. PROVIDE LATCH AND STRIKE PLATE HARDWARE BY DOOR MFR. TO BE COMPATIBLE WITH LOCK.
16. NOT USED.
17. NOT USED.
18. GC TO TRIM DOOR SWEEP TO FIT DOOR.

NOTES 4

Table with columns: DOOR NO., ROOM NAME, DOOR SIZE (WIDTH, HEIGHT, THICK), TYPE, DOOR, FRAME, BUTTS (1-4), LOCKS (1-6), CLOSERS (1-3), KICK PLATE (1-3), THRESHOLD (1-3), DOOR STOP (1-3), PUSH (1-3), PULL (1-3), MISCELLANEOUS (1-6), DETAIL LOCATIONS (HEAD, JAMB, SILL), DOOR NOTES. Includes rows for DINING, ENTRANCE, KITCHEN, MEN, WOMEN, OFFICE, CLOSET, and KITCHEN.

DOOR SCHEDULE NOTES 1

DOOR SCHEDULE 2 Table with columns: DOOR NO., ROOM NAME, DOOR SIZE, TYPE, DOOR, FRAME, BUTTS, LOCKS, CLOSERS, KICK PLATE, THRESHOLD, DOOR STOP, PUSH, PULL, MISCELLANEOUS, DETAIL LOCATIONS, DOOR NOTES.





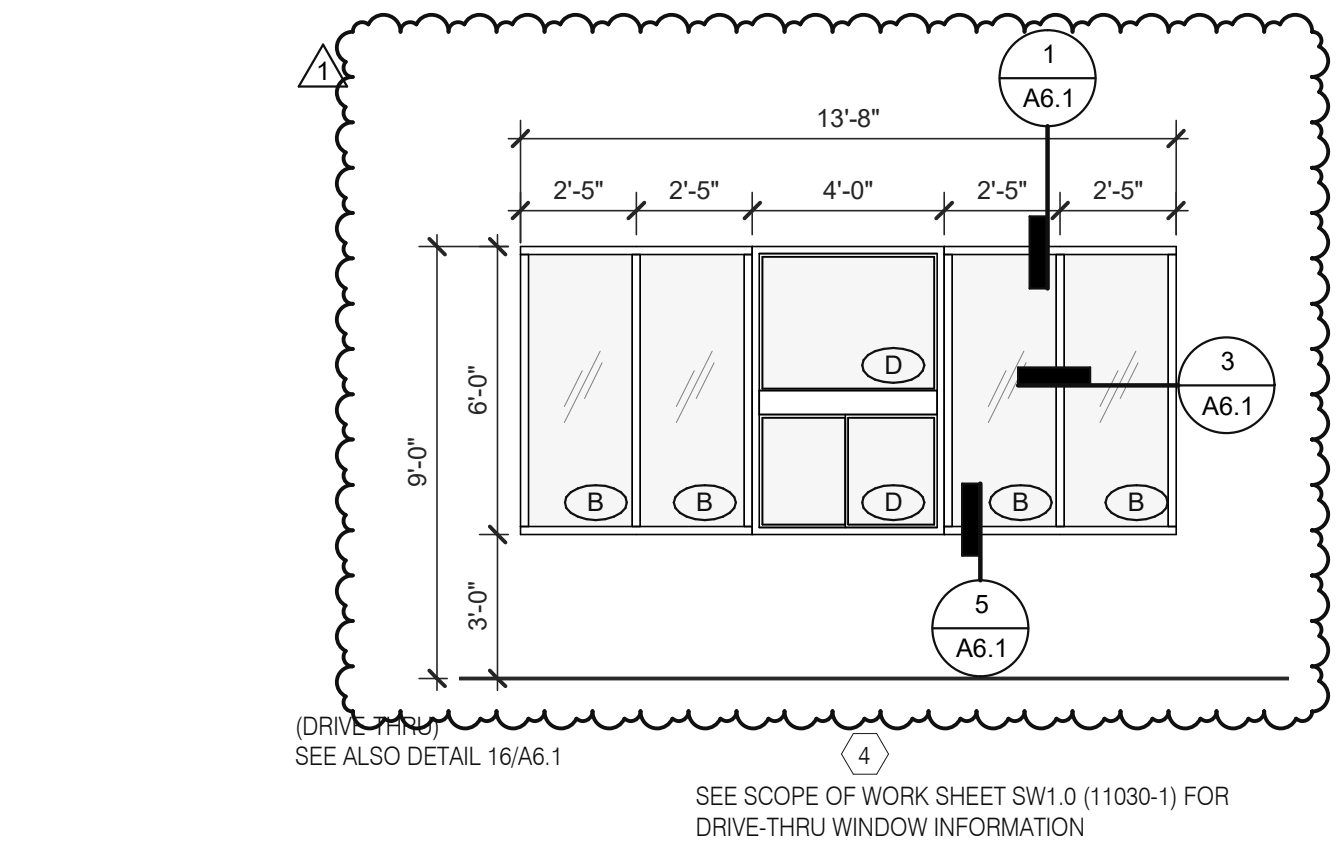


Table with columns: DATE, REMARKS. Entries for 11.07.22: Issued for Construction, Bulletin #1.

CONTRACT DATE: 02.28.22 BUILDING TYPE: END.MED20 PLAN VERSION: MARCH 2021 BRAND DESIGNER: SITE NUMBER: 314481 STORE NUMBER: 454078 PA/PM: SM DRAWN BY: RS JOB NO.: 2020088.03

TACO BELL 18550 E. WARREN AVE DETROIT, MI 48236

TACO BELL logo and project title: ENDEAVOR 2.0 DOOR & WINDOW ELEVATIONS & SCHEDULES A1.1 PLOT DATE: 11/3/2022 11:19:28 AM

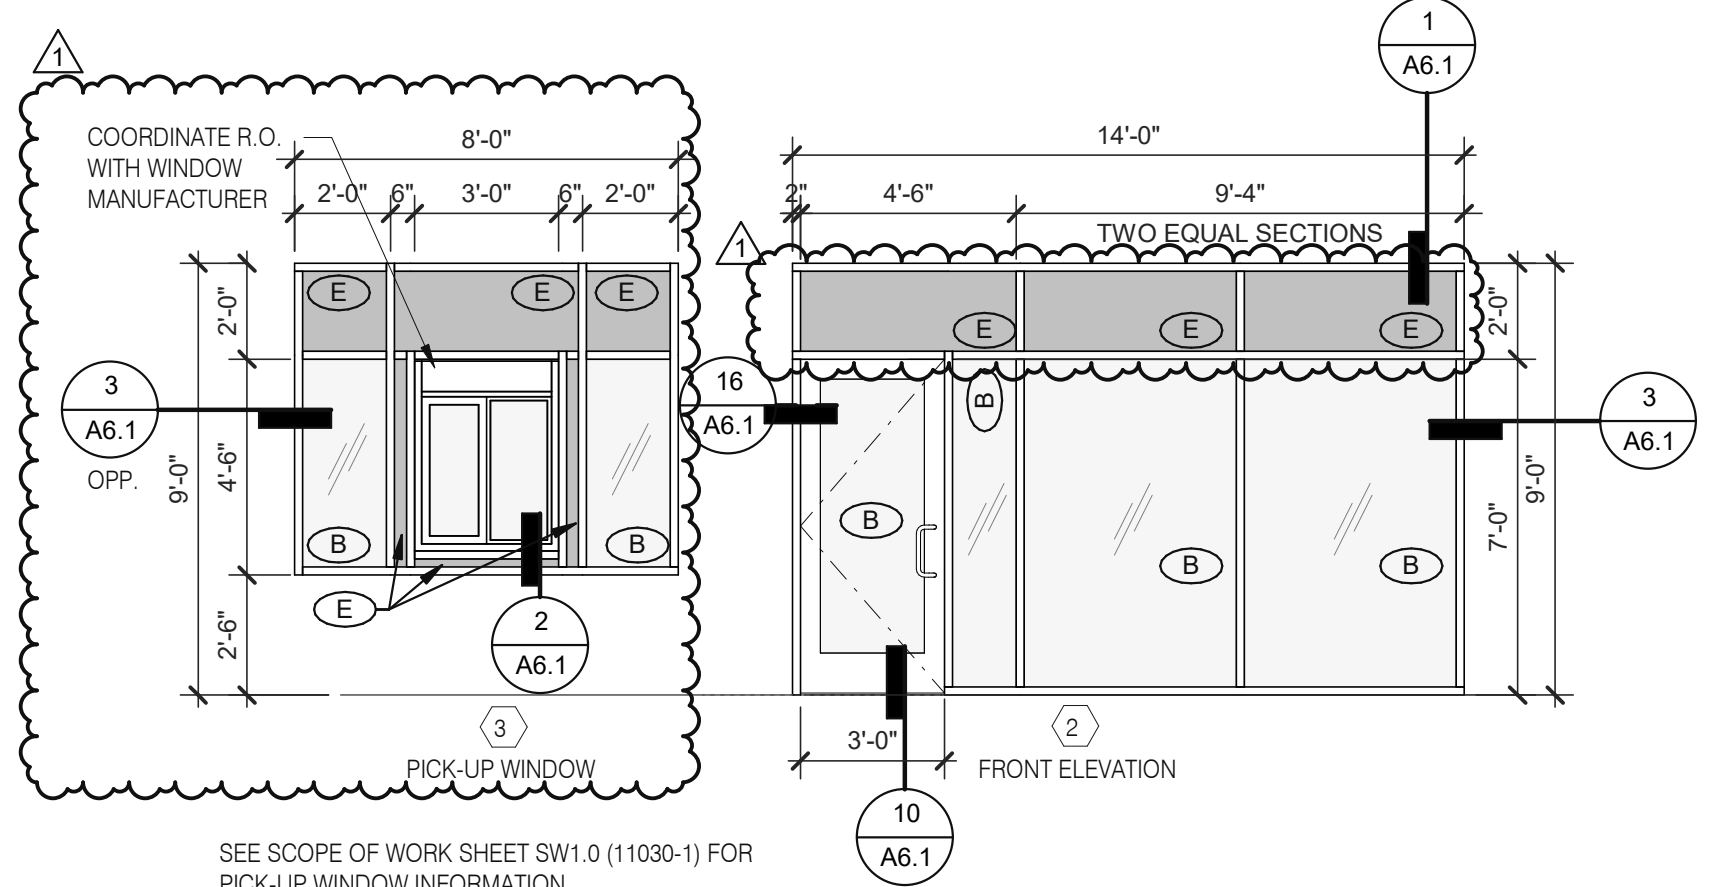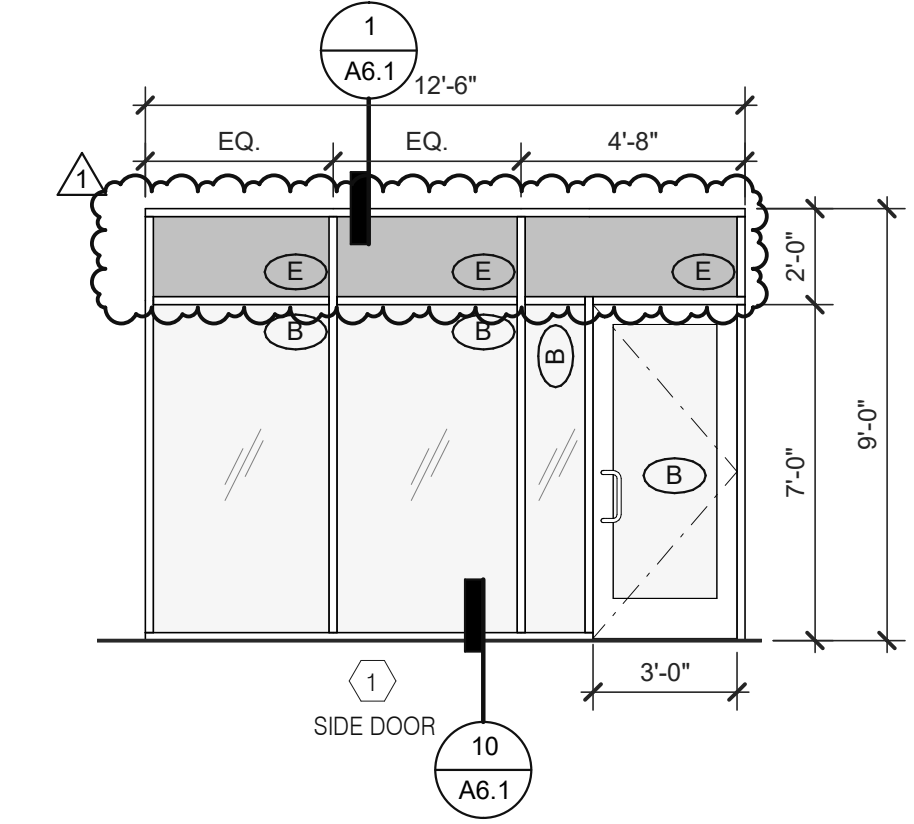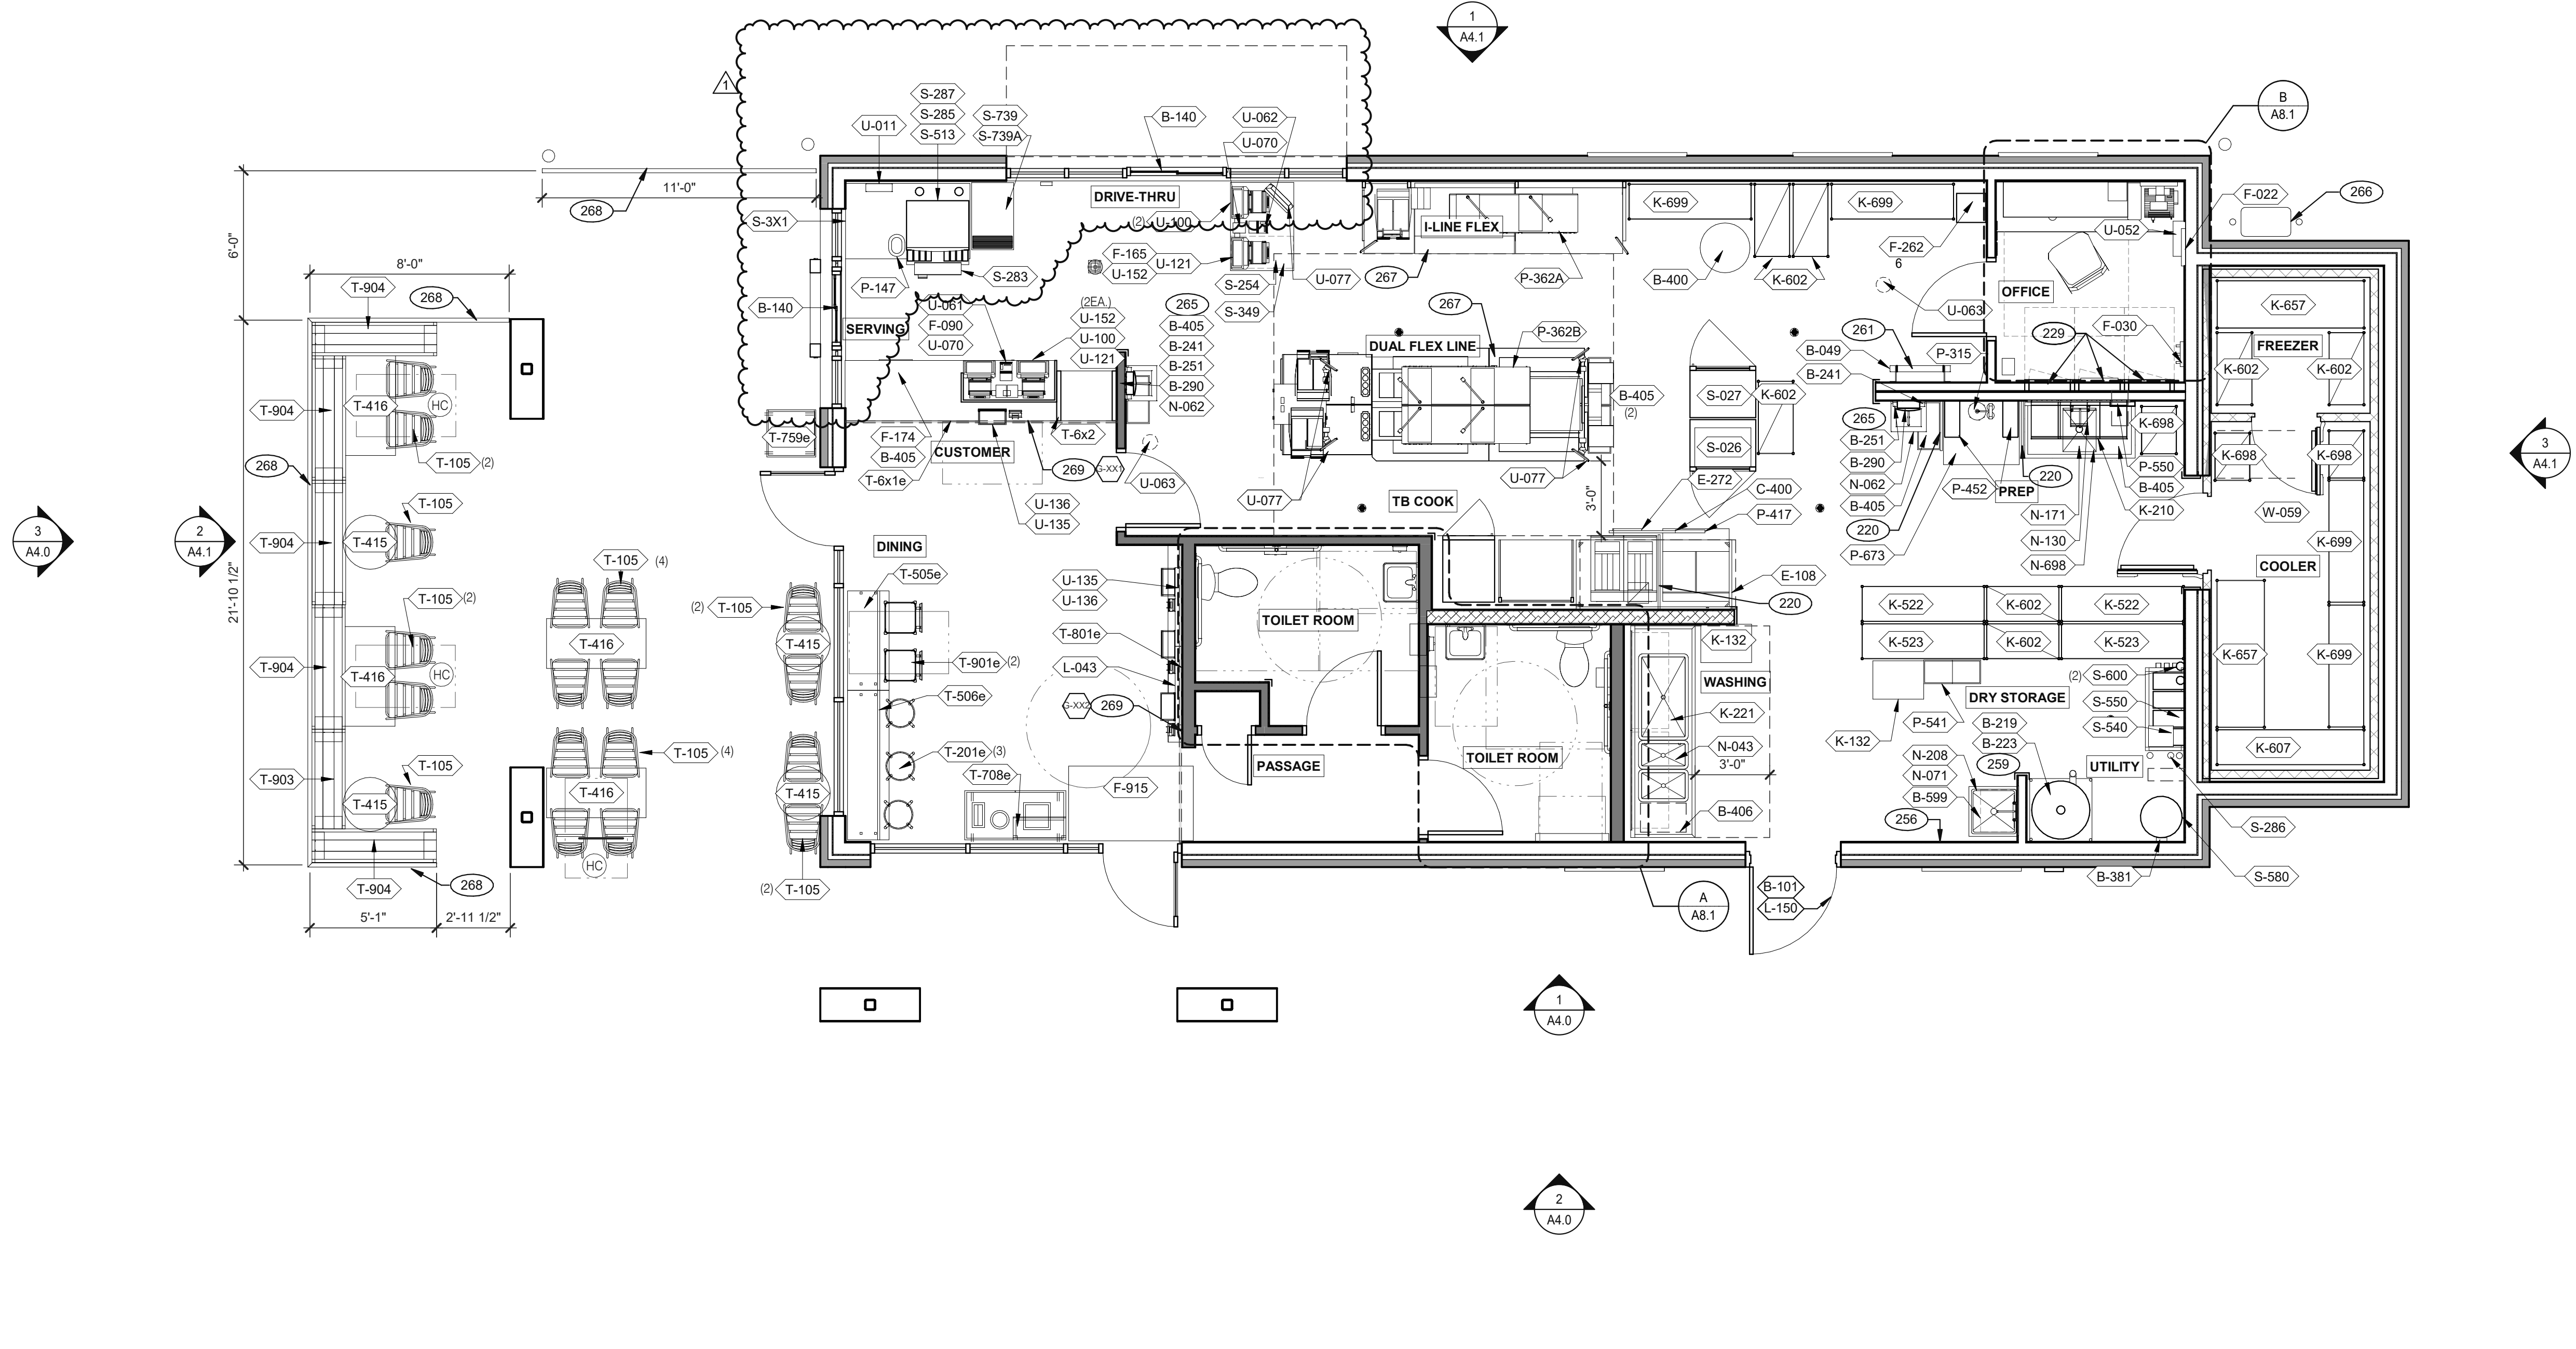

EQUIPMENT AND SEATING PLAN 1/4" = 1'-0" **A**

DATE	REMARKS
11.07.22	Issued for Construction
1 11.07.22	Bulletin #1

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236



**ENDEAVOR 2.0
 EQUIPMENT
 AND SEATING
 PLAN**

A2.0

PLOT DATE: 11/3/2022 11:19:35 AM

TAG	QTY	ITEM DESCRIPTION
T-6x1e	1	GO MOBILE COUNTER
T-6x2	1	25in. TOGO Cubby
T-105	18	RETRO CHAIR - 18
T-201e	3	BARREL BARSTOOL - 29 PURPLE WOOD SEAT
T-415	4	SS TABLE - 24 DIA X 30 - 2 TOP
T-416	4	LAMINATE TABLE ADA - 24 X 48 X 30 - 4 TOP
T-505e	1	COUNTER TOP - 48" X 20" X 30"
T-506e	1	COUNTER TOP - 48" X 20" X 30"
T-708e	1	WASTE ENCLOSURE - 3 STREAM
T-759e	1	WASTE ENCLOSURE - SINGLE
T-801e	1	KIOSK 1/2 TOWER
T-901e	2	CHAIR - LAMINATE SEAT
T-903	1	BENCH SEAT - 48"
T-904	5	BENCH SEAT - 60"

FURNITURE PACKAGE - BY FURNITURE VENDOR U.O.N. **E**

QTY.	NAME	FAMILY	FRAME OR MURAL	SIZE	LOCATION
1	BULKHEAD MURAL	TBD	M01	CUSTOM	SEE A8.0
1	WALL MURAL	TBD	M01	CUSTOM	SEE A8.0

ARTWORK SCHEDULE **D**

DECOR

- REFER TO SC SHEETS FOR SCOPE OF WORK RESPONSIBILITY
- (HC) SYMBOL DENOTES A HANDICAP ACCESSIBLE TABLE.

STORAGE TYPE	LINEAR FT.
DRY STORAGE	50
COLD STORAGE	26
FROZEN STORAGE	12

SHELVING QUANTITIES **C2**

- GENERAL NOTES** **C1**
- 220 SPLASH GUARD. SEE DETAIL 9/A6.3.
 - 229 ELECTRICAL PANELS.
 - 256 PULL STATION @ 3'-8" A.F.F.
 - 259 6" HIGH WATER HEATER PLATFORM.
 - 261 ROOF LADDER WITH BILCO LADDER UP SAFETY POST.
 - 265 AUTOMATIC HAND SOAP AND SANITIZER DISPENSERS PROVIDED BY ECOLAB.
 - 266 GAS METER.
 - 267 FOR DUAL-FLEX LINE AND I-FLEX LINE SUB-EQUIPMENT SEE SHEET A8.3.
 - 268 BLACK IRON RAILING SYSTEM PROVIDED AND INSTALLED BY G.C.
 - 269 SEE INTERIOR ELEVATIONS FOR ARTWORK PLACEMENT.

KEY NOTES **B**

C:\Users\mim\Documents\TB_Gross\Plan_A\BCH202_Ruays.rvt

EQUIPMENT SCHEDULE

Main equipment schedule table with columns: TAG, #, C.C. INSTALL, ITEM DESCRIPTION, MFR. & MODEL NUMBER, PLUMBING/ELECTRICAL/GAS, REMARKS. Includes sections for B CONTRACTOR BUILDING ELEMENTS, S SERVING/DRIVE-THRU, C COOKING EQUIPMENT, E EXHAUST HOODS/FIRE SUPPORT, F OFFICE/EMPLOYEE/MUSIC/MISCELLANEOUS, U SECURITY/COMMUNICATIONS/FIRE PROTECTION/POS, W WALK-IN COOLERS/FREEZERS, K WORKSTATIONS/SHELVING/CARTS, R REFRIGERATION, L LIGHTING/SIGNAGE/MENUBOARDS, N SINKS/DISHWASHER, P FOOD PREPARATION.

GPD GROUP Professional Corporation logo and contact information: 520 S. MAIN STREET, SUIT 2531 AKRON, OH 44311 330.572.2100 FAX: 330.572.2102

Table with columns: DATE, REMARKS. Row 1: 11.07.22 Issued for Construction

CONTRACT DATE: 02.28.22 BUILDING TYPE: END, MED20 PLAN VERSION: MARCH 2021 BRAND DESIGNER: DICKSON SITE NUMBER: 314481 STORE NUMBER: 454078 PA/PM: SM DRAWN BY.: RS JOB NO.: 2020088.03



TACO BELL 18550 E. WARREN AVE DETROIT, MI 48236



ENDEAVOR 2.0 EQUIPMENT SCHEDULE

A2.1 PLOT DATE: 11/3/2022 11:19:40 AM

\\usernam\Documents\TB_General\Bldg_A\BCH242_Ruys.rvt

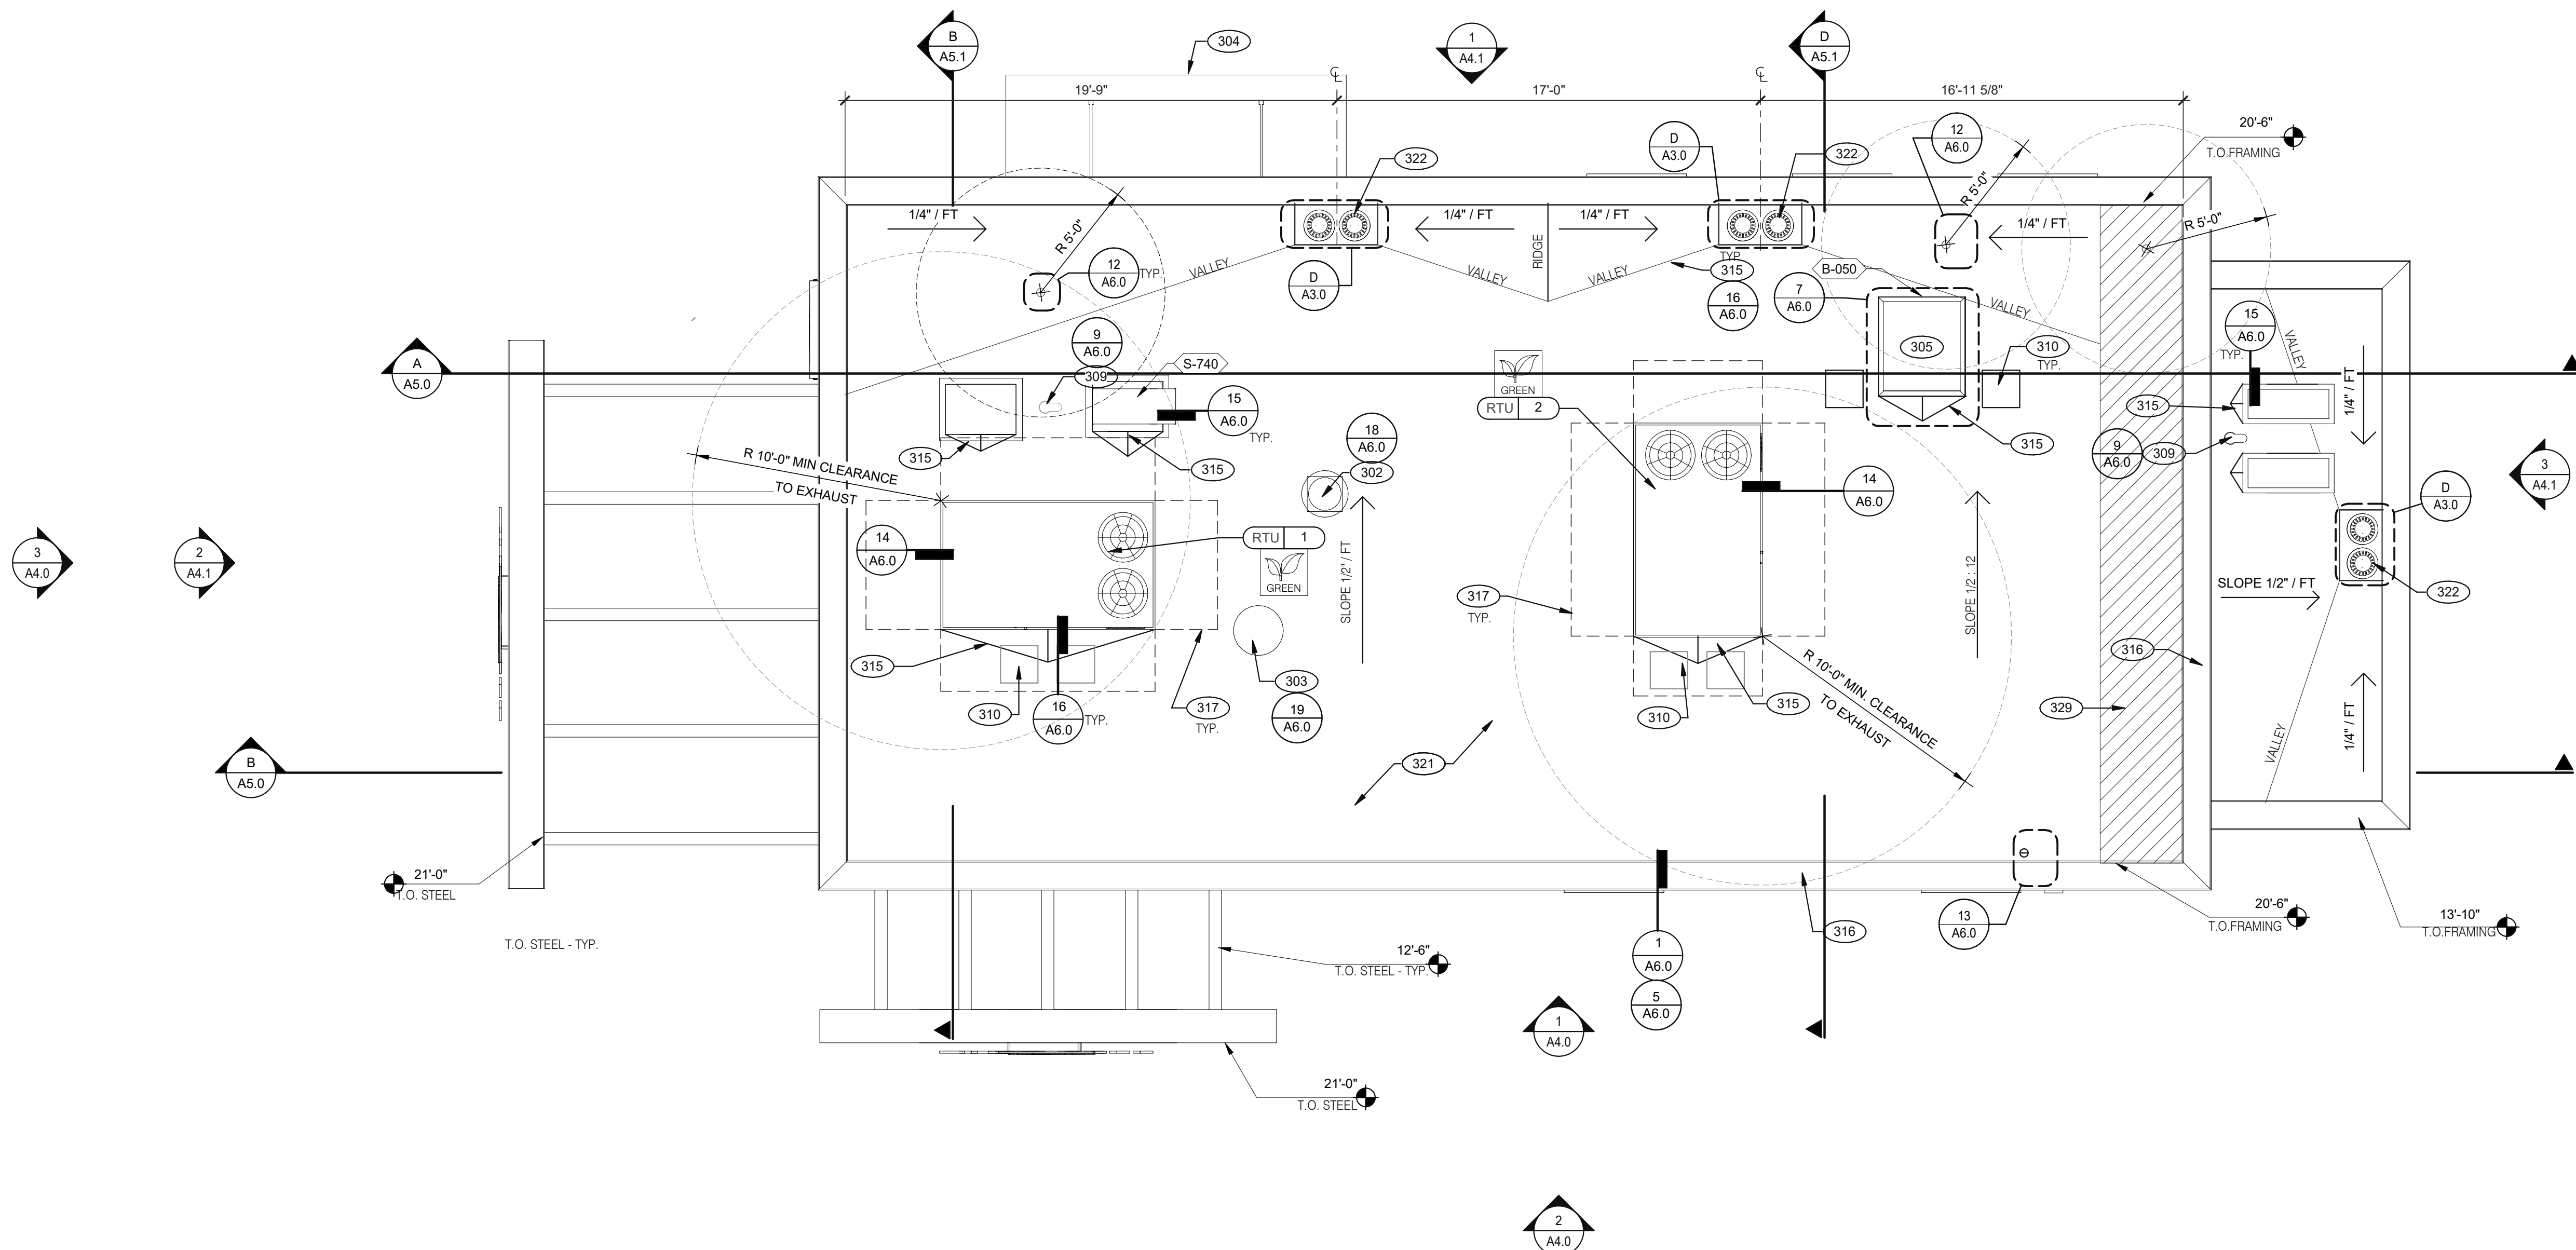

ROOF PLAN 1/4" = 1'-0" **A**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL


18550 E. WARREN AVE
 DETROIT, MI 48236



ENDEAVOR 2.0 ROOF PLAN

A3.0

PLOT DATE: 11/3/2022 11:19:42 AM

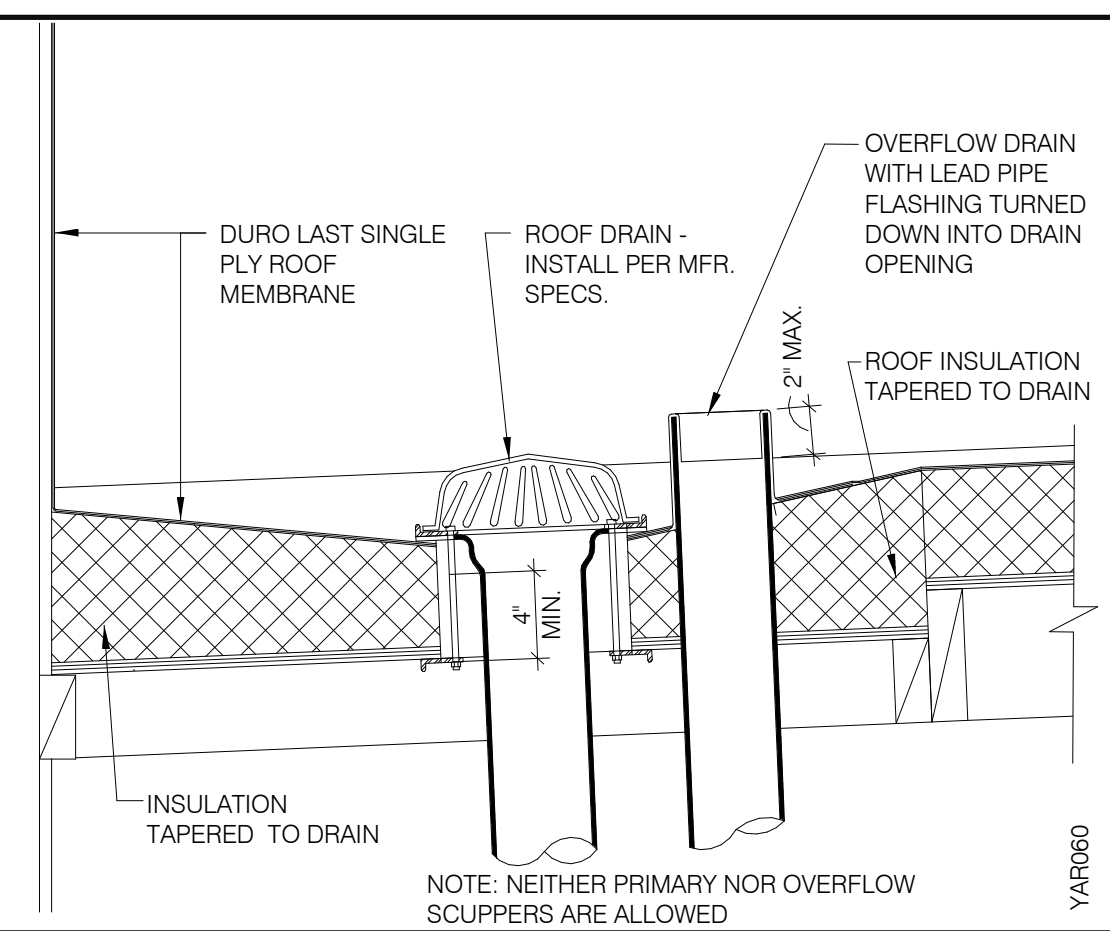

NOTE: NEITHER PRIMARY NOR OVERFLOW SCUPPERS ARE ALLOWED

ROOF DRAIN **D**

WATERPROOFING:

- A. PAINT UNDERSIDE OF PARAPET CAP FLASHING WITH FACTORY BONDED PAINT GRIP OR PRIMER
- B. TOP NAILING AT PARAPET CAP FLASHING WILL NOT BE ACCEPTED
- C. PENETRATIONS IN ROOFING MEMBRANE AND FLASHING SHALL ONLY BE MADE AS INDICATED ON THE DRAWINGS OR SPECS.
- D. SEE SPECIFICATIONS FOR SEALANT SPECS.
- E. ALL SHEETS MTL FLASHING SHALL BE 22 GA MIN.


MISCELLANEOUS:

- A. ROOF PENETRATIONS CLOSER THAN 12" FROM ANOTHER WILL NOT BE ALLOWED.
- B. EXHAUST FANS MIN. 10'-0" AWAY FROM ALL AIR INTAKE / SUPPLY
- C. LOCATE WALK-IN CONDENSERS ON ROOF ONLY IF REQUIRED BY CODE.


ROOF PLAN NOTES **C**

- 302 KITCHEN HOOD EXHAUST FAN. SEE SHEETS M3.0 AND DETAIL 19/A6.0.
- 303 RESTROOM EXHAUST FAN. SEE MECHANICAL DRAWINGS AND DETAIL 18/A6.0.
- 304 CANOPY, BY SIGNAGE VENDOR. SEE SCOPE OF WORK.
- 305 ROOF HATCH. SEE DETAIL 7/A6.0.
- 309 PIPE HOOD FOR UTILITIES. SEE DETAIL 9/A6.0.
- 310 24x36 WALK MATS. SEE ROOF SPECS.
- 315 ROOF CRICKET. SEE DETAIL 16/A6.0.
- 316 METAL PARAPET CAP.
- 317 MAINTAIN MANUFACTURERS ROOFTOP UNIT MAINTENANCE CLEARANCE.
- 321 'DURO-LAST' SINGLE PLY ROOF MEMBRANE OVER MINIMUM R-35 RIGID INSULATION BOARD OVER 5/8" APA RATED EXTERIOR GRADE PLYWOOD OVER TRUSSES. INSTALL PER MANUFACTURER'S SPECIFICATIONS.
- 322 OVERFLOW DRAIN. SEE DETAIL D/A3.0.
- 329 KICKERS. SEE STRUCTURAL DRAWINGS


KEY NOTES **B**

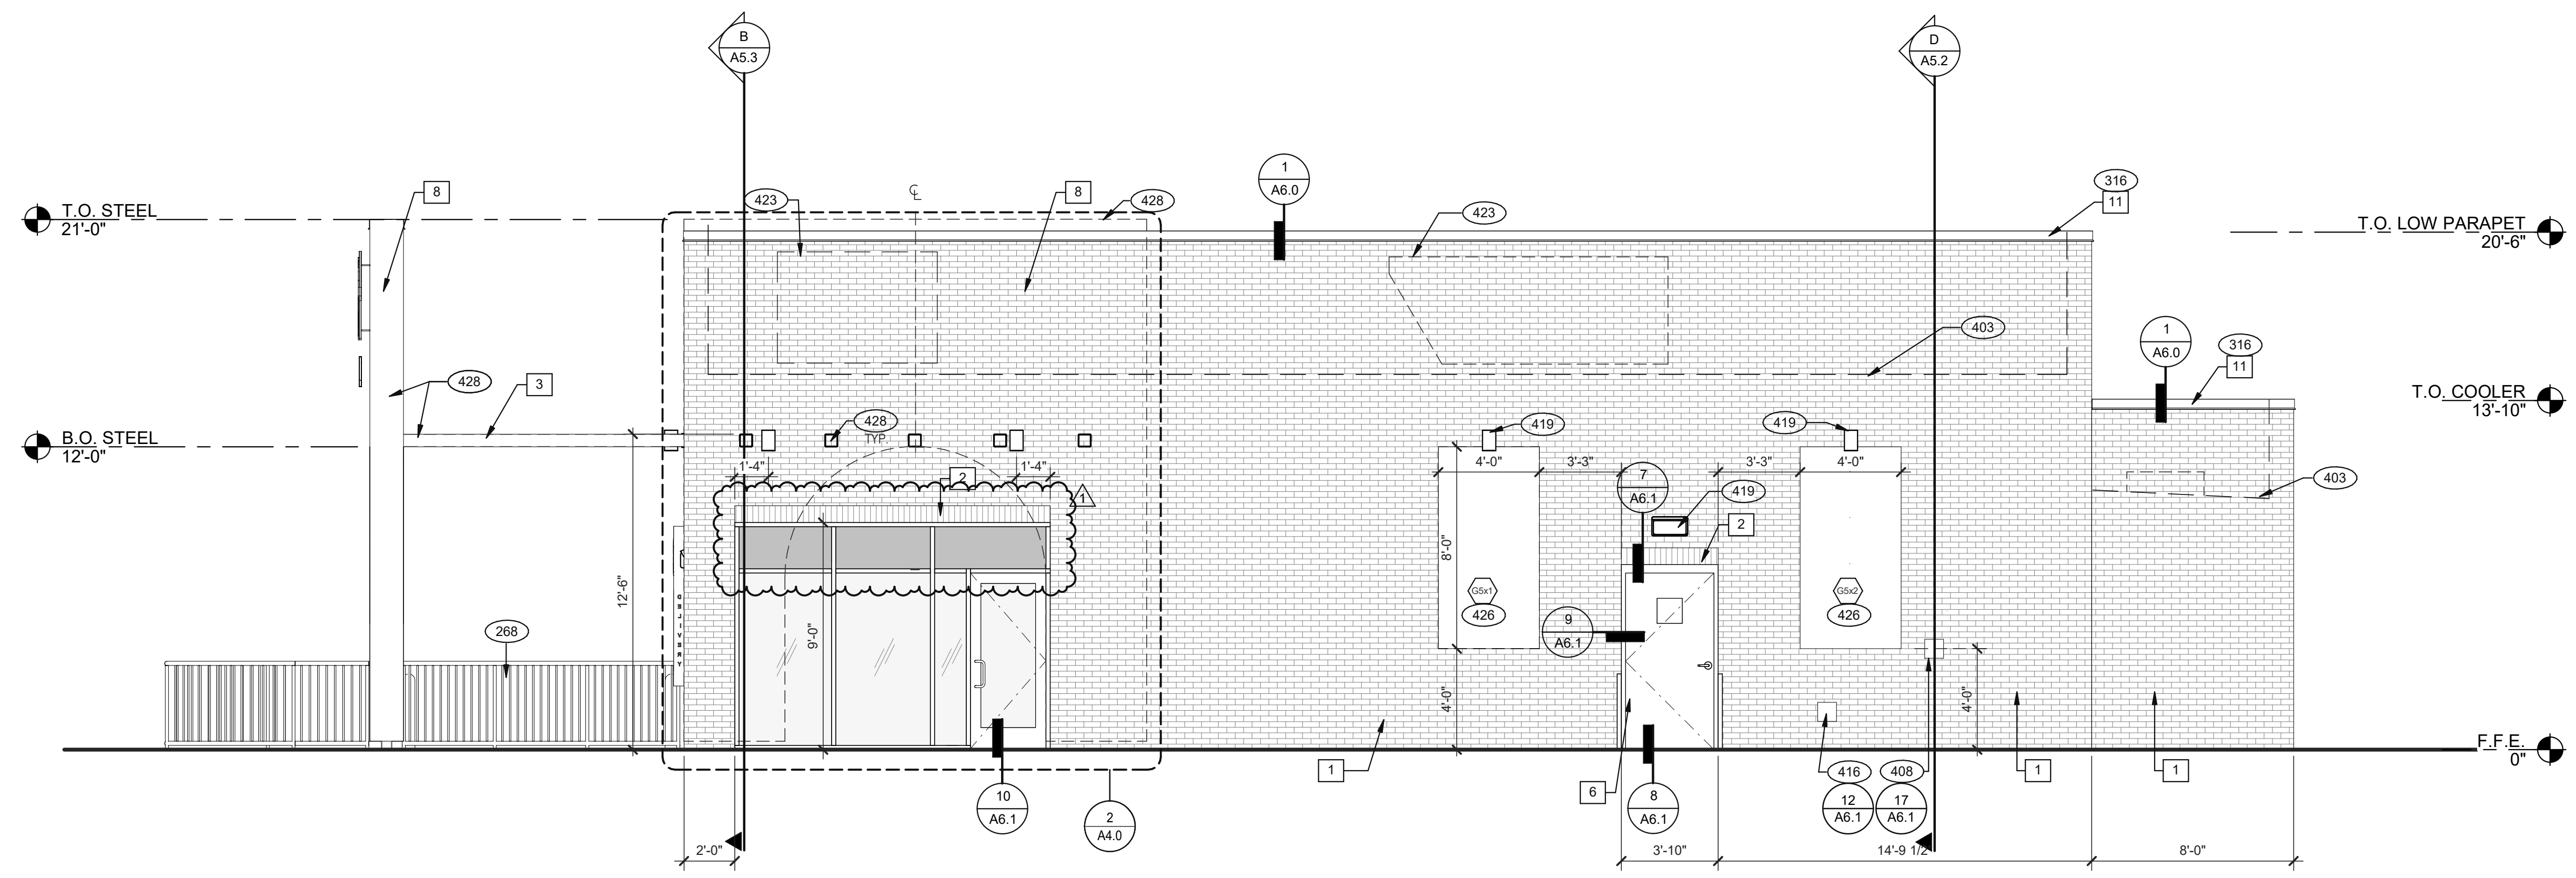

RIGHT ELEVATION 1/4" = 1'-0" 1

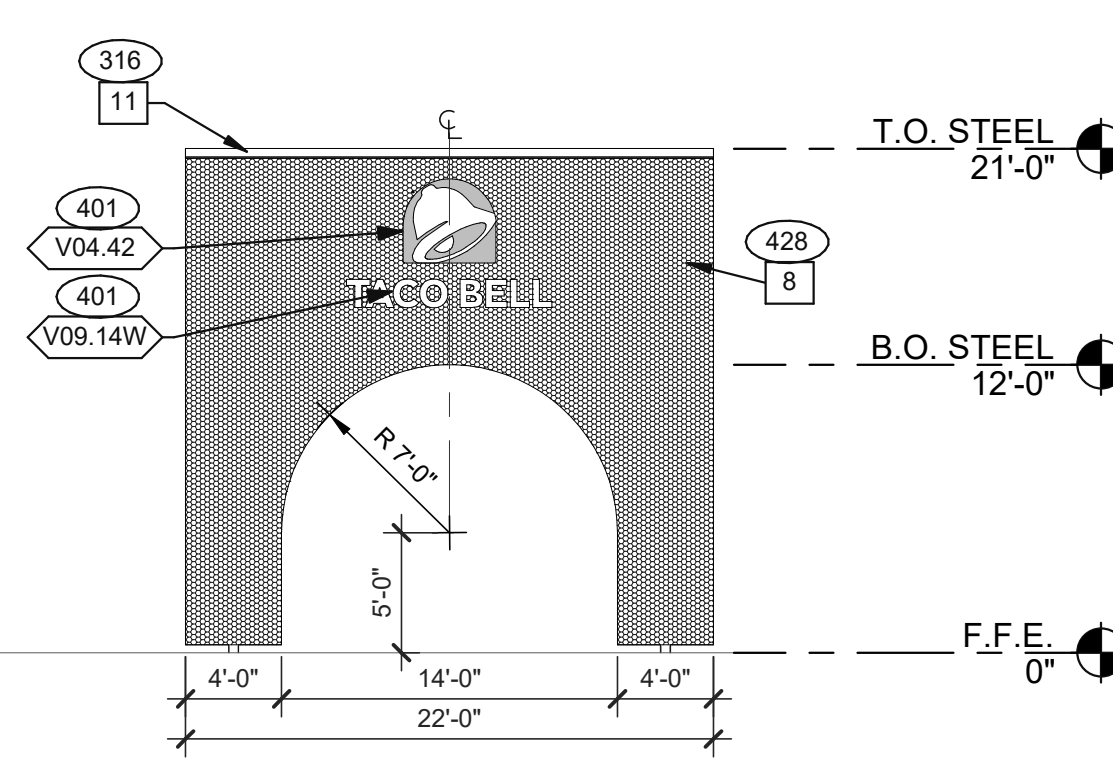

FRONT SCREEN WALL ELEVATION 1/8" = 1'-0" 3

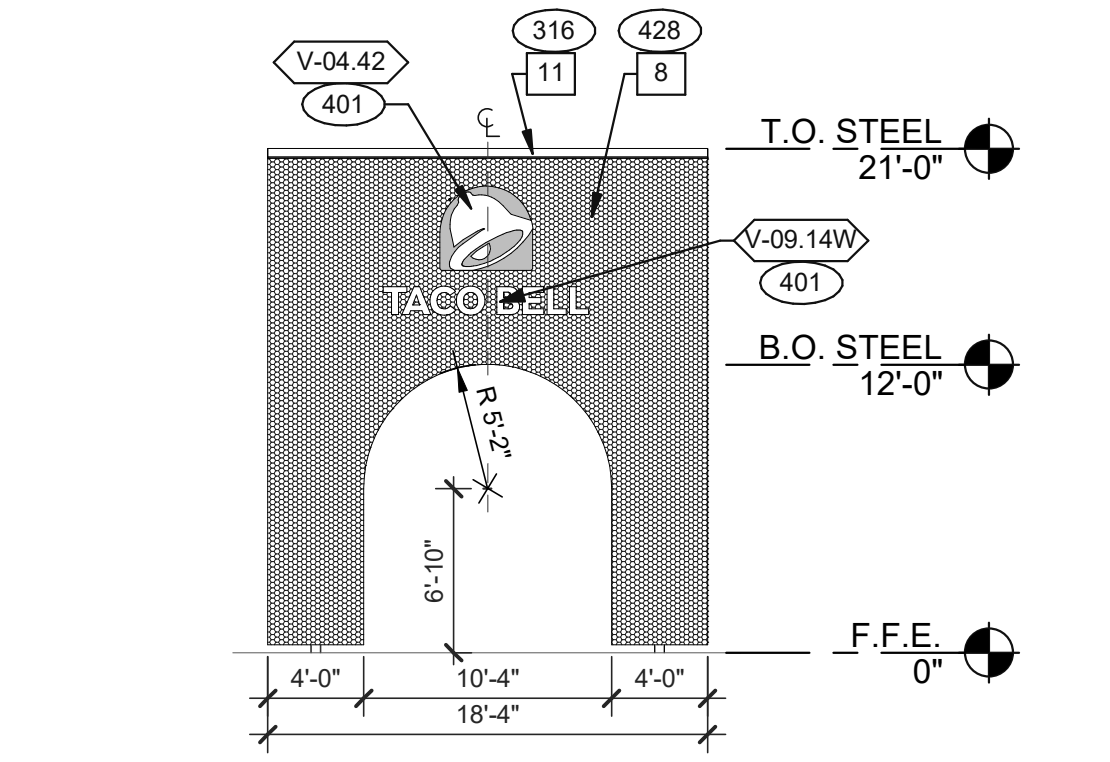

RIGHT SCREEN WALL ELEVATION 1/8" = 1'-0" 2

TYPE MARK	QTY	ITEM DESCRIPTION
V-09.14W	2	14' WHITE CHANNEL LETTERS VERTICAL
V-04.42	2	42" SWINGING BELL PLUMBING CAPS (1" DT AWNING OVER DT) 13'-8" X 4'-6" BLACK
V-101.DT	1	

MISCELLANEOUS
A. SEE SHEET A1.1 "WINDOW TYPES" FOR WINDOW ELEVATIONS.
SEALERS (REFER TO SPECS)
A. SEALANT AT ALL WALL AND ROOF PENETRATIONS.
B. SEALANT AT ALL WINDOW AND DOOR FRAMES AND JAMB. DO NOT SEAL SILL @ WINDOWS.
C. APPLY NEOPRENE GASKET (CONT.) BETWEEN BUILDING AND CANOPY.
CRITICAL DIMENSIONS
A. REQUIRED CLEAR OPENING WIDTH TO ENSURE COORDINATION WITH STANDARD SIGNAGE/BUILDING ELEMENTS DIMENSIONS.

NOTE: NO EXTERIOR SIGNS ARE WITHIN THE SCOPE OF WORK COVERED BY THE BUILDING PERMIT APPLICATION. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE INSTALLATION OF ALL EXTERIOR SIGNS AND INSTALLATION OF REQUIRED BLOCKING AND ELECTRICAL CONNECTIONS FOR FINAL APPROVED SIGNS.

X	QTY.	NAME	FAMILY	FRAME OR MURAL	SIZE	LOCATION
316	1	TBD	-	M02	48X96	SEE A4.0
401	1	TBD	-	M02	48X96	SEE A4.0
403	1	TBD	-	M02	48X96	SEE A4.1
408	1	TBD	-	M02	48X96	SEE A4.1
416	1	TBD	-	M02	48X96	SEE A4.1

DATE	REMARKS
11.07.22	Issued for Construction
11.07.22	Bulletin #1

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

SIGNAGE E

GENERAL NOTES C

EXTERIOR ARTWORK SCHEDULE A

SYMBOL	ITEM/MATERIAL	MANUFACTURER	MATERIAL SPEC	COLOR	CONTACT INFORMATION
1	BRICK	INTERSTATE BRICK	3 5/8" X 2 1/4" X 7 5/8" SHAPE: FACE BRICK, MODULAR	BRICK: -COLOR = PEWTER -TEXTURE = SCRATCH & MATTE (50/50), RANDOMIZED	
2	BRICK SOLDIER	INTERSTATE BRICK	3 5/8" X 2 1/4" X 7 5/8" SHAPE: FACE BRICK, MODULAR	BRICK: -COLOR = PEWTER -TEXTURE = SCRATCH & MATTE (50/50), RANDOMIZED	
3	METAL HSS SQUARE TUBE	SIGNAGE VENDOR		SHERWIN WILLIAMS, CAVIAR (SW 6990)	
6	HOLLOW METAL DOOR	-	-	SHERWIN WILLIAMS, CAVIAR (SW6990)	
7	AWNINGS	SIGNAGE VENDOR	-	BLACK BY THE SIGNAGE VENDOR	
8	TOWER	SIGNAGE VENDOR	PERFORATED METAL PANELS	SIGNAGE VENDOR TO PROVIDE SAMPLES FOR OWNERS APPROVAL PRIOR TO FABRICATION.	
11	METAL PARAPET CAP	-	24GA GALVANIZED	BLACK: EXTRUSION 398A1632	

EXTERIOR FINISH SCHEDULE D

268 BLACK IRON RAILING SYSTEM PROVIDED AND INSTALLED BY G.C.
316 METAL PARAPET CAP.
401 BUILDING SIGN BY VENDOR. REQUIRES ELECTRICAL, SEE ELECTRICAL PLANS.
403 DASHED LINE INDICATES ROOF BEYOND.
408 CO2 FILLER VALVE & COVER.
416 HOSE BIBB BOX AT 18" A.F.F. SEE PLUMBING DRAWINGS.
419 EXTERIOR LIGHT FIXTURE. SEE ELECTRICAL DRAWINGS.
423 OUTLINE OF RTU BEYOND.
426 EXTERIOR ARTWORK. SEE SCHEDULE ON SHEET A4.0.
428 SCREEN WALL AND BUILDING TIE BACKS BY SIGNAGE VENDOR. SEE VENDOR DRAWINGS FOR MORE INFORMATION.

KEY NOTES B


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0 EXTERIOR ELEVATIONS


A4.0

- SEE SHEET A4.0 FOR FINISH SCHEDULE
- 203 PIPE BOLLARD. SEE CIVIL DRAWINGS.
 - 316 METAL PARAPET CAP.
 - 403 DASHED LINE INDICATES ROOF BEYOND.
 - 404 STOREFRONT, TYPICAL. SEE SHEET A1.1.
 - 407 METAL CANOPIES BY VENDOR. REQUIRES ELECTRICAL. SEE ELECTRICAL PLANS.
 - 409 ASSUME D/T LANE SURFACE IS 6" BELOW THE FINISH FLOOR. REFER TO GRADING & SITE PLAN.
 - 411 CONCRETE CURB.
 - 416 HOSE BIBB BOX AT 18" A.F.F. SEE PLUMBING DRAWINGS.
 - 418 GAS METER.
 - 419 EXTERIOR LIGHT FIXTURE. SEE ELECTRICAL DRAWINGS.
 - 423 OUTLINE OF RTU BEYOND.
 - 426 EXTERIOR ARTWORK. SEE SCHEDULE ON SHEET A4.0.
 - 427 DAYLIGHT ROOF OVERFLOW. INSTALL BRONZE LAMBS TONGUE.
 - 428 SCREEN WALL AND BUILDING TIE BACKS BY SIGNAGE VENDOR. SEE VENDOR DRAWINGS FOR MORE INFORMATION.

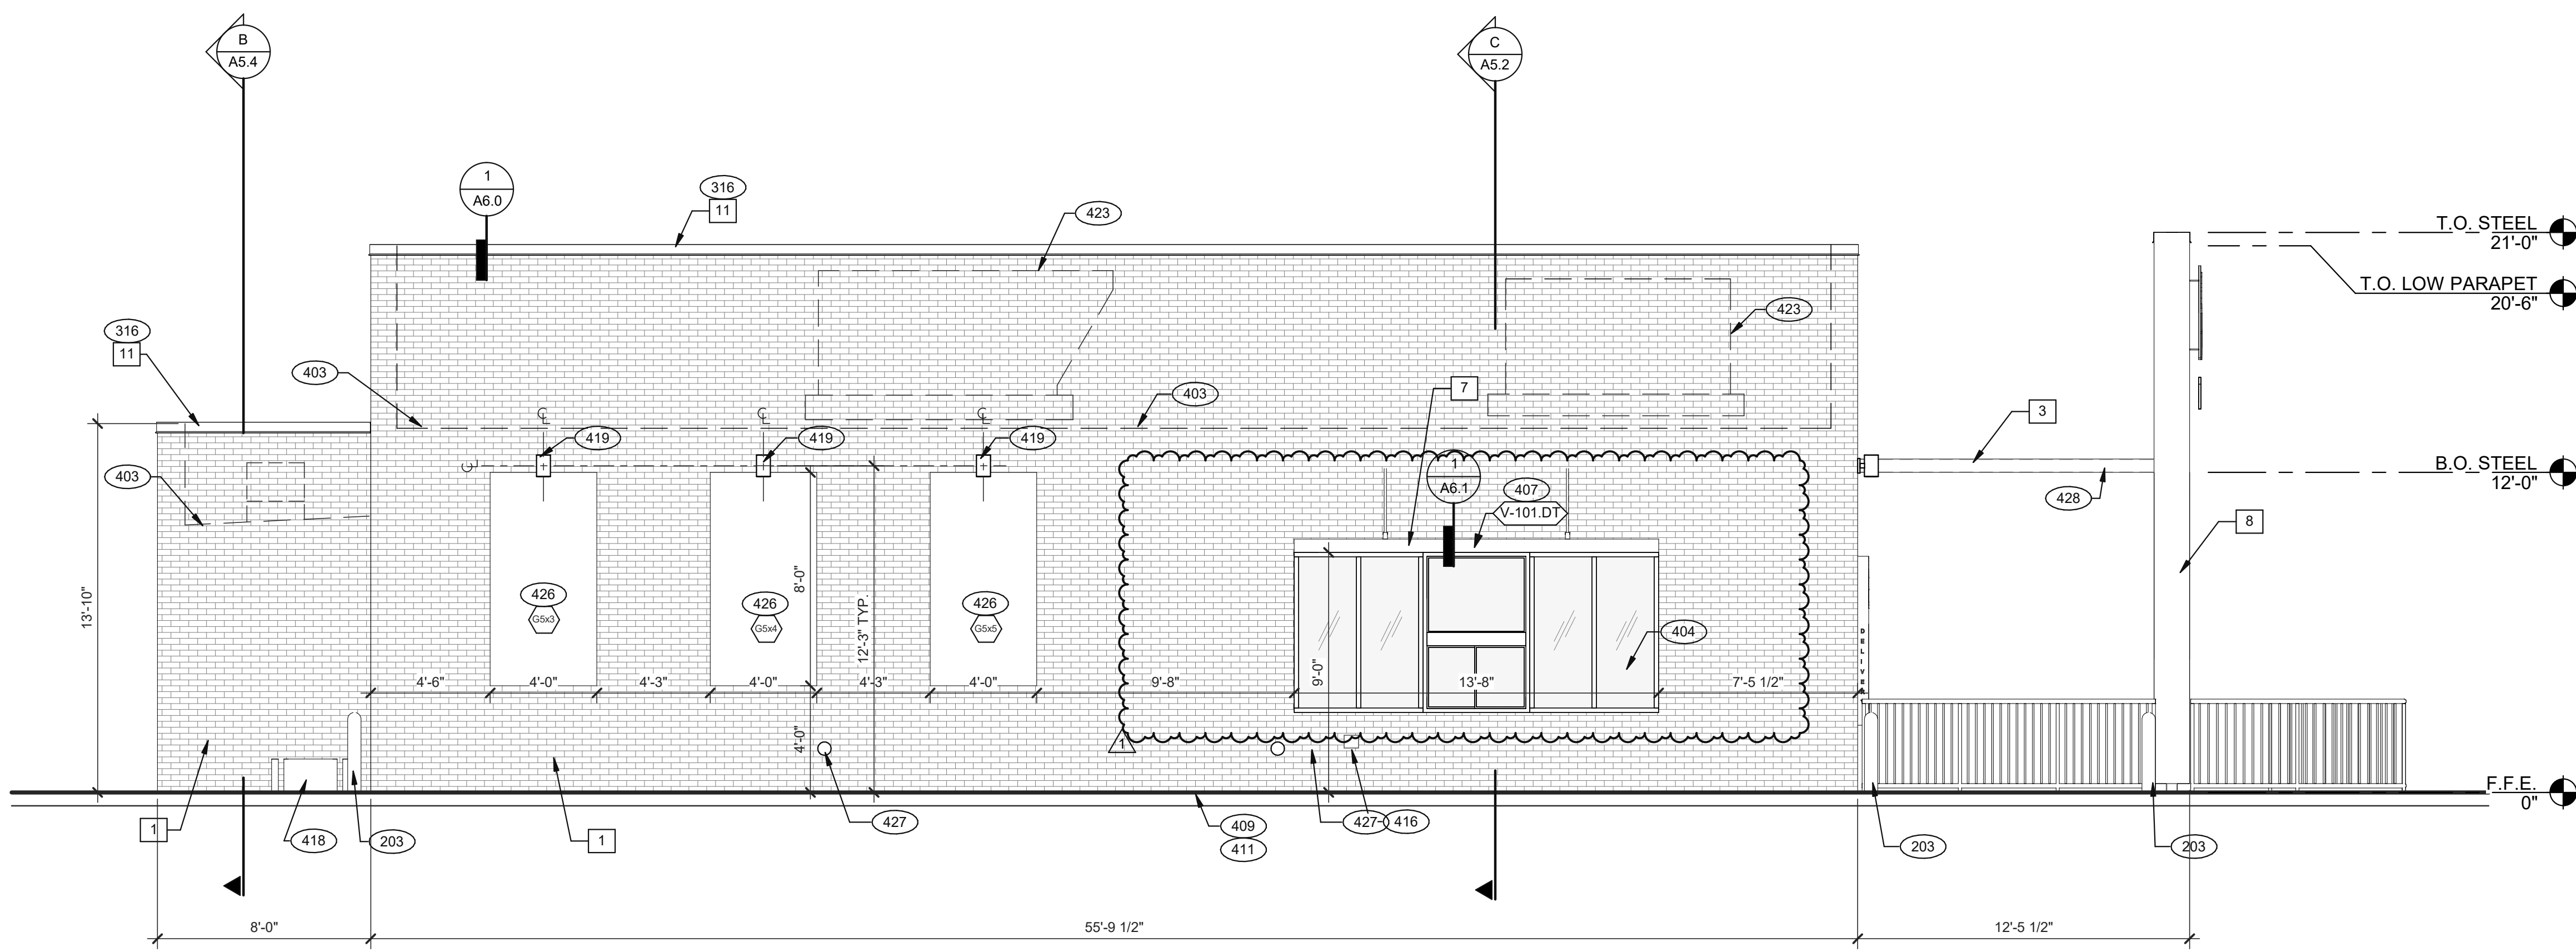


LEFT ELEVATION 1/4" = 1'-0" **1**

KEY NOTES **A**

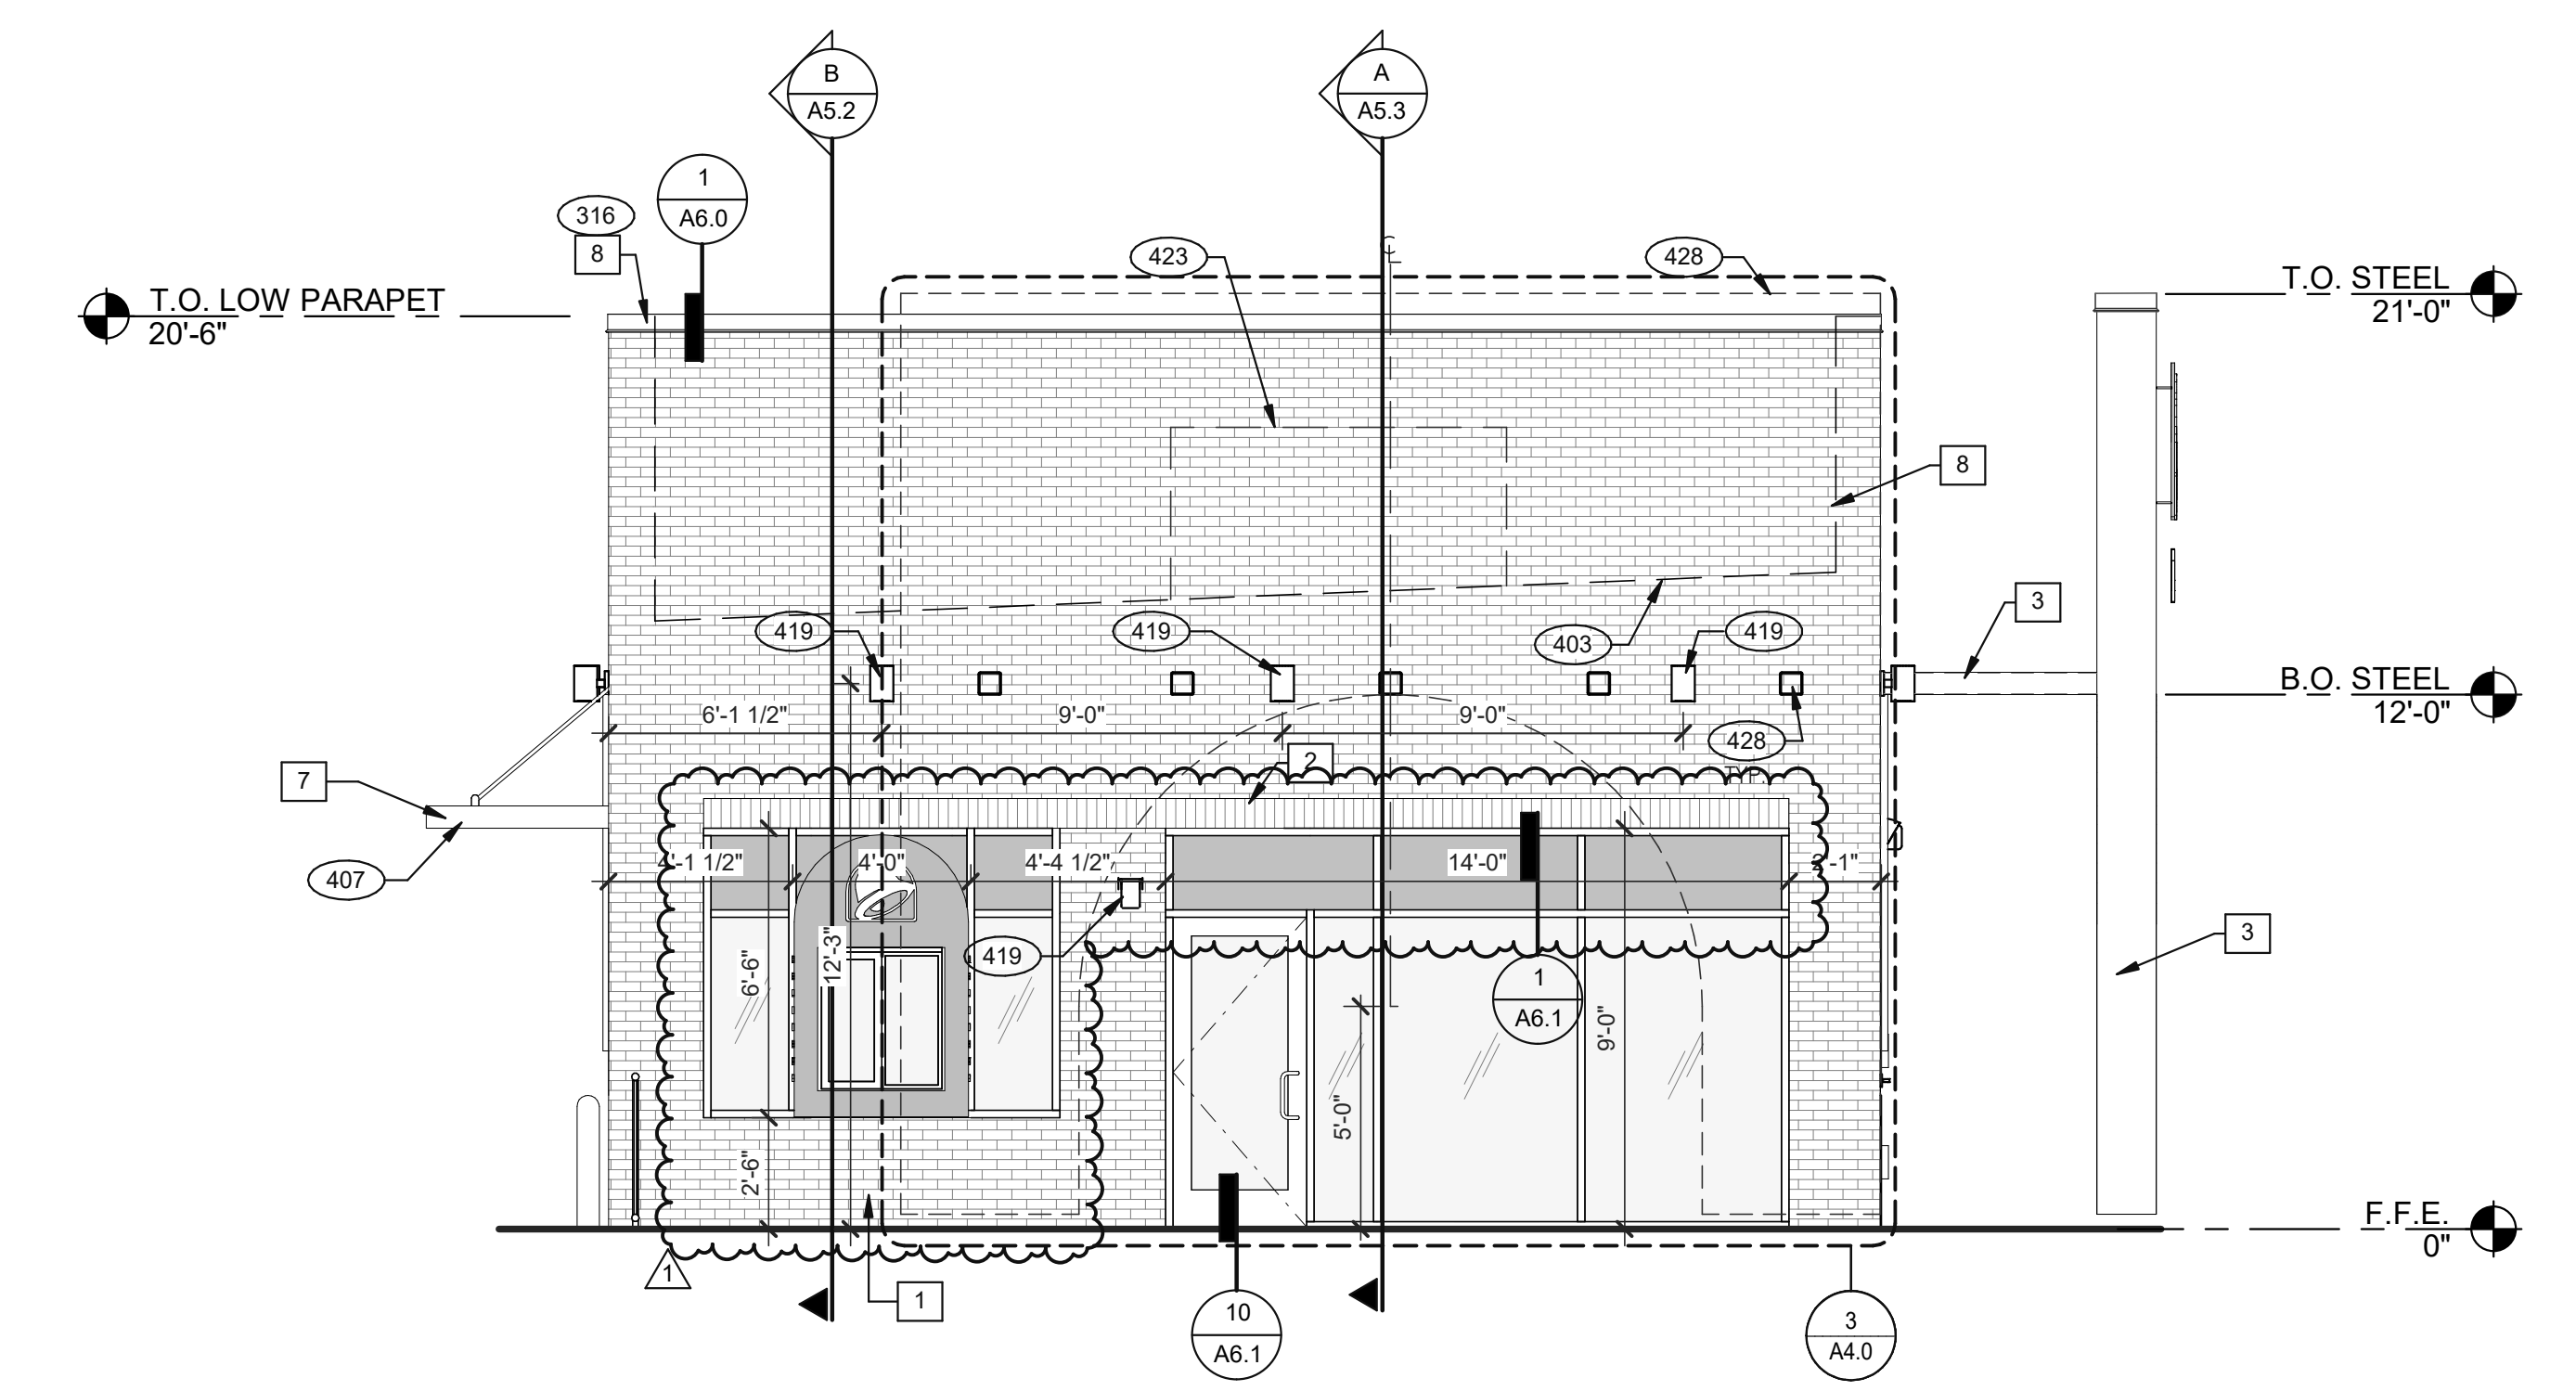

FRONT ELEVATION 1/4" = 1'-0" **2**

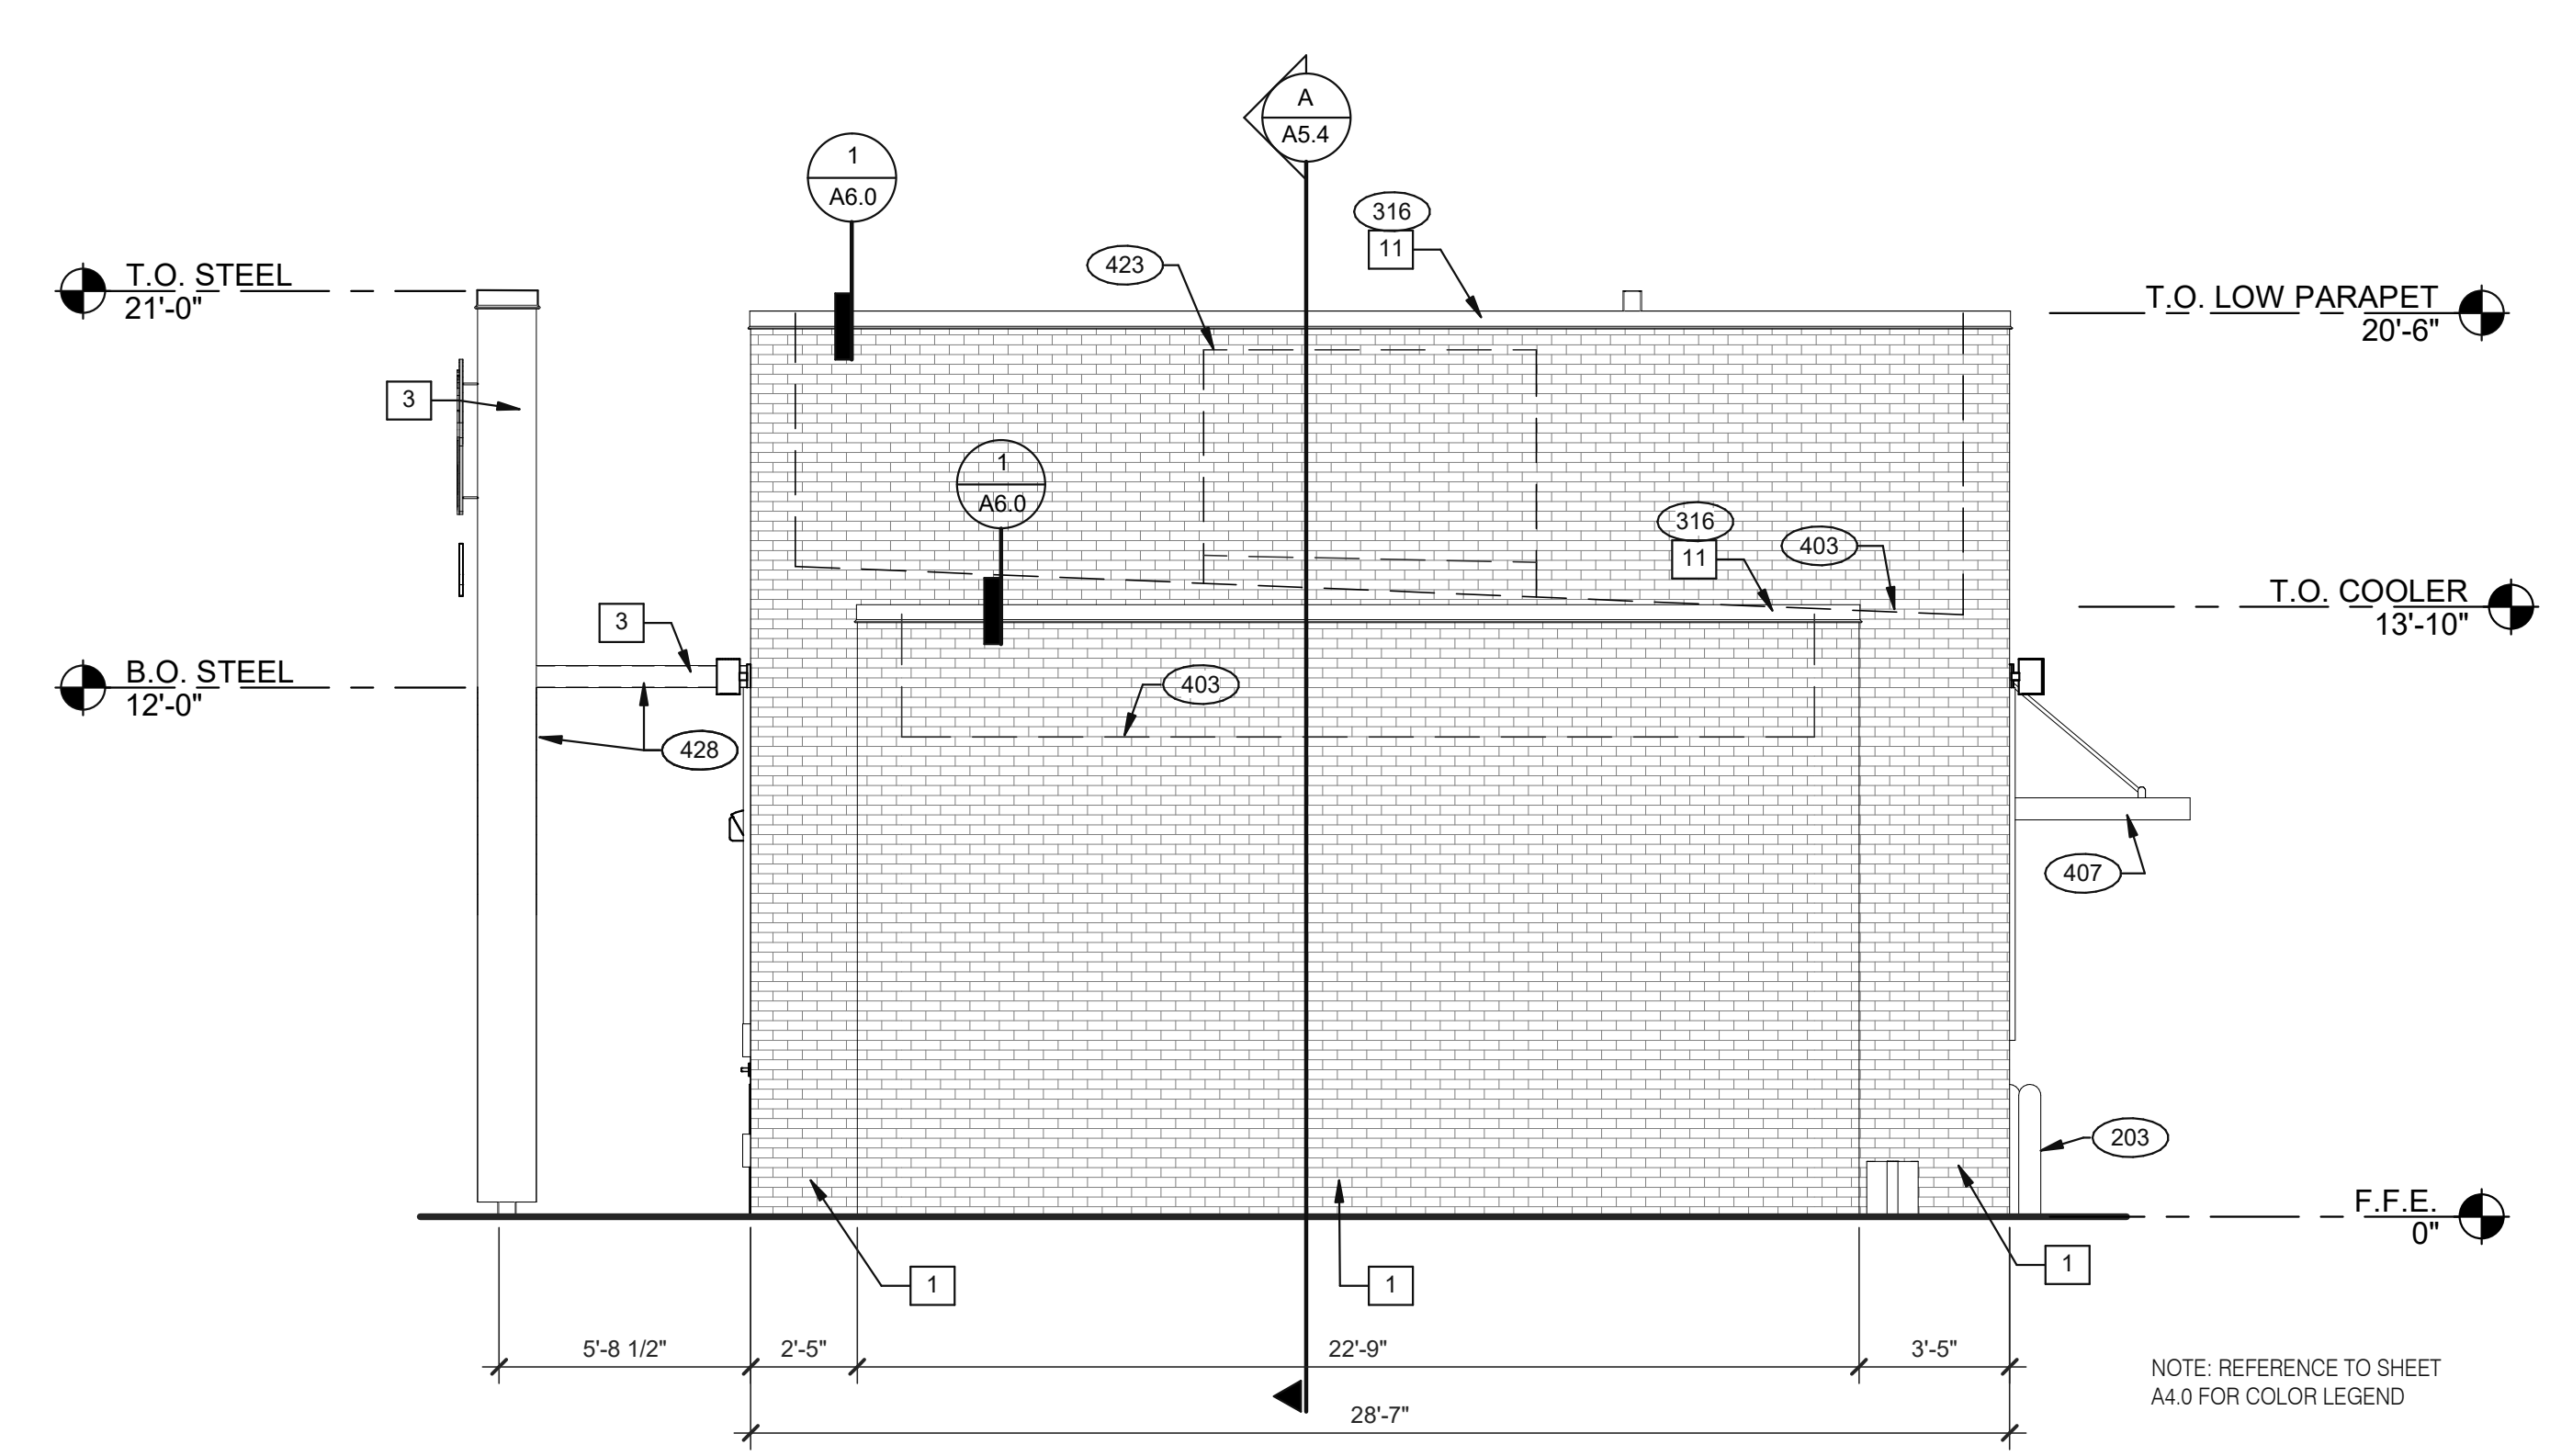

REAR ELEVATION 1/4" = 1'-0" **3**

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1


CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236




ENDEAVOR 2.0 EXTERIOR ELEVATIONS

A4.1

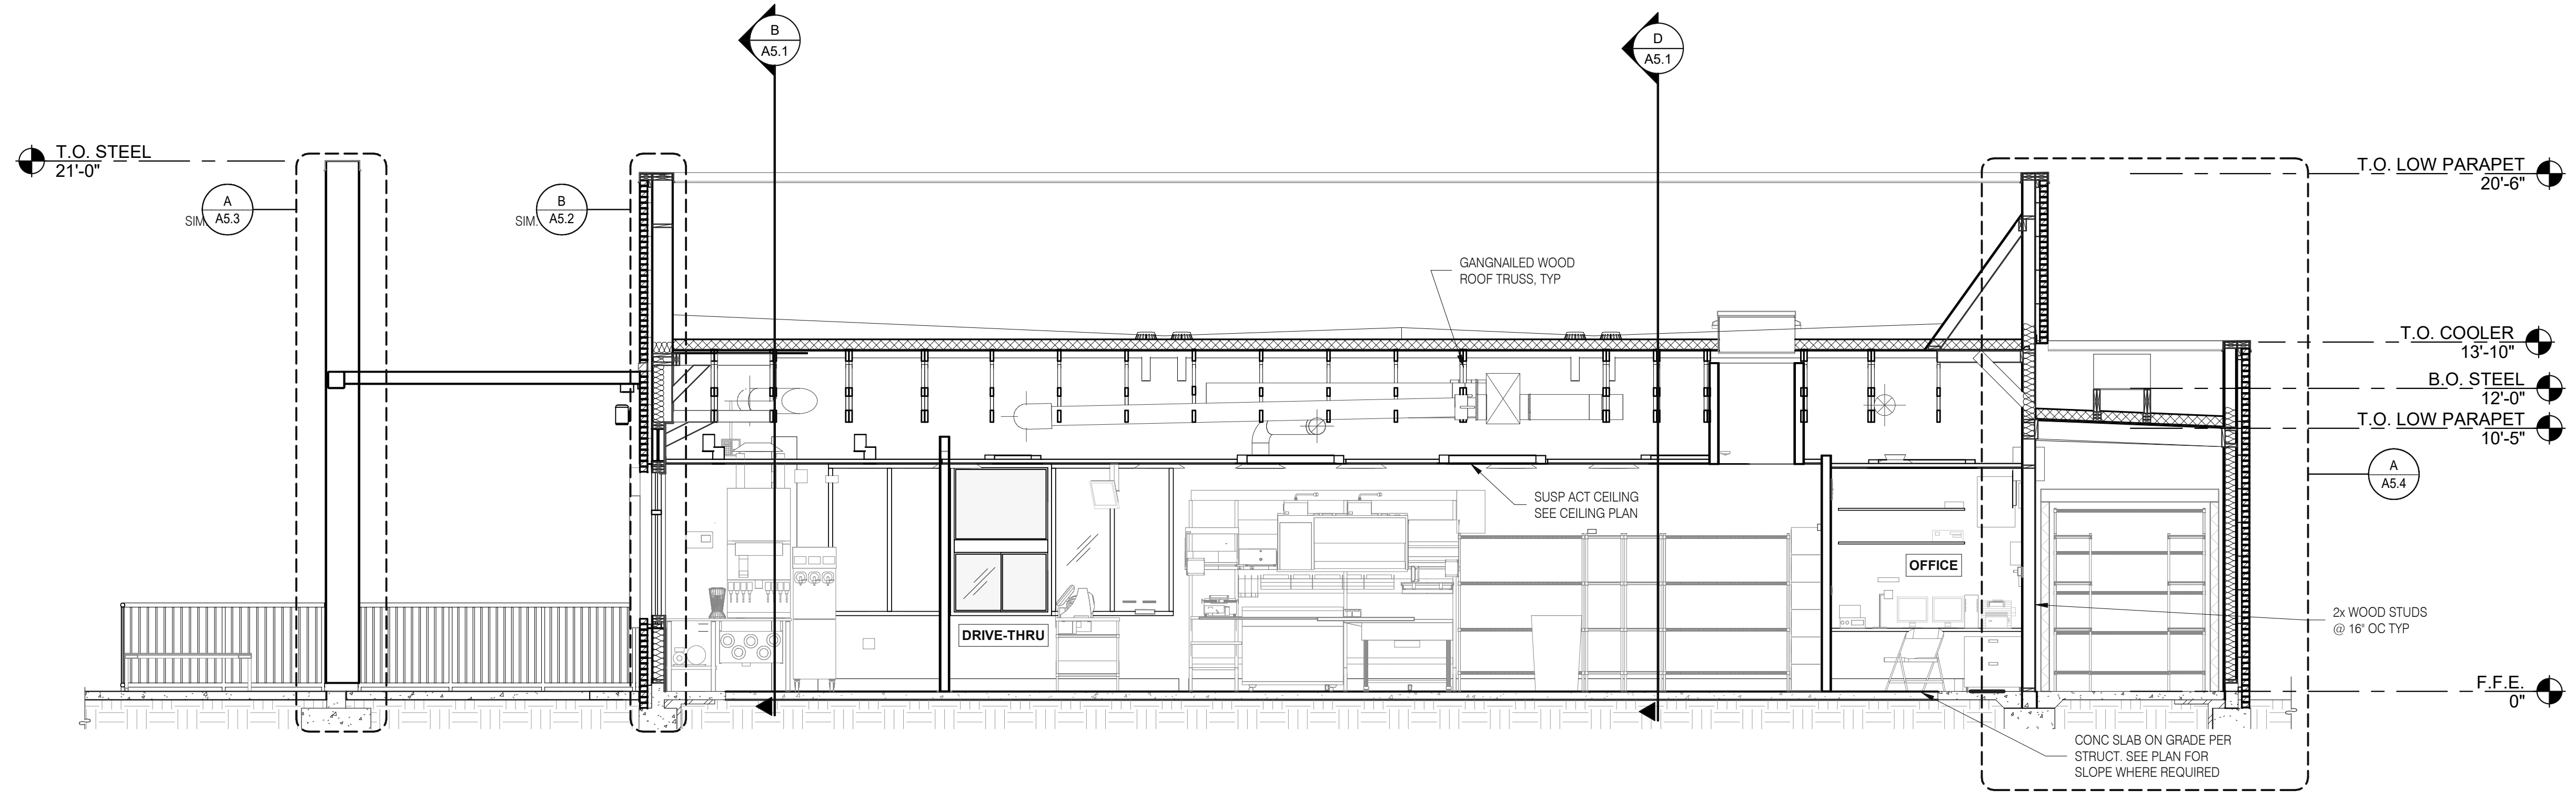

EAST/WEST BUILDING SECTION 2 1/4" = 1'-0" **A**

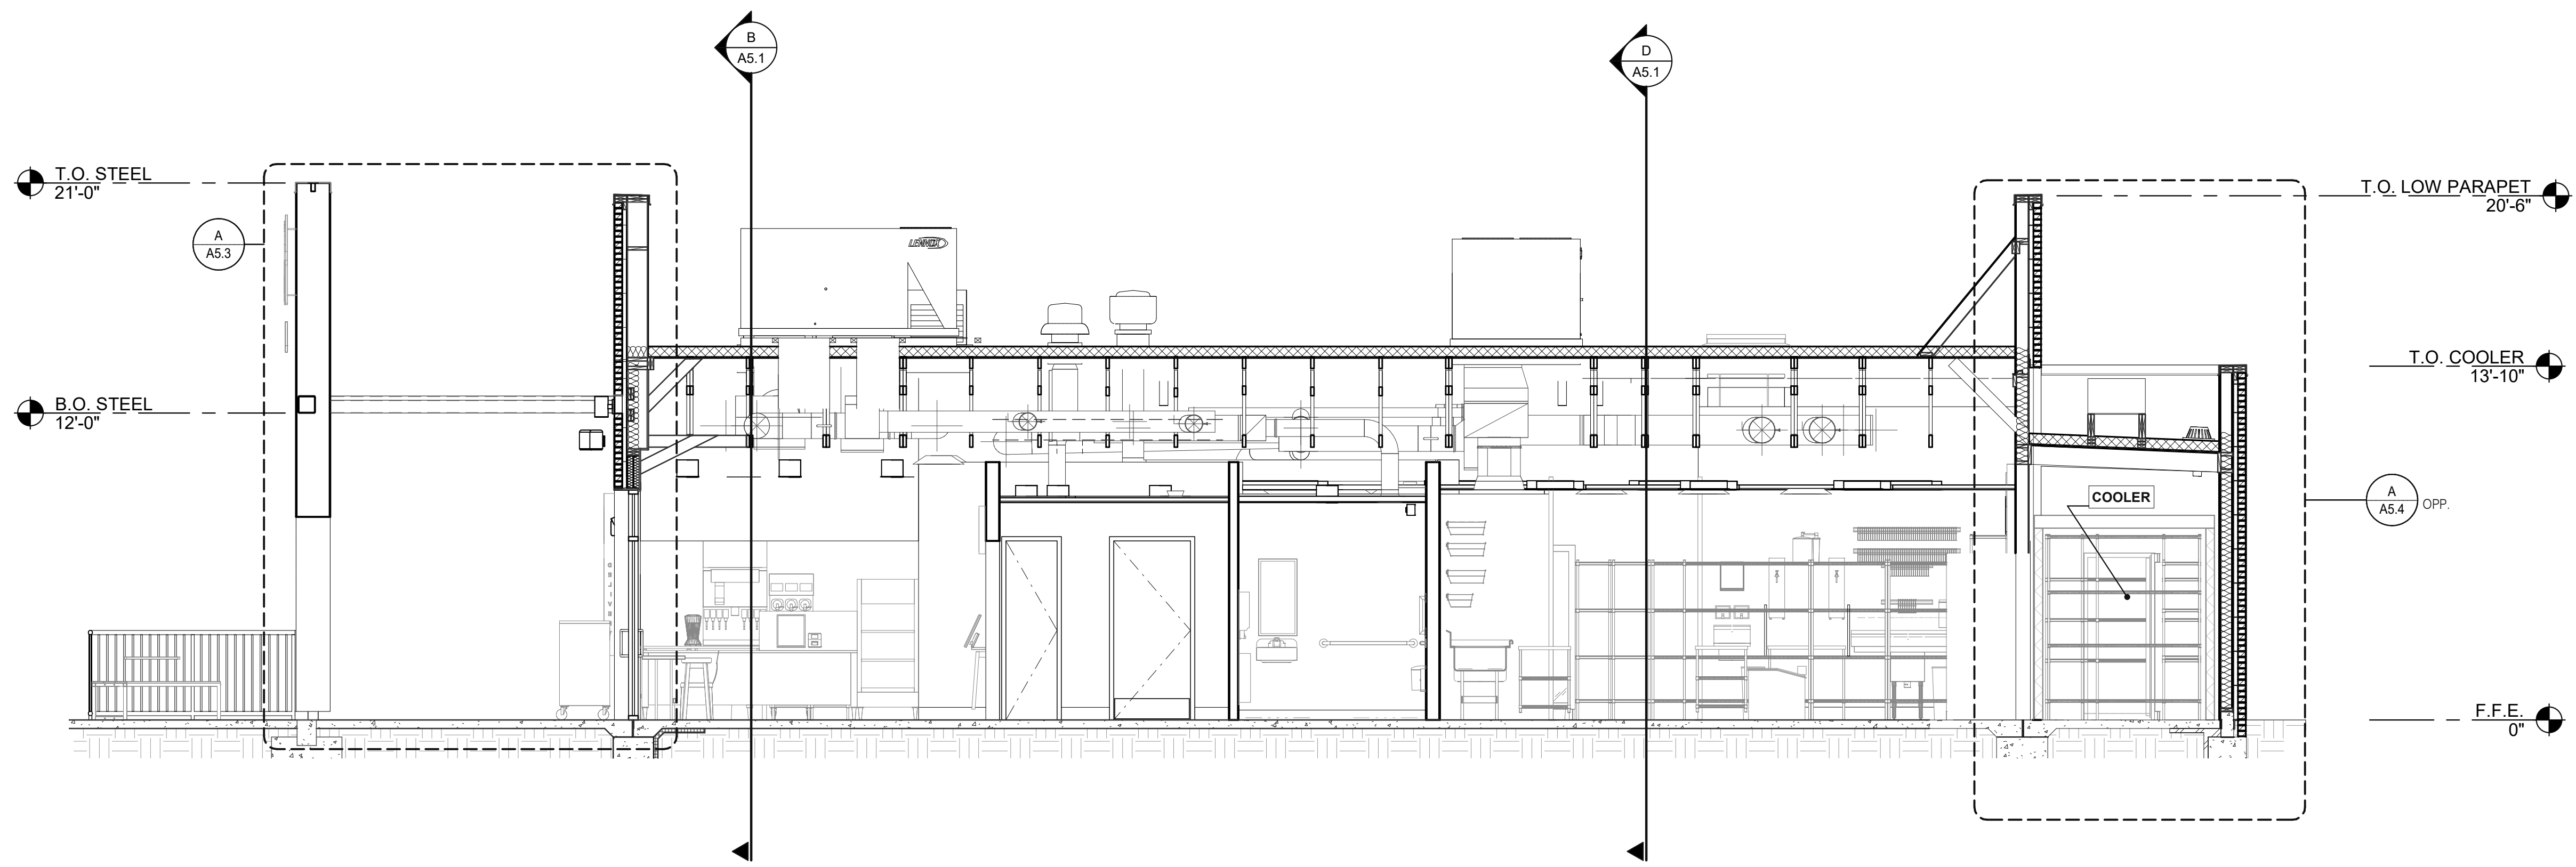

EAST/WEST BUILDING SECTION 1 1/4" = 1'-0" **B**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03


TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236




**ENDEAVOR 2.0
 BUILDING
 SECTIONS**

A5.0

PLOT DATE: 11/3/2022 11:19:58 AM

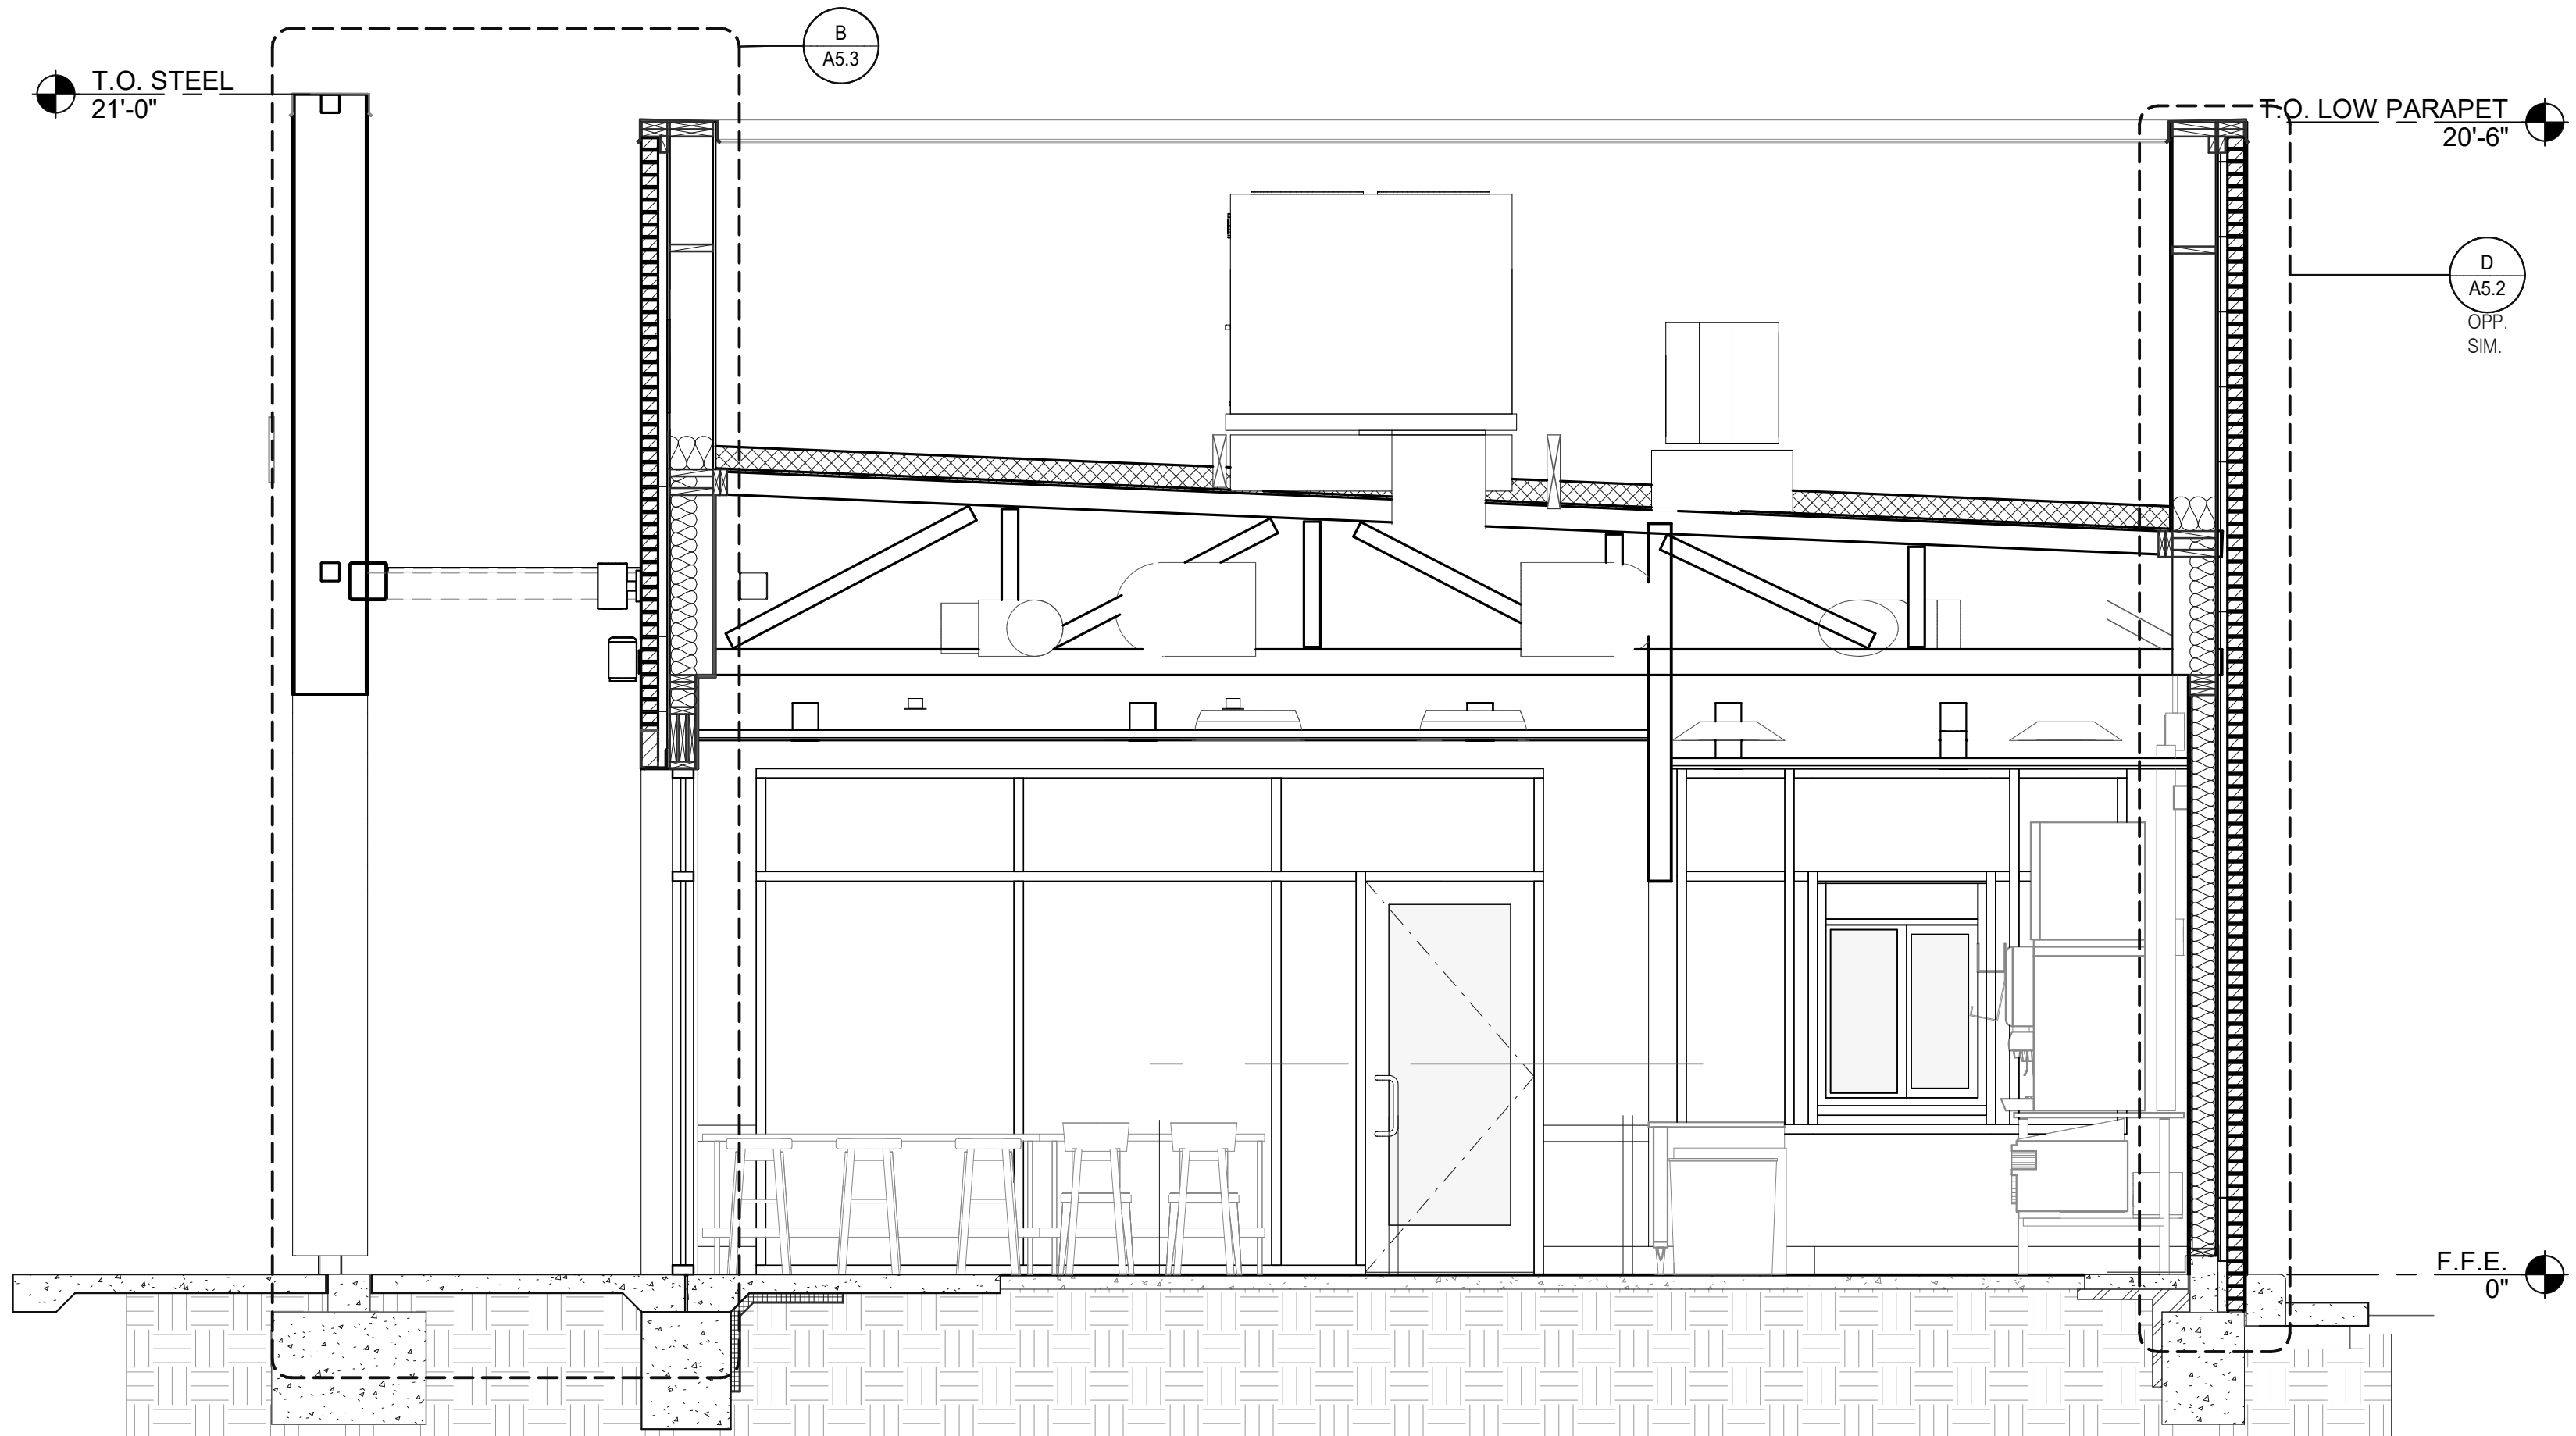

LEFT TO RIGHT BUILDING SECTION 3 3/8" = 1'-0" **B**

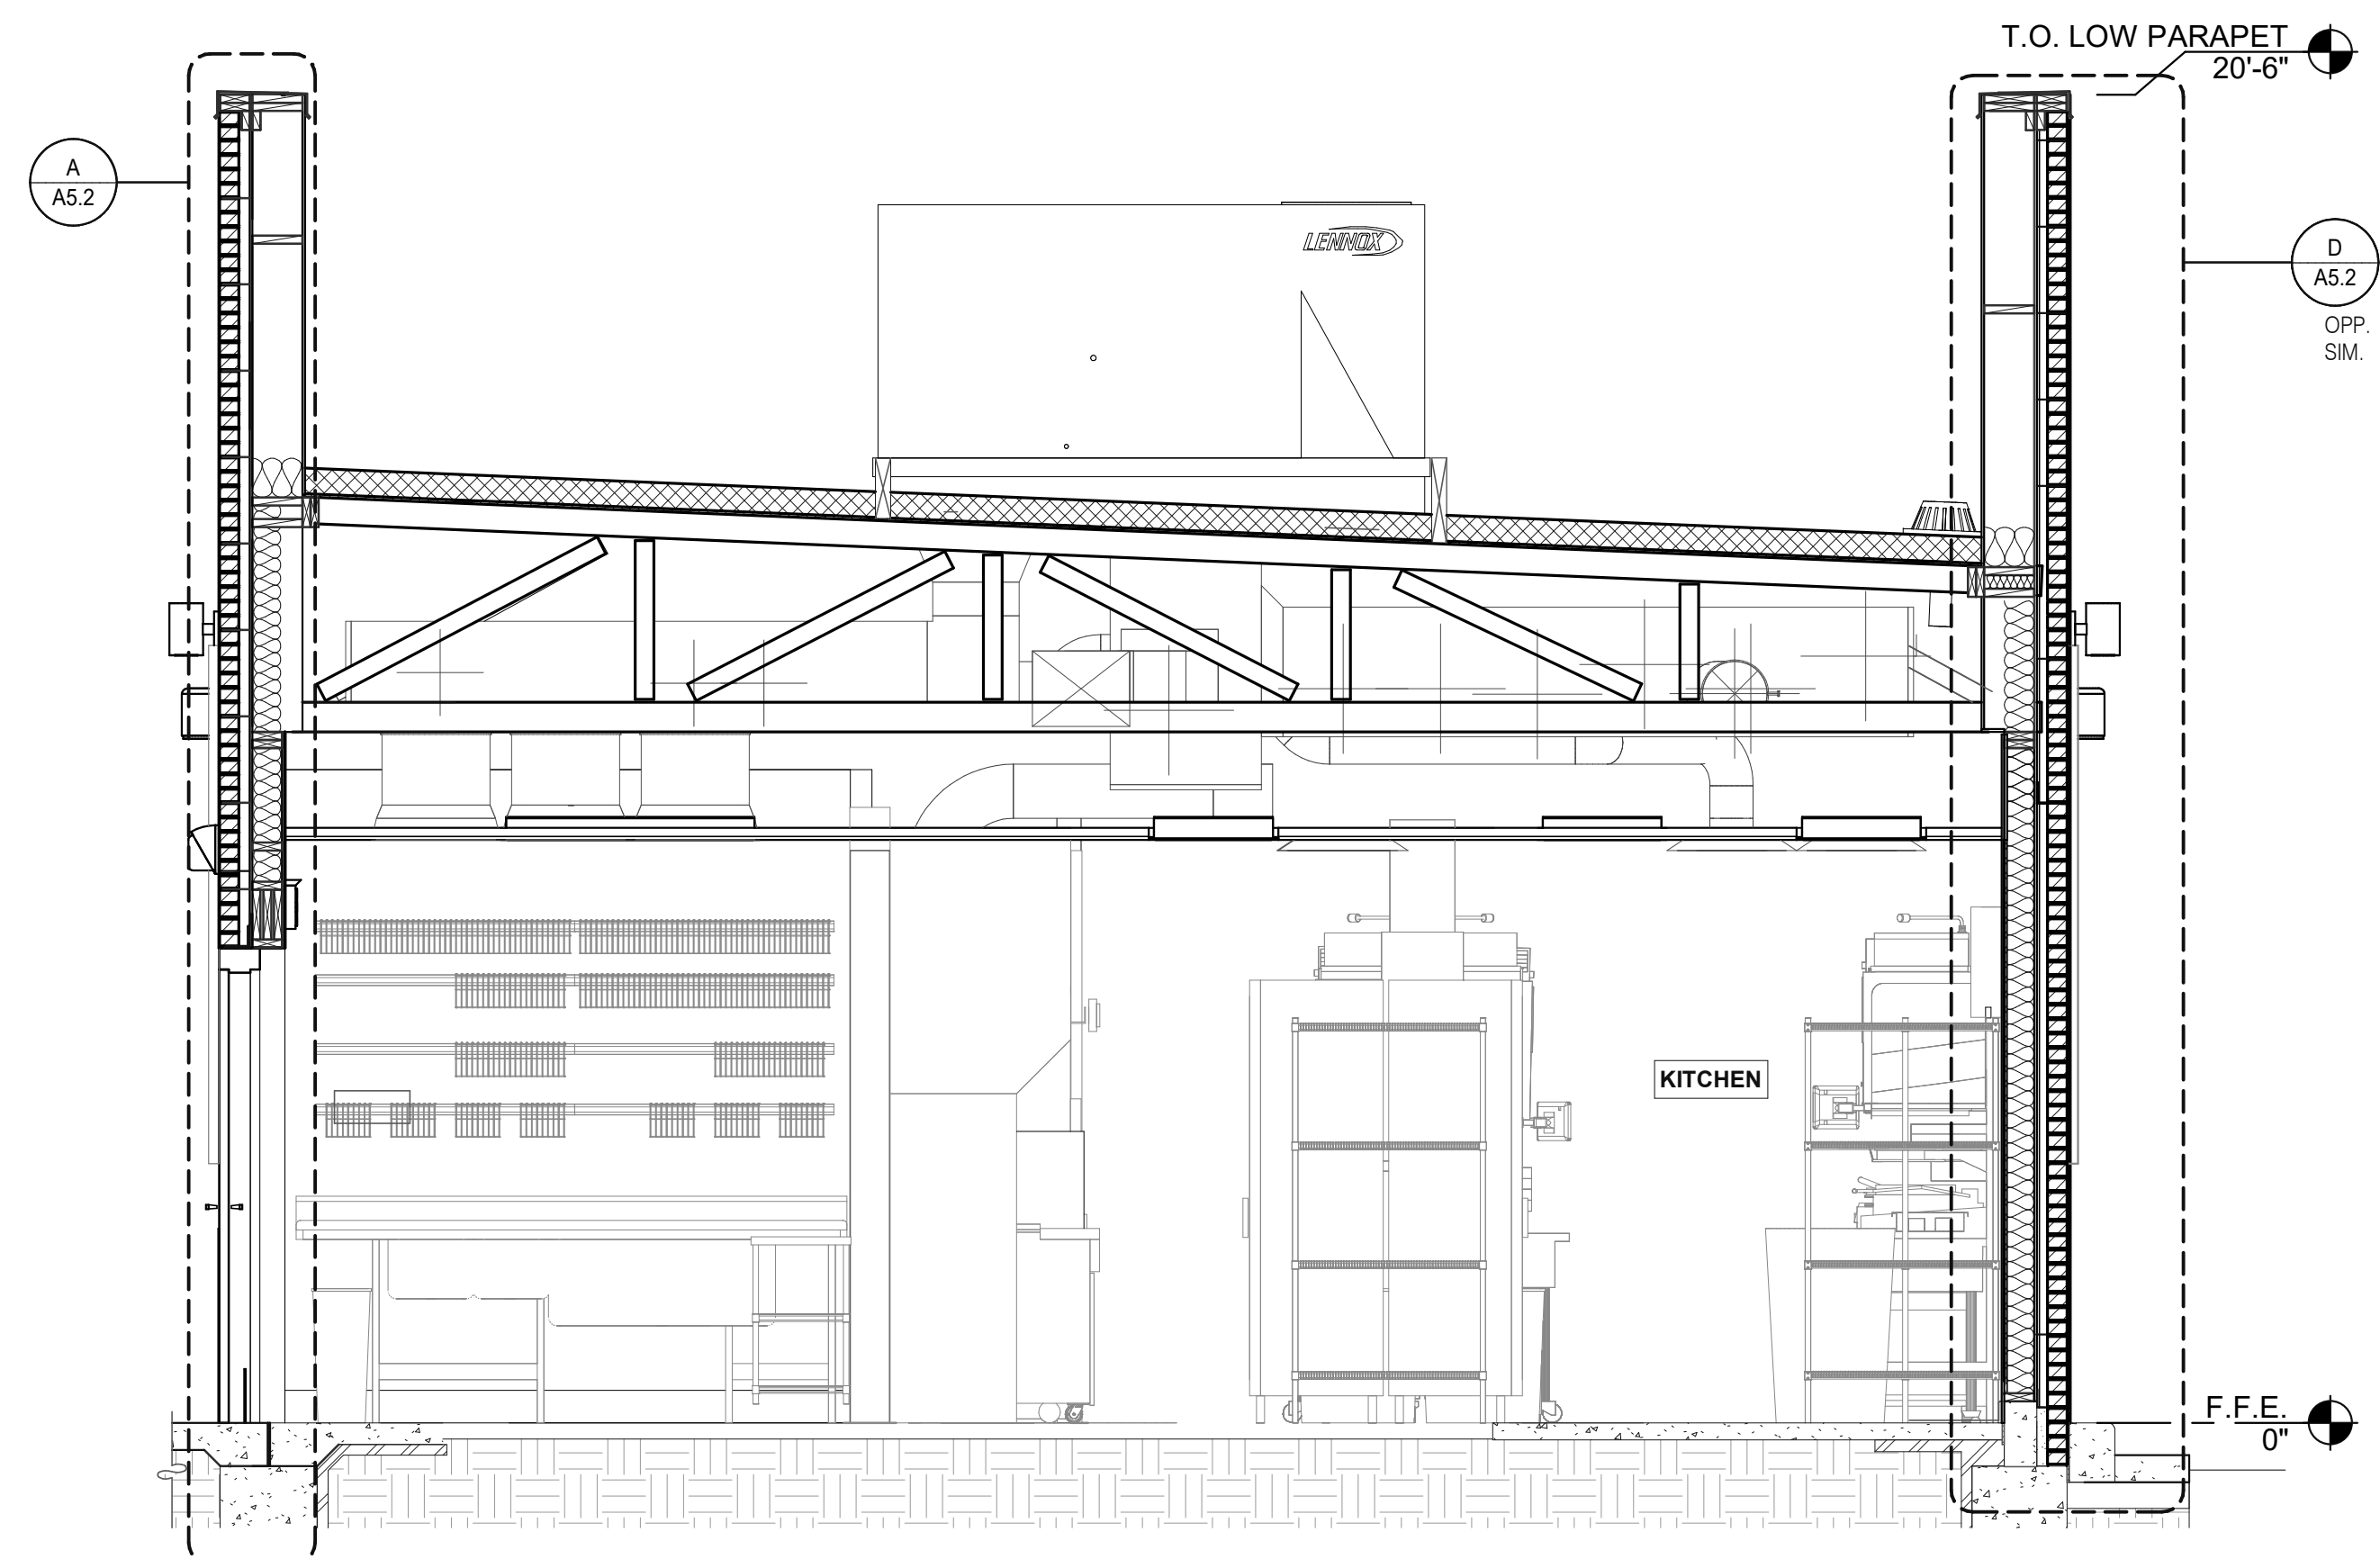

LEFT TO RIGHT BUILDING SECTION 4 3/8" = 1'-0" **D**

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236




**ENDEAVOR 2.0
 BUILDING
 SECTIONS**


A5.1

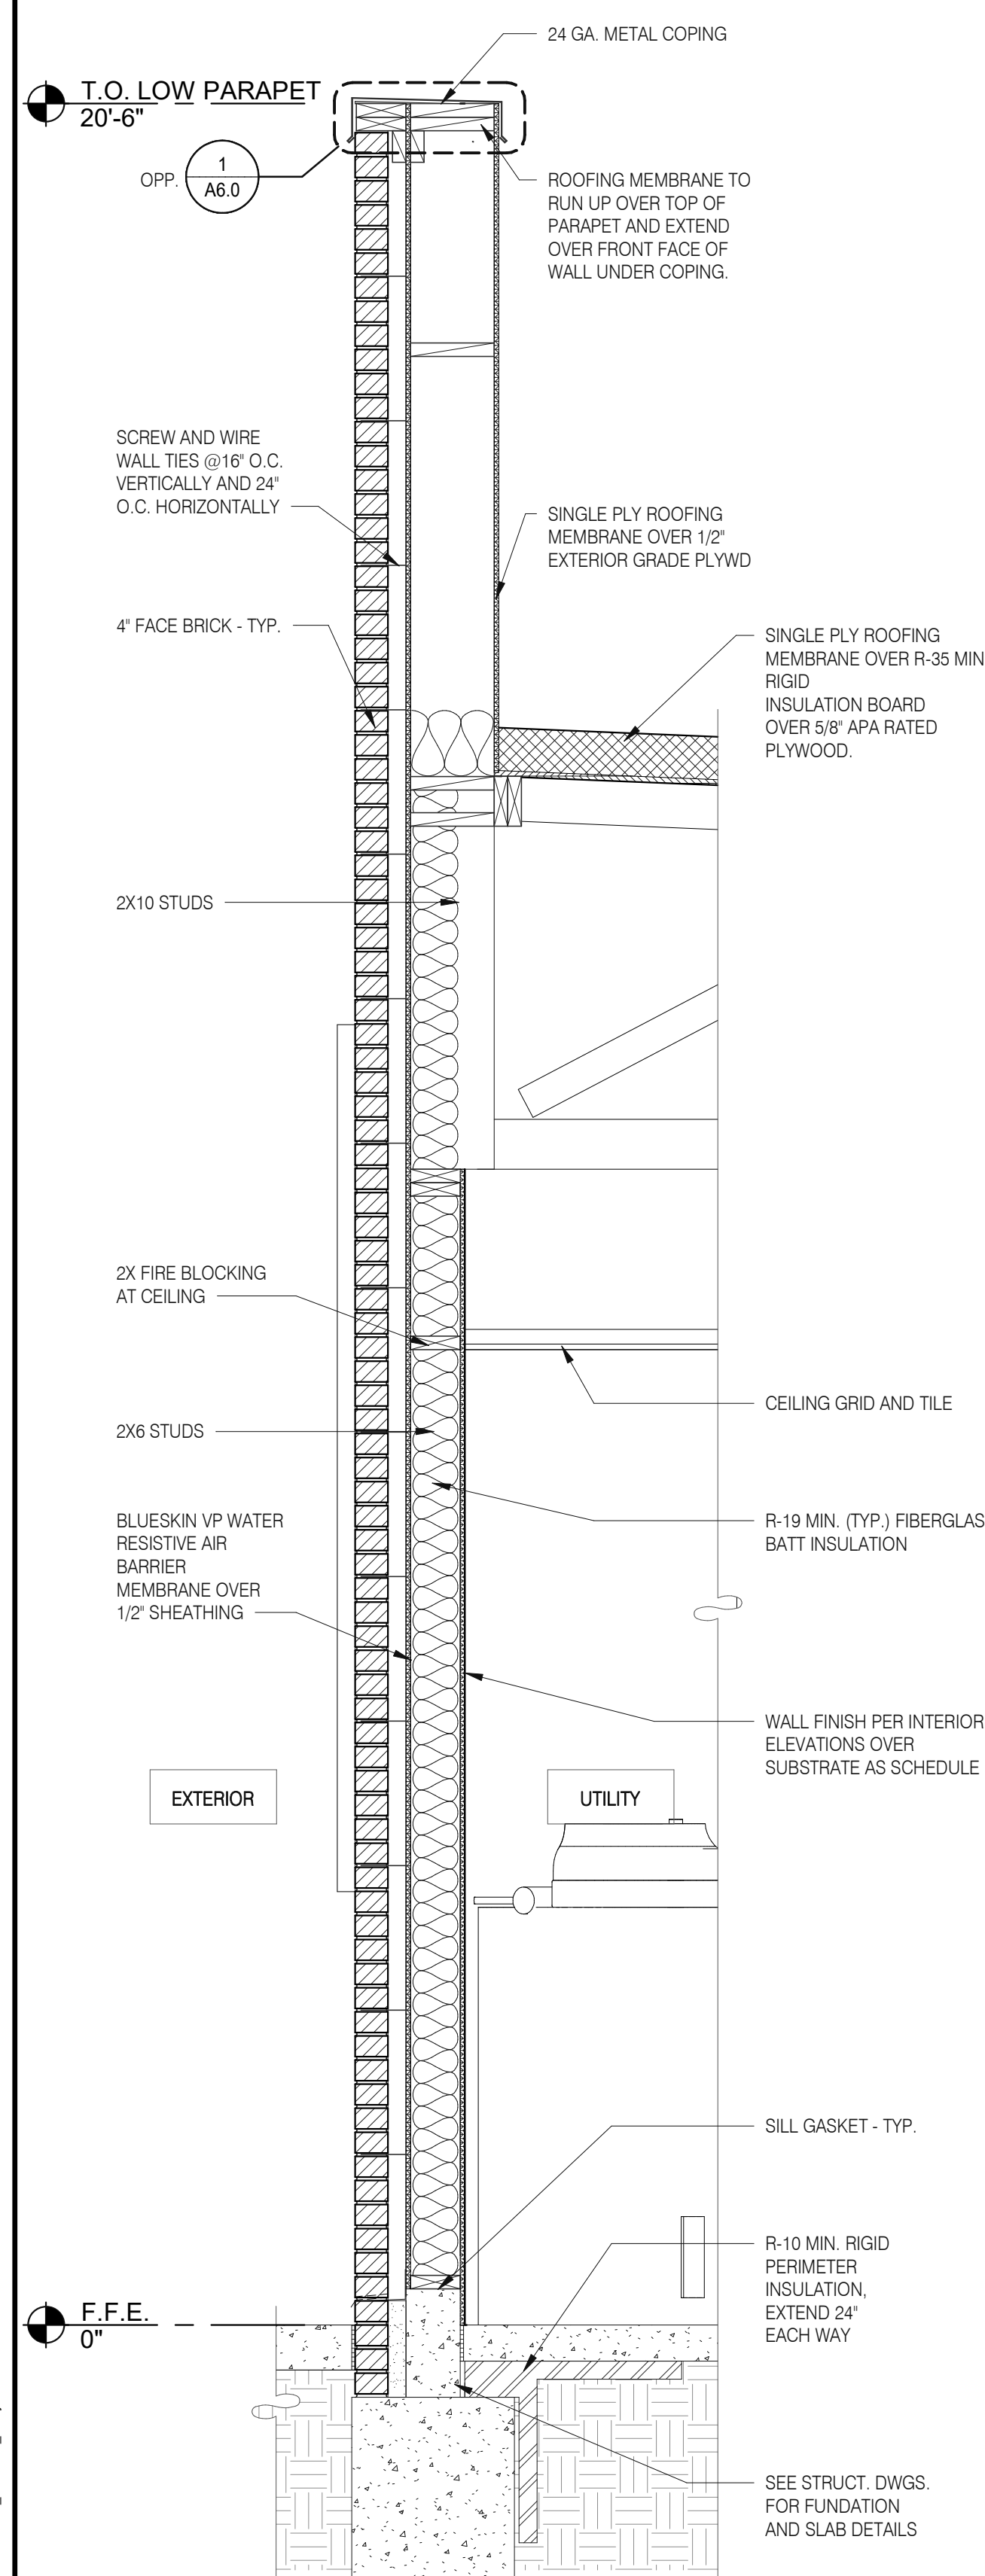


TYPICAL WALL SECTION 3/4" = 1'-0" D

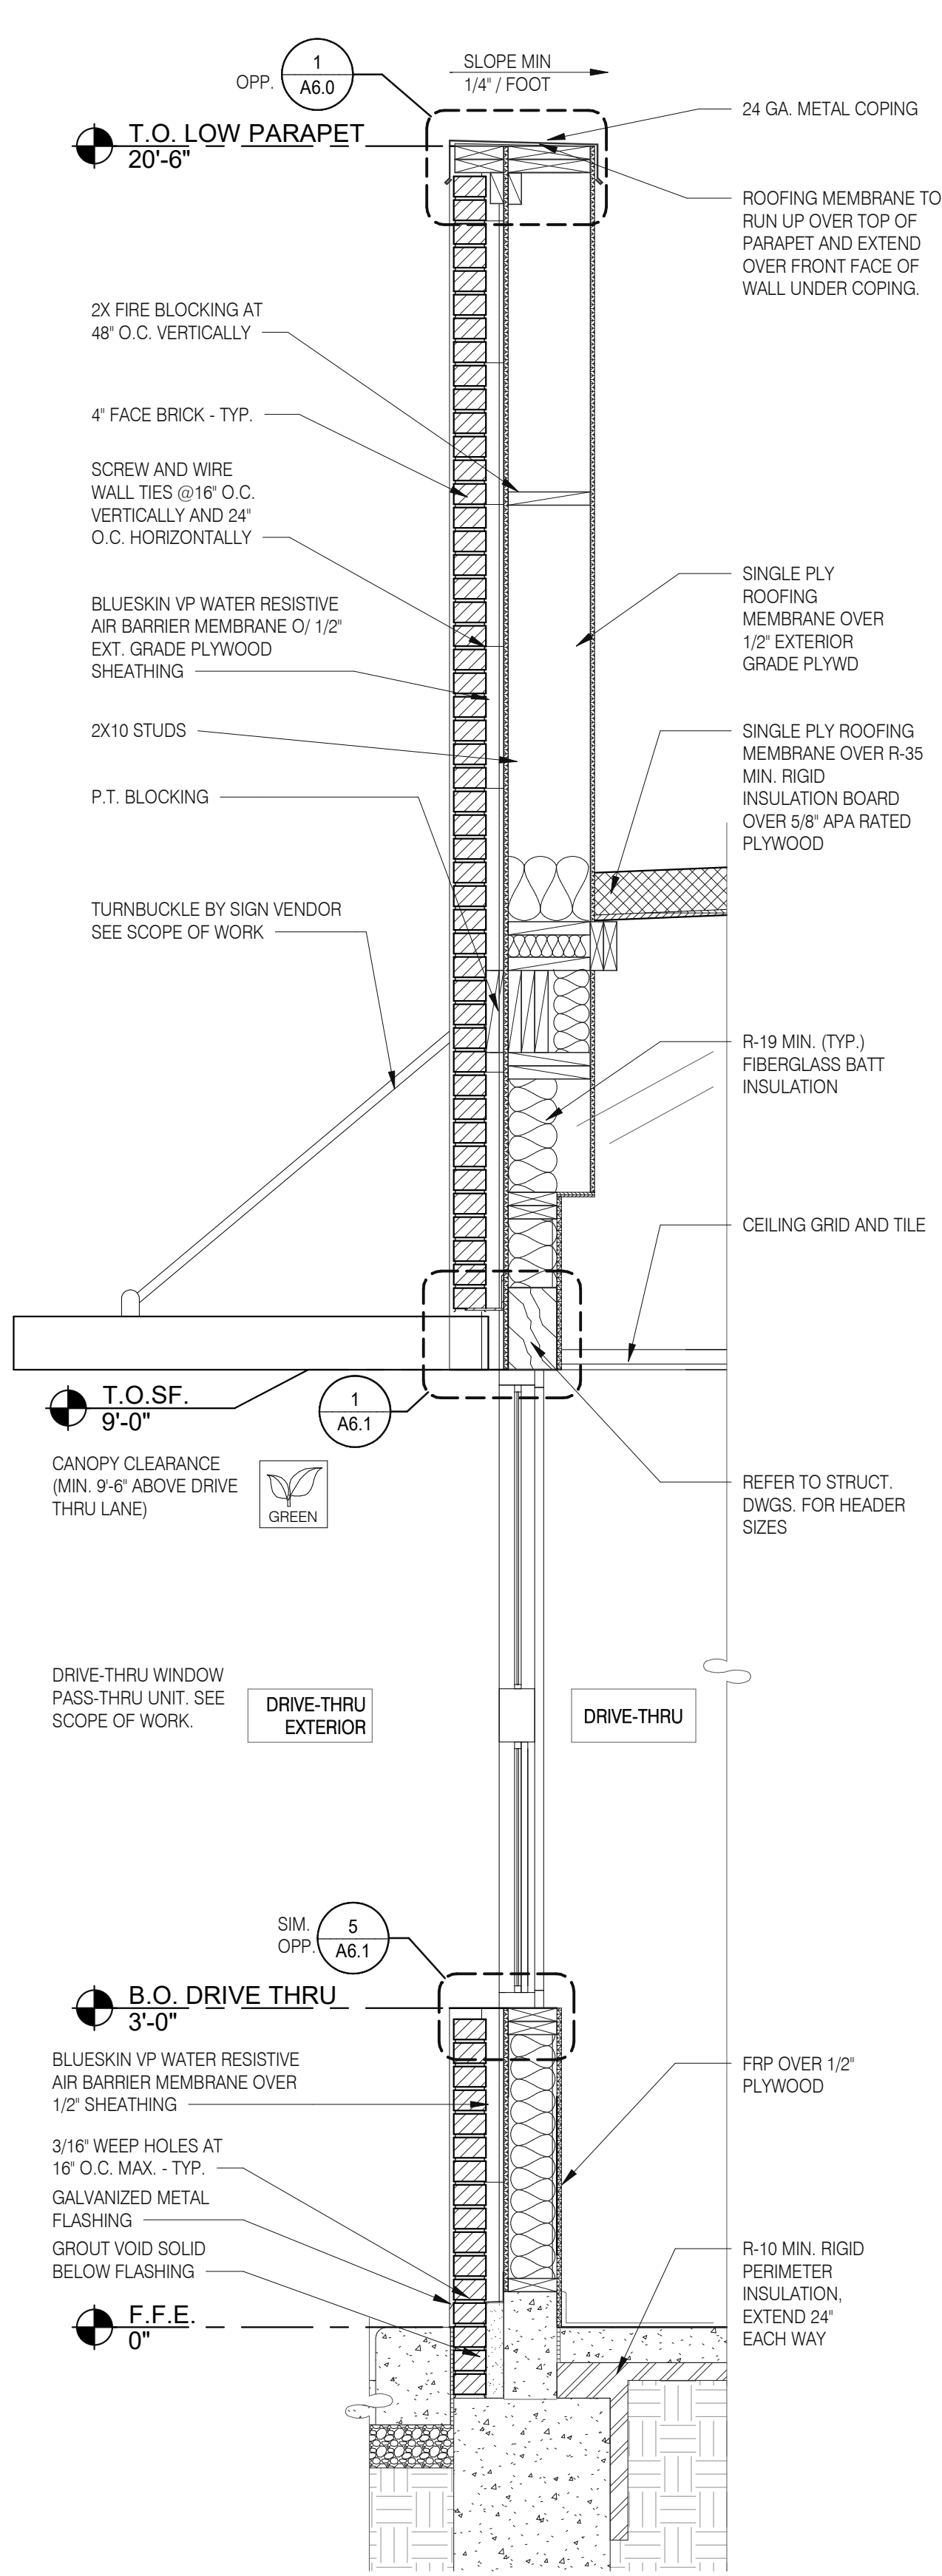

WALL SECTION AT DRIVE THRU 3/4" = 1'-0" C

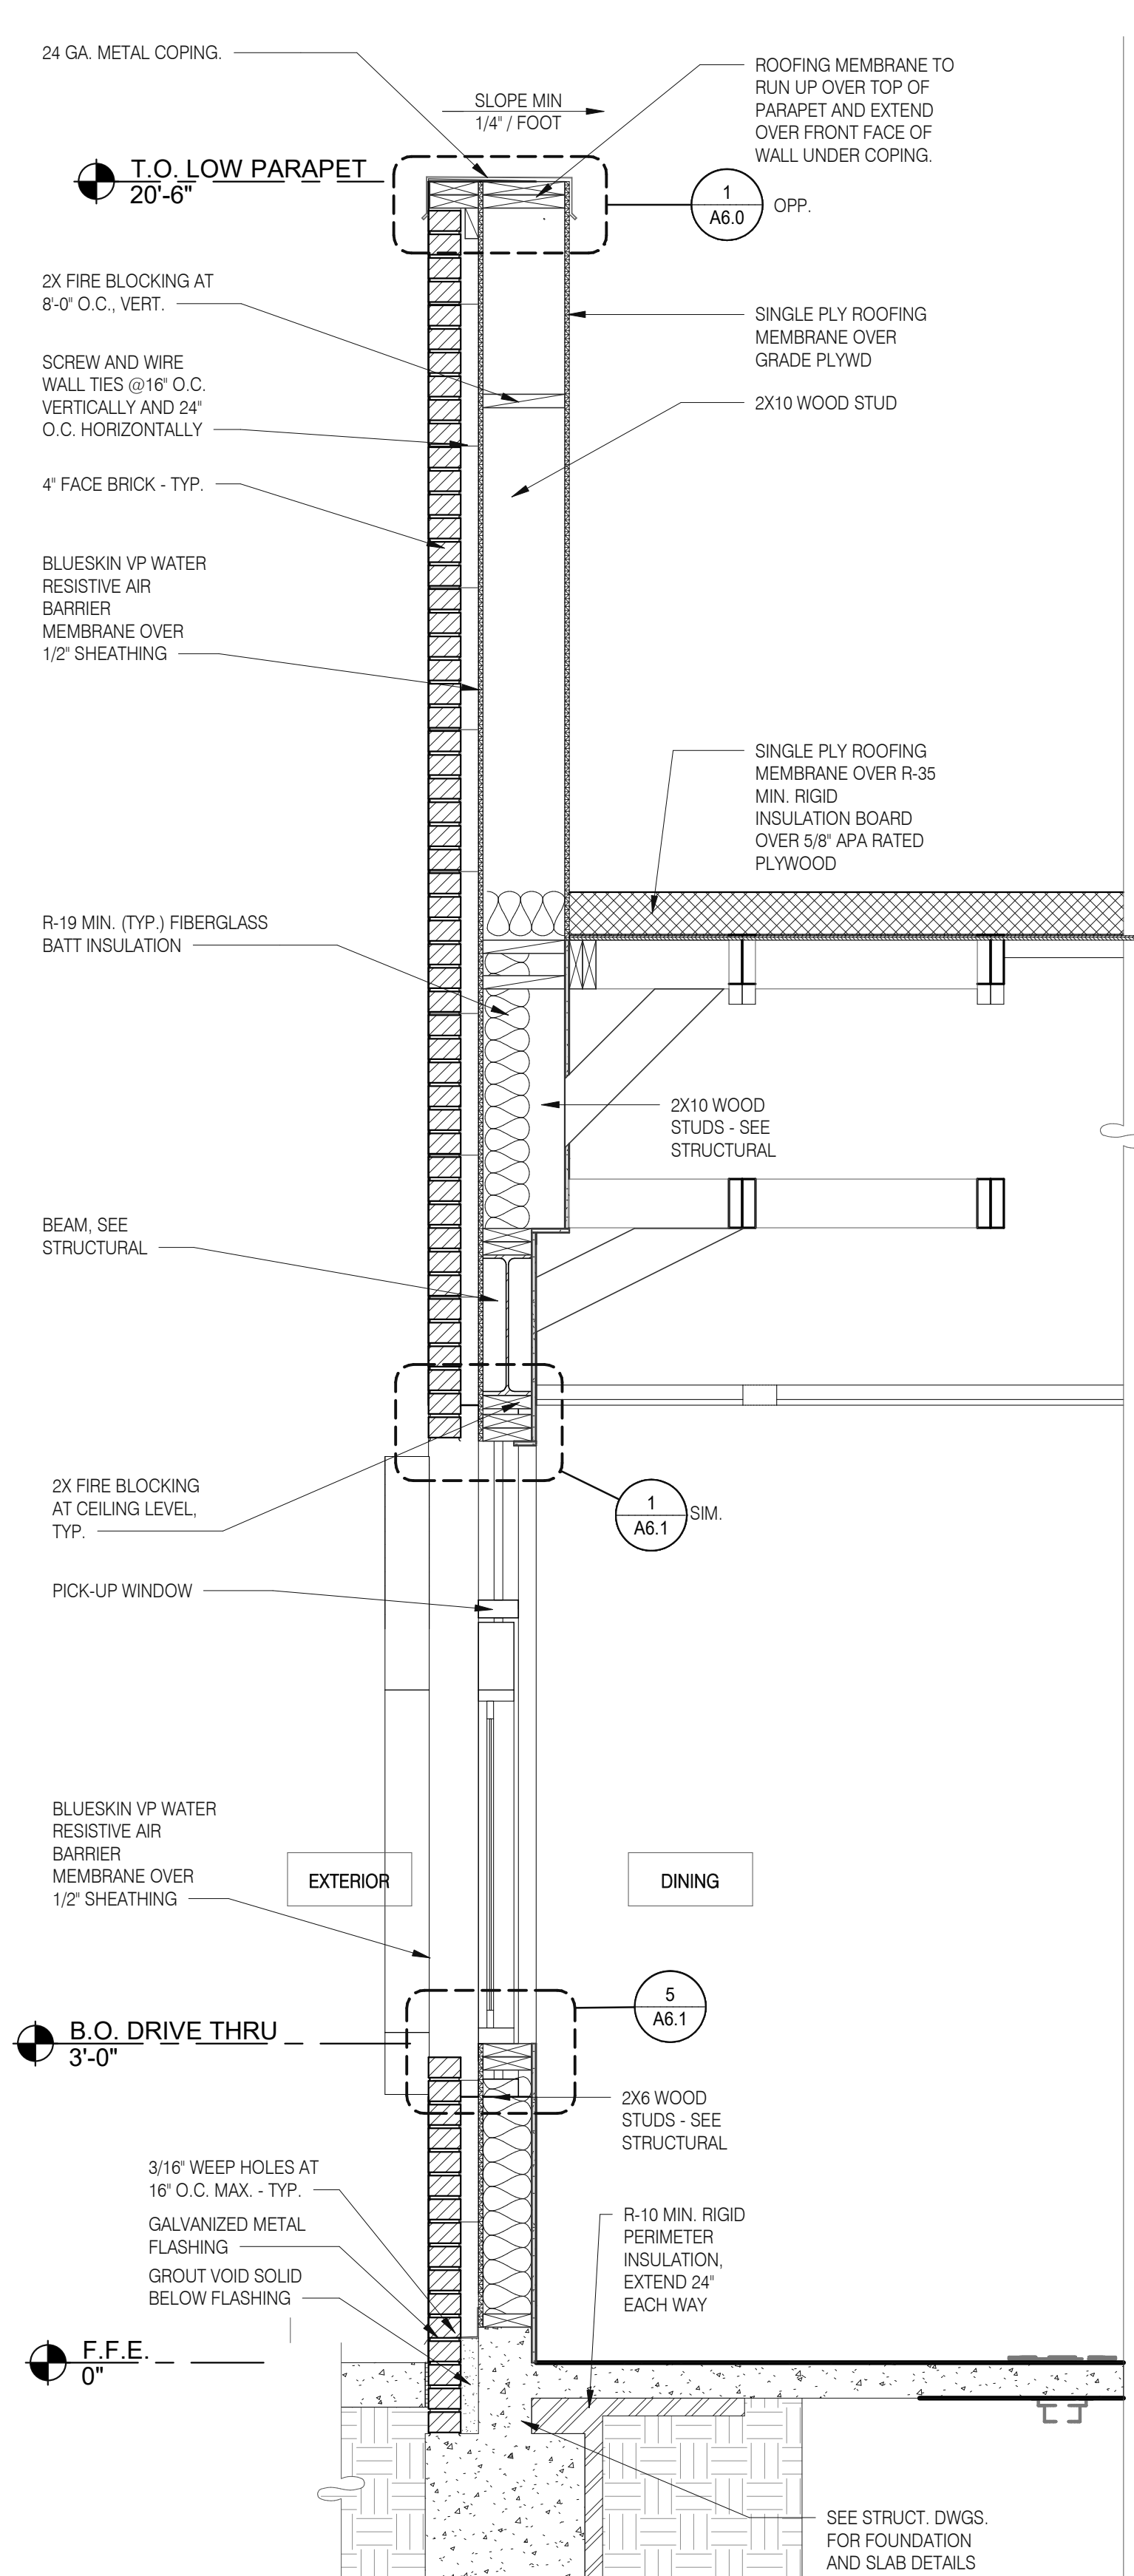

SECTION AT DINING - TOWER 3/4" = 1'-0" B

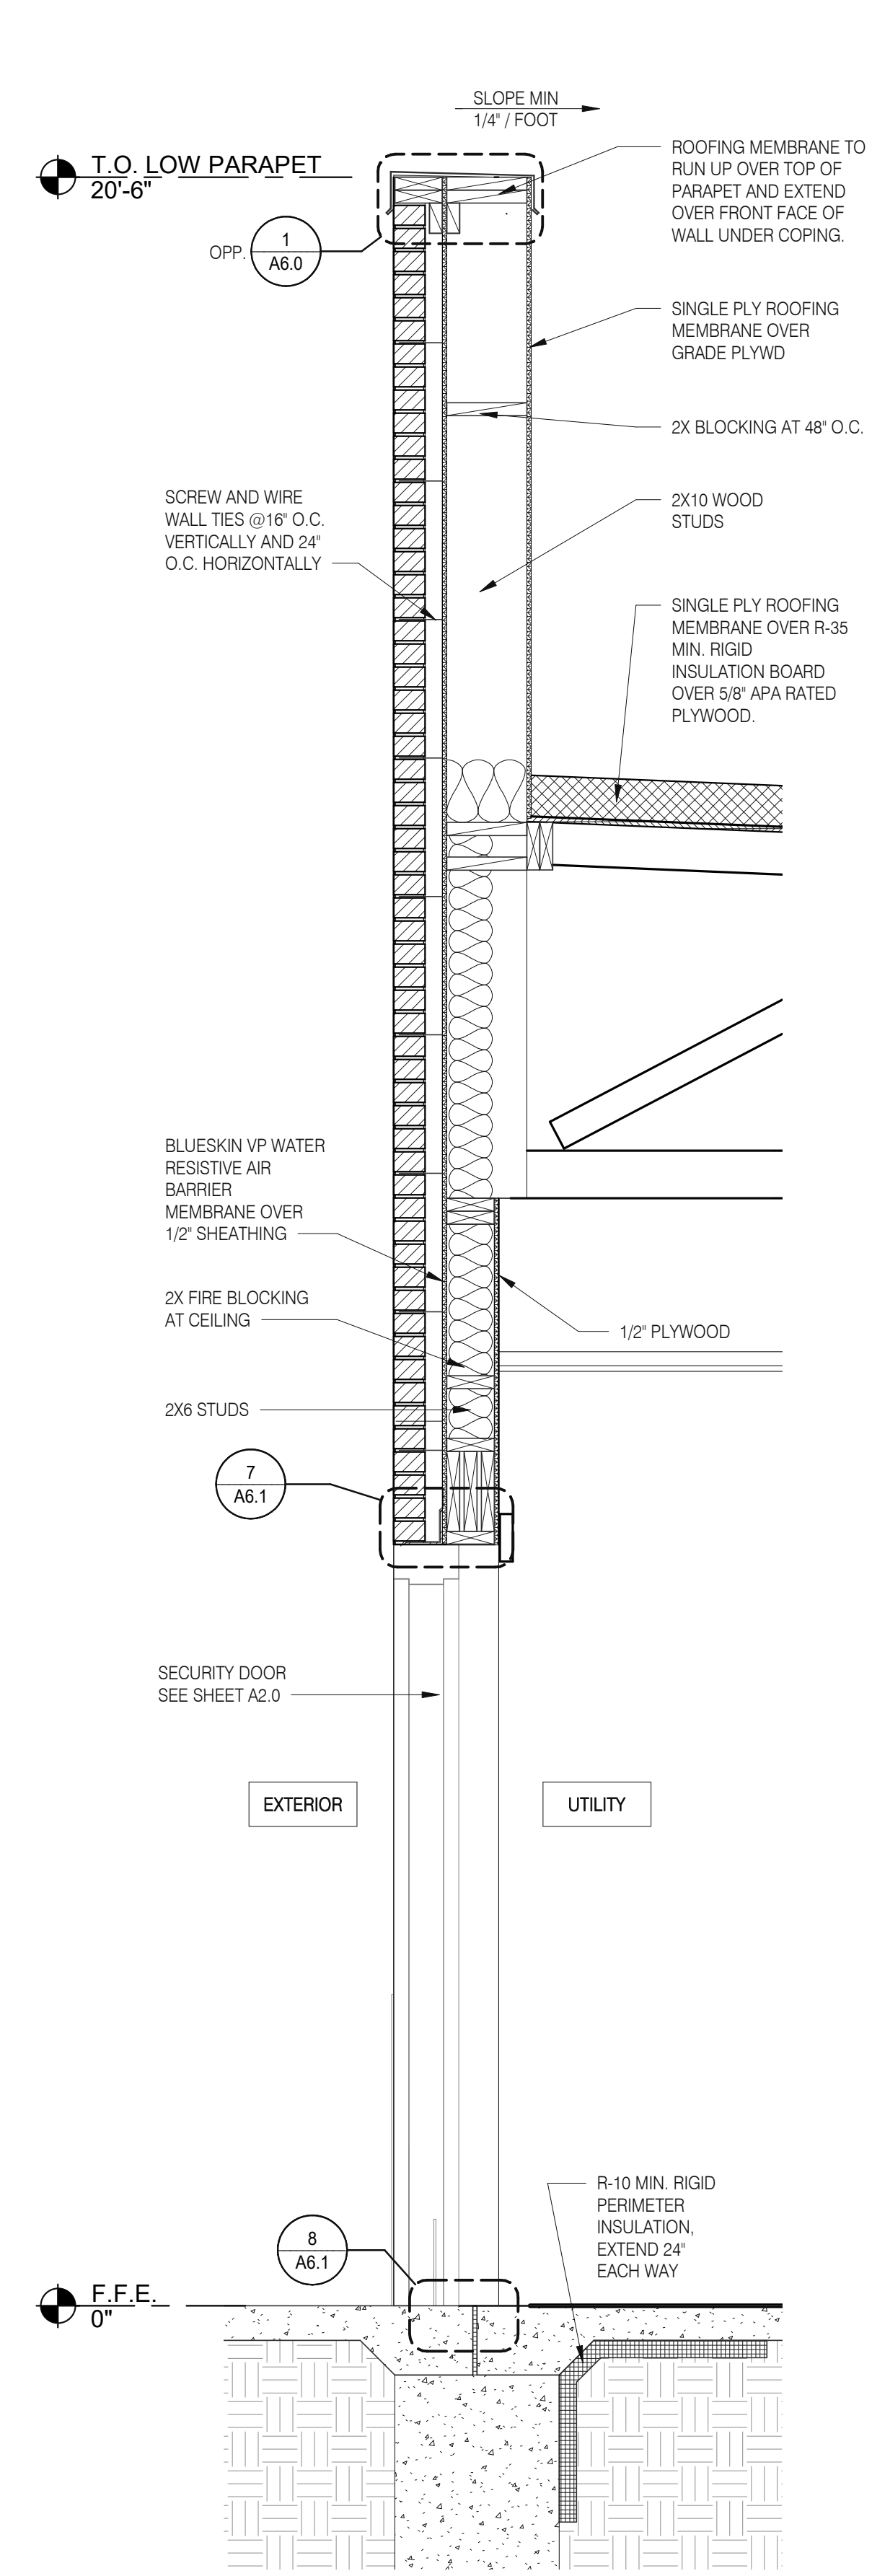

WALL SECTION AT SERVICE DOOR 3/4" = 1'-0" A

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




**ENDEAVOR 2.0
WALL
SECTIONS**

A5.2

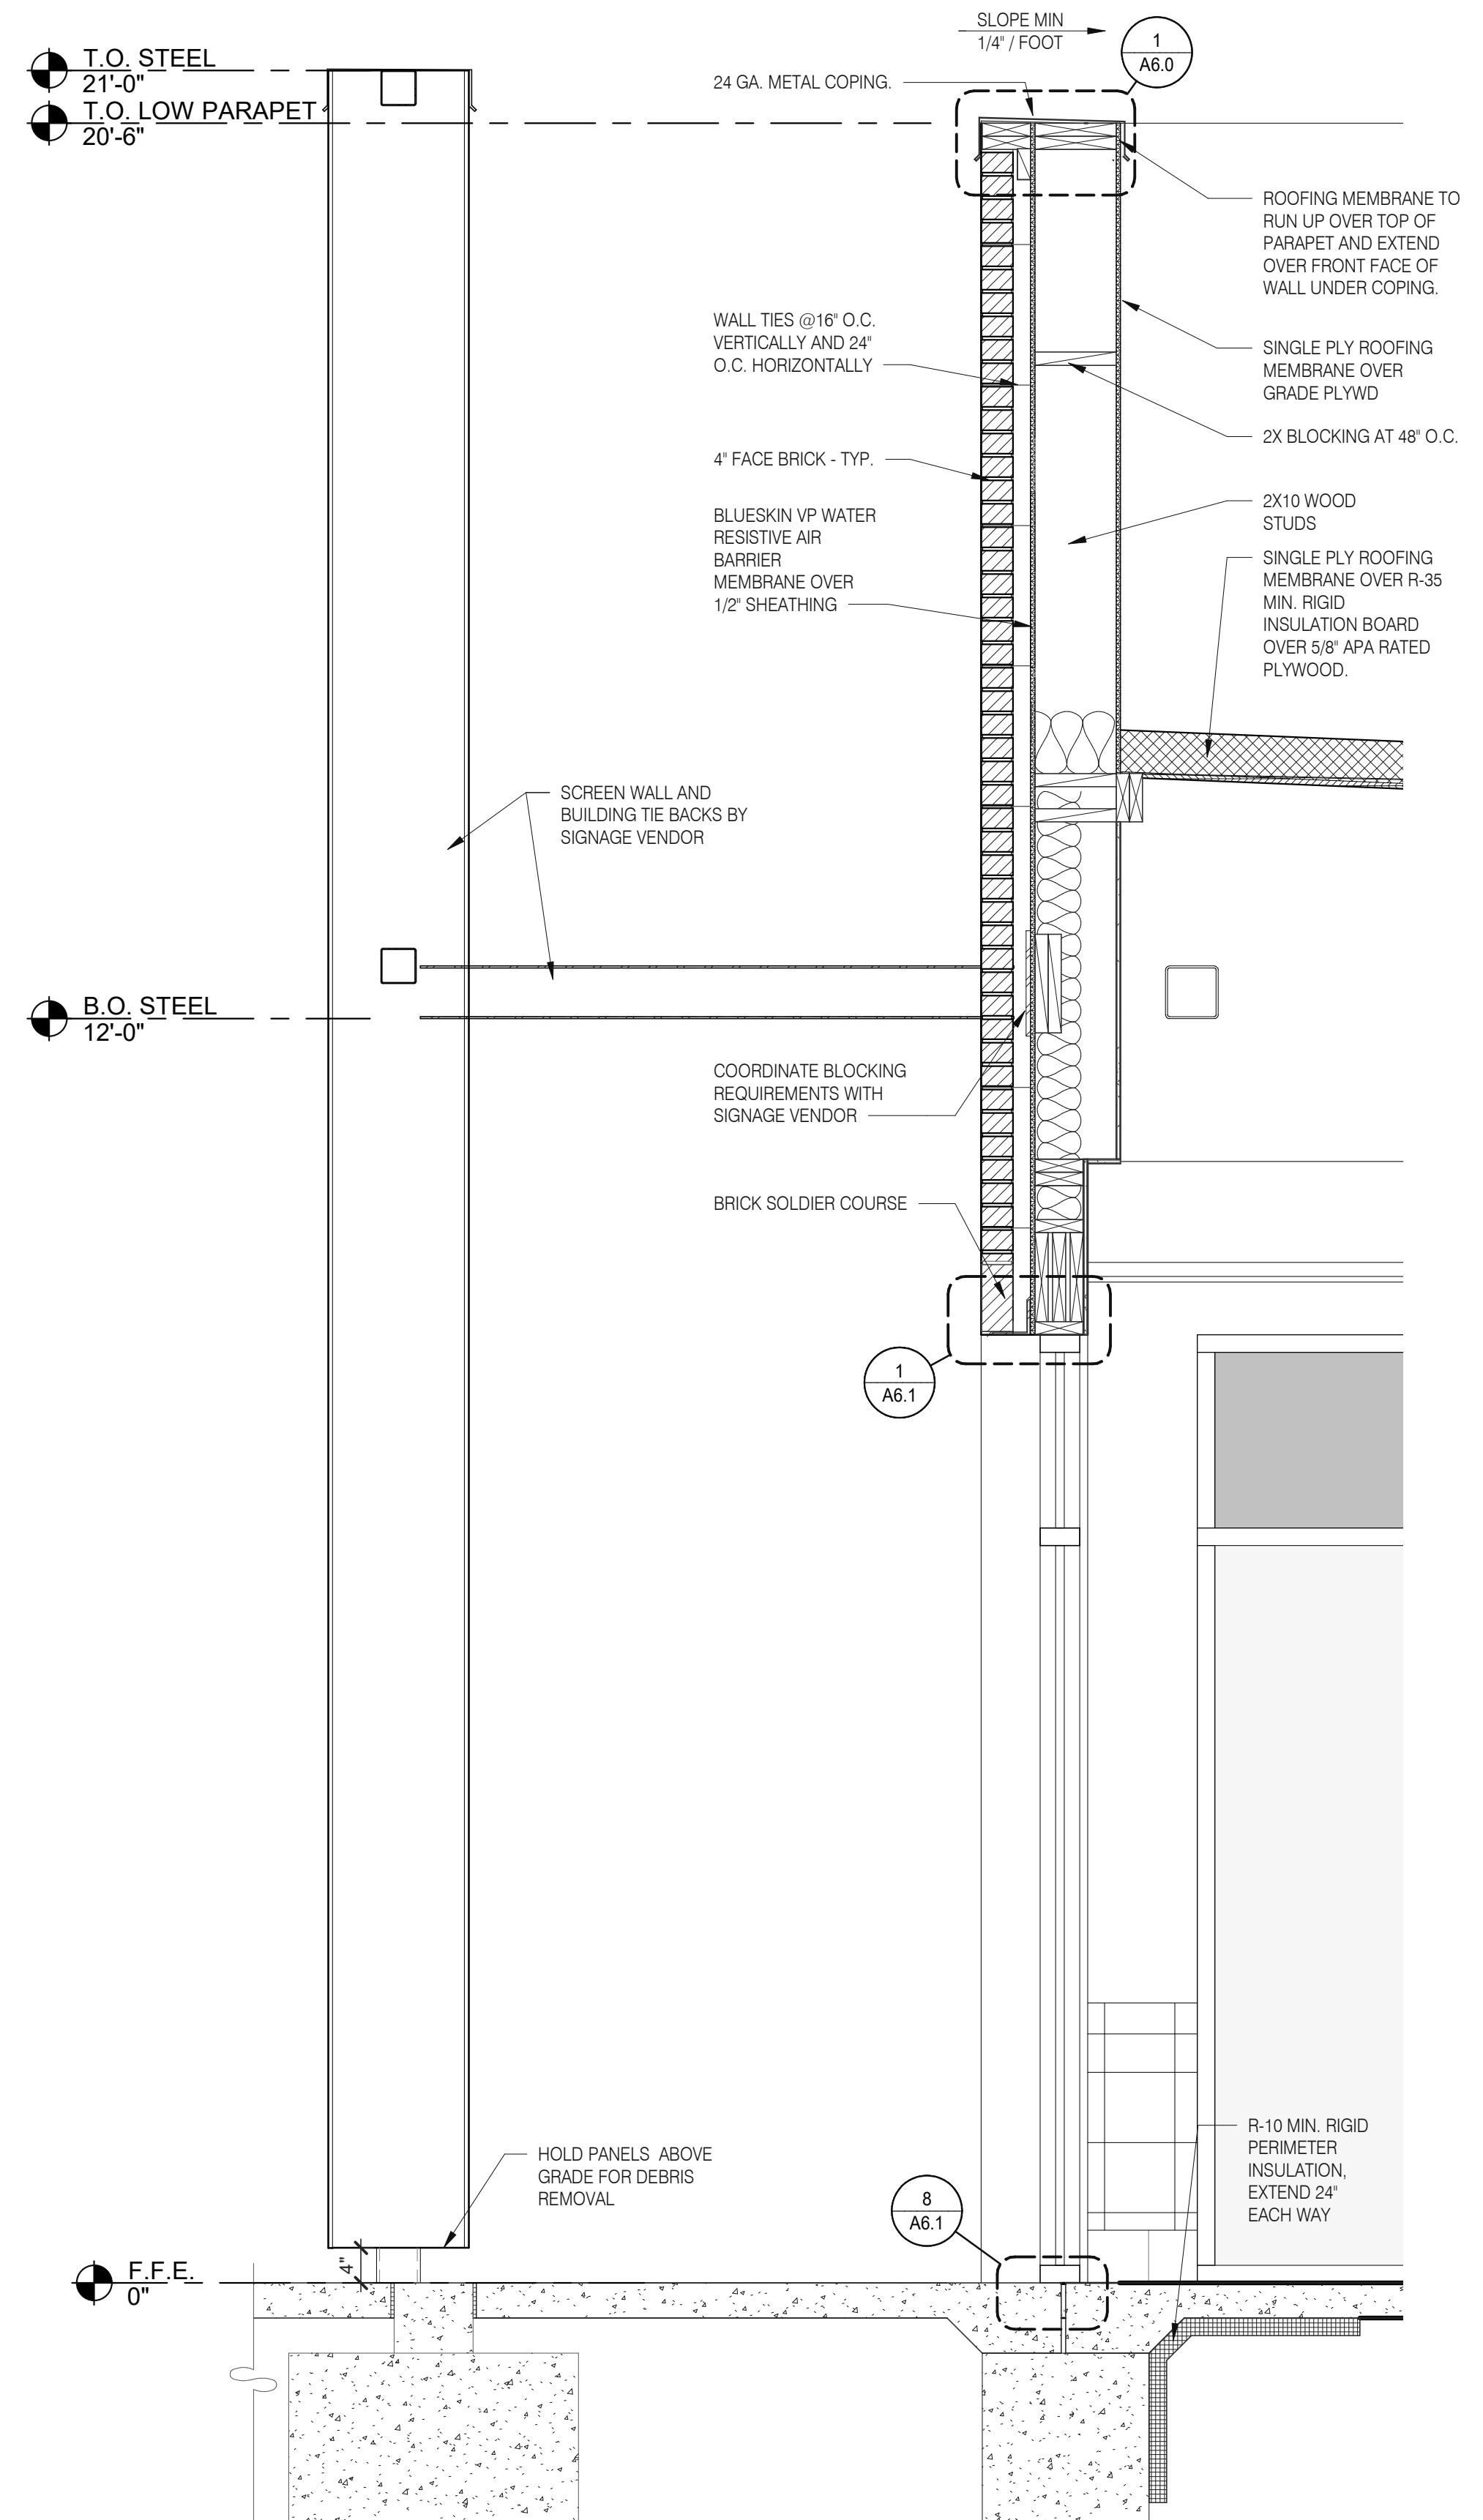

SIDE SCREEN WALL SECTION 3/4" = 1'-0" B

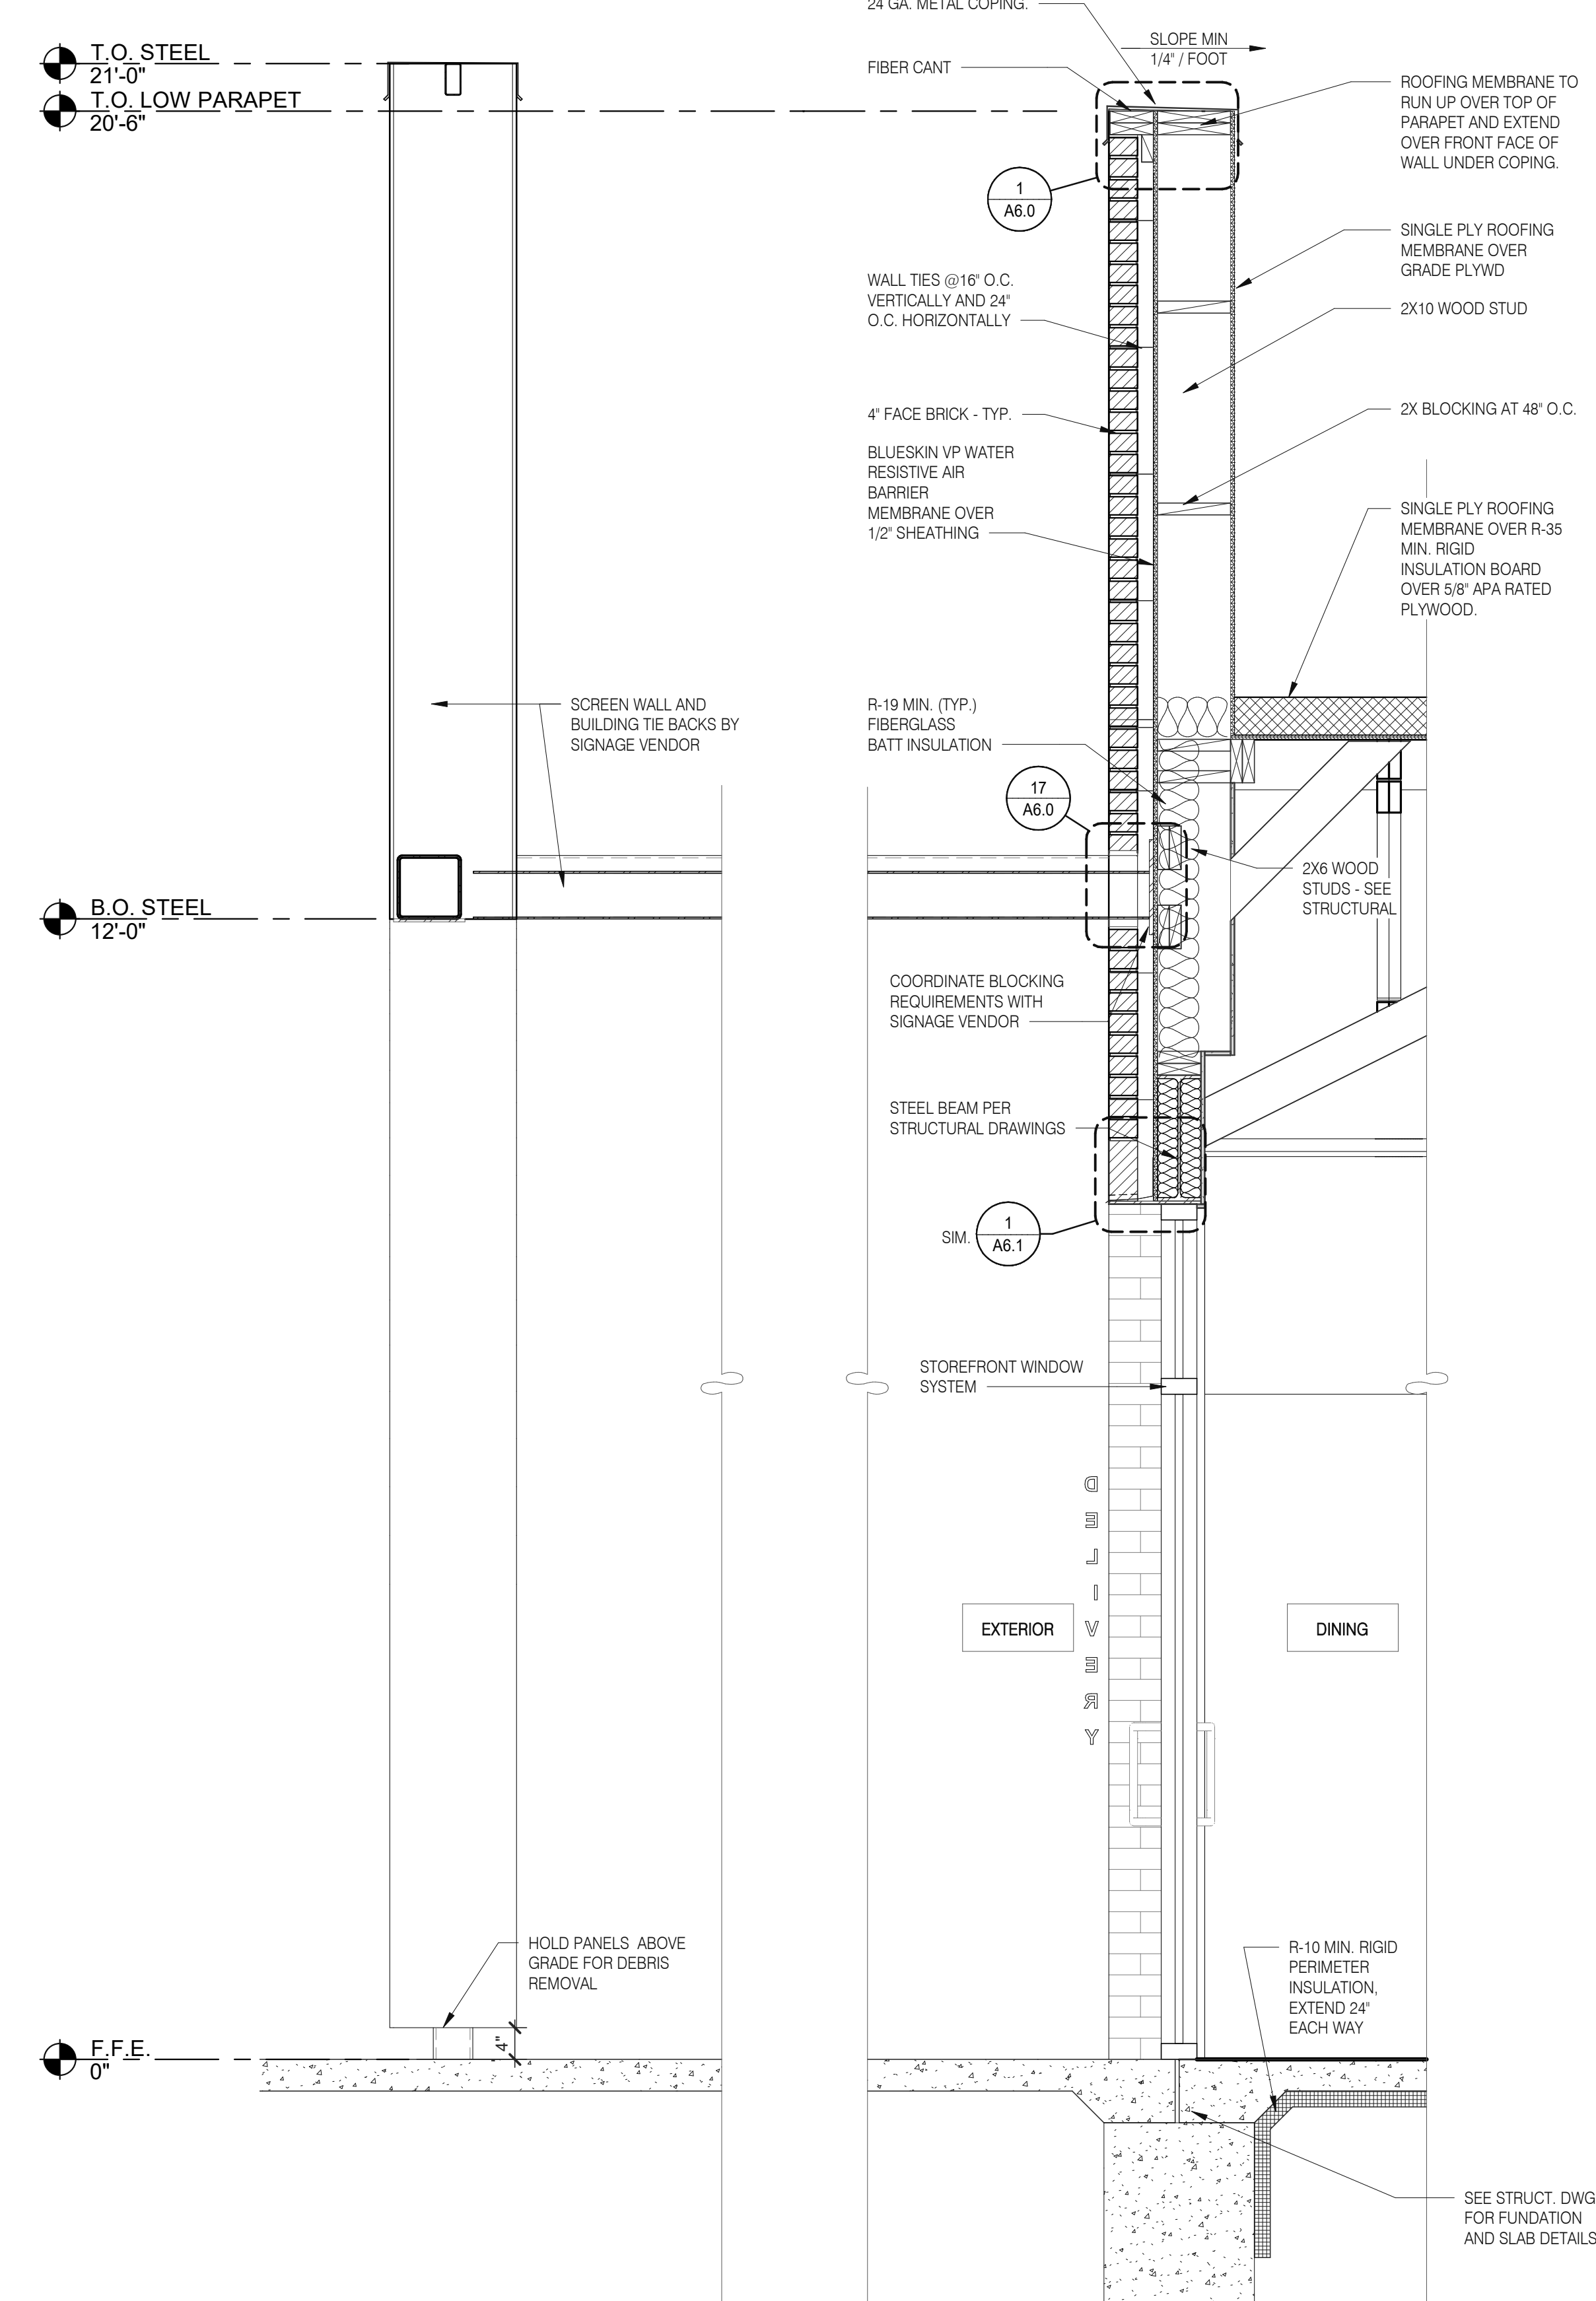

FRONT WALL SECTION 3/4" = 1'-0" A

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03


TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236




ENDEAVOR 2.0 WALL SECTIONS

A5.3

C:\Users\ramm\Documents\Taco_General\Bldg_Arch\2022_Ruays.rvt

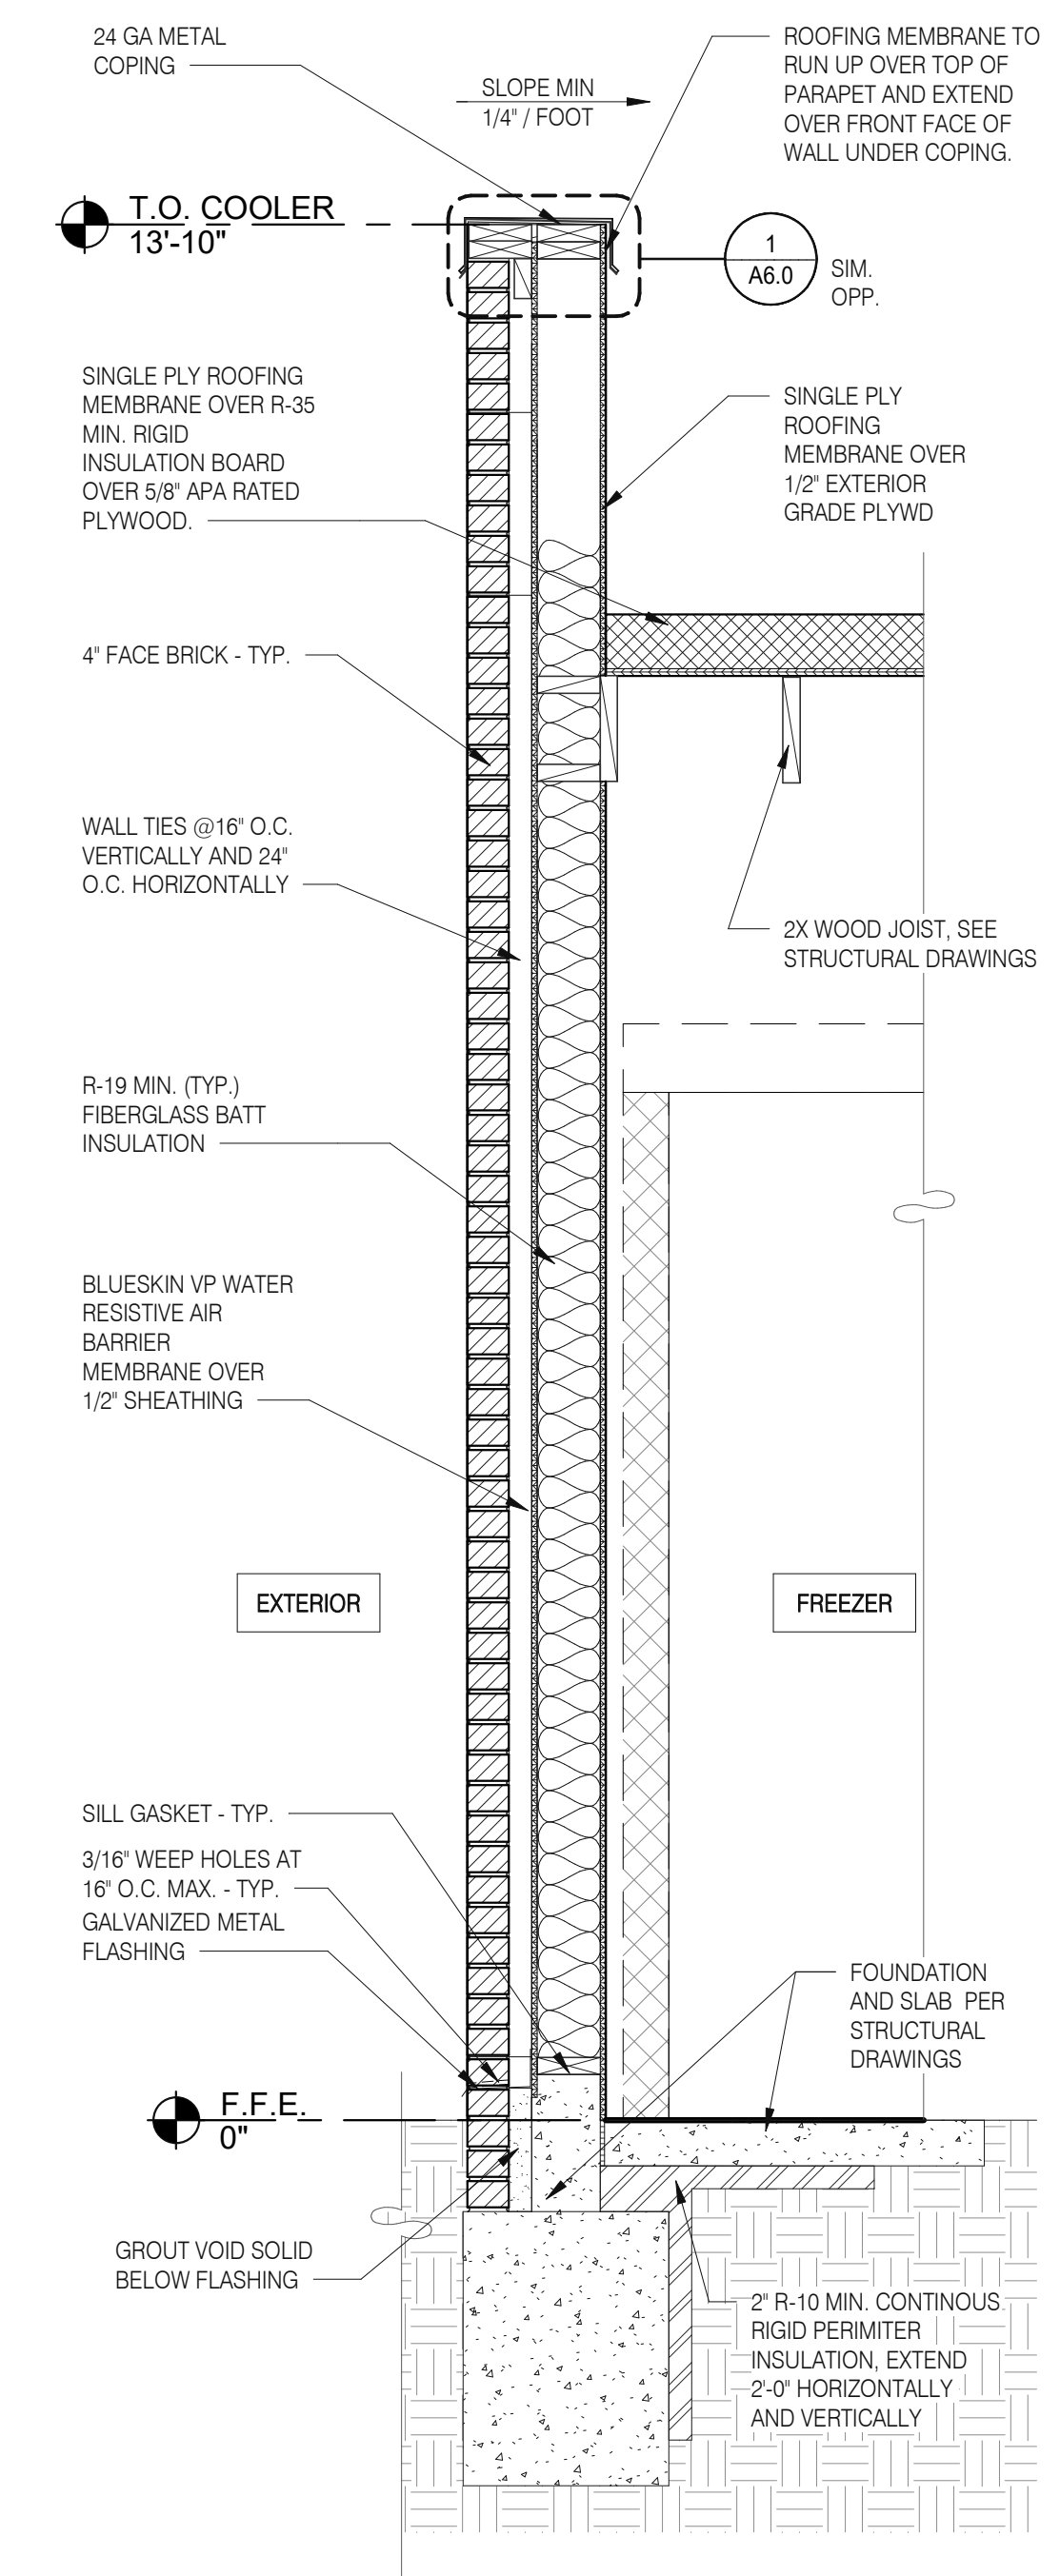

WALL SECTION 3/4" = 1'-0" B

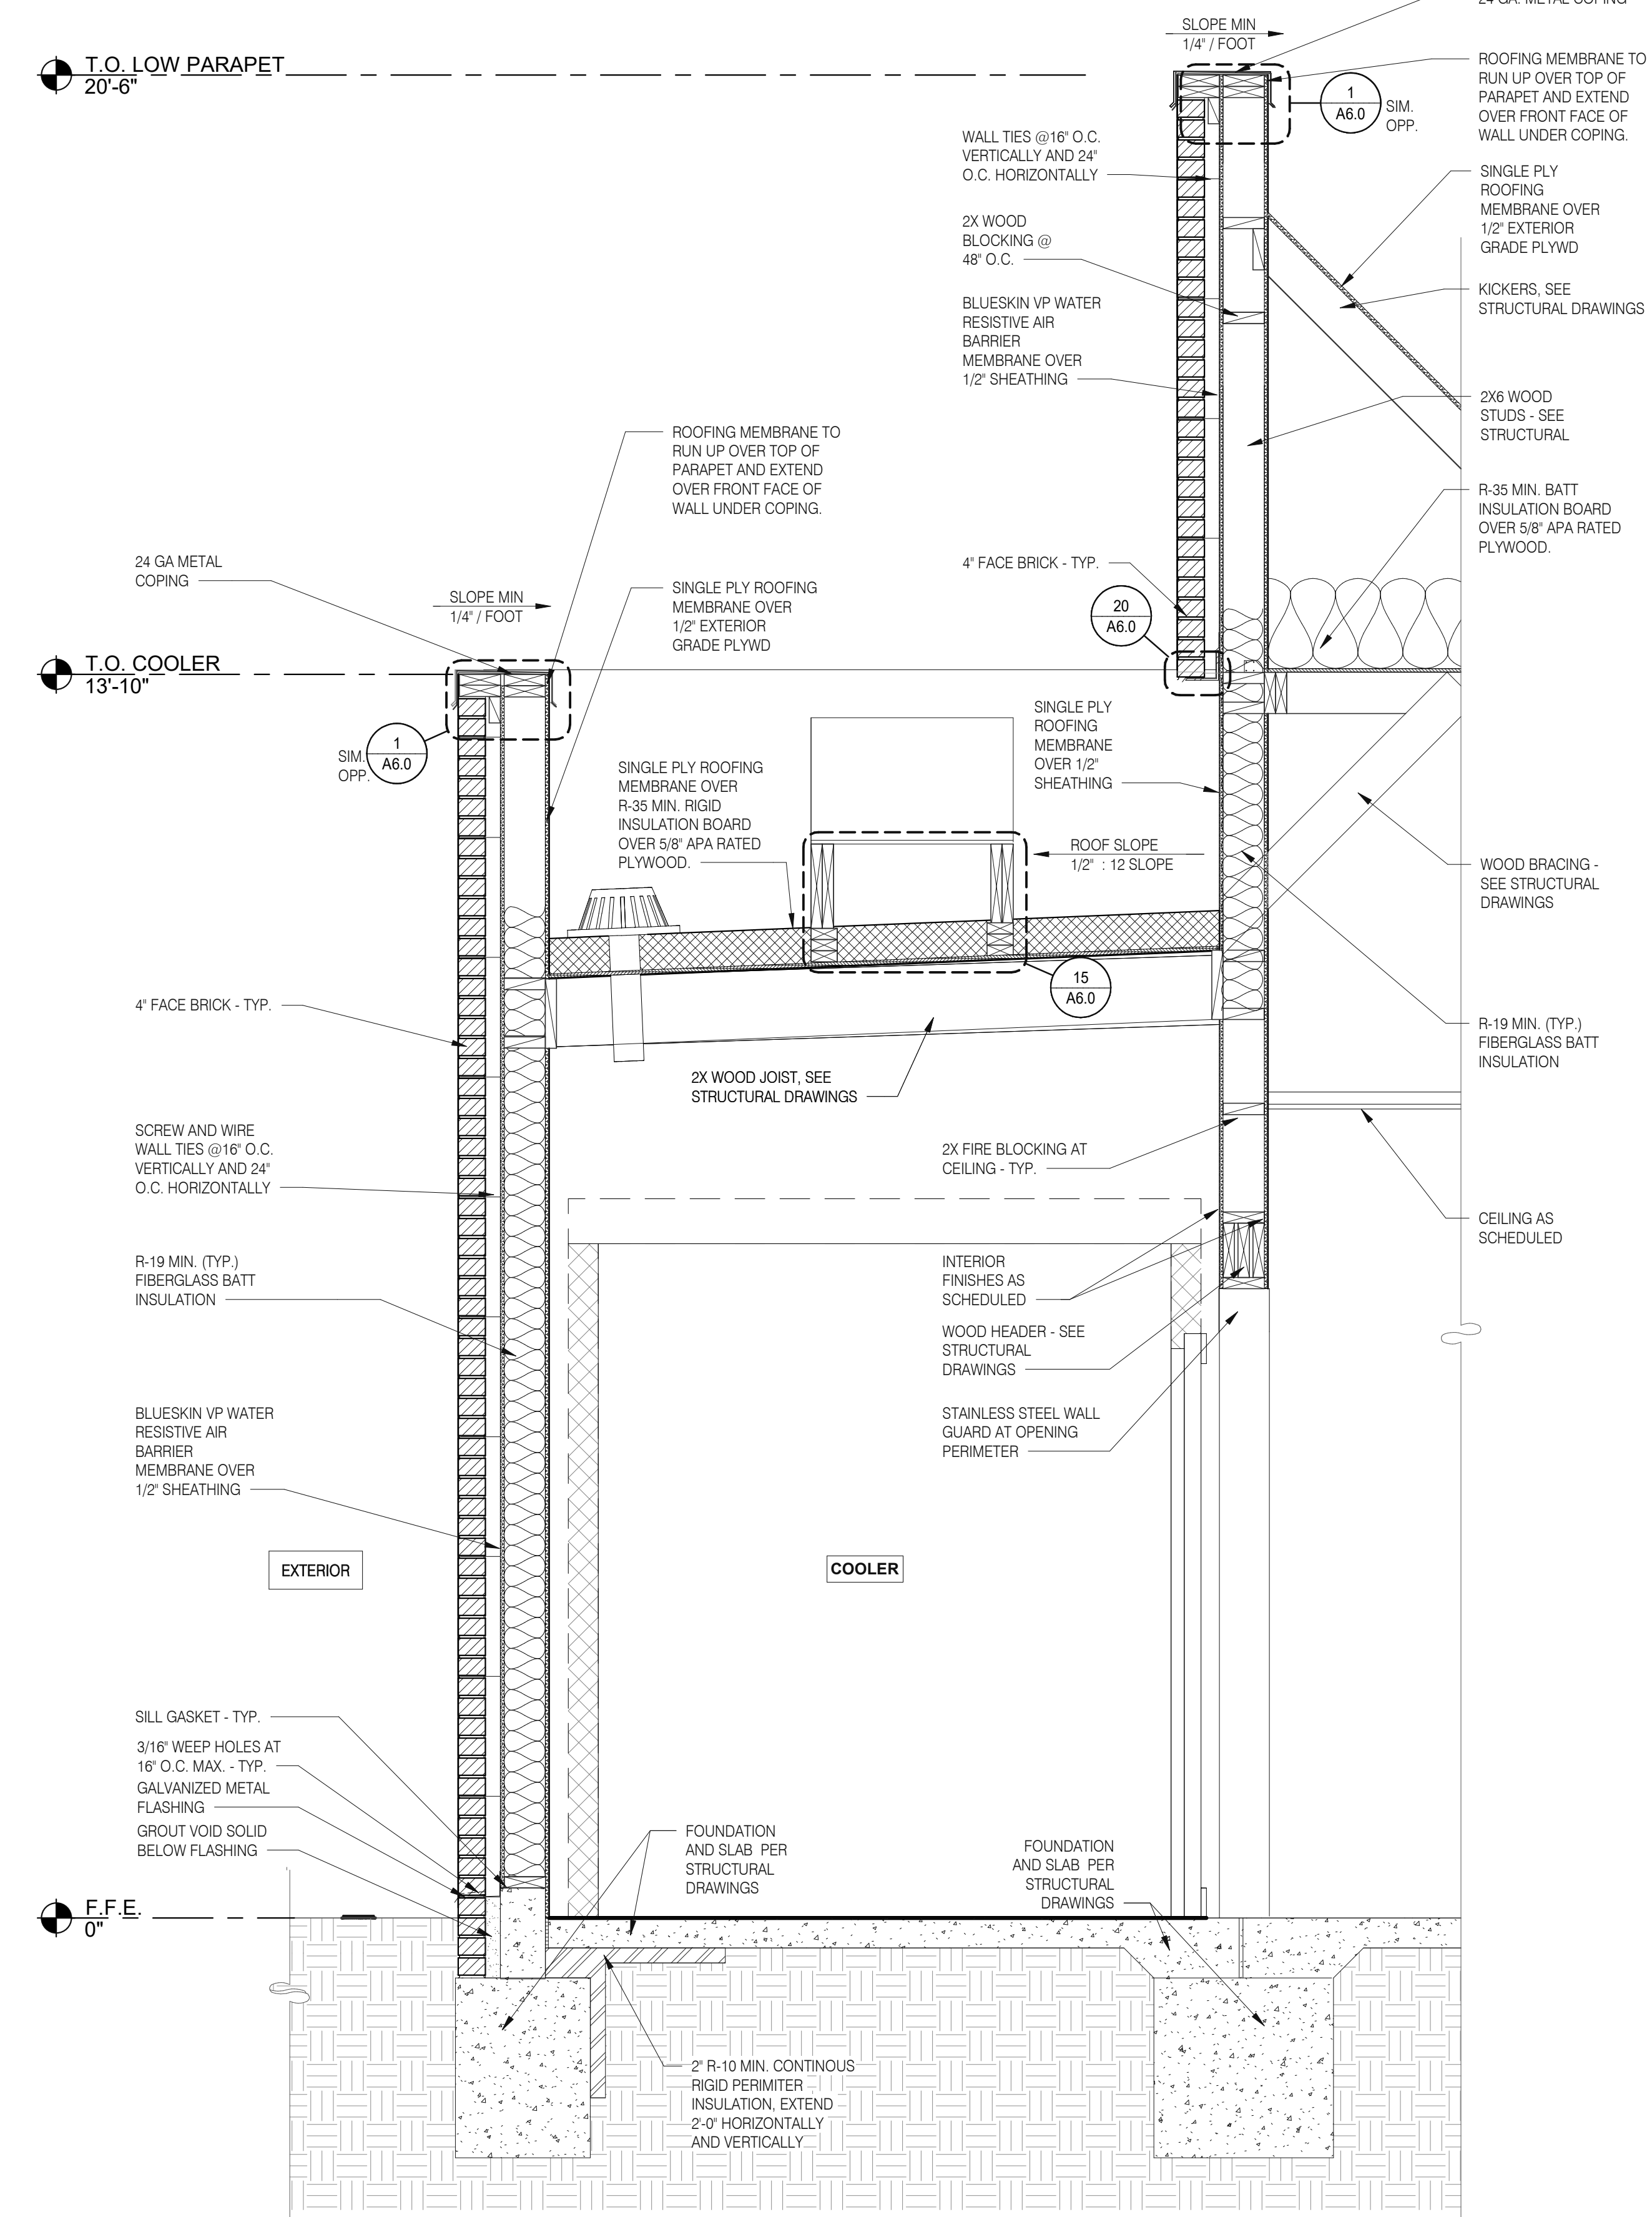

WALL SECTION AT COOLER 3/4" = 1'-0" A

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236




ENDEAVOR 2.0 WALL SECTIONS


A5.4

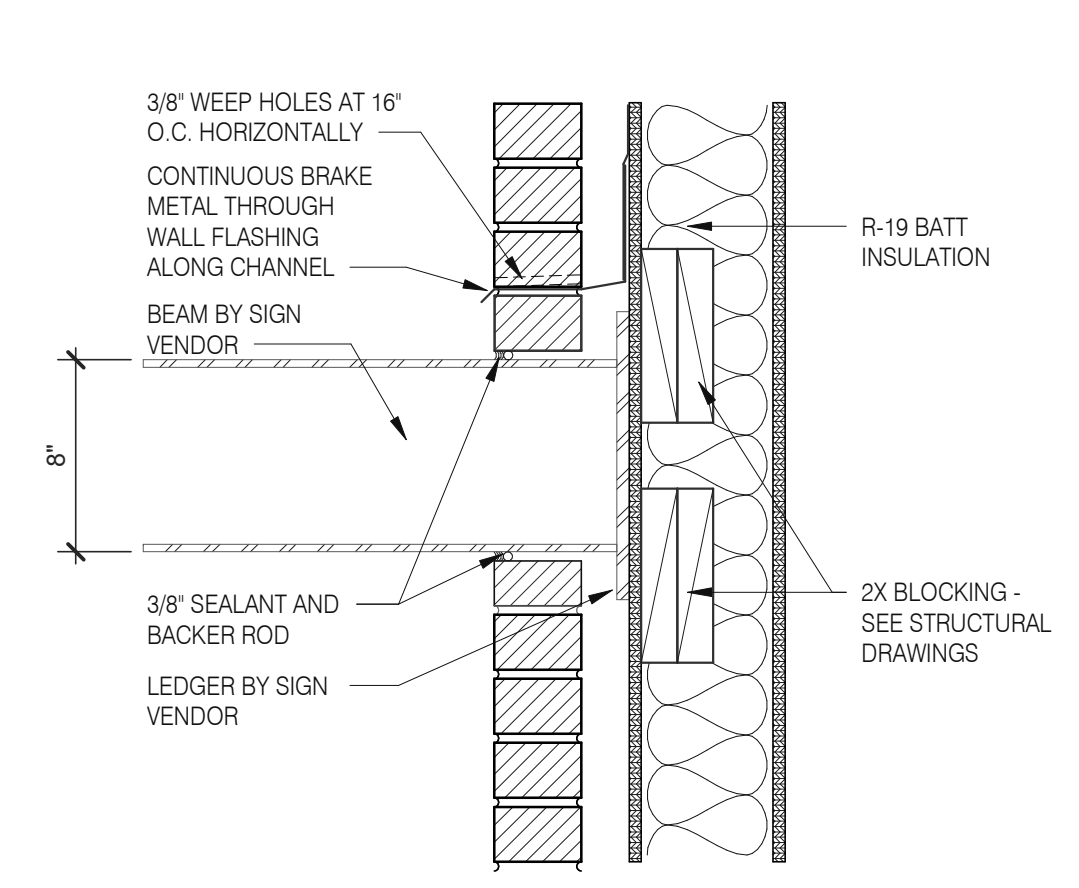


CONNECTION DETAIL 1 1/2" = 1'-0" **17**

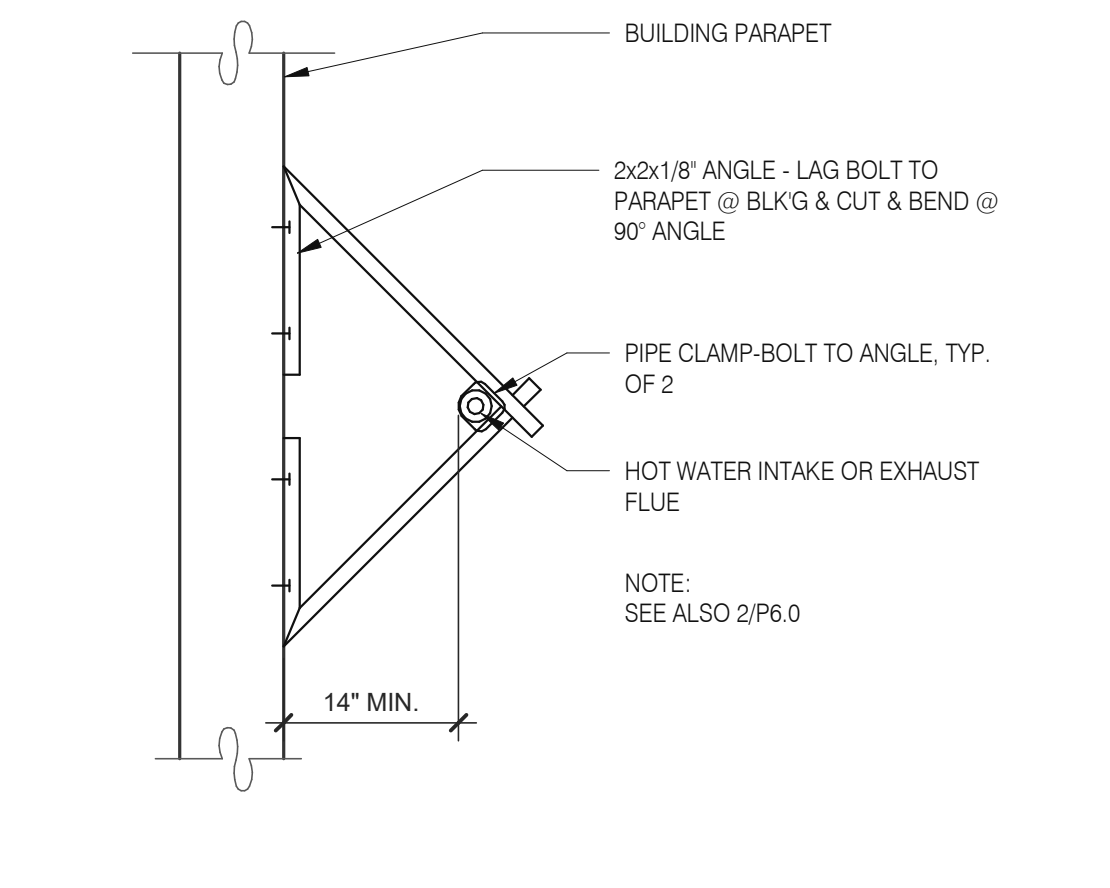


W.H. FLU / INTAKEN PIPE SUPPORT 3" = 1'-0" **13**

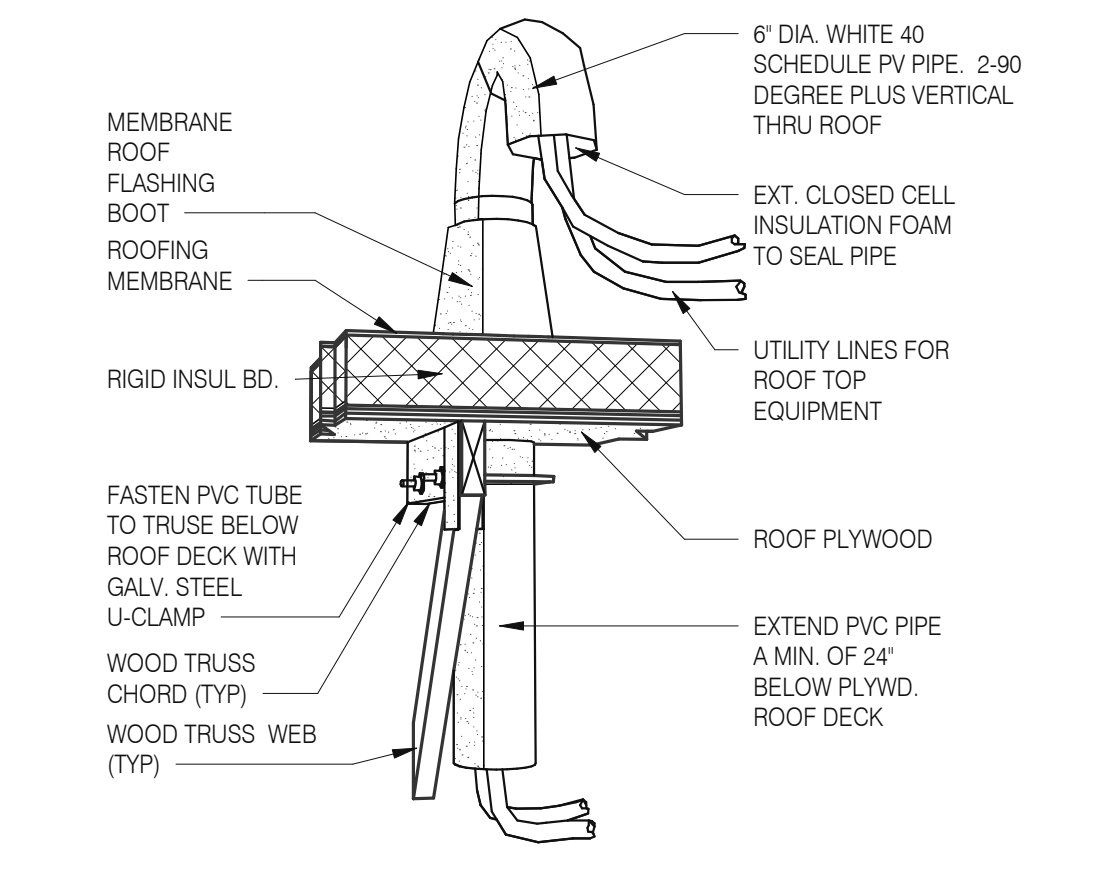


PIPE HOOD N.T.S. **9**

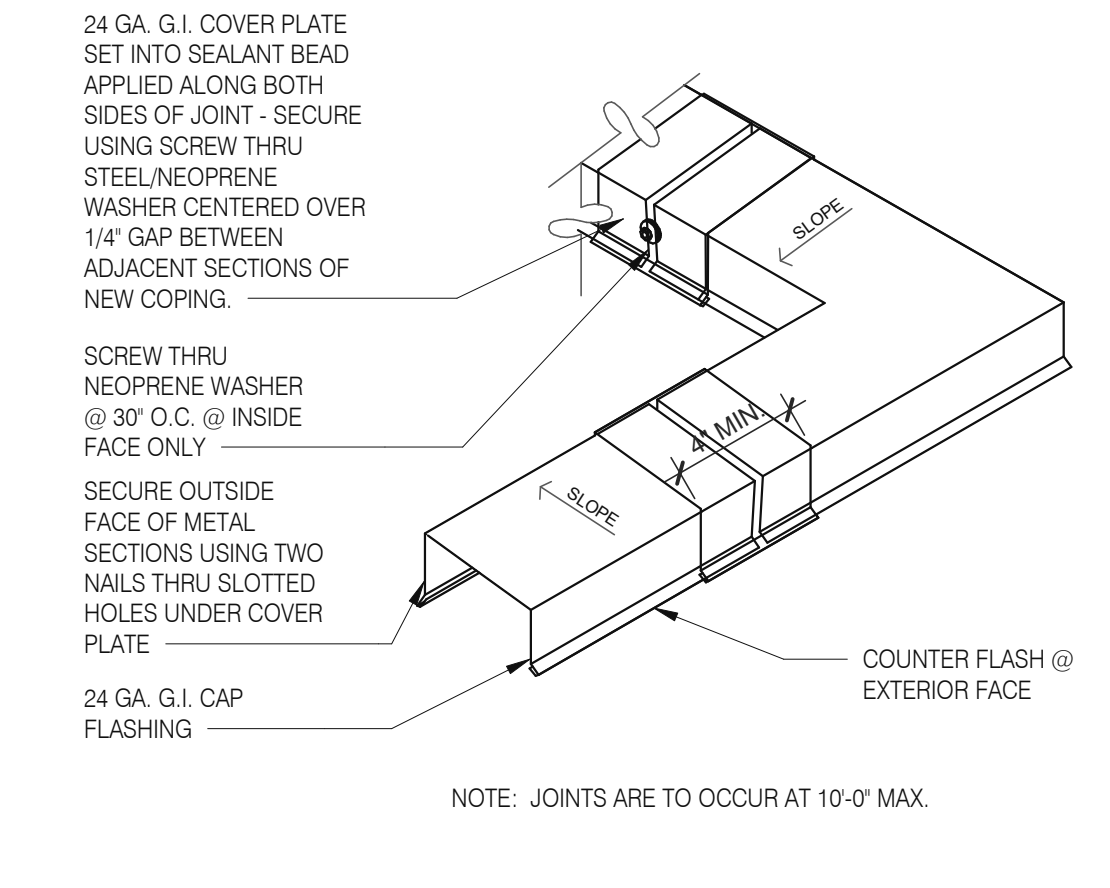



COPING JOINT N.T.S. **5**

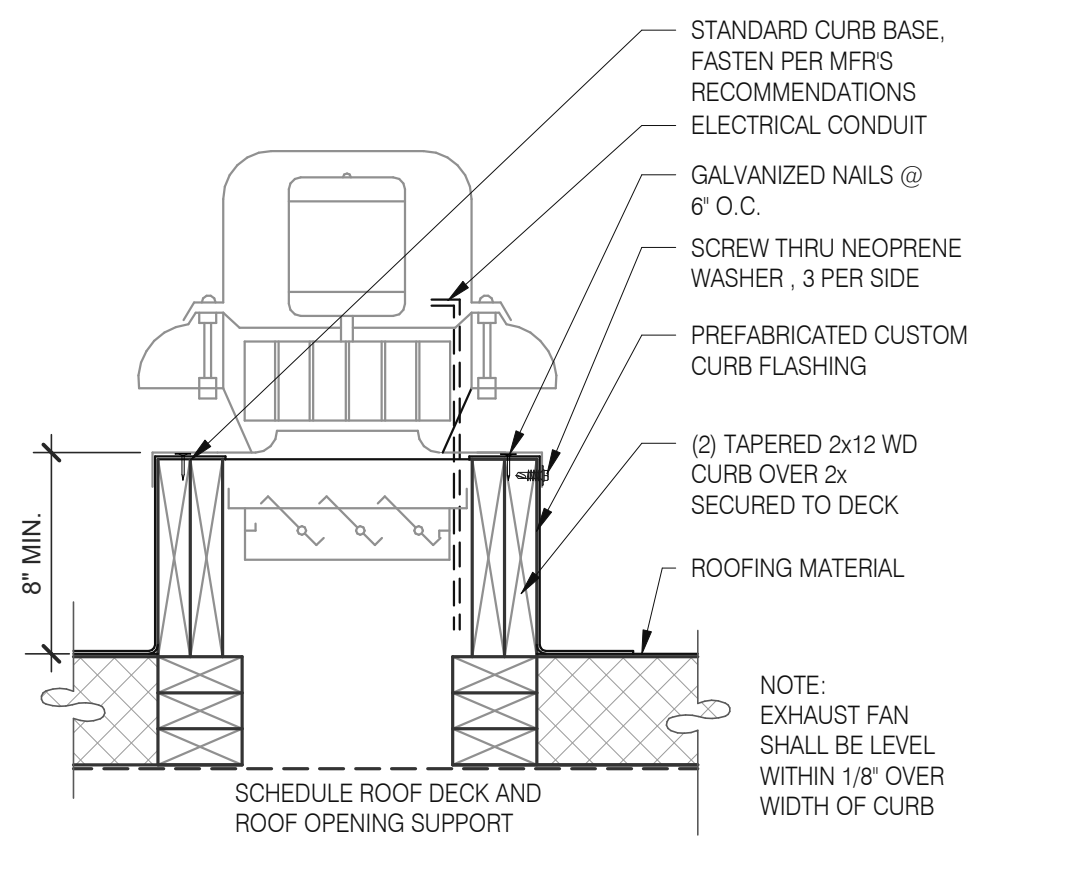


EXHAUST FAN CURB 3" = 1'-0" **18**

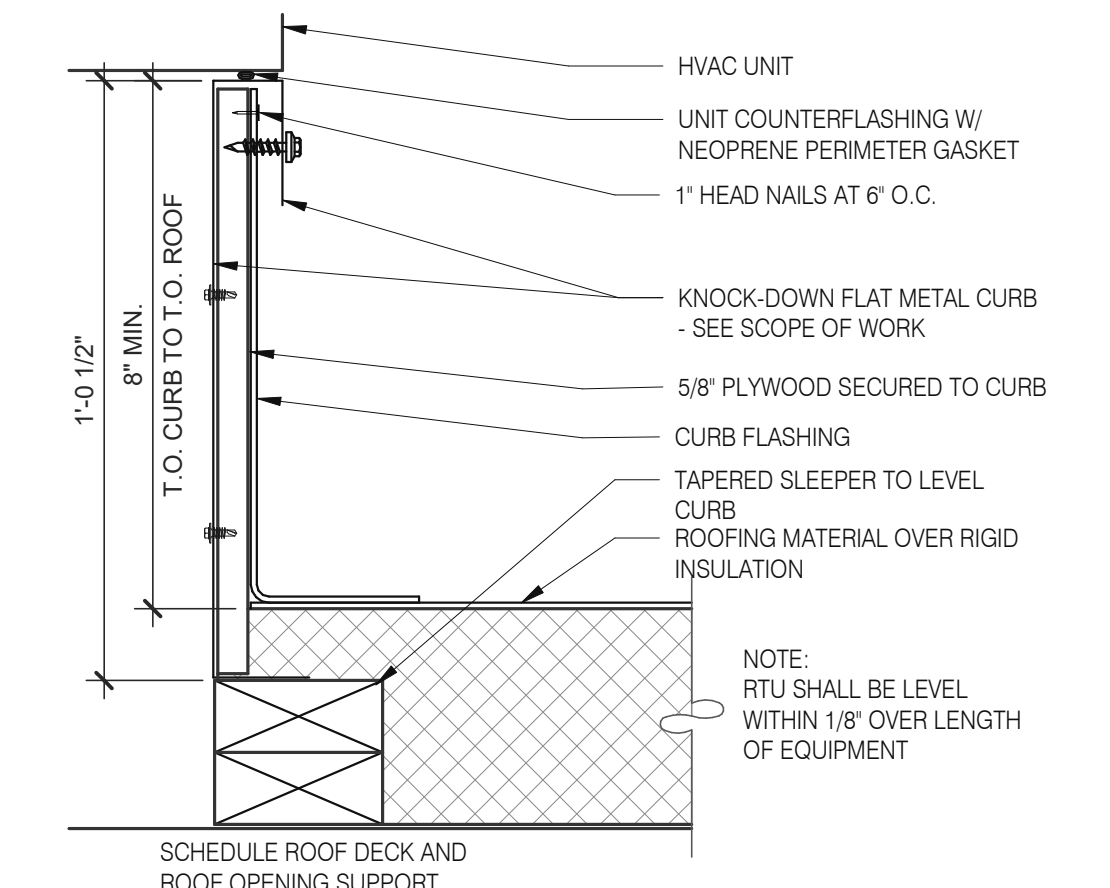


HVAC CURB 3" = 1'-0" **14**

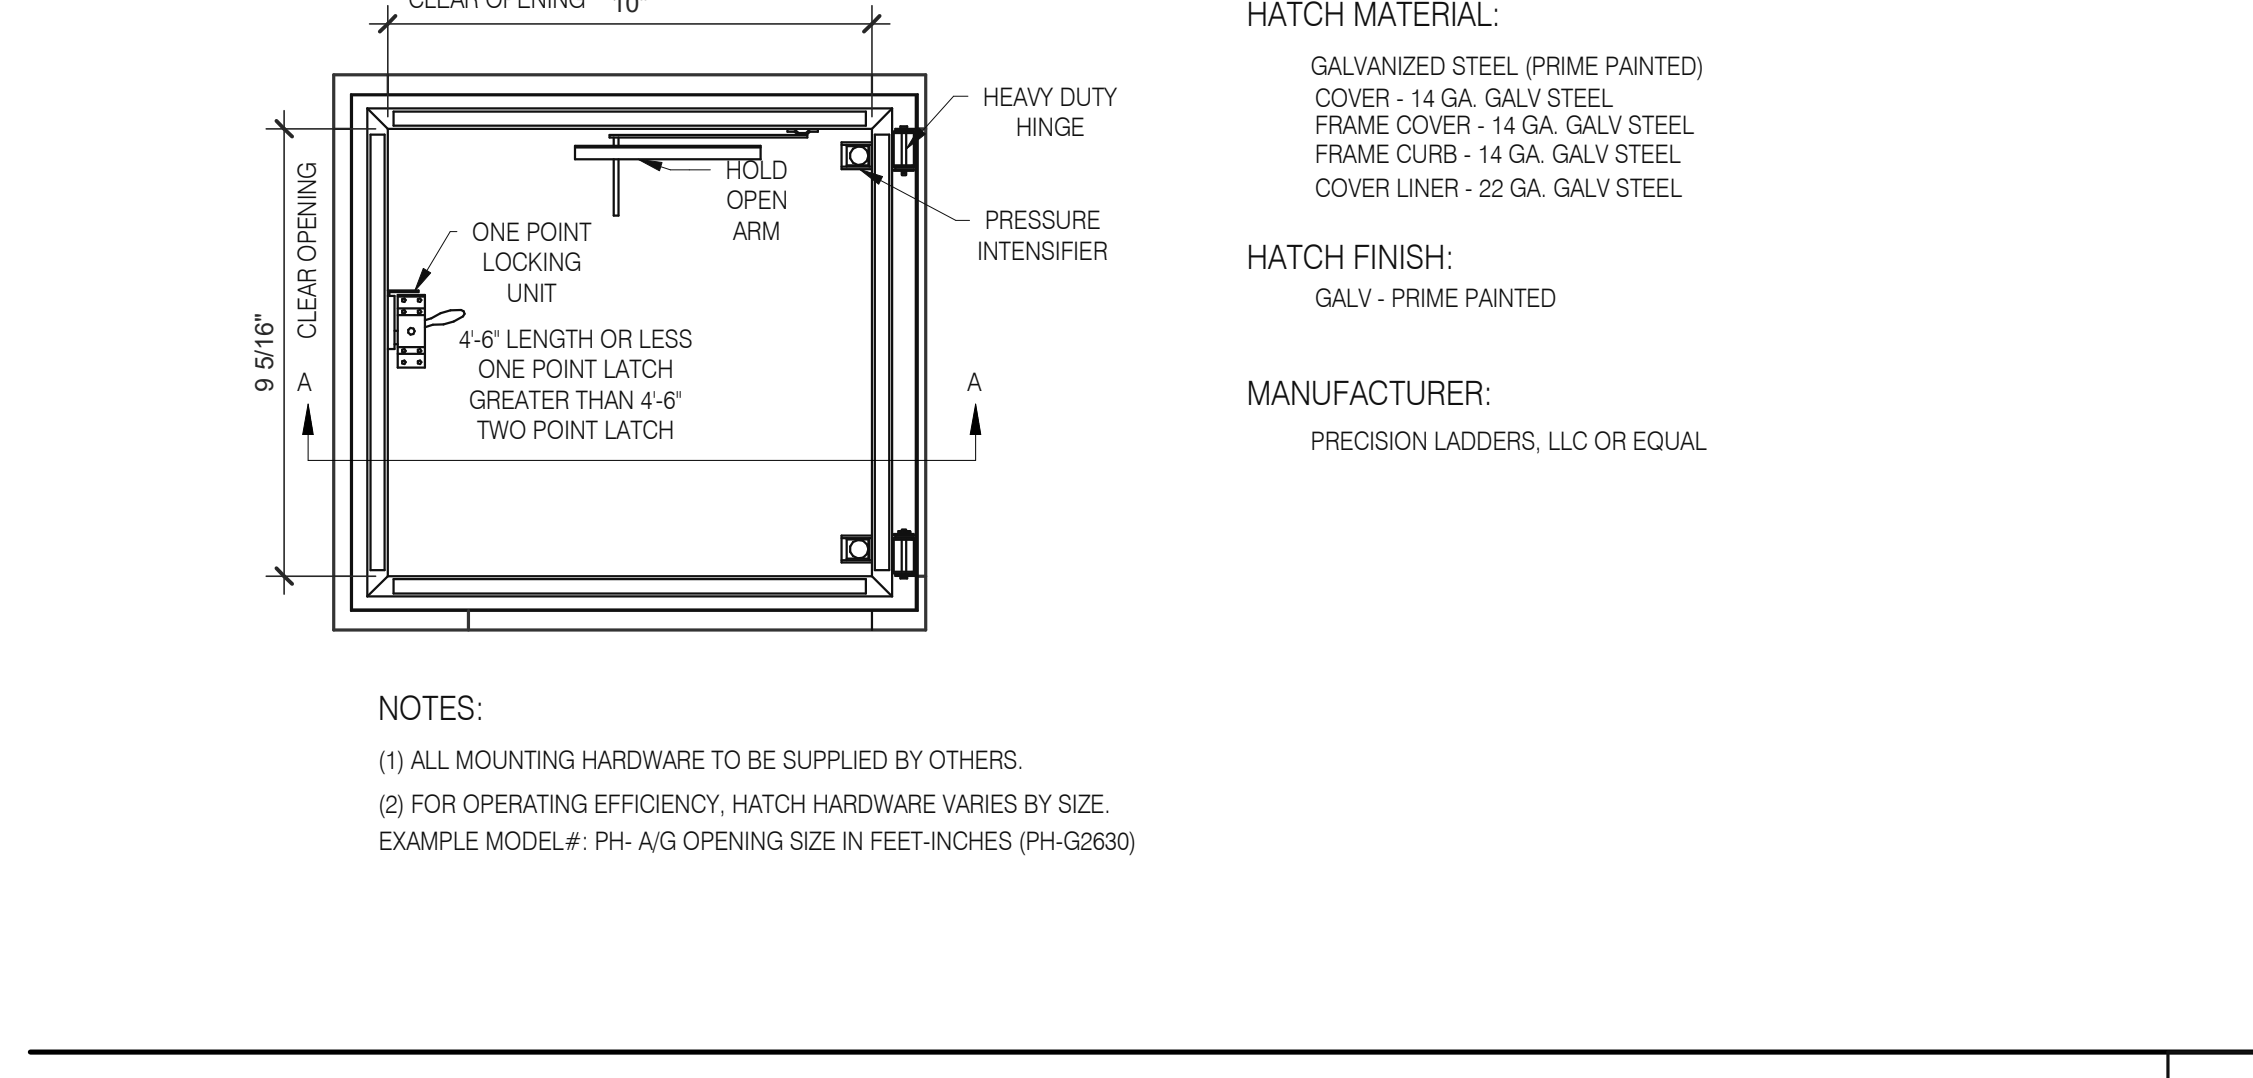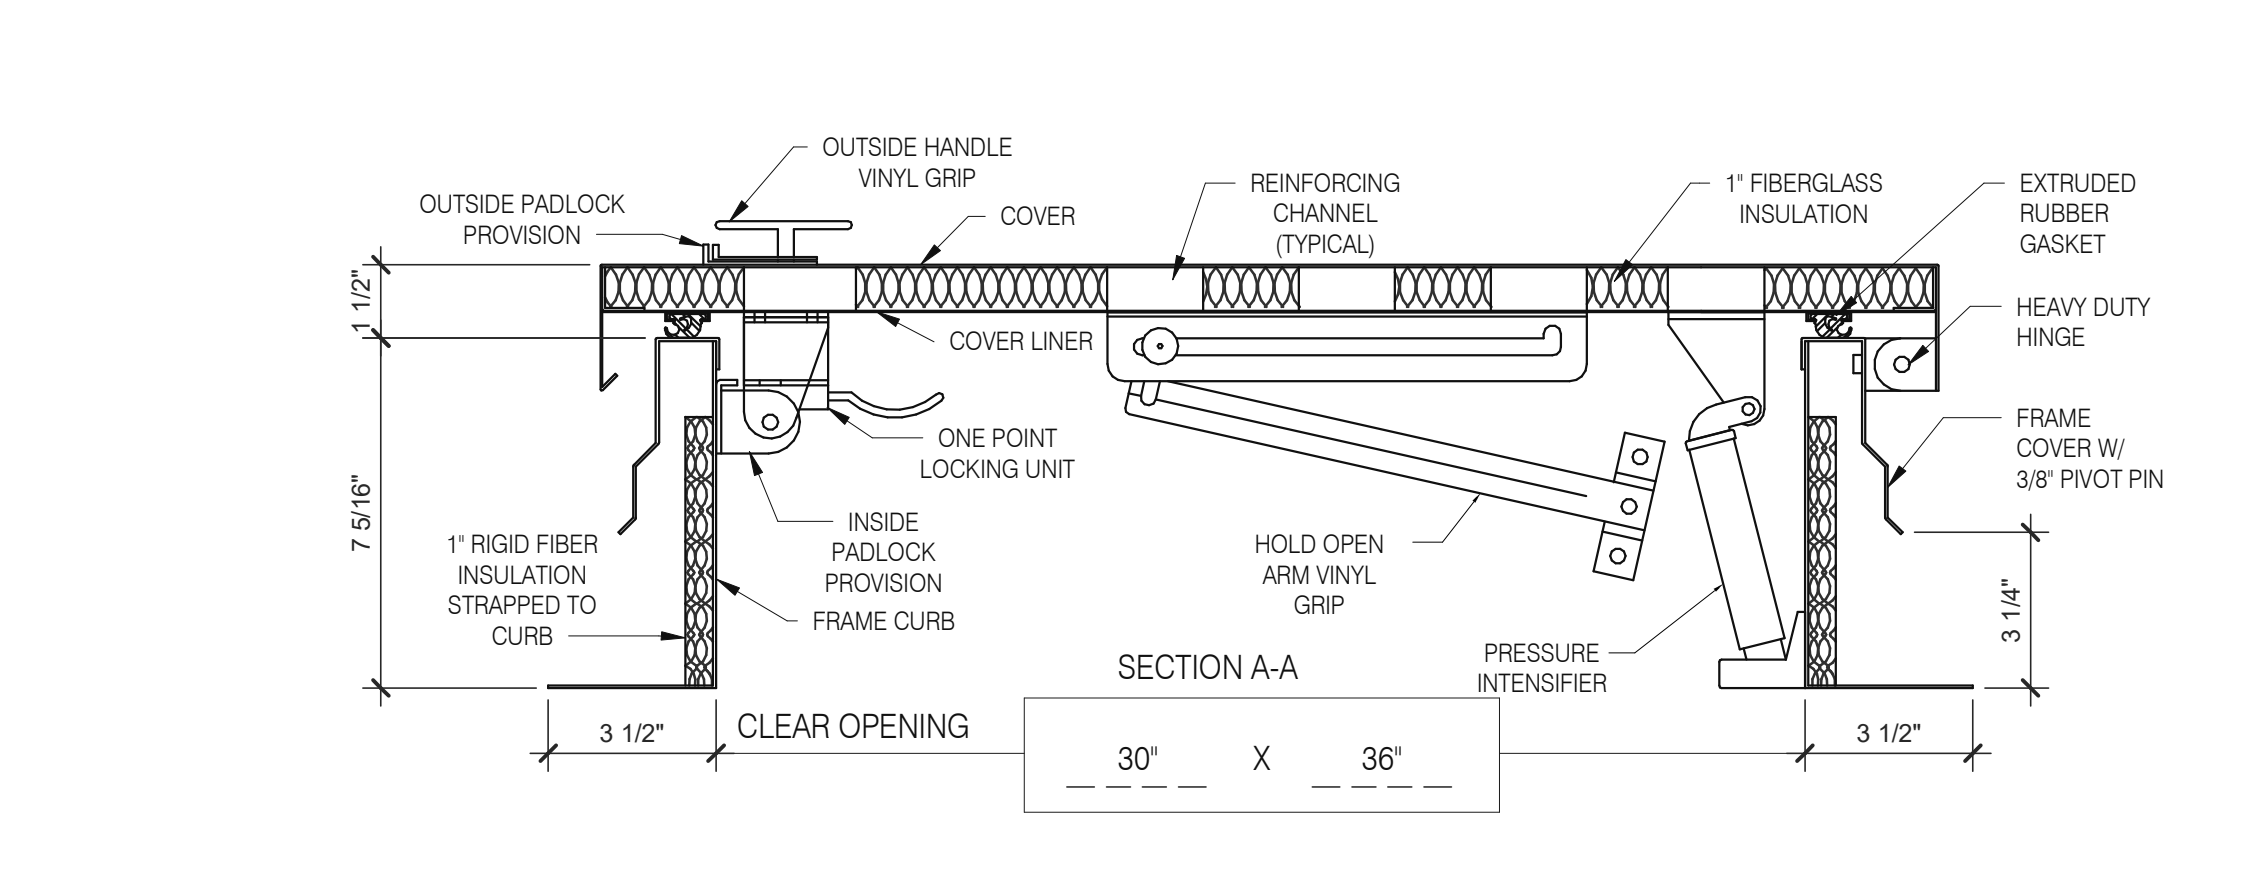


ROOF LADDER AND HATCH 3" = 1'-0" **7**

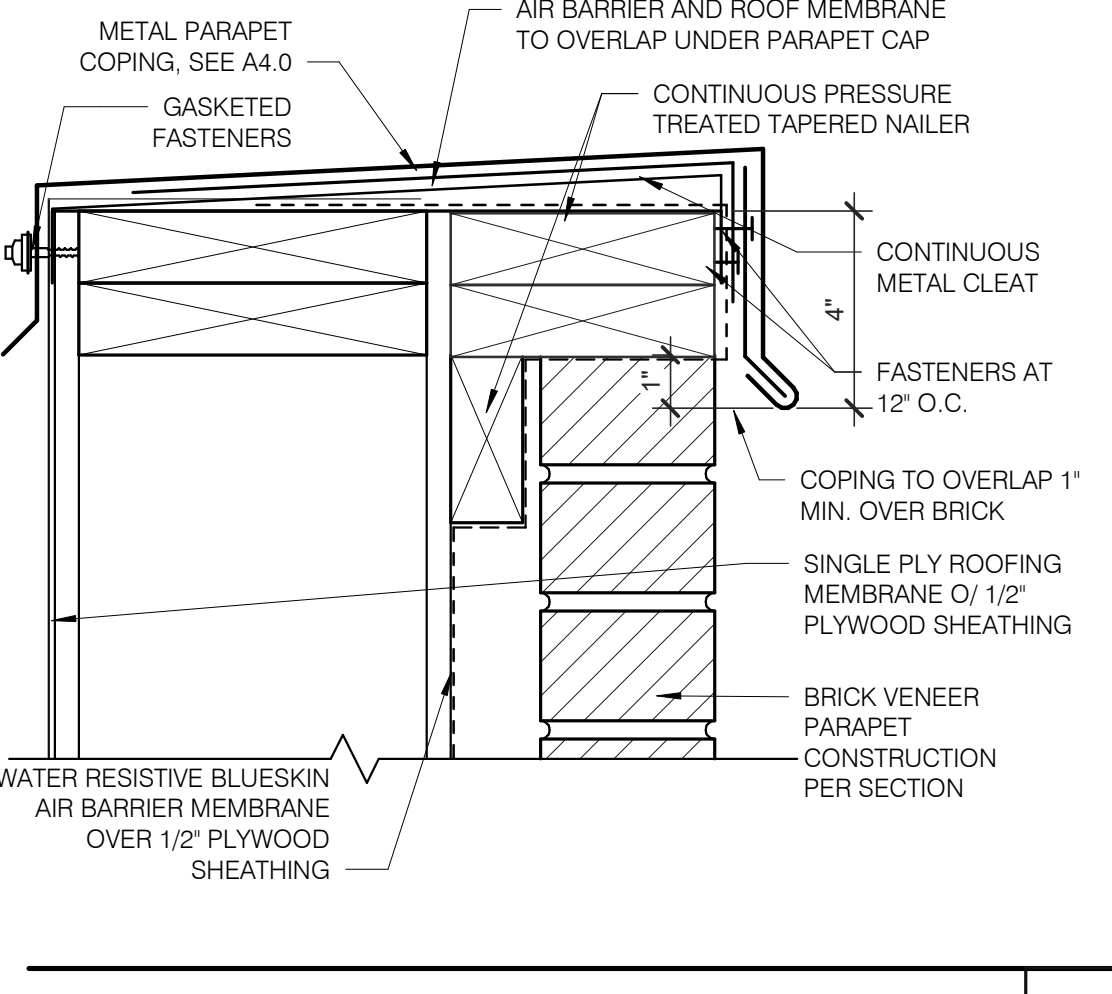


PARAPET WALL CAP 3" = 1'-0" **1**

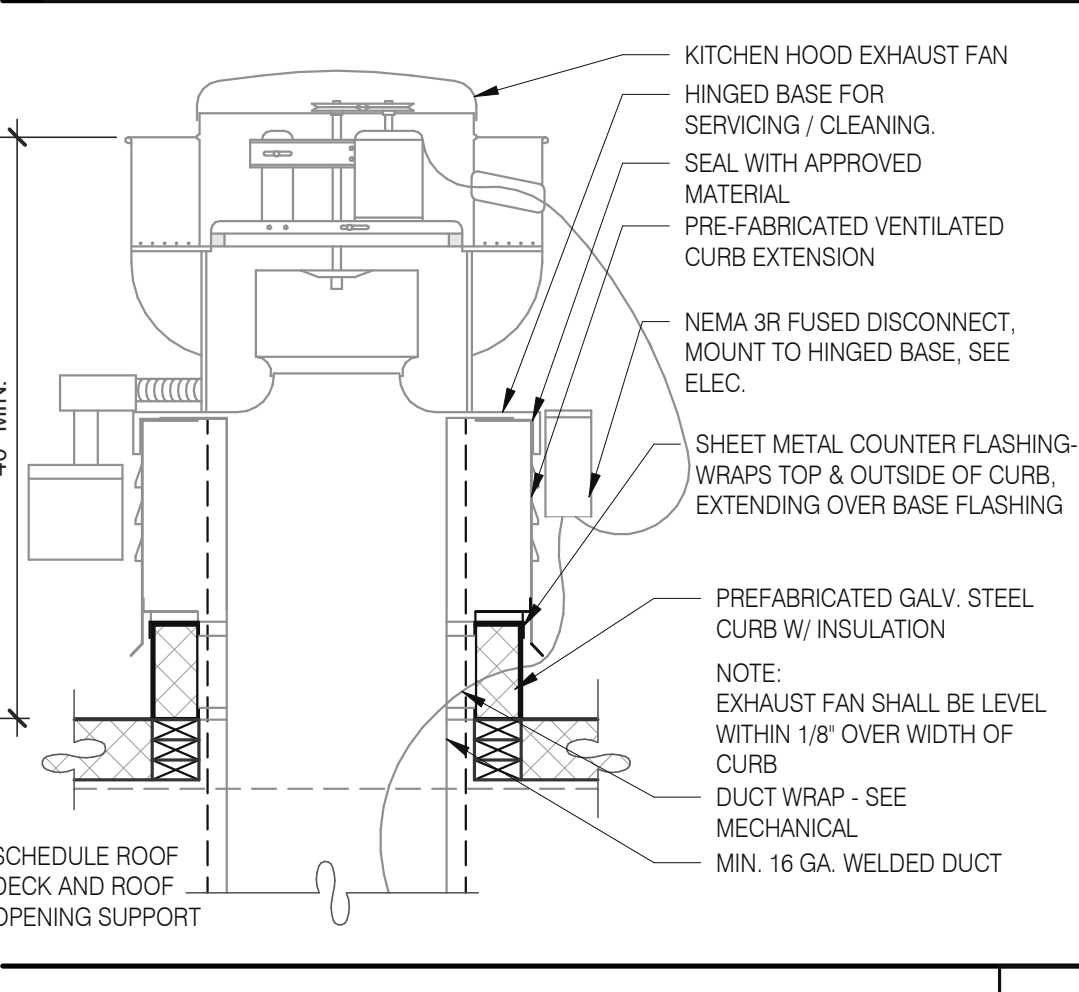


EXHAUST FAN CURB 3" = 1'-0" **19**

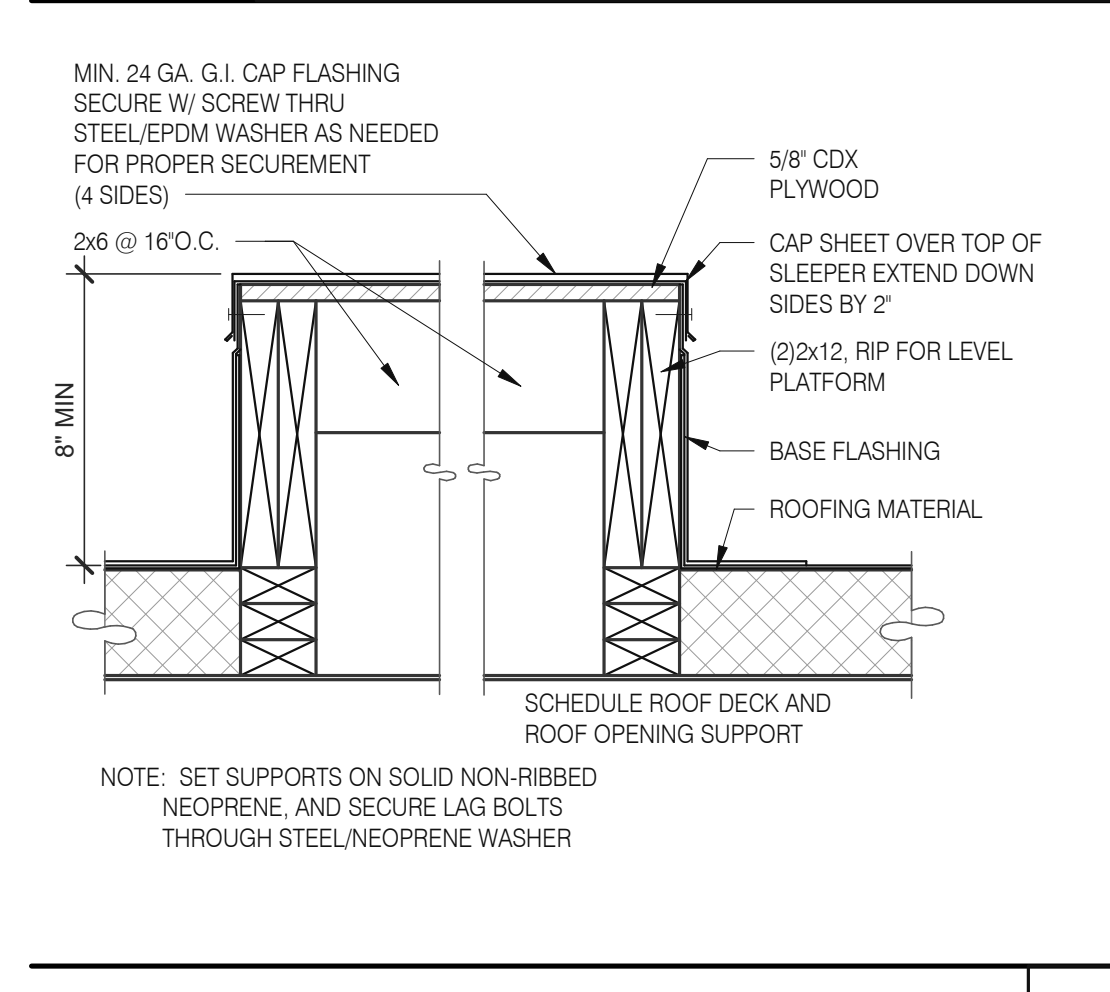


EQUIPMENT PLATFORM SUPPORT 3" = 1'-0" **15**

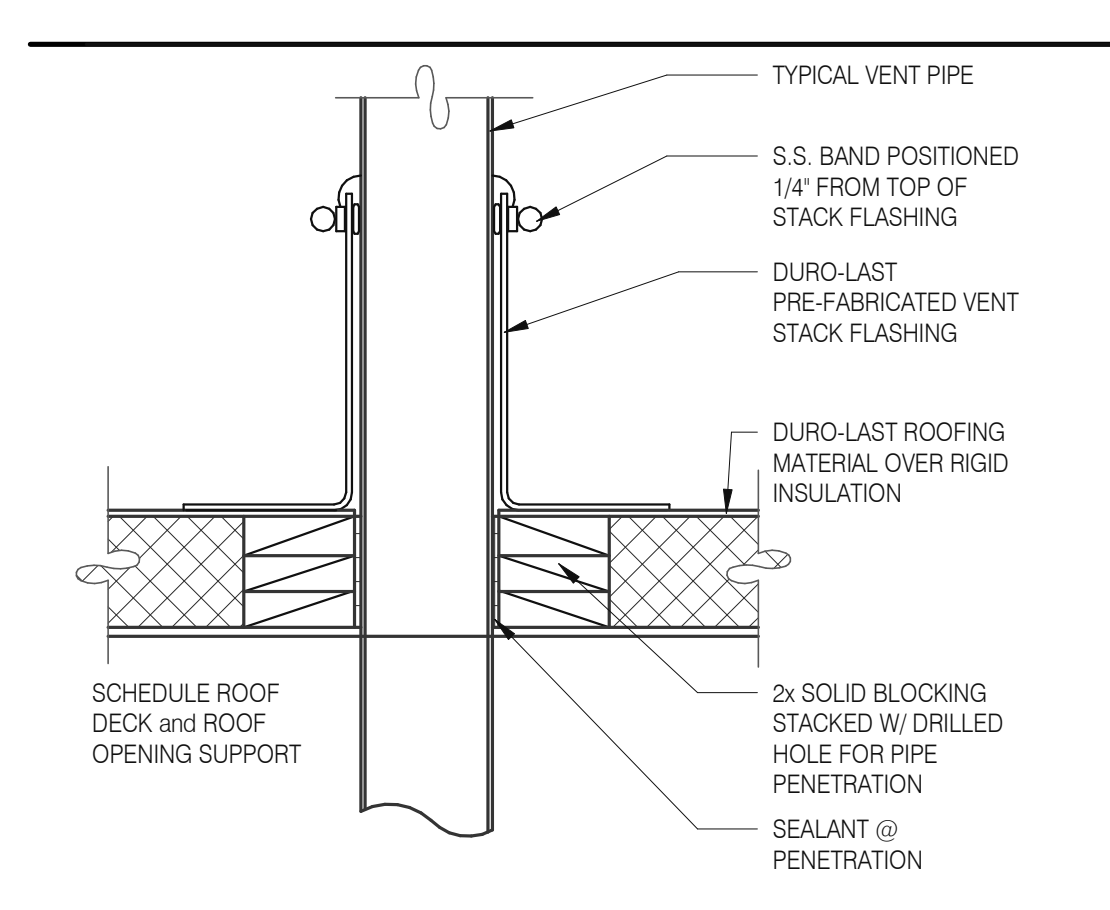



SEALED PIPE FLASHING 3" = 1'-0" **12**

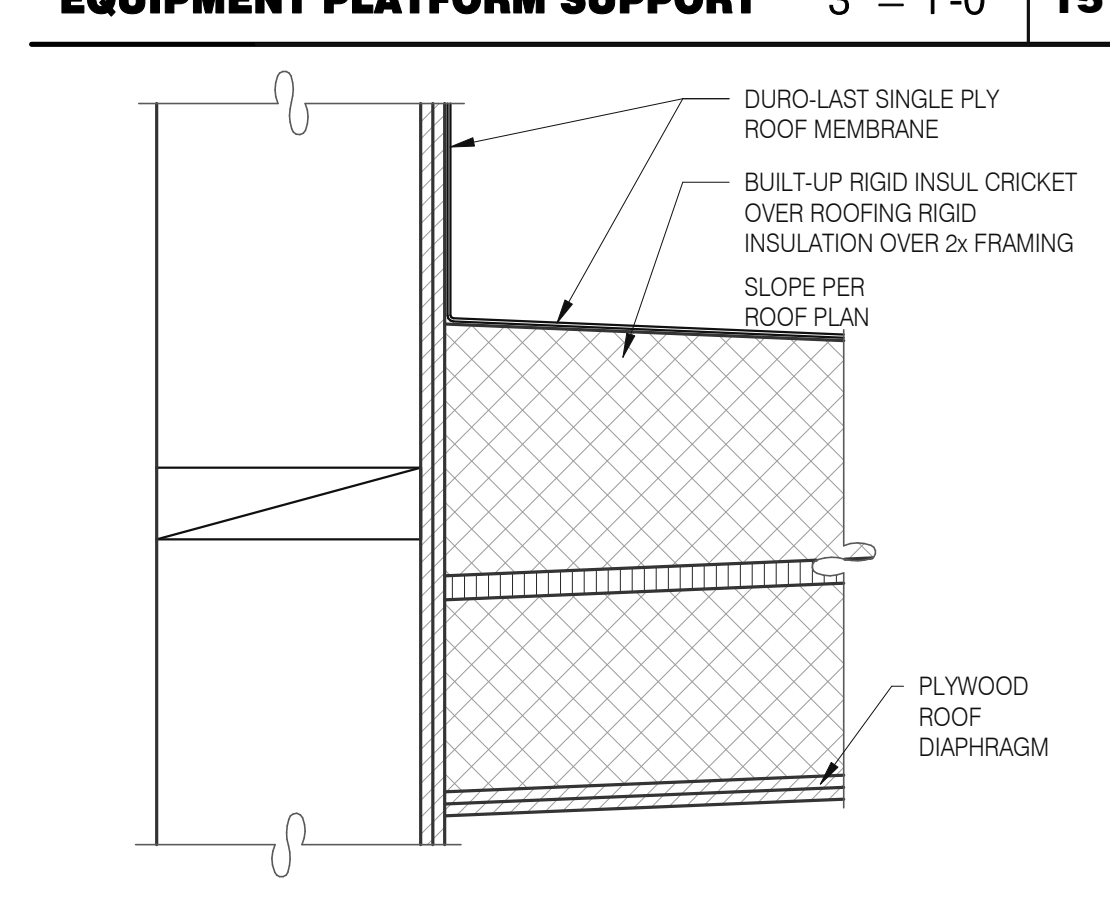

CRICKET 3" = 1'-0" **16**

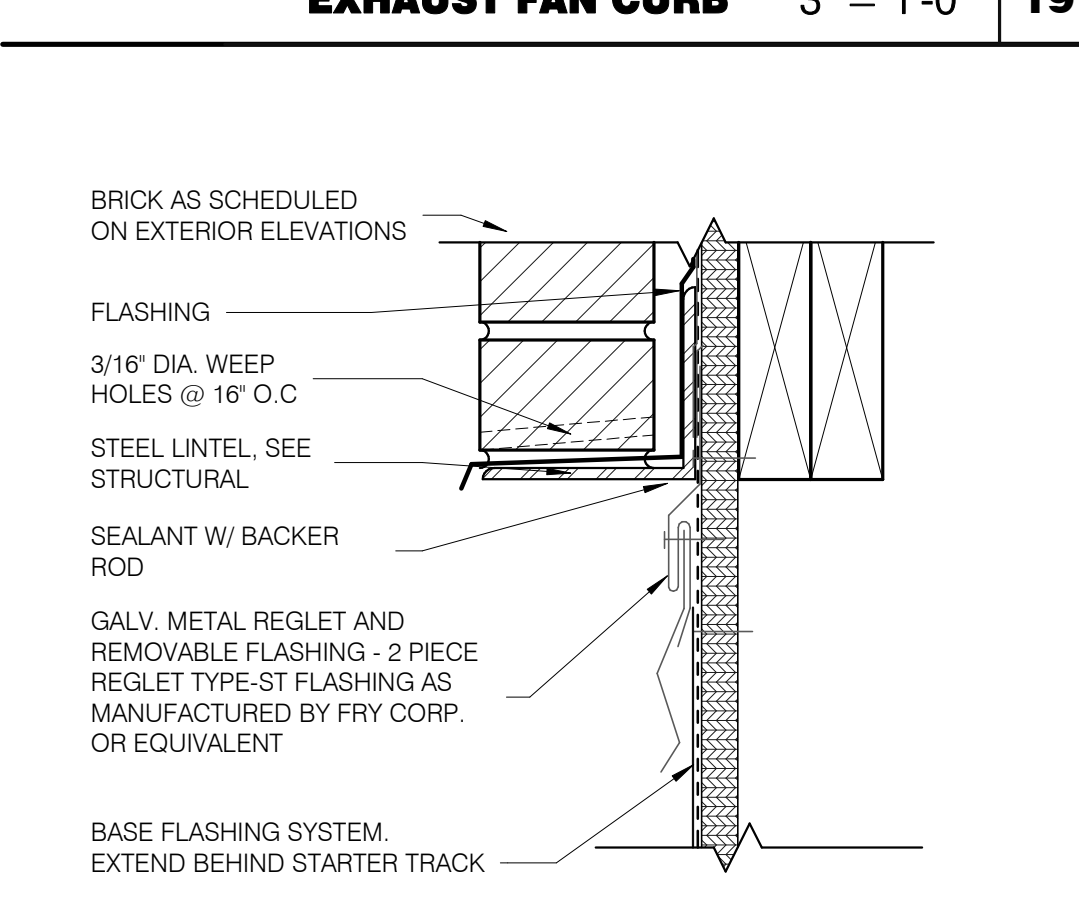

WALL FINISH TO BASE FLASHING 3" = 1'-0" **20**

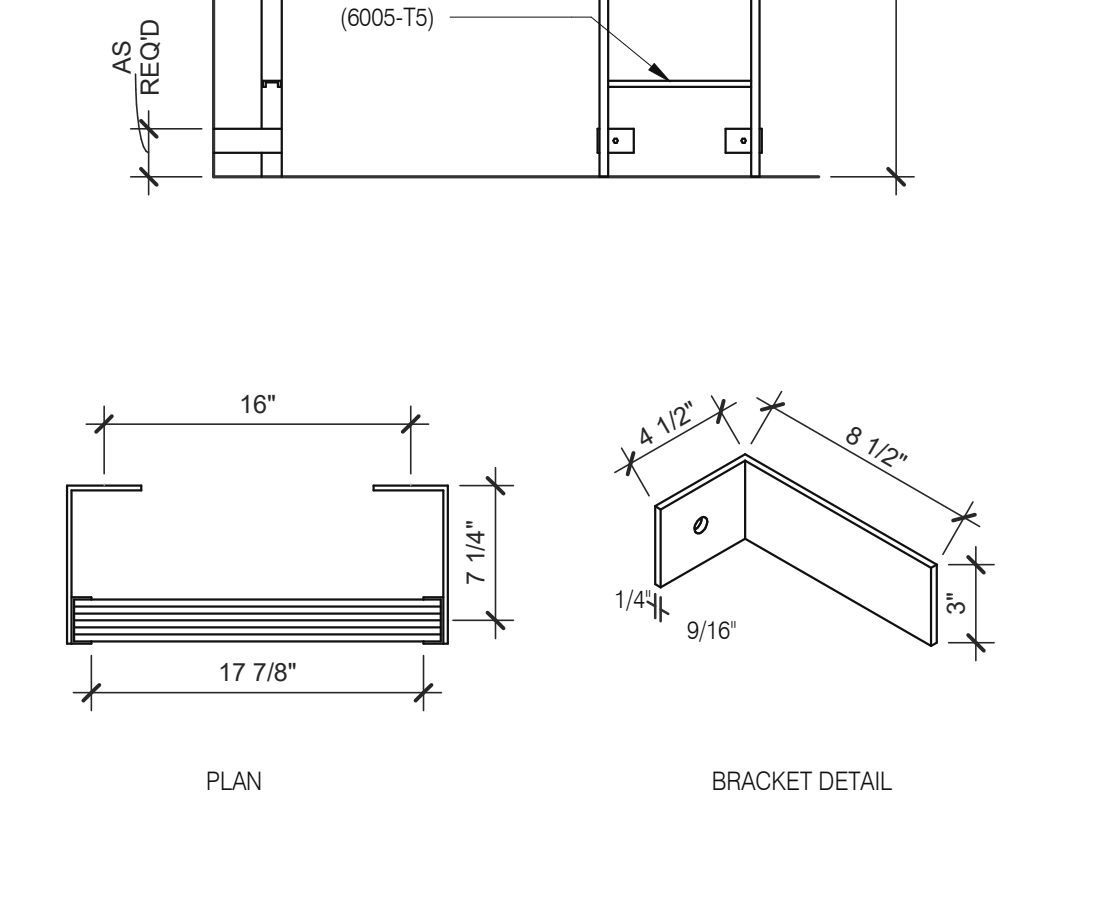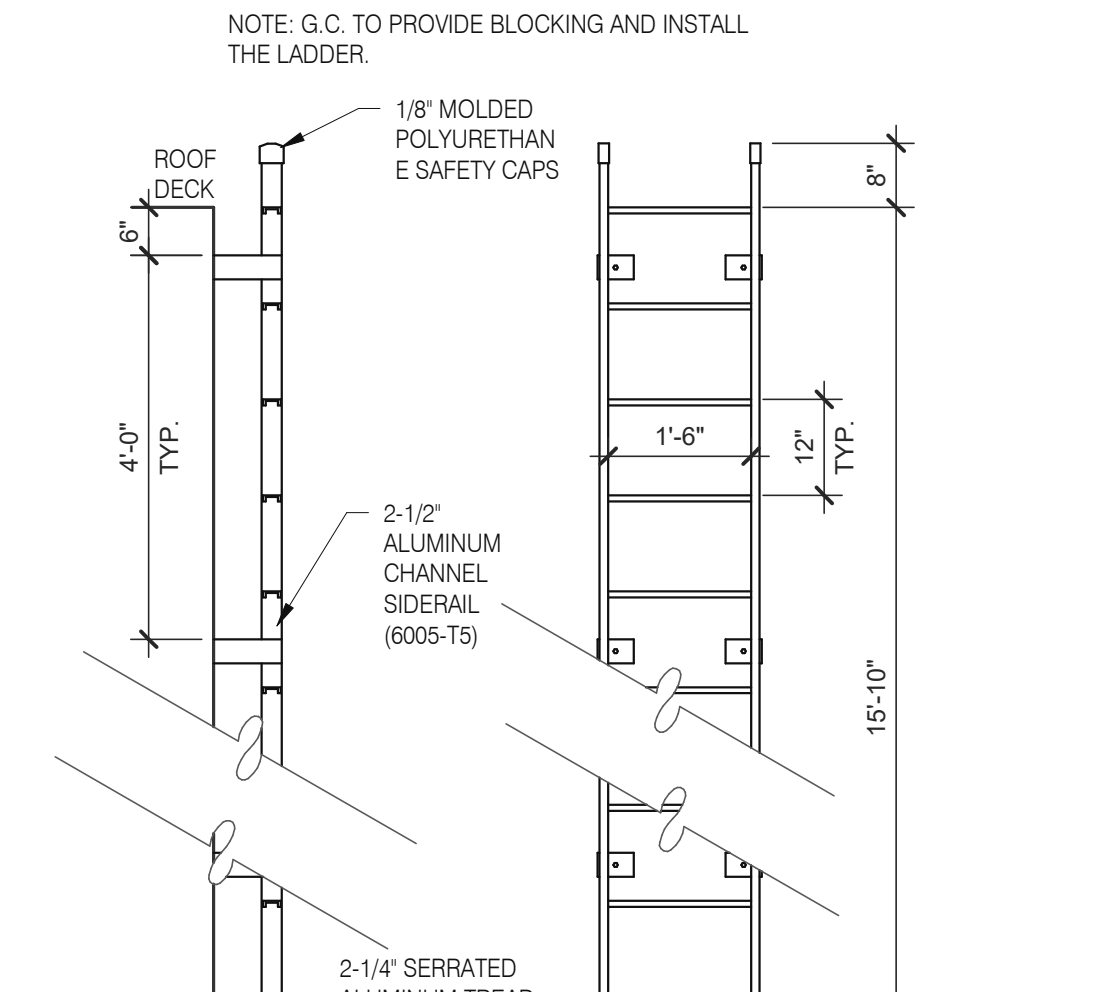

ROOF LADDER N.T.S. **4**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



ENDEAVOR 2.0 CONSTRUCTION DETAILS ROOF

A6.0

PLOT DATE: 11/3/2022 11:20:08 AM

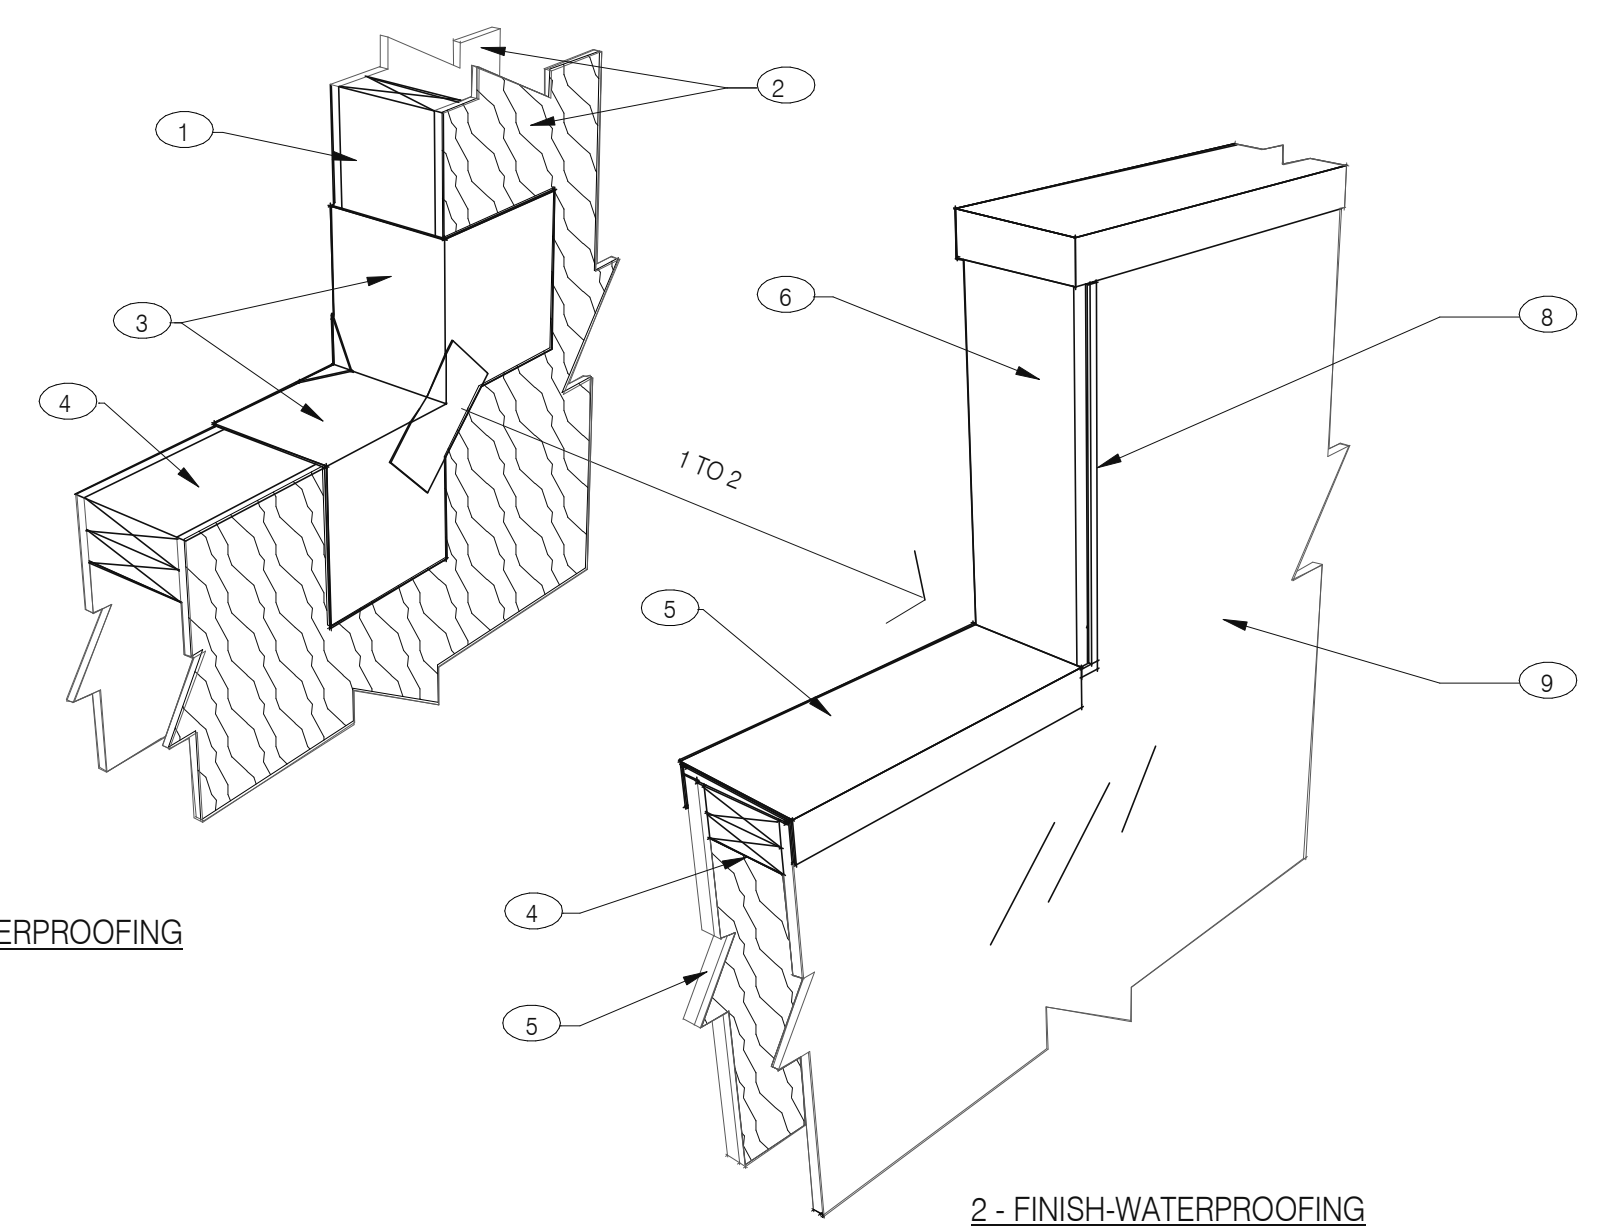

1 - PRE-WATERPROOFING


2 - FINISH-WATERPROOFING

NOTES


- 1 2X WOOD STUDS
- 2 PLYWOOD SUBSTRATE FOR EXTERIOR WALLS
- 3 FLASHING TAPE AT ALL VERTICAL PARAPET TRANSITIONS. EXTEND TAPE 12" OUTWARD AND UPWARD FROM CORNER AS SHOWN. LAP CORNERS WITH ANGLED TAPE AS SHOWN TO INSURE FULL COVERAGE AT CORNERS
- 4 DOUBLE 2X TOP PLATE.
- 5 PAINTED 24 GAUGE PARAPET COPING. SLOPE 1/4:1 TOWARDS ROOF WITH FIBER CANT STRIPS UNDER COPING. LAP FRONT AND BACK EDGE 2" DOWN VERTICAL FACE. LAP EXPOSED COPING EDGE EXPOSED ENDS AT VERTICAL PARAPET TRANSITION.
- 6 WRAP EXTERIOR FINISH MATERIAL ONTO VERTICAL FACE OF PARAPET TRANSITION. SEE EXTERIOR ELEVATIONS.
- 7 EXTERIOR FINISH MATERIAL AS NOTED ON EXTERIOR ELEVATIONS ON SHEET A4.0
- 8 TERMINATION BAR AT VERTICAL TRANSITION OF EXTERIOR FINISH MATERIAL AND MEMBRANE ROOFING. SEAL VERTICAL GAP BETWEEN TERMINATION BAR AND EXTERIOR FINISH PER ROOFING MANUFACTURER SPECIFICATIONS.
- 9 PVC ROOFING MEMBRANE ON BACKSIDE OF PARAPET.

IMPORTANT : ONLY FASTEN PARAPET COPING ALONG THE FRONT AND BACK VERTICAL EDGE. NEVER ON TOP OF COPING.


PARAPET CAP & TRANSITION 1" = 1'-0" 13

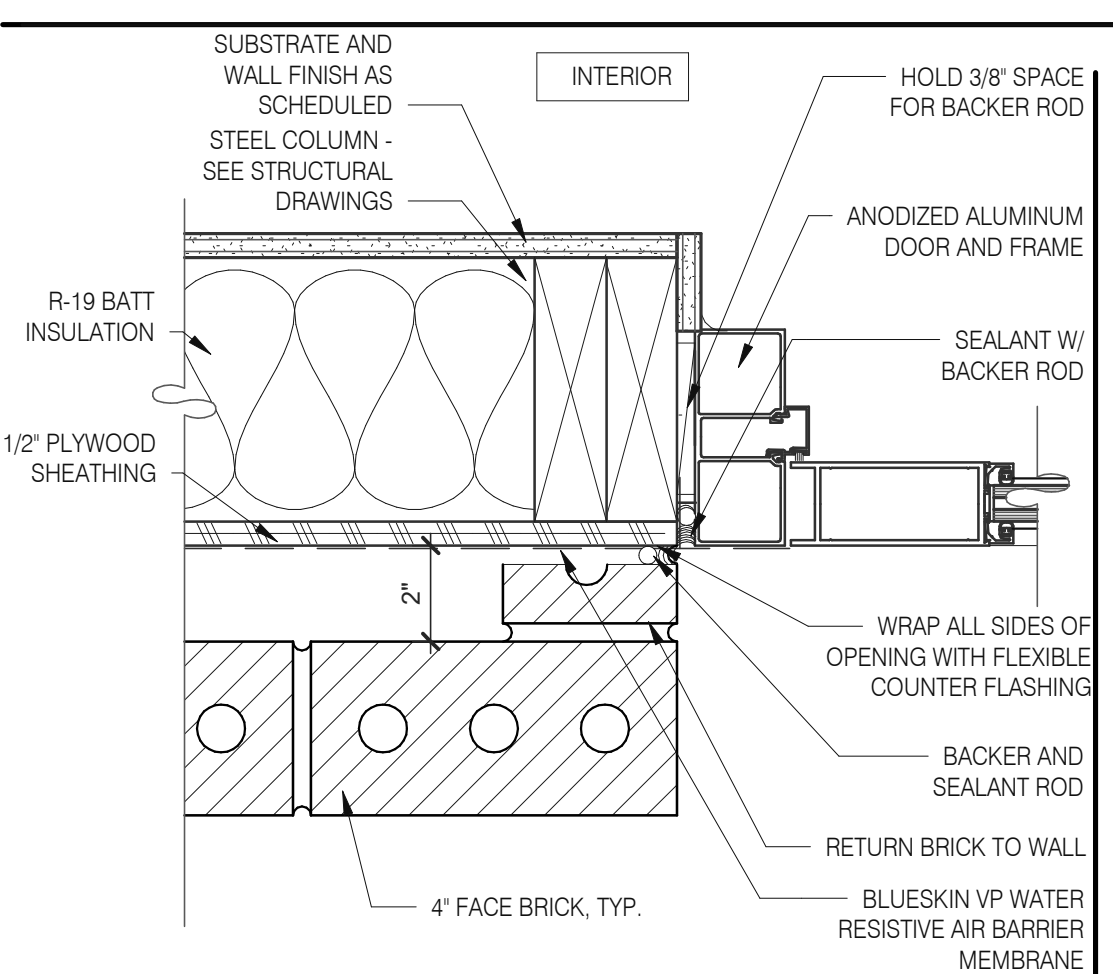


DOOR JAMB 3" = 1'-0" 16

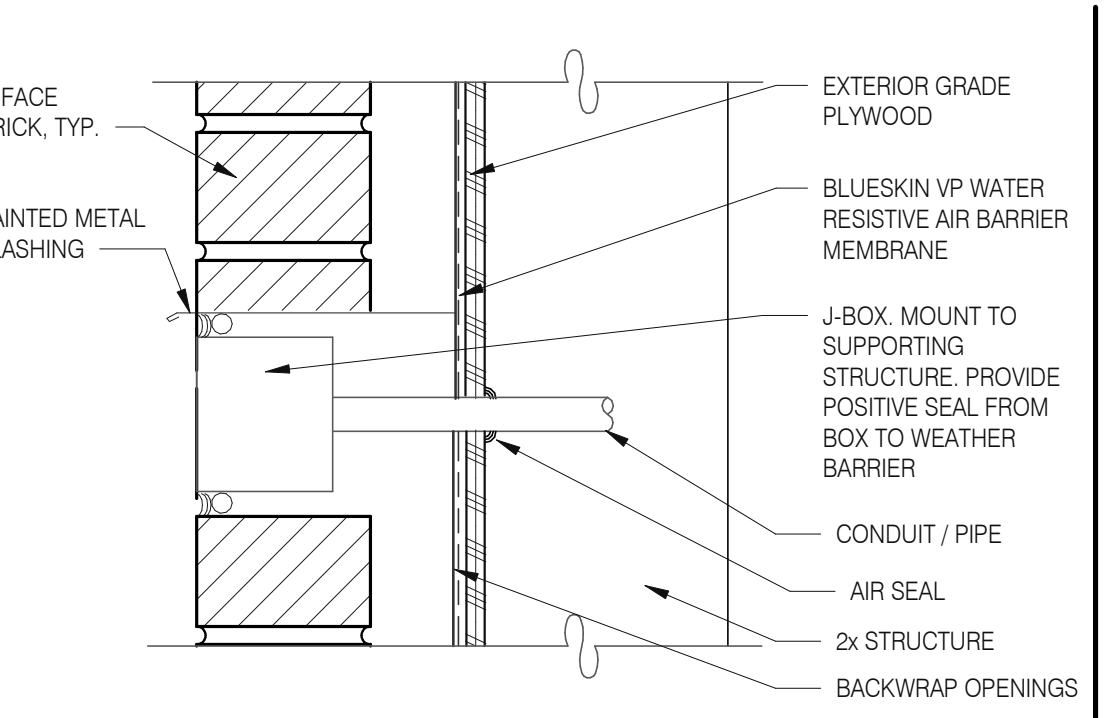


CO2 FILL / J-BOX 3" = 1'-0" 17

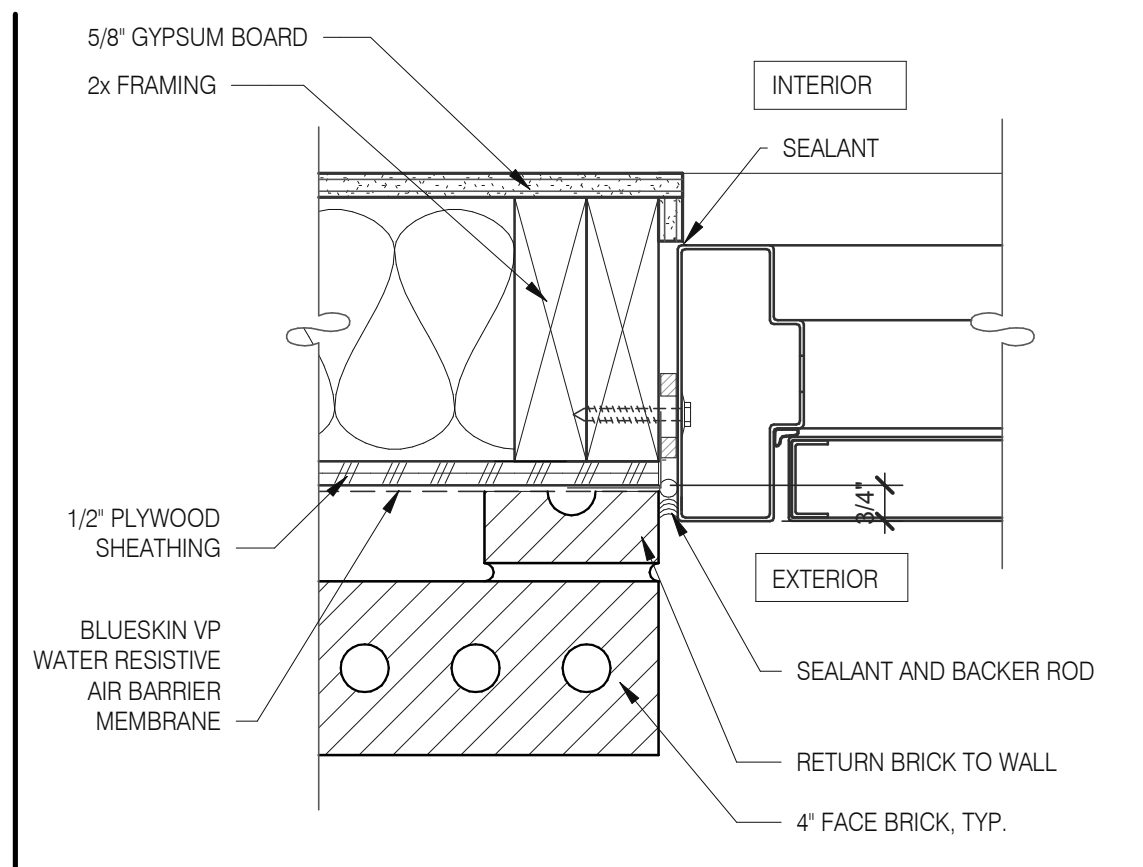


JAMB SERVICE DOOR 3" = 1'-0" 9

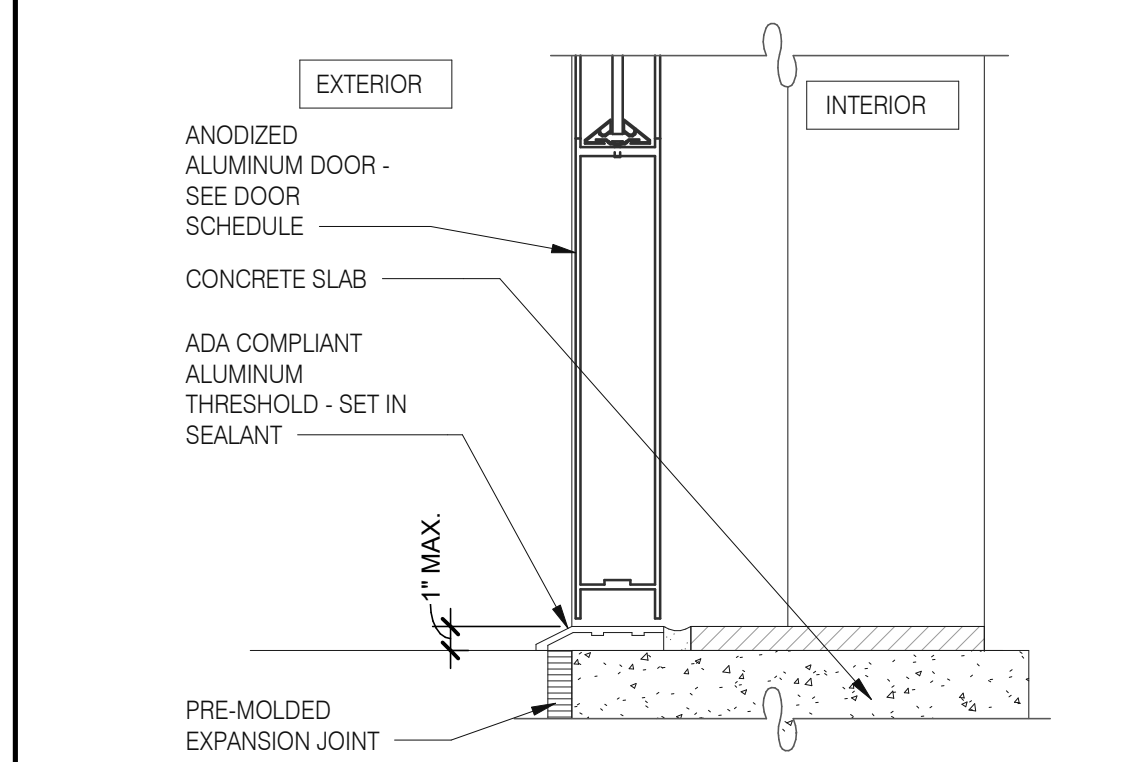


STOREFRONT DOOR SILL 3" = 1'-0" 10

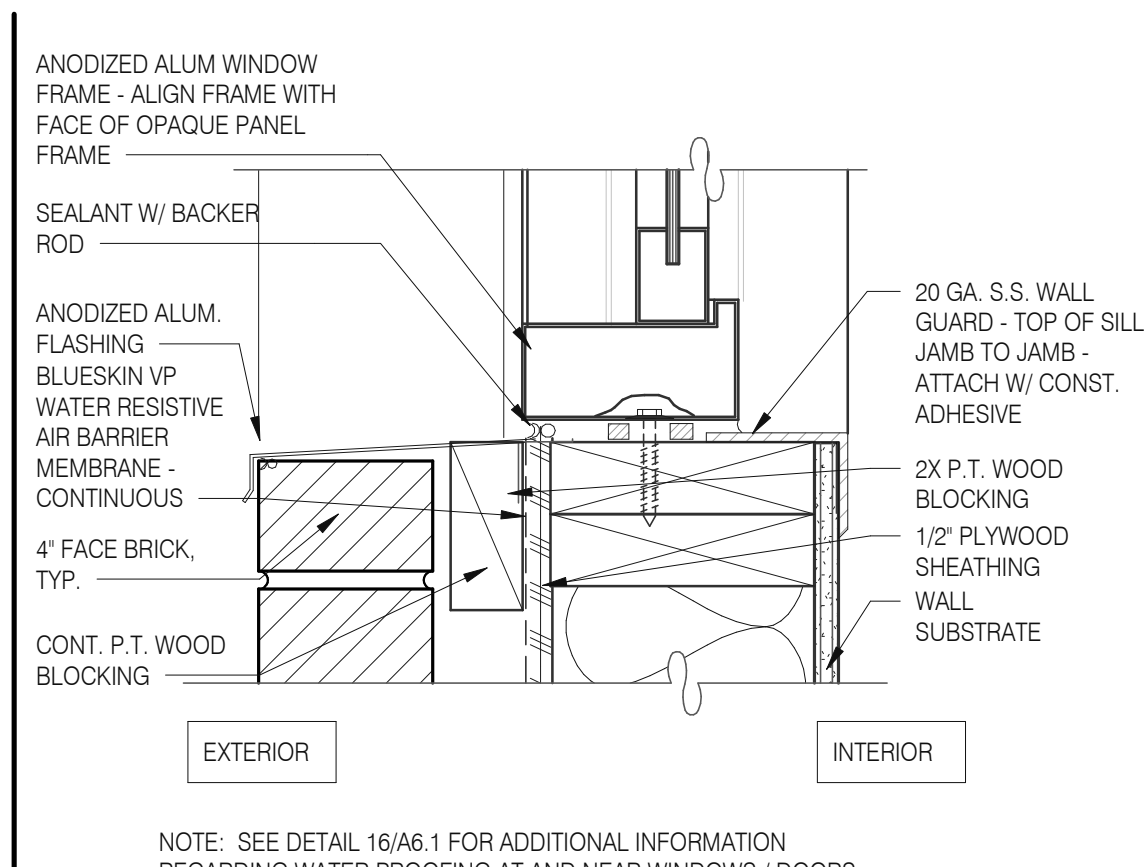


WINDOW SILL @ DRIVE THRU 3" = 1'-0" 5

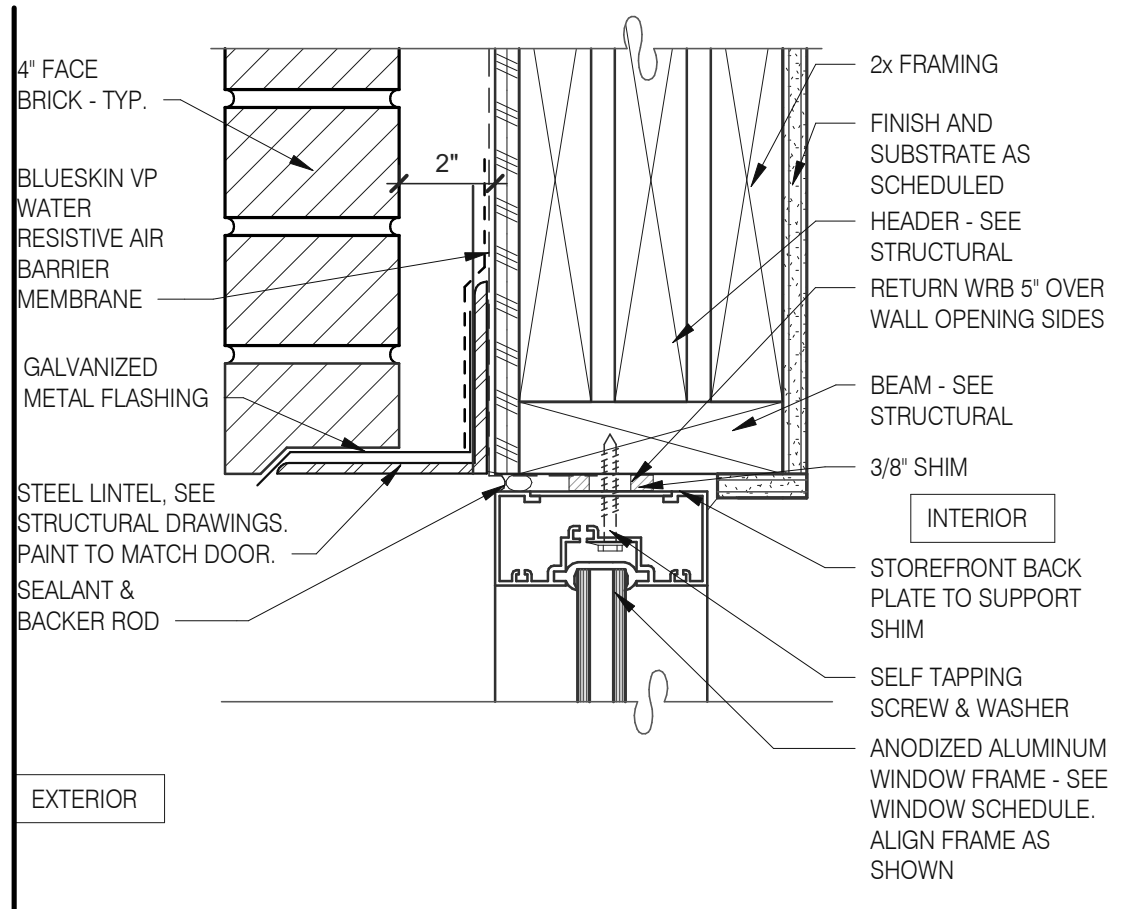


HEAD/ JAMB @ SERVICE DOOR 3" = 1'-0" 6

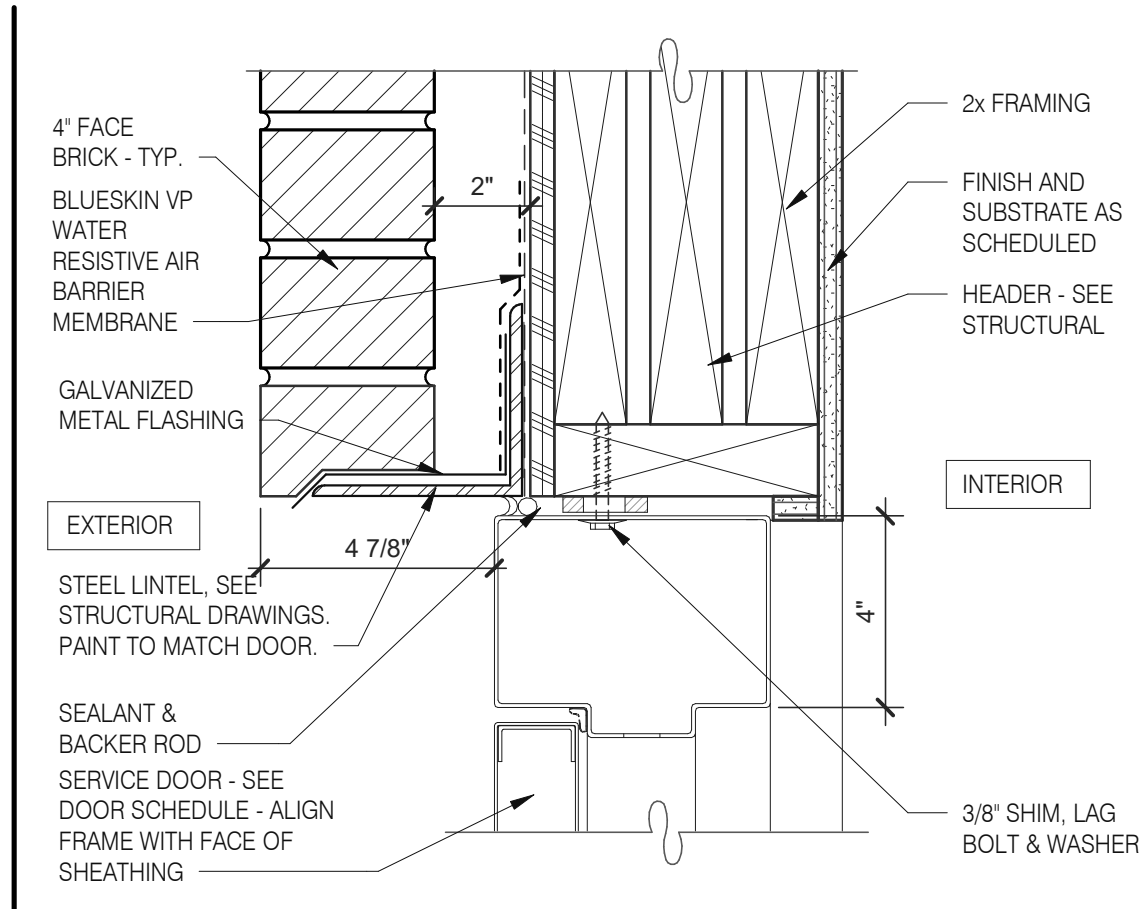


HEAD/ JAMB @ SERVICE DOOR 3" = 1'-0" 7

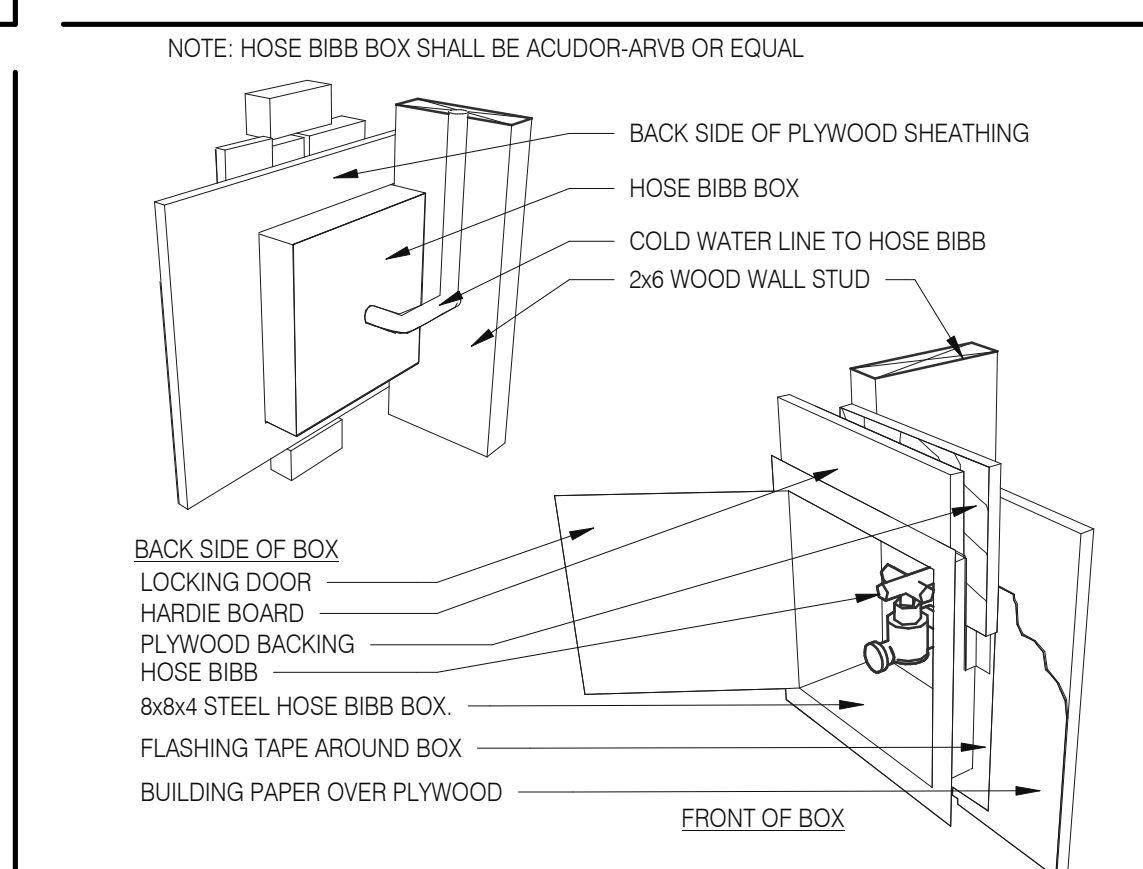


HOSE BIBB BOX 3" = 1'-0" 12

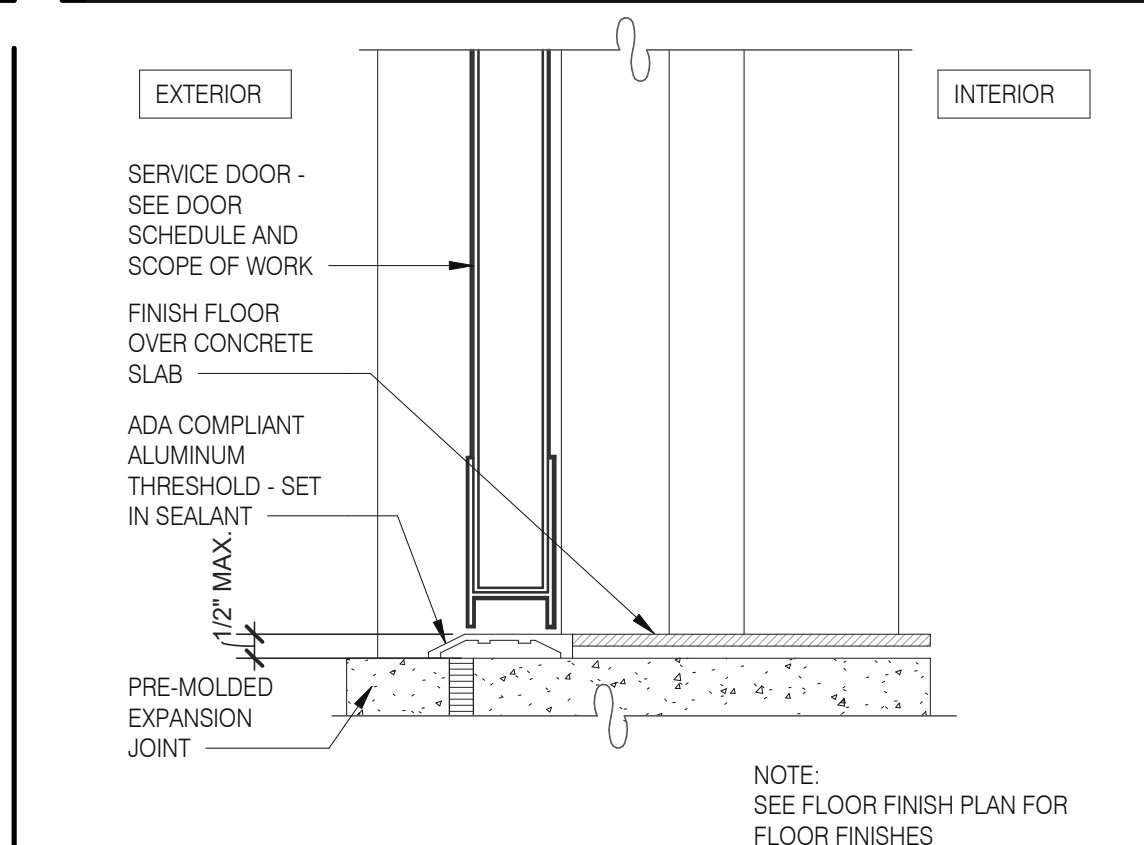


THRESHOLD @ SERVICE DOOR 3" = 1'-0" 8

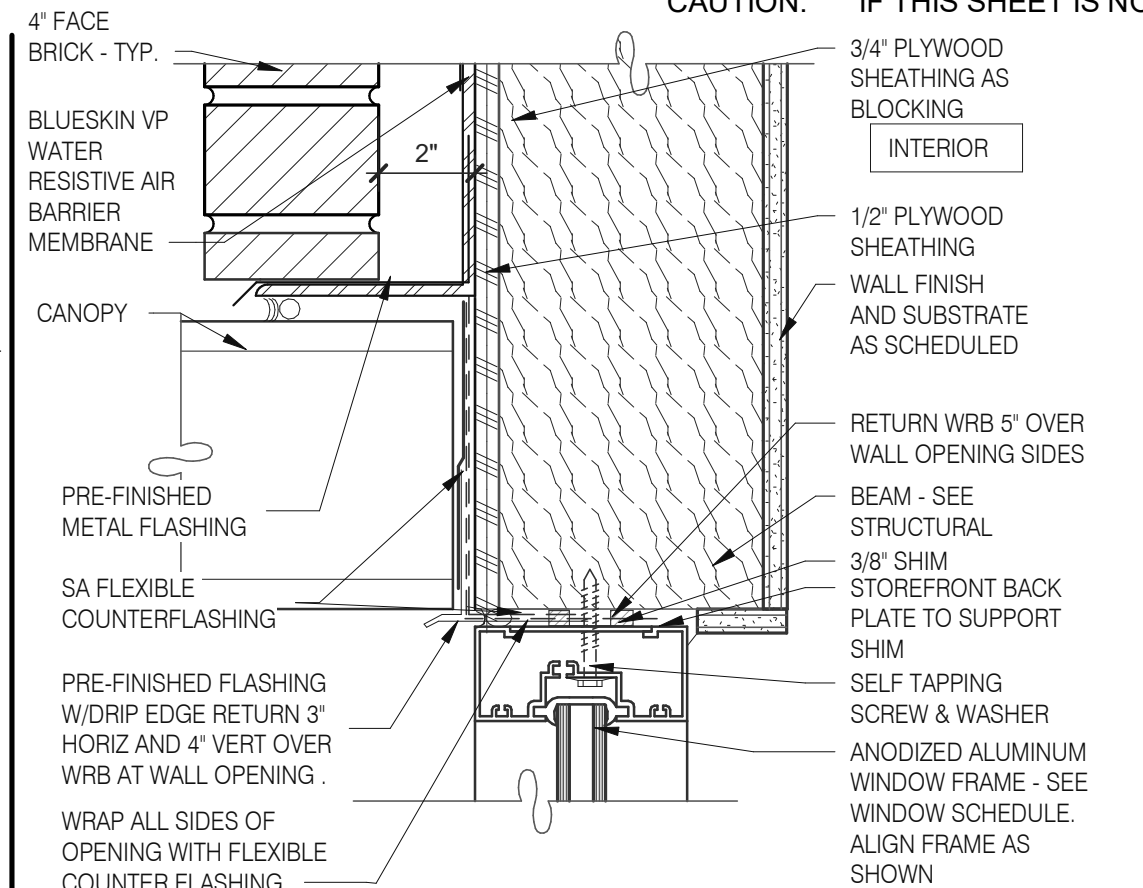

TYPICAL WINDOW HEAD W/ CANOPY 3" = 1'-0" 1

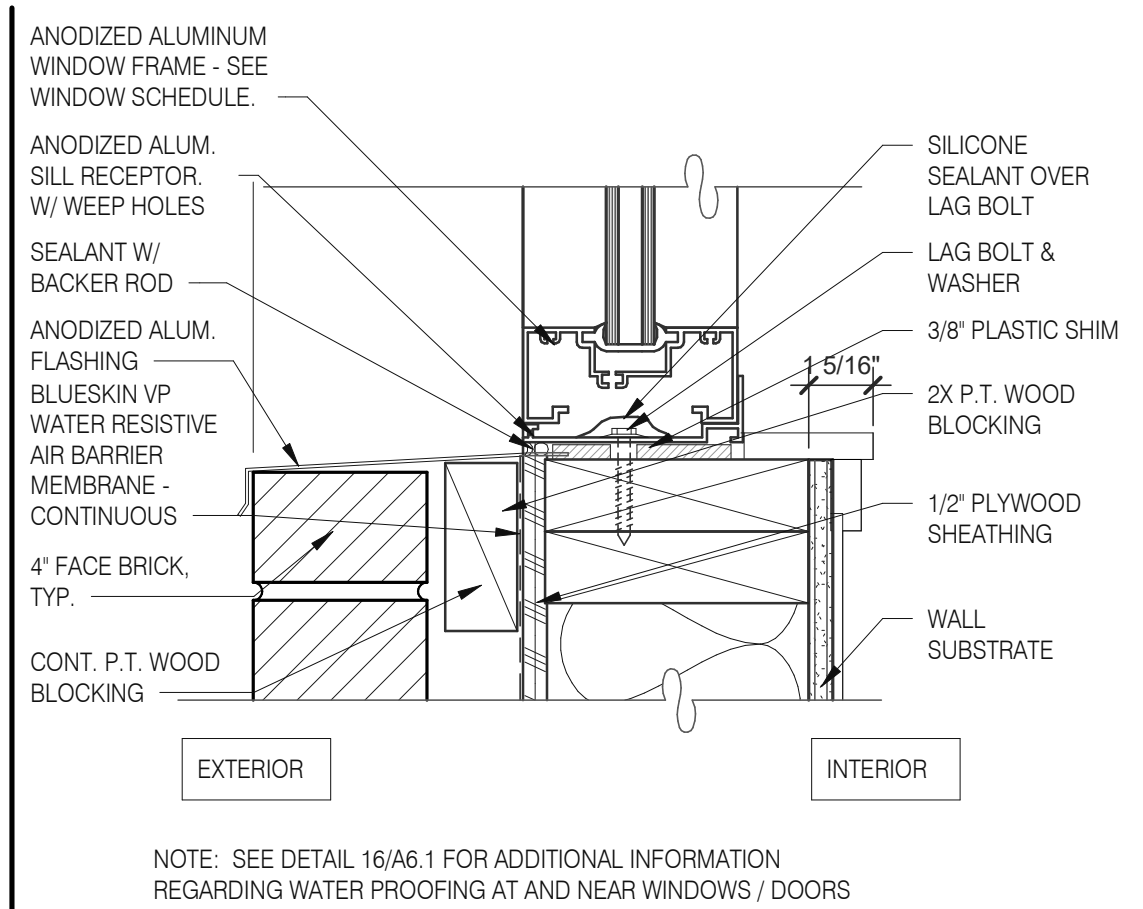

TYPICAL WINDOW SILL 3" = 1'-0" 2

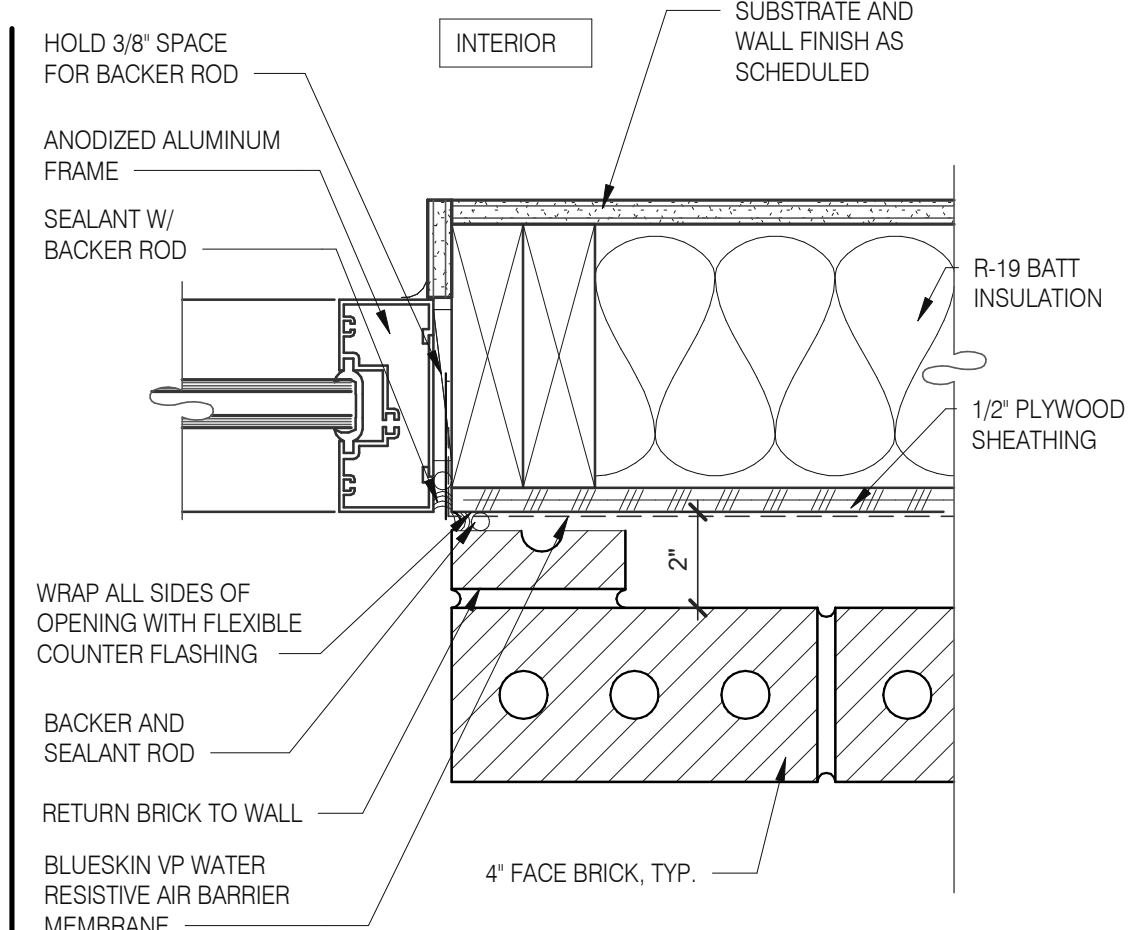

TYPICAL WINDOW JAMB 3" = 1'-0" 3

GENERAL NOTES:
HARDIE BOARD TO BE ATTACHED WITH CONCEALED FASTENERS PER MANUFACTURERS SPECIFICATIONS

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0 CONSTRUCTION DETAILS DOOR/WINDOW

A6.1

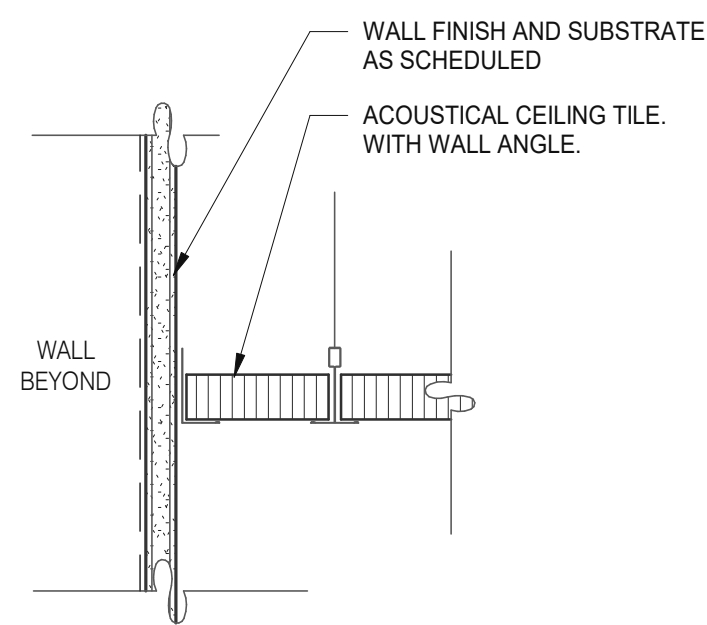


GYPSUM BOARD TRANSITION 3" = 1'-0" **17**

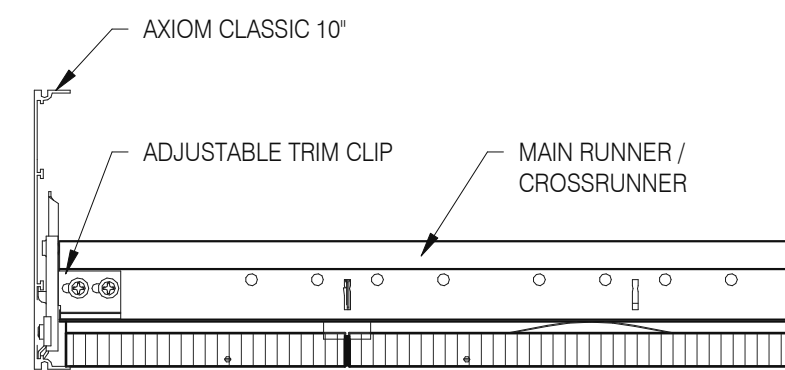

ASSEMBLY CLIP-ON 3" = 1'-0" **13**

LATERAL BRACING: 4-12 GA. WIRES SECURED TO MAIN RUNNER WITHIN 2" OF CROSS RUNNER INTERSECTION AND SPLAYED 90° FROM EACH OTHER AT ANGLE NOT TO EXCEED 45° FROM THE PLANE OF THE CEILING TYP. @ 12'-0" EA. WAY BEGINNING 6'-0" MAX. FROM WALL.

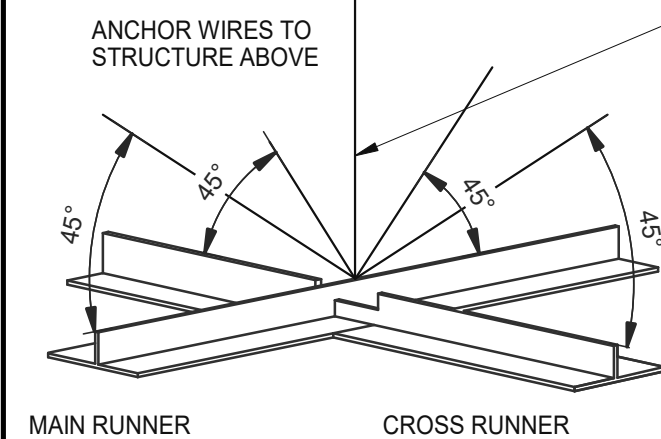


SUSPENDED ACOUSTICAL CEILING 3" = 1'-0" **9**

AT SUSPENDED CEILING: VERTICAL HANGER WIRE AT 4'-0" O.C. W/ (2) 1 1/2" X 8" GA. STAPLES @ LOOP & (1) ACROSS LAP. 3 FULL TURNS MINIMUM WITHIN 3" LENGTH

AT OPEN GRID: VERTICAL SUSPENSION WITH THREADED ROD PER OTHER DETAILS.

NOTE:
○ ALL WIRES 12 GA.
○ PROVIDE 6" CLEARANCE AT ALL PIPES & DUCTS, ETC.
○ BRACING WIRES MUST BE ATTACHED TO THE GRID AND TO THE STRUCTURE IN SUCH A MANNER THAT THEY CAN SUPPORT A DESIGN LOAD OF NOT LESS THAN 200 POUNDS OR THE ACTUAL LOADS, WHICHEVER IS GREATER, WITH A SAFETY FACTOR OF 2.

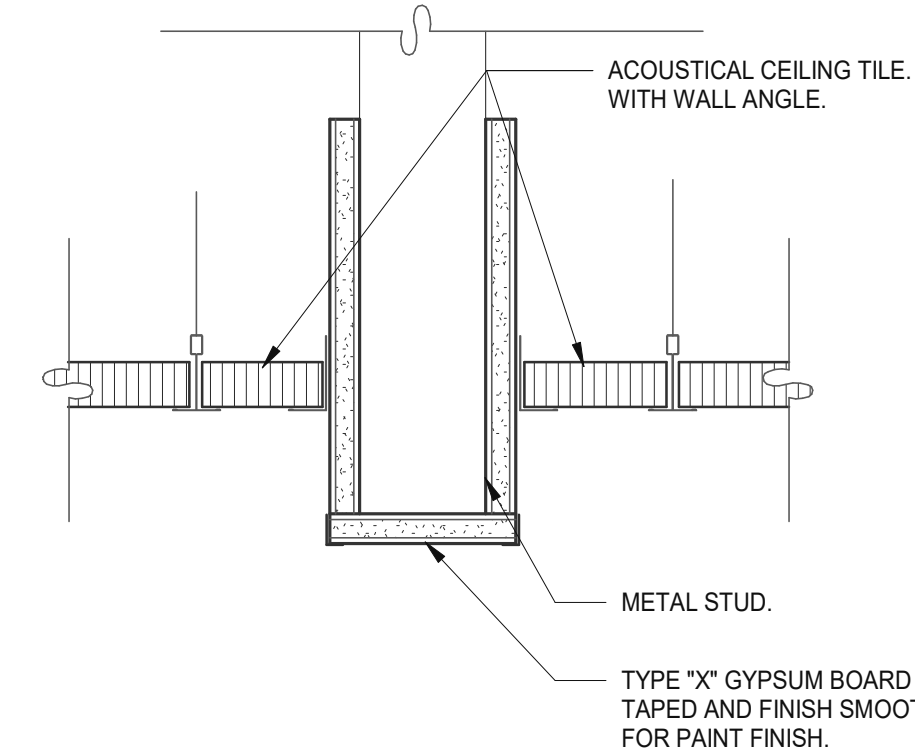

CEILING HEADER TRANSITION 3" = 1'-0" **5**


MEMBER DEPTH:
(EXAMPLE: 6" = 600 X 1/100 INCHES)
ALL MEMBER DEPTHS ARE TAKEN IN 1/100 INCHES. FOR ALL "T" SECTIONS MEMBER DEPTH IS THE INSIDE DIMENSION.

FLANGE WIDTH:
(EXAMPLE: 1 5/8" = 1.625" - 162 X 1/100 INCHES) ALL FLANGE WIDTHS ARE TAKEN IN 1/100 INCHES.


MATERIAL THICKNESS:
(EXAMPLE: 0.054 IN. = 54 MILS: 1 MIL = 1/1000 IN.) MATERIAL THICKNESS IS THE MINIMUM BASE METAL THICKNESS IN MILS. MINIMUM BASE METAL THICKNESS REPRESENTS 95% OF THE DESIGN THICKNESS.

STYLE:
(EXAMPLE: STUD OR JOIST SECTION = S)
THE FOUR ALPHA CHARACTERS UTILIZED BY THE DESIGNATOR SYSTEM ARE:
S = STUD OR JOIST, T = TRACK, U = CHANNEL, F = FURRING


CEILING SPAN TABLE NOTES:
1. VALUES ARE FOR SINGLE SPANS.
2. ALLOWABLE CEILING SPAN CALCULATIONS BASED ON 33KSI YIELD STRENGTH STEEL.
3. FOR FULLY BRACED CEILINGS, USE MID-SPAN BRACED VALUES.
4. END BEARING LENGTH = 1" MINIMUM.

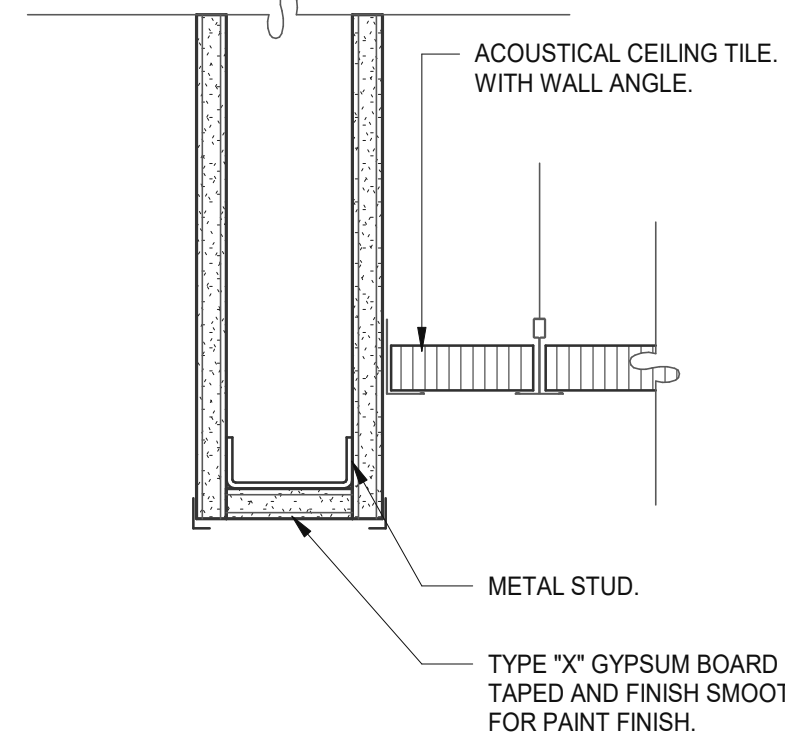

CEILING HEADER TRANSITION 3" = 1'-0" **14**

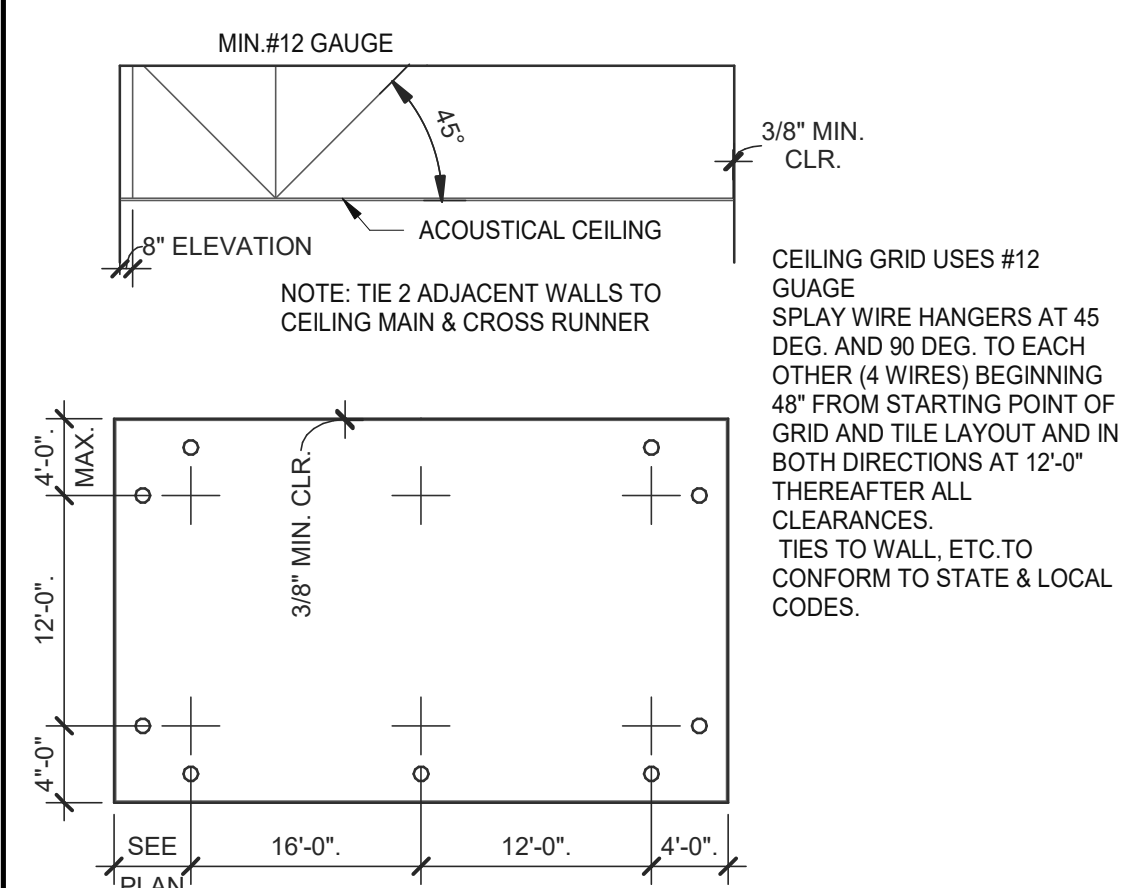

SUSPENDED CEILING GRID 12" = 1'-0" **10**

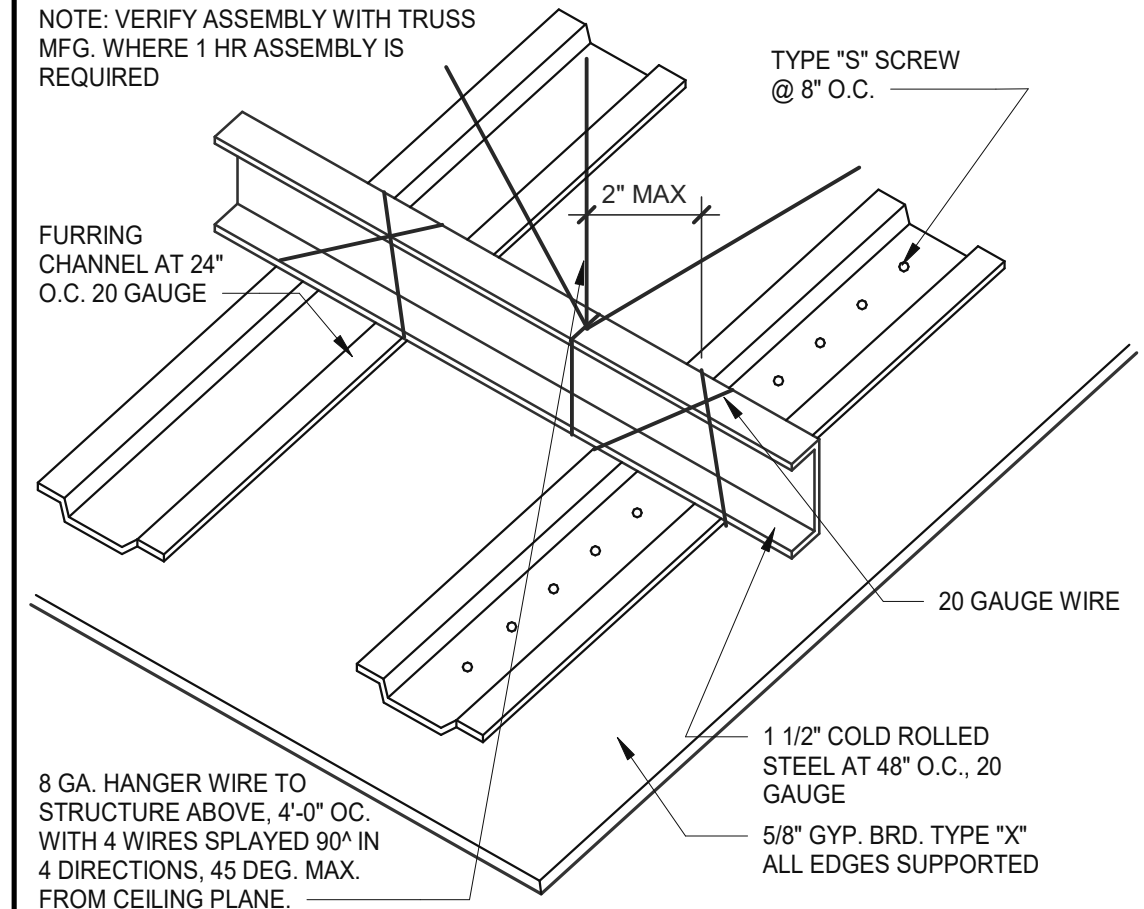

GYPSUM BOARD CEILING 3" = 1'-0" **6**

SECTION:	(MIL)	4 PSF LATERAL SUPPORT OF COMPRESSION FLANGE UNSUPPORTED					
		JOIST SPACING (IN.) O.C.			MID-SPAN JOIST SPACING (IN.) O.C.		
		12"	16"	24"	12"	16"	24"
362S125	18	9'-3"	8'-7"	7'-7"	12'-8"	11'-7"	10'-0"
362S125	27	10'-8"	9'-10"	8'-10"	15'-0"	13'-11"	12'-4"
362S125	30	11'-0"	10'-2"	9'-1"	15'-6"	14'-4"	12'-10"
362S125	33	11'-5"	10'-7"	9'-5"	16'-2"	14'-10"	13'-3"
362S125	43	12'-8"	11'-8"	10'-5"	17'-9"	16'-5"	14'-8"
362S137	27	12'-0"	11'-2"	10'-0"	17'-2"	15'-11"	14'-3"
362S137	33	12'-11"	11'-11"	10'-8"	18'-4"	16'-11"	15'-2"
362S137	43	14'-3"	13'-2"	11'-8"	20'-0"	18'-6"	16'-7"
362S162	33	14'-8"	13'-7"	12'-2"	20'-10"	18'-11"	16'-6"
362S162	43	16'-2"	14'-11"	13'-4"	22'-8"	20'-7"	18'-0"
400S125	27	10'-11"	10'-1"	9'-1"	15'-5"	14'-3"	12'-9"
400S125	30	11'-4"	10'-5"	9'-4"	16'-0"	14'-9"	13'-2"
400S125	33	11'-9"	10'-10"	9'-8"	16'-7"	15'-3"	13'-8"
400S125	43	13'-0"	12'-0"	10'-8"	18'-3"	16'-10"	15'-0"
400S137	27	12'-4"	11'-5"	10'-3"	17'-7"	16'-4"	14'-8"
400S137	33	13'-3"	12'-3"	10'-11"	18'-9"	17'-4"	15'-7"
400S137	43	14'-7"	13'-6"	12'-0"	20'-7"	19'-0"	17'-0"
400S162	33	15'-0"	13'-11"	12'-6"	21'-5"	19'-10"	17'-9"
400S162	43	16'-7"	15'-3"	13'-8"	23'-4"	21'-7"	19'-4"
600S125	27	12'-5"	11'-6"	10'-4"	17'-11"	16'-6"	14'-9"
600S125	30	12'-9"	11'-10"	10'-8"	18'-5"	17'-1"	15'-3"
600S125	33	13'-2"	12'-3"	11'-0"	18'-11"	17'-7"	15'-10"
600S125	43	14'-6"	13'-4"	11'-11"	20'-6"	19'-0"	17'-0"
600S137	33	14'-11"	13'-9"	12'-5"	21'-5"	19'-10"	17'-10"
600S137	43	16'-3"	15'-0"	13'-5"	23'-1"	21'-5"	19'-3"
600S162	33	16'-11"	15'-8"	14'-1"	24'-5"	22'-8"	20'-5"
600S162	43	18'-5"	17'-0"	15'-3"	26'-4"	24'-4"	21'-11"

NOTE: ALL JOIST INFORMATION IS BASED ON STEEL STUD MANUFACTURERS ASSOCIATION (SSMA) ICC ESR-3064P

INDICATES THAT WEB STIFFENERS ARE REQUIRED AT ENDS

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL


18550 E. WARREN AVE
DETROIT, MI 48236



**ENDEAVOR 2.0
CEILING
DETAILS**

A6.2


PLOT DATE: 11/3/2022 11:20:11 AM

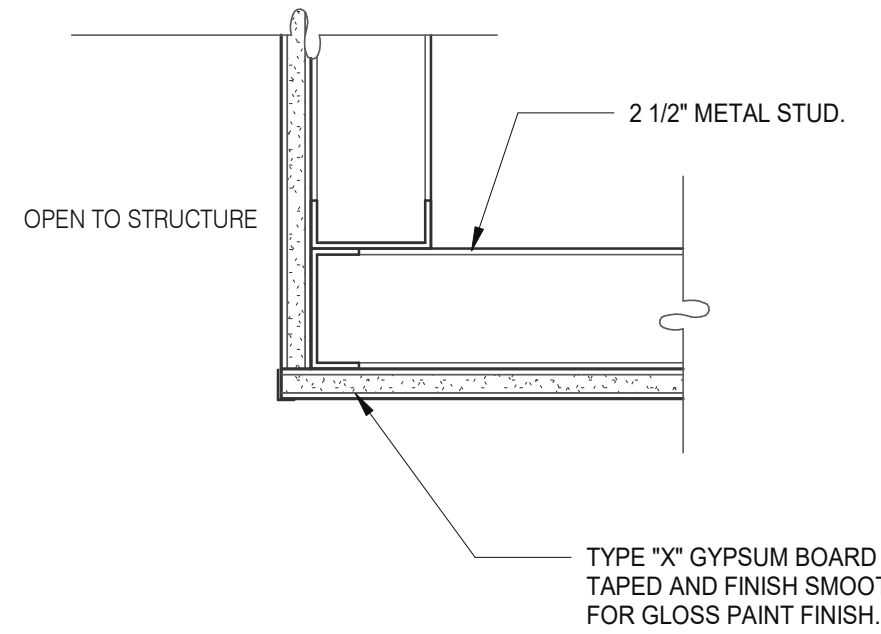

CEILING TRANSITION 3" = 1'-0" **11**

TWO (2) NO. 12 GAUGE WIRES MUST BE SECURED FROM LIGHT & MECHANICAL FIXTURES AT OPPOSING CORNERS ALONG THE FIXTURE'S DIAGONAL. WIRES MAY BE SLACK.

FOUR (4) NO. 12 GAUGE WIRES MUST BE ATTACHED TO THE GRID MEMBERS WITHIN 3" OF EA. CORNER OF EA. FIXTURE WHEN INTERMEDIATE CEILING SYSTEMS ARE USED.

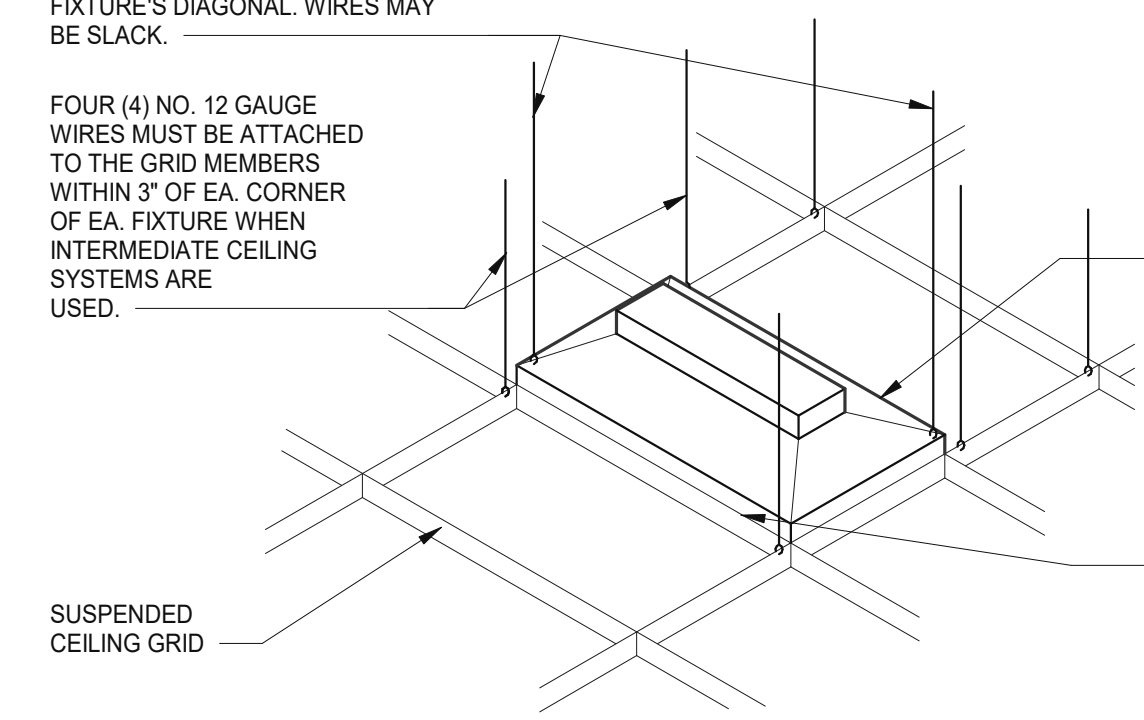


LIGHT FIXTURE @ SUSP. CLNG. 12" = 1'-0" **8**


LATERAL FORCE BRACING MEMBERS MUST BE SPACED A MINIMUM OF 6" FROM ALL HORIZONTAL PIPING OR DUCT WORK THAT IS NOT PROVIDED WITH BRACING RESTRAINTS FOR HORIZ. FORCES. BRACING WIRES MUST BE ATTACHED TO THE GRID AND TO THE STRUCTURE IN SUCH A MANNER THAT THEY CAN SUPPORT A DESIGN LOAD OF NOT LESS THAN 200 POUNDS OR THE ACTUAL LOADS, WHICHEVER IS GREATER, WITH A SAFETY FACTOR OF 2.

LIGHT FIXTURE (LESS THAN 56 LBS.)


PROVIDE MINIMUM OF 2 SCREWS AT OPPOSIT CORNERS OF SUPPORT WIRES, OR SCREW ON T-BAR SAFETY CLIPS AT SIDES OR ENDS.

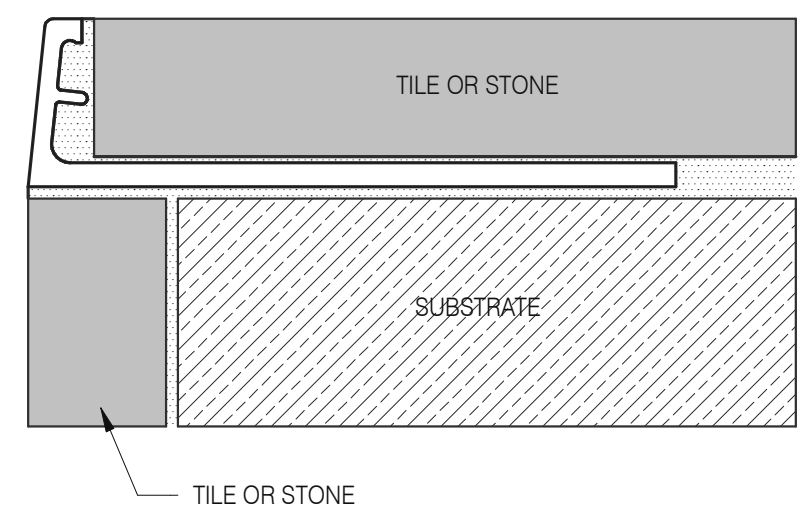


Schluter Jolly Corner Guard 1 1/2" = 1'-0" **17**

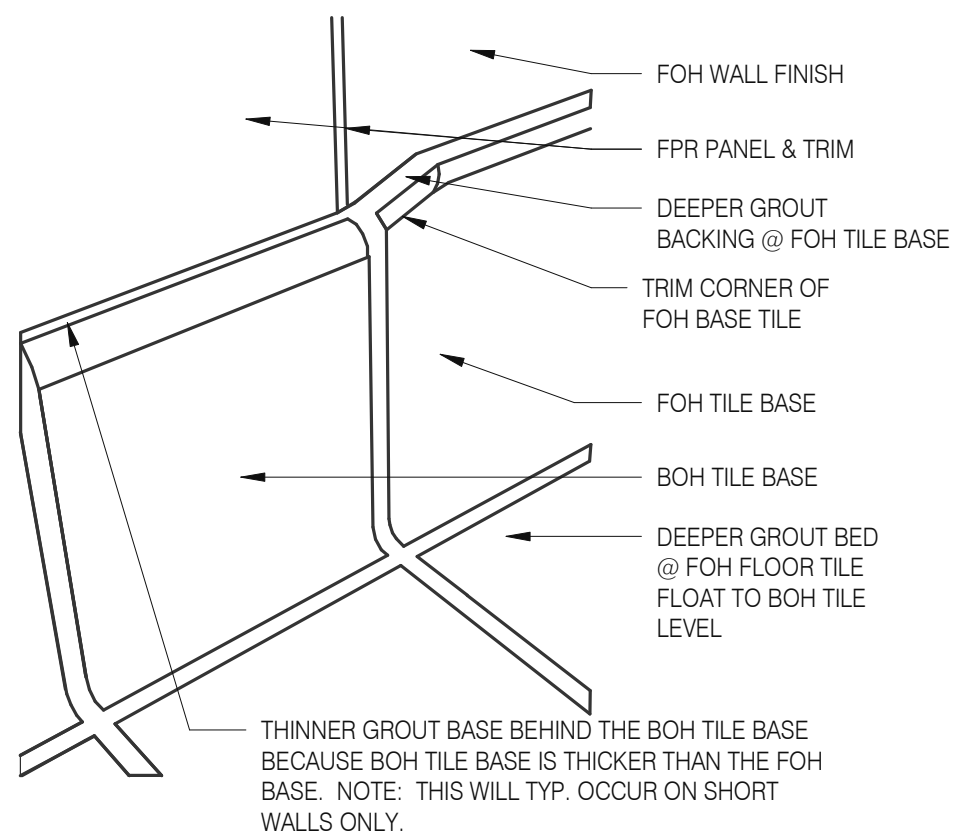


Tile Base Transition 12" = 1'-0" **13**

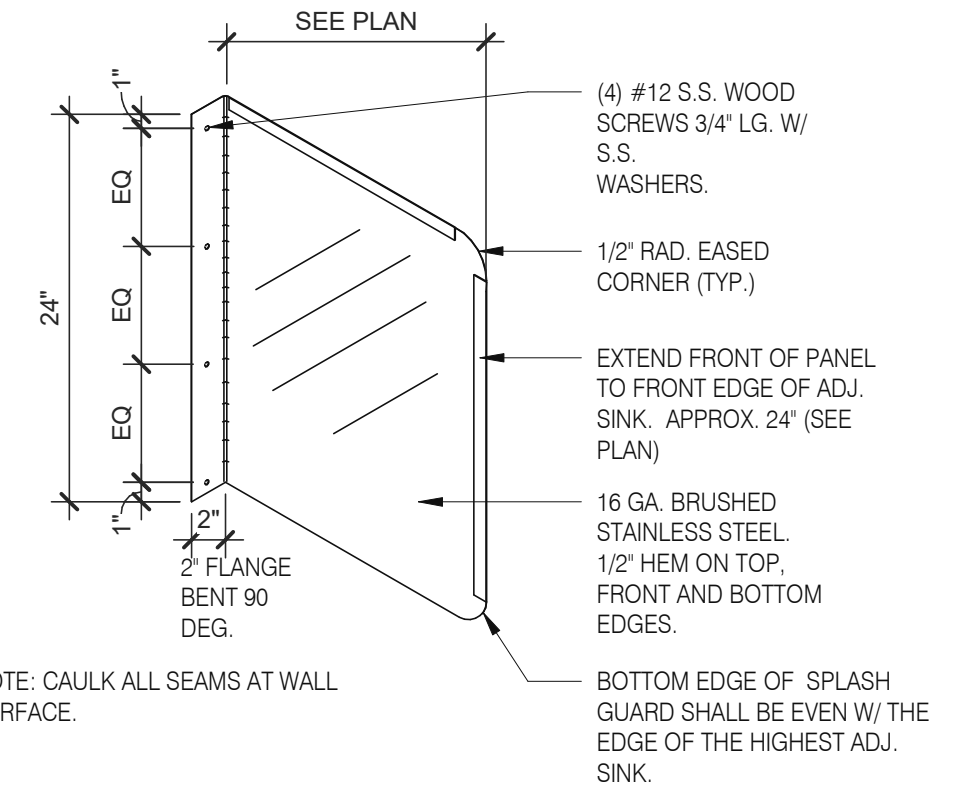


Splash Guard 1" = 1'-0" **9**

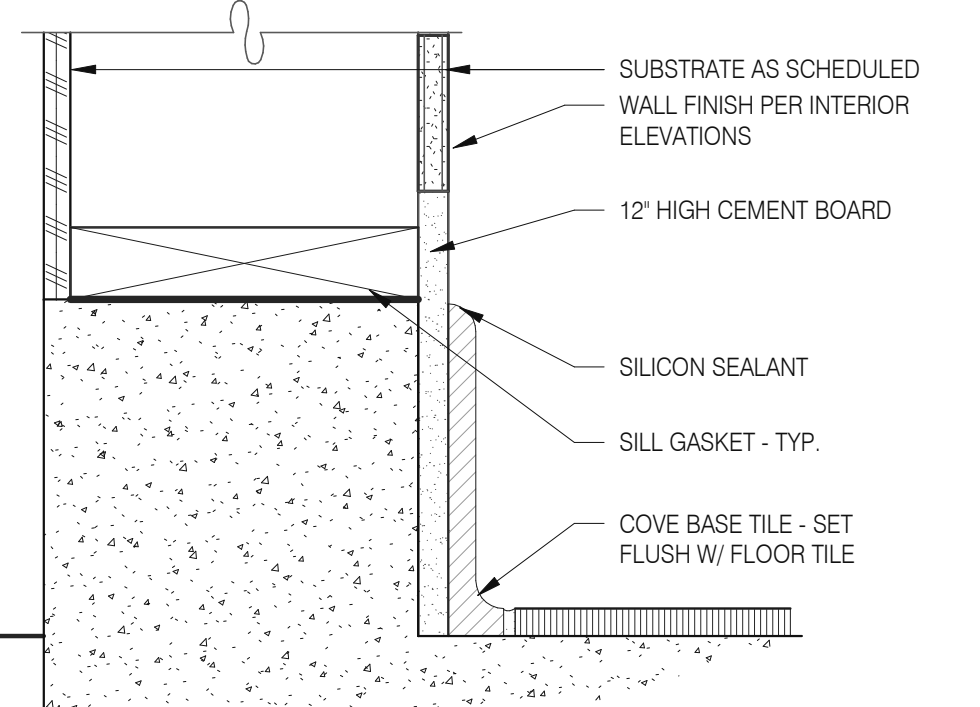


Base @ Dining Ext. Side Walls 3" = 1'-0" **5**

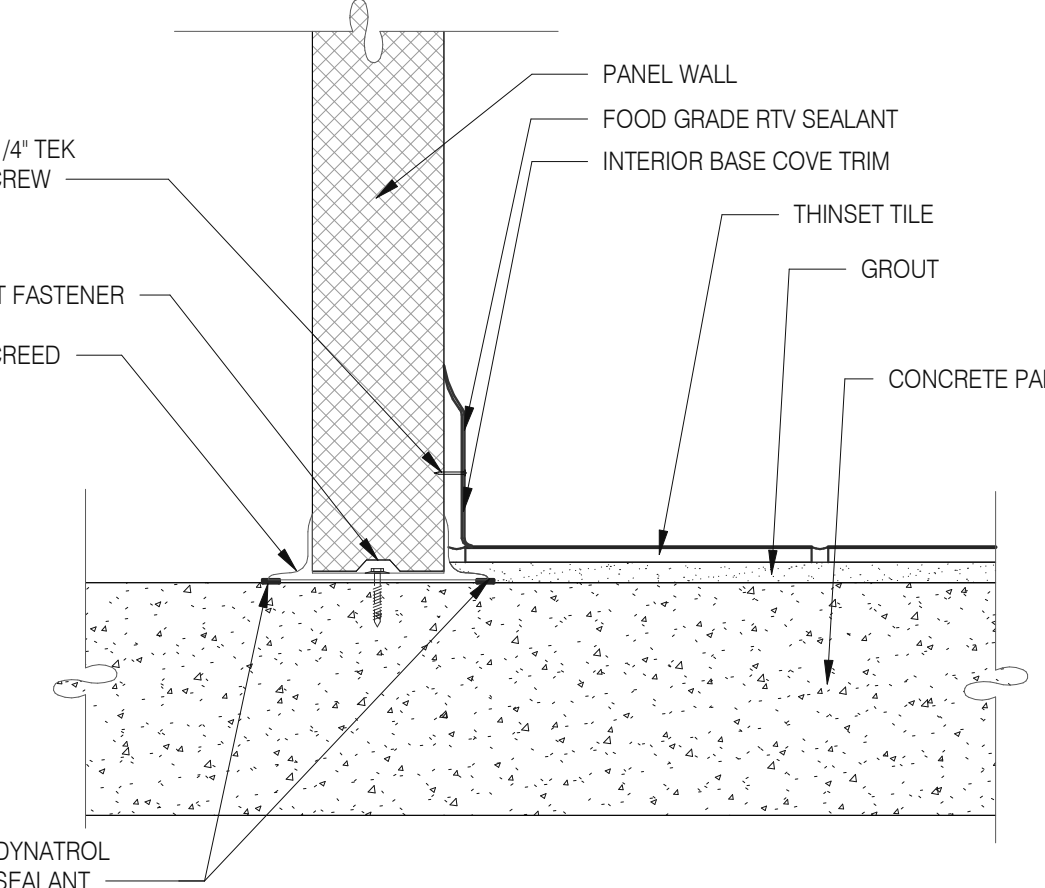


Walk-in Tile/Base 1 1 1/2" = 1'-0" **1**

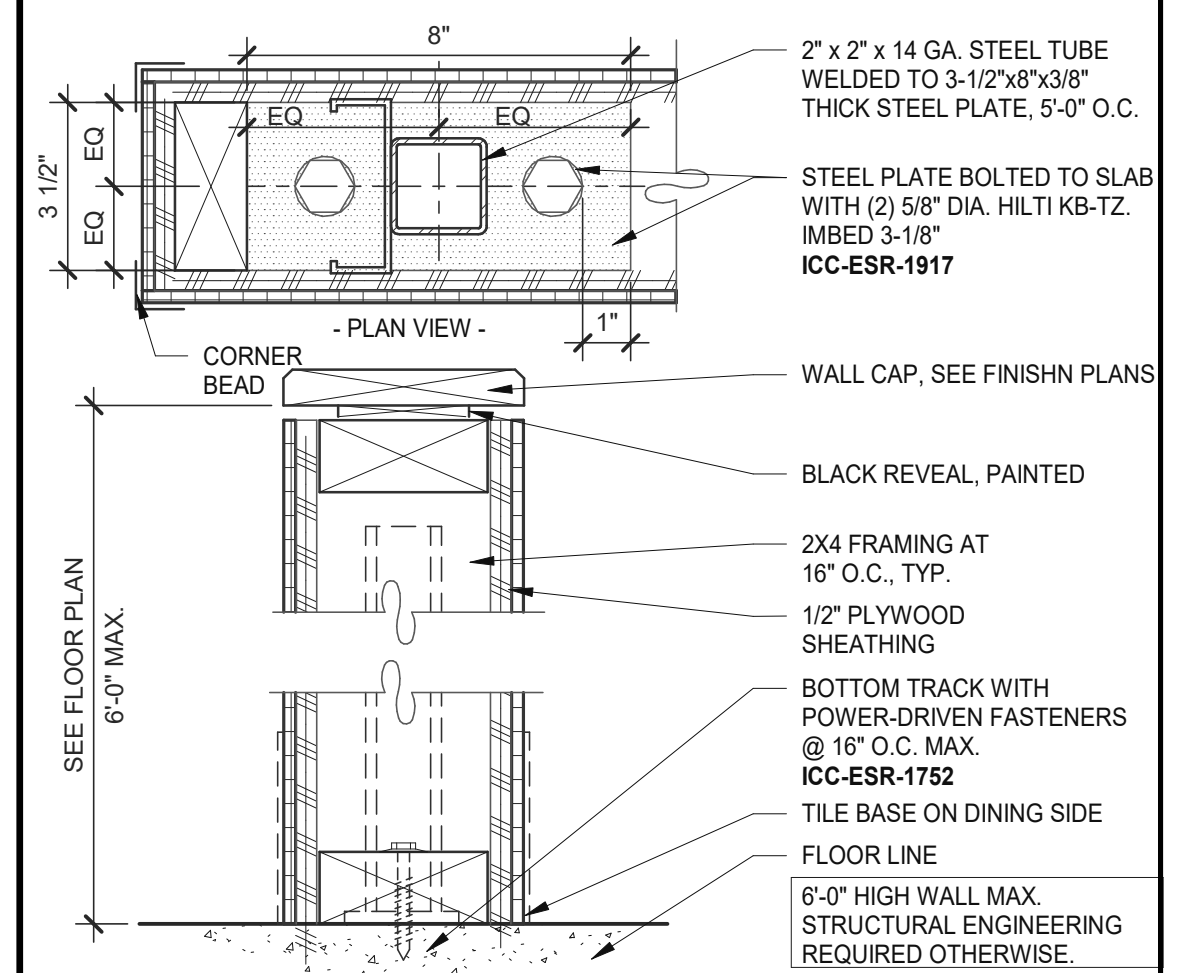


Low Wall 3" = 1'-0" **18**

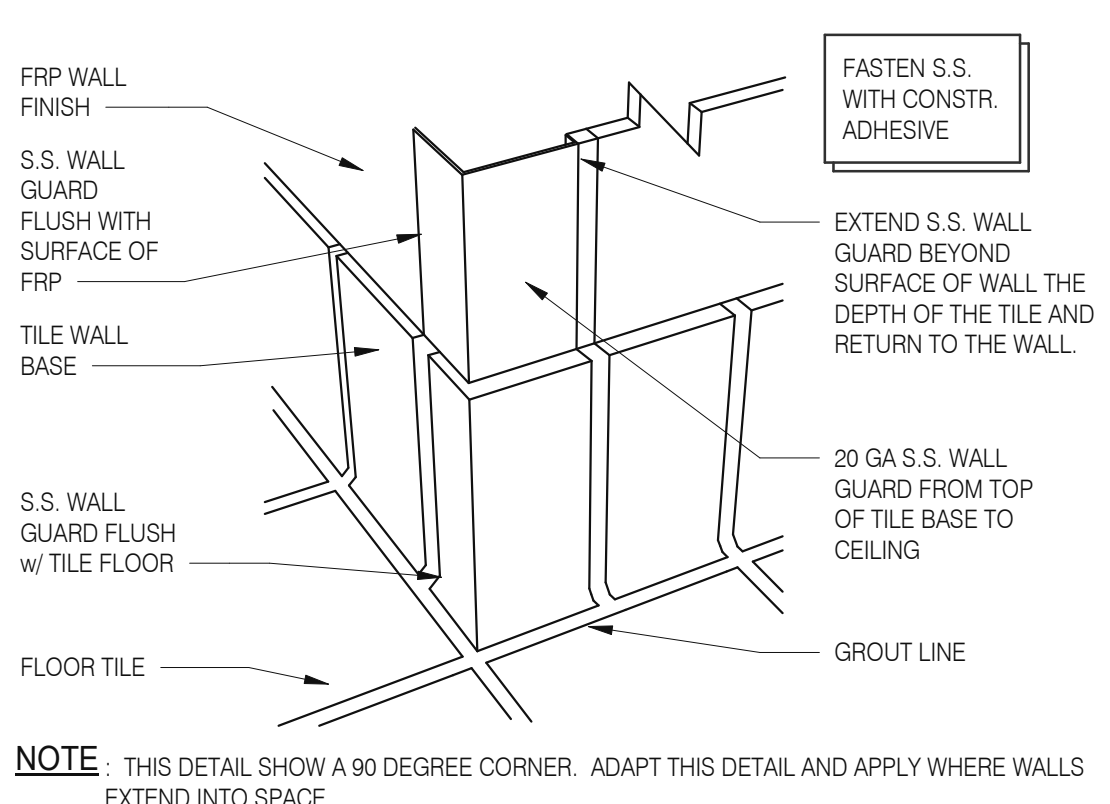


S.S. Corner & End Wall Guard 12" = 1'-0" **14**

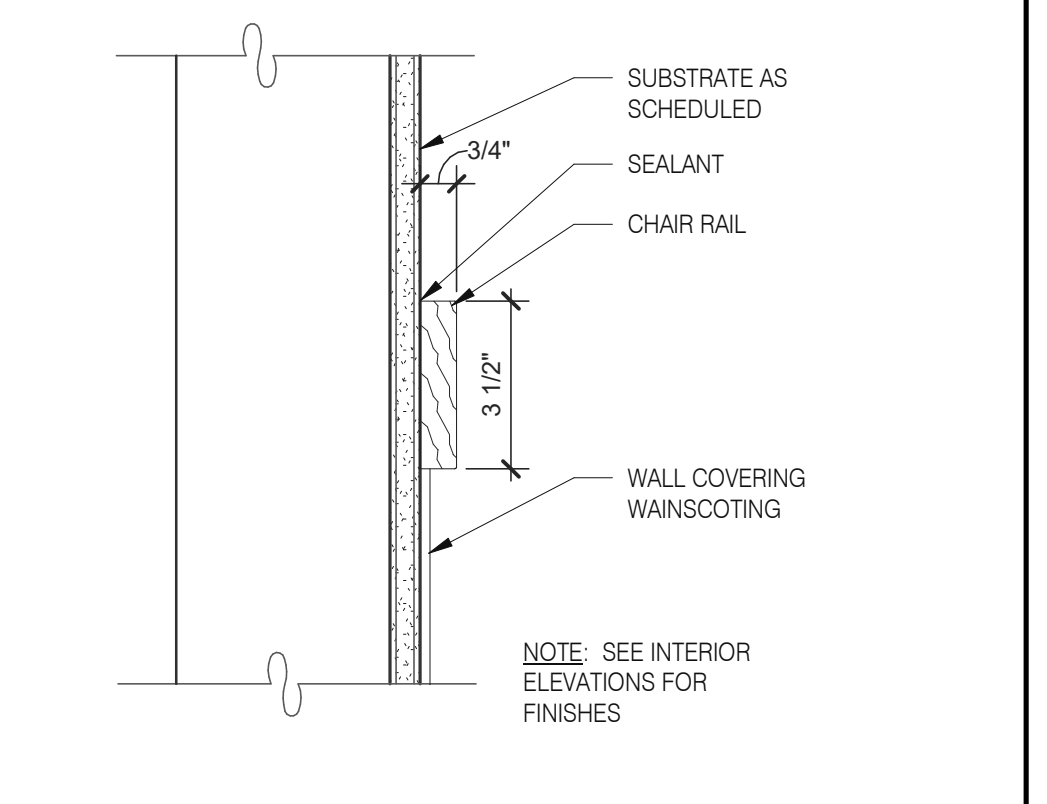


Chair Rail Detail 3" = 1'-0" **10**

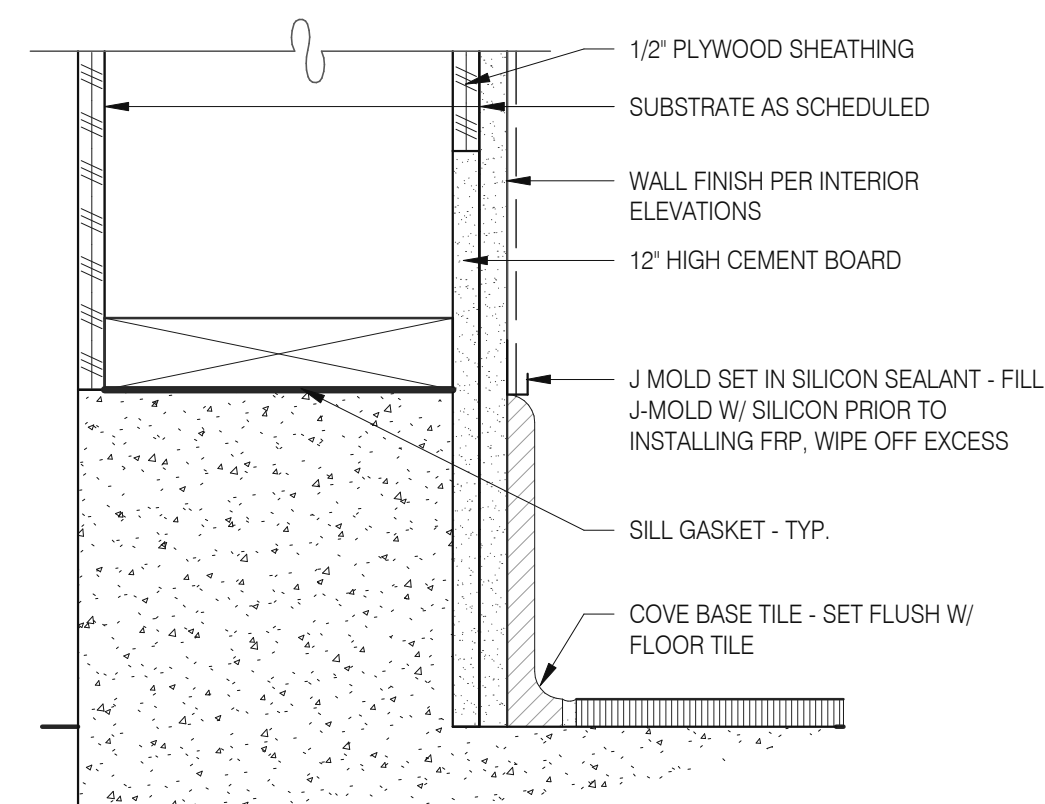


Base @ Ext. Wall 3" = 1'-0" **6**

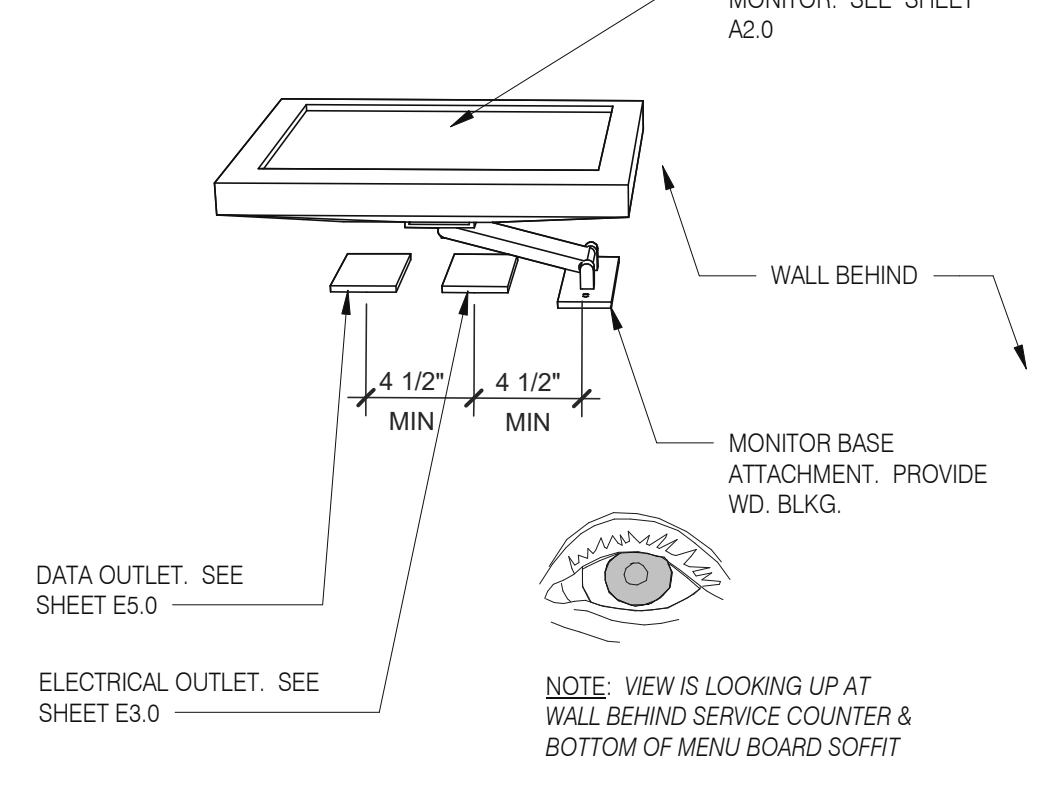


Wall Mount Monitor 1 1/2" = 1'-0" **2**

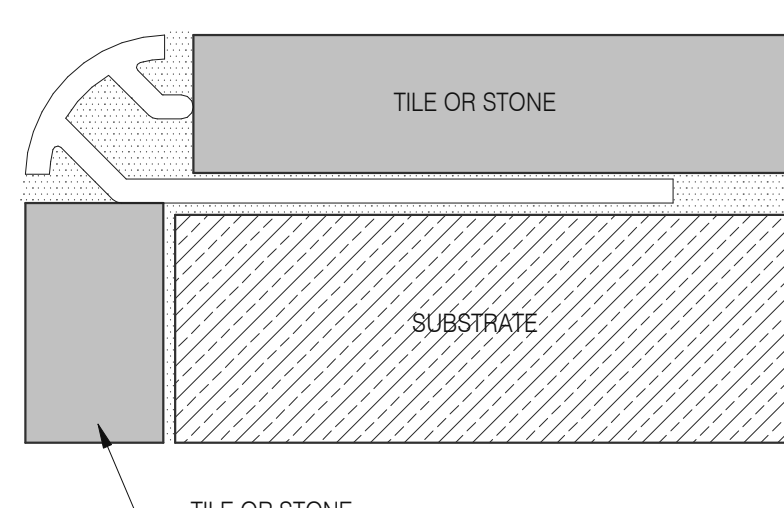


Schluter Corner Guard 1 1/2" = 1'-0" **15**

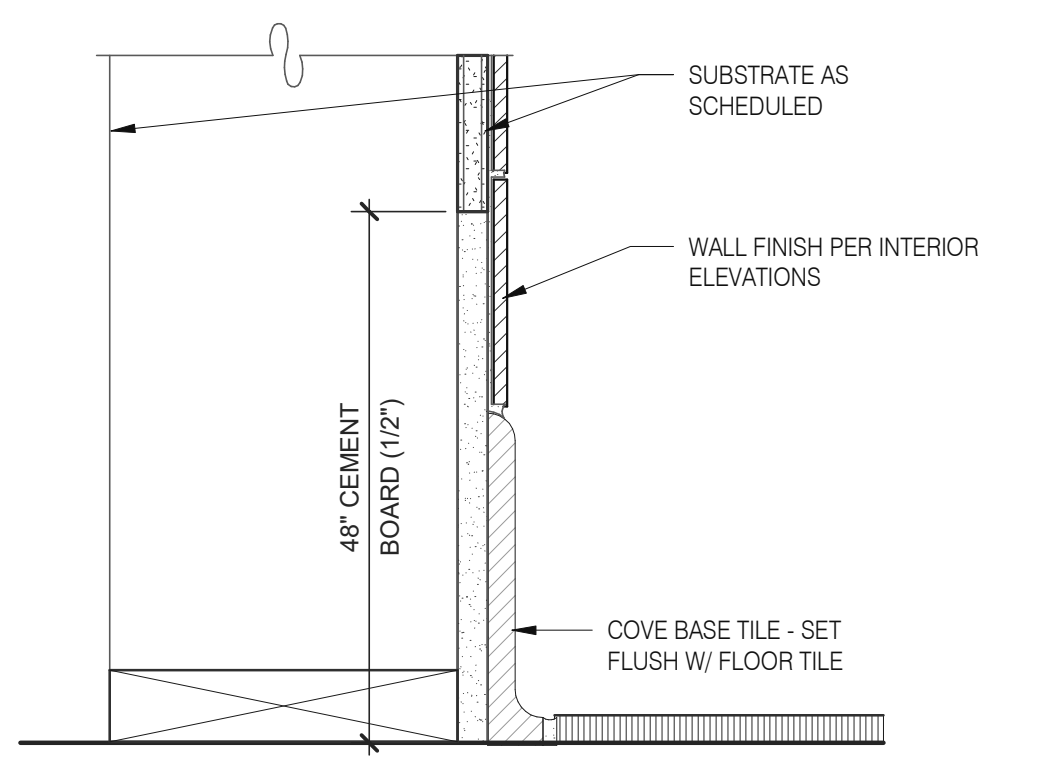


Base in Restroom 3" = 1'-0" **7**

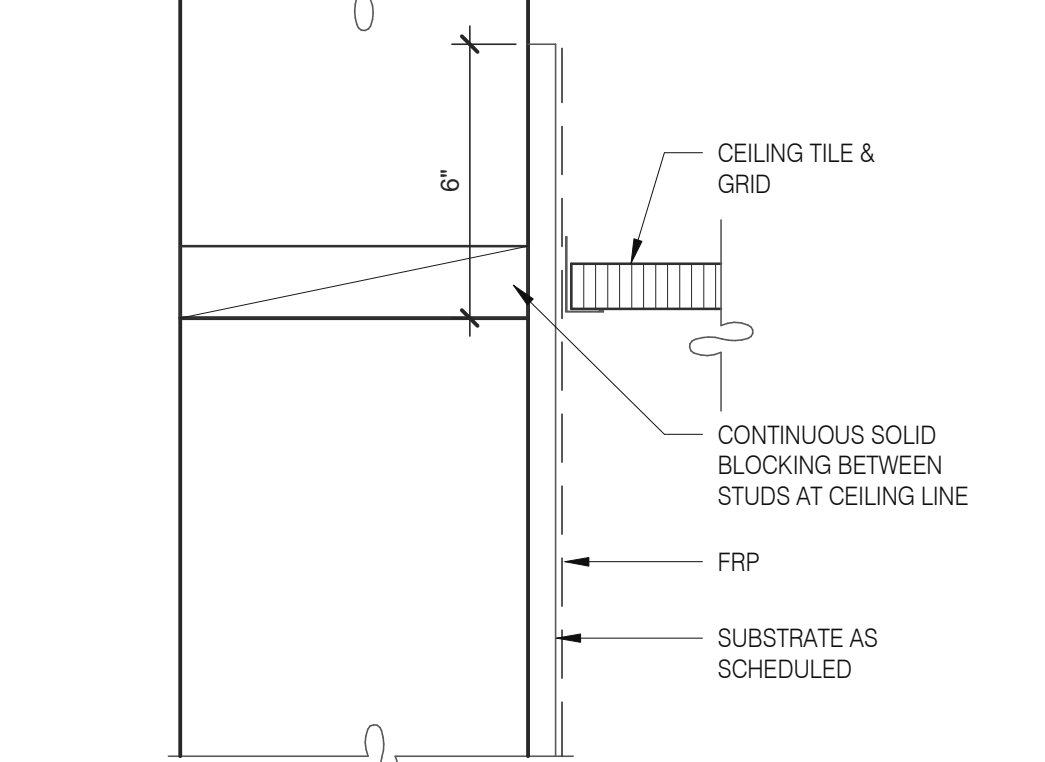


Kitchen Finish @ Ceiling 3" = 1'-0" **3**

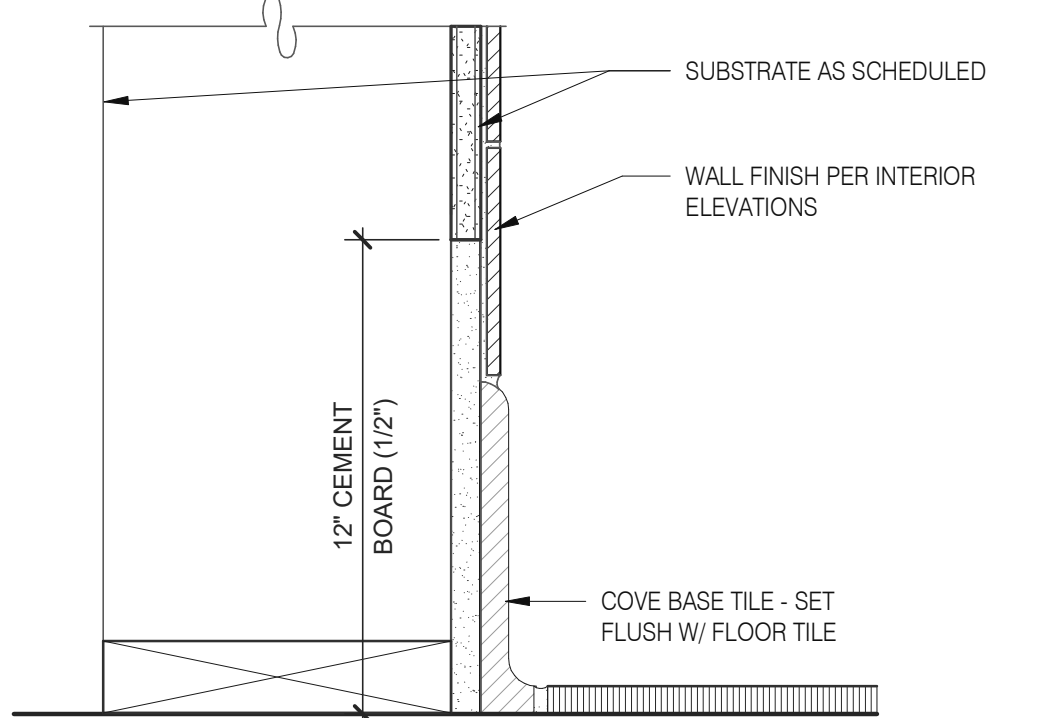

Base @ Kitchen Wall 3" = 1'-0" **16**

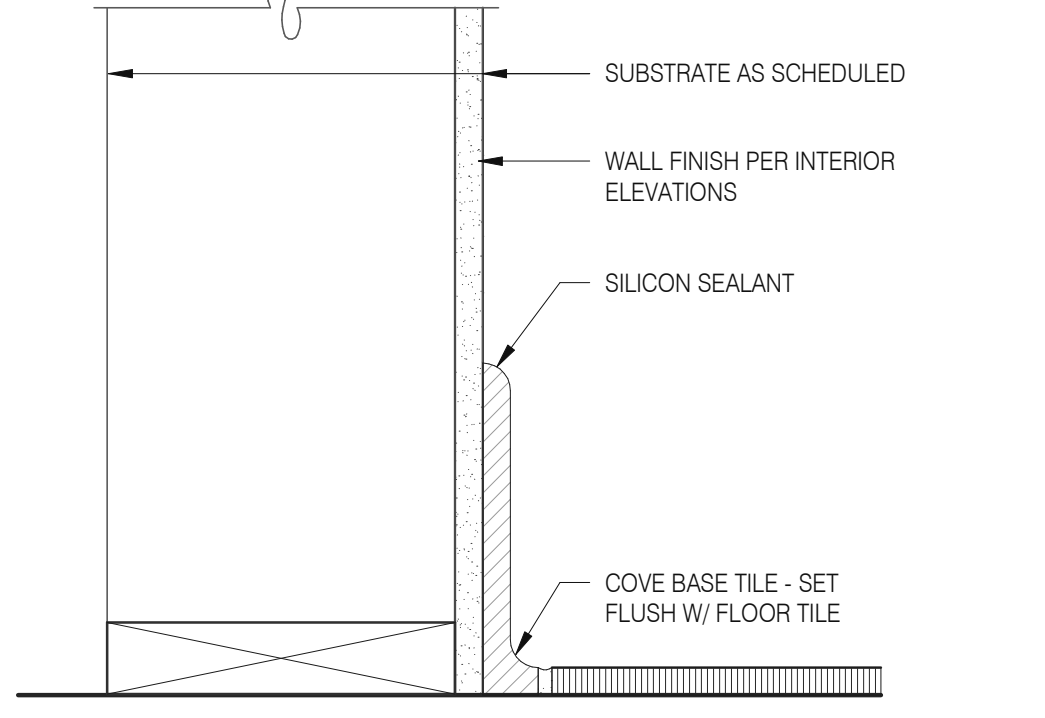

Base @ Dining Room Int. Wall 3" = 1'-0" **8**

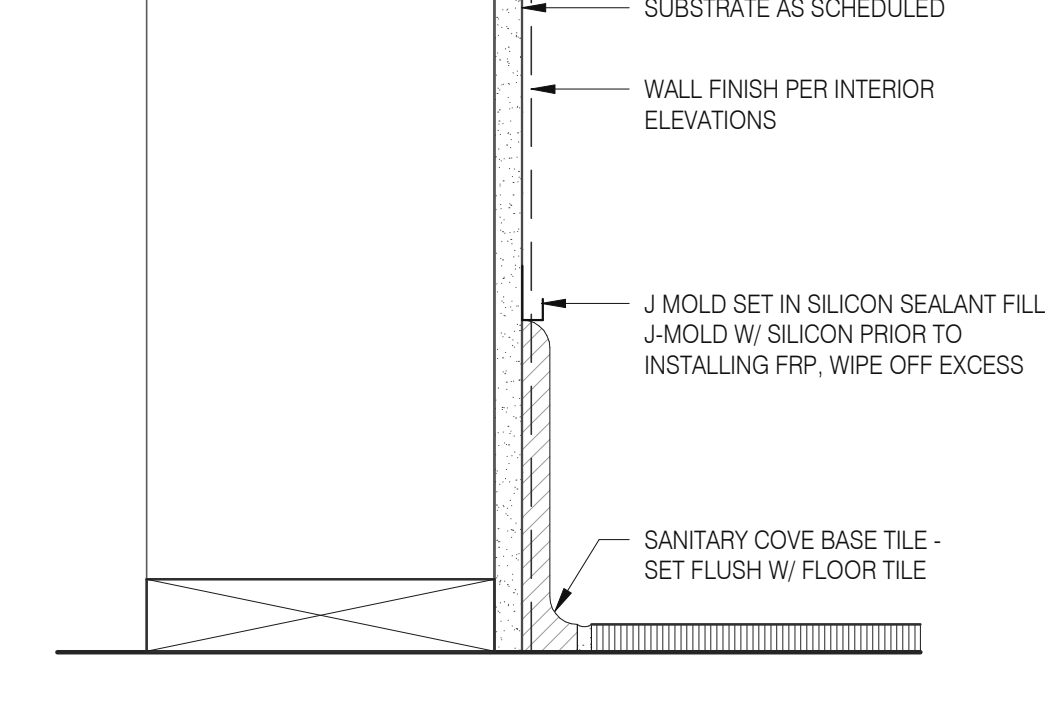

Base @ Dining Room Int. Wall 3" = 1'-0" **4**

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




**ENDEAVOR 2.0
FINISH DETAILS**


A6.3

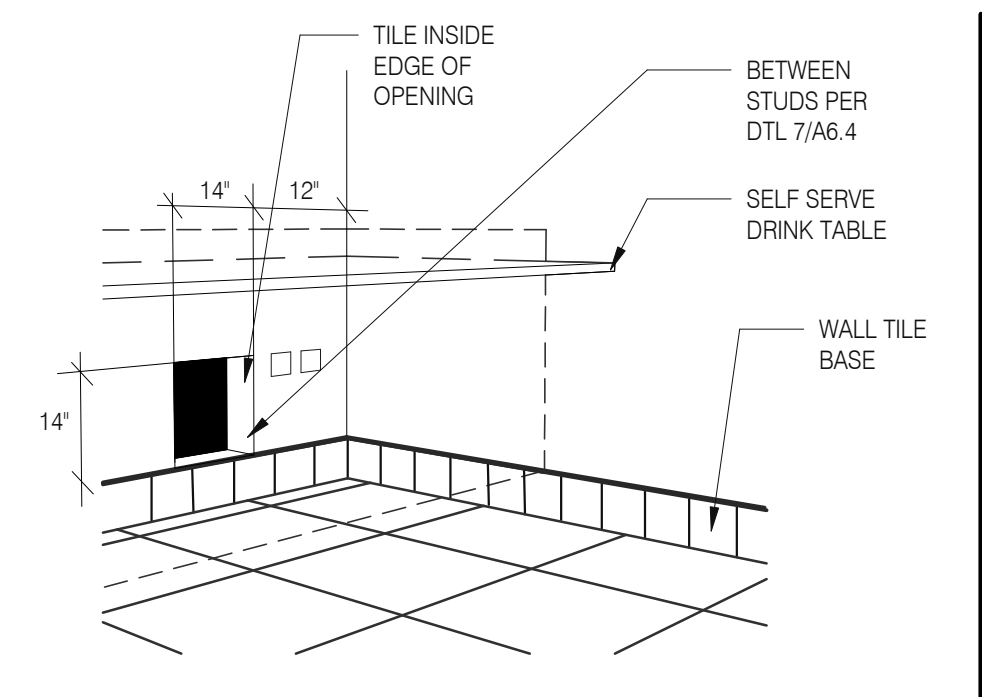


WALL PASS THRU N.T.S. **8**

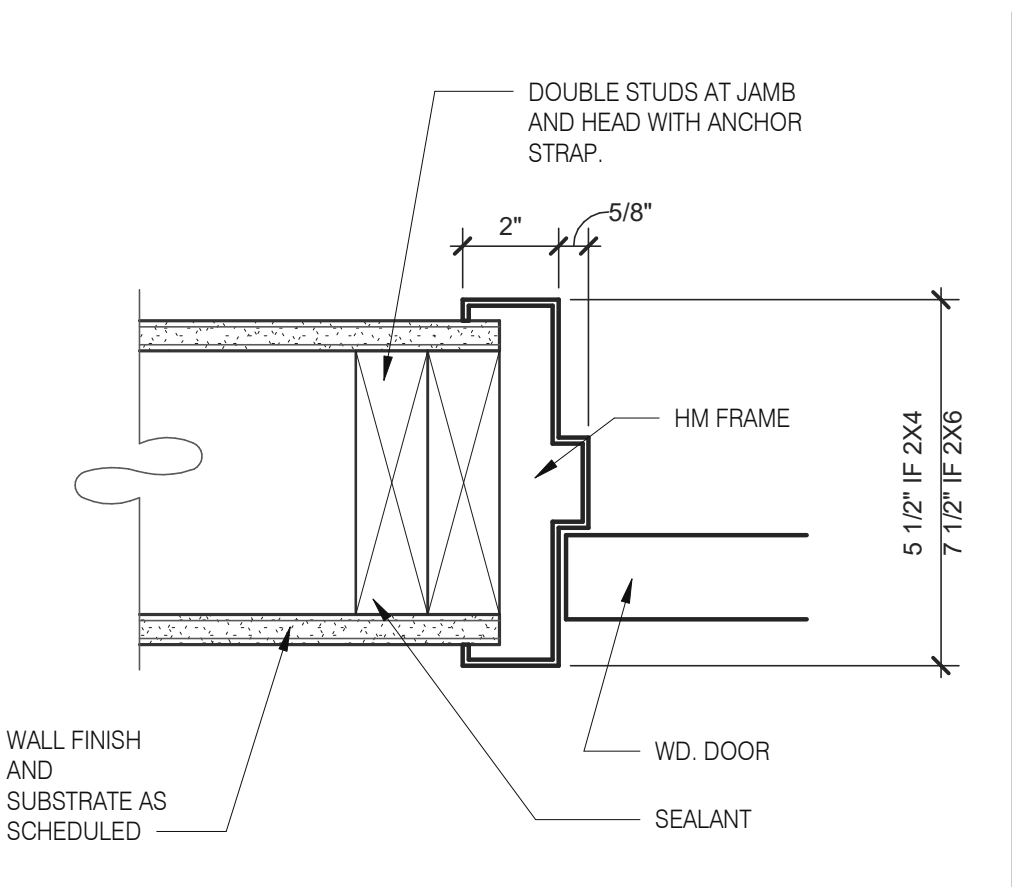


HEAD/JAMB @ H.M. DOOR N.T.S. **6**

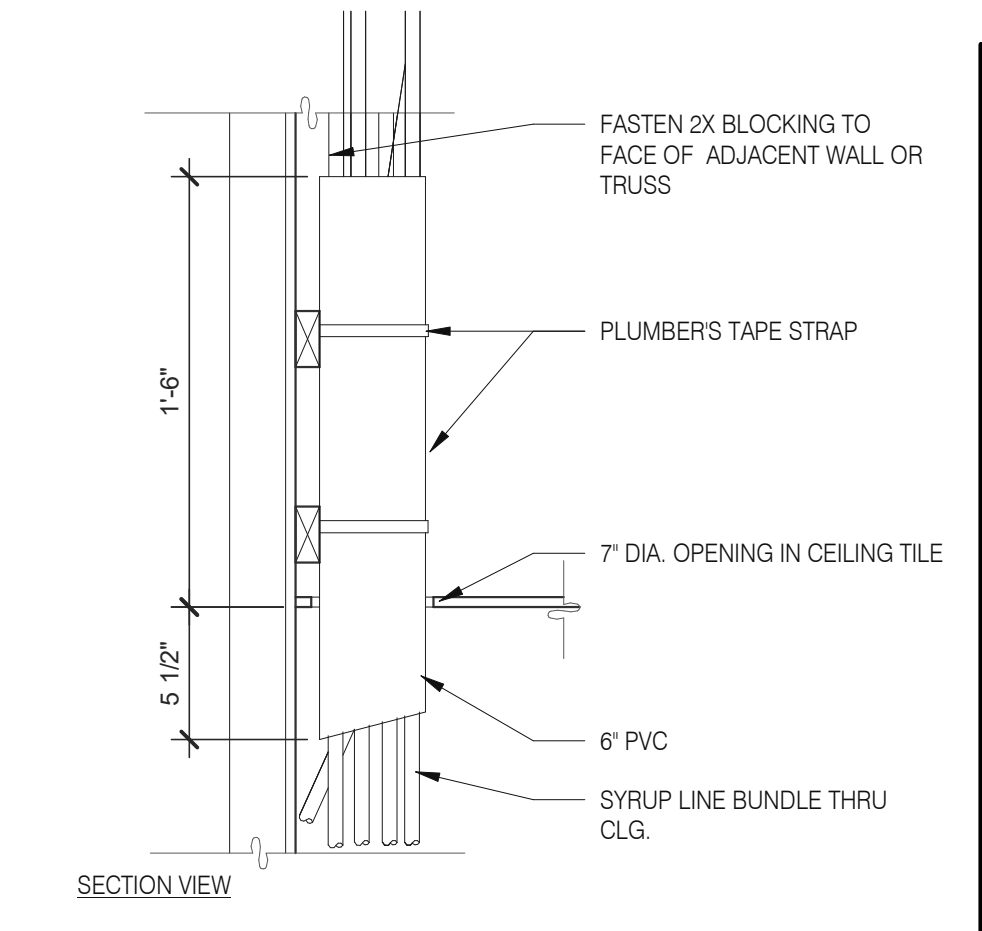

SYRUP BUNDLE CLG. 1 1/2" = 1'-0" **10**

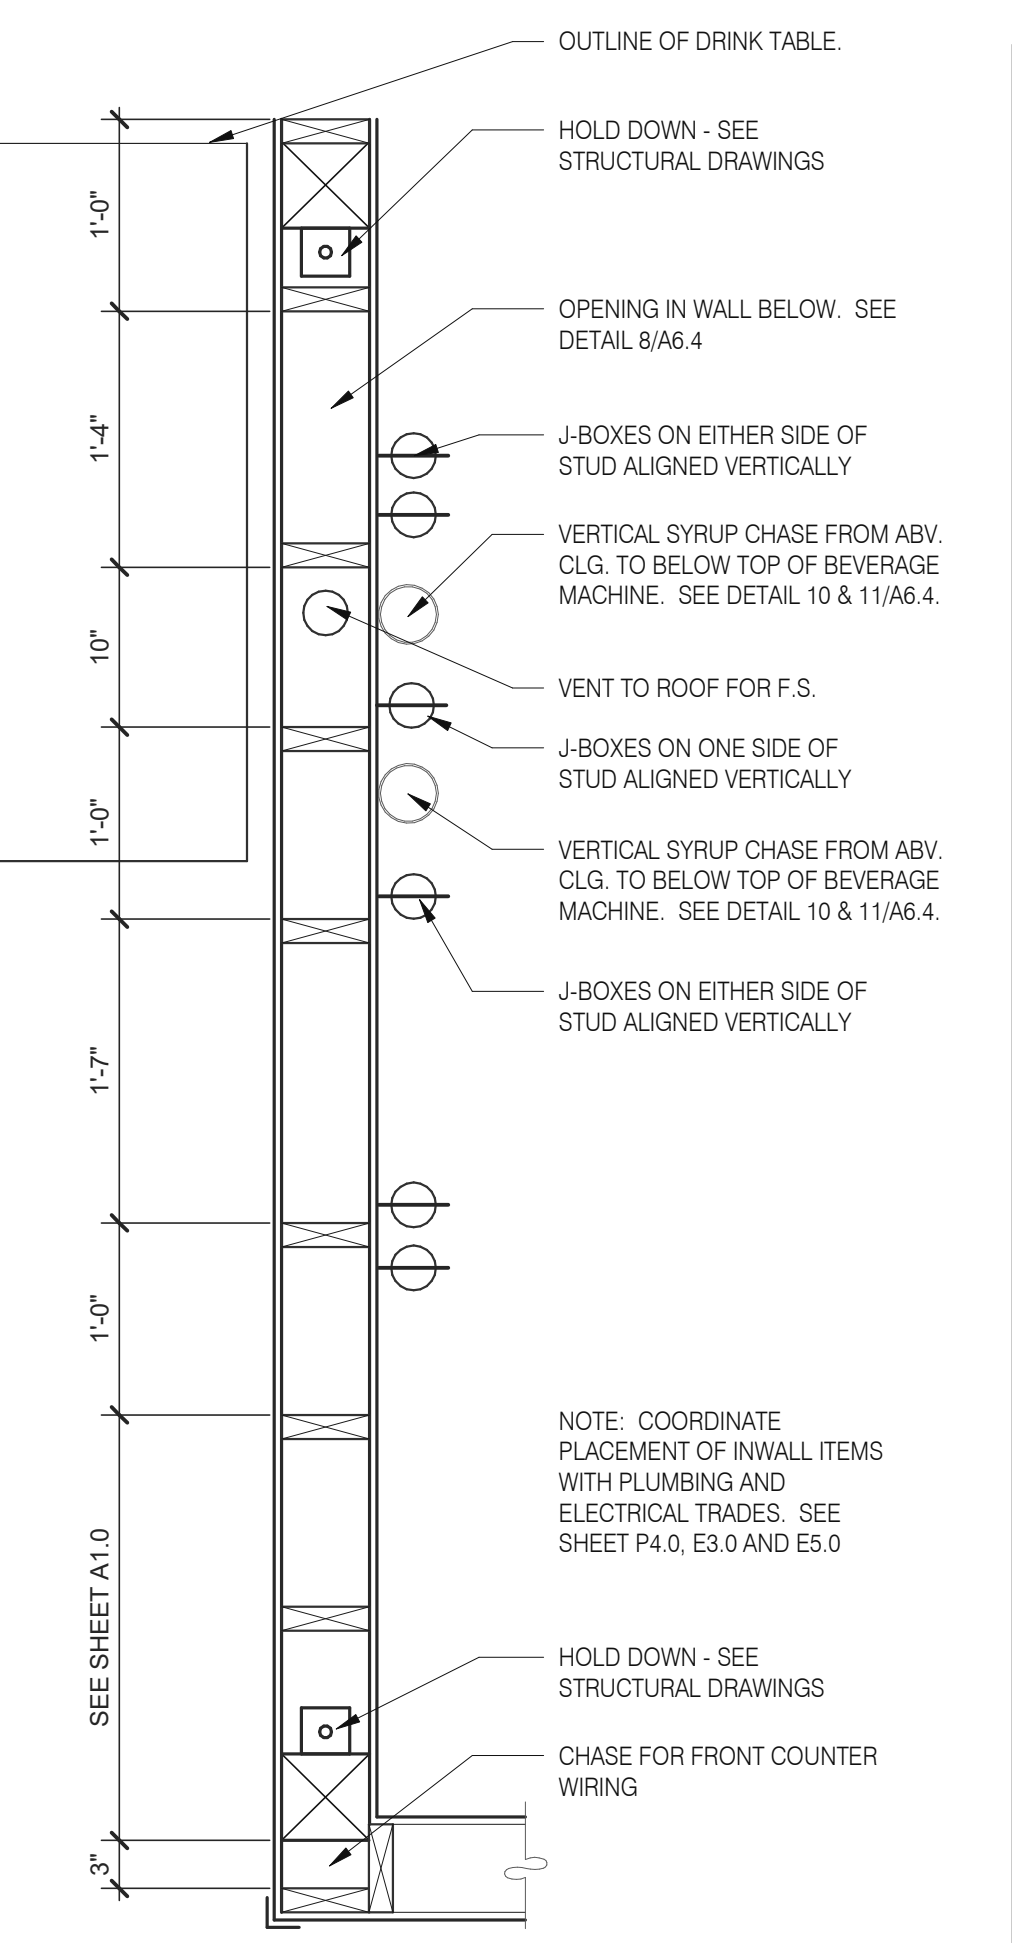

INTERIOR CHASE WALL N.T.S. **7**

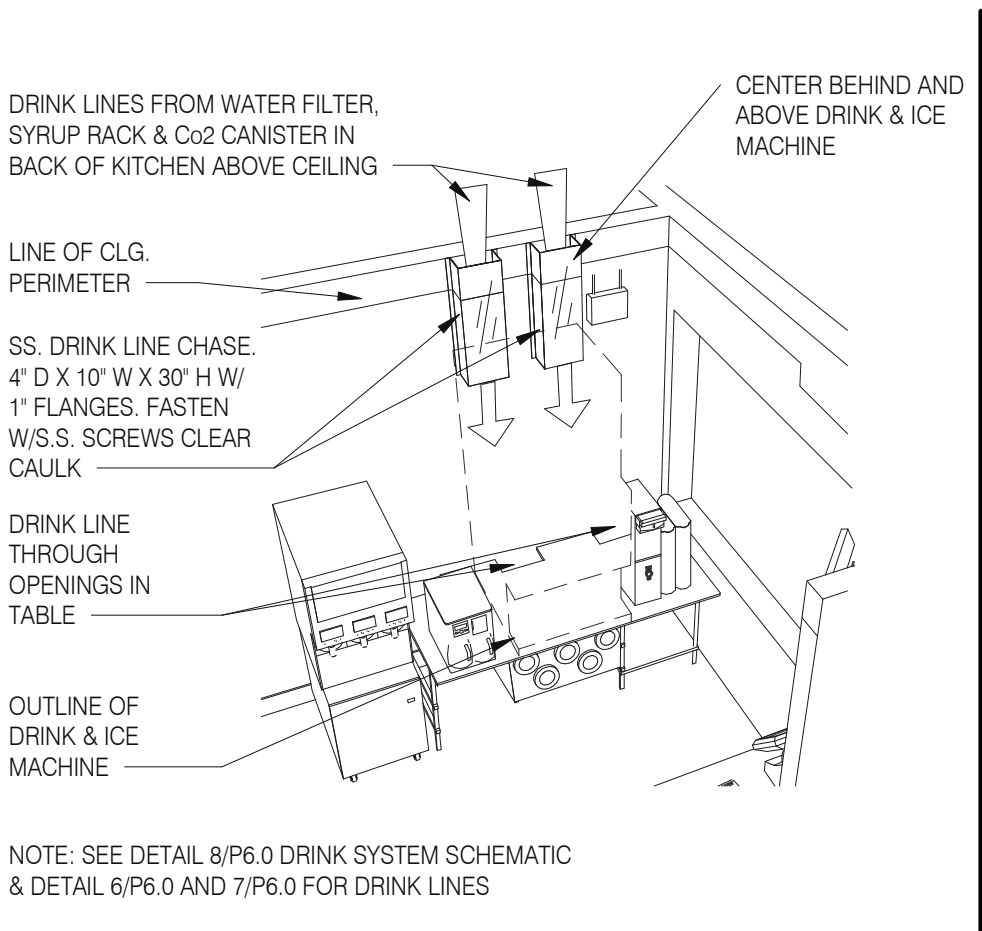

SYRUP CHASE ON WALL 1 1/2" = 1'-0" **11**

DATE	REMARKS
11.07.22	Issued for Construction



CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236



ENDEAVOR 2.0
**CONSTRUCTION
 DETAILS
 INTERIOR**

A6.4

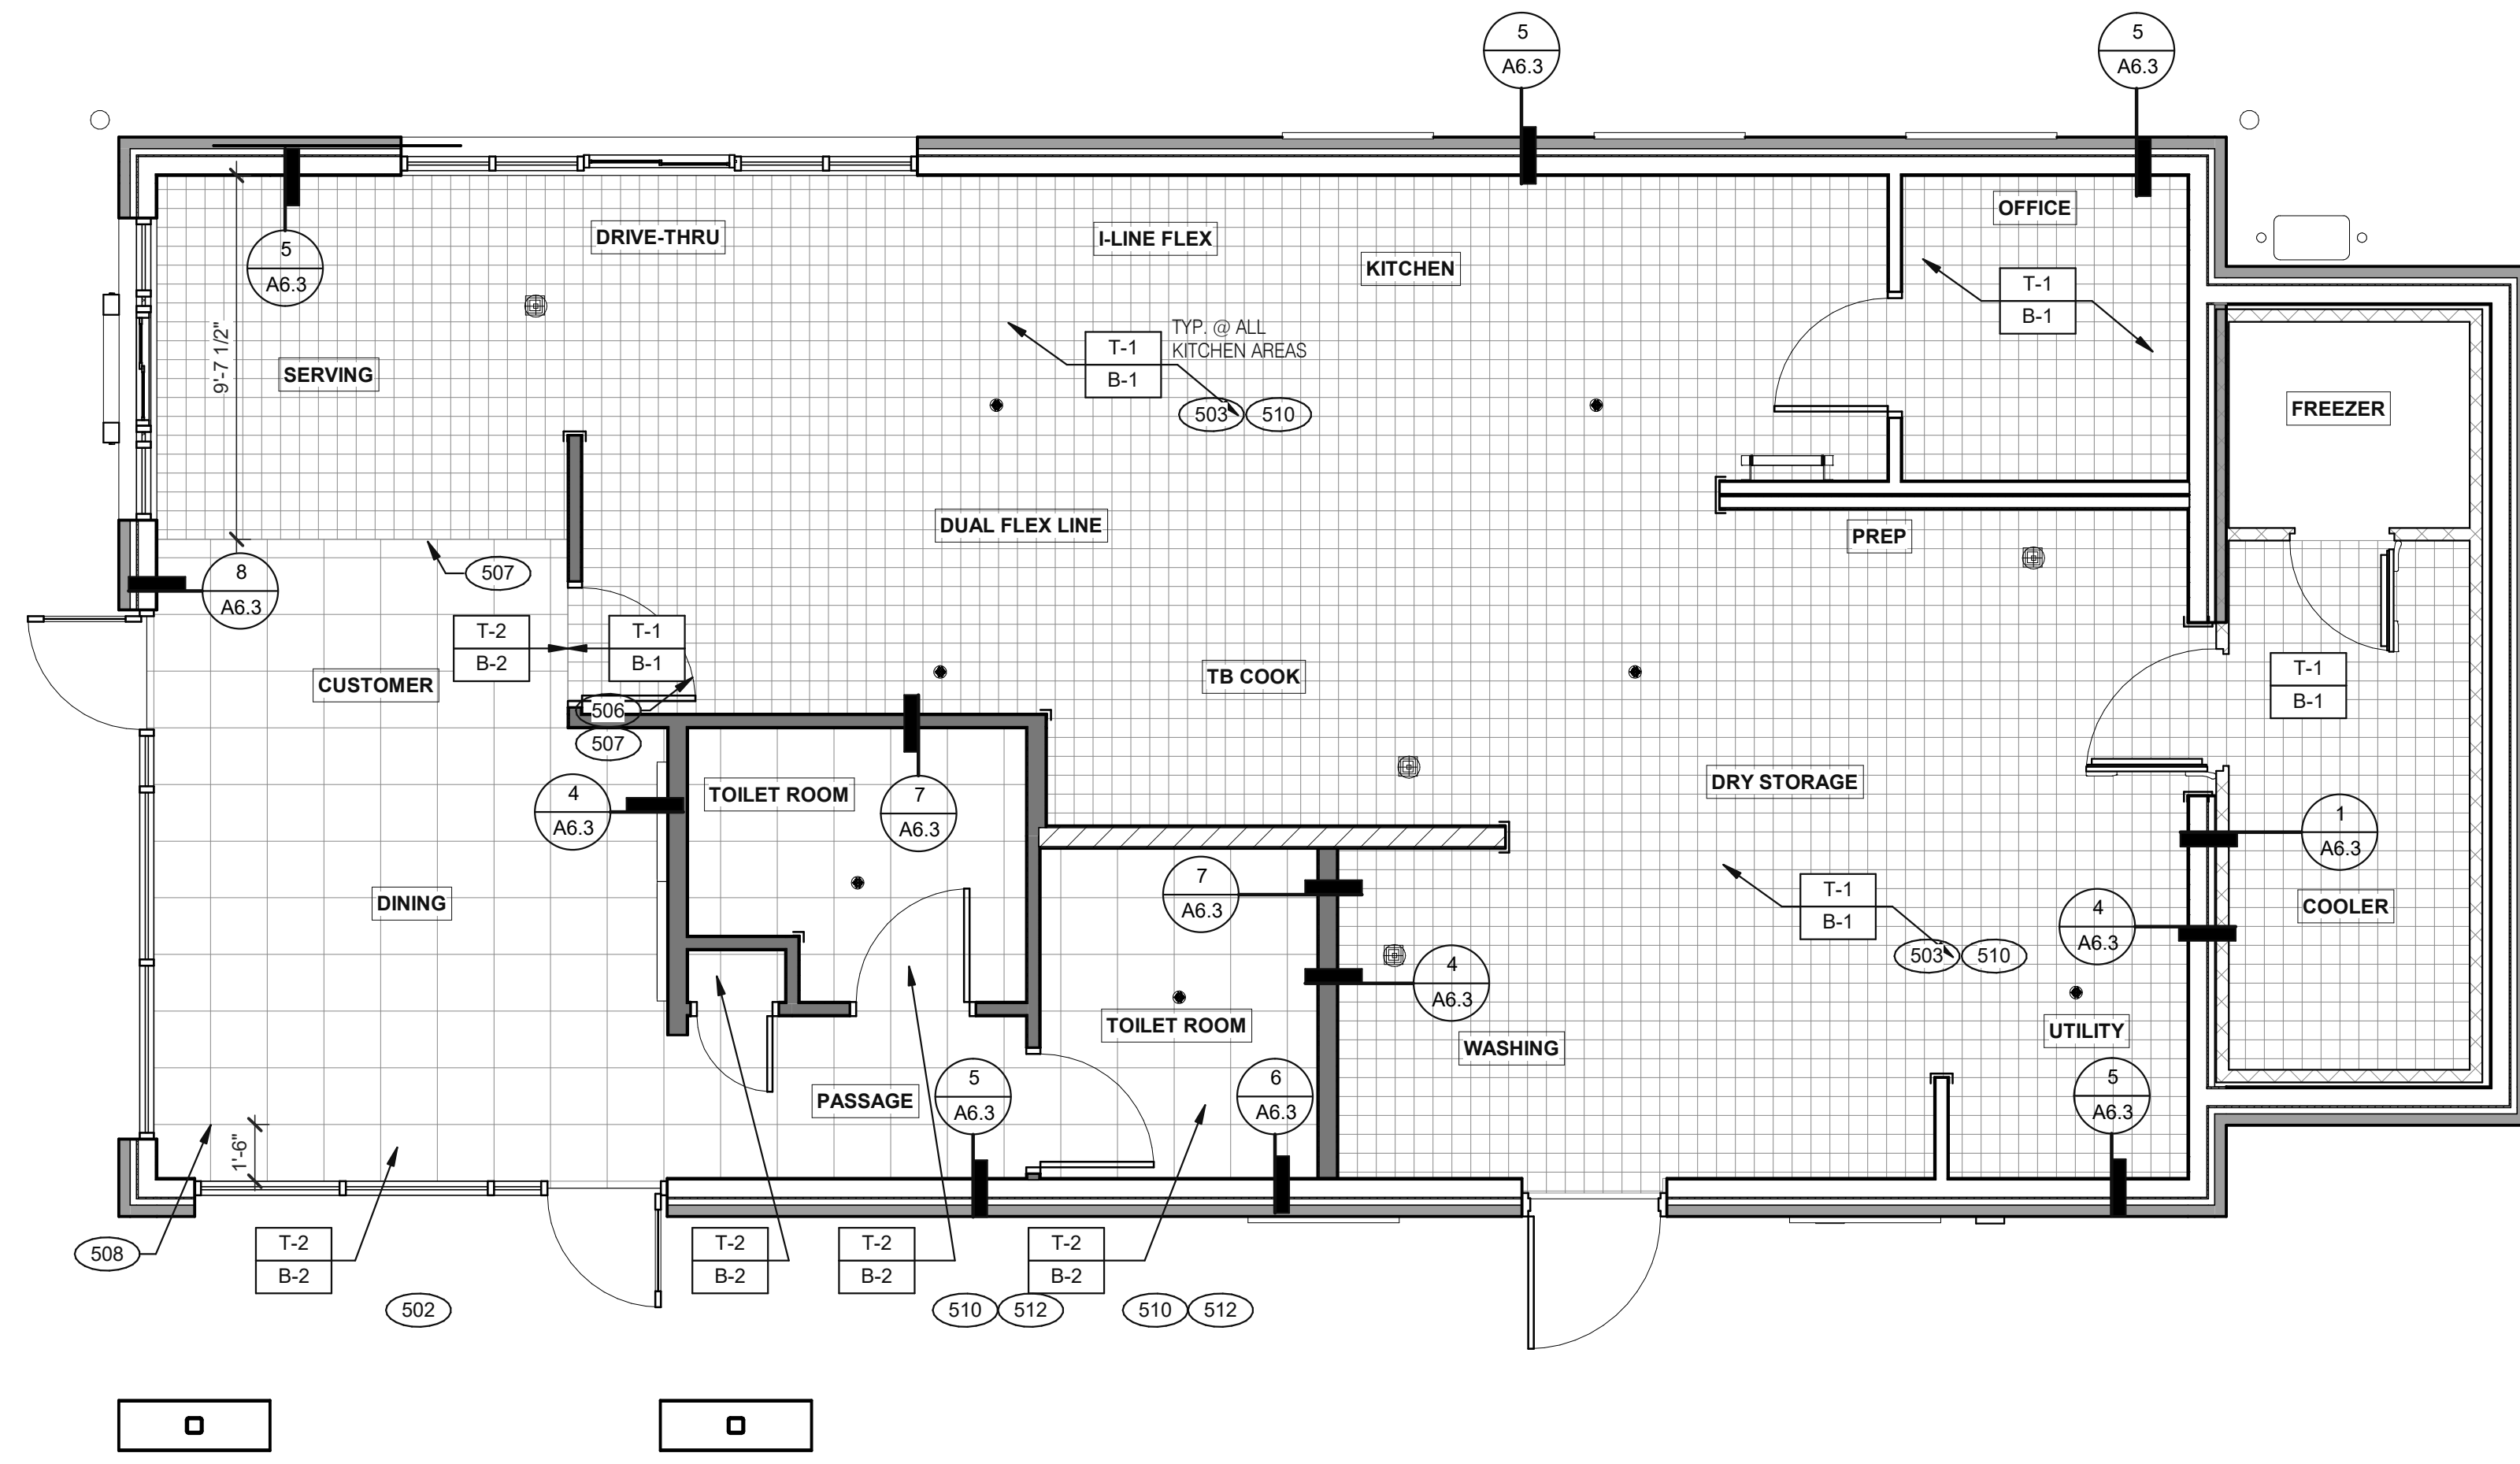

FLOOR FINISH PLAN 1/4" = 1'-0" **A**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03


TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236



**ENDEAVOR 2.0
 FLOOR FINISH
 PLAN**

A7.0

PLOT DATE: 11/3/2022 11:20:13 AM



- A.  DENOTES FINISH MATERIAL. REFER TO SHT A7.2 FOR FINISHES
- B. TILE JOINT (U.O.N.):
 1. QUARRY FLOOR TILE: 1/4"
 2. PORCELAIN FLOOR TILE: 3/16"
 3. GLAZED WALL TILE: 1/8"
 4. BASE, TRIM AND ACCESSORIES: MATCH ADJOINING TILE UNITS
- C. TILE INSTALLATIONS REQUIRE MANUFACTURERS STANDARD MOLDED CORNERS AT BOTH INSIDE AND OUTSIDE CORNERS.
- D. ALL BASE TILE SHALL BE SANITARY COVE STYLE WITH 3/8" MIN RADIUS UNLESS NOTED OTHERWISE.
- E. SEE SCOPE OF WORK SHEETS FOR RESPONSIBILITIES.
- F. PROVIDE CLEAR SILICONE CAULK WHERE FRP STOPS AT TOP OF COVE BASE.
- G. TILE CHIPPING AROUND CORE DRILL HOLES FOR SEATING FIXTURE WILL NOT BE ACCEPTED.

- 502 6" COVE TILE BASE. SEE DETAILS 5 & 8/A6.3.
- 503 6" SANITARY COVE TILE BASE. SEE DETAILS 4, 6/A6.3.
- 506 ALIGN FLOOR TILE TRANSITION WITH FACE OF WALL.
- 507 FLOAT FLOOR TILE FOR FLUSH TRANSITION.
- 508 START POINT FOR FLOOR TILE.
- 510 REFER TO STRUCTURAL DRAWINGS FOR CONCRETE FLOOR SLOPES AROUND FLOOR DRAINS.
- 512 SANITARY TILE BASE IN RESTROOM.

NOT USED **D**

FLOOR FINISH NOTES **C**

KEY NOTES **B**

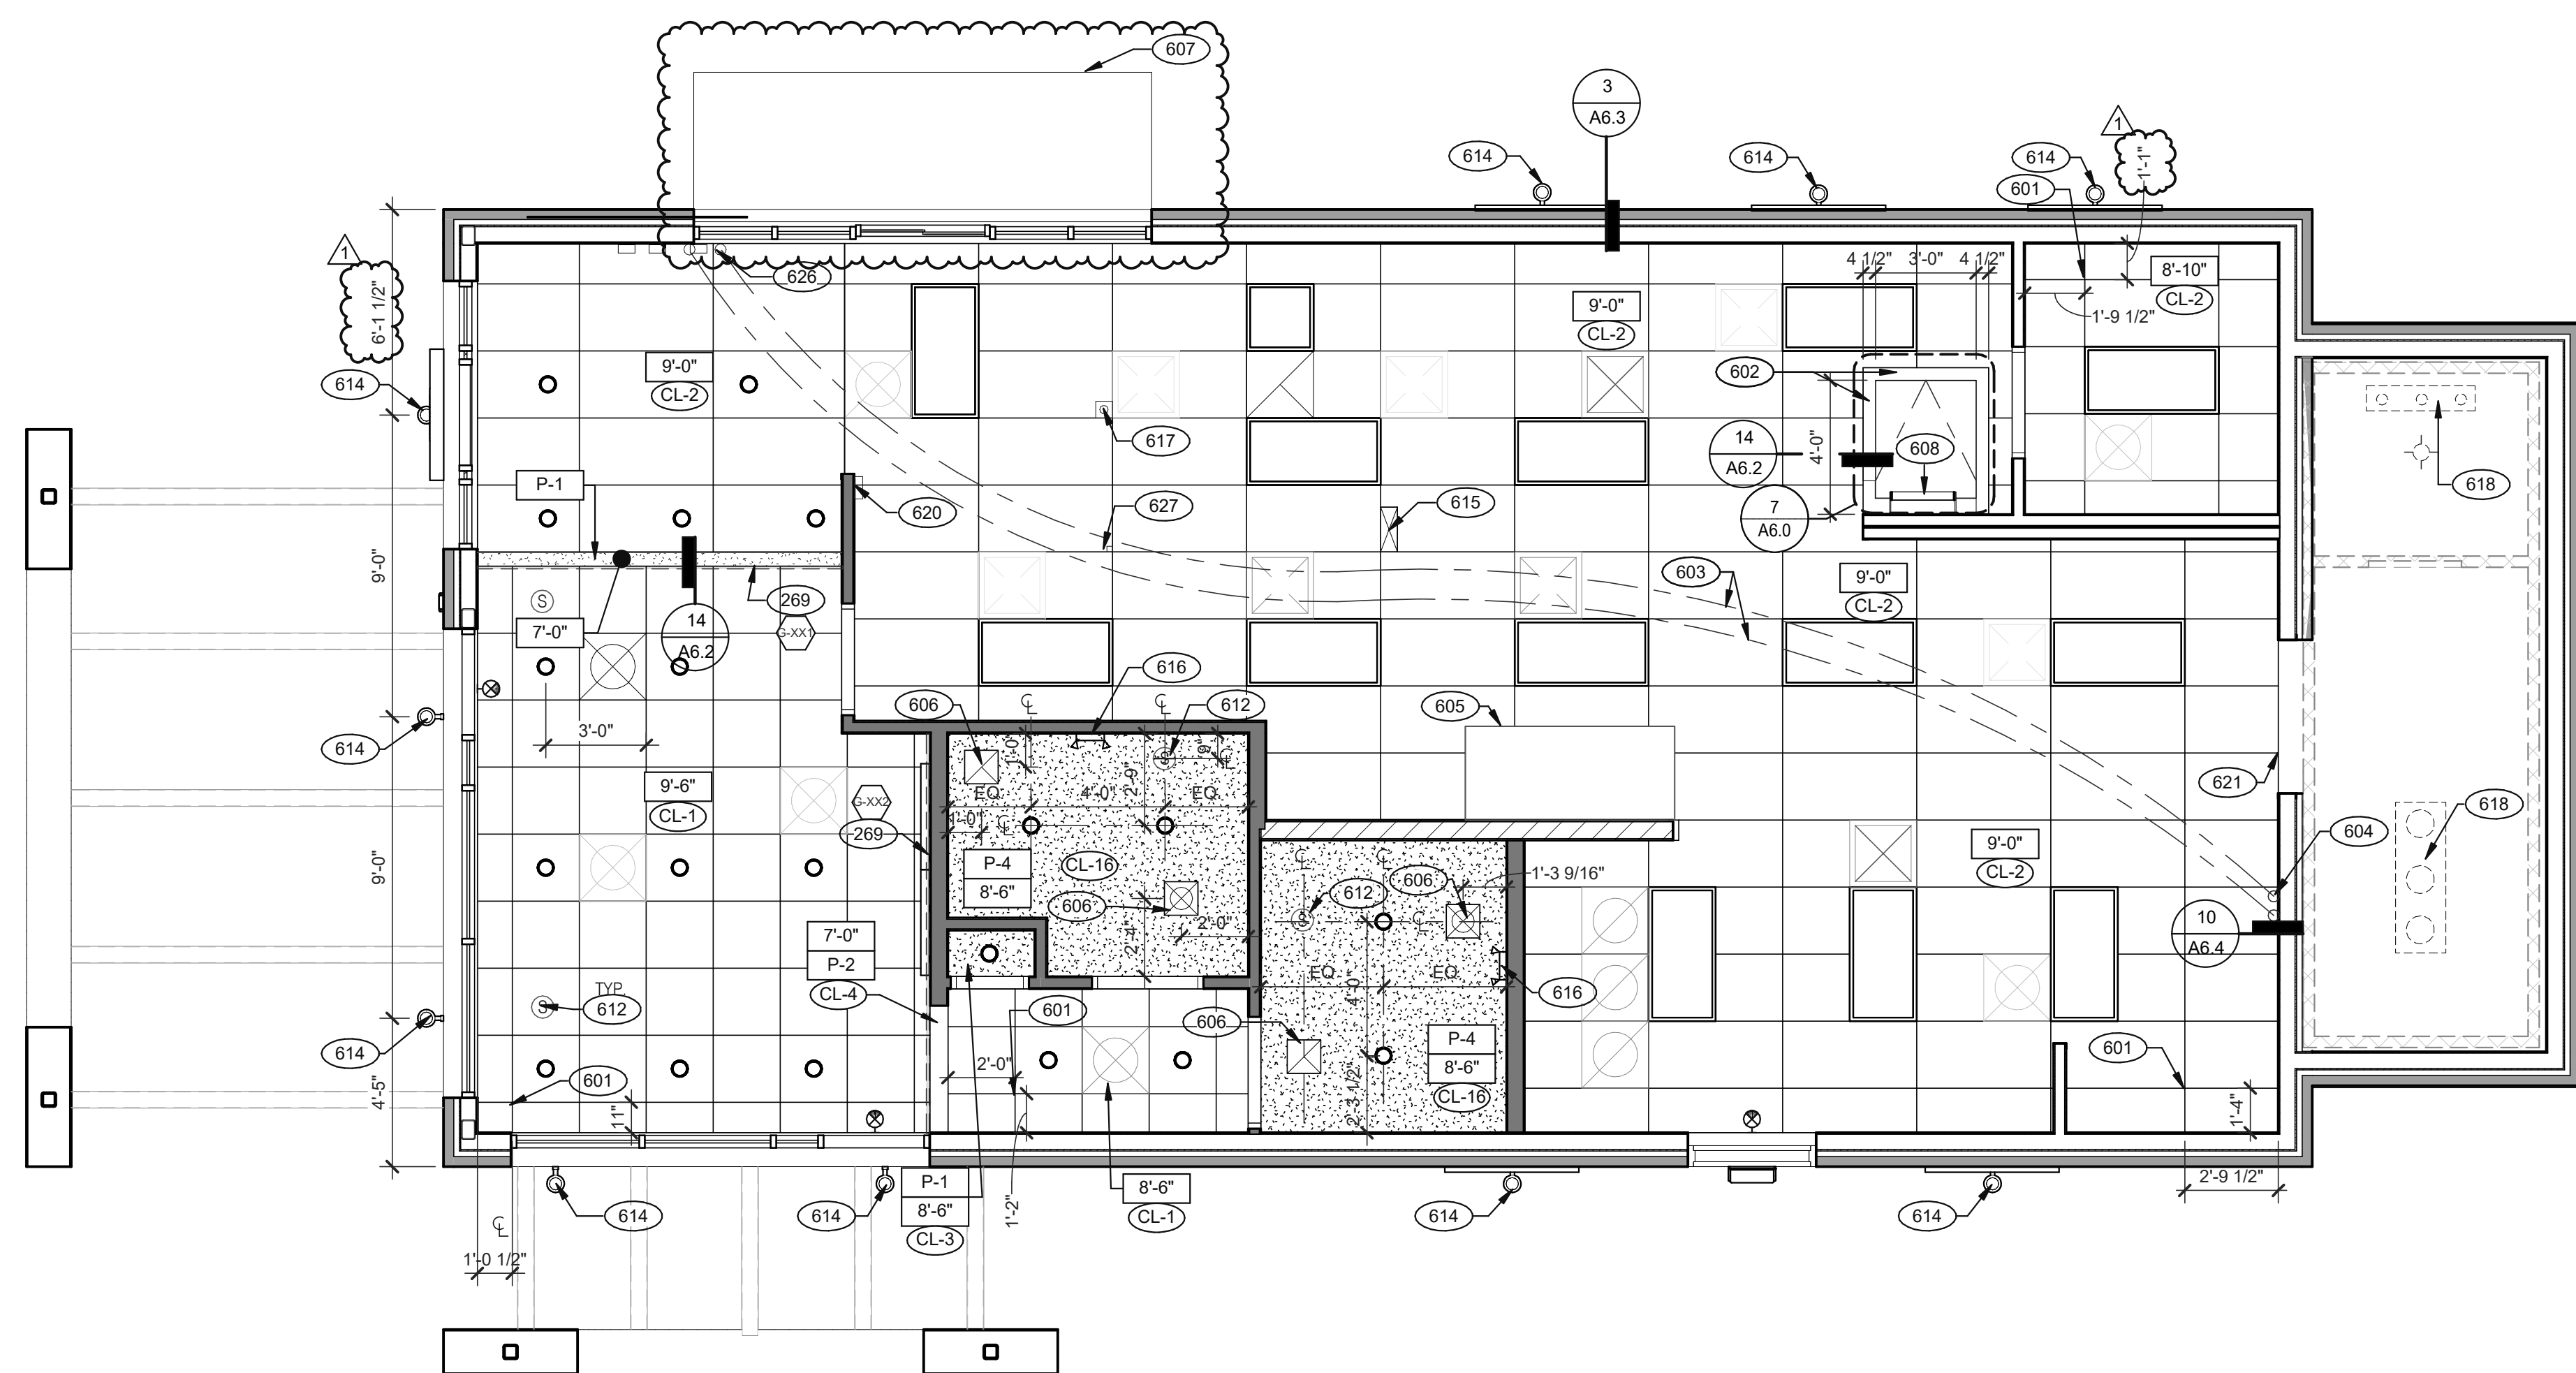

REFLECTED CEILING PLAN 1/4" = 1'-0" **A**

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236



**ENDEAVOR 2.0
 REFLECTED
 CEILING PLAN**

A7.1

PLOT DATE: 11/3/2022 11:20:14 AM

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	1'-0" x 4'-0" LED TROFFER		EXIT LIGHT (WALL MOUNTED)
	2'-0" x 4'-0" LED TROFFER		EXIT LIGHT (CEILING MOUNTED)
	2'-0" x 4'-0" LED LIGHT FIXTURE		EXTERIOR WALL FIXTURE
	DOWNLIGHT @ WALK-IN (BY WALK-IN MFR.)		SPEAKER - CENTER ON CEILING TILE
	PENDANT FIXTURE.		12" EXHAUST FAN
	DOWNLIGHT - CENTER ON CEILING TILE		HVAC RETURN GRILLE
	EMERGENCY LIGHT		HVAC SUPPLY DIFFUSER
			BACK DOOR SECURITY STROBE LIGHT
			OCCUPANCY SENSOR, CEILING MOUNTED

CEILING SYMBOL LEGEND **D**

DIMENSIONS:
 A. ALL DIMENSIONS ARE TO FACE OF FINISH U.O.N.

CEILING FINISHES:
 A. REFER TO ROOM FINISH SCHEDULE (SHT A7.2) FOR CLG. FINISHES.

SUSPENDED CEILING:
 A. ACOUSTICAL PANEL INSTALLATION: INSTALL ACOUSTICAL PANELS WITH EDGES IN CLOSE CONTACT WITH METAL SUPPORTS AND IN TRUE ALIGNMENT.
 B. ALLOWABLE VARIATIONS FROM FLAT AND LEVEL SURFACE: 1/8" IN 10'-0" MAX.
 C. ALLOWABLE VARIATIONS FROM PLUMB OF GRID MEMBERS: AS CAUSED BY ECCENTRIC LOADS, 2" MAX.
 D. INSTALL SYSTEM AFTER MAJOR ABOVE CLG. WORK IS COMPLETE. COORD LOCATIONS OF HANGERS WITH RELATED WORK.
 E. SEE SPECS FOR ADDITIONAL INFORMATION.

GYPSUM BOARD CEILING:
 A. SUBSTRATE SHALL BE 1/2" THICK GYP. BD.
 B. ACOUSTICAL SEALANT: APPLY TO GYP. BD. PANELS AS INDICATED IN SPECS.
 GYP. BD. FINISHING AND DECORATING: REFER TO DWGS FOR TEXTURE AND FINISHES.

ELECTRICAL:
 A. SEE ELECT. DWGS. FOR FIXTURE SCHED.

REFLECTED CEILING PLAN NOTES **C**

269 SEE INTERIOR ELEVATIONS FOR ARTWORK PLACEMENT.
 601 CEILING GRID AT STARTING POINT.
 602 BULKHEAD @ 8'-0" A.F.F.
 603 NON-INSULATED BUNDLED SYRUP LINES FOR DRINK SYSTEM. SEE SCOPE OF WORK.
 604 6" DIAMETER PVC STUB THROUGH CEILING, SEE DETAIL 10/A6.4.
 605 HOOD, SEE MECHANICAL DRAWINGS.
 606 FOR ROUGH FRAMING OPENINGS SEE AIR DEVICE SCHEDULE (TYP. ALL RESTROOMS).
 607 DRIVE-THRU CANOPY.
 608 ROOF HATCH.
 612 SPEAKER. CENTER ON CEILING TILE, UON.
 614 EXTERIOR WALL LIGHT FIXTURES, SEE ELEVATIONS AND ELECTRICAL DRAWINGS.
 615 UTILITY CHASE BY 3RD PARTY VENDOR TO CEILING.
 616 EMERGENCY DUAL HEAD FIXTURE. SEE ELECTRICAL DRAWINGS.
 617 SECURITY STROBE LIGHT, REFER TO ELECTRICAL DRAWINGS.
 618 FAN COIL FOR WALK-IN.
 620 ALERT LIGHT BOX FOR 3-COMP POWER SOAK MOUNTED AT CENTERLINE OF BOX 7'-11" A.F.F.
 621 30"x30" ACCESS OPENING IN REAR WALL ABOVE CEILING. FINISH WITH GYP. BD.
 626 STAINLESS STEEL SYRUP CHASE ON WALL. SEE DETAIL 11/A6.4.
 627 WATER INLET CHASE FOR CHEESE MELTER SCREWED TO HEATED AIR SCREEN.

KEY NOTES **B**



FINISH LEGEND						
SYMBOL	MANUFACTURER	STYLE	COLOR	SIZE	GROUT	COMMENTS
CEILING						
CL-1	USG	ACT SYSTEM, ARMSTRONG, TECTUM LAY-IN, SQUARE EDGE	#TBD	2X2	N/A	USG DONN BRAND DX/DXL 15/16 TEE SYSTEM, INTERMEDIATE DUTY #107 TAUPE
CL-2	USG	ACT SYSTEM, USG CLEAN ROOM ACOUSTICAL PANELS, CLIMAPLUS PERFORMANCE, SQ EDGE	#050 WHITE	2x4	N/A	CLASS 100 (ISO 5) PANELS, USG DONN BRAND DX/DXL 15/16 TEE SYSTEM, INTERMEDIATE DUTY #050 WHITE
CL-3	USG	ACT SYSTEM, USG CLEAN ROOM ACOUSTICAL PANELS, CLIMAPLUS PERFORMANCE, SQ EDGE	#050 WHITE	2X2	N/A	CLASS 100 (ISO 5) PANELS, USG DONN BRAND DX/DXL 15/16 TEE SYSTEM, INTERMEDIATE DUTY #050 WHITE
CL-4	USG	USG COMPASSO STANDARD	#002 SILVER SATIN	10"H PROFILE		SEE PLANS AND DETAILS FOR MORE INFO
CL-16	N/A	GYPSUM BOARD	PAINTED PER RCP			
CHAIR RAIL						
CR-1	SW	SW6990	CAVIAR	3 1/2" X 3/4"		SEMI-GLOSS
FLOOR BASE						
B-1	CMC	QUARRY	PURITAN GREY #507	6X6	MAPEI #9 GRAY, 1/8" JOINT WIDTH	KERAPOXY GROUT IEG CO 3/8" SANITARY COVE
B-2	CMC	MOTIF GREY - PORCELAIN	GREY	6X12	MAPEI #2 PEWTER, 1/8" JOINT WIDTH	3/8" SANITARY COVE
FLOORING						
T-1	CMC	QUARRY	PURITAN GREY #507	6X6	MAPEI #9 GRAY, 1/8" JOINT WIDTH	KERAPOXY GROUT IEG CO
T-2	CMC	MOTIF GREY - PORCELAIN	GREY	18X18	MAPEI #2 PEWTER, 1/8" JOINT WIDTH	
FRP/LAMINATE						
FRP-1	MARLITE	SMOOTH SURFACE	S100 S/2/S WHITE	4' X 9' X .90		COORDINATE ALL TRIM PIECES WITH FRP MFG
L-1	WILSONART	4783K FINISH 7	WHITE TIGRIS			OFFICE SHELVING LAMINATE
L-2	WILSONART	BLACK 1595-60	BLACK (W/ AEON FIN.)			FOR RR & UTILITY DOORS, REFER TO SCHEDULE
CORNER GUARDS						
CG-1	C.S GROUP	ACROVYN VA SERIES	VA-034N #934 PEARL	3/4" X 3/4"		FOR PAINT MATCH P-1
CG-2	C.S GROUP	ACROVYN VA SERIES	VA-034N #262 DRIFTWOOD	3/4" X 3/4"		FOR PAINT MATCH CR-1 & WC-1
METAL TRANSITION						
MT-1	SCHLUTER	JOLLY	A 100 AT - SATIN NICKEL ANODIZED ALUMINUM	3/8"	N/A	TILE EDGE TRIM DETAIL 17/A6.3
MT-3	SCHLUTER	RONDEC - ALUMINUM		3/8"	N/A	TILE EDGE TRIM DETAIL 17/A6.3
SOLID SURFACE						
SS-1	CORIAN	LAVA ROCK	LAVA ROCK			COUNTERTOPS/24" DIAMETER TABLE TOP
WALL COVERING						
WC-1	WOLF GORDON	RAMPART HIGH IMPACT WALL COVERING	FOUNDATION/ PIGMENT (GOH 12172606)		RAILROAD INSTALLATION: THERE SHOULD BE NO SEAMS ALONG WALLS	1 ROLL: 80 L.F.
WALL PAINT						
P-1	SHERWIN WILLIAMS	SW7004	SNOW BOUND	N/A	N/A	PAINT FINISH: WALLS: EGG SHELL TRIM/BOH: SEMI-GLOSS (CHAIR RAIL) CEILING: FLAT
P-2	SHERWIN WILLIAMS	TB2603C	PURPLE	N/A	N/A	
P-3	SHERWIN WILLIAMS	SW6990	CAVIAR	N/A	N/A	
P-4	SHERWIN WILLIAMS	SW7005	PURE WHITE	N/A	N/A	
WALL TILE						
W-1	CMC	FORM - PORCELAIN	ICE DECO MIX	8X8	MAPEI #47 CHARCOAL, 1/8" JOINT WIDTH	RESTROOM ACCENT WALL TILE
W-2	CMC	FORM - PORCELAIN	ICE	8X8	MAPEI #47 CHARCOAL, 1/8" JOINT WIDTH	RESTROOM WALL TILE
W-3	CMC	SALVAGEWOOD - PORCELAIN	WHITEWASH	3X36	MAPEI #01 ALABASTER, 1/8" JOINT WIDTH	RUNNING BOND INSTALLATION OFFSET 25%

NOT USED **A**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236



**ENDEAVOR 2.0
 FINISH
 SCHEDULE**

A7.2

PLOT DATE: 11/3/2022 11:20:15 AM

FINISH LEGEND **D**

WESTERN STATES METAL ROOFING
 CAMERON BERG
 INSIDE SALES REPRESENTATIVE
 P: (602) 245-8323
 W: www.metalroofing.com
 CAMERON@WESTERNSTATESMETALROOFING.COM

CREATIVE MATERIALS CORP.
 ALLISON PICHE
 CLIENT SERVICES SUPERVISOR
 ONE WASHINGTON SQUARE, ALBANY, NY 12205
 P: (518) 452-9694
 D: (518) 713-5395
 APICHE@CREATIVEMATERIALSCORP.COM

USG CORPORATION
 TRAVIS TOMANEK
 CORPORATE ACCOUNT MANAGER
 (440) 541-3972
 TTOMANEK@USG.COM

MAPEI
 LISA FYKE
 ARCHITECTURAL REPRESENTATIVE
 MAPEI CORP.
 (909) 247-5324
 LFYKE@MAPEI.COM

CORIAN
 DAVID GREENING
 NA COMMERCIAL SALES
 FOOD SERVICE/ RETAIL SEGMENT SALES LEADER
 CORIAN DESIGN
 P: (614) 975-6700
 DAVID.P.GREENING@DUPONT.COM

SHERWIN WILLIAMS
 SUNNY PATEL
 NATIONAL ACCOUNT EXECUTIVE
 2100 W. ORANGEWOOD AVE. SUITE 100
 ORANGE, CA 92868
 (619) 990-1920
 SUNDEE@SHERWIN.COM


MARLITE
 DAN EGBERS
 REGION SALES MANAGER -
 SPECIFICATIONS MARLITE, INC.
 P: (800) 377-1221
 M: (330) 260-7633
 1 MARLITE DRIVE, DOVER, OH 44622
 www.marlite.com
 degbers@marlite.com

JAMES HARDIE
 MIKE MAZURK
 MULTI-FAMILY & COMMERCIAL SALES
 P: (470) 589-0540
 MICHEAL.MAZURK@JAMESHARDIE.COM


WOLF GORDON
 ANNE KONIE
 ACCOUNT EXECUTIVE
 P: (800) 347-0550
 M: (949) 520-0619
 ANNE.KONIE@WOLFGORDON.COM

FINISH CONTACTS N.T.S. **C**

NOT USED **B**

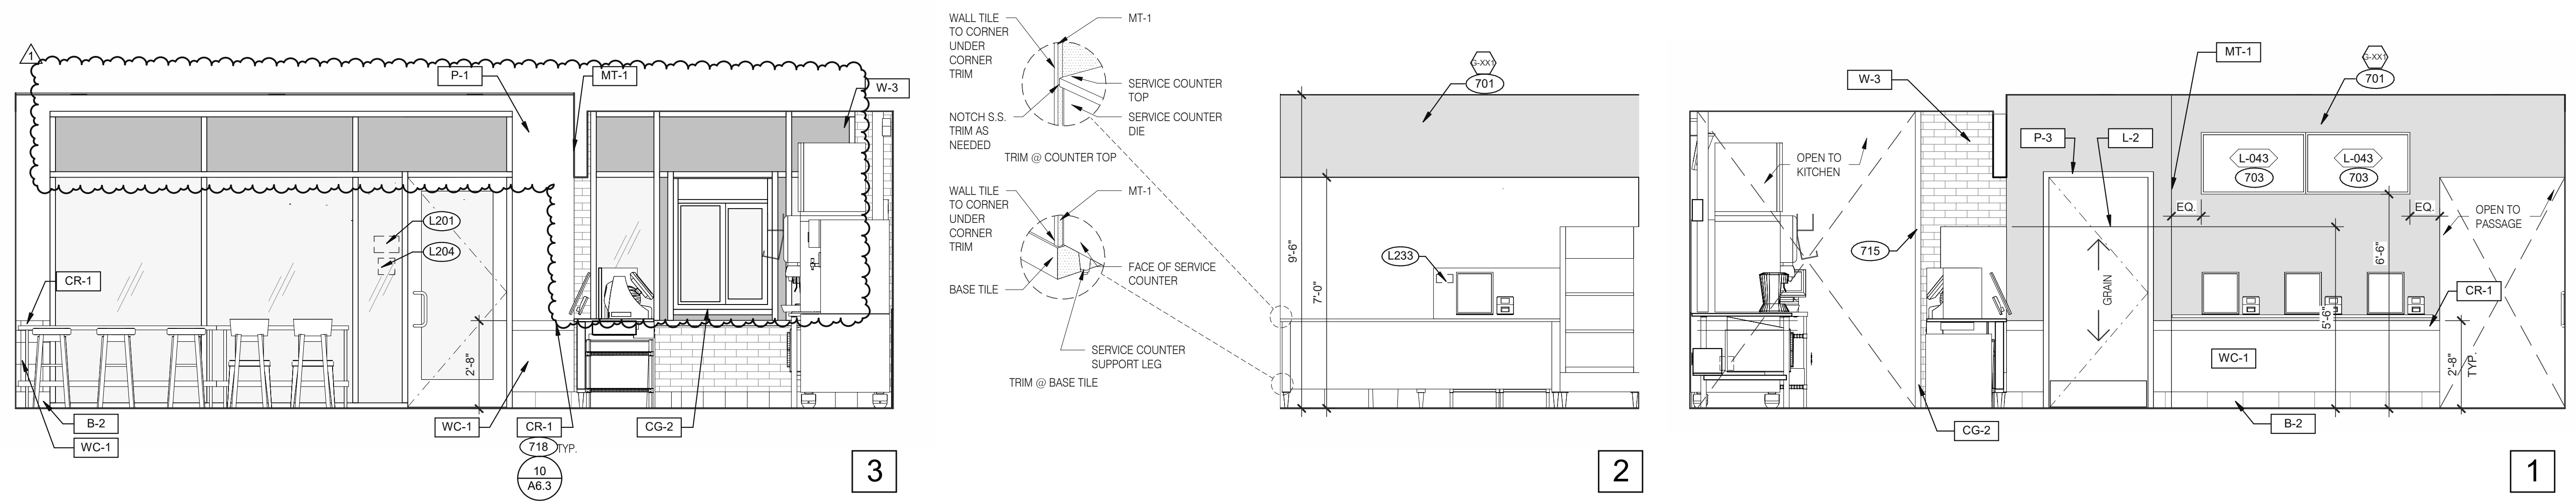

DINING 3/8" = 1'-0"

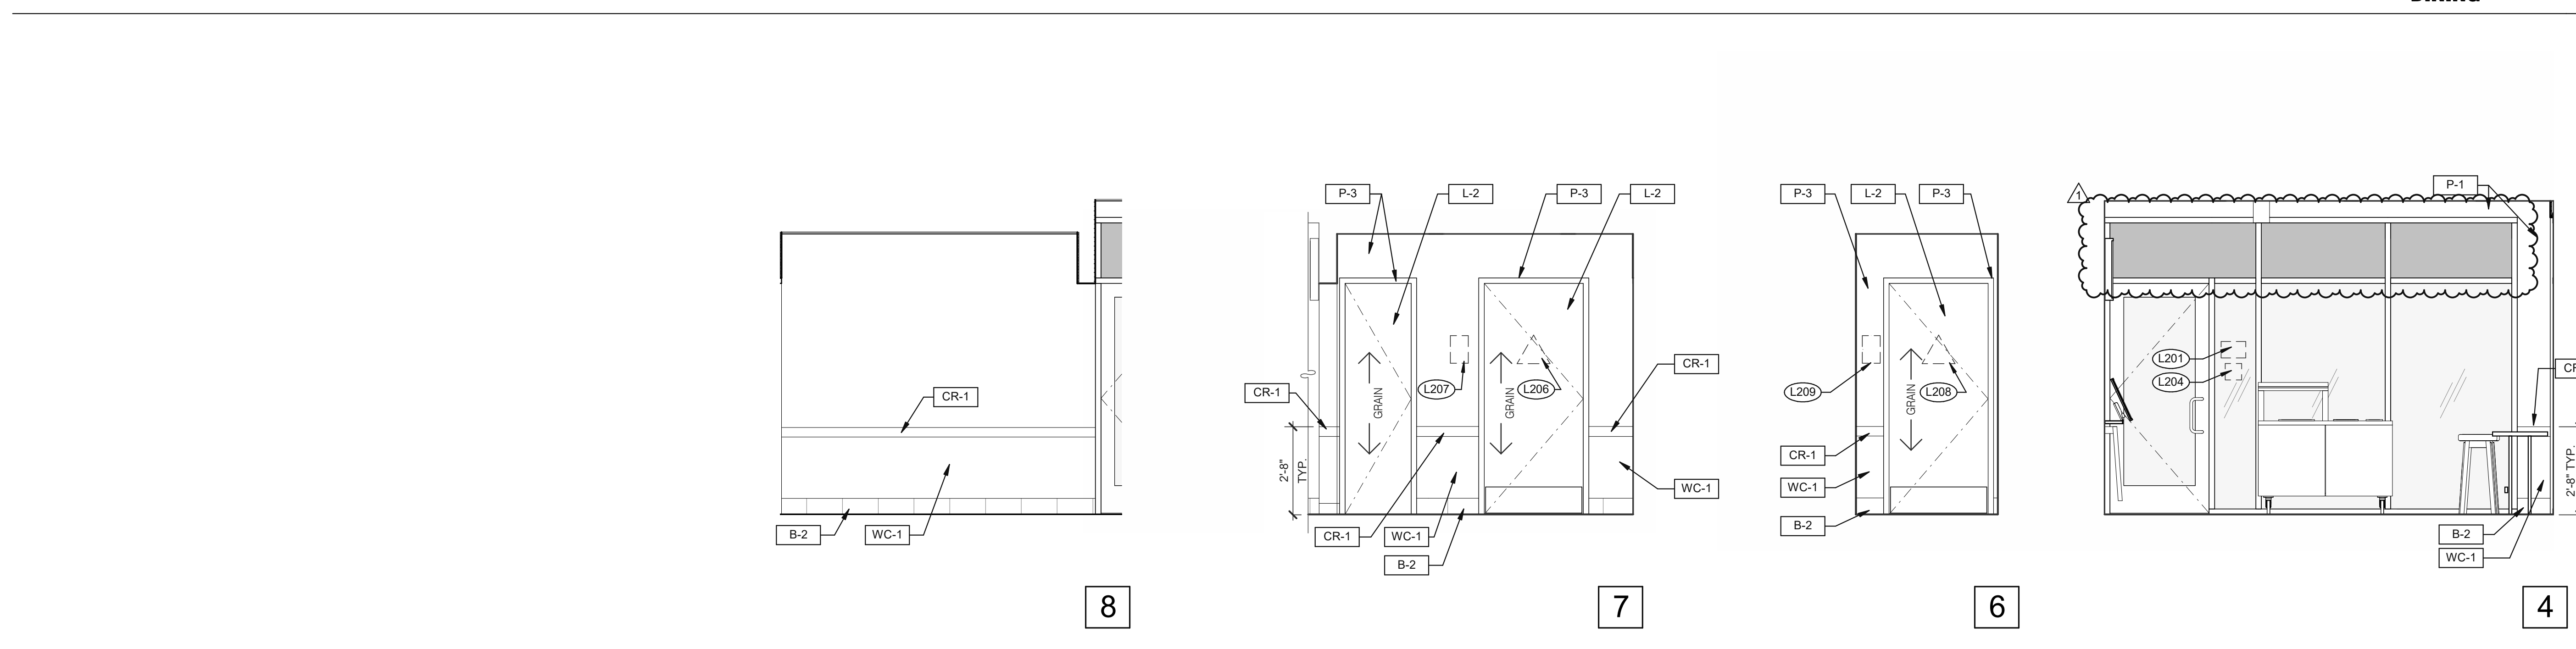

PASSAGE 3/8" = 1'-0"

DINING 3/8" = 1'-0"

- 701 FOR ARTWORK DESCRIPTION, REFER TO ARTWORK SCHEDULE ON SHEET A2.0
- 703 LTO MENUBOARD.
- 715 SS CORNER/END WALL CHANNEL GUARD, FULL HEIGHT. SEE DETAIL 14/A6.3 AND
- 718 CHAIR RAIL.

DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0
INTERIOR
ELEVATIONS
DINING ROOM

A8.0


PLOT DATE: 11/3/2022 11:20:18 AM

KEYNOTES


A

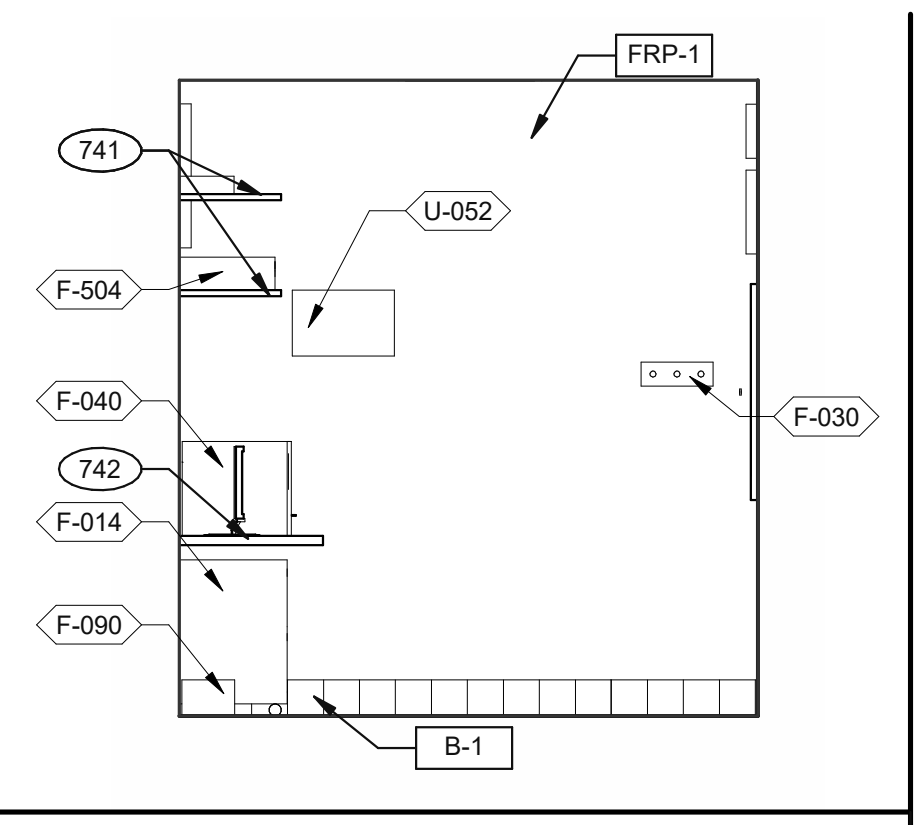


OFFICE ELEVATION 3/8" = 1'-0" **9**

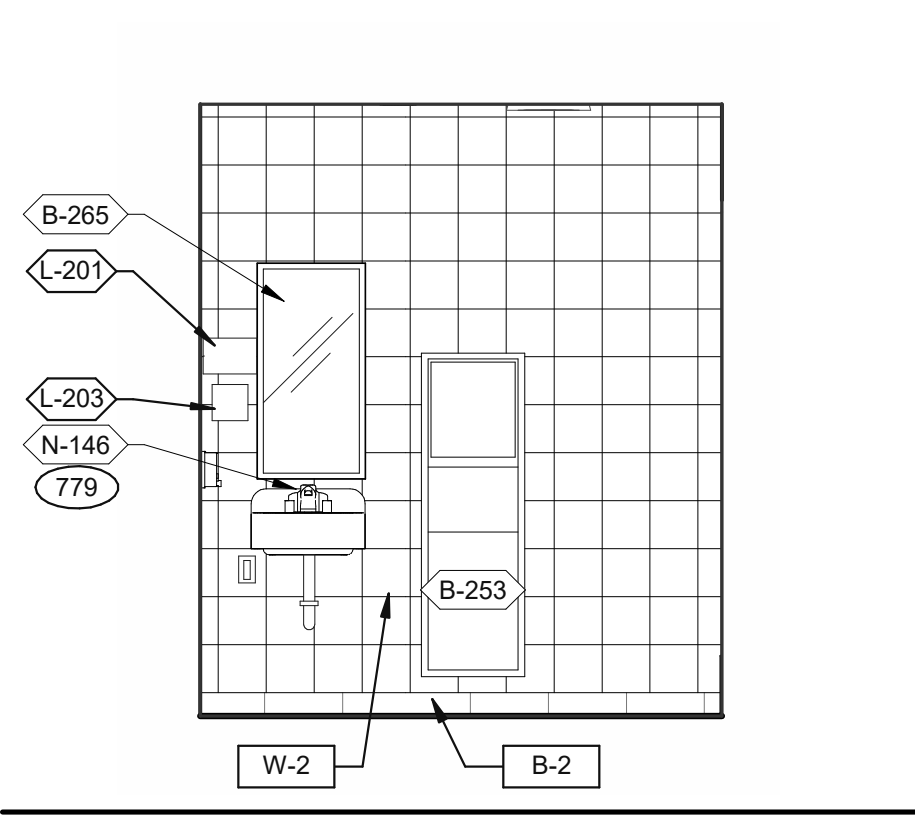

MEN'S RESTROOM 3/8" = 1'-0" **5**

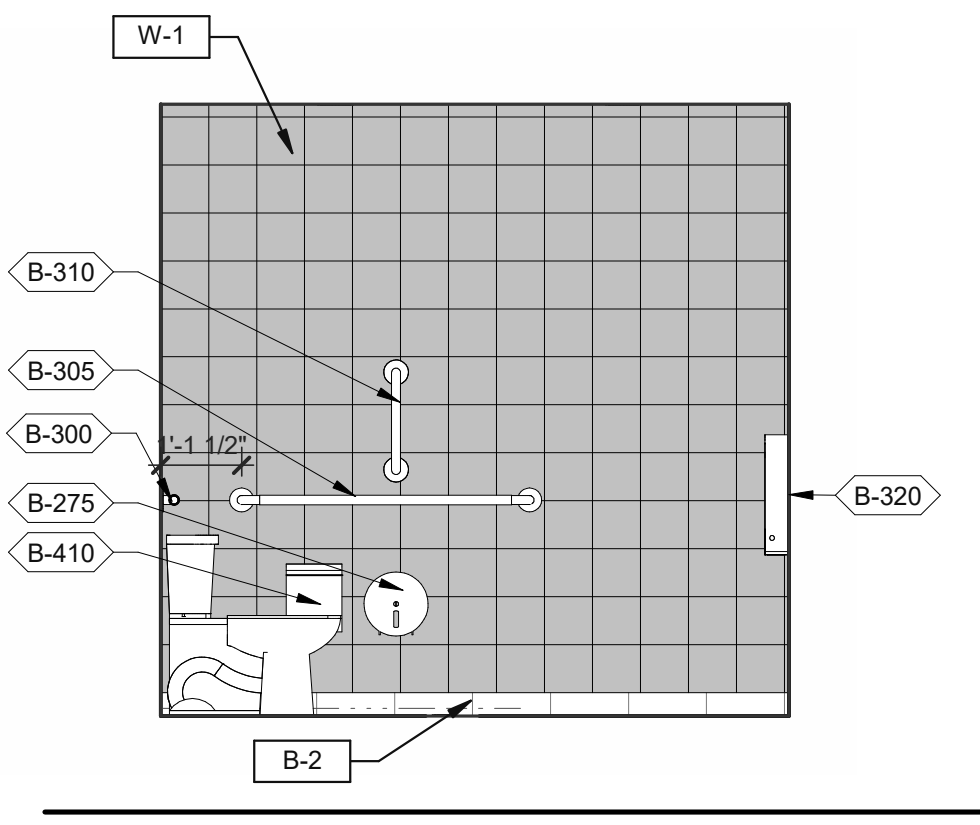


WOMEN'S RESTROOM 3/8" = 1'-0" **1**

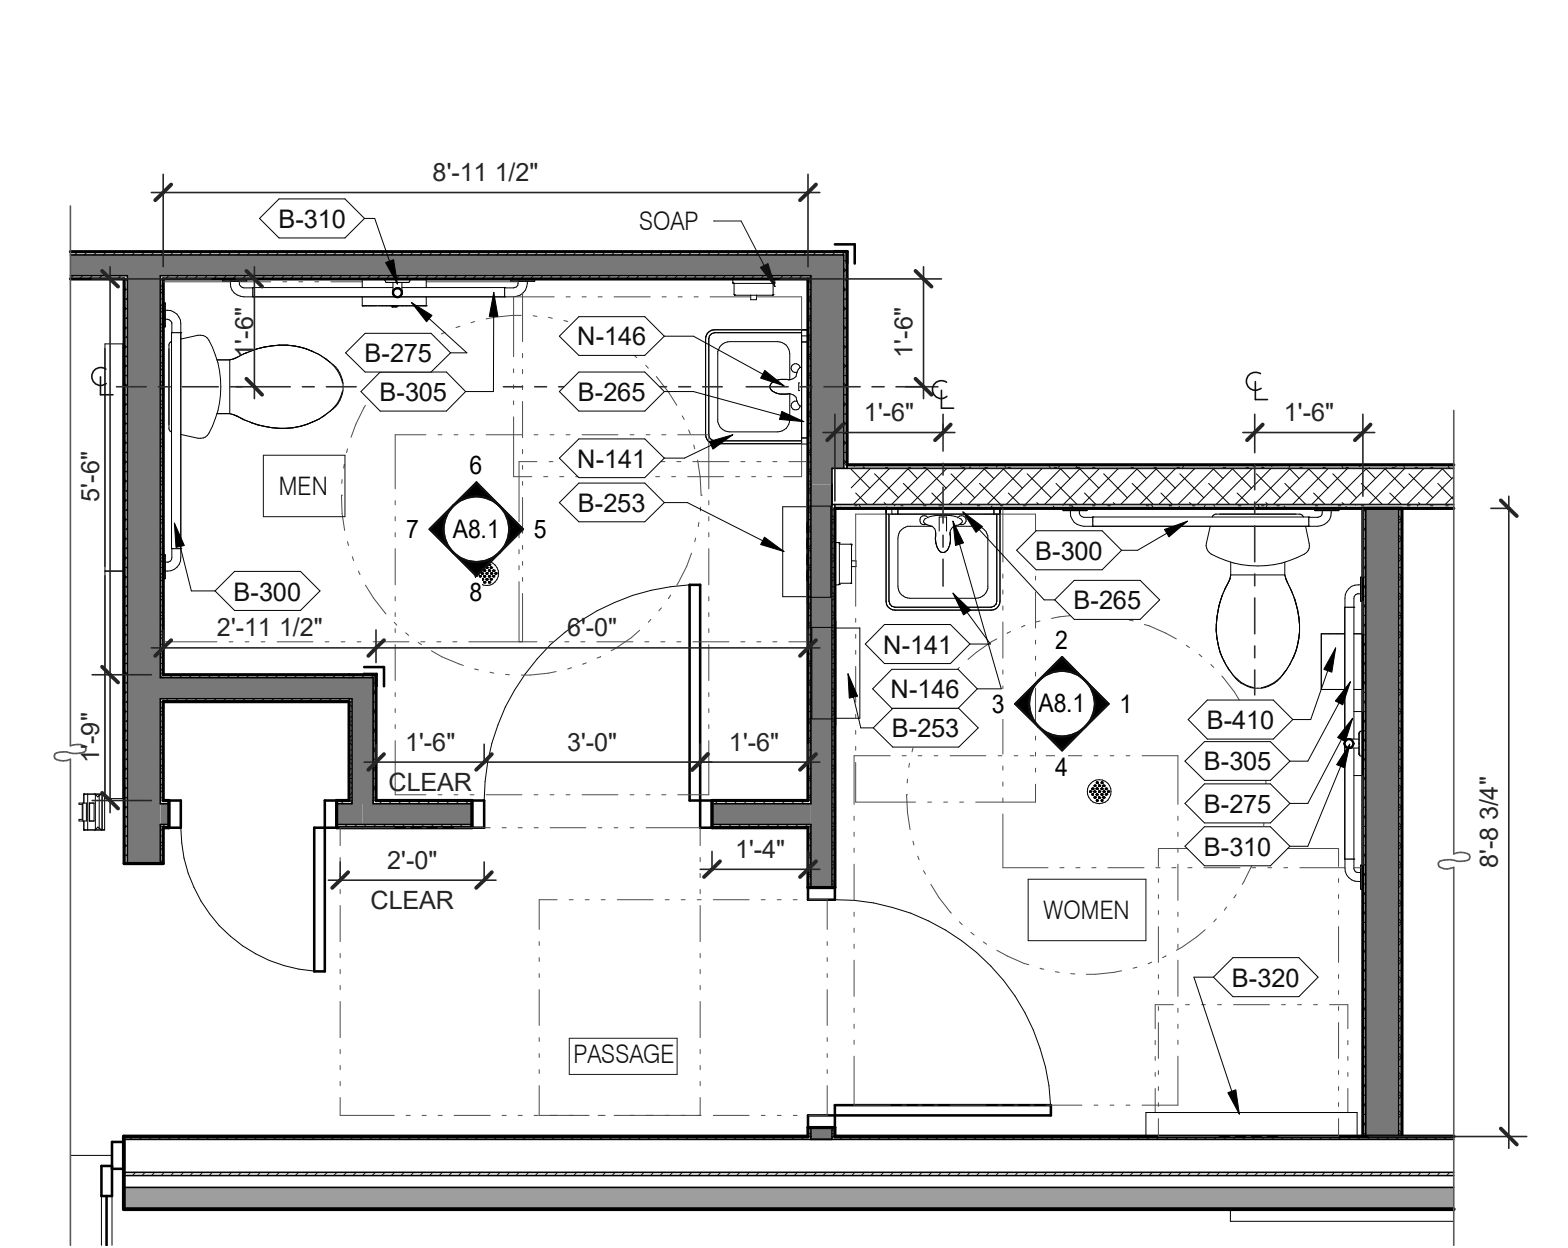


- A. PROVIDE PROPER 2x BLOCKING AT WALL RECESSED MOUNTED ACCESSORIES.
 - B. GRAB BARS, FASTENERS AND MOUNTING DEVICES SHALL BE INSTALLED PER ADA REQUIREMENTS. REFER TO SHEET ADA1.0
 - C. REFER TO FLOOR PLAN NOTE FOR BLOCKING AND SUBSTRATE NOTES.
 - D. REFER TO SHEET ADA1.0 FOR MOUNTING HEIGHTS AND CLEARANCES OF ACCESSORIES AND FIXTURE.
- ALL DIMENSIONS THIS DRAWING ARE TO FINISH SURFACE.
- * ABSOLUTE DIMENSION


DESIGNER NOTE:
REFER TO G4.0 & G4.1
REFER TO SHEET A-2.1 FOR FIXTURE LIST.




ENLARGED RESTROOM / GENERAL NOTES 3/8" = 1'-0" **A**

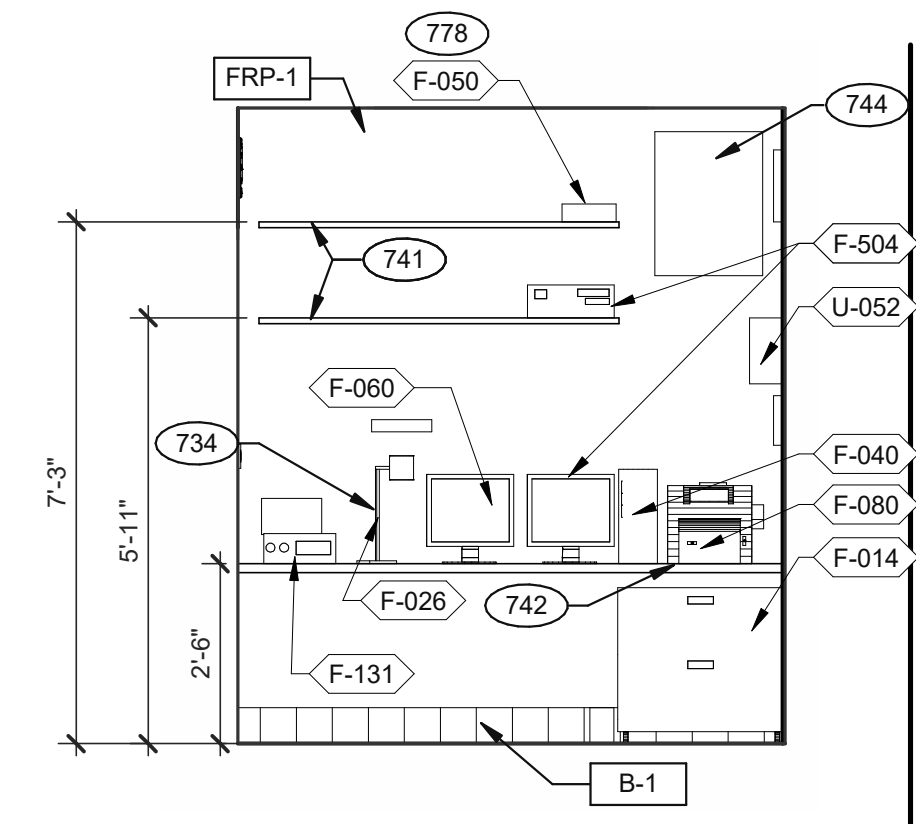


OFFICE ELEVATION 3/8" = 1'-0" **10**

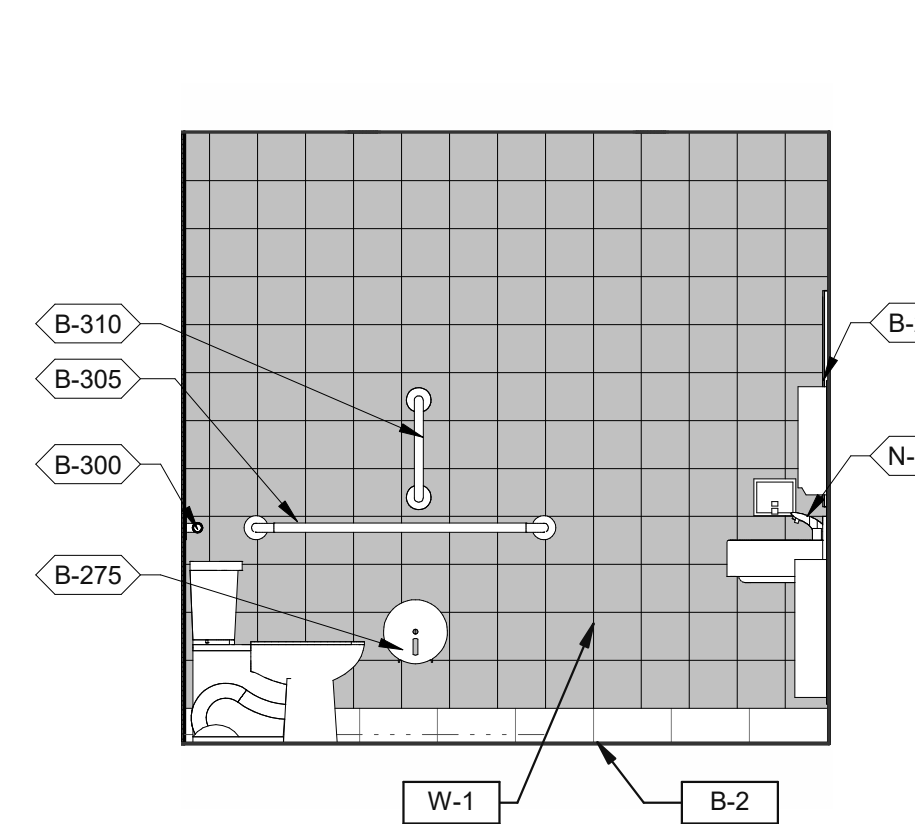


MEN'S RESTROOM 3/8" = 1'-0" **6**

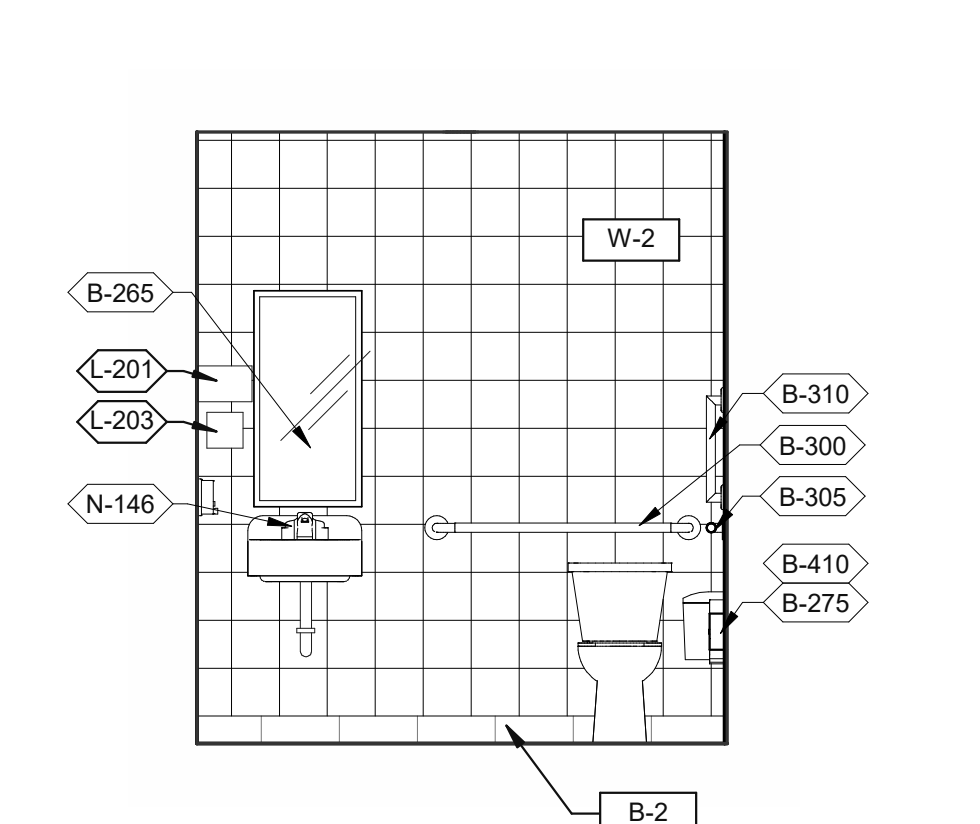


WOMEN'S RESTROOM 3/8" = 1'-0" **2**

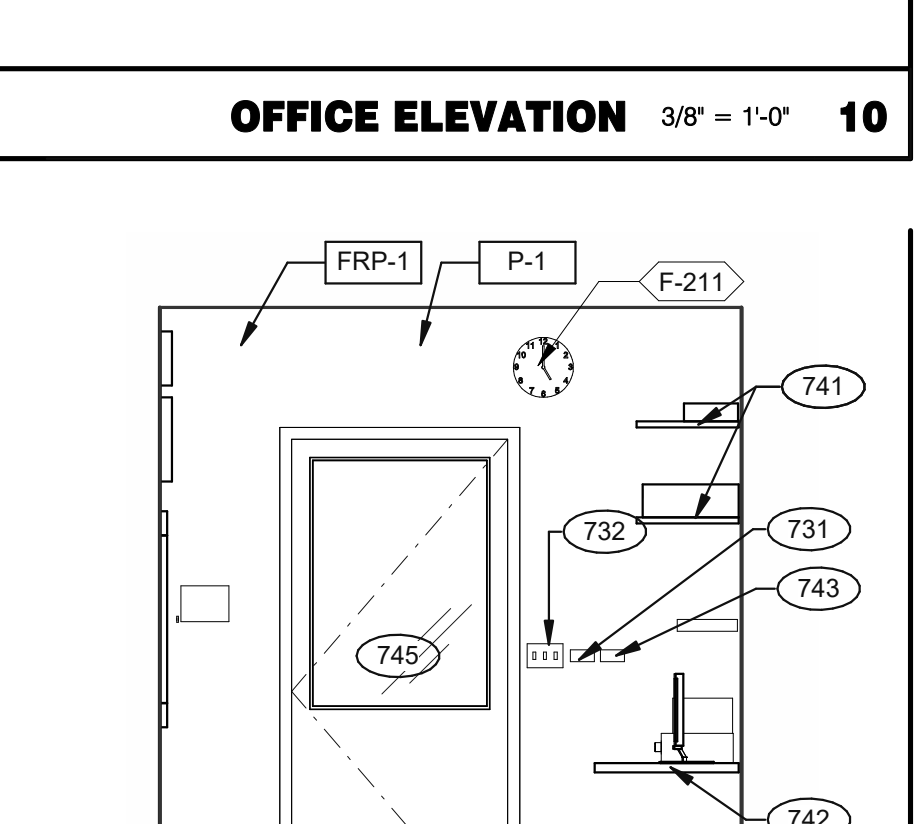


OFFICE ELEVATION 3/8" = 1'-0" **11**

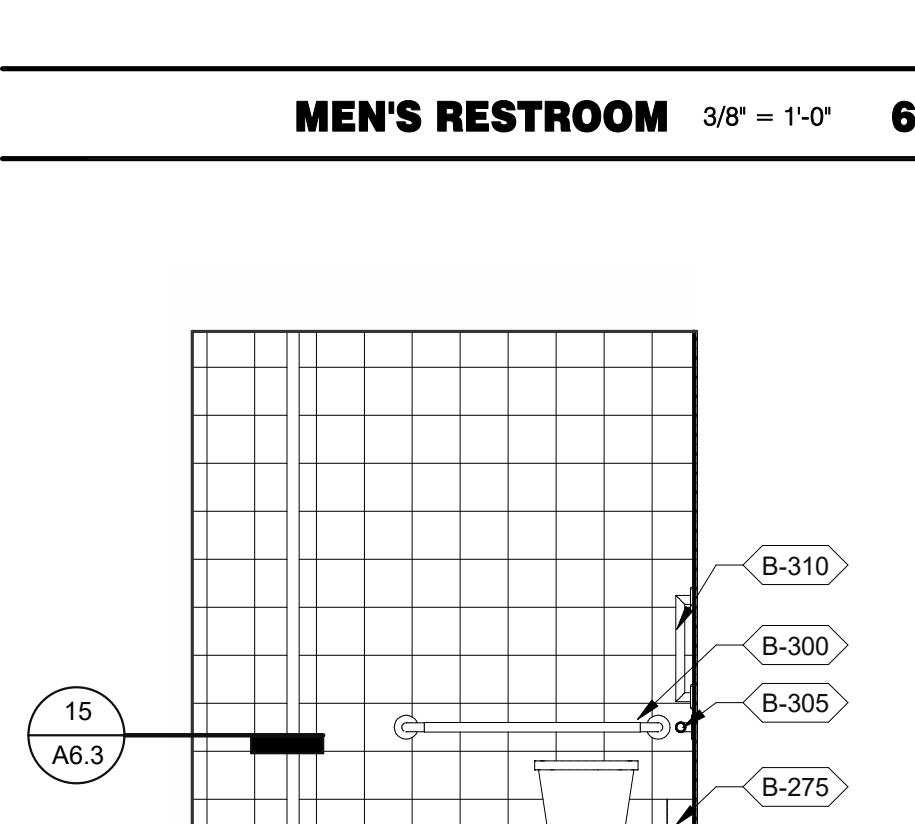


MEN'S RESTROOM 3/8" = 1'-0" **7**

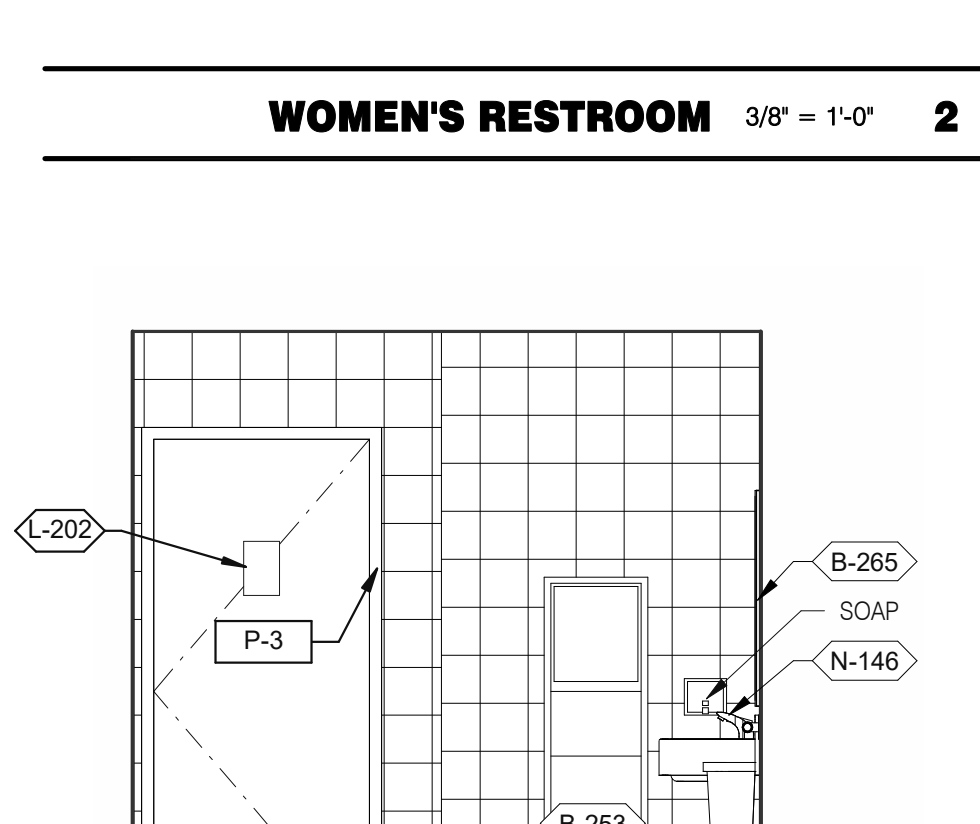


WOMEN'S RESTROOM 3/8" = 1'-0" **3**

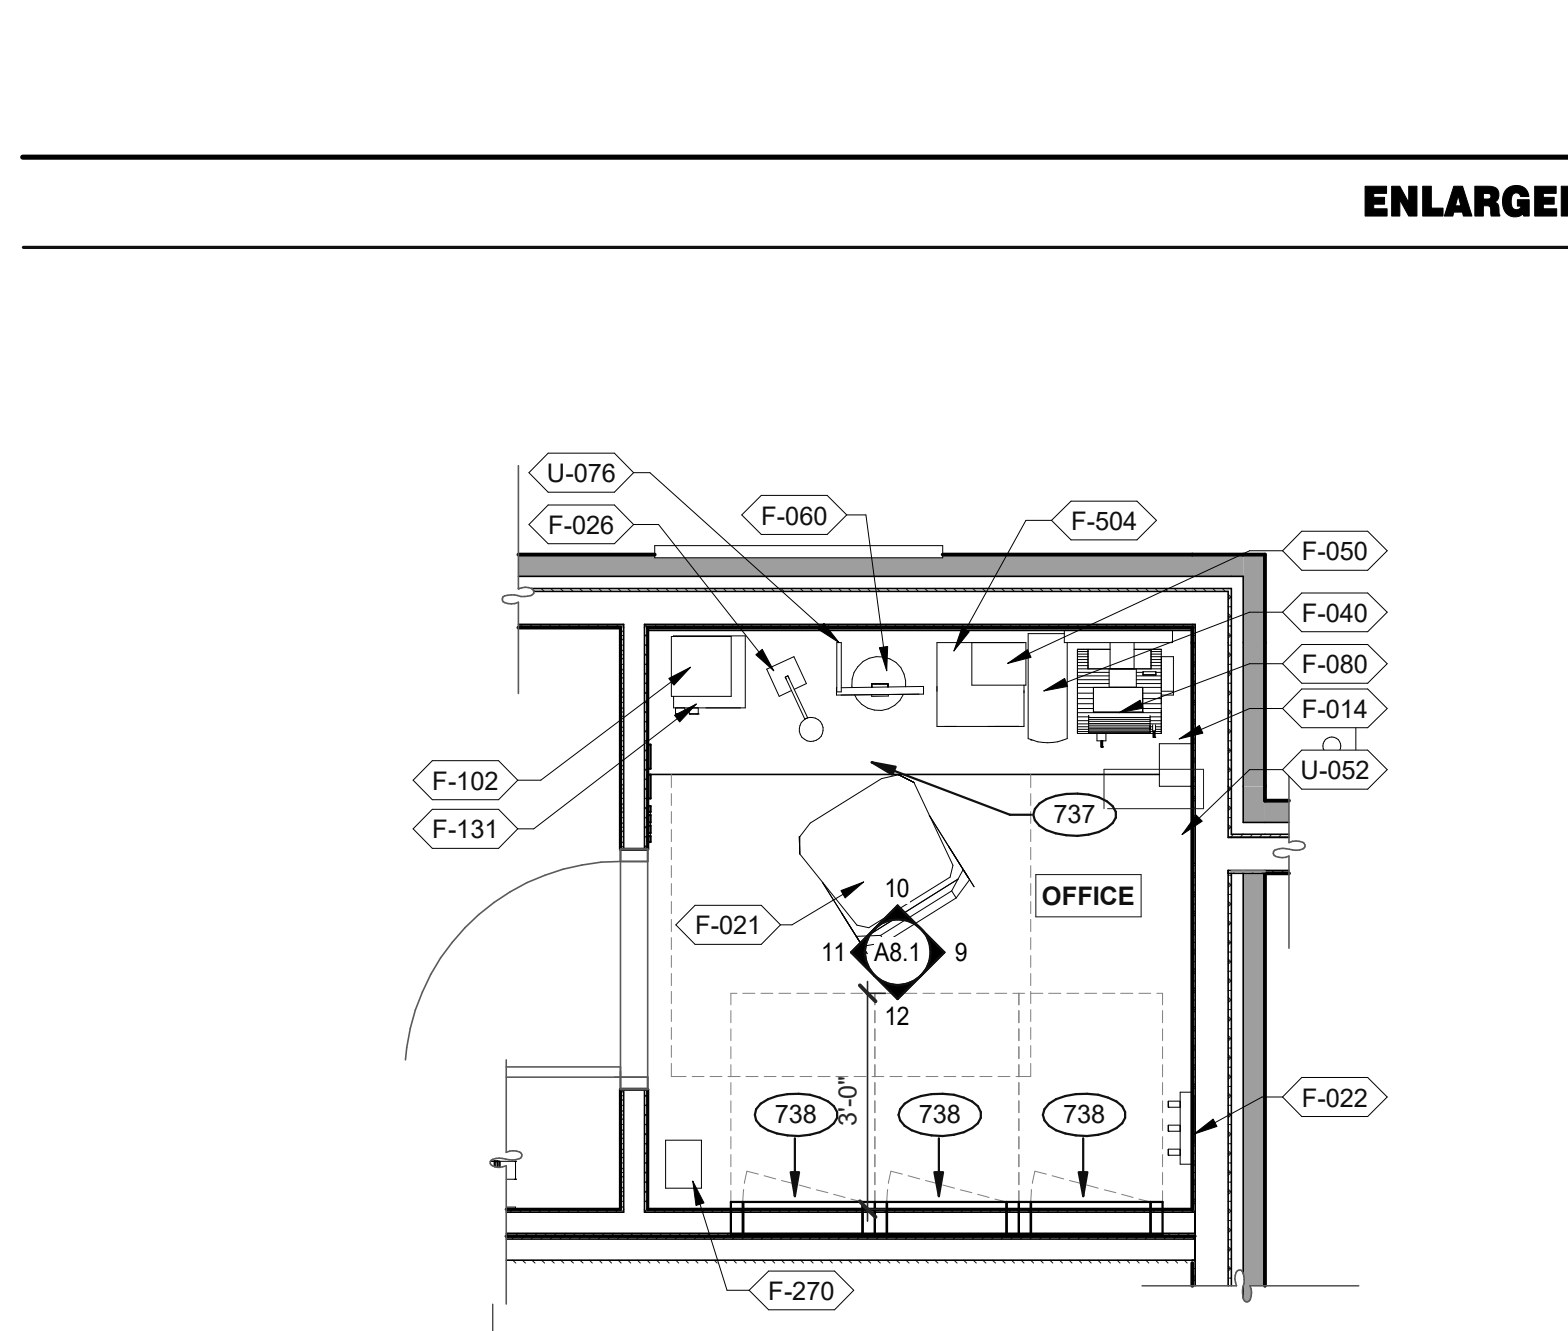


OFFICE PLAN 3/8" = 1'-0" **B**

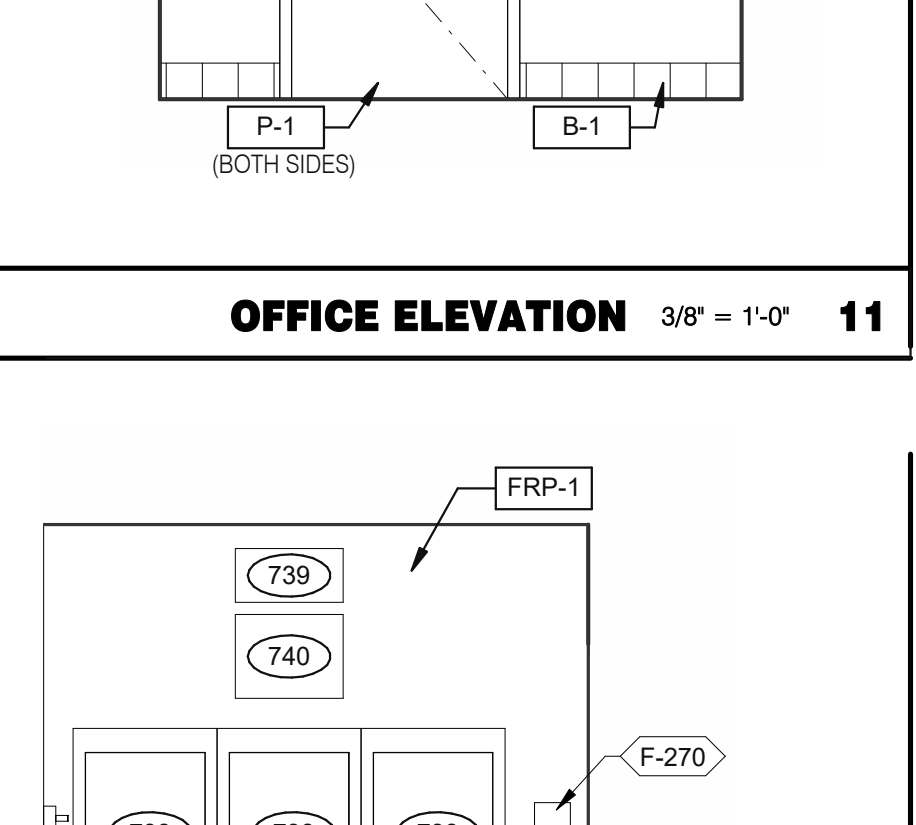

OFFICE ELEVATION 3/8" = 1'-0" **12**

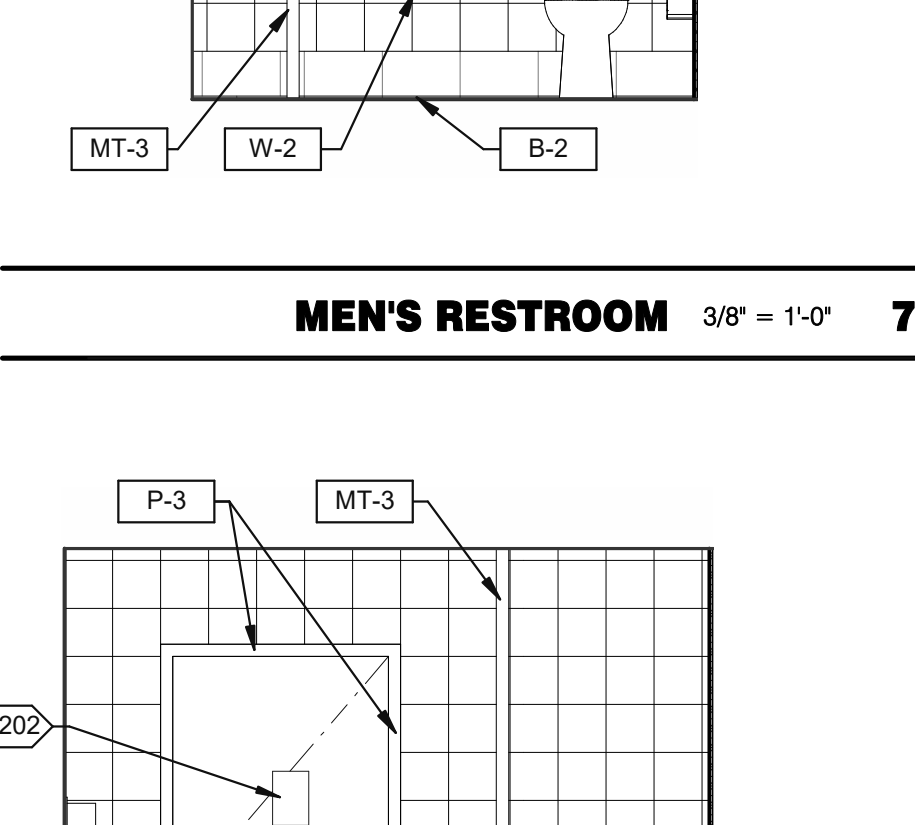

MEN'S RESTROOM 3/8" = 1'-0" **8**

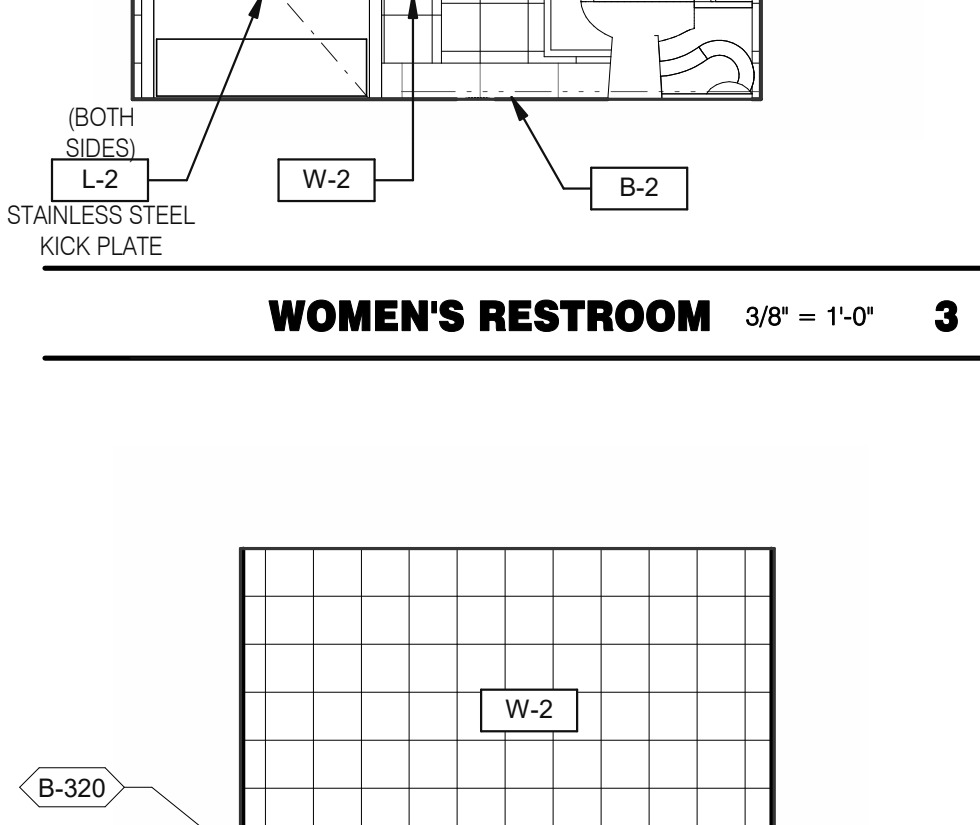

WOMEN'S RESTROOM 3/8" = 1'-0" **4**

- 731 THERMOSTATS.
- 732 LIGHTING CONTROL RELAY SWITCHES. SEE DETAIL 3/E3.1.
- 734 DESK LAMP.
- 737 UNDER COUNTER KEYBOARD TRAY.
- 738 ELECTRIC PANELS.
- 739 FAN & LIGHT CONTROL BOX; REFER TO SHEET E6.0.
- 740 EXTERIOR LIGHTING CONTROL PANEL (GREEN GATE).
- 741 SHELF BY GC - FINISH WITH PLASTIC LAMINATED, L-1.
- 742 COUNTER BY GC - FINISH WITH PLASTIC LAMINATED, L-1.
- 743 DUCT SMOKE DETECTOR RESET SWITCH.
- 744 TECH-IN-A-BOX (WALL MOUNT RACK ENCLOSURE CABINETS); REFER TO SHEET E3.1. GC TO PROVIDE BLOCKING WHERE REQUIRED.
- 745 DOOR IS OPTIONAL.
- 778 PROVIDE POWER FOR F-050.
- 779 PROVIDE POWER FOR N-146.

KEYNOTES **C**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03








TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



**ENDEAVOR 2.0
INTERIOR ELEV.
ENLARGED
RESTROOMS &
OFFICE PLAN**

A8.1

PLOT DATE: 11/3/2022 11:20:22 AM

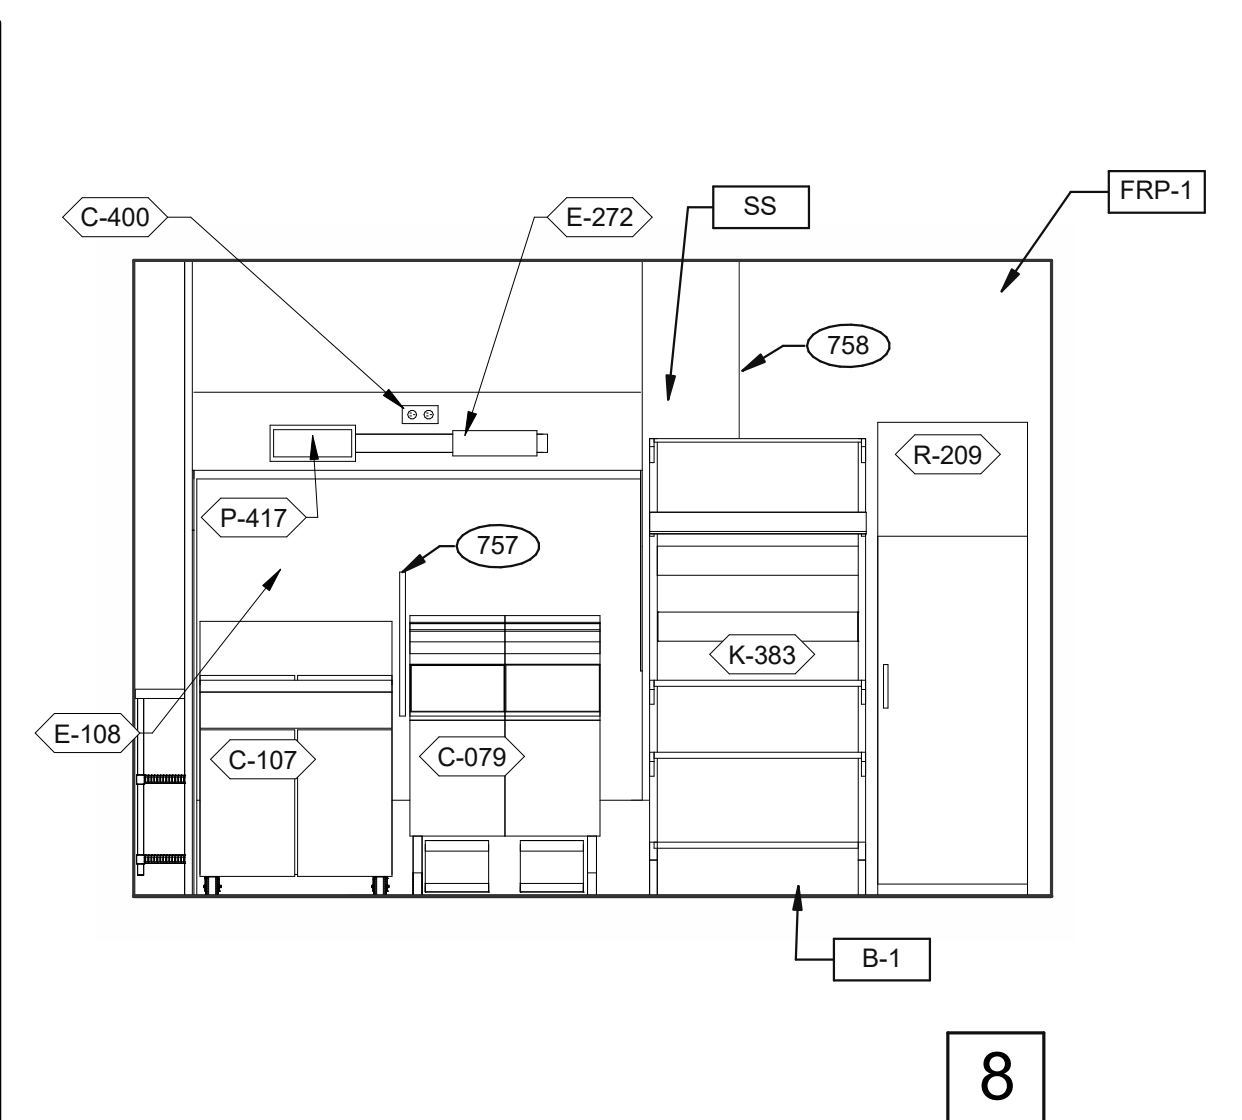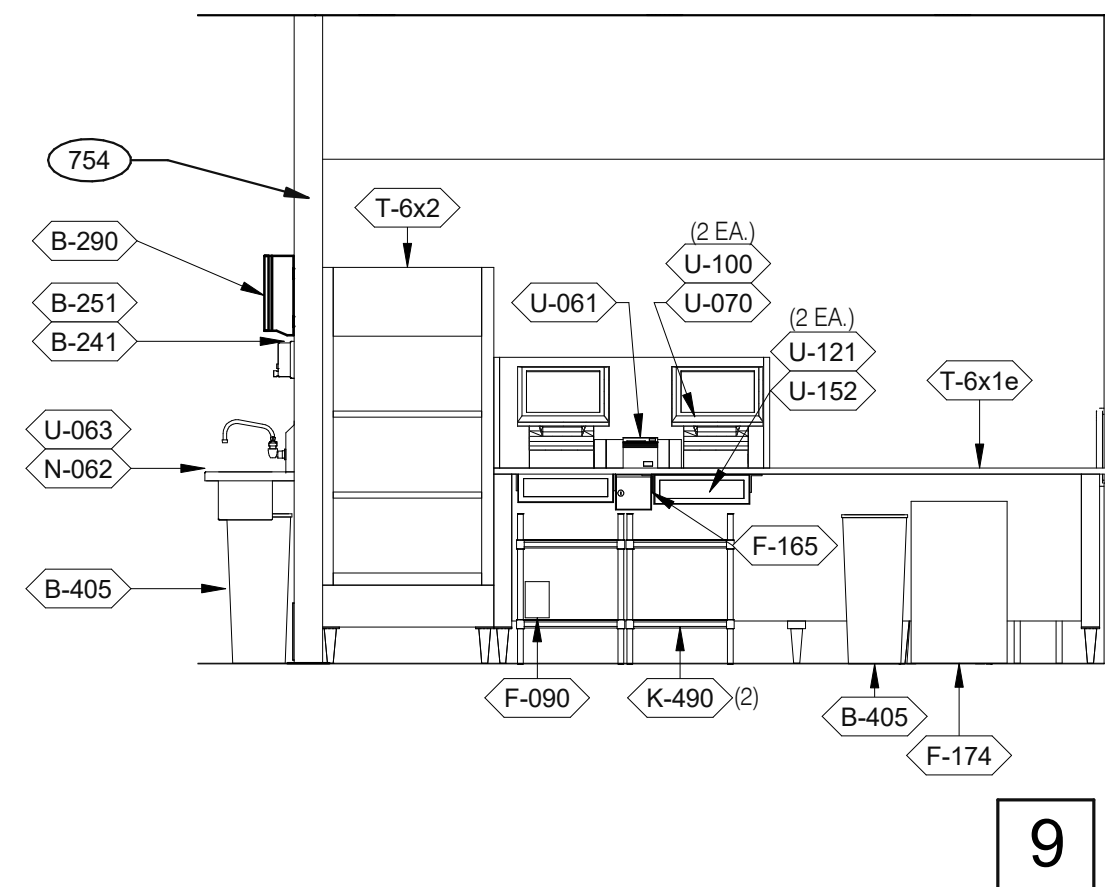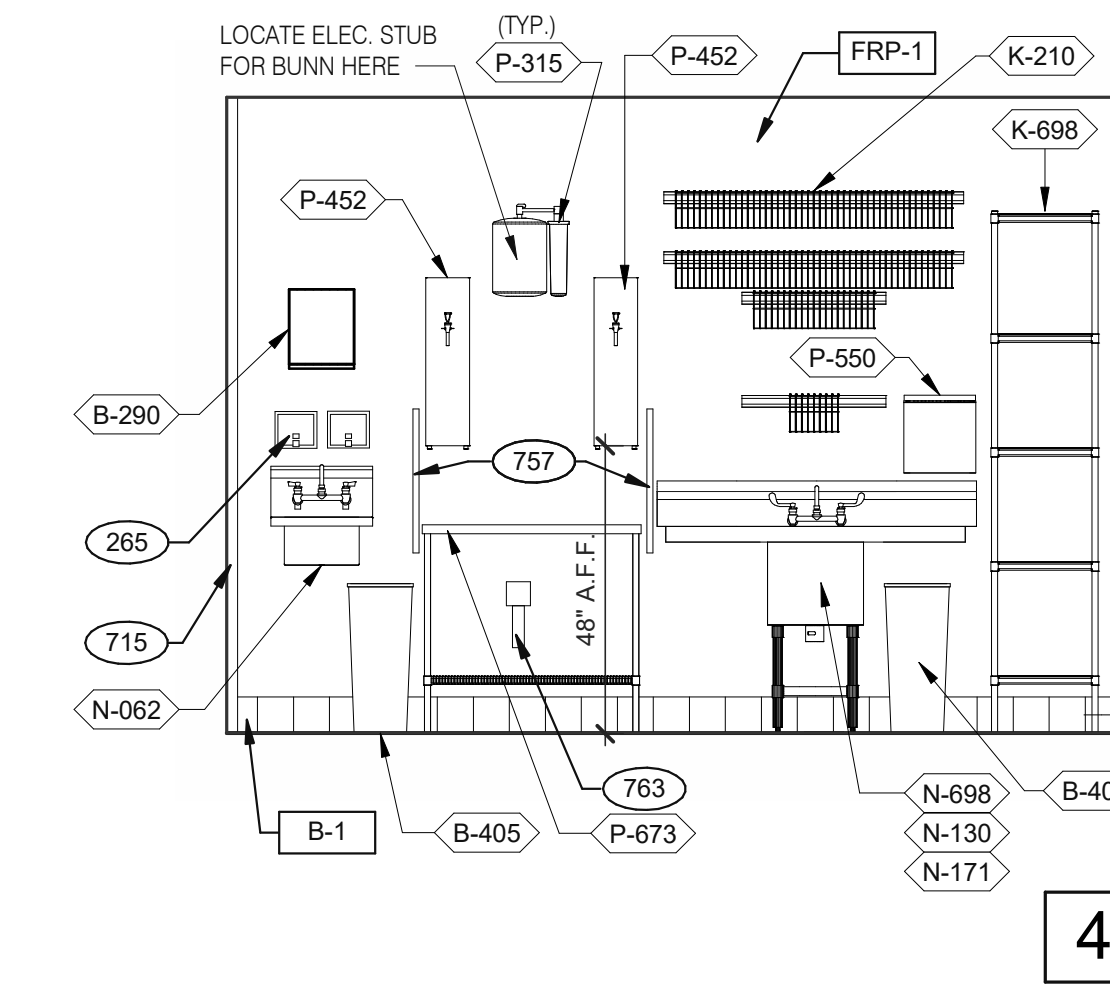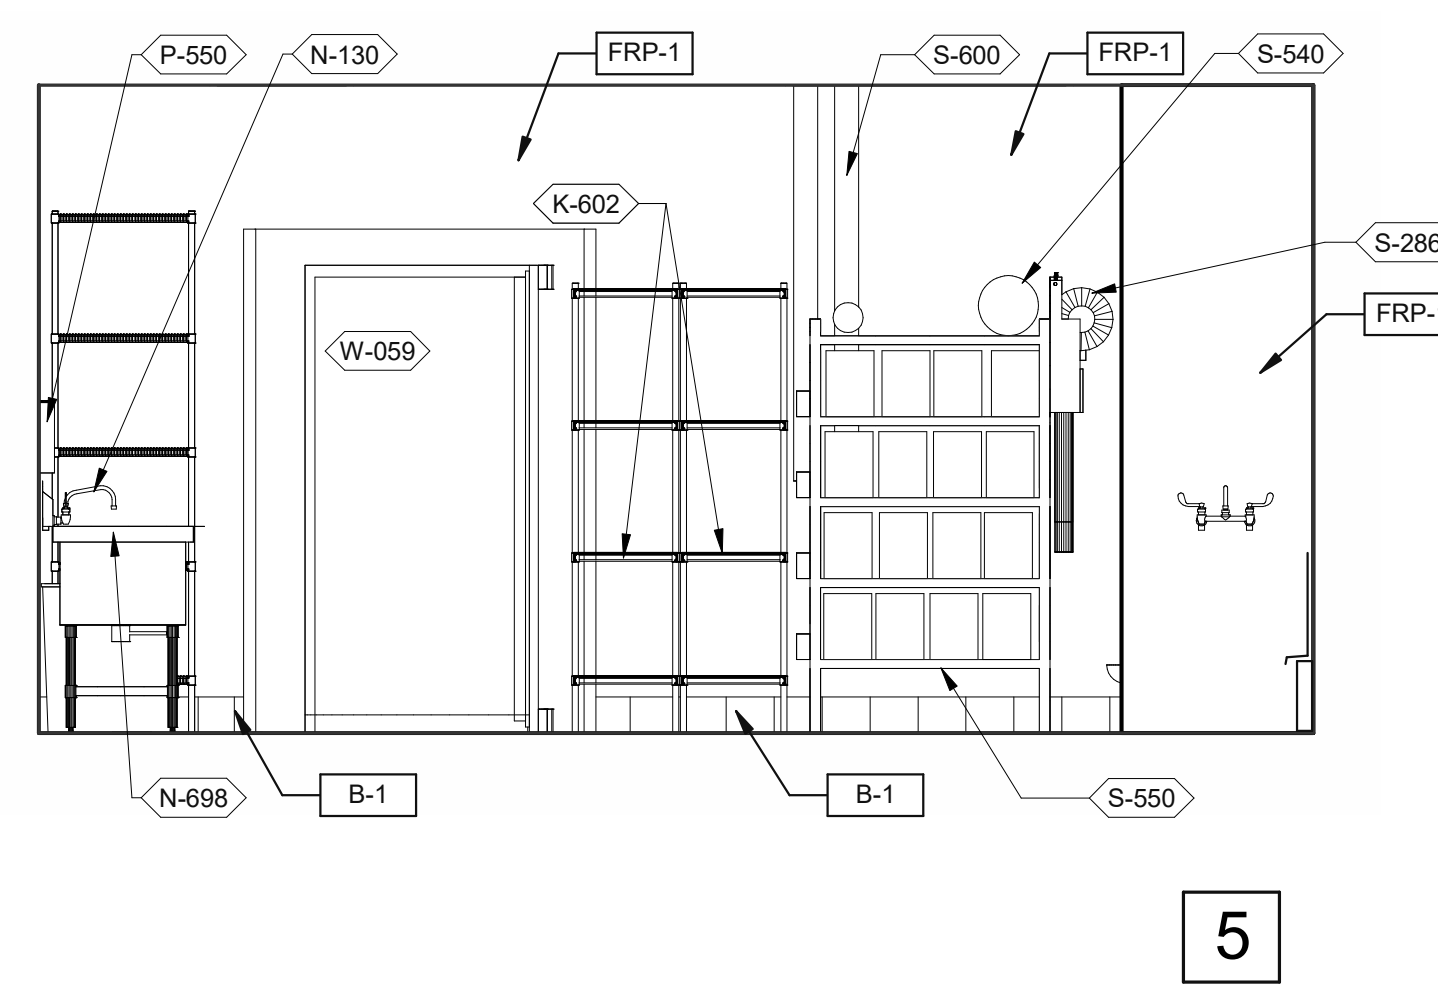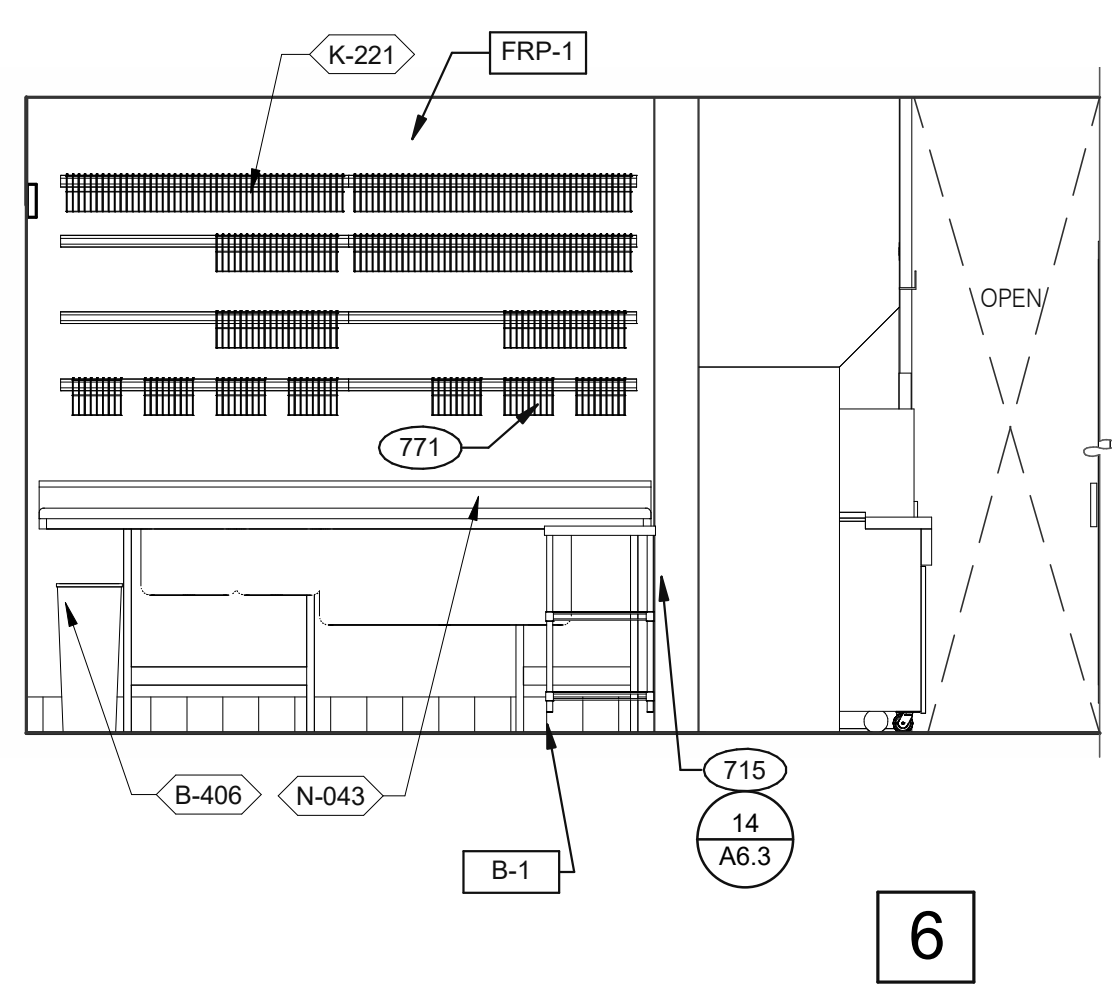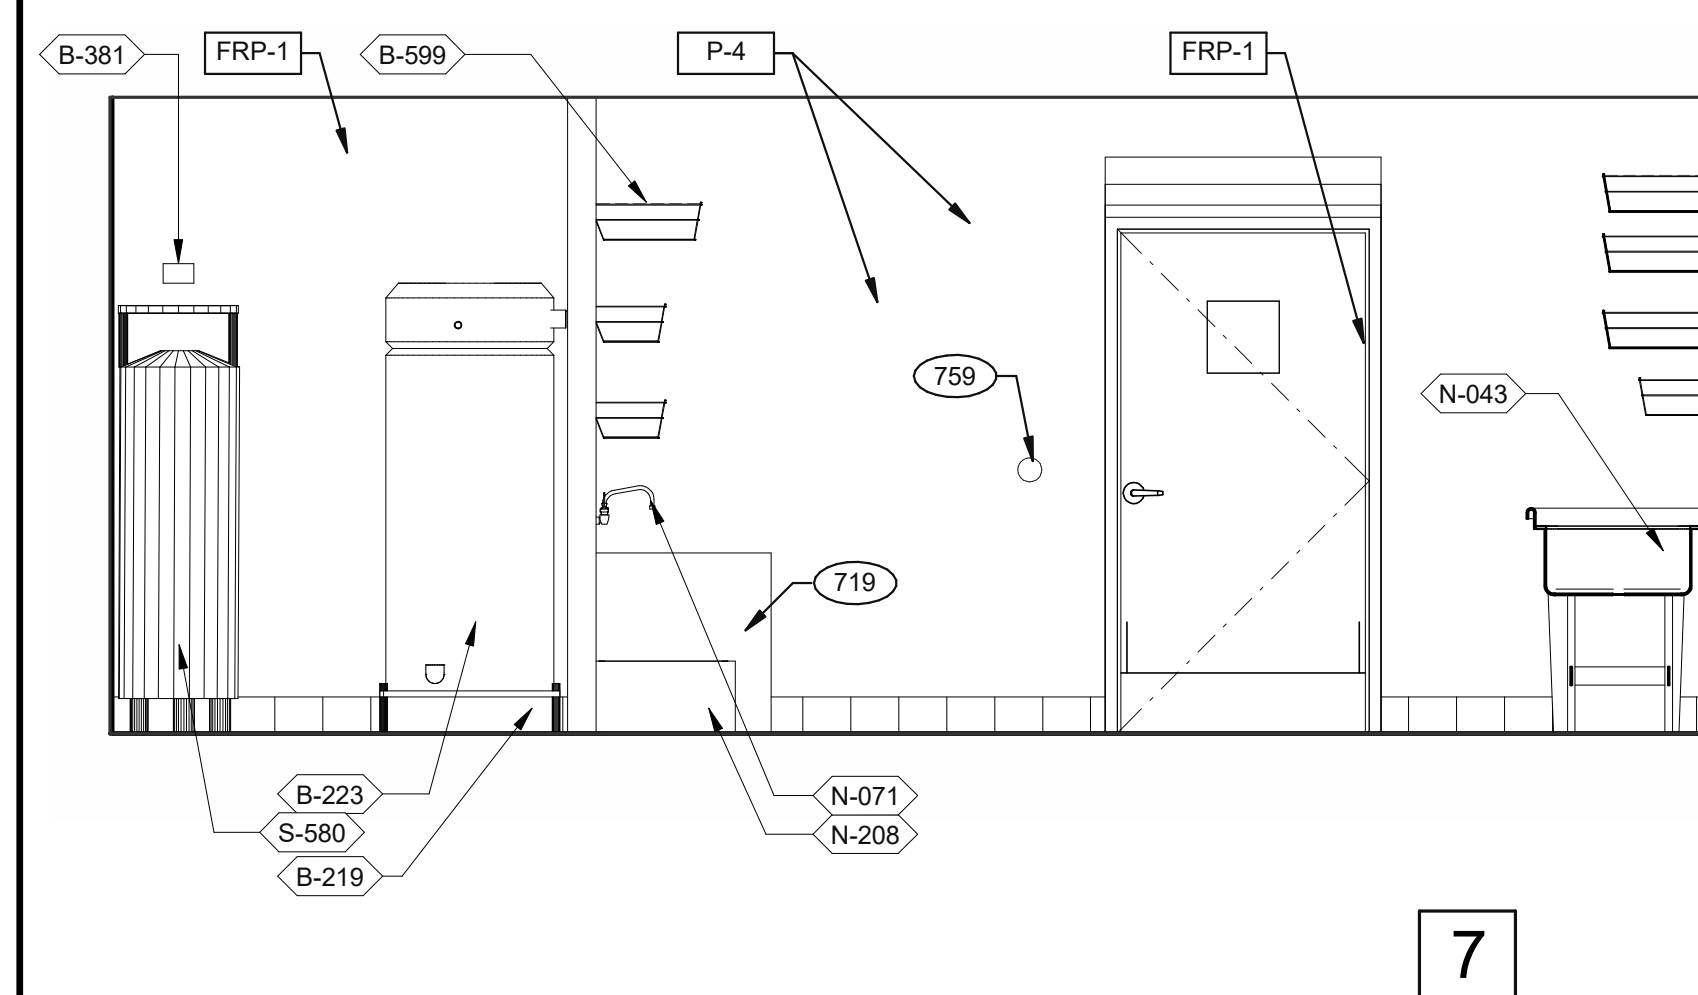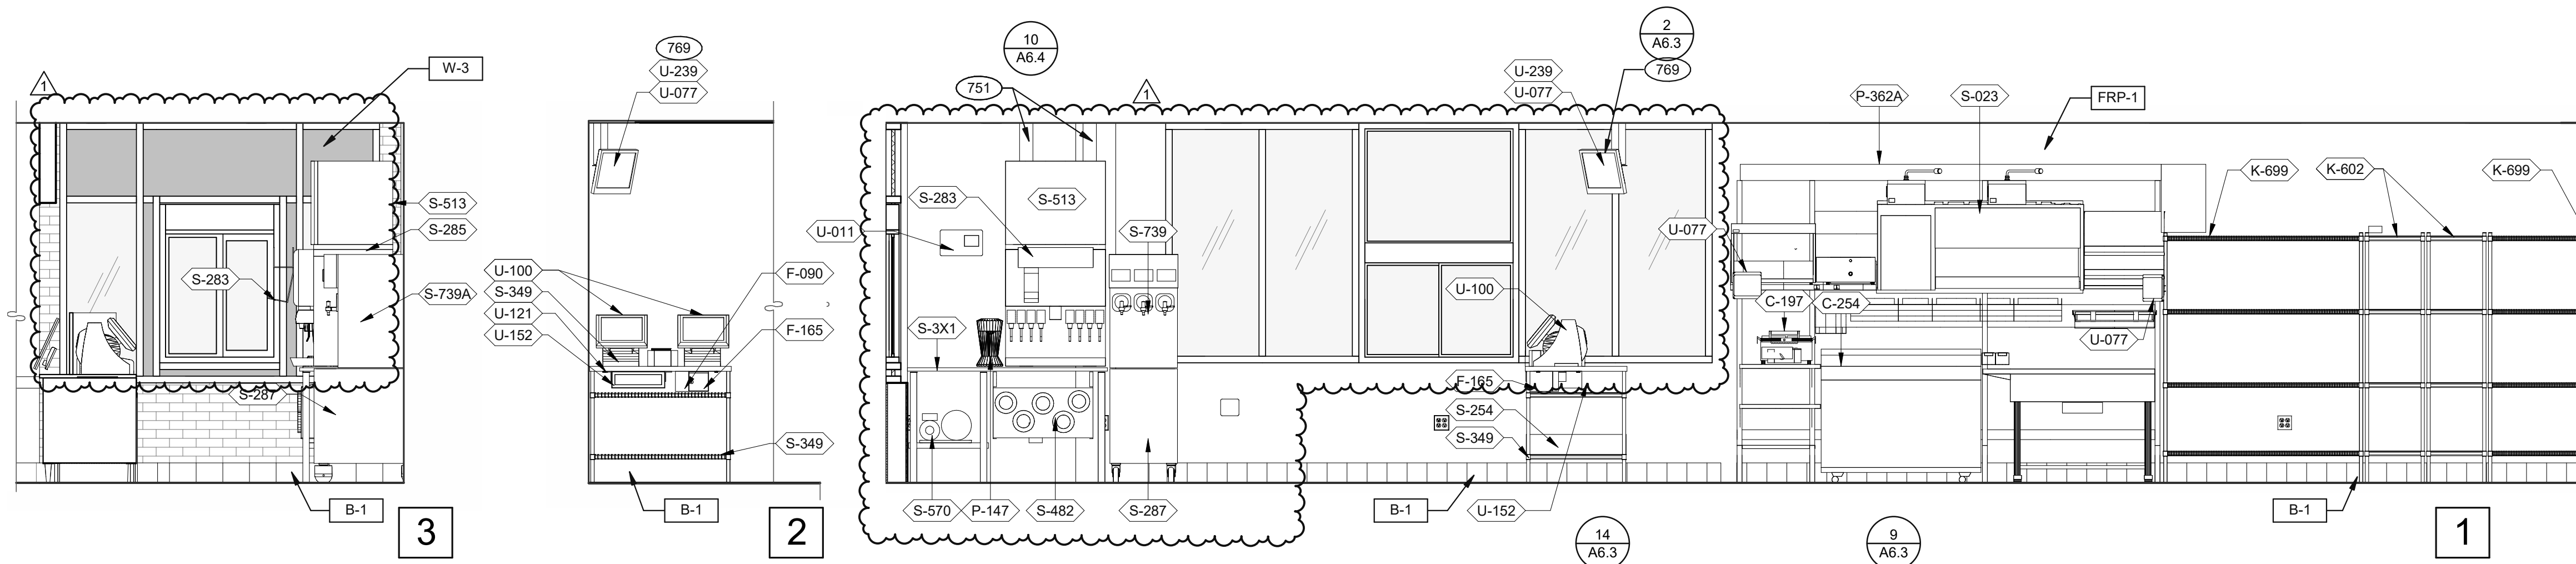

- KEY NOTES**
- 265 AUTOMATIC HAND SOAP AND SANITIZER DISPENSERS PROVIDED BY ECOLAB.
 - 715 SS CORNER/END WALL CHANNEL GUARD, FULL HEIGHT. SEE DETAIL 14/A6.3 AND
 - 719 STAINLESS STEEL CLOSURE WITH FLASHING AND END CAP.
 - 751 STAINLESS STEEL CHASE FOR SYRUP LINES & ICE MACHINE REFRIGERANT LINES.
 - 754 SS CORNER/END WALL CHANNEL GUARD, FULL HEIGHT.
 - 757 SPLASHGUARD. SEE DETAIL 9/A6.3.
 - 758 EDGE OF SS PANEL BEHIND HOOD.
 - 759 ANSUL PULL STATION.
 - 763 FILTER FOR HOT WATER SYSTEM.
 - 769 CEILING MOUNT MONITOR BRACKET.
 - 771 CUT WALL-HANGING TRACK TO ALLOW SPACE FOR CLICK & CLEAN SYSTEM.



DATE	REMARKS
11.07.22	Issued for Construction
1	11.07.22 Bulletin #1

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03


TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236

ENDEAVOR 2.0
 INTERIOR
 ELEVATIONS
 KITCHEN


A8.2
 PLOT DATE: 11/3/2022 11:20:29 AM

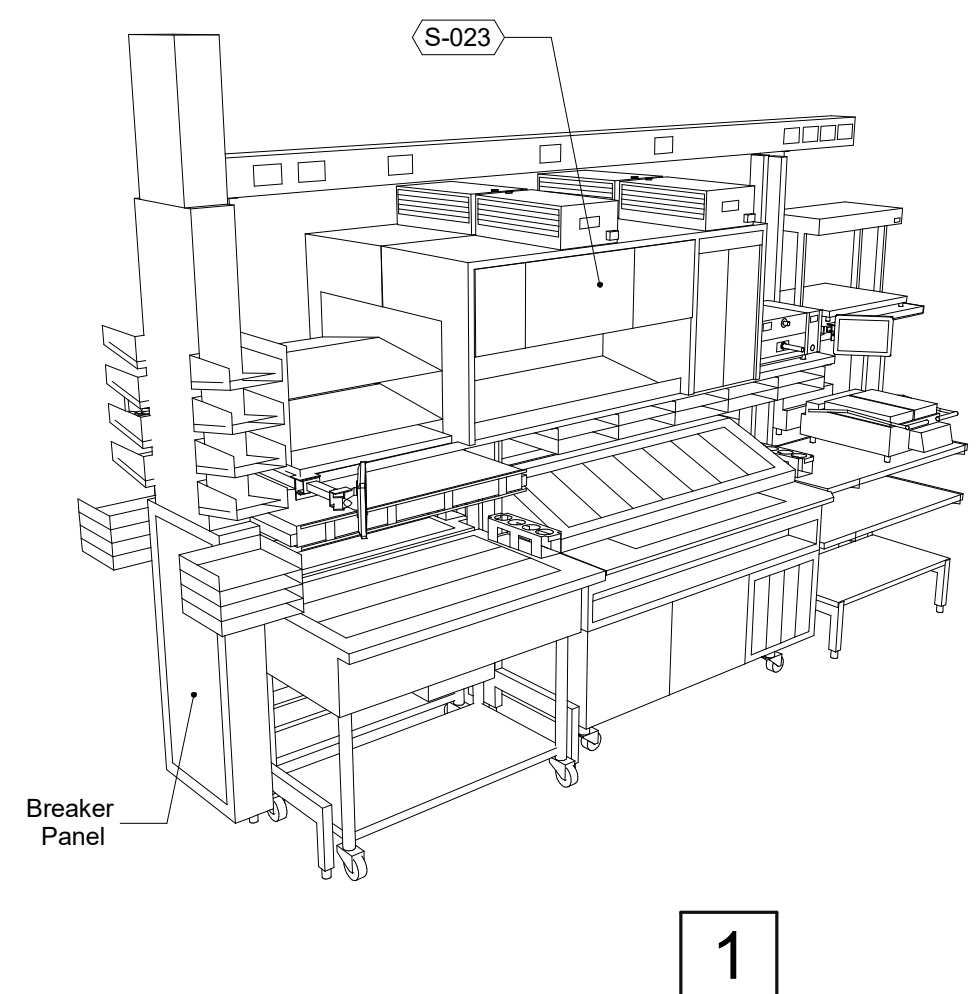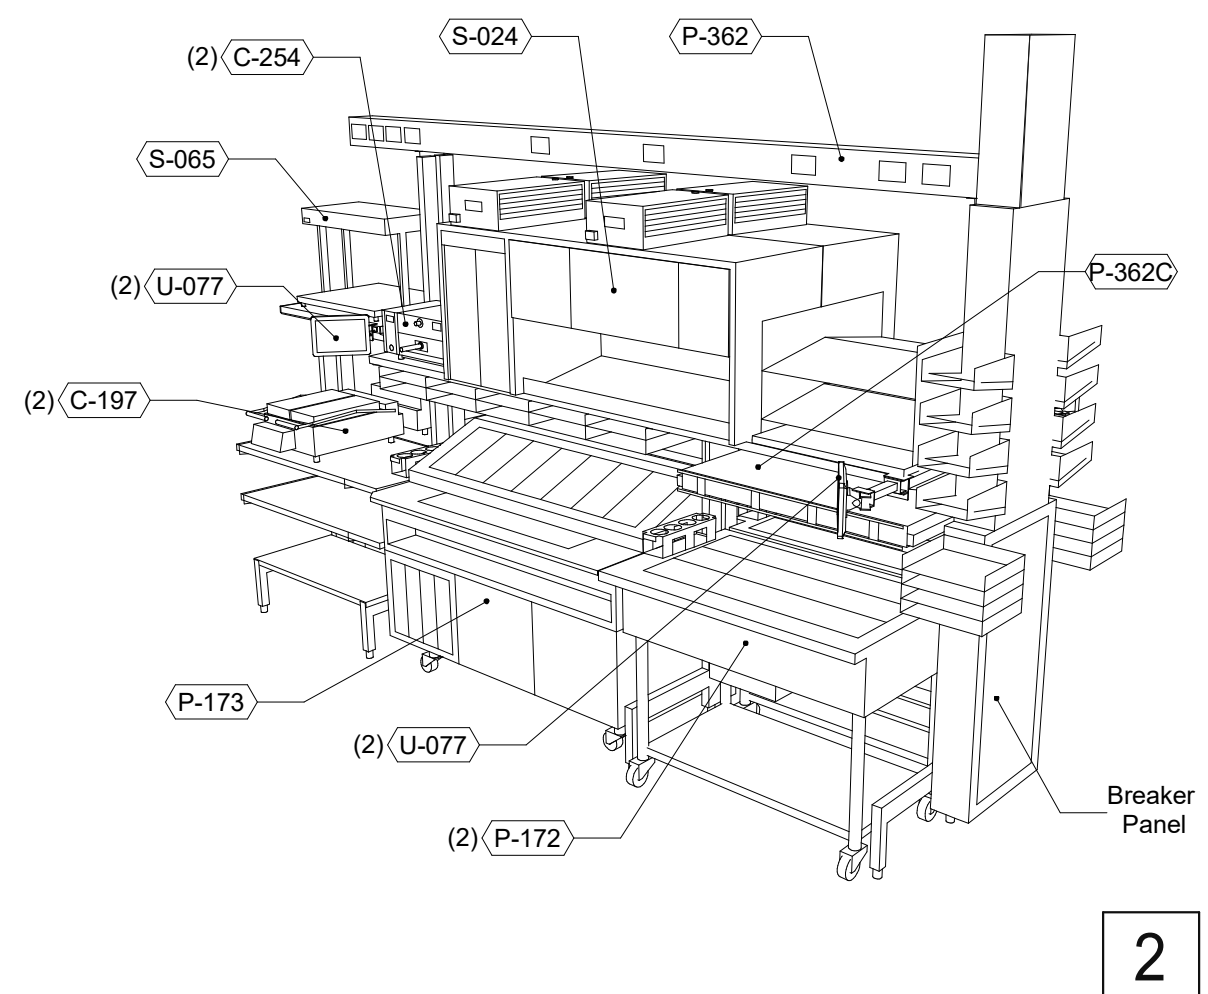


P-362B FLEX DUAL-LINE 3/8" = 1'-0"

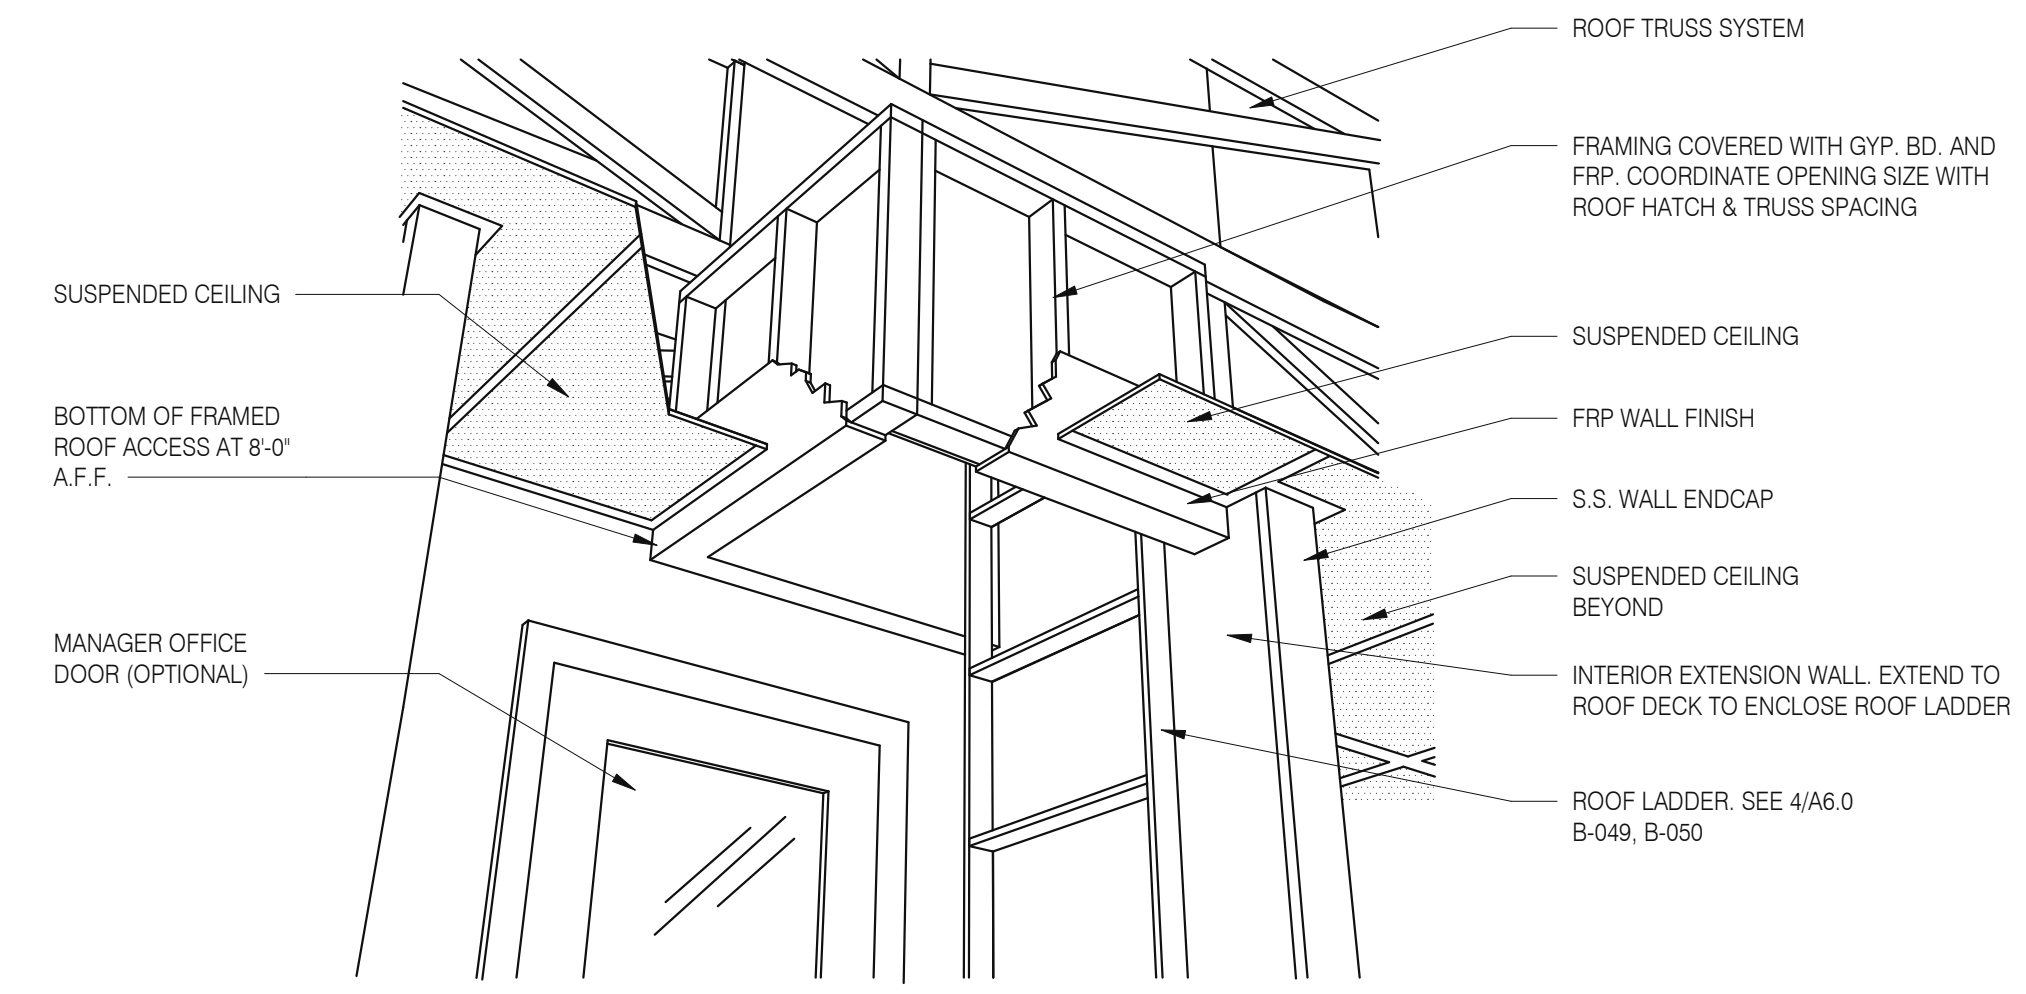


A - ROOF LADDER VIEW

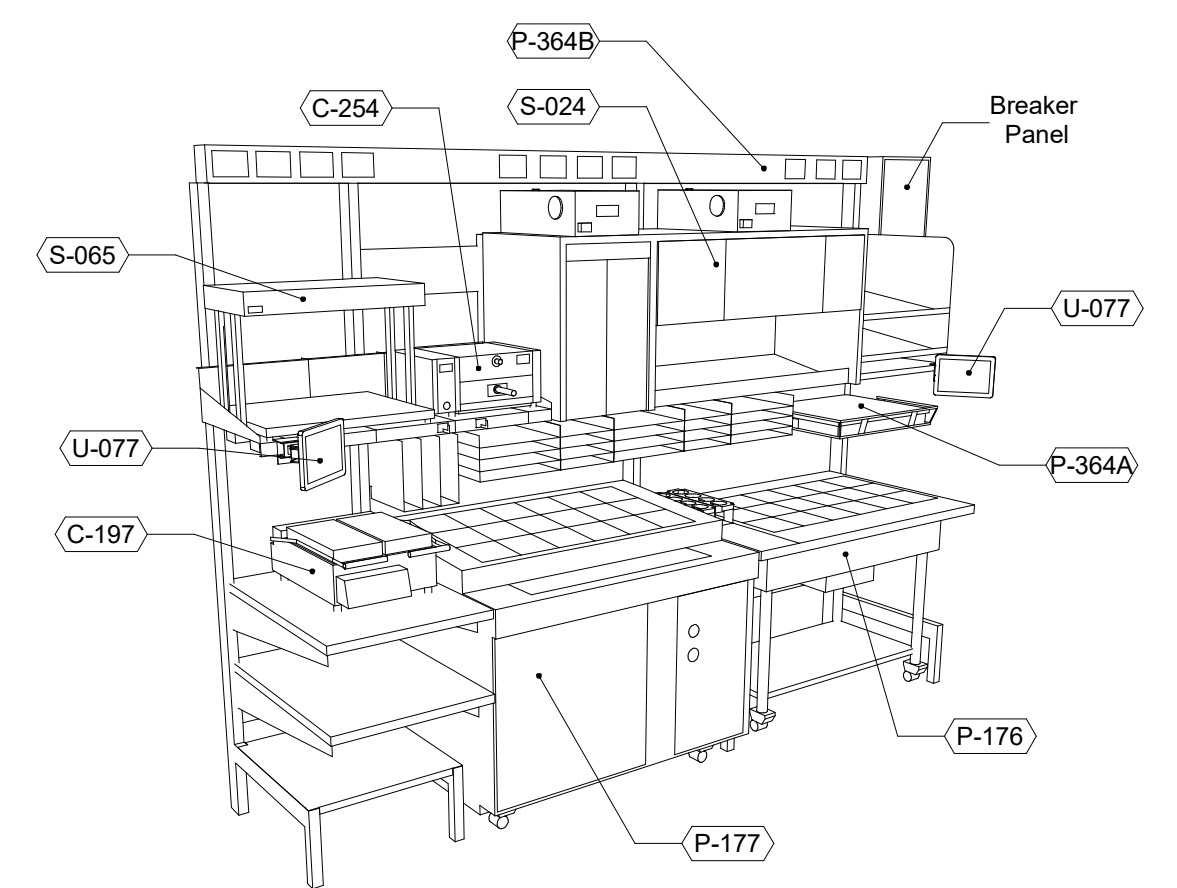

P-362A FLEX I-LINE, L-R N.T.S. **7**

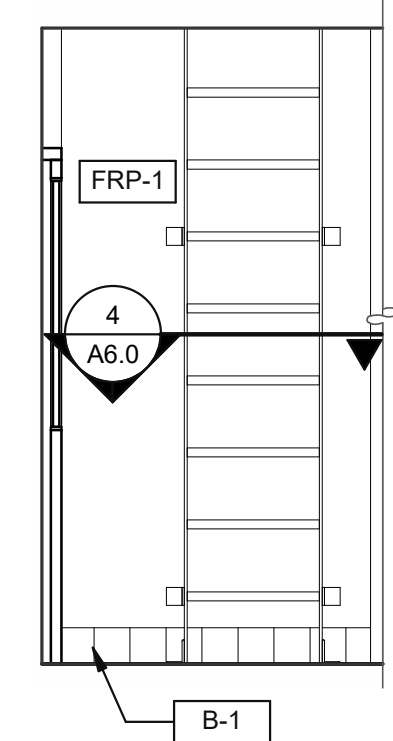

6

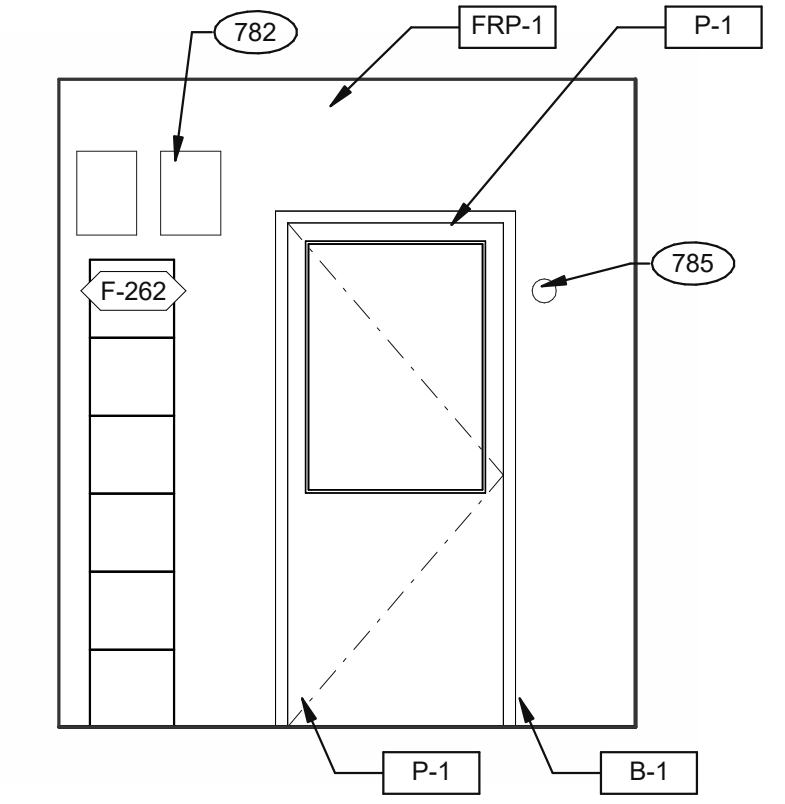

5

EMPLOYEE / STORAGE 3/8" = 1'-0"

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: RS
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236



**ENDEAVOR 2.0
INTERIOR
ELEVATIONS
KITCHEN**

A8.3


PLOT DATE: 11/3/2022 11:20:32 AM

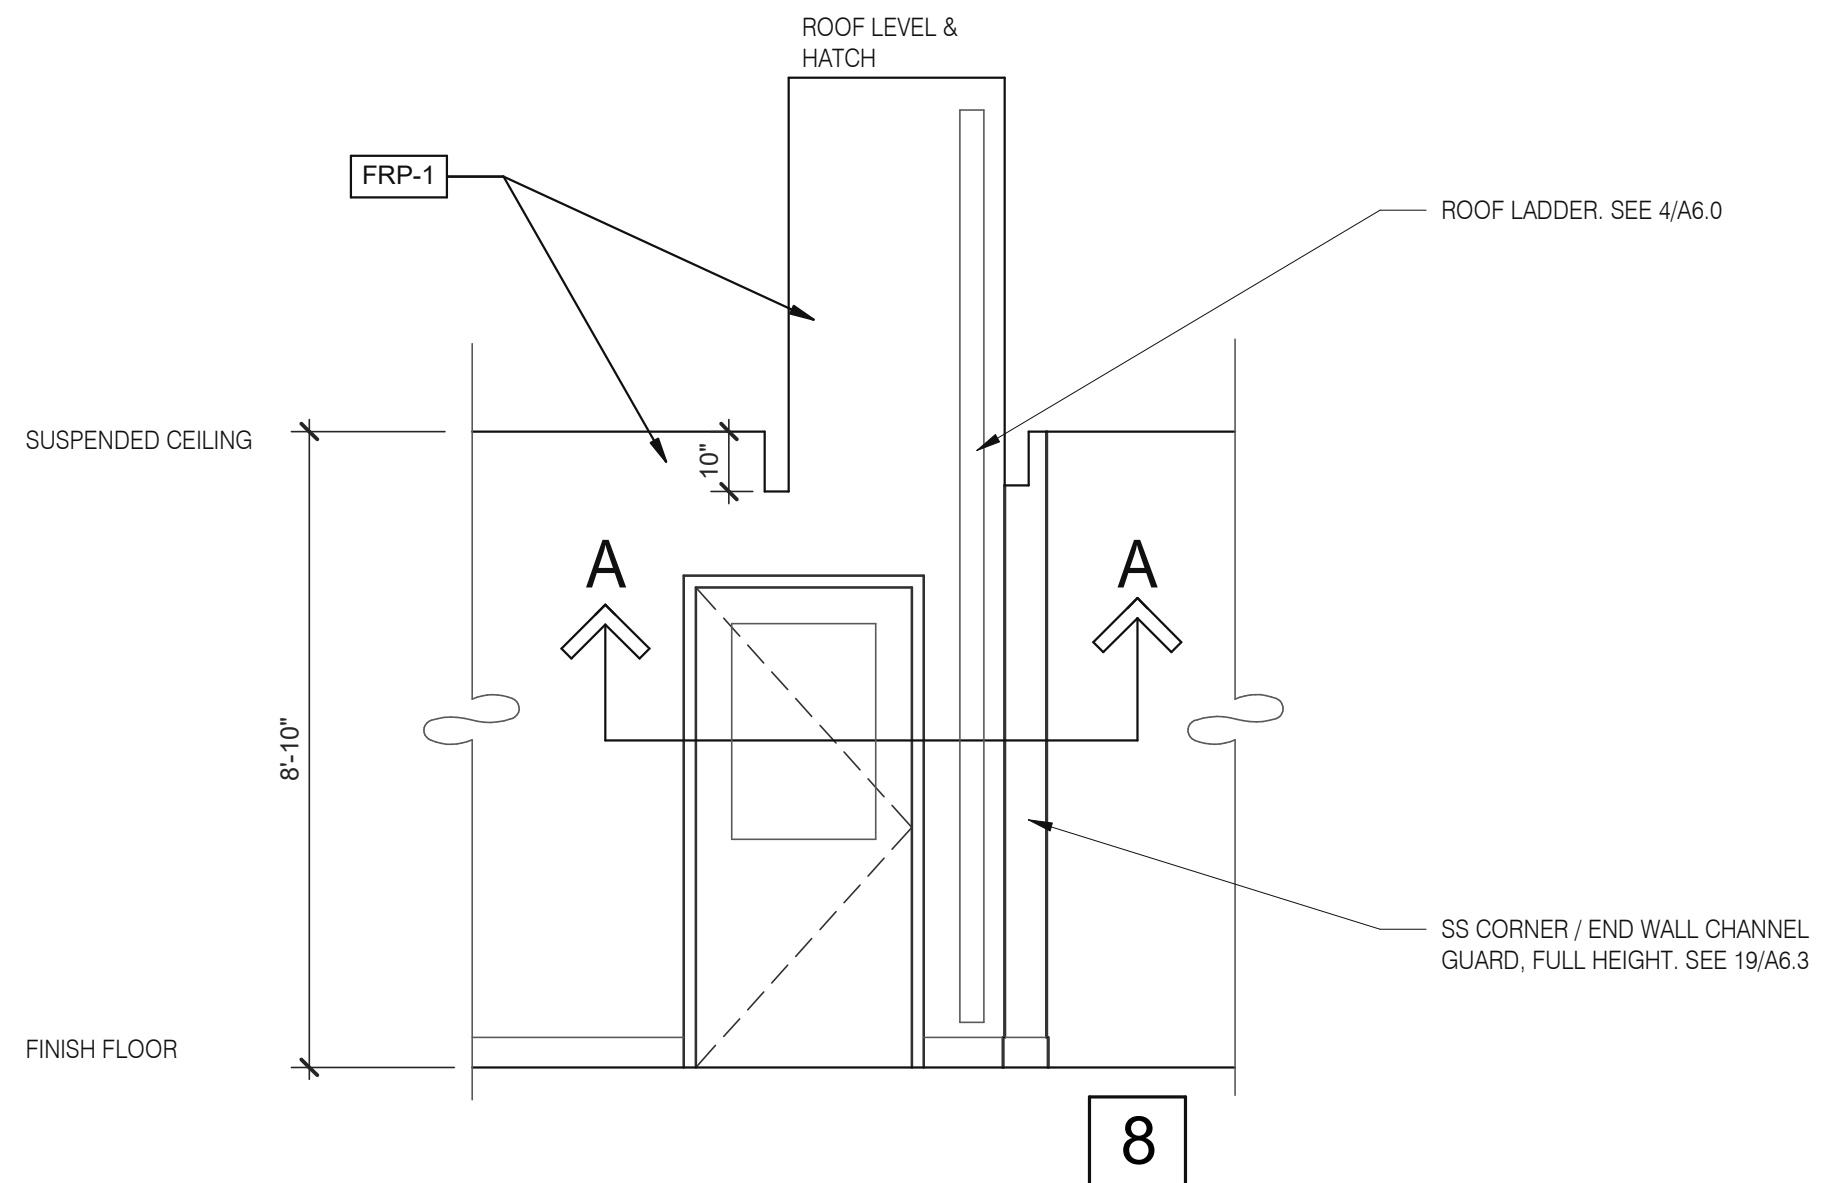

8

ROOF ACCES PASSAGEWAY 3/8" = 1'-0" **B**

Taco Bell Mop Sink Installation

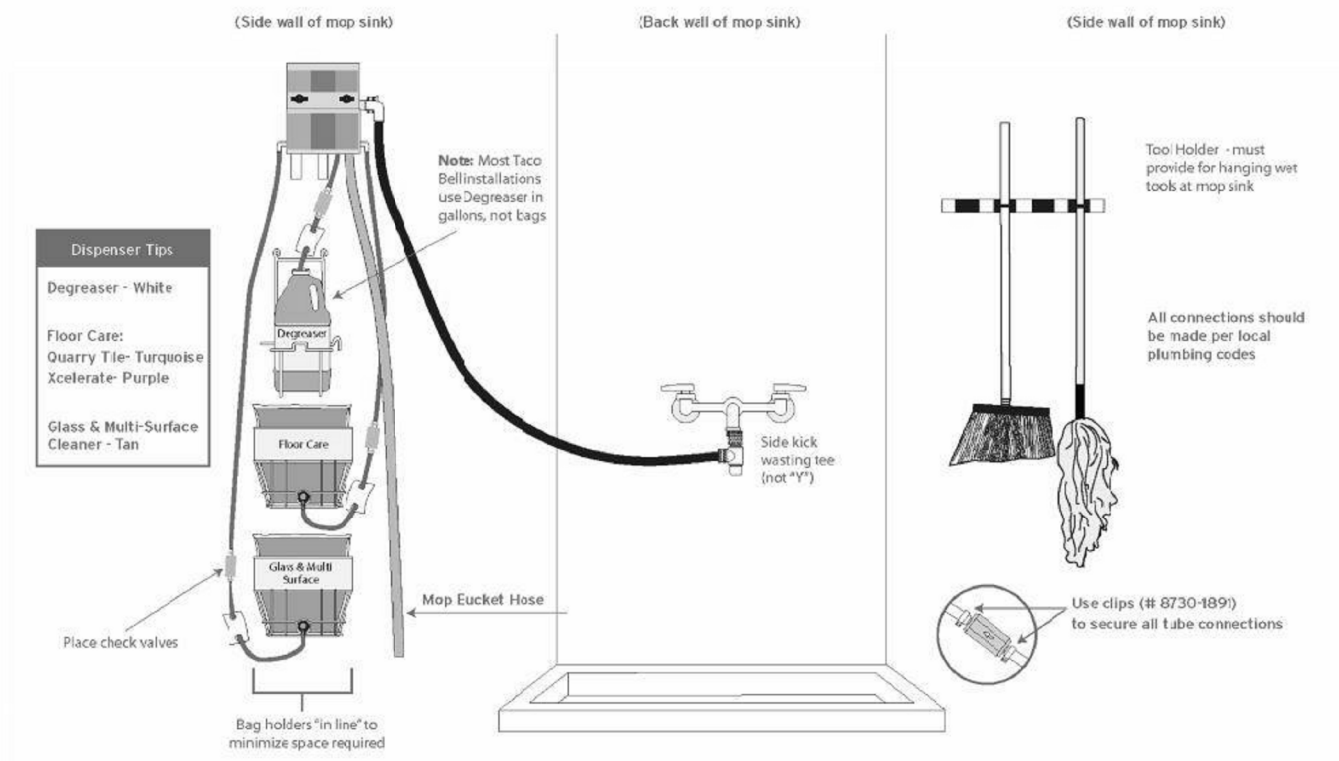

INSTALL IN ACCORDANCE WITH STATE AND LOCAL PLUMBING CODES. In states or municipalities requiring dedicated or hard plumbed water lines, the dispensing unit at the 3-compartment sink must be connected to a "TEMPERED" water source. This may require the installation of a mixing/tempering valve.

ECOLAB Key Chemical Company
8500 Capital Drive
Greensboro, NC 27409-9796, USA 800.529.5458

QSR 44-980/8000702
©2002 Key Chemical Company. All Rights Reserved.



MOP SINK INSTALLATION **C**

782 FAN MOTOR STARTERS, SURFACE MOUNTED, TYP. OF 2.
785 TEMPERATURE SENSOR. SEE MECHANICAL DRAWINGS.

KEYNOTE **A**


TOTAL SEATS	ACCESSIBLE SEATS
1 - 20	1
21 - 40	2
41 - 60	3
61 - 80	4
81 - 100	5
101 - 120	6
121 - 140	7

NUMBER OF ACCESSIBLE SEATS

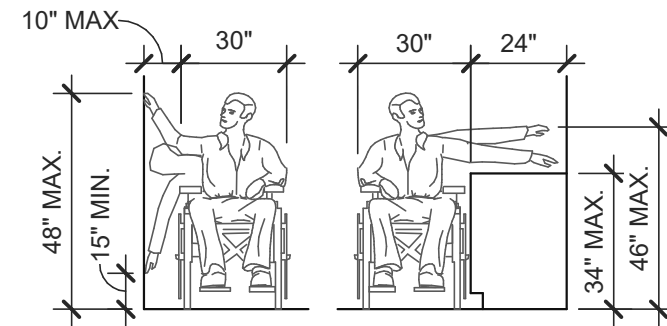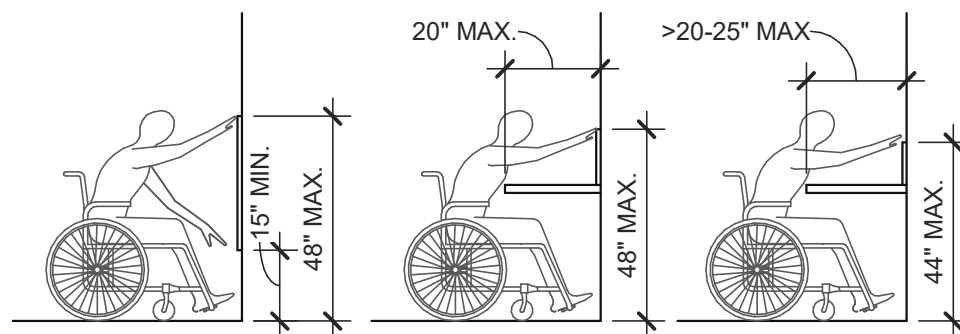


SIDE APPROACH


REACH RANGES 1/4" = 1'-0" **13**

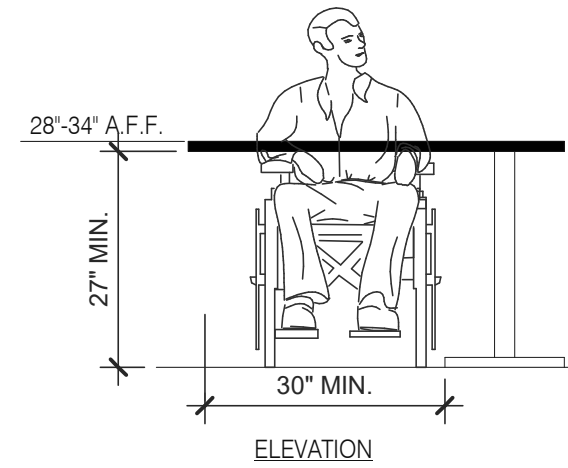


SEATING AND TABLES 1/2" = 1'-0" **18**

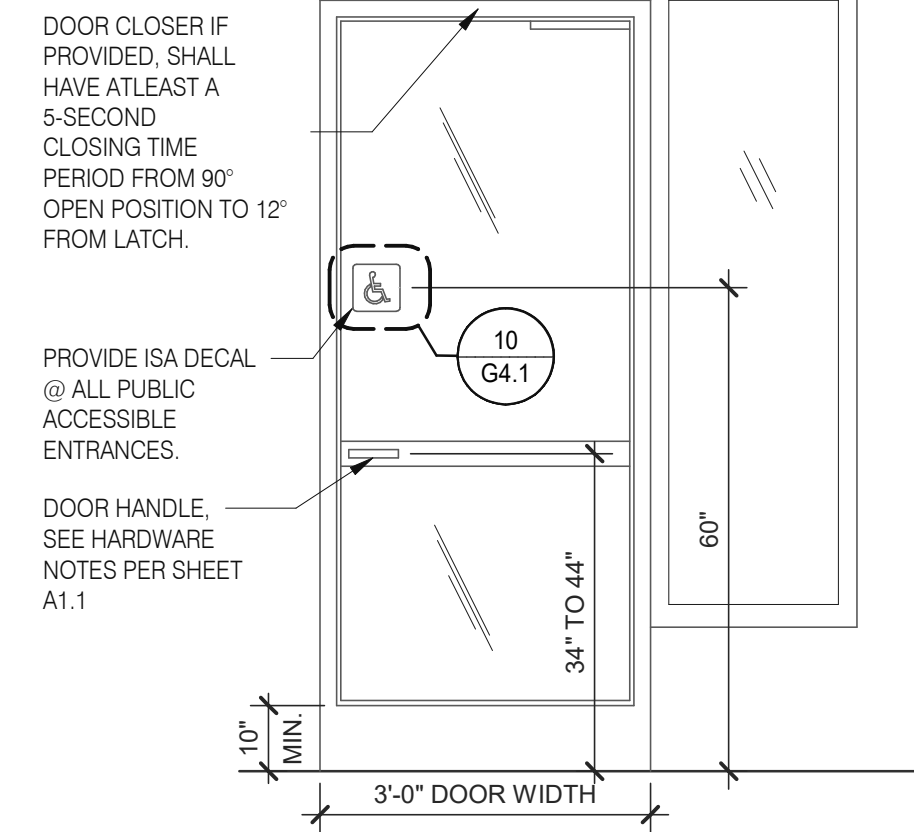


TYP. ENTRANCE / EXIT DOOR 3/8" = 1'-0" **14**

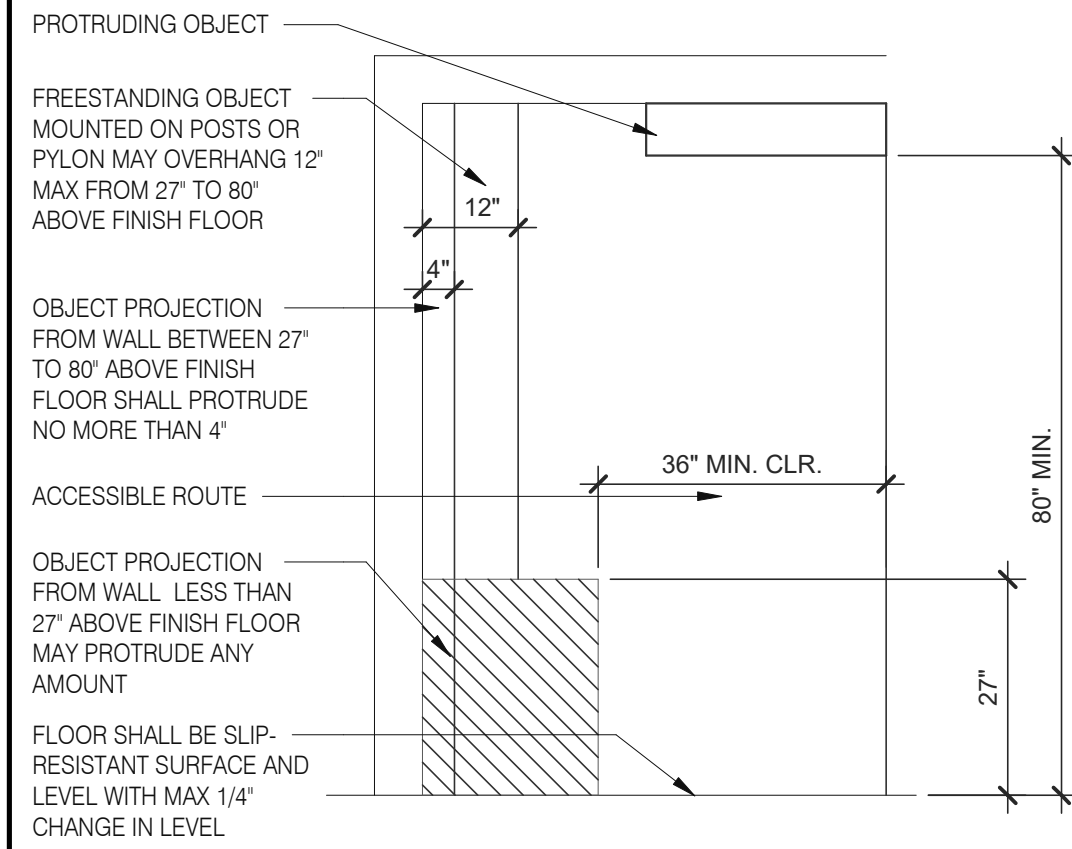


INT. ACCESS. ROUTE CLEARANCES 1/2" = 1'-0" **10**

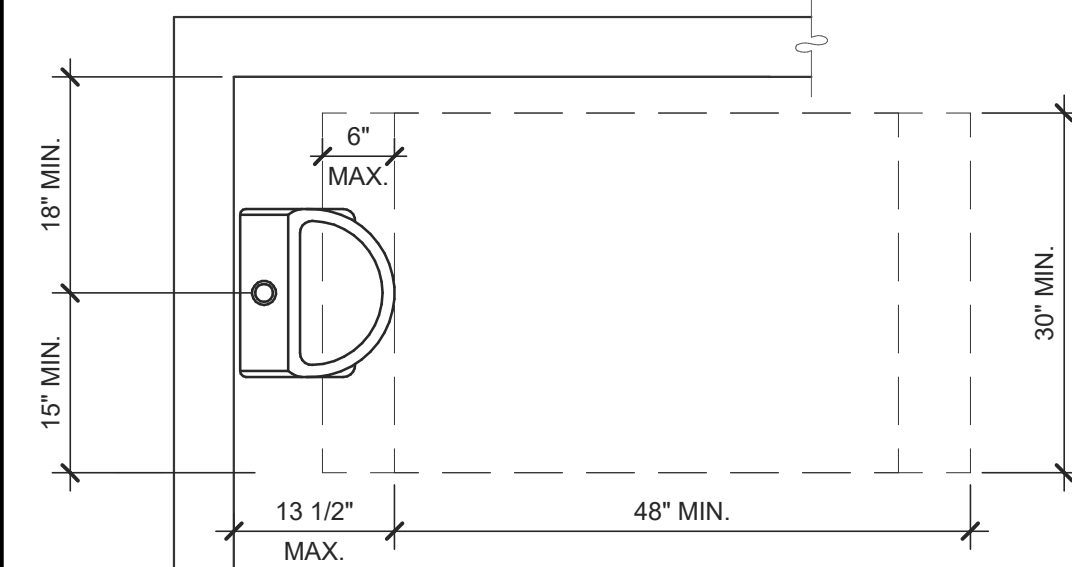


ACCESSIBLE URINAL 3/4" = 1'-0" **6**

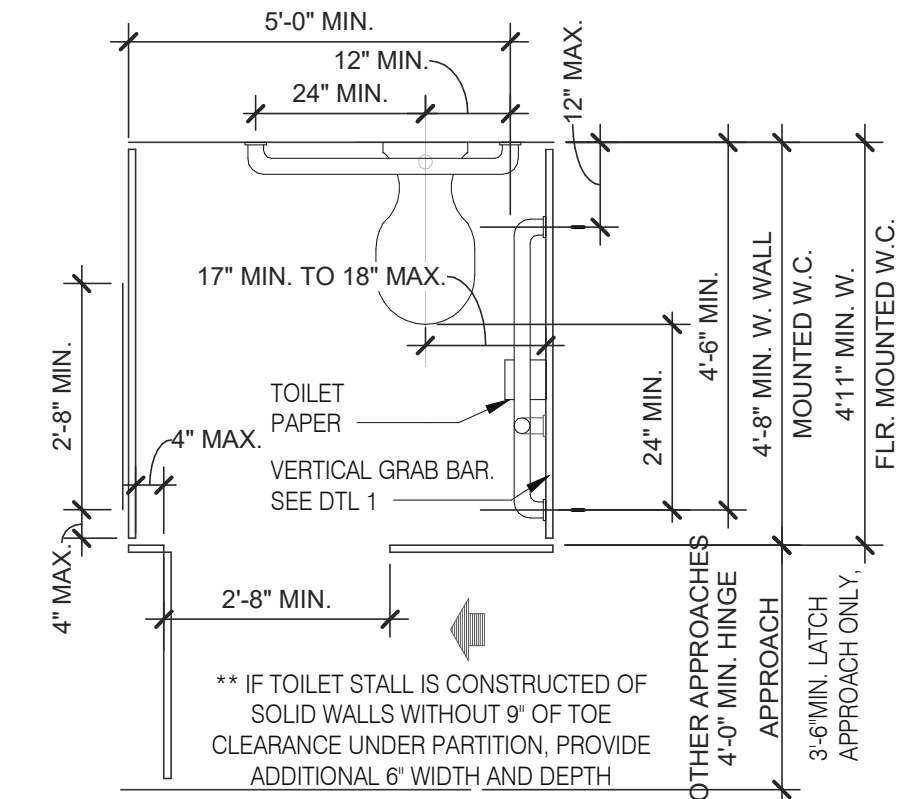


STANDARD TOILET STALL 1/2" = 1'-0" **2**

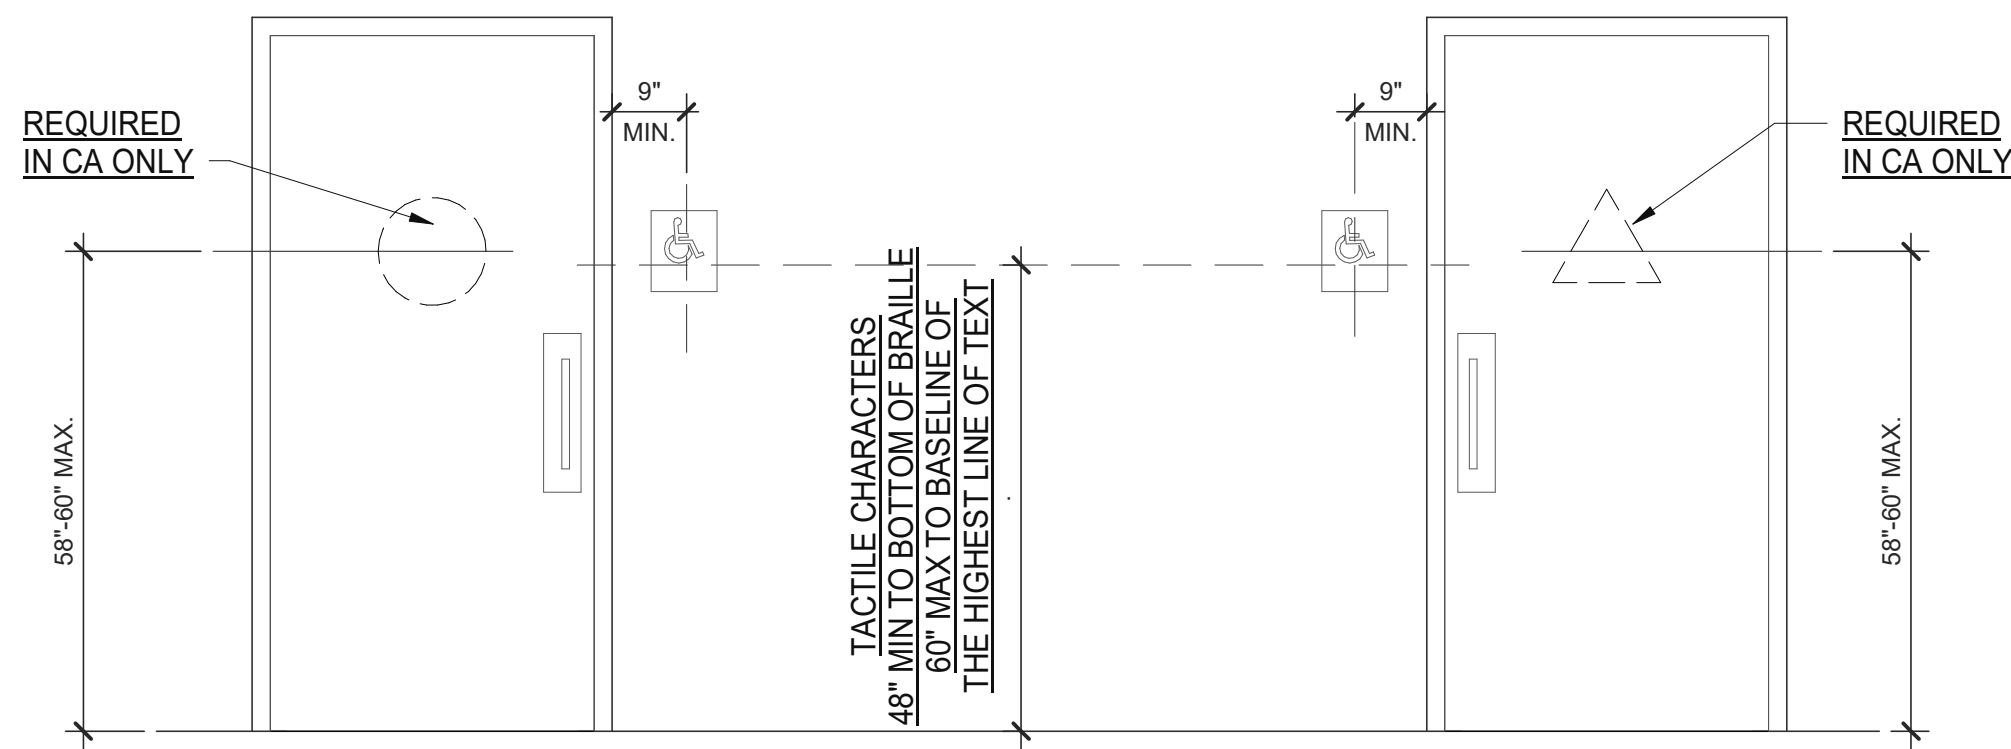

ACCESSIBLE RESTROOM DOORS 1/2" = 1'-0" **15**

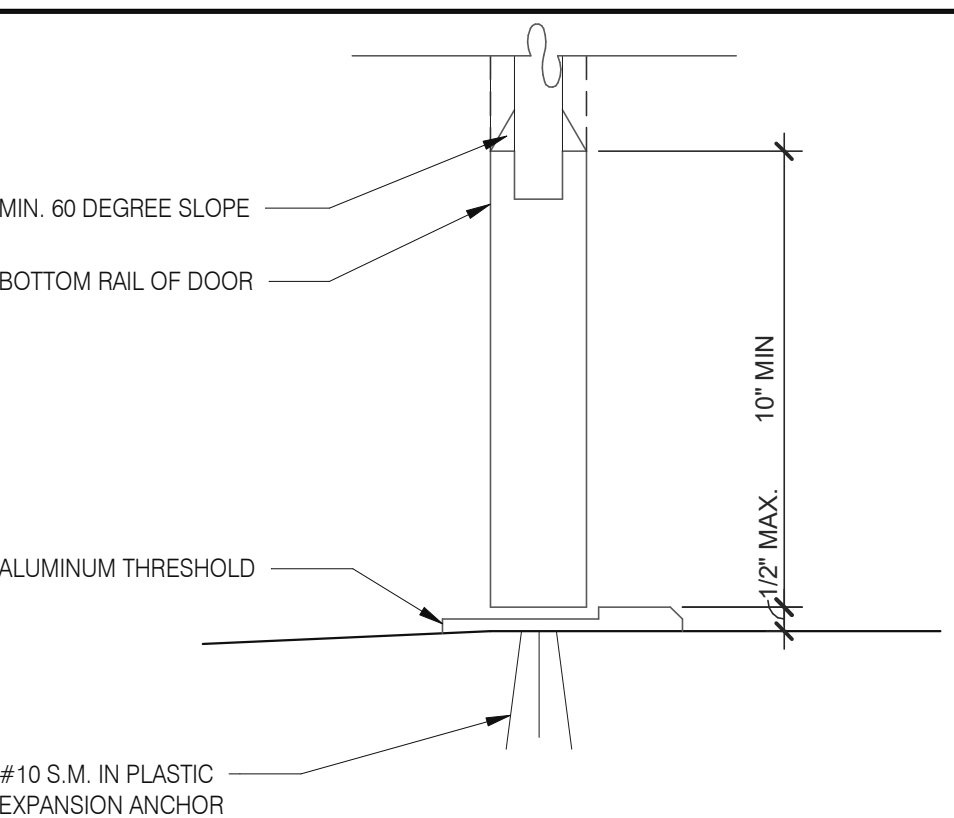


BOTTOM RAIL (EXTERIOR DOOR) 3" = 1'-0" **20**

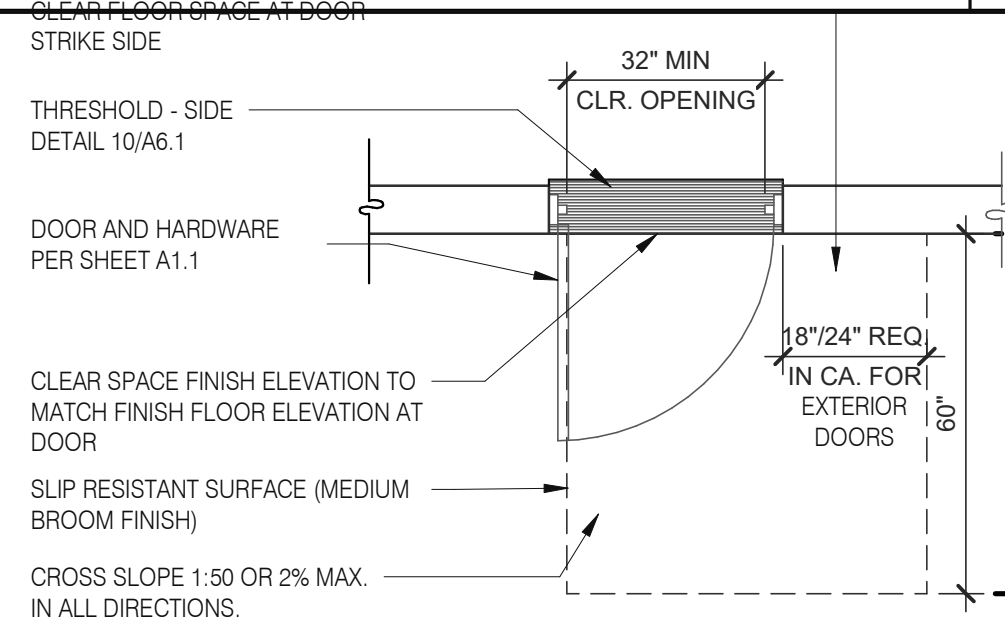


NOTE:
1. EXTERIOR DOOR PRESSURE CANNOT EXCEED 8.5 LBS. (GC TO DOOR PRESSURE TO MINIMUM ALLOWABLE BY AHJ).
2. INTERIOR DOOR PRESSURE CANNOT EXCEED 5 LBS.
3. 60% OF PUBLIC ENTRANCES MUST BE ACCESSIBLE (100% IN CA)

EXTERIOR DOOR REQUIREMENTS 3/8" = 1'-0" **16**

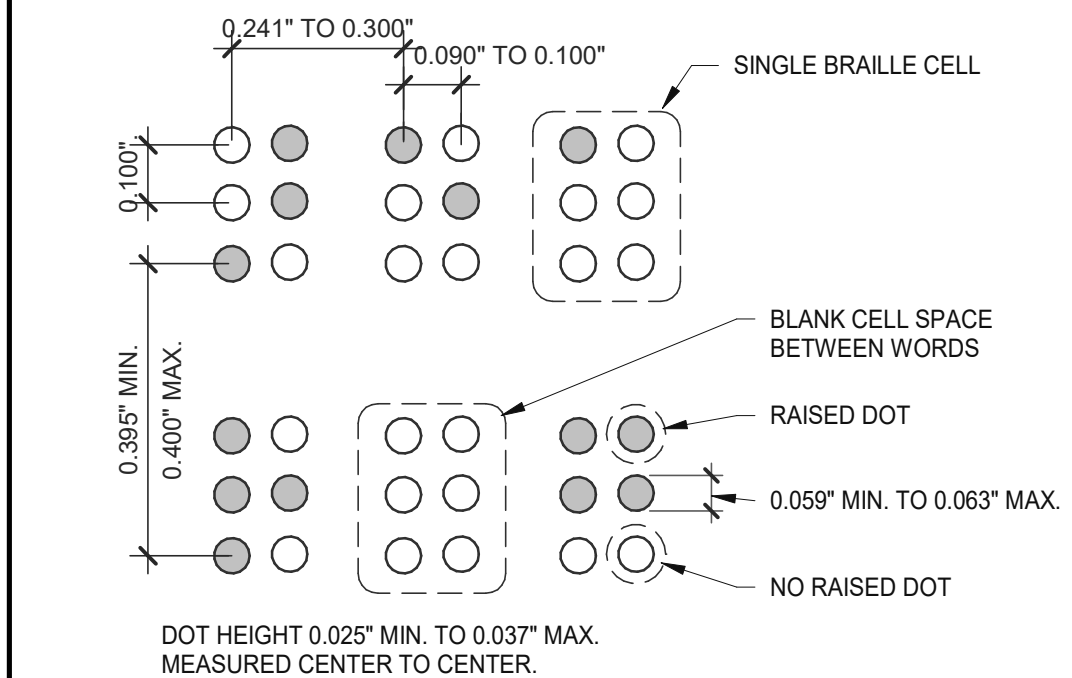


BRAILLE MEASUREMENT 1/4" = 1'-0" **11**


NOTES:
1. FLOOR AND GROUND SURFACES SHALL BE STABLE, FIRM AND SLIP RESISTANT.
2. CARPET OR CARPET TILE SHALL BE SECURELY ATTACHED AND SHALL HAVE A FIRM CUSHION, PAD OR BACKING OR NO CUSHION OR PAD. CARPET OR CARPET TILE SHALL HAVE A LEVEL LOOP, TEXTURED LOOP, LEVEL CUT PILE, LEVEL CUT/UNCUT PILE TEXTURE. PILE HEIGHT SHALL COMPLY WITH CARPET PILE HEIGHT FIGURE BELOW. EXPOSED EDGES OF CARPET SHALL BE FASTENED TO FLOOR SURFACES AND SHALL HAVE TRIM ON THE ENTIRE LENGTH OF THE EXPOSED EDGE. CARPET EDGE SHALL COMPLY WITH CHANGE IN LEVEL FIGURES BELOW.

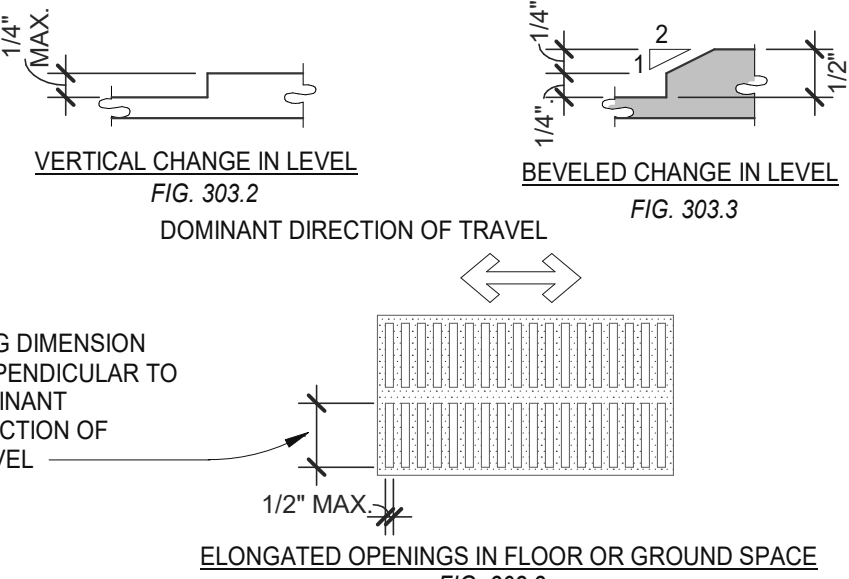

CHANGES IN LEVEL 1/2" = 1'-0" **12**

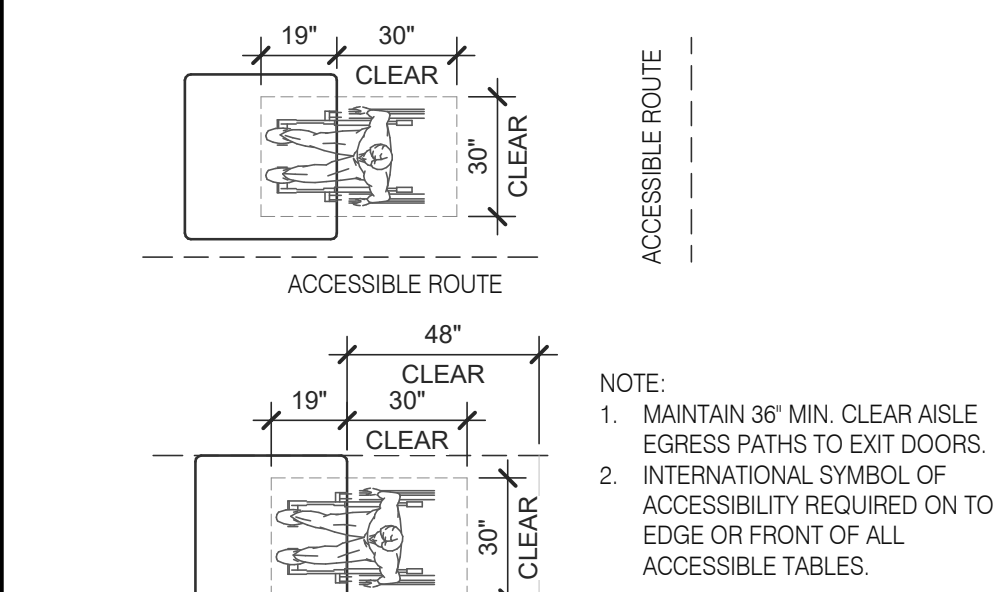

DINING SEATING CLEARANCES N.T.S. **8**

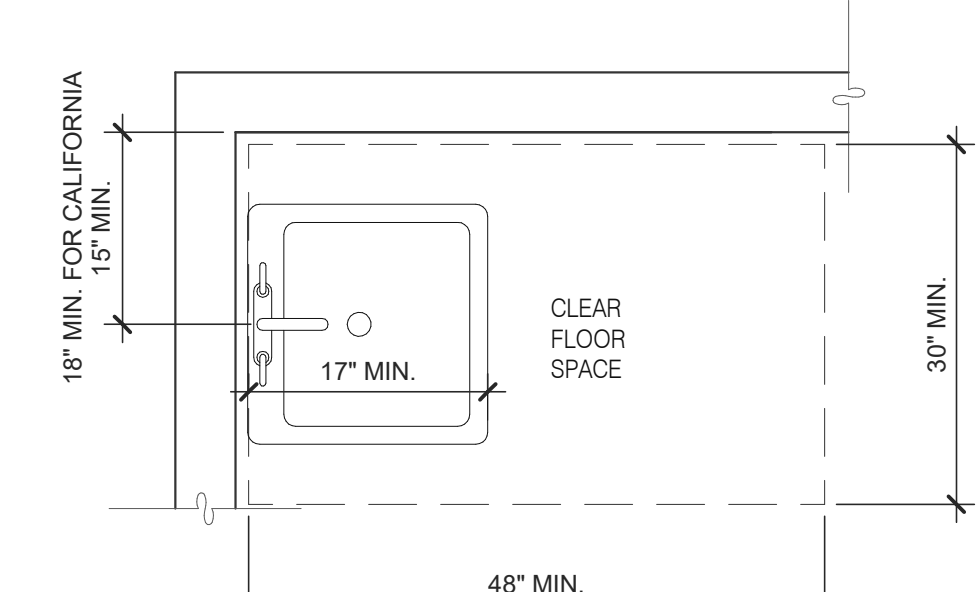

ACCESSIBLE LAVATORY 3/4" = 1'-0" **3**

1. INDICATED DIMENSIONS, HEIGHTS, DEPTHS, AREAS AND OTHER GRAPHIC INFORMATION ARE PROVIDED AS MINIMUMS THAT MUST BE MAINTAINED. THESE MINIMUMS ARE BASED UPON YUM STANDARDS AND MAY EXCEED ADA REQUIREMENTS.
THE DETAILS SHOWN ARE CONCEPTUAL ONLY AND INTENDED TO SHOW ABSOLUTE MINIMUMS AND SHALL BE COORDINATED WITH THE OTHER CONSTRUCTION DOCUMENTS ASSOCIATED WITH THIS PROJECT.
2. 60" TURNING SPACE
- PERMITTED OVERLAP LIMITED TO 1 ARM OF T-SHAPED SPACE
- CAN OVERLAP FIXTURE & DOOR CLEARANCE
- DOOR CAN SWING INTO TURNING SPACE A MAXIMUM OF 12"
3. RESTROOM, IN GENERAL, DOOR SWING MUST BE OUTSIDE OF THE FIXTURE CLEAR FLOOR SPACE HOWEVER A DOOR CAN SWING INTO FIXTURE CLEAR FLOOR SPACE IF WHEELCHAIR SPACE 30"x48" IS PROVIDED BEYOND THE DOOR SWING.
4. TOILET ROOM MUST ALLOW FOR SIDE TRANSFER - 42" BETWEEN FIXTURES.
5. ADAPT TEAM TO VERIFY LOCAL CODE REQUIREMENTS.

GENERAL NOTES **4**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER:
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY: RS
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE
DETROIT, MI 48236




ENDEAVOR 2.0 ACCESSIBILITY REQUIREMENTS

ADA1.0


PLOT DATE: 11/3/2022 11:20:33 AM

ACCESSIBILITY NOTES

- "THE ACCESSIBILITY GUIDELINES AND CODES" MENTIONED BELOW REFER TO ALL APPLICABLE LOCAL/STATE BUILDING CODES REFERENCED ON THE PROJECT DATA SHEET OF THIS SET IN ADDITION TO THE FEDERAL REQUIREMENTS OF THE ADA (THE AMERICANS WITH DISABILITIES ACT).
- DETAILS ON THIS SHEET ARE FOR REFERENCE ONLY. REFER TO THE ACCESSIBILITY GUIDELINES AND CODES FOR ALL ACCESSIBILITY REQUIREMENTS.
- THE GENERAL CONTRACTOR SHALL BECOME FAMILIAR WITH THE ACCESSIBILITY GUIDELINES AND CODES.
- ANY DISCREPANCY CONTAINED HEREIN DOES NOT RELIEVE THE GENERAL CONTRACTOR OR OWNER FROM COMPLYING WITH THE ACCESSIBILITY GUIDELINES AND CODES.

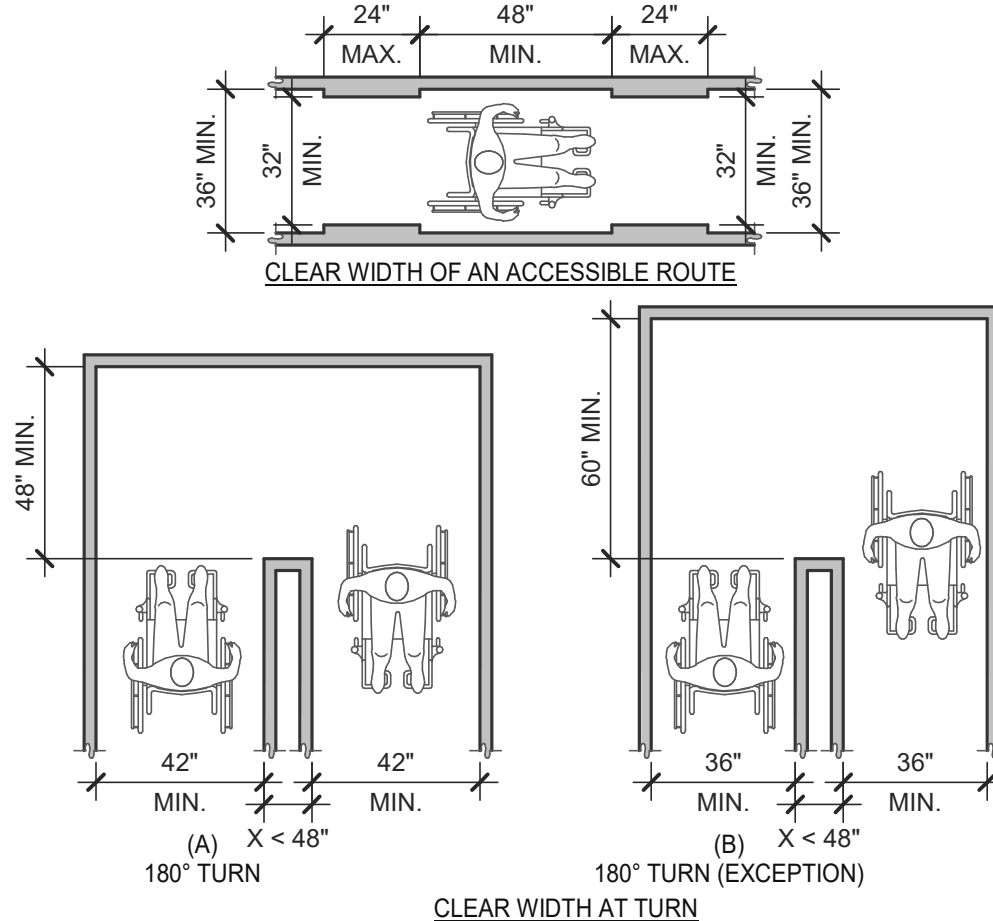


CLEAR WIDTH 1/4" = 1'-0" **17**

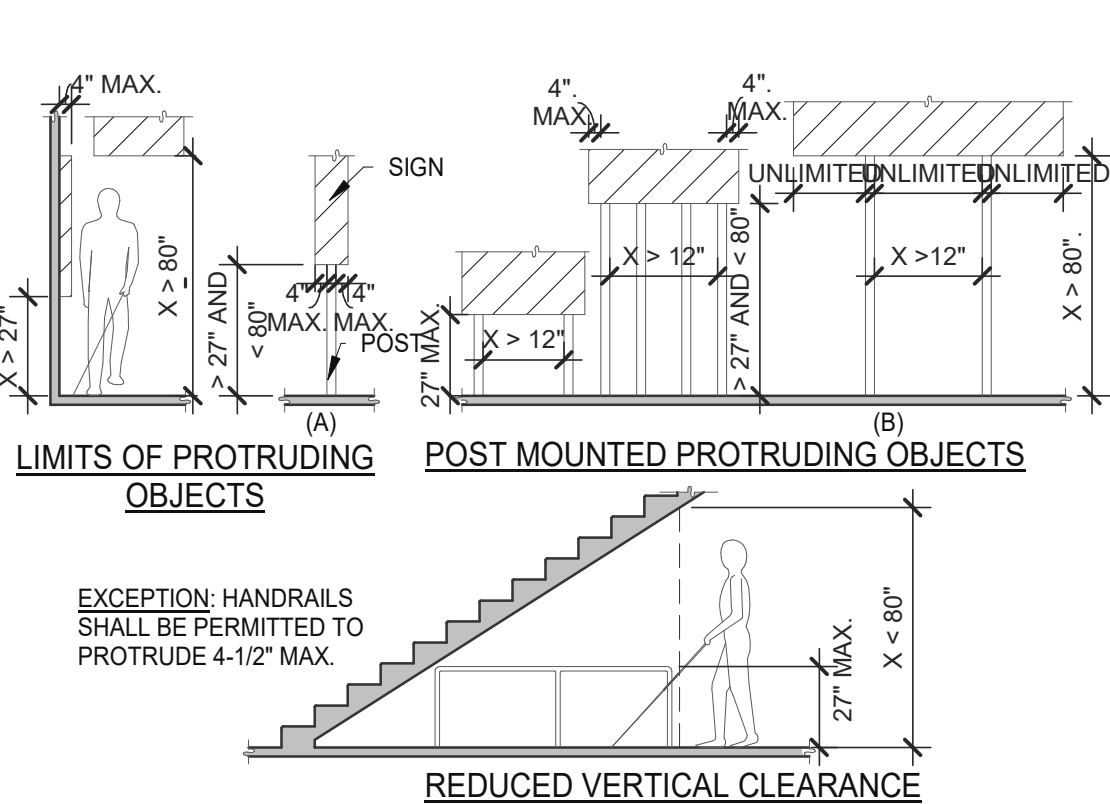

PROTRUDING OBJECTS 3/16" = 1'-0" **13**


NOTES:
 1. FLOOR OR GROUND SURFACE WITHIN REQUIRED MANEUVERING CLEARANCES SHALL COMPLY WITH [FLOOR OR GROUND SURFACES & CHANGES IN LEVEL] DETAIL AND SHALL HAVE A SLOPE NOT STEEPER THAN 1:48. CHANGES IN LEVEL ARE NOT PERMITTED AT DOOR LANDINGS.
 2. THRESHOLDS, IF PROVIDED AT DOORWAYS SHALL BE 1/2" HIGH MAX. RAISED THRESHOLDS AND CHANGES IN LEVEL AT DOORWAYS SHALL COMPLY WITH [FLOOR OR GROUND SURFACES & CHANGES IN LEVEL] DETAIL.
 3. HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERABLE PARTS ON DOORS AND GATES SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OR THE WRIST.
 4. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 LBS (22.5 N) MAX.
 5. OPERABLE PARTS OF DOOR HARDWARE SHALL BE 34" MIN. AND 48" MAX. ABOVE THE FINISH FLOOR OR GROUND.
 6. WHEN SLIDING DOORS ARE IN THE FULLY OPEN POSITION, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES.
 7. DOOR AND GATE CLOSERS SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 90° THE TIME REQUIRED TO MOVE THE DOOR TO A POSITION OF 12° FROM THE LATCH IS 5 SECONDS MIN.
 8. DOOR AND GATE SPRING HINGES SHALL BE ADJUSTED SO THAT FROM THE OPEN POSITION OF 70° THE DOOR OR GATE SHALL MOVE TO THE CLOSED POSITION IN 1.5 SECONDS MIN.
 9. THE FORCE FOR PUSHING OR PULLING OPEN A DOOR OR GATE SHALL BE AS FOLLOWS:
 9.1. INTERIOR HINGED DOORS AND GATES: 5 LBS (22.5 N) MAX.
 9.2. SLIDING OR FOLDING DOORS: 5 LBS (22.5 N) MAX.
 9.3. REQUIRED FIRE DOORS: THE MINIMUM OPENING FORCE ALLOWABLE BY THE APPROPRIATE ADMINISTRATIVE AUTHORITY, NOT TO EXCEED 15 LBS (68.7N).
 9.4. EXTERIOR HINGED DOORS: 5 LBS (22.5 N) MAX.
 10. SWINGING DOOR AND GATE SURFACES WITHIN 10" OF THE FINISH FLOOR OR GROUND MEASURED VERTICALLY SHALL HAVE A SMOOTH SURFACE ON THE PUSH SIDE EXTENDING THE FULL WIDTH OF THE DOOR OR GATE. PARTS CREATING HORIZONTAL OR VERTICAL JOINTS IN THESE SURFACE SHALL BE WITHIN 1/16" OF THE SAME PLANE AS THE OTHER AND BE FREE OF SHARP OR ABRASIVE EDGES. CAVITIES CREATED BY ADDED KICK PLATES SHALL BE CAPPED.
 11. WHERE AUTOMATIC AND POWER-ASSISTED DOORS AND GATES WITHOUT STANDBY POWER ARE PART OF A MEANS OF EGRESS THE CLEAR BREAK OUT OPENING AT SWINGING OR SLIDING DOORS AND GATES SHALL BE 32" MIN. WHEN OPERATED IN EMERGENCY MODE.

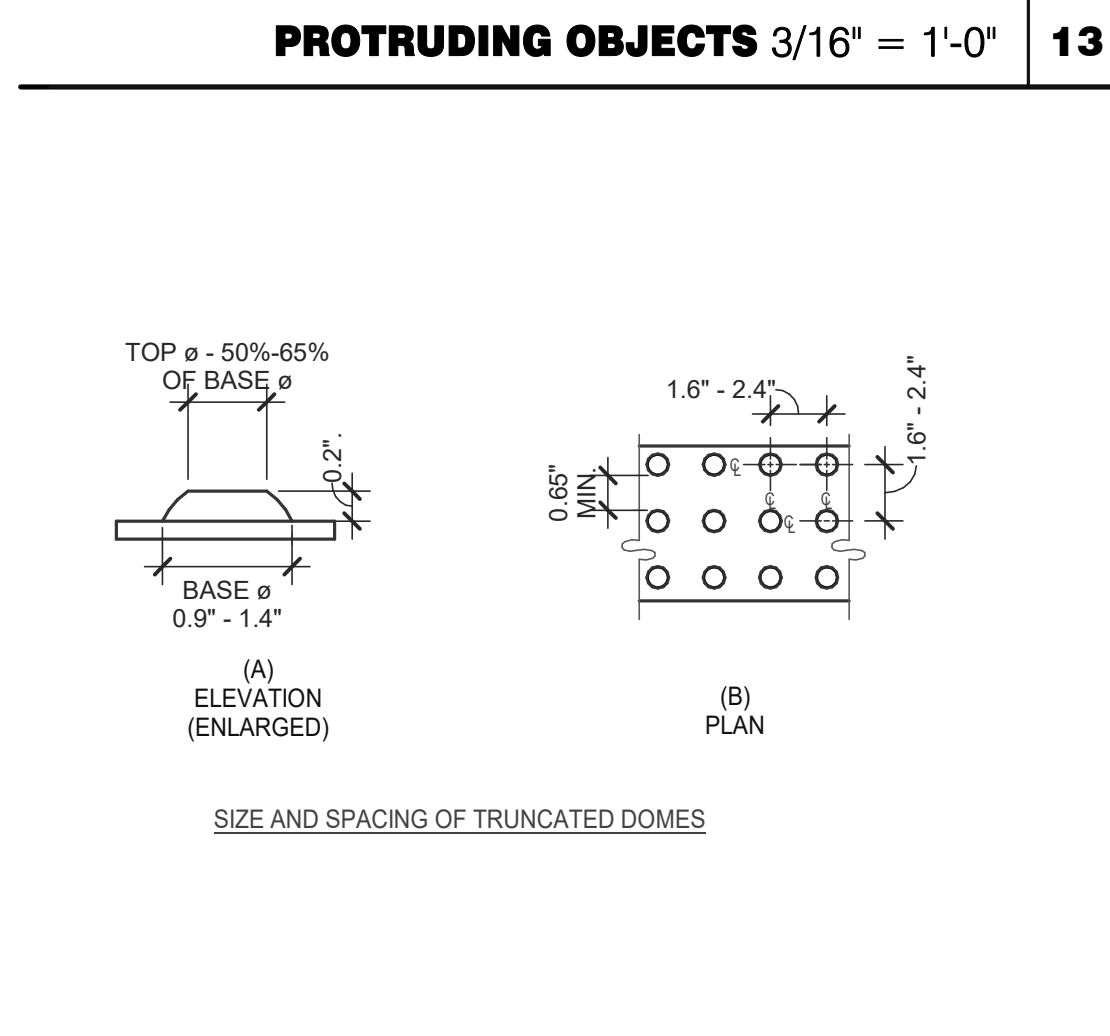



DETECTABLE WARNINGS 3" = 1'-0" **14**

PARKING SPACES


TOTAL NUMBER OF PARKING SPACES PROVIDED IN PARKING FACILITY	MINIMUM NUMBER OF REQUIRED ACCESSIBLE PARKING SPACES
1 TO 25	1
26 TO 50	2
51 TO 75	3
76 TO 100	4
101 TO 150	5
151 TO 200	6
201 TO 300	7
301 TO 400	8
401 TO 500	9
501 TO 1000	2 PERCENT OF TOTAL
1001 AND OVER	20, PLUS 1 FOR EACH 100, OR FRACTION THEREOF, OVER 1000

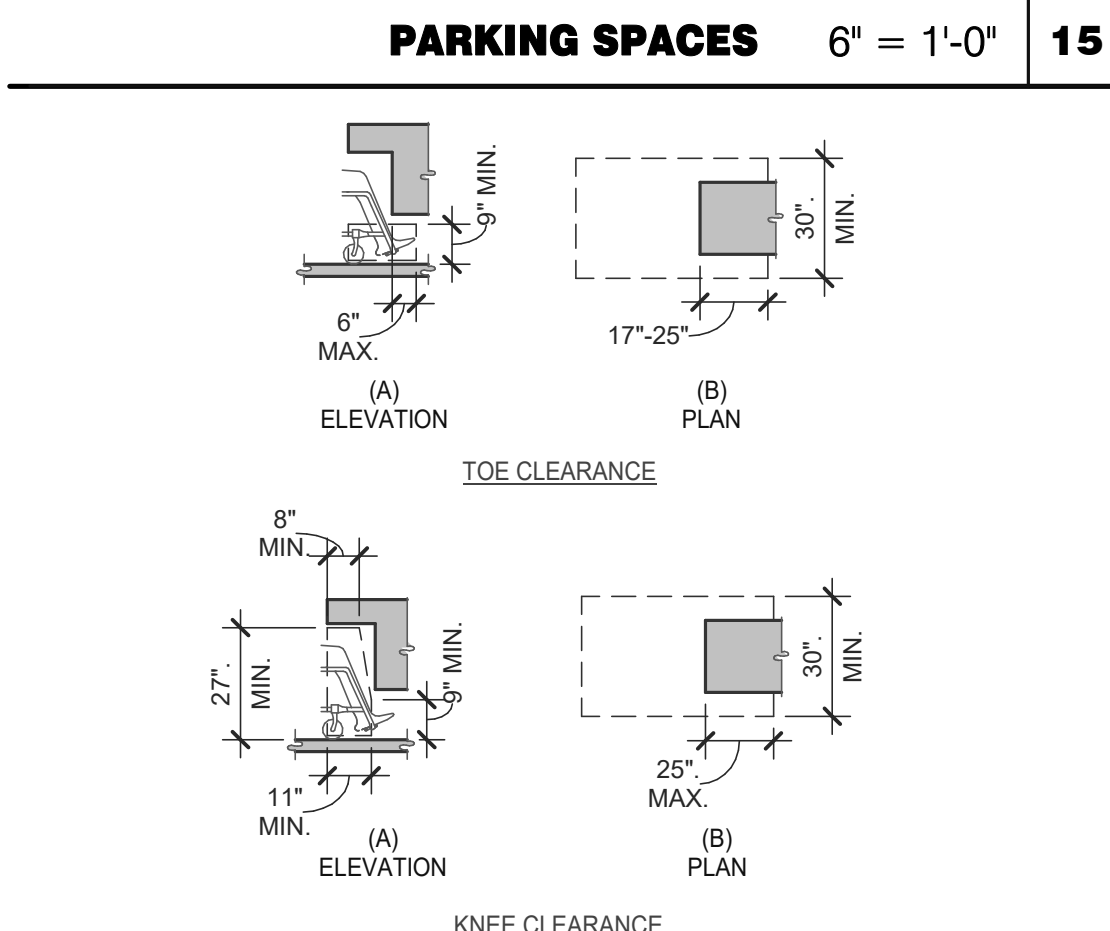


KNEE AND TOE CLEARANCE 1/4" = 1'-0" **16**

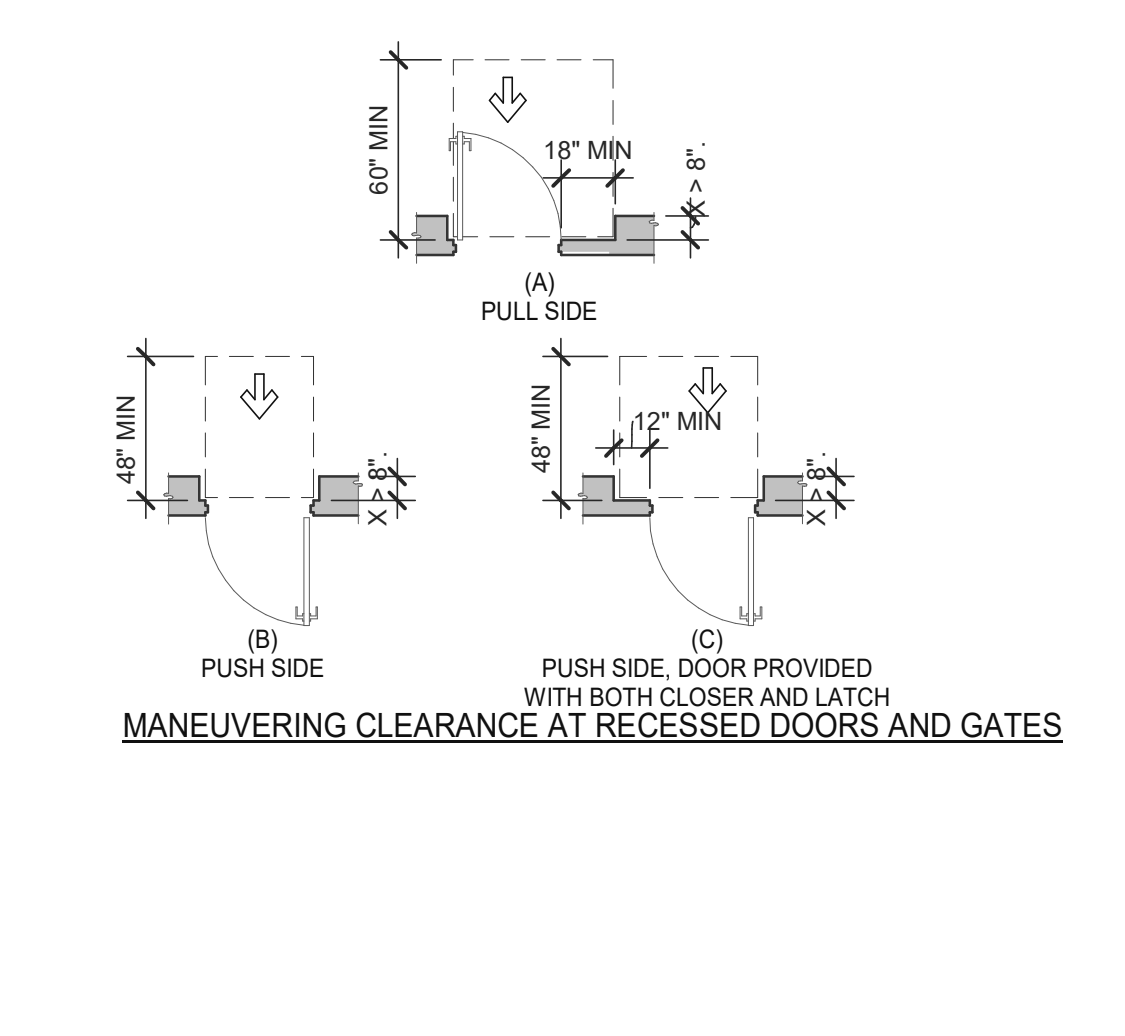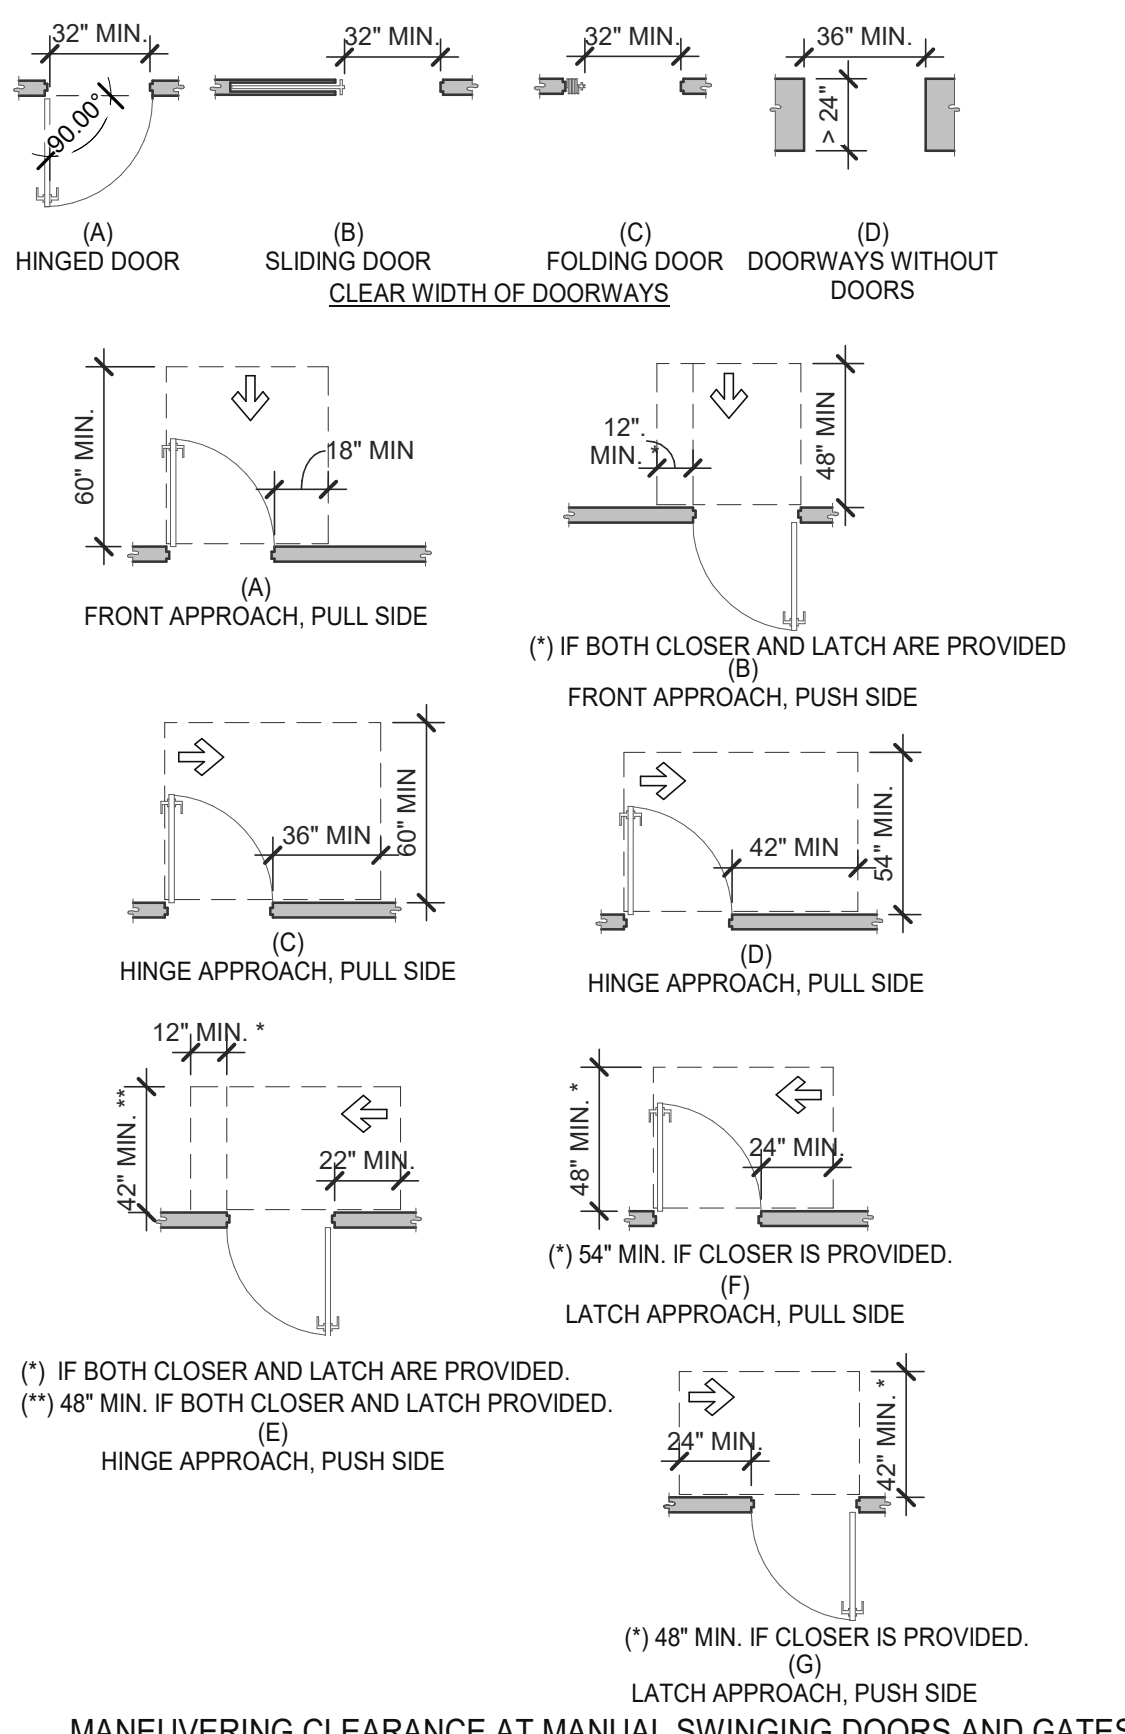


DOORS, DOORWAYS & GATES 3/16" = 1'-0" **12**

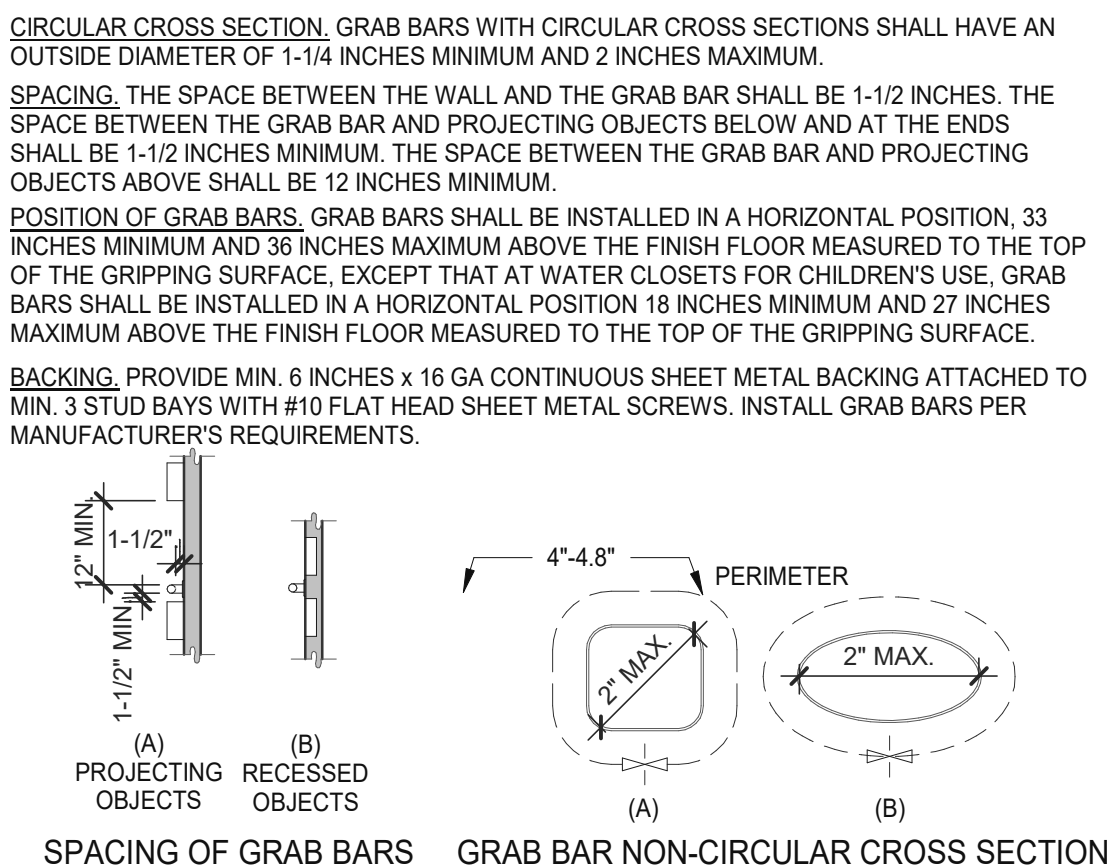


GRAB BARS 3/16" = 1'-0" **5**

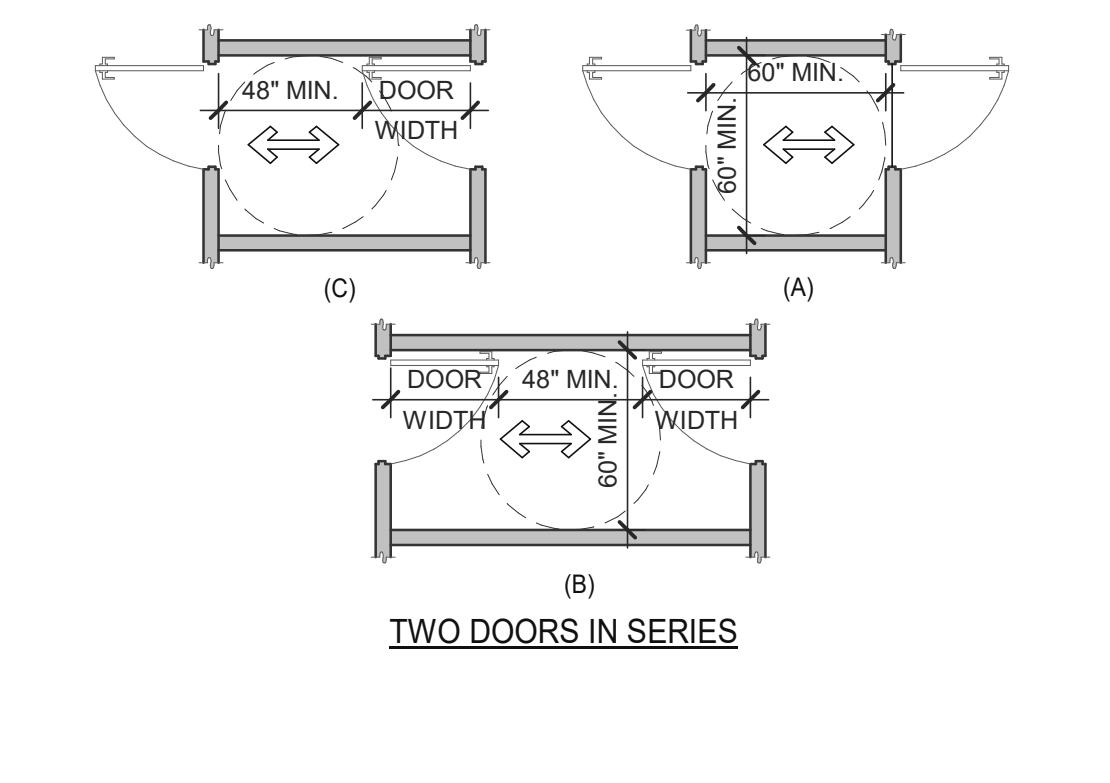


DOORS, DOORWAYS & GATES 3/16" = 1'-0" **6**

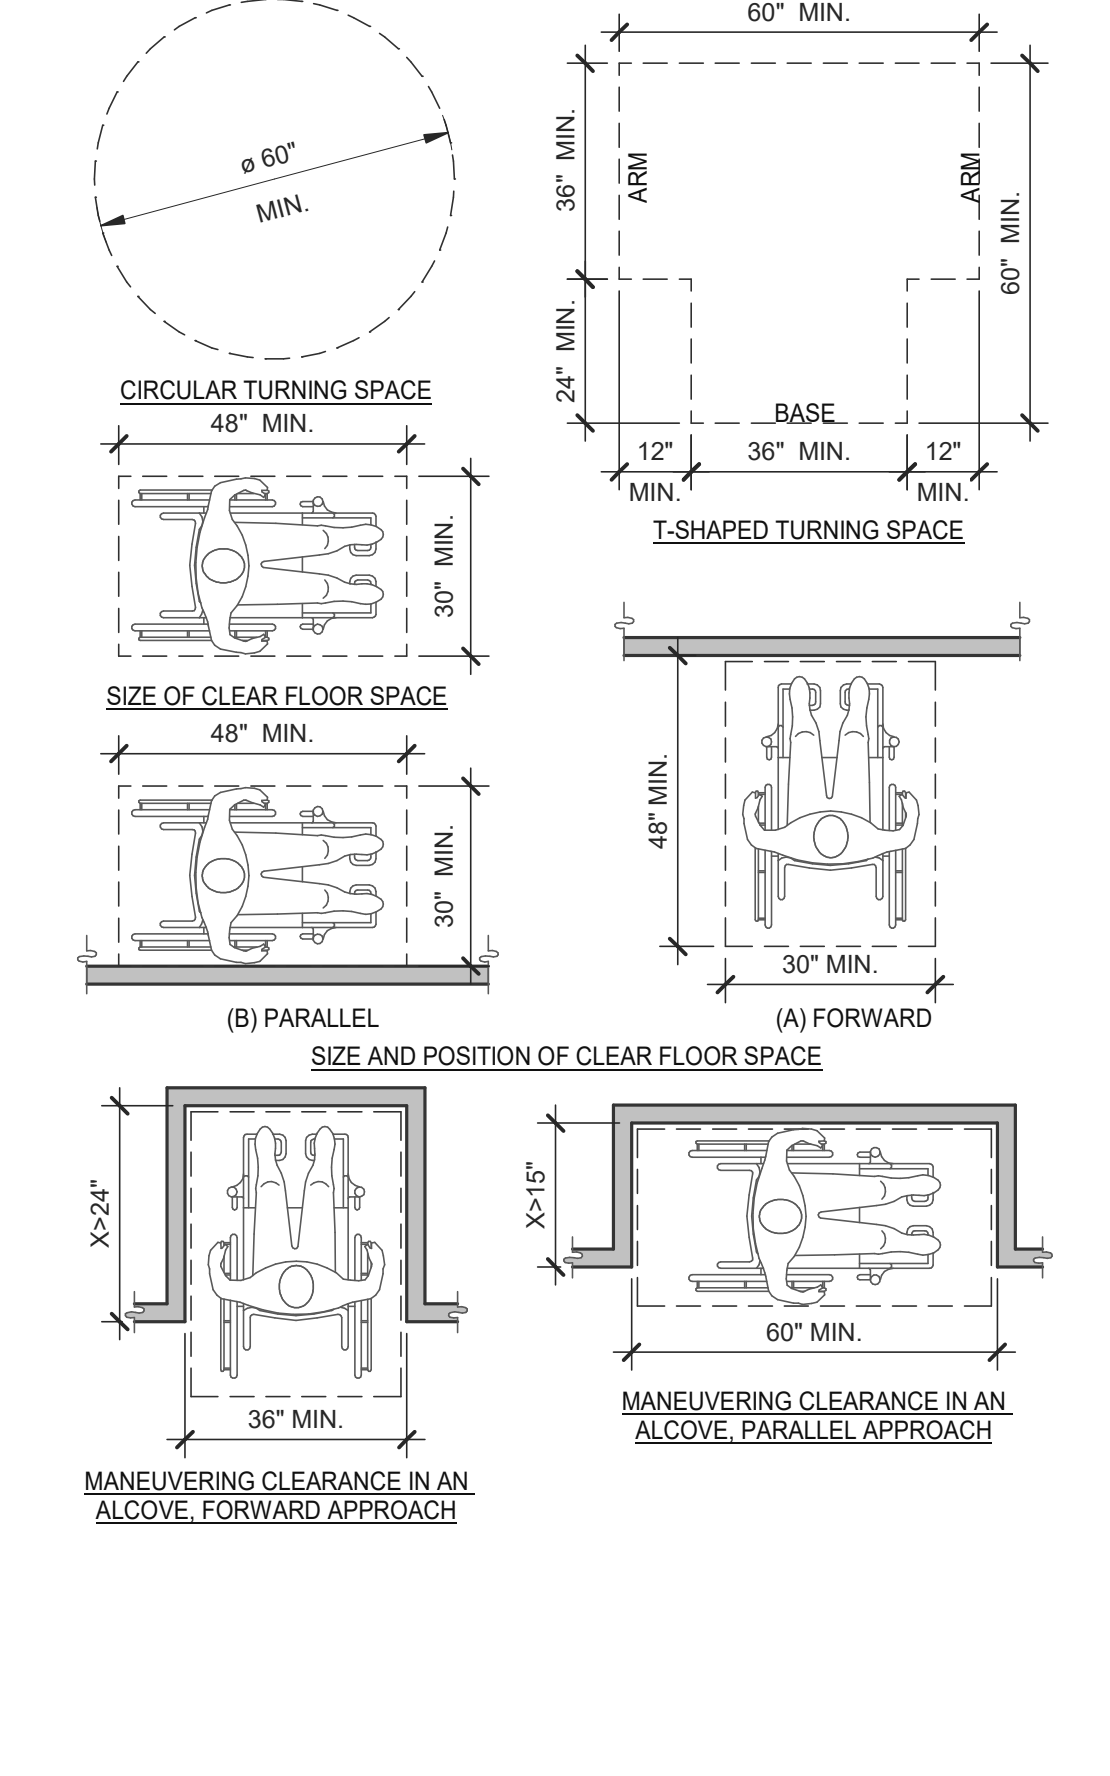

CLEAR FLOOR OR GROUND SPACE 3/8" = 1'-0" **8**

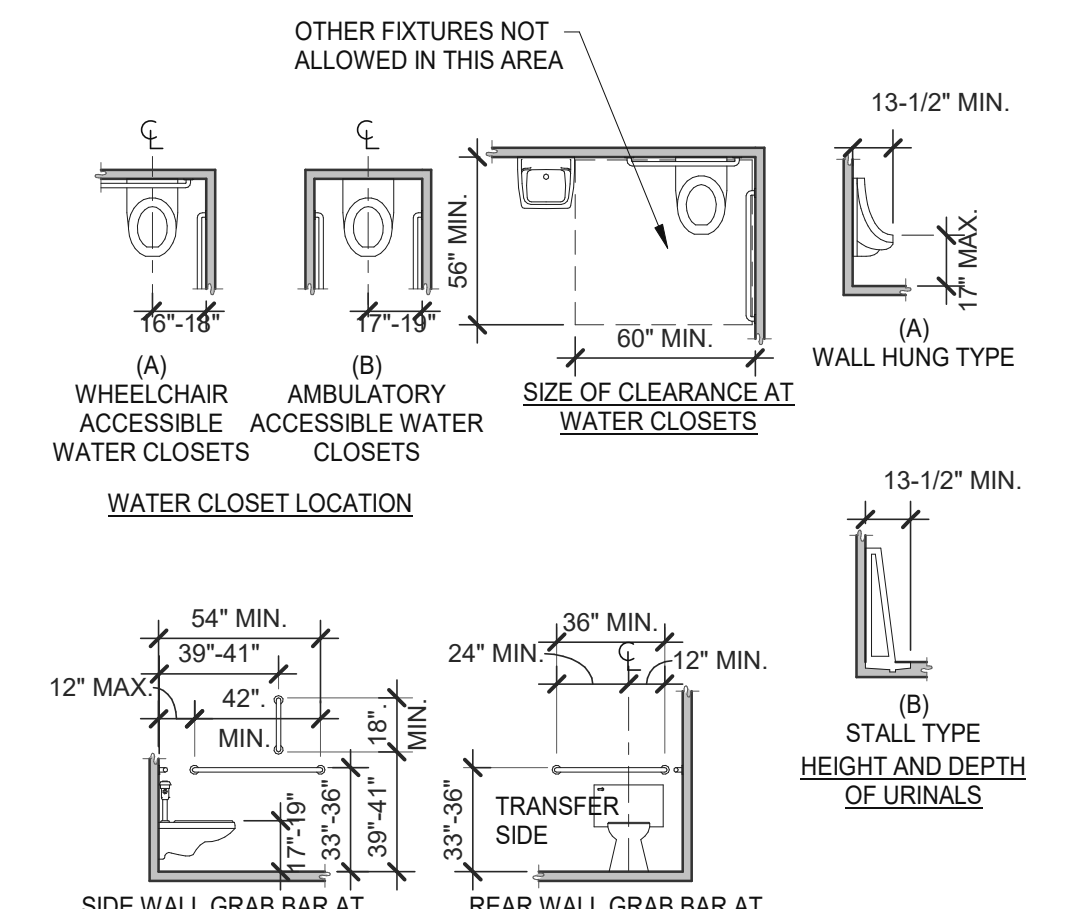

WC AND TOILET COMPARTMENTS 3/16" = 1'-0" **4**

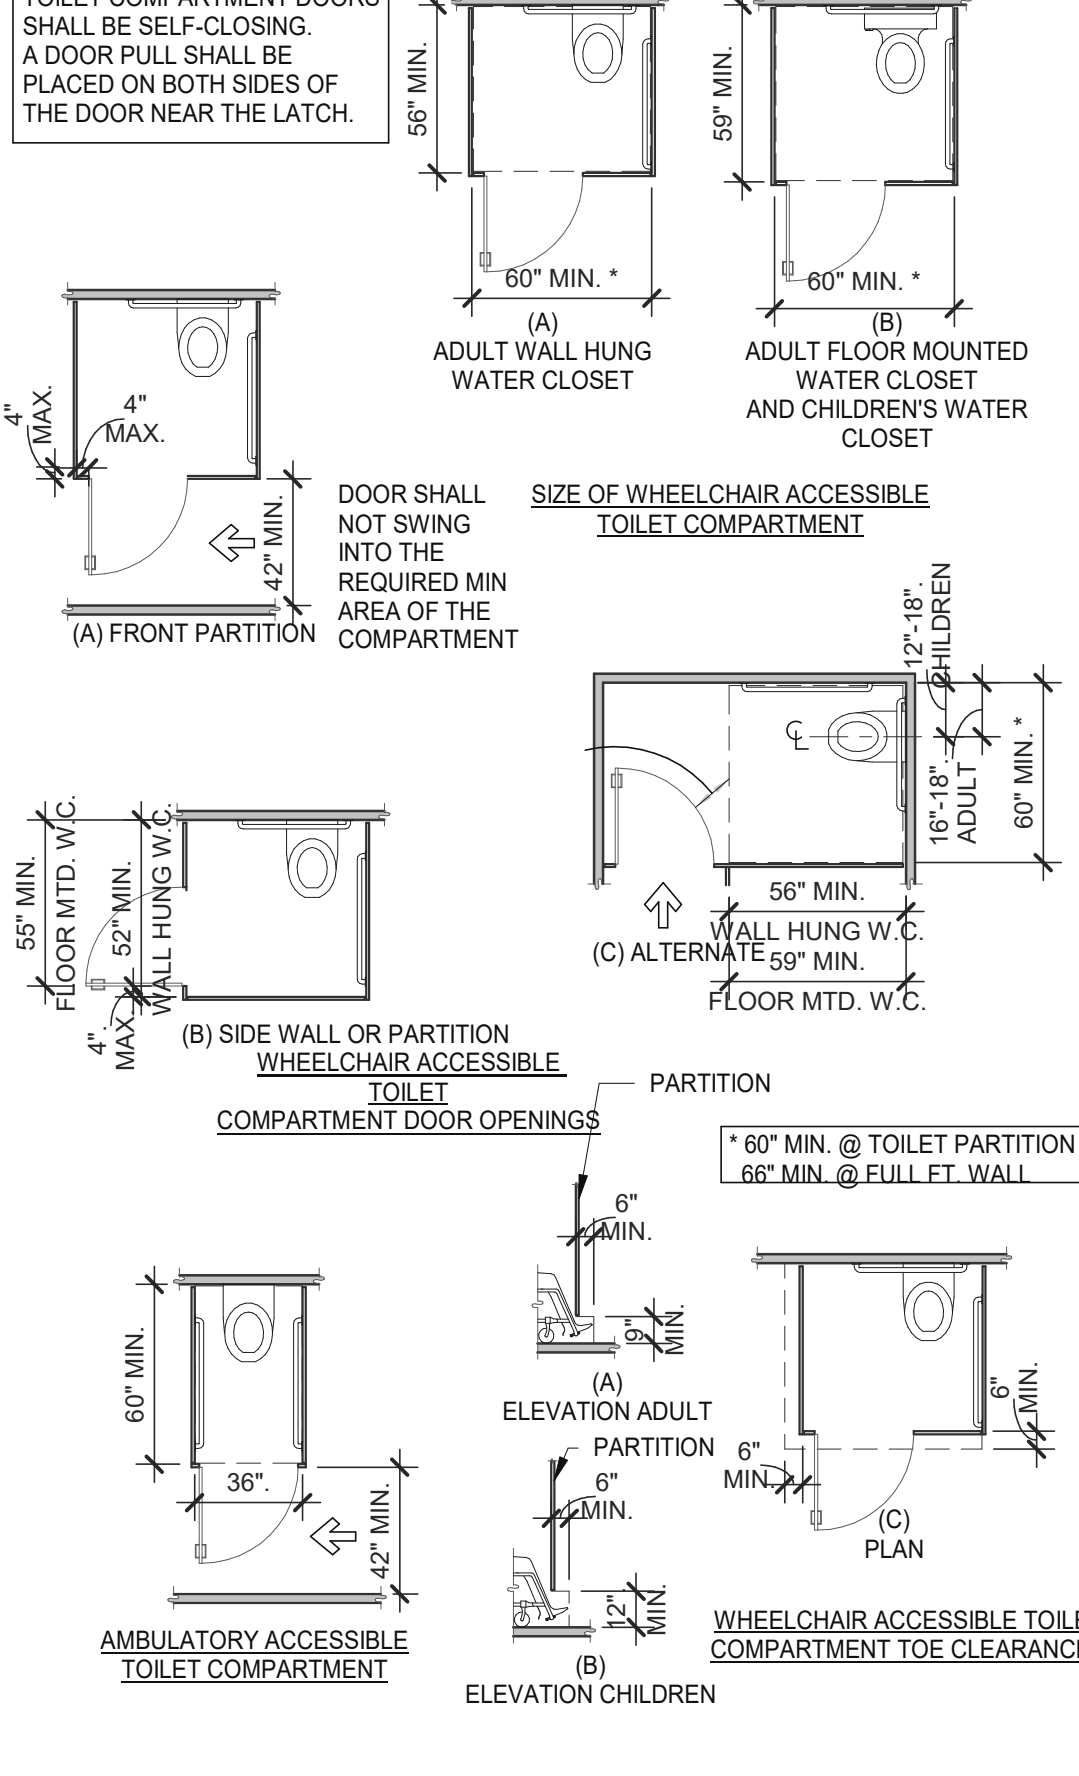

WC AND TOILET COMPARTMENTS 3/16" = 1'-0" **4**

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236




**ENDEAVOR 2.0
 ACCESSIBILITY
 REQUIREMENTS**

ADA1.1

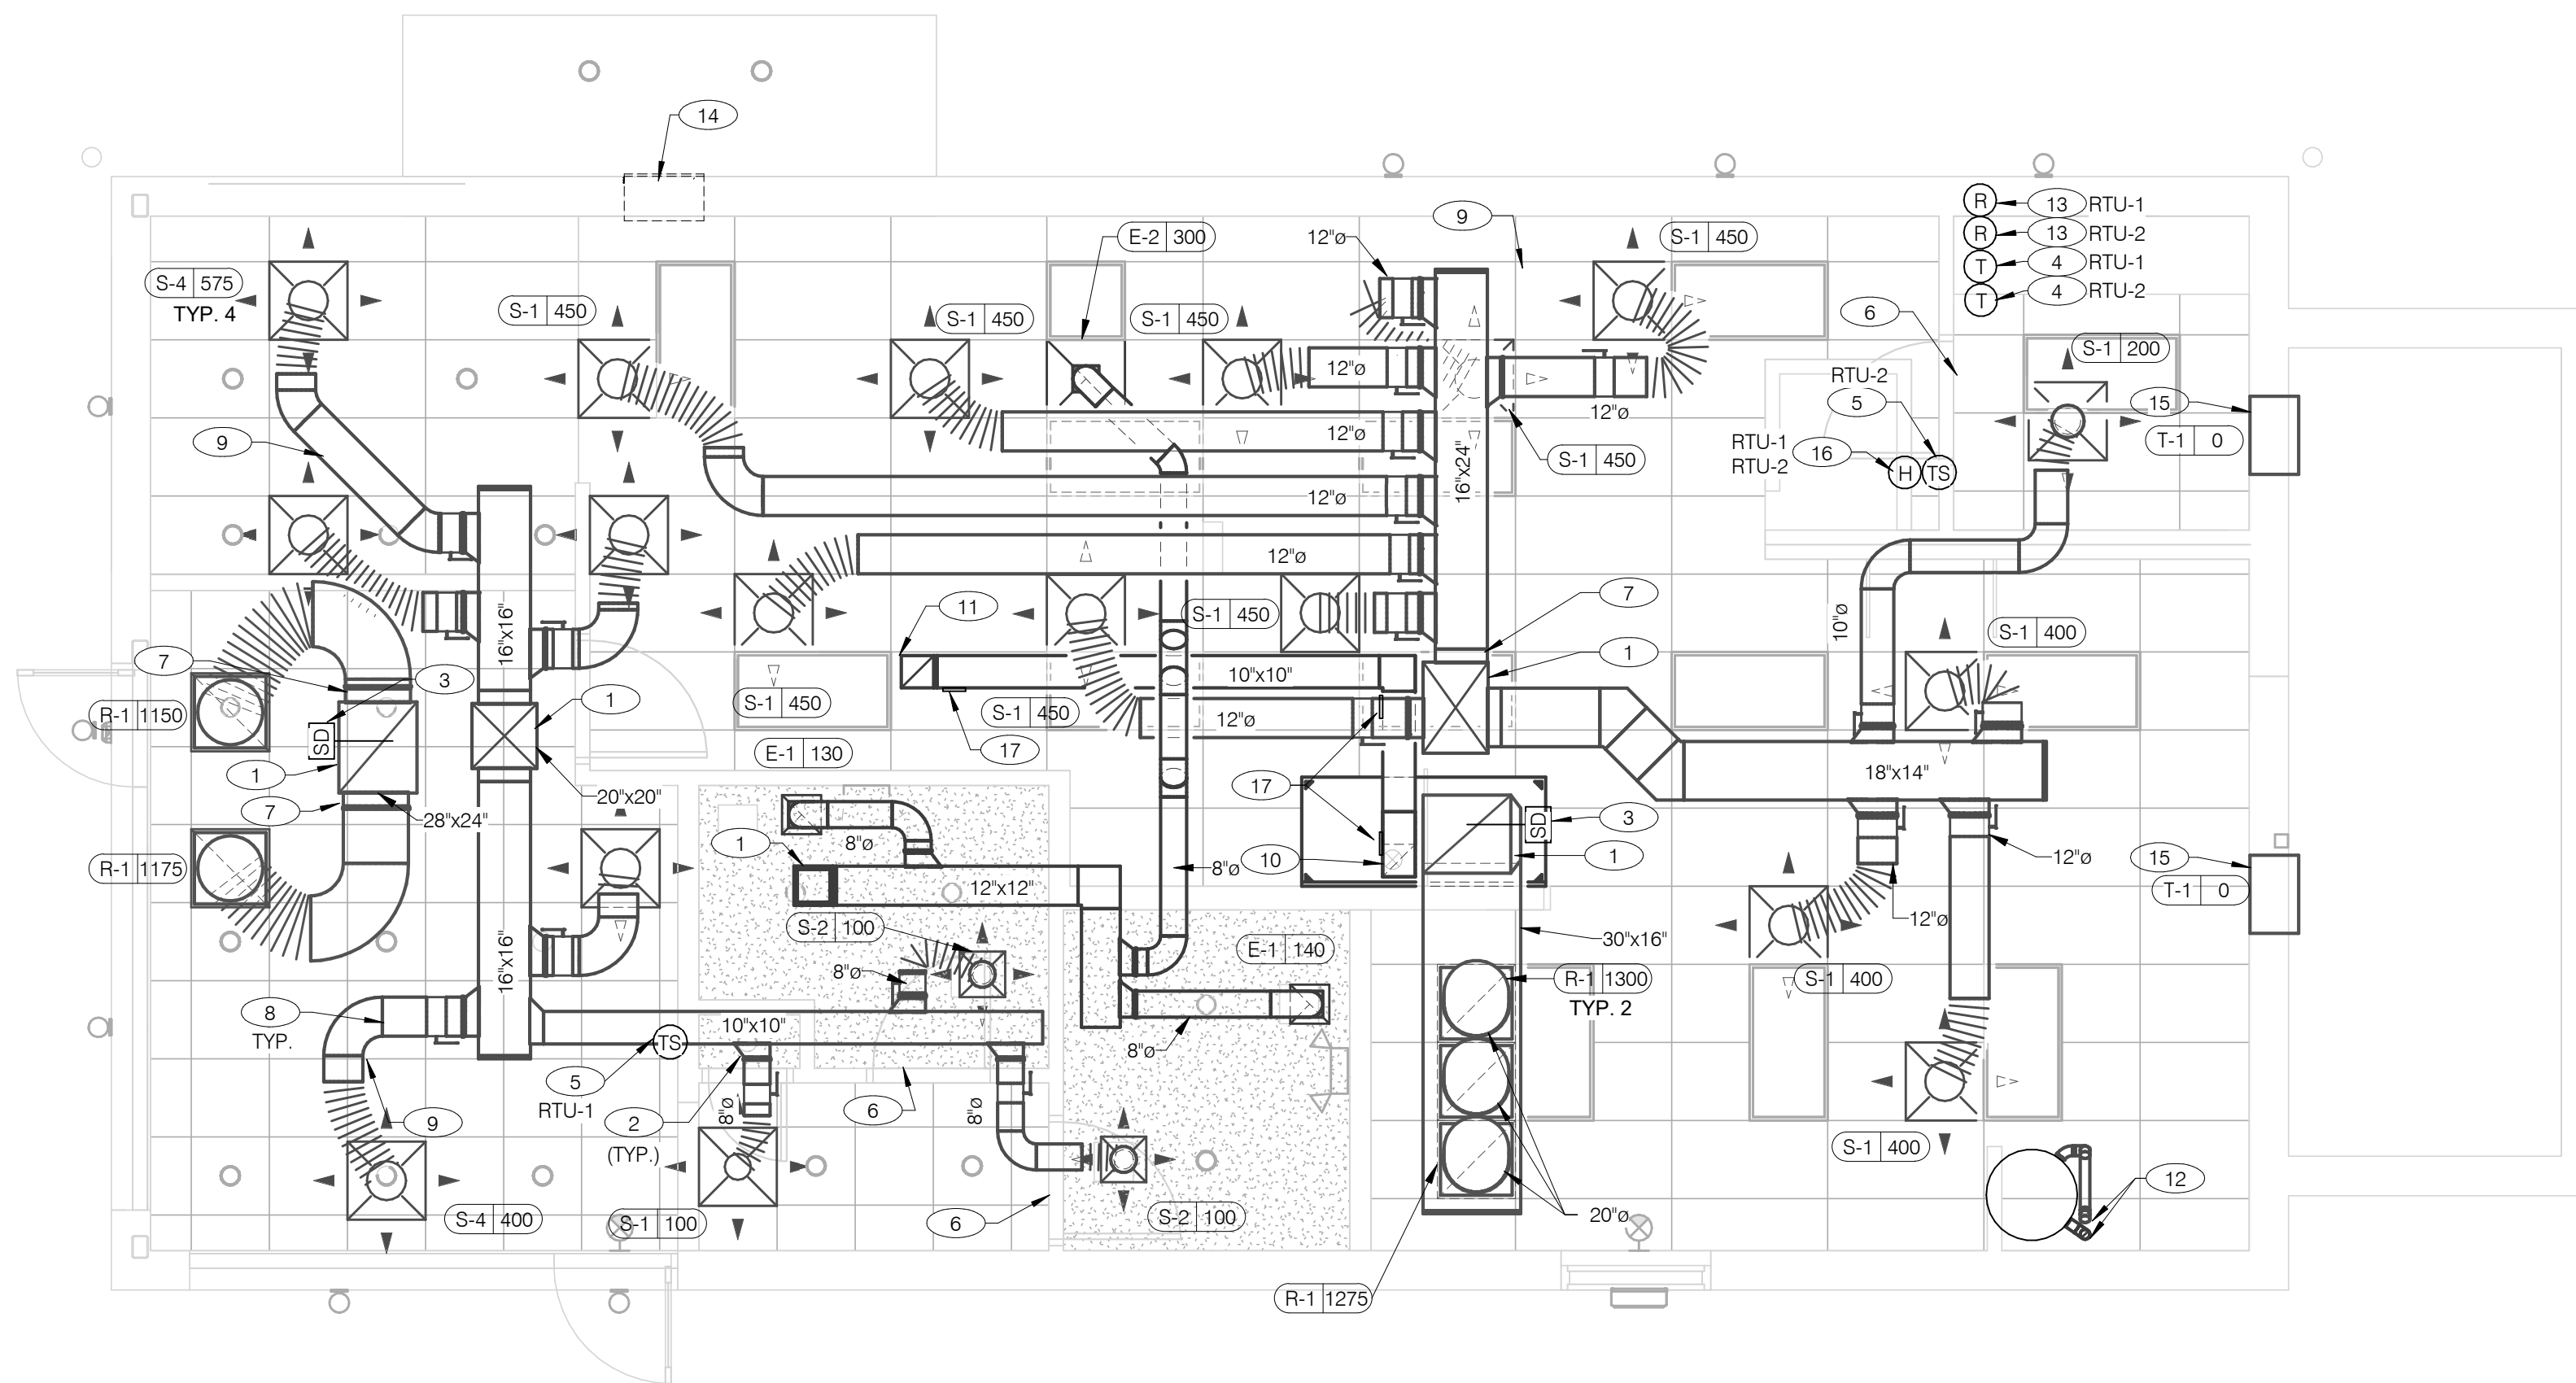

COVER ALL HVAC DUCT SYSTEMS OPENINGS TO PROTECT FROM CONSTRUCTION DUST AND DEBRIS UNTIL CONSTRUCTION IS COMPLETE. IF HVAC SYSTEM IS OPERATED BEFORE CONSTRUCTION IS COMPLETE, PROVIDE MERV8 FILTERS AT ALL AIR INTAKES INSIDE THE BUILDING.



DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE:	02.28.22
BUILDING TYPE:	END. MED20
PLAN VERSION:	MARCH 2021
BRAND DESIGNER:	DICKSON
SITE NUMBER:	314481
STORE NUMBER:	454078
PA/PM:	SM
DRAWN BY.:	TH
JOB NO.:	2020088.03

TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236



**ENDEAVOR 2.0
DUCT AND
DIFFUSER PLAN**

M2.0

PLOT DATE: 11/3/2022 9:59:43 AM


DUCT AND DIFFUSER PLAN 1/4" = 1'-0" **A**

1. DINING ROOM LIGHT FIXTURE LOCATIONS ARE CRITICAL. COORDINATE DUCTWORK LOCATIONS WITH LIGHTING AND STRUCTURAL.
2. THERMOSTATS SHALL BE PROGRAMMABLE THERMOSTAT WITH SUBBASE AND REMOTE TEMPERATURE SENSOR (PROVIDED WITH RTU PACKAGE).
3. HUMIDITY SENSOR APPLICATION IS VARIABLE PER SITE SPECIFIC CONDITIONS. REFER TO HVAC UNIT SCHEDULE FOR APPLICATION CONDITIONS.


1. AIR DUCT UP TO UNIT.
2. SEE DETAIL 4 ON DRAWING M4.0 FOR SUPPLY AIR TAKE-OFF TO CEILING DIFFUSERS AND GRILLES.
3. FACTORY INSTALLED SMOKE DETECTOR MOUNTED IN ROOFTOP UNIT.
4. LOCATE THERMOSTAT CONTROLS ON WALL IN OFFICE AT 48" A.F.F. COORDINATE LOCATION WITH LIGHT SWITCHES AND OTHER WALL MOUNTED ACCESSORIES. RUN 24 VAC POWER AND SIGNAL CONDUCTORS IN TWO (2) SEPARATE TWO (2) CONDUCTOR CABLES, 18 AWG.
5. MOUNT THERMOSTAT REMOTE SENSOR AT 60" ABOVE FINISHED FLOOR. CONNECT TO THERMOSTAT WITH 18 AWG 2 CONDUCTOR CABLE PER MANUFACTURER INSTALLATION INSTRUCTIONS. ENSURE THAT TEMPERATURE SENSOR IN DINING AREA IS NOT LOCATED ON TILE WALL.
6. UNDERCUT RESTROOM DOORS MINIMUM 3/4" FOR MAKE-UP AIR.
7. PROVIDE SHOE TAP AT CONNECTION TO DUCT DROP FROM ROOFTOP UNIT.
8. RUN DUCT THROUGH OPEN WEBBING OF ROOF TRUSSES (WHERE POSSIBLE). COORDINATE WITH TRUSS DESIGN PRIOR TO DUCTWORK FABRICATION.
9. RUN DUCTWORK BETWEEN TRUSSES AS HIGH AS POSSIBLE UNDER ROOF JOISTS.
10. 10"x10" EXHAUST AIR DUCT DOWN AND TRANSITION TO FIELD CUT EXHAUST CONNECTION AT HOOD.
11. EXHAUST DUCT SHALL RUN BETWEEN ROOF JOISTS TO CONNECT TO ROOF EXHAUST FAN EF-1. SEE HOOD DETAILS ON DRAWING M3.0. SEE DETAIL 10 ON SHEET M4.0 FOR FIRE PROTECTION OF DUCT WORK. SEE DETAIL 11 ON SHEET M4.0 FOR EXHAUST DUCT TRANSITION.
12. PROVIDE 3" PVC WATER HEATER INTAKE AND FLUE VENT. TERMINATION ON ROOF. COORDINATE WORK WITH ALL TRADES.
13. PROVIDE SMOKE DETECTOR RESET SWITCH WITH KEY. RESET SWITCH SHALL BE "SYSTEM SENSOR" MODEL # RT5151 KEY. MOUNT NEXT TO THERMOSTATS @ 48" A.F.F. - INSTALL PER MANUFACTURER'S REQUIREMENTS.
14. PROVIDE AIR CURTAIN IN LOCATION AS SHOWN ON PLAN. MOUNT AIR CURTAIN ON MULLION DIRECTLY ABOVE SERVICE OPENING DOORS AT DRIVE-THRU WINDOW. AIR CURTAIN SHALL BE BERNER MODEL DTU03-2026A, WITH 120V/1/60 POWER CONNECTION. REFER TO MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR MORE DETAILS.
15. TRANSFER AIR GRILLE MOUNTED ABOVE CEILING TO ALLOW TRANSFER AIR TO PREVENT FREEZING ABOVE WALK-IN COOLER/FREEZER. COORDINATE IN FIELD WITH OTHER TRADES TO ENSURE NO OBSTRUCTIONS.
16. HUMIDITY SENSOR (REMOTE). MOUNT HUMIDITY SENSORS FOR RTU-1 & RTU-2 AT EYE LEVEL IN KITCHEN. VERIFY EXACT LOCATION.
17. HOOD EXHAUST DUCT CLEANOUT. CLEANOUT SHALL BE PROVIDED SPACED NOT MORE THAN 20'-0" APART AND NOT MORE THAN 10'-0" FROM CHANGES IN DIRECTION GREATER THAN 45 DEGREES.

GENERAL NOTES - MECHANICAL NTS **C**

KEYNOTES - DUCT AND DIFFUSER NTS **B**

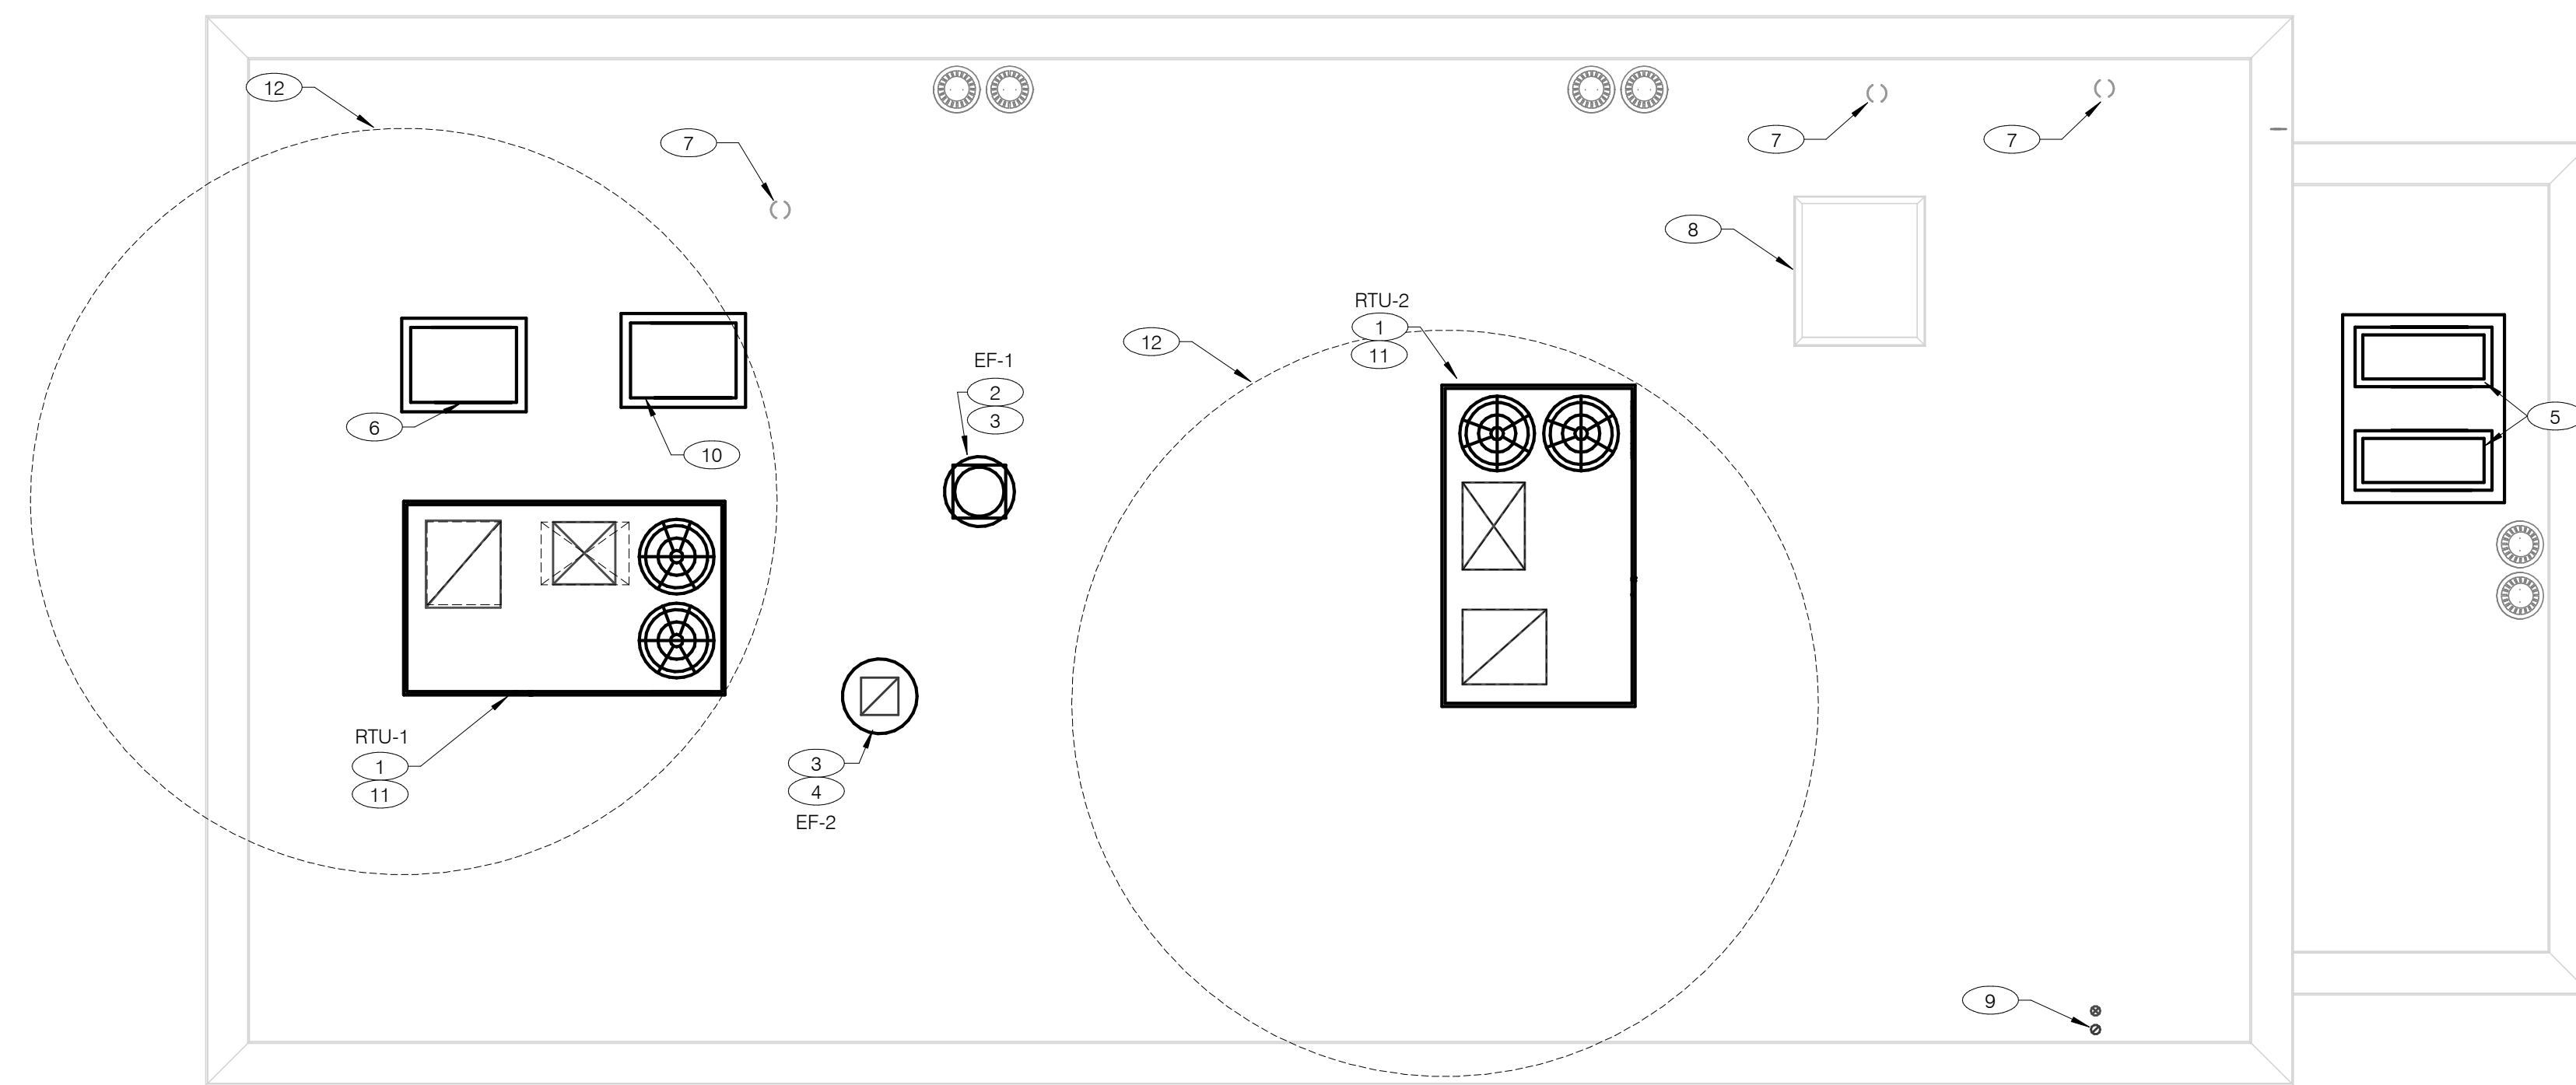

COVER ALL HVAC DUCT SYSTEMS OPENINGS TO PROTECT FROM CONSTRUCTION DUST AND DEBRIS UNTIL CONSTRUCTION IS COMPLETE. IF HVAC SYSTEM IS OPERATED BEFORE CONSTRUCTION IS COMPLETE, PROVIDE MERV8 FILTERS AT ALL AIR INTAKES INSIDE THE BUILDING.



MECHANICAL ROOF PLAN 1/4" = 1'-0" **A**

- 1 PROVIDE RTU IN LOCATION AS SHOWN ON PLANS. COORDINATE EXACT RTU LOCATION AND DUCT DROPS WITH STRUCTURAL TRUSS LAYOUT. MAINTAIN MINIMUM 10'-0" CLEARANCE BETWEEN OUTSIDE AIR INTAKES AND EXHAUST TERMINATIONS.
- 2 PROVIDE TYPE I EXHAUST FAN IN LOCATION AS SHOWN PLANS. CONNECT 10"x10" EXHAUST DUCT FROM EXHAUST HOOD UP TO EF-1 ON ROOF. COORDINATION EXHAUST DUCT ROUTING WITH STRUCTURAL TRUSS LAYOUT.
- 3 COORDINATE EXHAUST FAN LOCATION WITH ROOFTOP UNIT. MAINTAIN ROOFTOP UNIT MANUFACTURER'S REQUIRED CLEARANCE AND MINIMUM 10 FT TO ROOFTOP UNIT'S OUTSIDE AIR INTAKE.
- 4 PROVIDE EXHAUST FAN IN LOCATION AS SHOWN PLANS. CONNECT 10"x10" EXHAUST DUCT FROM RESTROOM EXHAUST GRILLES TO EF-2 ON ROOF. COORDINATION EXHAUST DUCT ROUTING WITH STRUCTURAL TRUSS LAYOUT.
- 5 CONDENSING UNIT SERVING WALK-IN COOLER/FREEZER. COORDINATE EXACT LOCATION WITH ROOF LAYOUT. CONTRACTOR TO FIELD VERIFY EXACT REFRIGERANT PIPING. PROVIDE ALL NECESSARY PIPING ACCESSORIES INCLUDING PIPING INSULATION AND INSTALL ON APPROPRIATE EQUIPMENT SUPPORTS.
- 6 CONDENSING UNIT SERVING ICE MAKER. COORDINATE EXACT LOCATION WITH ROOF LAYOUT. CONTRACTOR TO FIELD VERIFY EXACT REFRIGERANT PIPING. PROVIDE ALL NECESSARY PIPING ACCESSORIES INCLUDING PIPING INSULATION AND INSTALL ON APPROPRIATE EQUIPMENT SUPPORTS.
- 7 PLUMBING VENT. REFERENCE 1/P2.0.
- 8 ROOF HATCH. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.
- 9 PROVIDE MANUFACTURER'S CONCENTRIC TERMINATION VENT KIT SERVING HOT WATER HEATER BELOW. INSTALL IN STRICT ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS. ENSURE AT LEAST 10'-0" DISTANCE BETWEEN OUTDOOR AIR INTAKES.
- 10 CONDENSING UNIT SERVING FROZEN BEVERAGE MACHINE. COORDINATE EXACT LOCATION WITH ROOF LAYOUT. FIELD VERIFY EXACT REFRIGERANT PIPING. PROVIDE ALL NECESSARY PIPING ACCESSORIES INCLUDING PIPING INSULATION AND INSTALL ON APPROPRIATE EQUIPMENT SUPPORTS.
- 11 ALL UTILITY PIPING FOR RTUS SHALL RUN UP THROUGH ROOF INSIDE EACH UNIT'S ROOF CURB.
- 12 MAINTAIN MINIMUM 10'-0" CLEARANCE FROM EXHAUST FANS AND SANITARY VENTS.

KEYNOTES - MECHANICAL ROOF PLAN NTS **B**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: TH
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236



**ENDEAVOR 2.0
 MECHANICAL
 ROOF PLAN**

M2.1

PLOT DATE: 11/3/2022 9:59:44 AM

STRATOVENT MODEL# SVDU50HFA

TAG	HOOD	STRATOVENT MODEL #	CFM	ESP	RPM	H.P.	B.H.P.	Q	VOLT	FLA	MCANCP	WEIGHT (LBS) (FAN/COIL)	SONES
EF-1	FRYER	SVDU50HFA	1050	0.9'	1429	0.50	0.33	1	115	8.4	19.5/15	85/40	14.5

SELECTION OPTIONS:
 - RESTAURANT MODEL
 - ULTRACLEAN GREASE RATED
 - DIRECT DRIVE
 - SPEED CONTROLLER
 - WEATHERPROOF DISCONNECT
 - FLAT CURB, VENTED
 - FACTORY ATTACHED HINGES

ATTENTION! INSTALLER MUST READ LABEL NEAR DISCONNECT SWITCH. MESSAGE ON LABEL. INSTALLER SHOULD SUPPLY ENOUGH ELECTRICAL CORD TO ALLOW FAN TO MAKE COMPLETE SWIRL.

REVISIONS:
 10-10-2018

HOOD EXHAUST FAN DETAIL NTS **7**

INSTALLATION: DUCT TEMPERATURE SWITCH

NOTE: IF SENSOR IS FIELD INSTALLED, THE KIT SHIPS WITH UL-LISTED QUICK SEALS MUST BE USED TO SEAL ANY HOOD OR DUCT PENETRATIONS (SEE EXPLODED PARTS VIEW).

INSTALLATION: DUCT TEMPERATURE SENSOR

SENSOR DETAIL

(1) NORMALLY OPEN DRY CONTACT, CLOSING ON TEMPERATURE RISE ABOVE 85F. WIRED IN PARALLEL TO NORMAL CONTROL CIRCUIT. WHEN ORDERED, SENSOR IS FACTORY INSTALLED IN HOOD CAVITY WITH J-BOX ON TOP OF THE HOOD.
 (2) DO NOT USE SENSOR AS THE PRIMARY MEANS OF FAN CONTROL. USED ONLY AS A SAFETY DEVICE PER INTERNATIONAL MECHANICAL CODE TO ENERGIZE HOOD EXHAUST FAN WHEN COOKING EQUIPMENT GENERATES HEAT.
 (3) FAN CONTRACTOR AND CONTROLS BY OTHERS, SEE ELECTRICAL SHEETS FOR DETAILS.
 (4) SEE SPECS ABOVE FOR TEMP SET POINT ADJUSTMENT

HEAT SENSOR ATTACHMENT

SPECIFICATIONS:
 * VULCAN CALSTAT, 1E2B9-85, NORMALLY OPEN DRY CONTACT
 * SENSOR FACTORY SET AT 85F
 * FIELD ADJUSTED W/SET SCREW, CW INCREASE, CCW DECREASE, 90F PER REVOLUTION
 * RATED FOR 10 AMPS @ 120 VAC, 5 AMPS @ 240 VAC
 * SHIPPED FACTORY INSTALLED IN HOOD CAVITY

ADDITIONAL QUESTIONS?? CONTACT, STRATOVENT VENTILATION HOODS, 919-573-4250 - 251-490-6114 JEFF.JOHNSON@STRATOVENT.COM

HEAT SENSOR ATTACHMENT NTS **5**

HOOD #	1 OF 1	MODEL #	STRATOVENT SVD2
LENGTH (IN):	6'-3"	WIDTH (IN):	36"
HEIGHT (IN):	14'H		
EXHAUST CFM:	1050	SUPPLY CFM:	BY RTU-SEE M1.0
EXHAUST SP:	0.9' (HOOD+DUCT)	SUPPLY SP:	NA
EXHAUST FPM:	1512	SUPPLY FPM:	NA
EXH. SIZE:	10'X10'	SUP SIZE:	NA
FILTERS: (4)	16" X 16"	HOOD WEIGHT:	300 LBS
FIRE SUPPRESSION:	ANSUL-R102	FILTER TYPE:	STAINLESS BAFFLE
LIGHT QTY: (3)	A19/ CFL	CONTROL SWITCH:	BY OTHERS

DESIGN NOTES:
 - STRATOVENT HOODS ARE ETL LISTED TO UL-710 STANDARDS, 3054804-001
 - MODEL SVD2 IS A NON-CANOPY HOOD, "LISTED" VALUES ARE UTILIZED FOR AIRFLOW, OVERHANGS AND TEMPERATURE RATINGS.
 - 18/20 GAUGE MINIMUM S/S ON EXPOSED SURFACES PER NFPA.
 - HOOD IS PRE-PIPPED FOR ANSUL R102, FIELD HOOKUP BY OTHERS
 - INSTALLER TO REVIEW ELECTRICAL SHEETS FOR HOOD AND FAN WIRING. STRATOVENT DOES NOT PROVIDE A CONTROL BOX IN THE "BASE" PACKAGE.

3" INTEGRAL REAR STAND-OFF, FACTORY INSULATED, HOOD ASSEMBLY IS LISTED AND LABELED FOR ZERO CLEARANCE TO COMBUSTIBLE IN THE REAR. ARCHITECT MUST VERIFY COMPLIANCE WITH ALL LOCAL CODES CONCERNING CLEARANCES.

25" TALL DUCT ENCLOSURE PANELS, FRONT, LEFT & RIGHT SIDES (PROVIDED WITH HOOD, GC INSTALLED).

TOP EDGE OF HOOD.

LOWER, LEADING EDGE OF HOOD, 71" ABOVE FINISHED FLOOR.

END PANELS, PROVIDED BY STRATOVENT, SEE SIDE VIEW DETAIL FIELD INSTALLED BY GC.

106"H X 95"L, BACKSPLASH, COVERING REAR WALL AND 18" BEYOND THE HOOD. ADJUST SIZE TO SUIT SITE CONDITIONS. MINIMUM 20 GA. STAINLESS STEEL PROVIDED BY HOOD VENDOR.

106" X 95" L, BACKSPLASH, COVERING REAR WALL AND 18" BEYOND THE HOOD. ADJUST SIZE TO SUIT SITE CONDITIONS. MINIMUM 20 GA. STAINLESS STEEL PROVIDED BY HOOD VENDOR.

8'-10" HIGH, DROP CEILING (TYPICAL). HOOD PROVIDER MUST BE NOTIFIED IF CEILING HEIGHT VARIES TO ADJUST TRIM HEIGHT. VERIFY WITH ARCHITECTURAL SHEETS

HOOD DETAIL 2: 30" L X 3" H, FACTORY ATTACHED MOUNTING CHANNEL FOR CUSTOMER SUPPLIED TIMERS. DUAL 115V/1PH OUTLET FACE MOUNTED ABOVE CHANNEL WITH J-BOX ON TOP OF HOOD.

STRATOVENT
 REDDING, CA - RALEIGH, NC
 800-474-0037 - WWW.STRATOVENT.COM - 251-490-6114

UL/LC-710 Standard (NSF/ANSI Standard 2) NFPA
 ETL-LISTED FILE #3054804-001 / TESTED TO UL-710

UPDATED: 6FT-3IN LONG VERSION, 04-11-2020

TACO BELL HOOD DETAIL NTS **2**

PROJECT: TACO BELL

System Size: ANSUL-3.0 Gallons Total, R102
 Flow Points: 8 Design, 11 (max)

Hood #1: 6'-3" L x 36" W x 14" H
 Exhaust Riser Size: 10" x 10"

NOTES
 - FIELD PIPE DROPS AS SHOWN: SLEEVING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY STRATOVENT FOR HOOD-BASED PIPING.
 - RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED.
 - MAXIMUM 9 ELBOWS IN SUPPLY LINE, MINIMUM 72 INCHES OF AGENT LINE FROM TANK TO FIRST NOZZLE.
 - ALL NOZZLE HEIGHT AND PLACEMENT TO BE DETERMINED BY INSTALLER AND AHJ PER ANSUL GUIDELINES.
 - ALL PIPING TO BE 3/8" SCH 40 BLACK IRON.
 - THIS FIRE SYSTEM COMPLIES WITH U.L. 300 REQUIREMENTS.
 - SYSTEM INSTALLATION AND FINAL HOOKUP SOURCED BY GEN CONTRACTOR. SYSTEM PARTS OPTIONALLY PURCHASED FROM STRATOVENT BY OWNER OR GC.

LEGEND - WALL MOUNTED ANSUL SYSTEM

1B	3.0 GALLON TANK
2	AUTOMAN RELEASE
5	ANSULEX LIQUID AGENT (3.0 GAL.)
7	CARTRIDGE (101-20)
10	TEST LINK
11	DOUBLE MICROSWITCH
1W	NOZZLE ASSEMBLY (419336)
1N	NOZZLE ASSEMBLY (419335)
3N	NOZZLE ASSEMBLY (419338)
28	DETECTOR BRACKET
30	HIGH TEMP FUSIBLE LINK
MGV	MECHANICAL GAS VALVE
34	REMOTE MANUAL PULL STATION
S	SWIVEL ADAPTOR

LOCATION OF PULL STATION PER LOCAL CODES.

DESIGN NOTE:
 1) ABOVE DEPICTION SHOWS DUAL FRYERS ON RIGHT END OF THE HOOD. HOOD SUPPLIER WILL VERIFY EQUIP LAYOUT PER PLANS AND PLACE FRYER NOZZLES ON THE LEFT END WHEN APPROPRIATE TO SUIT SITE CONDITIONS

TACO BELL HOOD FIRE SUPPRESSION SYSTEM PLAN 12" = 1'-0" **6**

HOOD NOTES AND SPECS (TYP.)

- Hoods shall be constructed of minimum 20 gauge stainless steel with # 3 grade. All attachment surfaces shall be constructed of minimum 18 gauge aluminum steel.
- UL listed stainless or stainless steel type filters shall be easily removable for cleaning. Filter housing shall be made of a painted grease proof that drains into a removable stainless steel grease cup.
- UL listed and NSF approved upper vent mechanism light fixtures permitted to function low at top of hood in accordance with NEC 710.
- Pre-wired fire suppression systems shall be located on the top of the hood and provided with the hood or by a certified technician. Final location of all nozzles and the suppression drops to be locally approved and approved.
- Hoods shall be fabricated in accordance with NFPA Bulletin #96 and shall have the NSF Seal of Approval. Hoods shall be listed under UL 710 EXHAUST HOODS FOR COMMERCIAL COOKING EQUIPMENT, certified by ETL under File # 3054804-001.
- Hoods shall be fabricated in accordance with NFPA Bulletin #96 and shall have the NSF Seal of Approval. Hoods shall be listed under UL 710 EXHAUST HOODS FOR COMMERCIAL COOKING EQUIPMENT, certified by ETL under File # 3054804-001.

THIS HOOD DESIGN IS BASED UPON STRATOVENT, MODEL SVD2. MANUFACTURED BY: STRATOVENT VENTILATION HOODS RALEIGH, NC 27616 CONTACT: JEFF JOHNSON, 251-490-6114

STRATOVENT HOOD

ENCLOSURE WRAPPERS

HEAT SENSOR

HOOD LIGHTS

DUAL OUTLET FOR TIMER, REQUIRES DEDICATED BREAKER

36"

26"

61" TYP.

71" TYP.

CHASE CUTOUT (GAS OR POWER LINES 19.5" X 4" W TYPICAL)

STRATOVENT-BRAND HOODS ARE CERTIFIED BY ETL-INTERTEK TO NATIONALLY RECOGNIZED UL-710 AND NSF STANDARDS.

CONTACT US: WWW.STRATOVENT.COM 919-573-4250 FEEDBACK@STRATOVENT.COM

MODIFIED: 04-11-2020

HOOD ISOMETRIC 12" = 1'-0" **3**

LOW-PROFILE HOOD HOOD #1

STRATOVENT HOODS BUILT IN COMPLIANCE WITH:
 NSF
 NFPA #96
 NSF STANDARD #2
 UL STANDARD 710
 ETL FILE NO. 3054804-001

NON-CANOPY HOOD DESIGN BASED ON:
 MANUFACTURER: STRATOVENT, MODEL SVD2
 ETL LISTED UL/LC-710, ULC-S646: # 3054804-001
 MIN. "LISTED" AIRFLOW: 150 CFM PER LINEAR
 DESIGN AIRFLOW: 168 CFM PER LINEAR FT
 MAX. DIST. ABOVE COOK SURFACE: 47"
 MAX. COOK SURFACE FRONT UNDERHANG: -3"
 MIN. SIDE COOK SURFACE OVERHANG: 0"
 MAX. APPLIANCE COOKING TEMPERATURE: 450 F

HOOD DESIGN QUESTIONS? STRATOVENT KITCHEN VENTILATION PHONE: 251.490.6114 JEFF.JOHNSON@STRATOVENT.COM

EXHAUST FAN (EF 1)

40" MIN. (N.T.S.)

ROOF LINE

DUCT TERMINATION SHALL EXPAND TO MATCH FAN INLET SIZE. DO NOT OBSTRUCT FAN INLET.

NOTE: DEPICTED DUCT ROUTING IS GENERIC AND WILL VARY BASED ON SITE CONDITIONS. ADJUST FAN SIZING TO MATCH REQUIRED STATIC PRESSURE.

DROP CEILING (TYPICAL)

27"H, 3-SIDED DUCT ENCLOSURE PANELS, SHIPPED LOOSE BY HOOD SUPPLIER. DESIGN FOR UP TO 9FT DROP CEILING.

FIELD CUT OPENING BY INSTALLER, TRANSITION PER PLANS. IF SELECTED, A HOOD MOUNTED HEAT SENSOR WILL BE FACTORY INSTALLED IN ROOF OF HOOD FOR AUTOMATIC ACTIVATION.

16"H, UL-LISTED, S/S BAFFLE FILTERS.

3" INTEGRAL REAR STAND-OFF, FACTORY INSULATED. HOOD ASSEMBLY IS LISTED FOR ZERO CLEARANCE TO COMBUSTIBLE IN THE REAR. COMPLIANCE WITH ALL LOCAL CODES VERIFIED BY ARCHITECT.

GREASE CUP

26" X 26" END PANELS, SHIPPED LOOSE AND GC INSTALLED. PROVIDED BY HOOD VENDOR.

20 GA. MIN S/S WALL PANEL COVERING REAR WALL. EXTENDING 18" BEYOND THE HOOD. PROVIDED BY STRATOVENT.

FULL END PANEL ON END OF HOOD CLOSEST TO THE RETHERMALIZER. PROVIDED BY HOOD VENDOR.

30" L X 3" H X 1.25" W, TIMER MOUNTING CHANNEL. FACTORY ATTACHED. DUAL 115V/1PH POWER OUTLET FLUSH MOUNTED ON FACE OF HOOD WITH J-BOX ON TOP.

5'-11"

5'-11"

3'-0"

6'-10"

FINISHED FLOOR LINE

UPDATED: 6FT-3IN LONG VERSION, 04-11-2020

TACO BELL HOOD SECTION 12" = 1'-0" **1**

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02-28-22
 BUILDING TYPE: END, MED40
 PLAN VERSION: MARCH 2020
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY: TH
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236




ENDEAVOR 1.0 HOOD DETAILS AND SECTIONS


M3.0

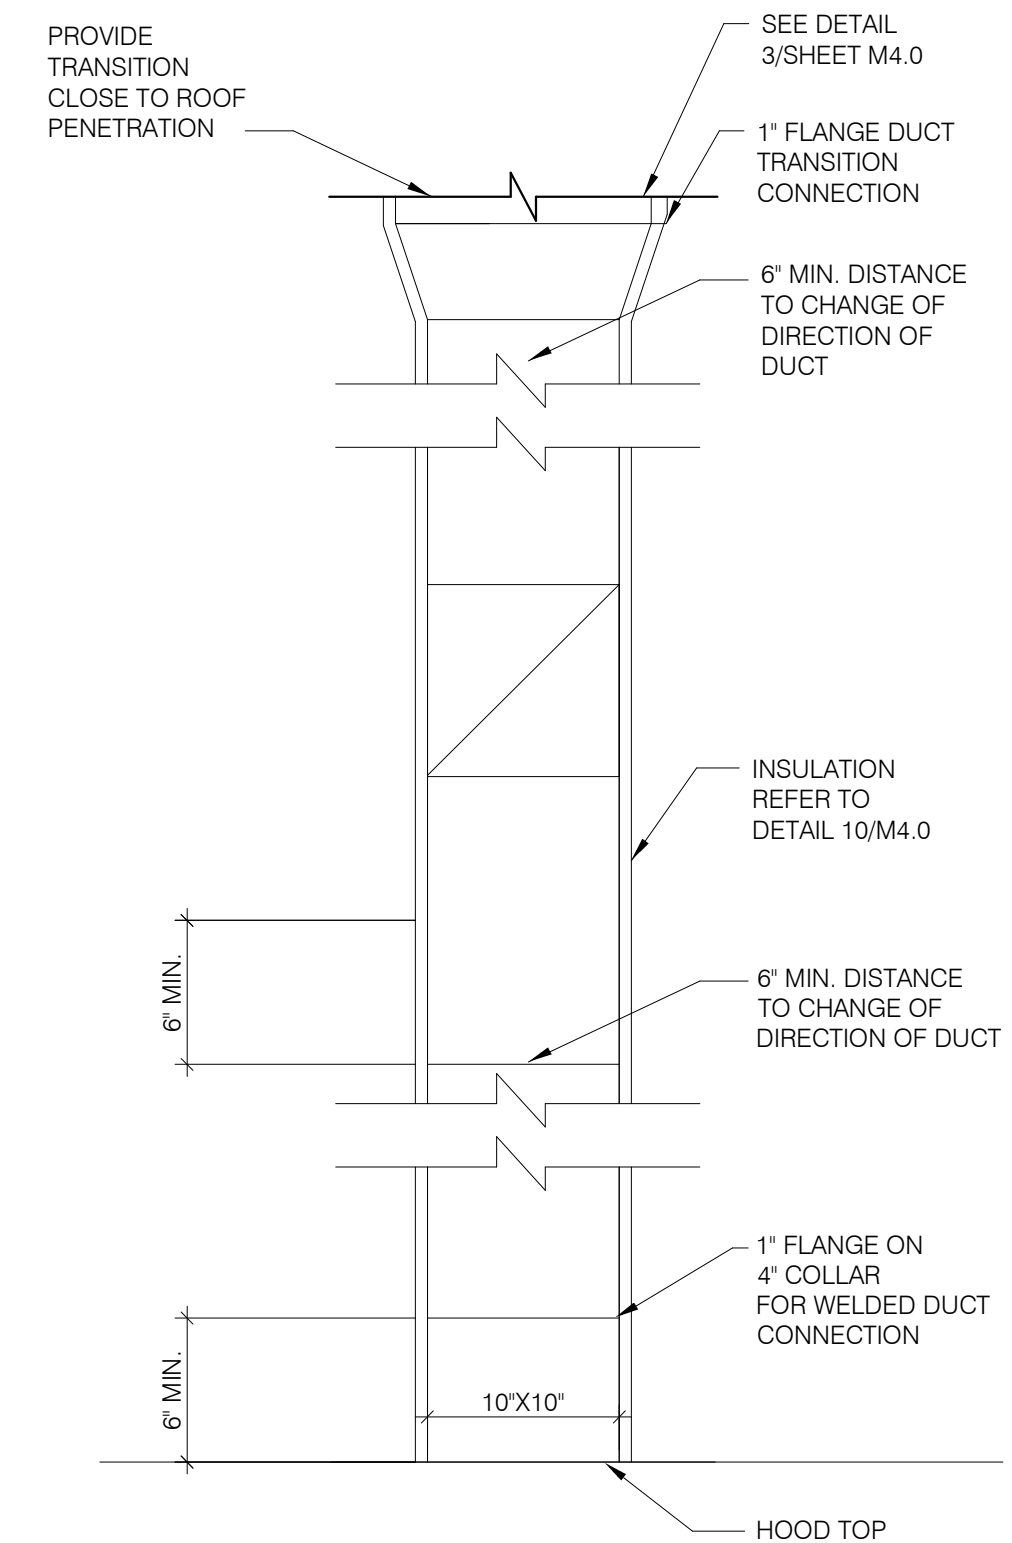


TB HOOD DUCT TRANSITION NTS **11**

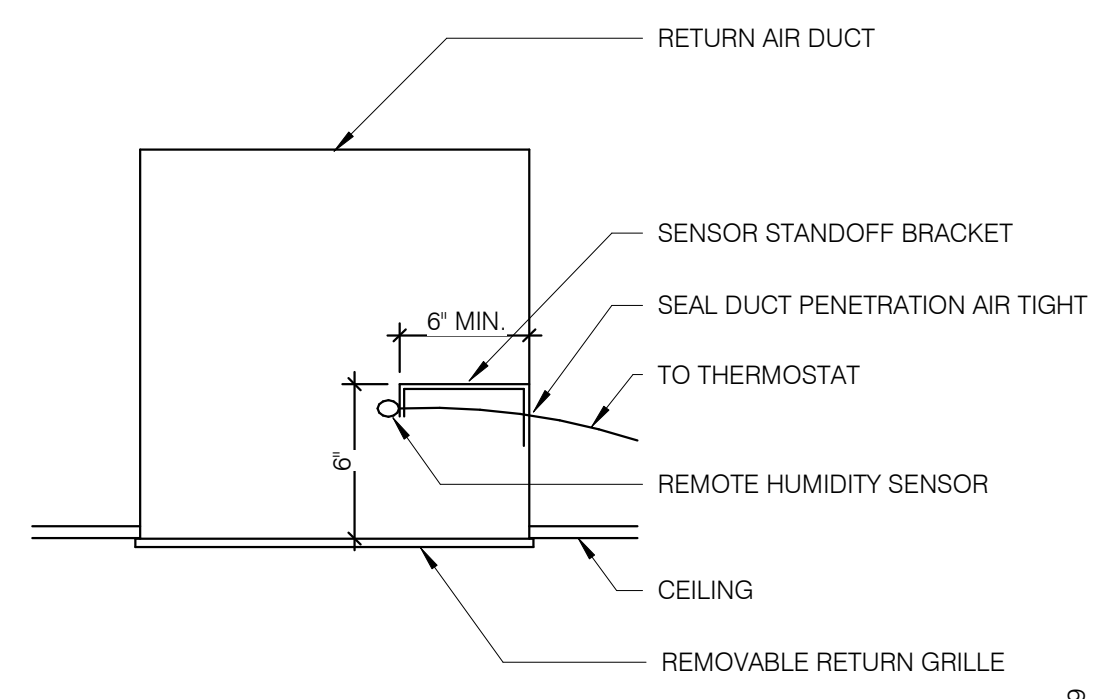


REMOTE HUMIDITY SENSOR NTS **8**

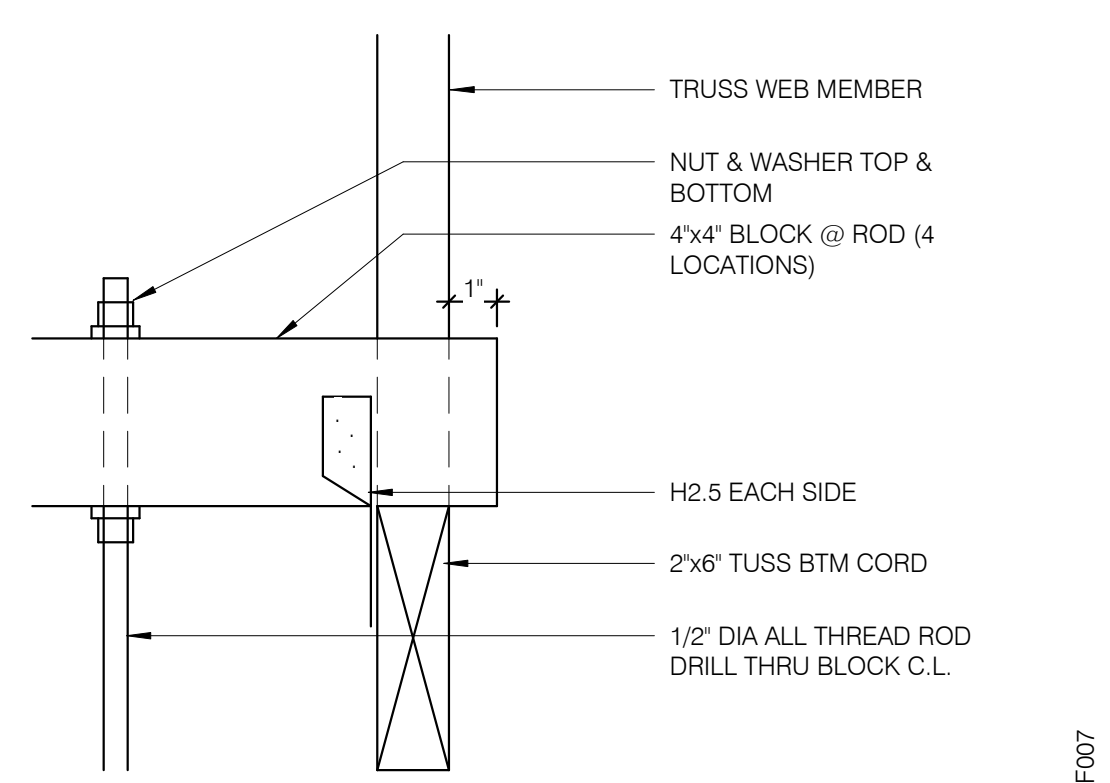


ROD ATTACHMENT NTS **7**

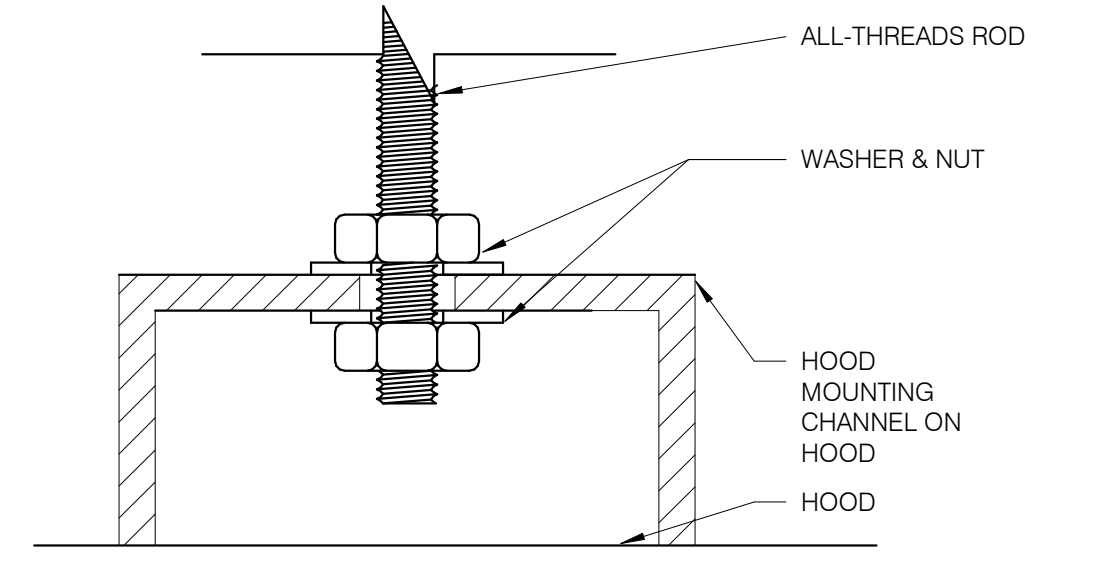


BOLT CONNECTION TO HOOD NTS **5**

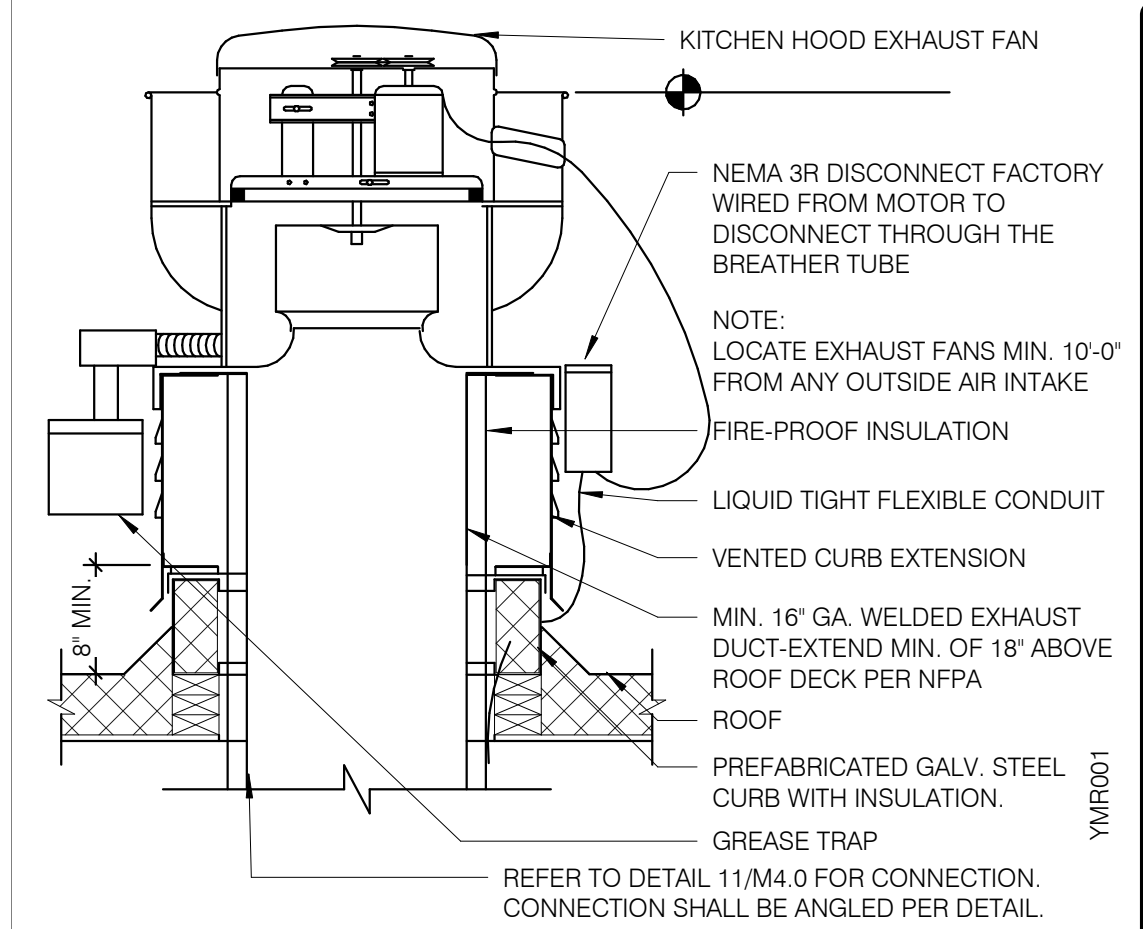

EXHAUST FAN (EF-1) NTS **3**

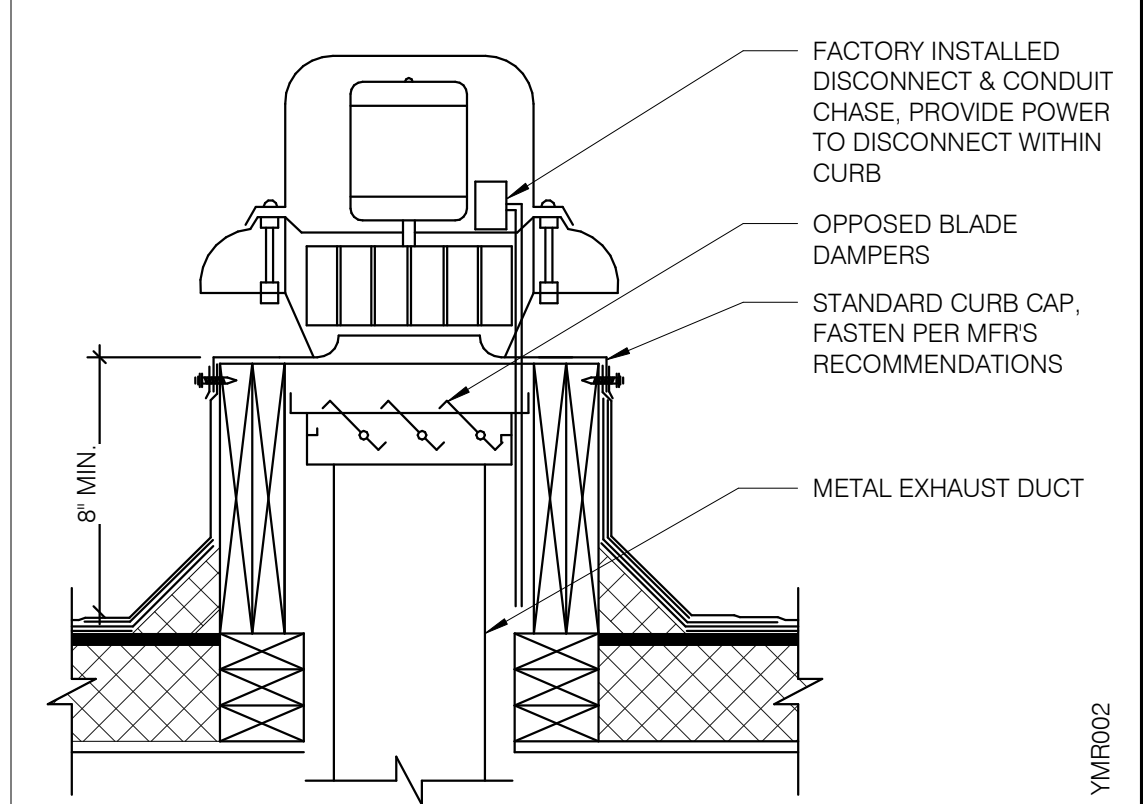


RESTROOM FAN (EF-2) NTS **2**

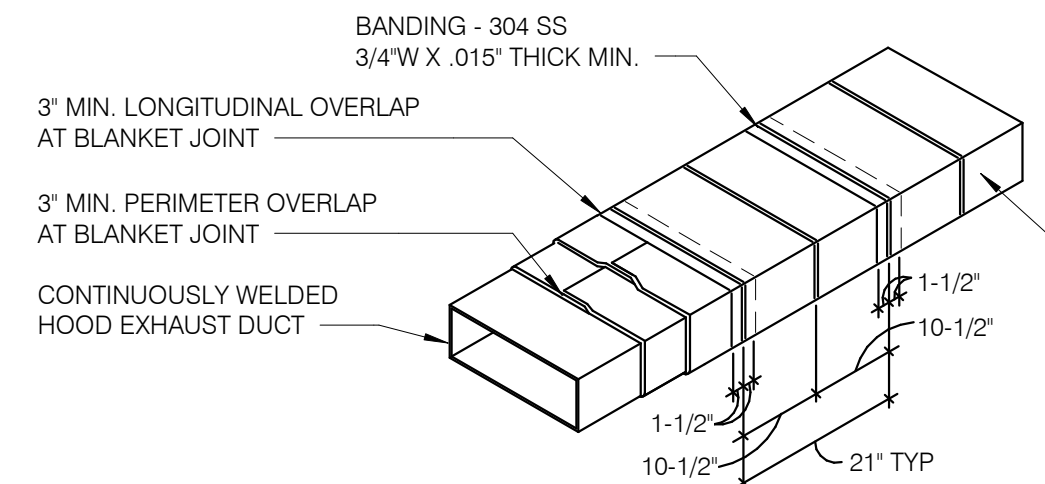


- NOTES:**
1. WRAP GREASE DUCT CONTINUOUS AS SHOWN FROM CONNECTION AT FAN THROUGH CURB AND EXTEND 18" MIN. BELOW ROOF DECK.
 2. FOR HORIZONTAL RUNS OF EXHAUST DUCTS PROVIDE TYPICAL TRAPEZE SUPPORT SYSTEM WITH 1/2" HANGER RODS A MAXIMUM OF 6' FROM INSULATION EDGE. TRAPEZE SUPPORTS SHALL BE SPACED A MAXIMUM OF 60" ON CENTER FROM CENTERLINE OF VERTICAL EXHAUST DUCT.
 3. SLOPE HORIZONTAL EXHAUST DUCT RUNS A MINIMUM OF 1/4" PER FOOT (2% SLOPE) TOWARDS EXHAUST HOOD.
 4. PROVIDE INSULATED ACCESS DOOR OR PANEL NEAR MID POINT OF EXHAUST DUCT RUN FOR CLEANING AND INSPECTION OF DUCT. PROVIDE AN APPROVED SIGN ON ACCESS DOOR OR PANEL WHICH READS 'ACCESS PANEL DO NOT OBSTRUCT.'


KITCHEN HOOD EXHAUST DUCT SYSTEM DETAIL NTS **10**

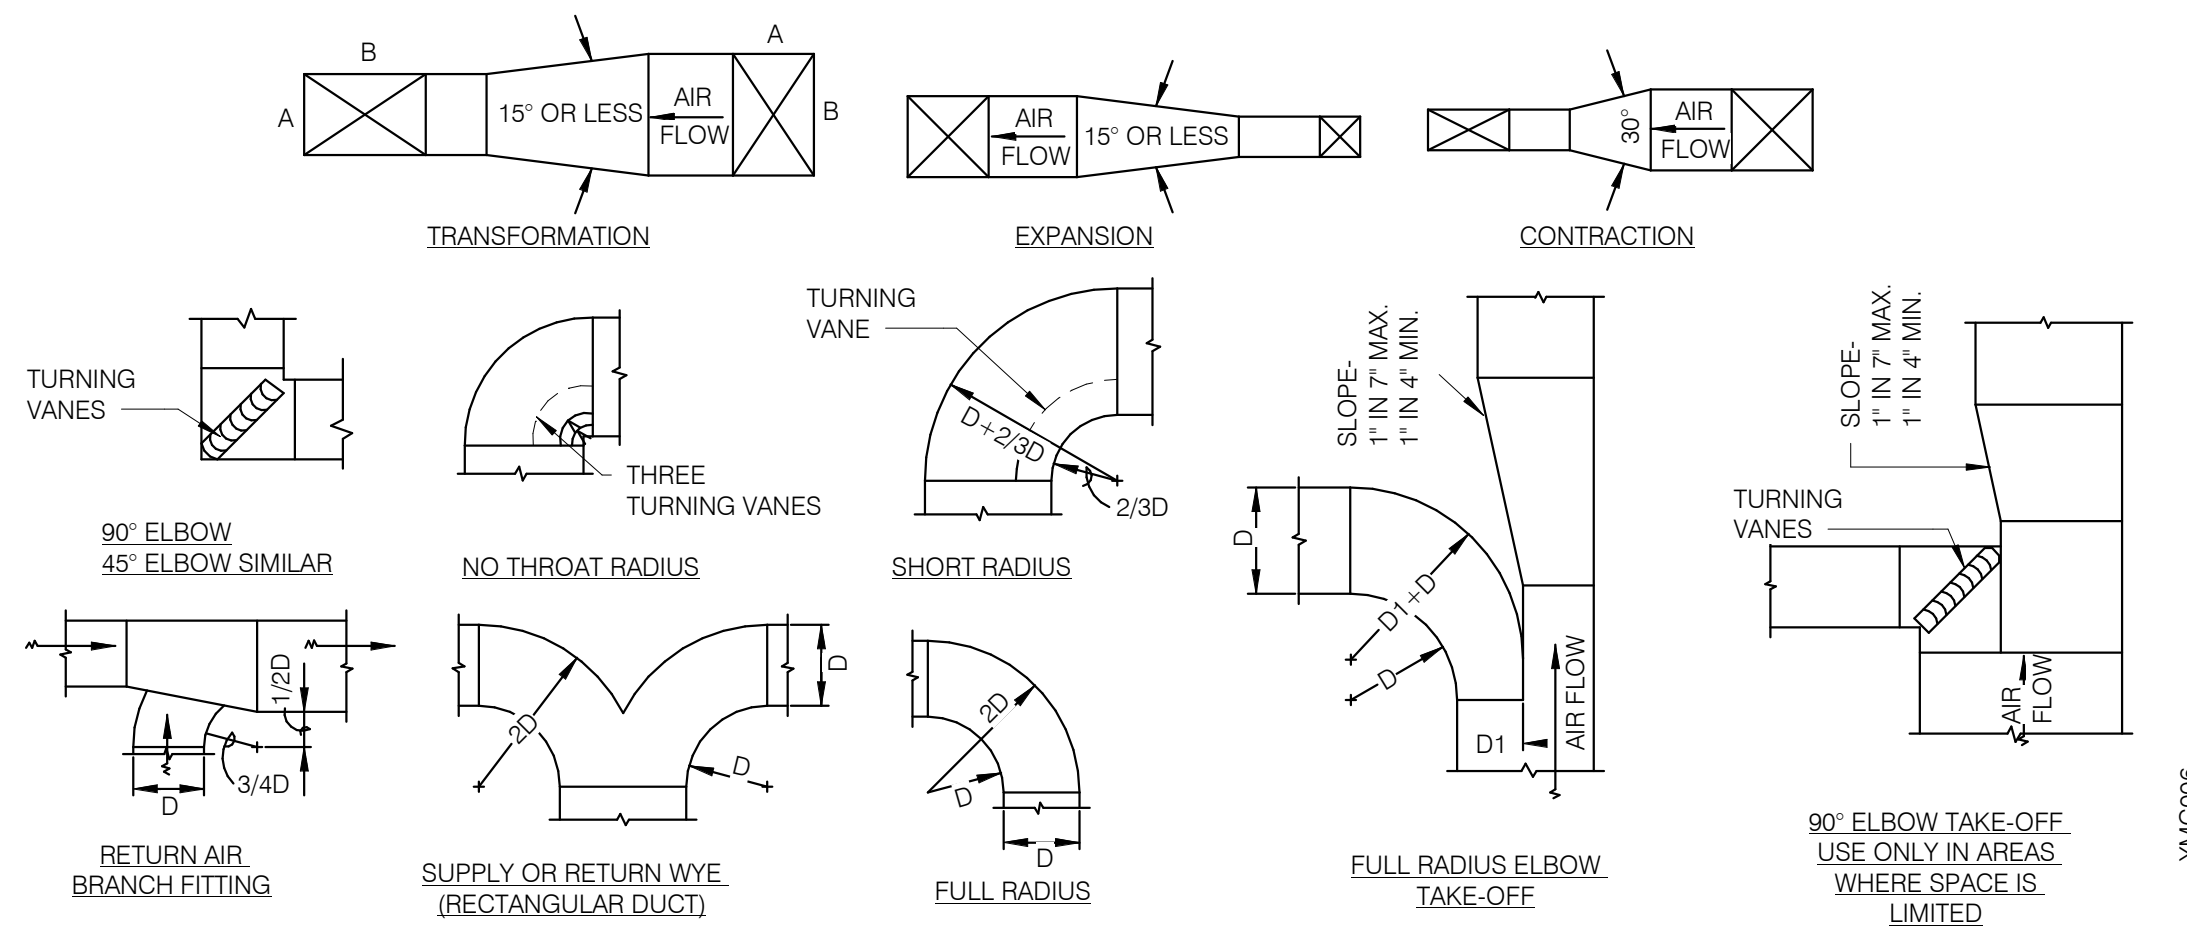

TYPICAL DUCTWORK DETAILS NTS **9**

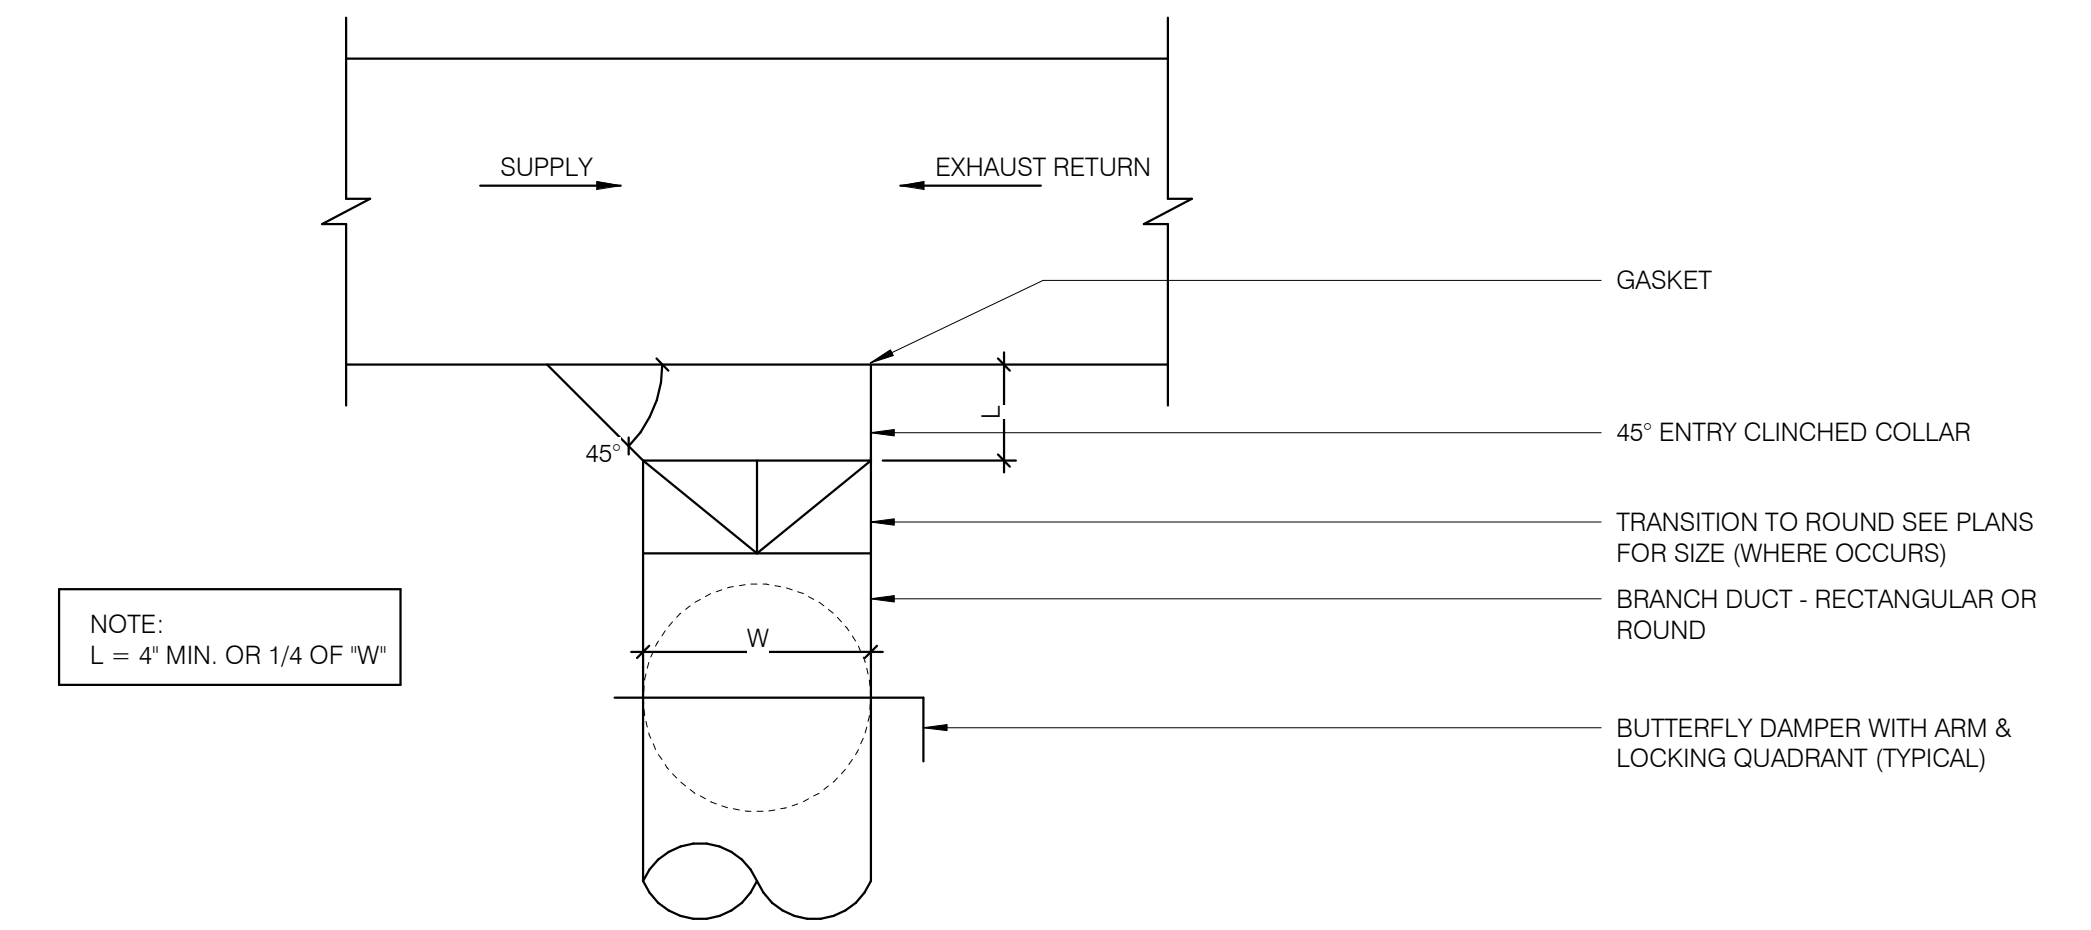

CEILING DIFFUSER CONNECTIONS NTS **4**

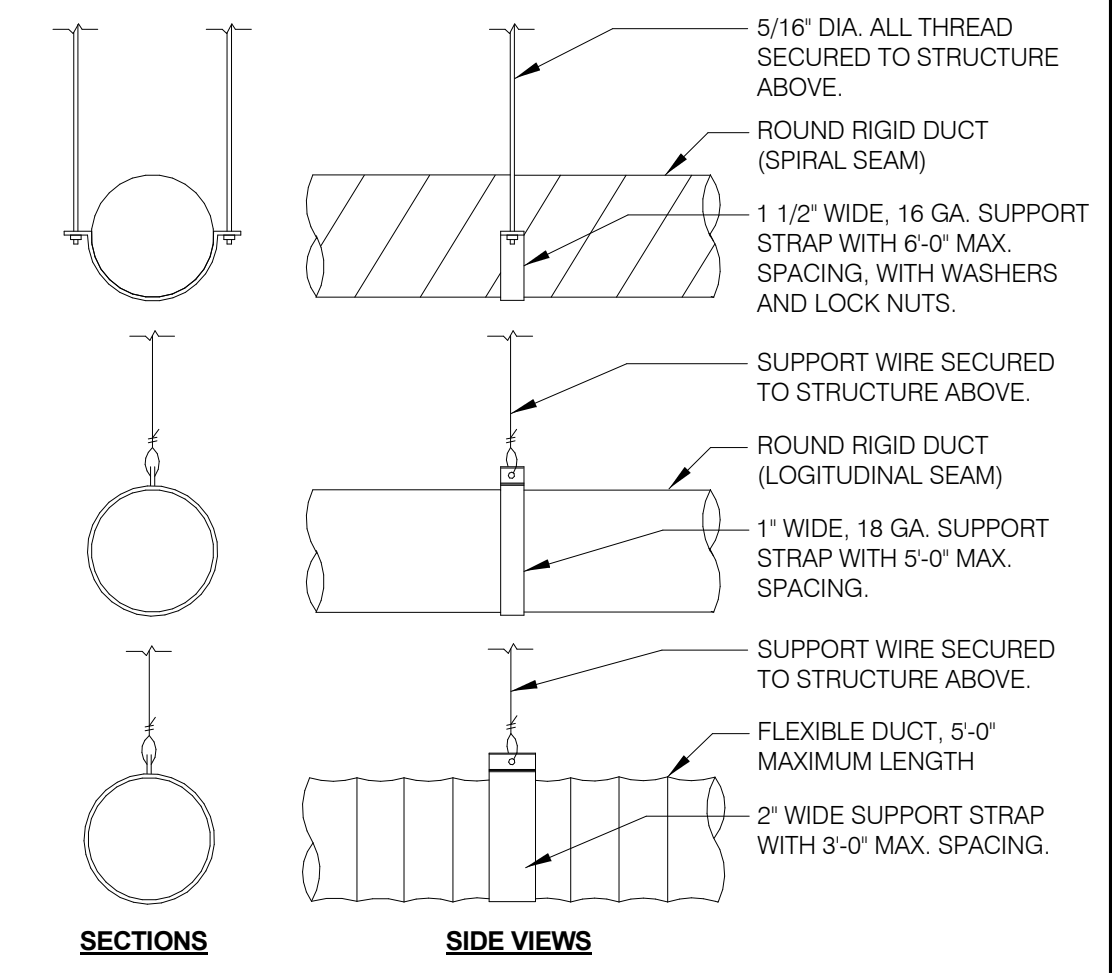

DUCT SUPPORT DETAIL NTS **1**

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: TH
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236




ENDEAVOR 2.0 MECHANICAL DETAILS


M4.0

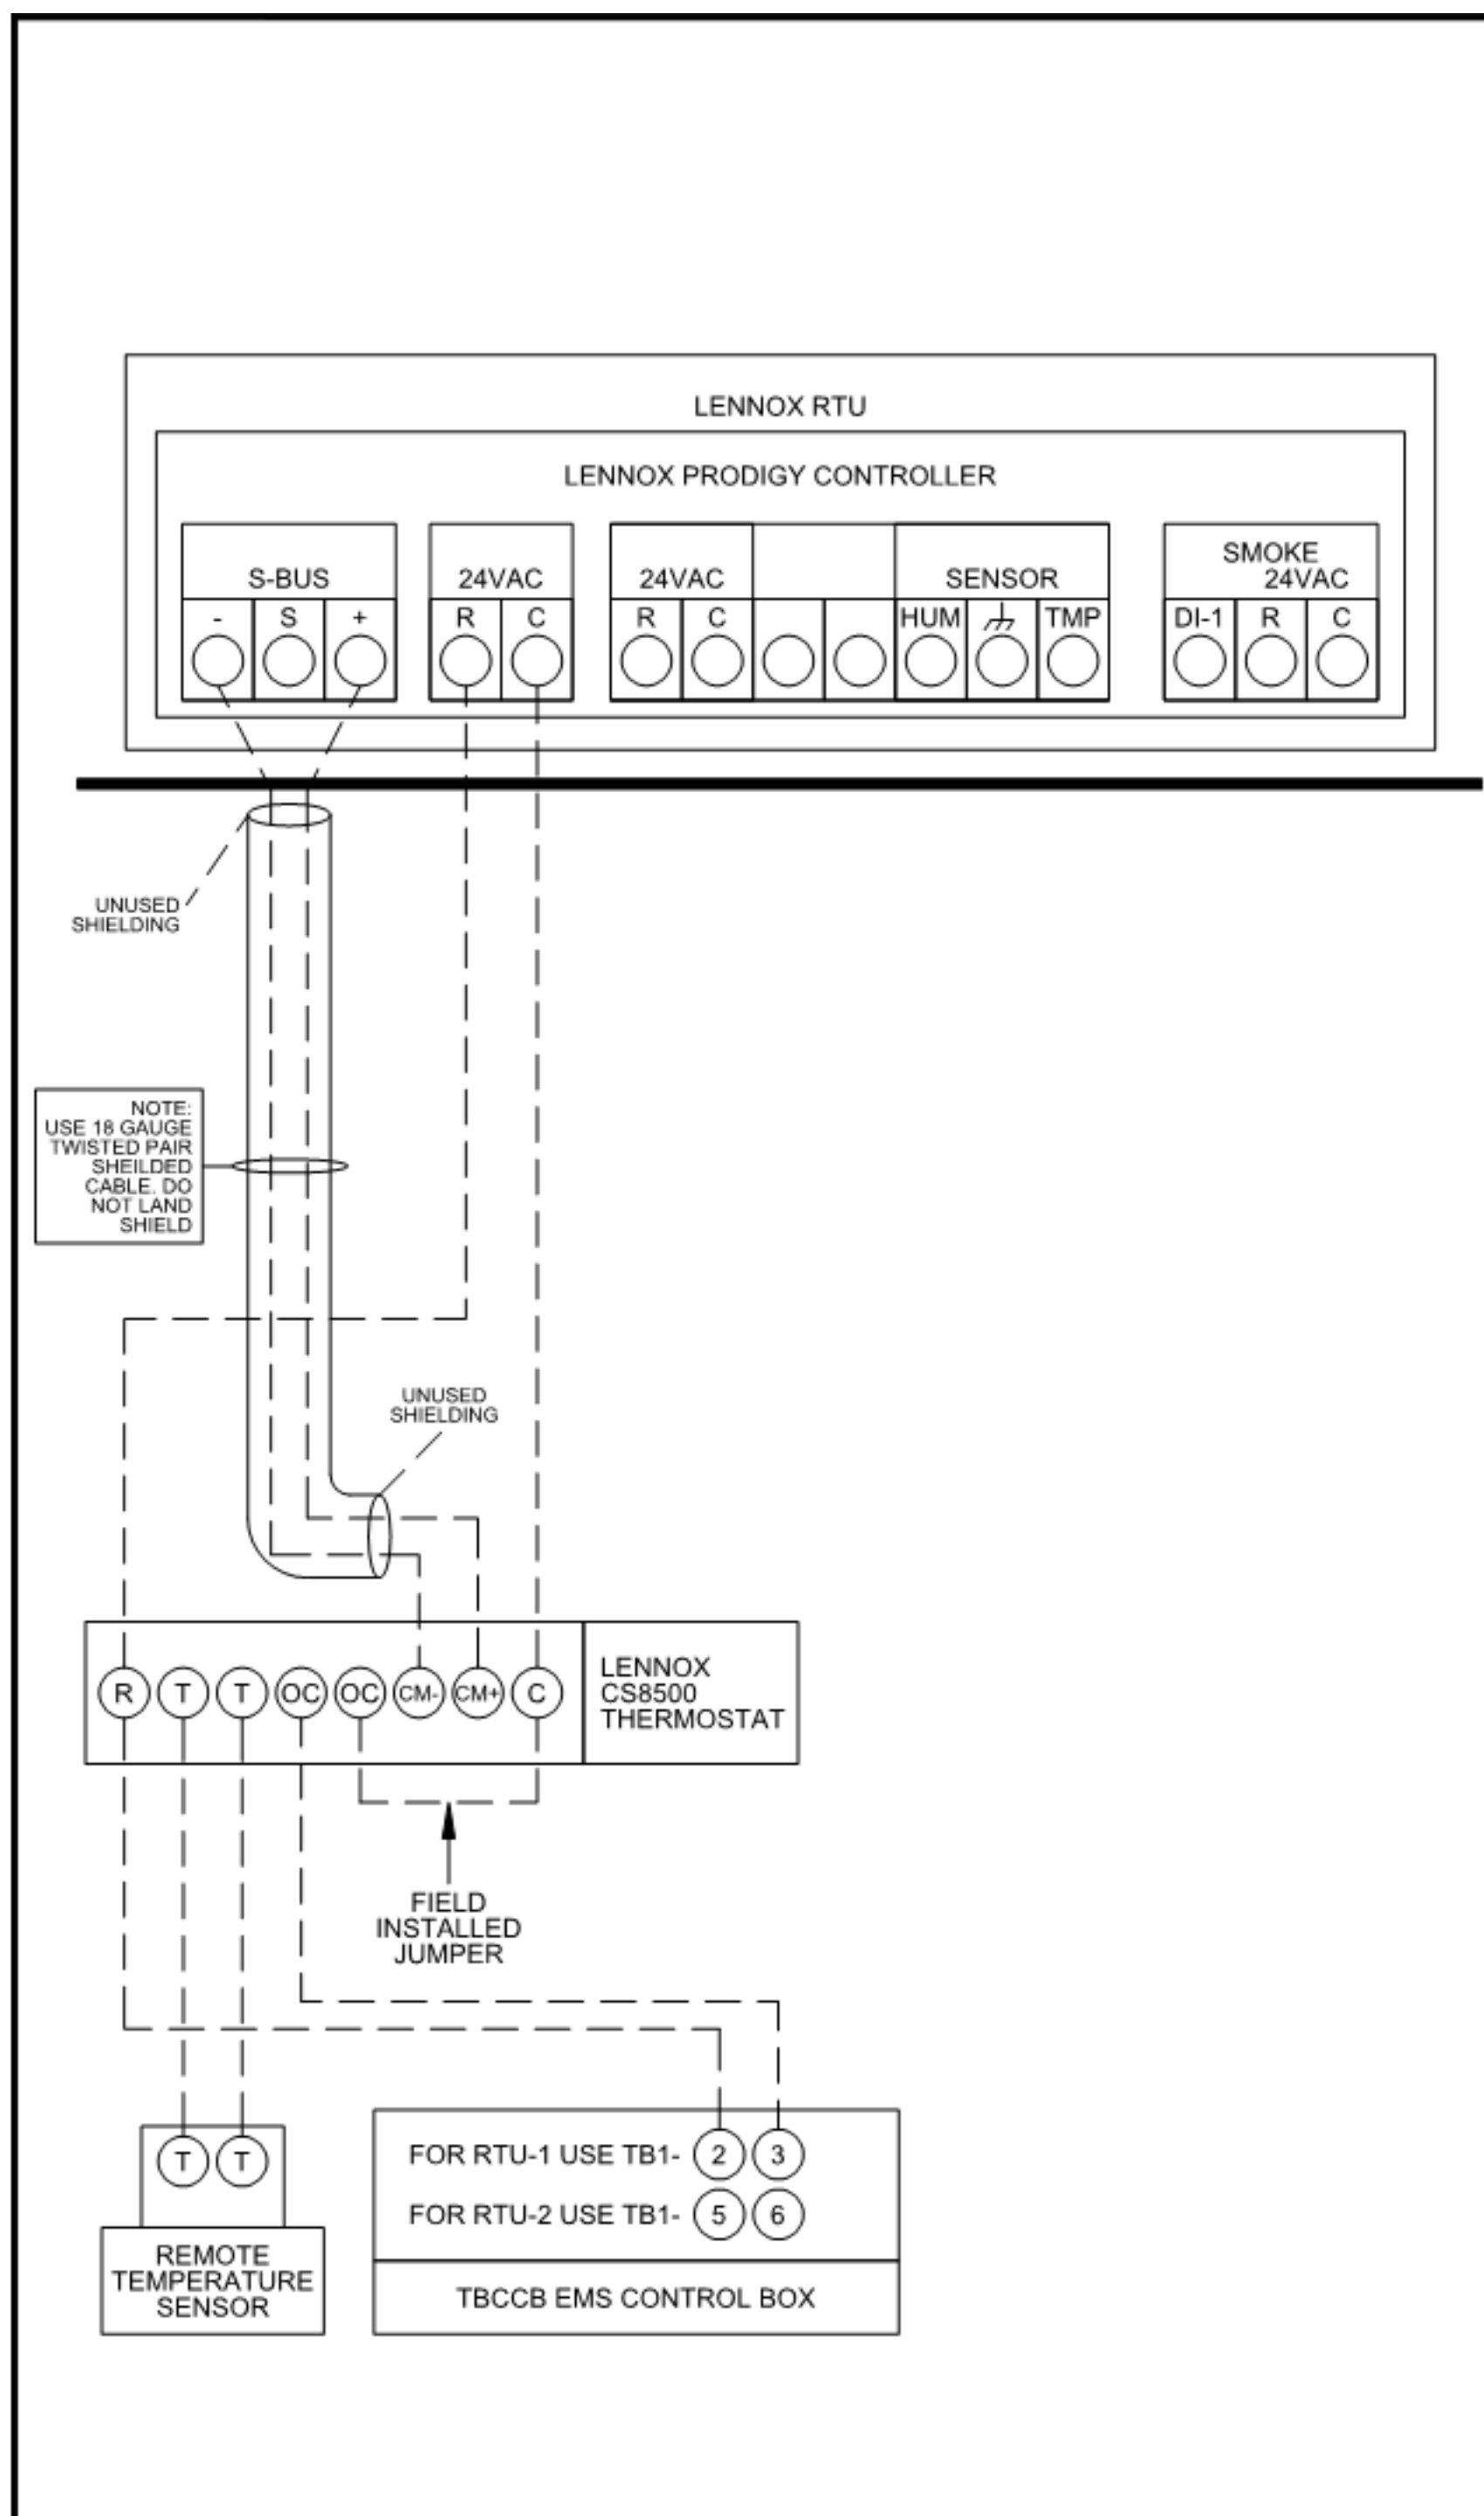

1 LENNOX PRODIGY TO THERMOSTAT AND TO TBCCB CONNECTION NTS

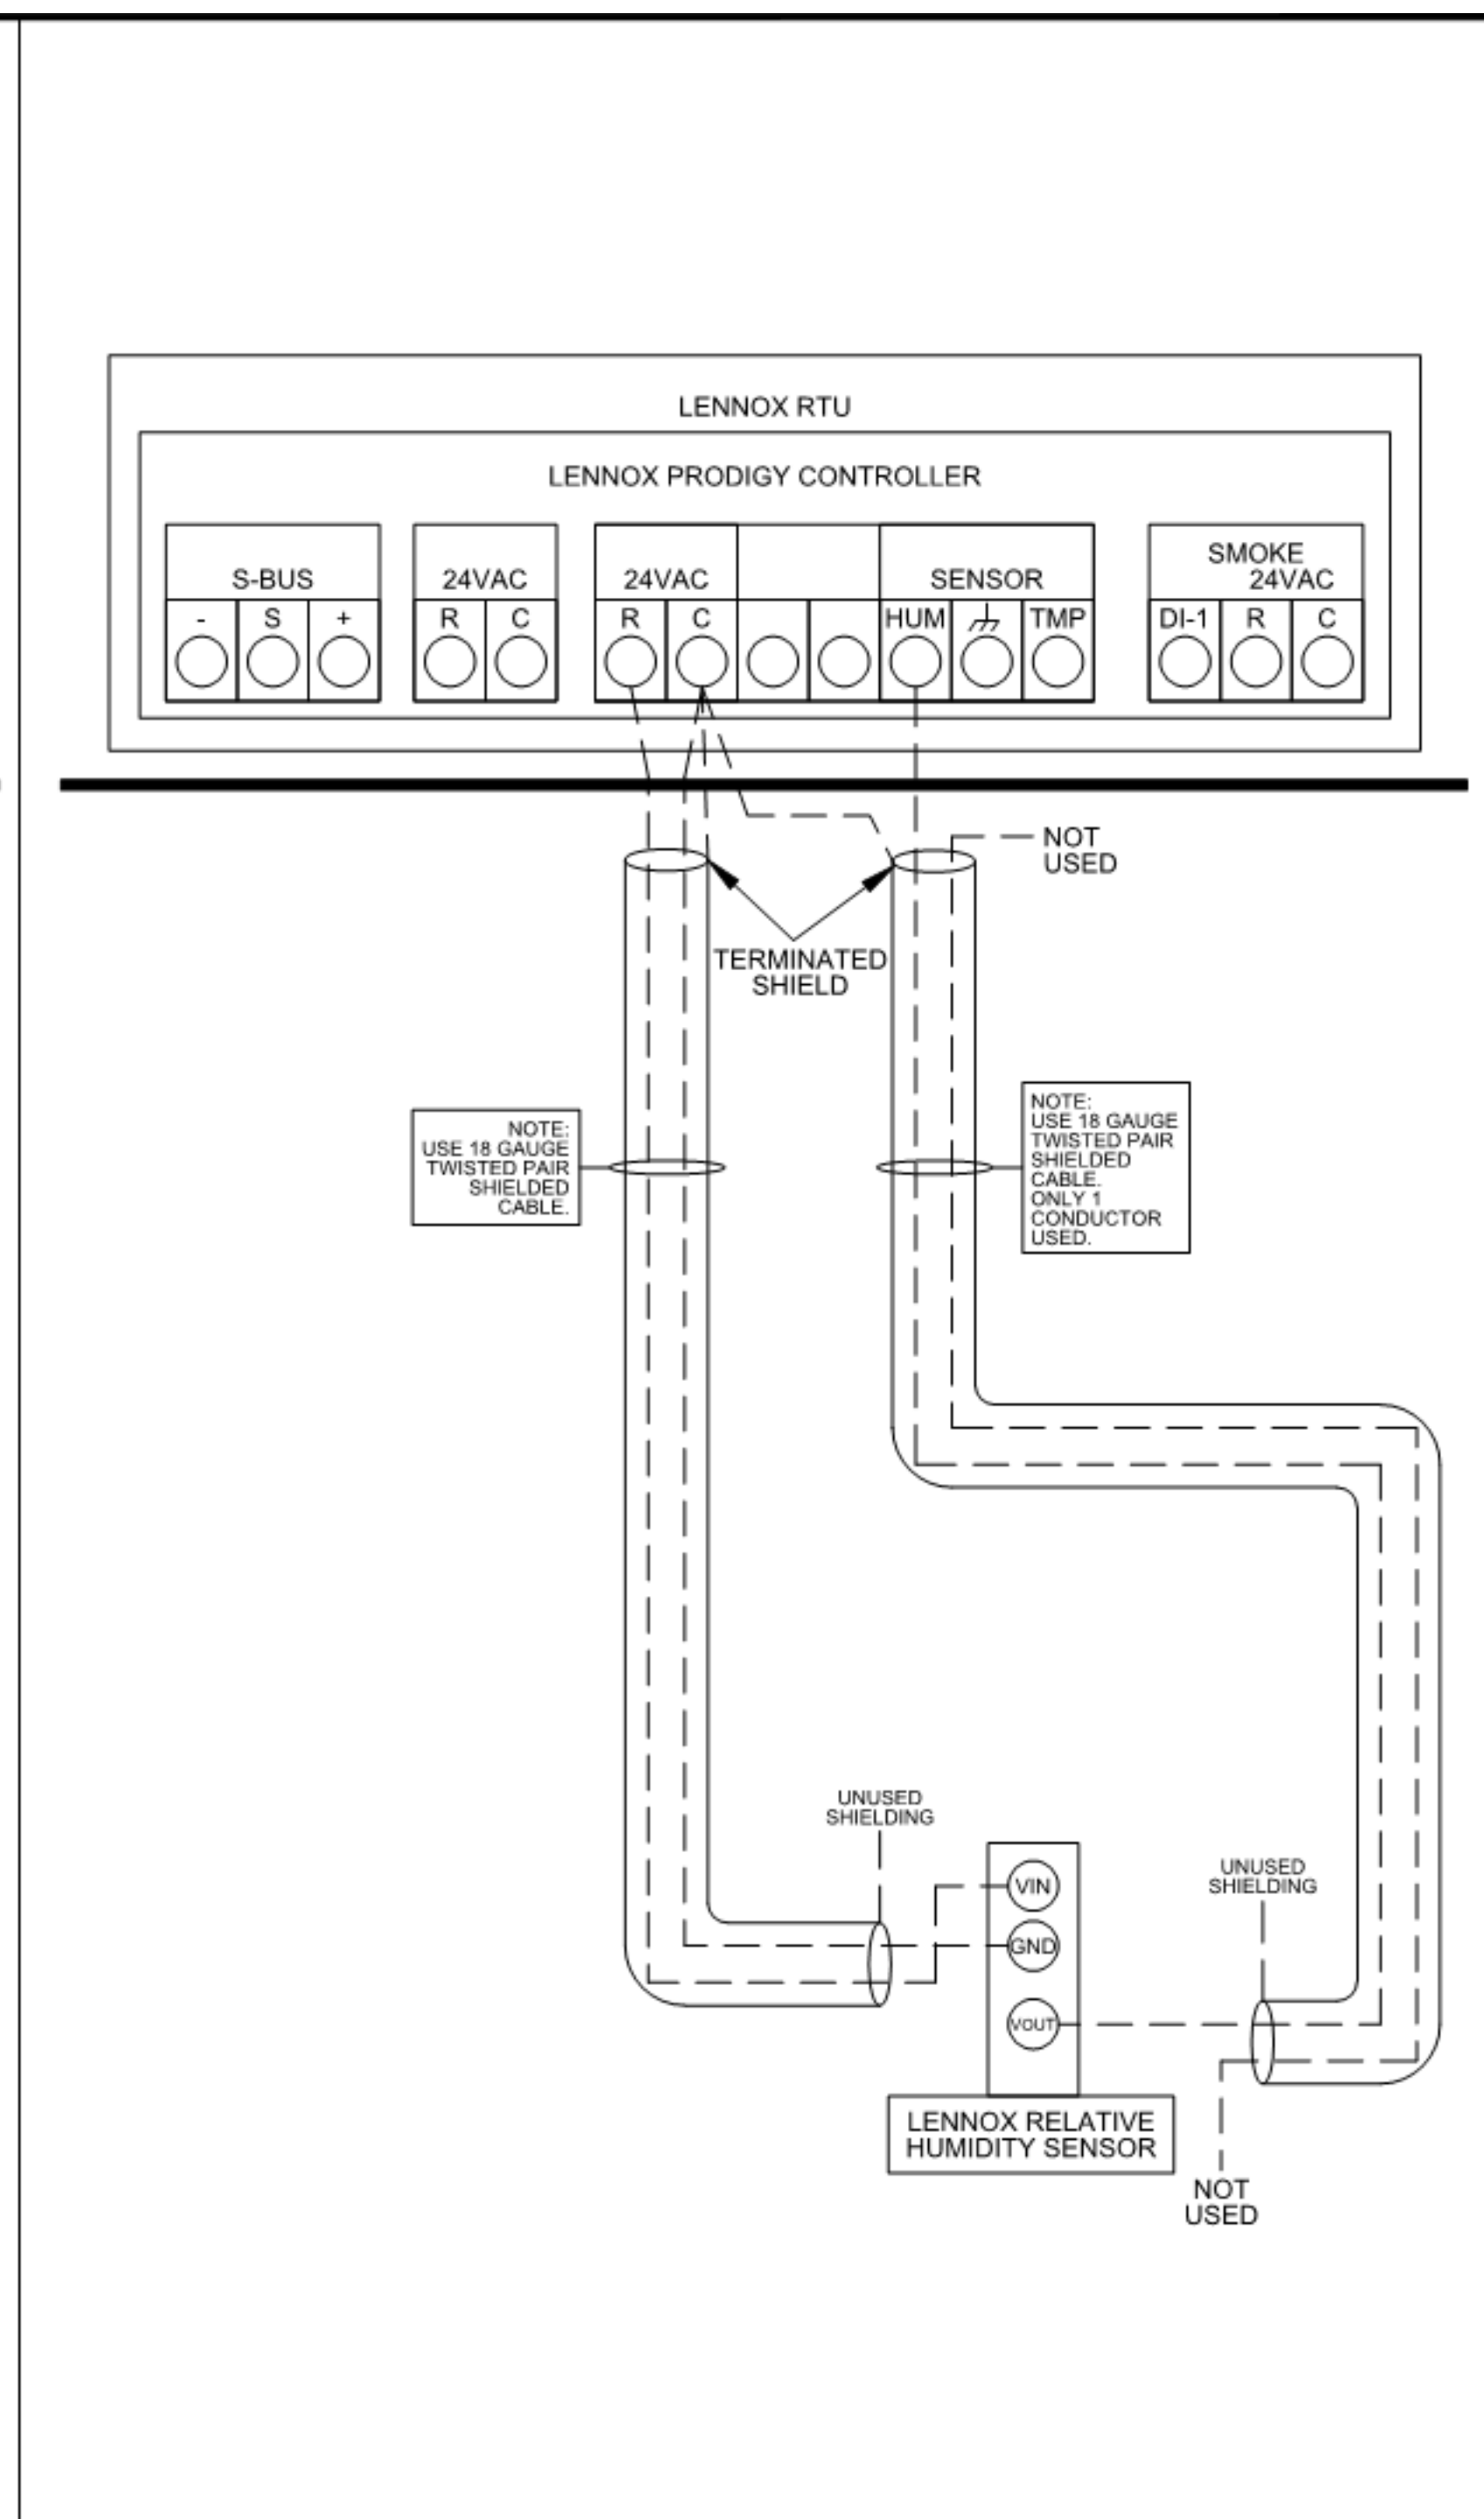

2 LENNOX PRODIGY TO OPTIONAL HUMIDITY SENSOR CONNECTION NTS

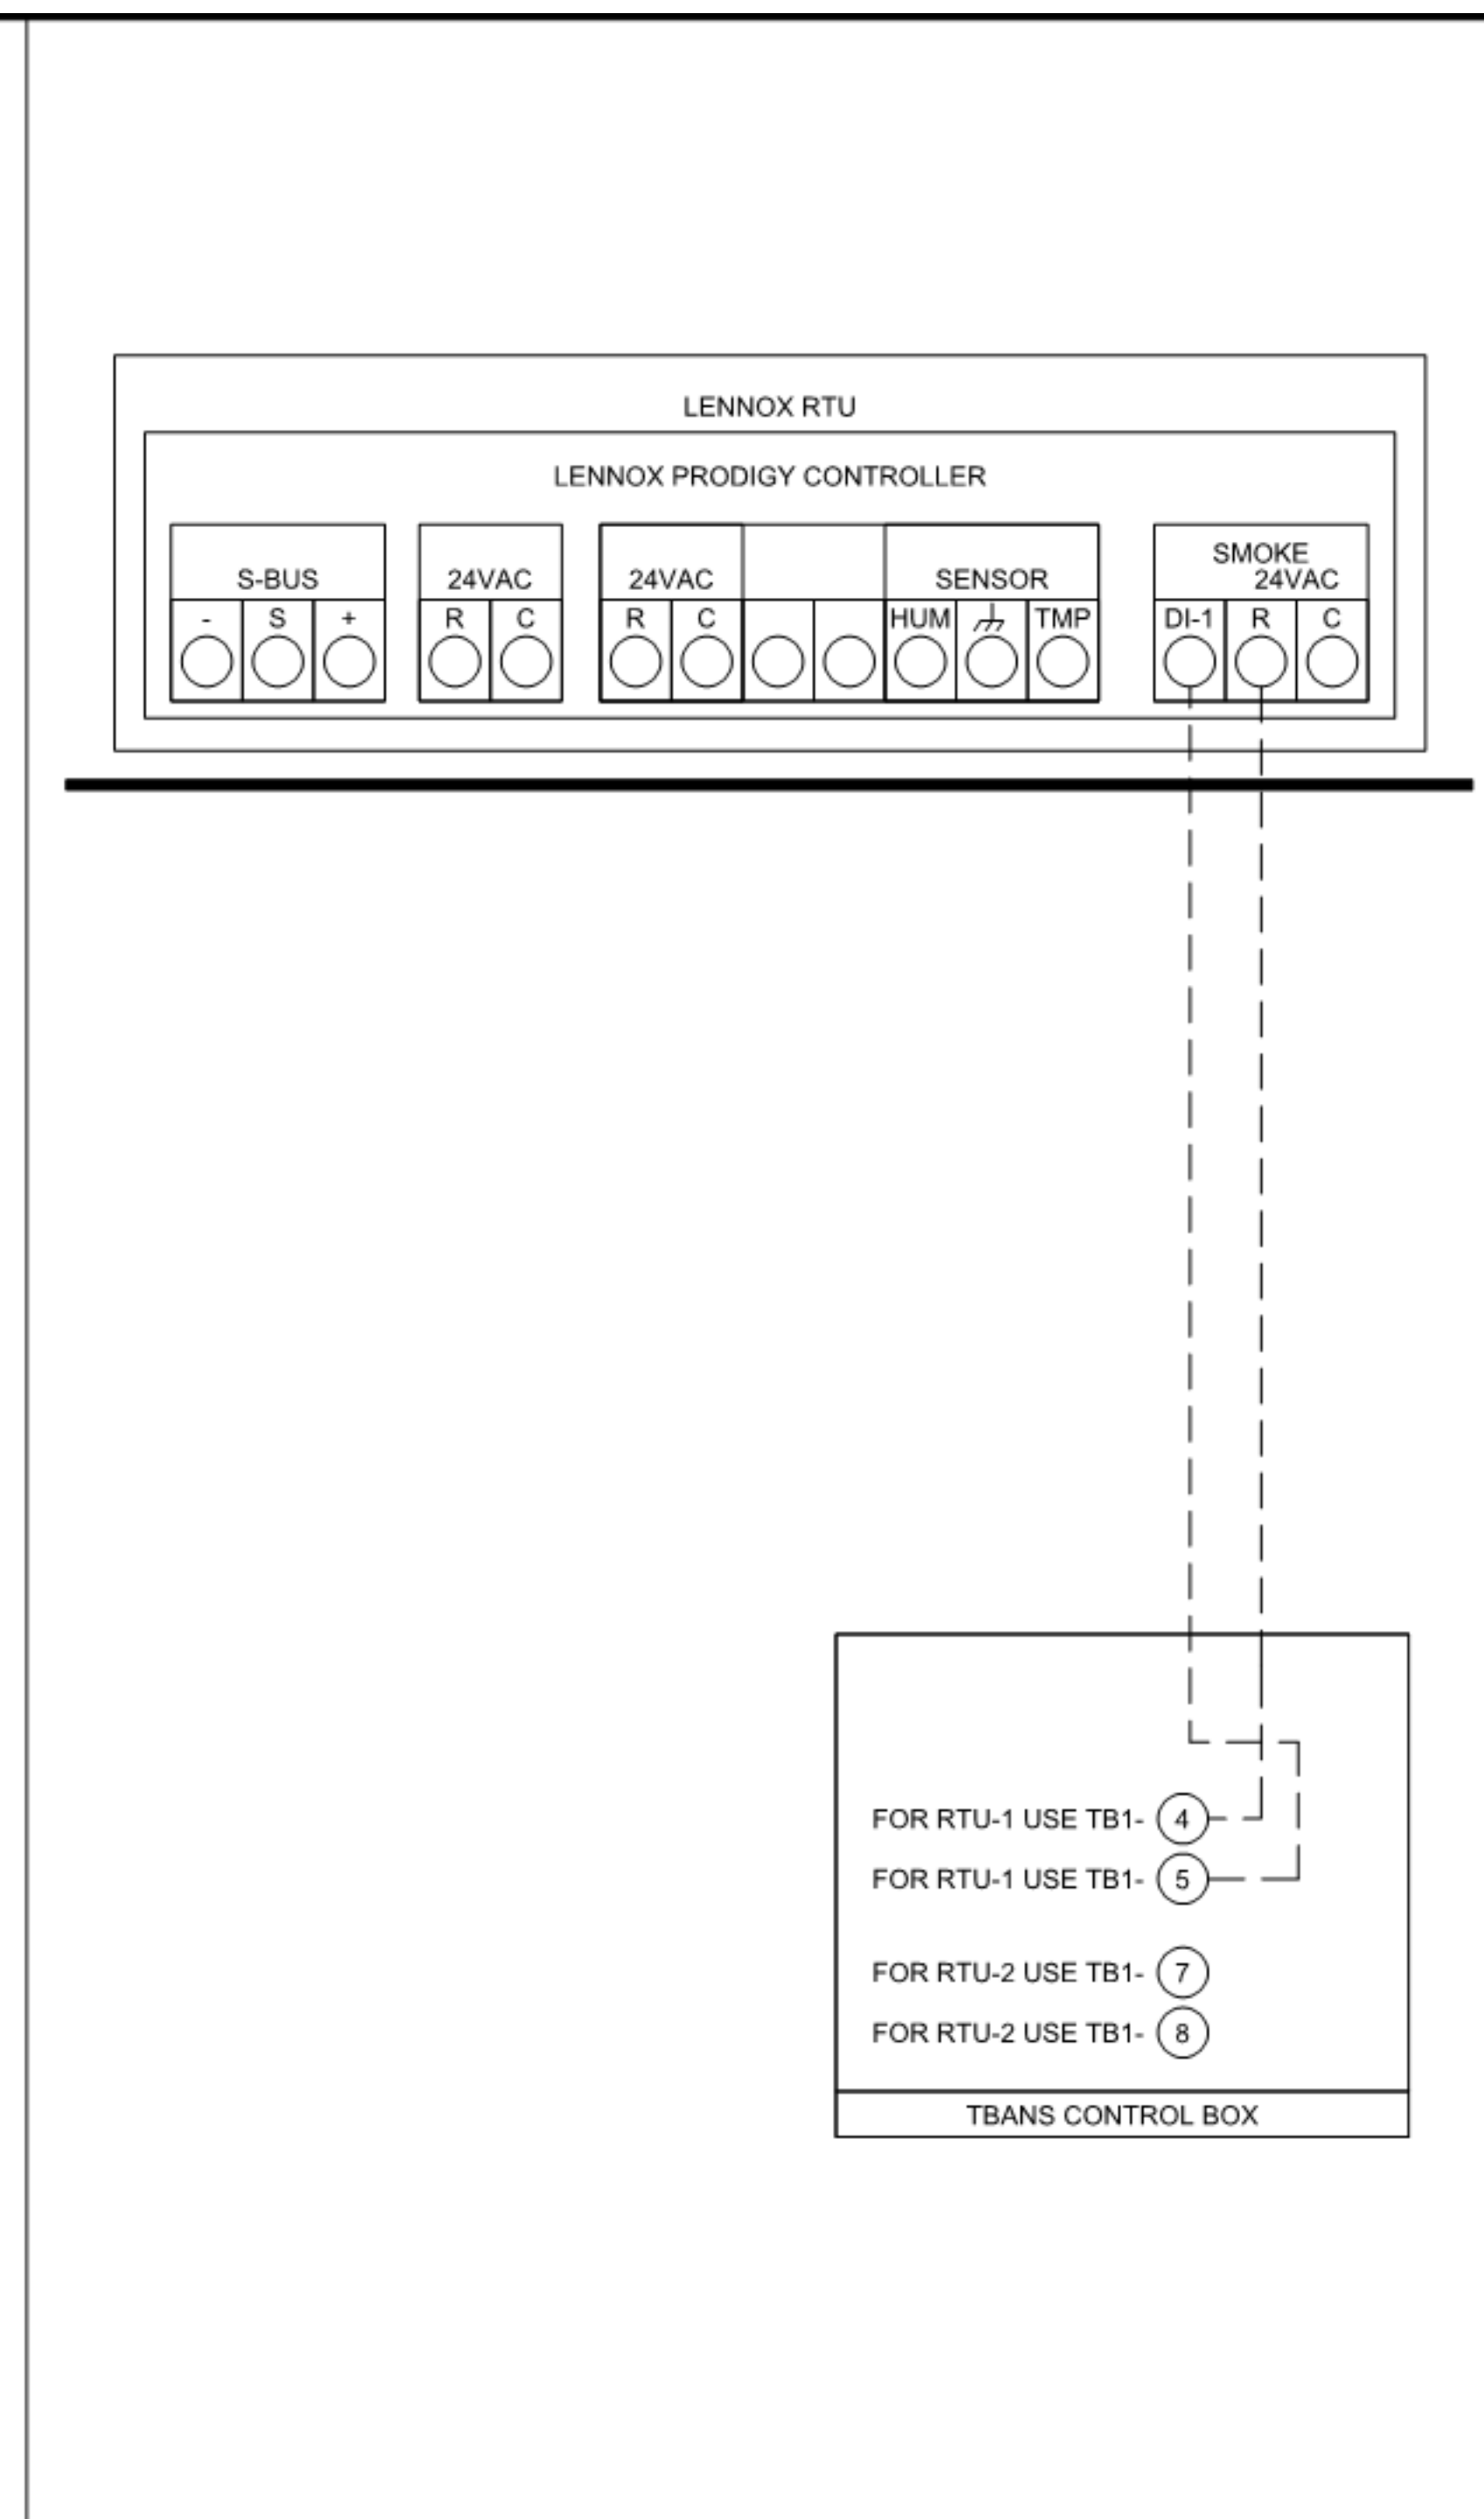

3 LENNOX PRODIGY TO TBANS CONNECTION NTS



LENNOX RTU LOW VOLTAGE FIELD CONNECTIONS DETAIL

LENNOX LOW VOLTAGE CONNECTIONS

Rev	Date	Change

Model#

Job #: **T7647**

Designed By: JL

Drawing By: EM

Approved By:

Date: 08-07-20

Sheet: 1 of 1

DATE	REMARKS
11.07.22	Issued for Construction


CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED40
 PLAN VERSION: MARCH 2020
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: TH
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236




**ENDEAVOR 1.0
 CONTROLS
 DETAILS**

M5.0

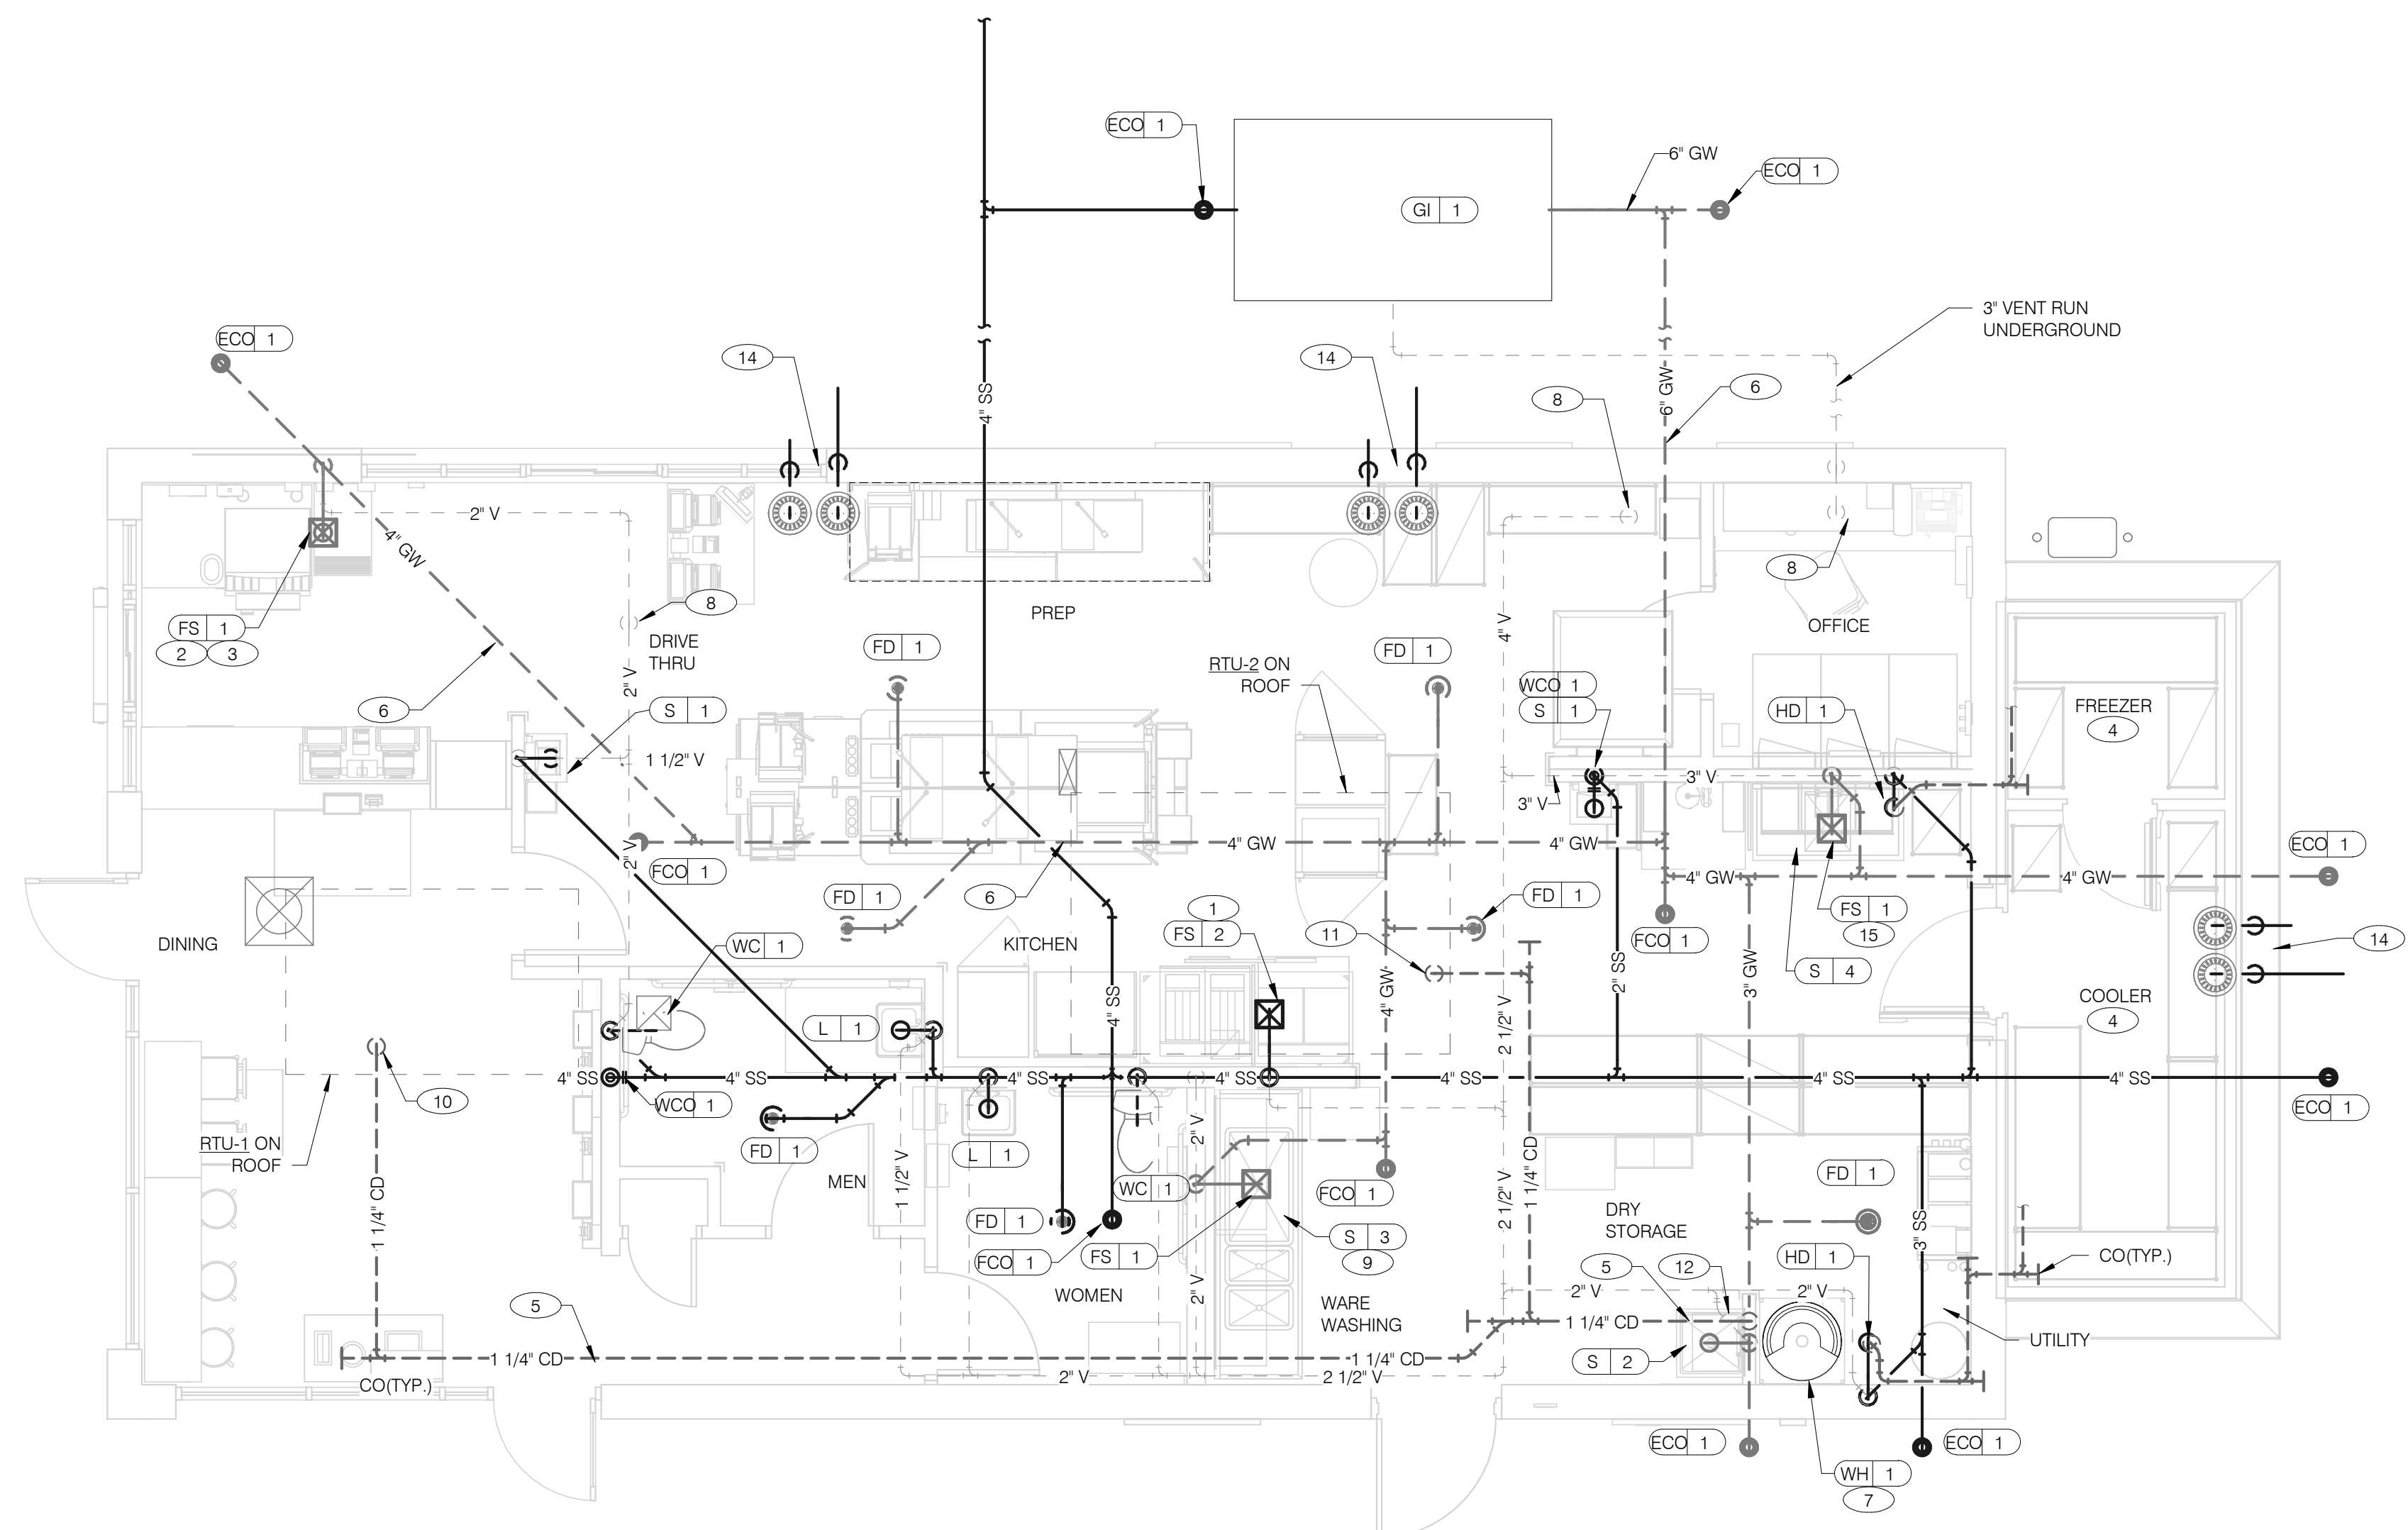


DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: TH
 JOB NO.: 2020088.03



WASTE & VENT PIPING PLAN 1/4" = 1'-0" **1**

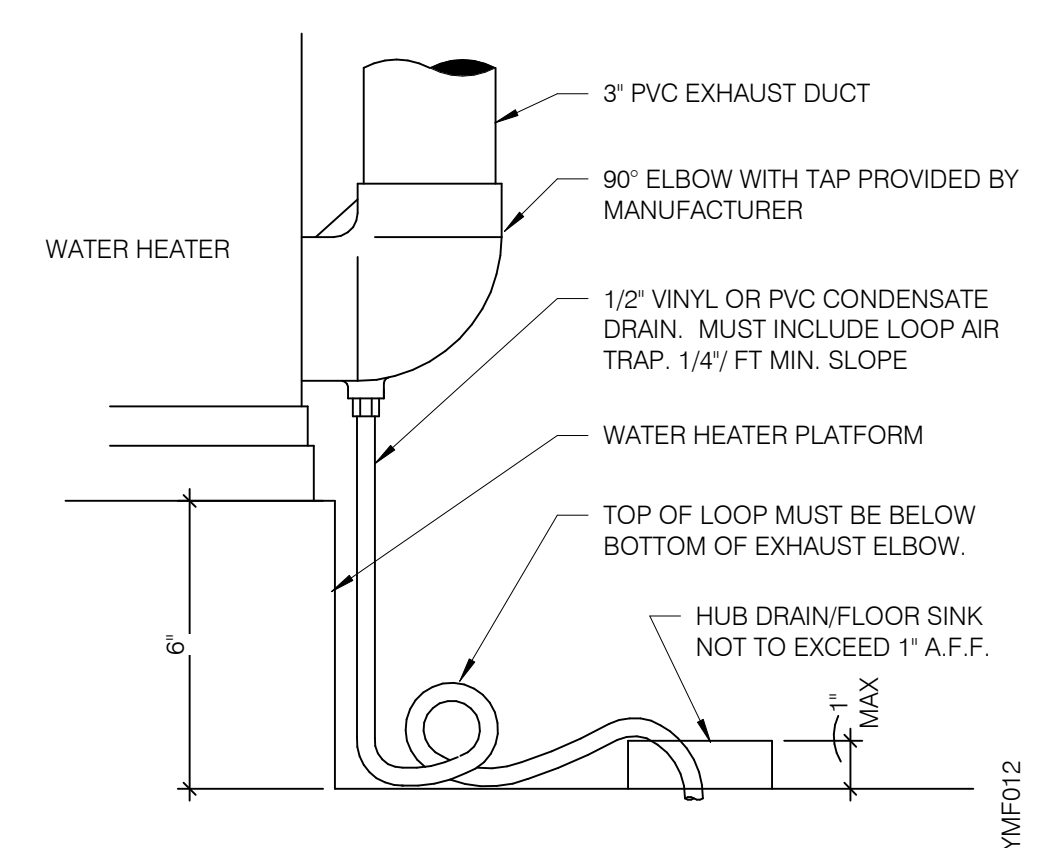

WATER HEATER CONDENSATE DETAIL NTS **4**

- A. NO ROOF PENETRATIONS PERMITTED WITHIN ROOF WATER PLY. REFER TO ROOF PLAN FOR LOCATIONS.
 B. REFER TO RISER DIAGRAM ON SHEET P5.0 FOR ALL WASTE AND VENT SIZES.
 C. SEE ARCHITECTURAL PLANS FOR DOWNSPOUT LOCATIONS
 D. VERIFY WITH THE LOCAL BUILDING AUTHORITY THAT CONDENSATE DRAINAGE CAN BE ROUTED TO THE MOP SINK.

WASTE & VENT PLAN NOTES NTS **3**

- 1 UNDERGROUND SANITARY PIPE SHALL BE NO HUB CAST IRON PIPE FOR THE FIRST 10 FEET FROM CONNECTION TO FLOOR SINK FS-2. OUTWARD.
- 2 PROVIDE DEDICATED CONDENSATE LINE AND DRAIN LINE FROM ICE MACHINE TO THE FS UNDERNEATH THE DRIVE THRU SODA MACHINE. PROVIDE AIR GAP PER LOCAL CODE.
- 3 PROVIDE DEDICATED WASTE LINES FROM BEVERAGE UNIT TO THE FS UNDERNEATH THE DRIVE THRU SODA MACHINE. PROVIDE AIR GAP PER LOCAL CODE.
- 4 PROVIDE 3/4" COPPER CONDENSATE FROM DRAIN PROVIDED BY VENDOR TO OUTFALL AT HUB DRAIN/MOP SINK (HEAT ROPE IS SUPPLIED WITH FREEZER CONDENSATE). CONCEAL CONDENSATE PIPE IN WALL.
- 5 PVC OR COPPER CONDENSATE DRAIN FROM HVAC UNITS ON ROOF. RUN TO MOP SINK. PIPING SHALL SLOPE 1/4" PER FOOT AND SHALL BE INSULATED WITH 1" CLOSED CELLULAR INSULATION. REFER TO RISER DIAGRAM ON SHEET P5.0 FOR PIPE SIZES.
- 6 ENTIRE RUN OF DRAIN LINES TO INLET OF EXTERIOR GREASE INTERCEPTOR AND OUTBOUND FROM INTERCEPTOR TO CONNECTION AT SANITARY MAIN SHALL BE SCHEDULE 40 PVC DWV OR AS REQUIRED BY AUTHORITY HAVING JURISDICTION.
- 7 ROUTE INDIRECT WASTE FROM WH-1 TO HD-1. REFERENCE DETAIL 2/P6.1 AND DETAIL 4/P2.0.
- 8 4" VENT UP THROUGH ROOF.
- 9 PIPE 3-COMPARTMENT SINK TO FLOOR SINK WITH AIR GAP PER CODE.

- 10 1-1/4" CONDENSATE DRAIN DOWN FROM RTU-1. SEE DETAIL 10/P6.0.
- 11 1-1/4" CONDENSATE DRAIN DOWN FROM RTU-2. SEE DETAIL 10/P6.0.
- 12 CONDENSATE DRAIN PIPE DOWN TO MOP SINK. PROVIDE AIR GAP AS REQUIRED BY CODE. IF REQUIRED RUN CONDENSATE PIPING TO EXTERIOR DRYWELL, RETENTION AREA OR STORM SEWER AS DIRECTED BY AUTHORITY HAVING JURISDICTION.
- 13 NOT USED.
- 14 ROOF DRAIN AND OVERFLOW.
- 15 ROUTE DRAIN FOR REVERSE OSMOSIS DISCHARGE TO FLOOR SINK. ENSURE PROPER AIR GAP.

KEYNOTES - WASTE AND VENT NTS **2**

TACO BELL



18550 E. WARREN AVE.,
DETROIT, MI 48236



**ENDEAVOR 2.0
WASTE AND
VENT PLAN**

P2.0

PLOT DATE: 11/3/2022 9:59:49 AM

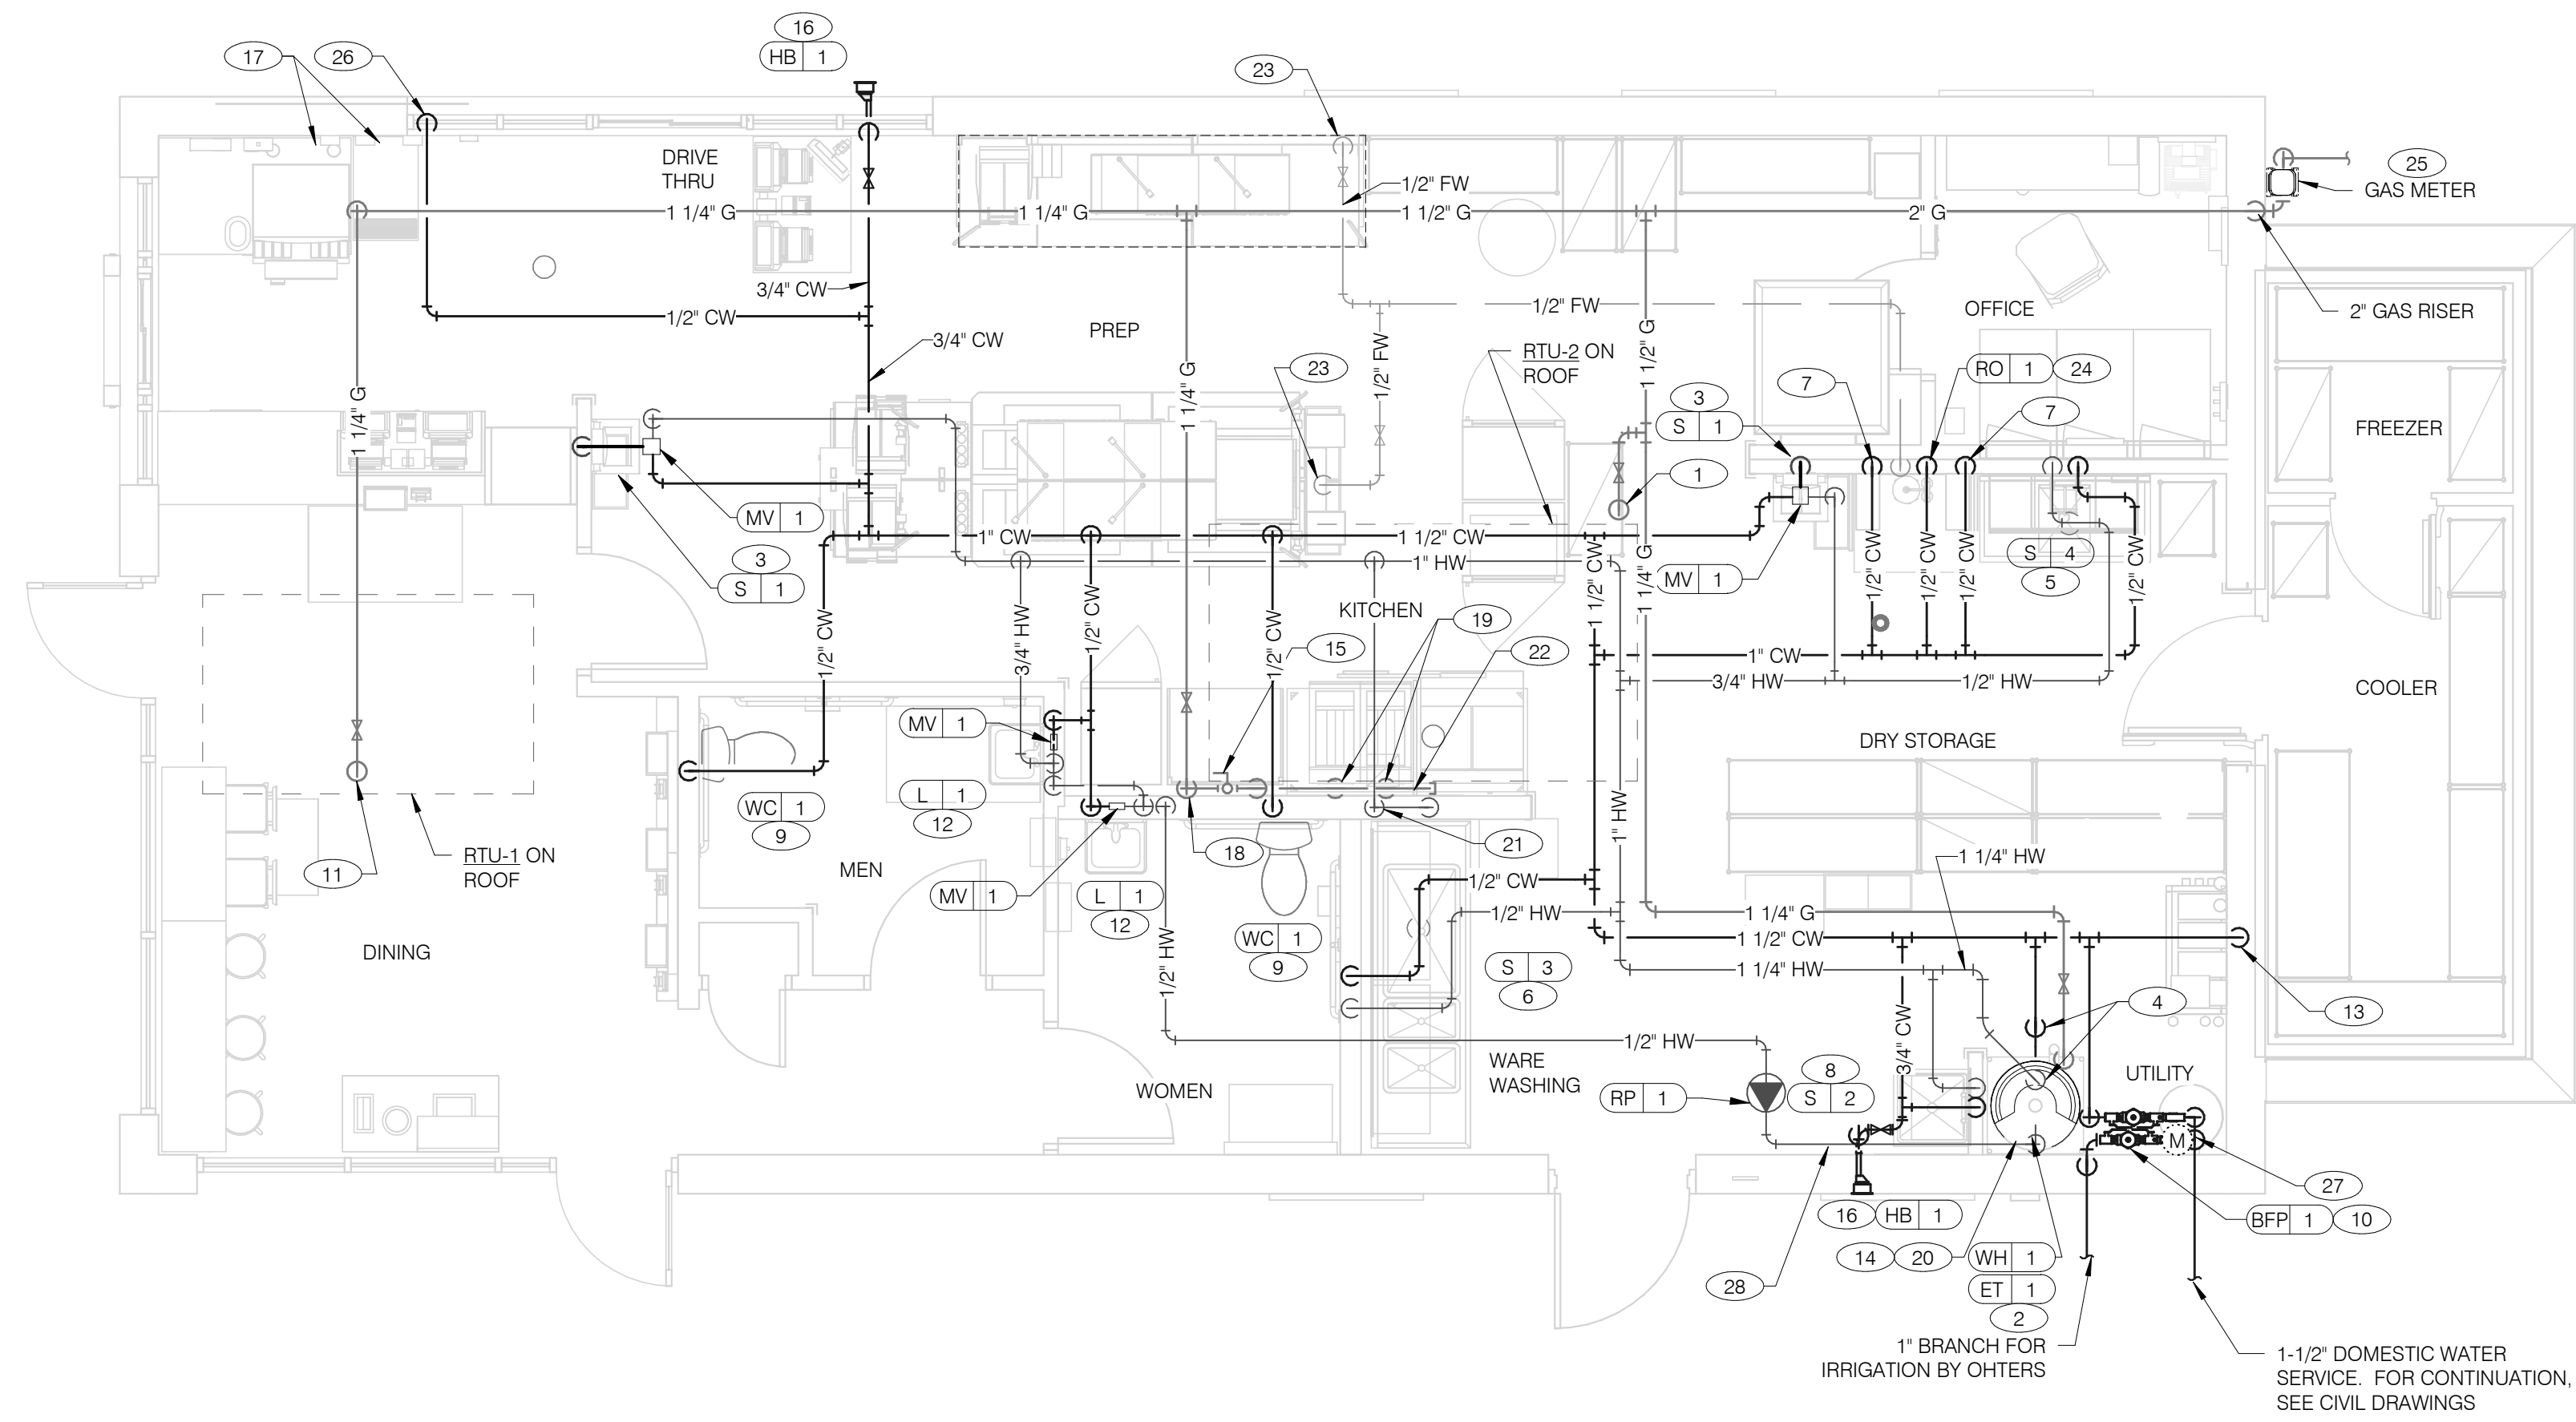

WATER & GAS PLAN 1/4" = 1'-0" **1**

- A. NO ROOF PENETRATIONS PERMITTED WITHIN ROOF "WATER VALLEYS". REFER TO ROOF PLAN FOR LOCATIONS.
- B. REFER TO SHEET P4.0 FOR ROUGH-IN LOCATIONS.
- C. REFER TO SHEET P5.0 FOR WATER AND GAS ISOMETRIC DRAWINGS.
- D. FLUSH ALL WATER SUPPLY LINES OF ALL DEBRIS AND IMPURITIES PRIOR TO CONNECTING TO WATER FILTERS.
- E. PROVIDE REDUCED PRESSURE BACKFLOW PREVENTER TO SERVE CARBONATOR. DRAIN RELIEF TO FLOOR SINK WITH AIR GAP

- 1 1-1/4" (260 CFH) GAS UP TO RTU-2 WITH DIRT LEG, GAS COCK AND UNION.
- 2 1-1/4" (120 CFH) GAS DOWN TO WATER HEATER WITH GAS COCK, DIRT LEG AND UNION.
- 3 1/2" TEMPERED WATER DOWN IN WALL TO HAND SINK.
- 4 1-1/4" HOT AND 1-1/4" COLD WATER LINES DOWN TO WATER HEATER.
- 5 1/2" HOT AND COLD WATER LINES DOWN IN WALL TO PREP SINK.
- 6 1/2" COLD AND HOT WATER LINES DOWN IN WALL TO THREE COMP. SINK.
- 7 1/2" COLD WATER 2'-0" A.F.F. . CONNECT TO WATER FILTER FOR HOT WATER SYSTEM P-452. PROVIDE SHUT-OFF VALVE PRIOR TO CONNECTION TO WATER FILTER.
- 8 1/2" COLD AND HOT WATER DOWN IN WALL TO MOP SINK.
- 9 1/2" CW DOWN IN WALL TO FLUSH TANK WATER CLOSET .
- 10 PROVIDE REDUCED PRESSURE BACKFLOW PREVENTER. WATER METER LOCATED OUTSIDE. REFER TO CIVIL PLANS FOR CONTINUATION AND FURTHER INFORMATION.
- 11 1-1/4" (180 CFH) GAS UP TO RTU-1 WITH DIRT LEG, GAS COCK AND UNION.
- 12 1/2" TEMPERED WATER LINES DOWN IN WALL TO LAVATORY.
- 13 3/4" CW DOWN ALONG WALL TO WATER FILTER S-540.
- 14 WATER HEATER (WH-1). PIPE CONDENSATE LINE, T&P DISCHARGE AND DRAIN PAN TO HUB DRAIN. SEE WATER HEATER DETAIL 2/P6.1.
- 15 EMERGENCY GAS SHUT OFF VALVE LOCATED BELOW CEILING.
- 16 3/4" CW DOWN IN WALL TO EXTERIOR HOSE BIBB.
- 17 BUNDLED SYRUP LINES TO BEVERAGE DISPENSERS S-284 & S-285 AND FILTERED WATER LINES TO ICE MAKERS S-513 AND FROZEN BEVERAGE DISPENSER S-546. SEE DRAWINGS A2.0 AND P5.0.
- 18 1-1/4" GAS DOWN ALONG WALL TO COOKING EQUIPMENT. VERTICAL GAS PIPING IN WALL SHALL NOT BE RIGIDLY SECURED AND ADEQUATE PIPE PROTECTION SHALL BE PROVIDED.
- 19 3/4" GAS DIRT LEG W/ GAS COCK TO COOKING EQUIPMENT. PROVIDE FLEXIBLE GAS HOSE KIT FOR CONNECTION TO COOKING EQUIPMENT.
- 20 3" PVC EXHAUST AND INTAKE FLUES FROM WATER HEATER, PIPE THROUGH ROOF AS RECOMMENDED BY MANUFACTURER TO LOCATIONS SHOWN ON SHEET M2.0. SEE DETAIL 1/P6.1.
- 21 1/2" HOT WATER DOWN IN WALL TO RETHERMALIZER C-107. PROVIDE SHUT-OFF VALVE OUTSIDE OF WALL FOR CONNECTION TO RETHERMALIZER.
- 22 RUN GAS PIPE 18" A.F.F. WITH DIRT LEGS FOR GAS HOSE KITS TO COOKING EQUIPMENT C-026 AND C-107.
- 23 1/2" RO WATER PIPE DOWN IN WALL AND ROUTED IN LOW WALL OF DRY PRODUCTION LINE. PROVIDE SHUT-OFF VALVE ON RO PIPING IN CEILING NEAR CHASE.
- 24 1/2" COLD WATER TO REVERSE OSMOSIS FILTER P-315 AND 1/2" FILTER WATER FROM REVERSE OSMOSIS FILTER. PROVIDE SHUT-OFF VALVE ON CW PIPE PRIOR TO CONNECTION TO FILTER. SEE DETAIL 9/P6.0.
- 25 GAS METER, REGULATOR VALVES, BRACKETS, ETC. AS REQUIRED BY LOCAL GAS COMPANY. SEE CIVIL DRAWINGS FOR CONTINUATION.
- 26 1/2" COLD WATER. CONNECT TO WATER FILTER FOR BUNN POD BREWER S-547. PROVIDE SHUT-OFF VALVE PRIOR TO CONNECTION TO WATER FILTER.
- 27 1" DUCT METER FOR IRRIGATION SYSTEM.
- 28 1/2" HOT WATER RETURN DOWN TO WATER HEATER HOT WATER RETURN INLET.

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: TH
 JOB NO.: 2020088.03


TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236



**ENDEAVOR 2.0
 WATER AND
 GAS PLAN**

P3.0

PLOT DATE: 11/3/2022 9:59:51 AM

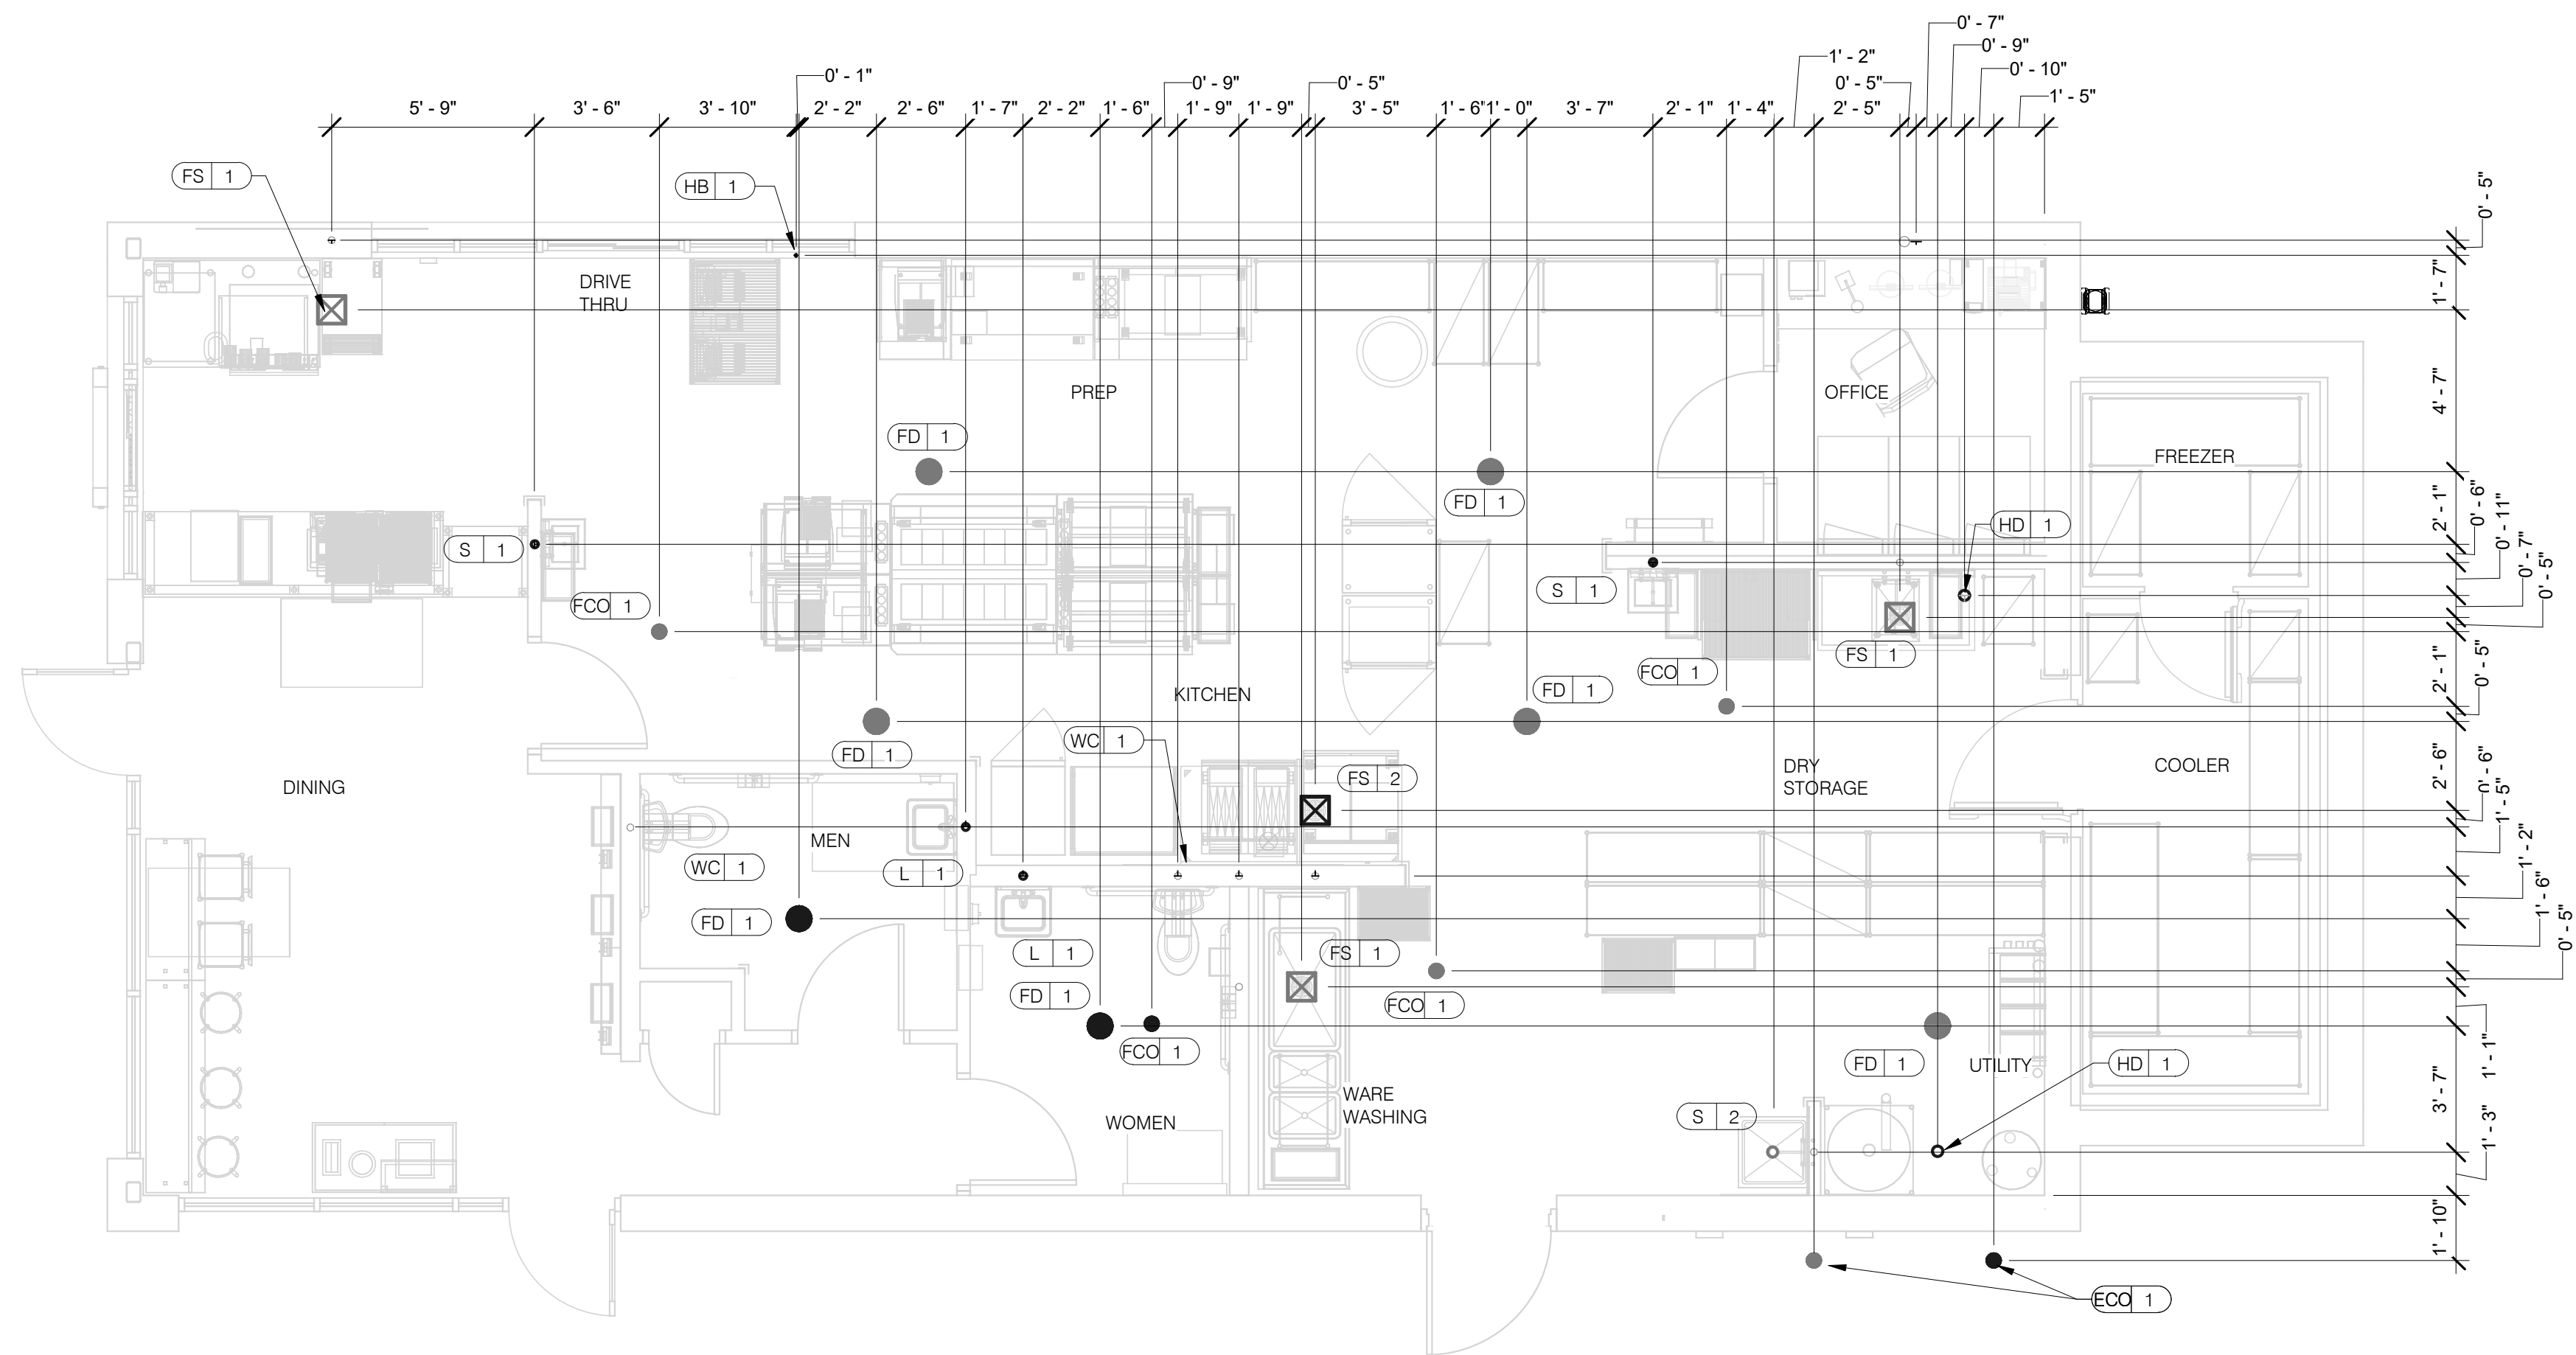

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: TH
 JOB NO.: 2020088.03

PLUMBING ROUGH-IN PLAN 1/4" = 1'-0" **1**

EQUIP #	EQUIPMENT ITEM	TYPE	ELEVATION	REMARKS	EQUIP #	EQUIPMENT ITEM	TYPE	ELEVATION	REMARKS
FS 1	FLOOR SINK			--	S 3	3-COMPARTMENT SINK FAUCET	CW/HW	+38" A.F.F.	--
FS 2	FLOOR SINK			EPOXY COATED CAST IRON	S 4	PREP SINK	W	+19" A.F.F.	--
HD 1	HUB DRAIN			--	S 4	PREP SINK FAUCET	CW/HW	+38" A.F.F.	--
WH 1	WATER HEATER	CW		--	WCO 1	WALL CLEAN OUT			--
WH 1	WATER HEATER	G	+15" A.F.F.	--	FCC 1	FLOOR CLEAN OUT			--
WC 1	WATER CLOSET	CW	+29" A.F.F.	BOTH HANDICAP AND REGULAR	HB 1	HOSE BIB			--
UR 1	URINAL FLUSH VALVE	CW	+47" A.F.F.	WALL MOUNTED					
UR 1	URINAL WASTE STUB	W	+16-1/2" A.F.F.	WALL MOUNTED					
L 1	LAVATORY	TW	+20" A.F.F.	--	C-107	REETHERMALIZER	HW	+8" A.F.F.	
L 1	LAVATORY WASTE LINE	W	+16-1/2" A.F.F.	--	C-107	REETHERMALIZER	G	+12" A.F.F.	
RO 1	REVERSE OSMOSIS	CW	+84" A.F.F.	--	C-026	DUAL VAT FRYER	G	+12" A.F.F.	
S 1	HAND SINK	TW	+18" A.F.F.	RIM OF LAV @ +2-8" A.F.F.					
S 2	MOP SINK	W	-6" A.F.F.	RECESSED IN FLOOR					
S 2	MOP SINK FAUCET	CW/HW	+36" A.F.F.	--	S-286	WATER FILTER SYSTEM	CW	+94" A.F.F.	INLET TO & OUTLET FROM FILTER
S 2	MOP SINK FAUCET	CW/HW	+42" A.F.F.	CLOSET MOP SINK ONLY					
S 3	3-COMPARTMENT SINK	W	+19" A.F.F.	--	P-452	HOT WATER SYSTEM	CW	+24" A.F.F.	

- ALL DIMENSIONS TO FLOOR SINKS, FLOOR DRAINS AND HUB DRAINS ARE TO CENTER OF FIXTURE.
- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE THIS DATA ON LOCATION OF ALL PLUMBING ROUGH-INS WITH INFORMATION PROVIDED ON ARCHITECTURAL AND STRUCTURAL DRAWINGS AND EQUIPMENT ACTUALLY SUPPLIED AND TO CONFIRM CORRECTNESS OF DIMENSIONS INDICATED HEREIN.

PLUMBING ROUGH-IN SCHEDULE NTS **3**

PLUMBING ROUGH-IN NOTES NTS **2**


TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236




ENDEAVOR 2.0
PLUMBING
ROUGH-IN PLAN

P4.0

PLOT DATE: 11/3/2022 9:59:52 AM

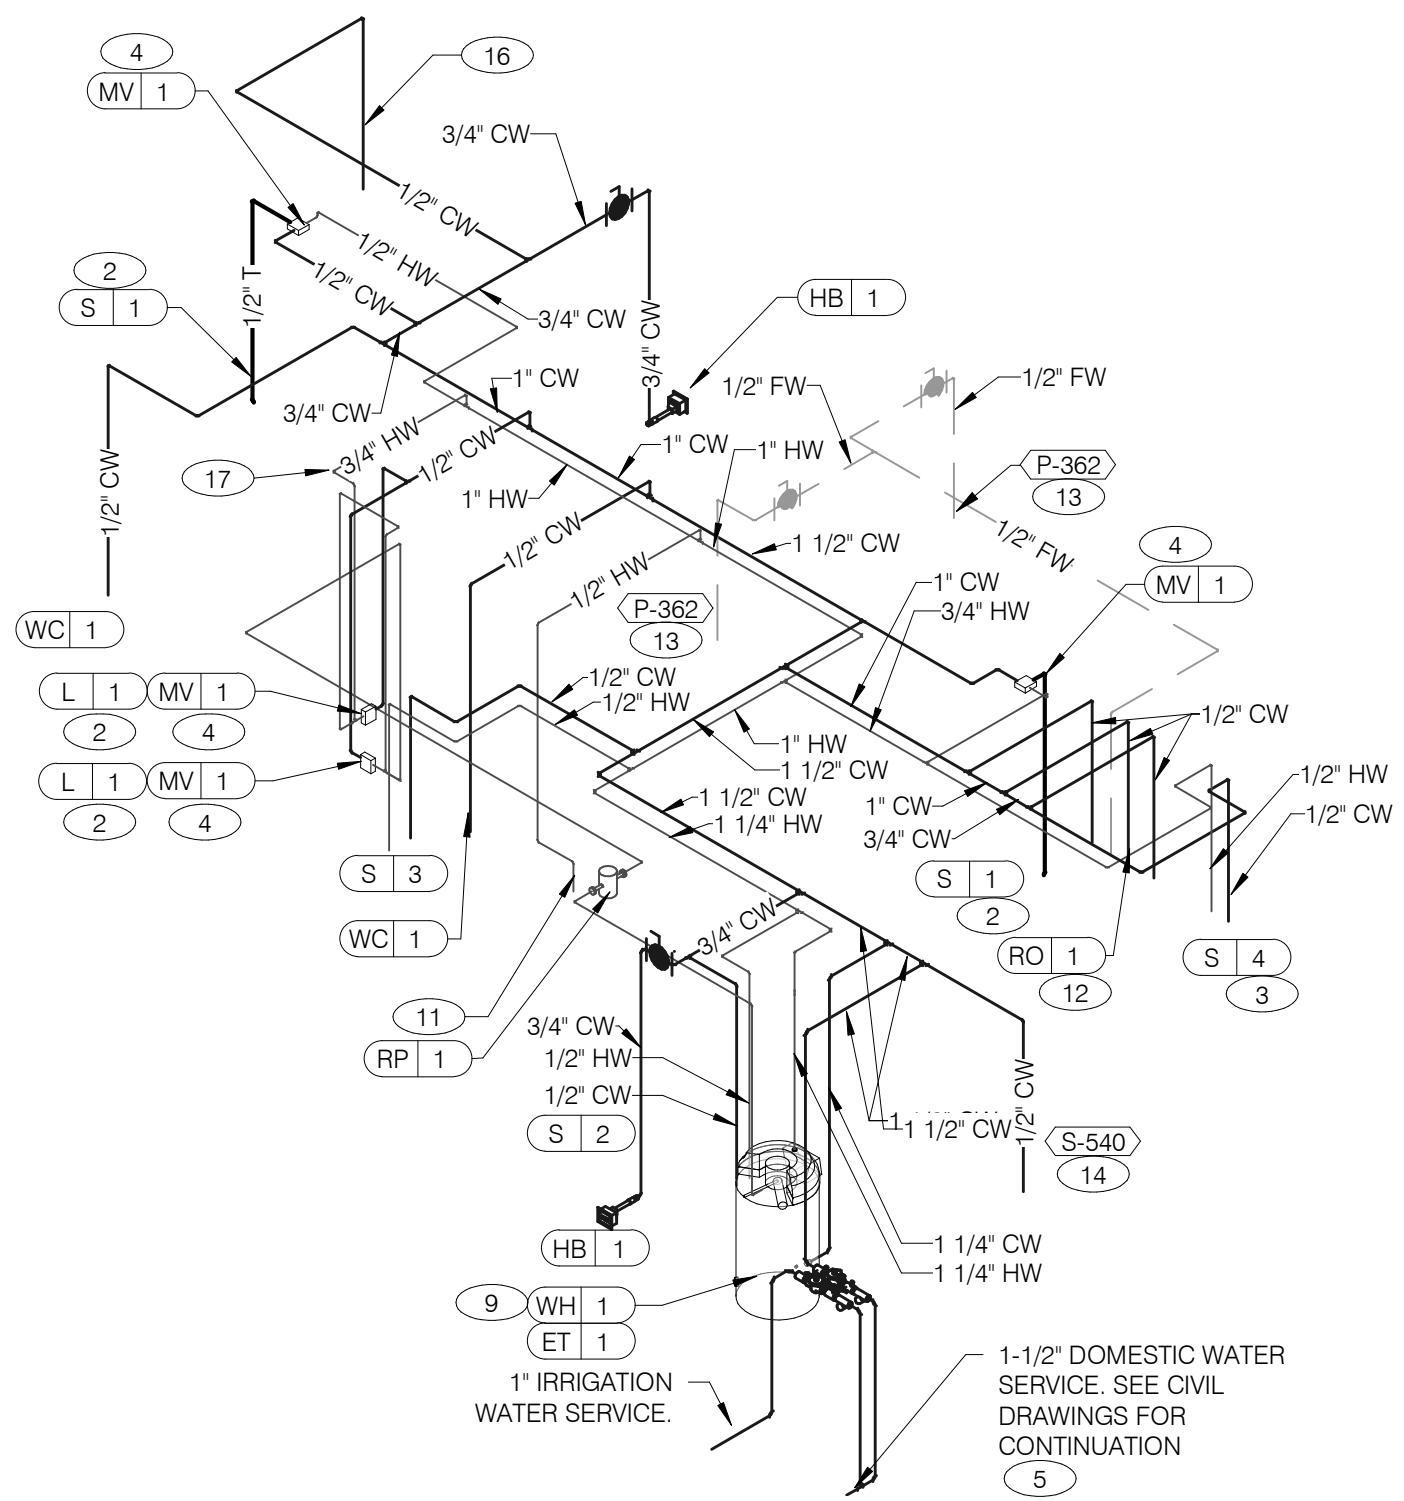

WATER ISOMETRIC NTS **4**

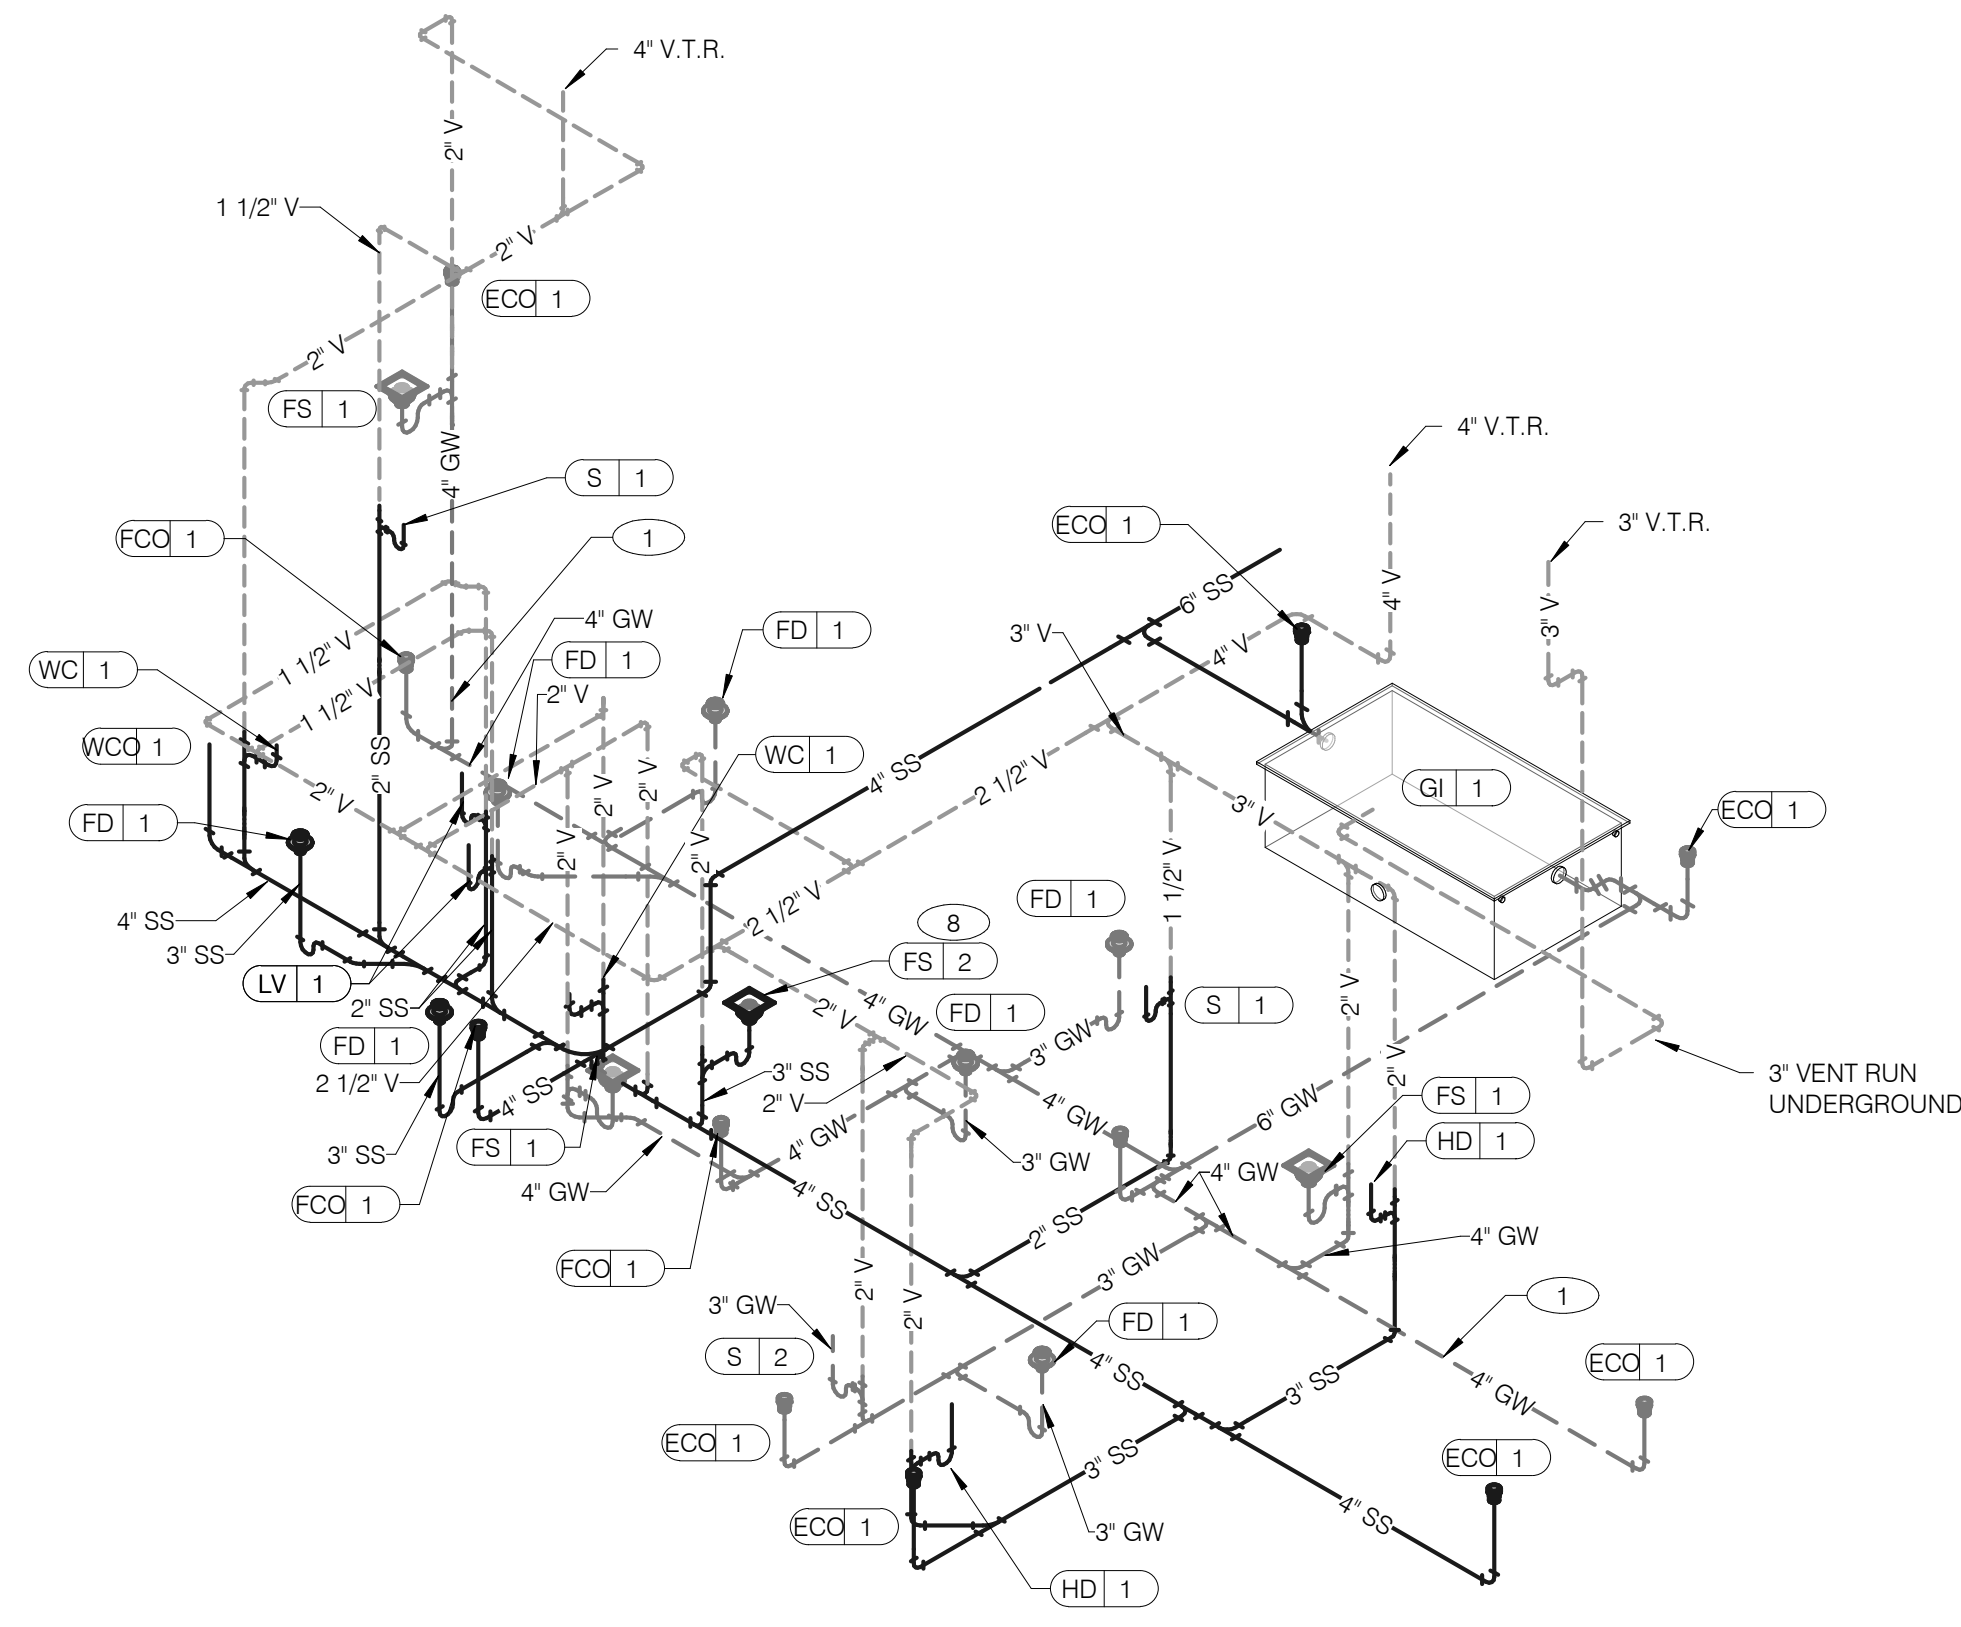


WASTE AND VENT ISOMETRIC NTS **1**


GAS DEMAND SCHEDULE	
RTU-1	180 CFH
RTU-2	180 CFH
WH-1	199.9 CFH
DUAL FRYER	160 CFH
REITHERMALIZER	110 CFH
TOTAL DEMAND	729.9 CFH = 829,900 BTUH

NOTE:
COORDINATE GAS DEMAND REQUIREMENTS WITH SITE-SPECIFIC RTU DESIGN.

PIPE SIZE BASED ON 120' OF PIPE AND 7" W.C. OPERATING PRESSURE

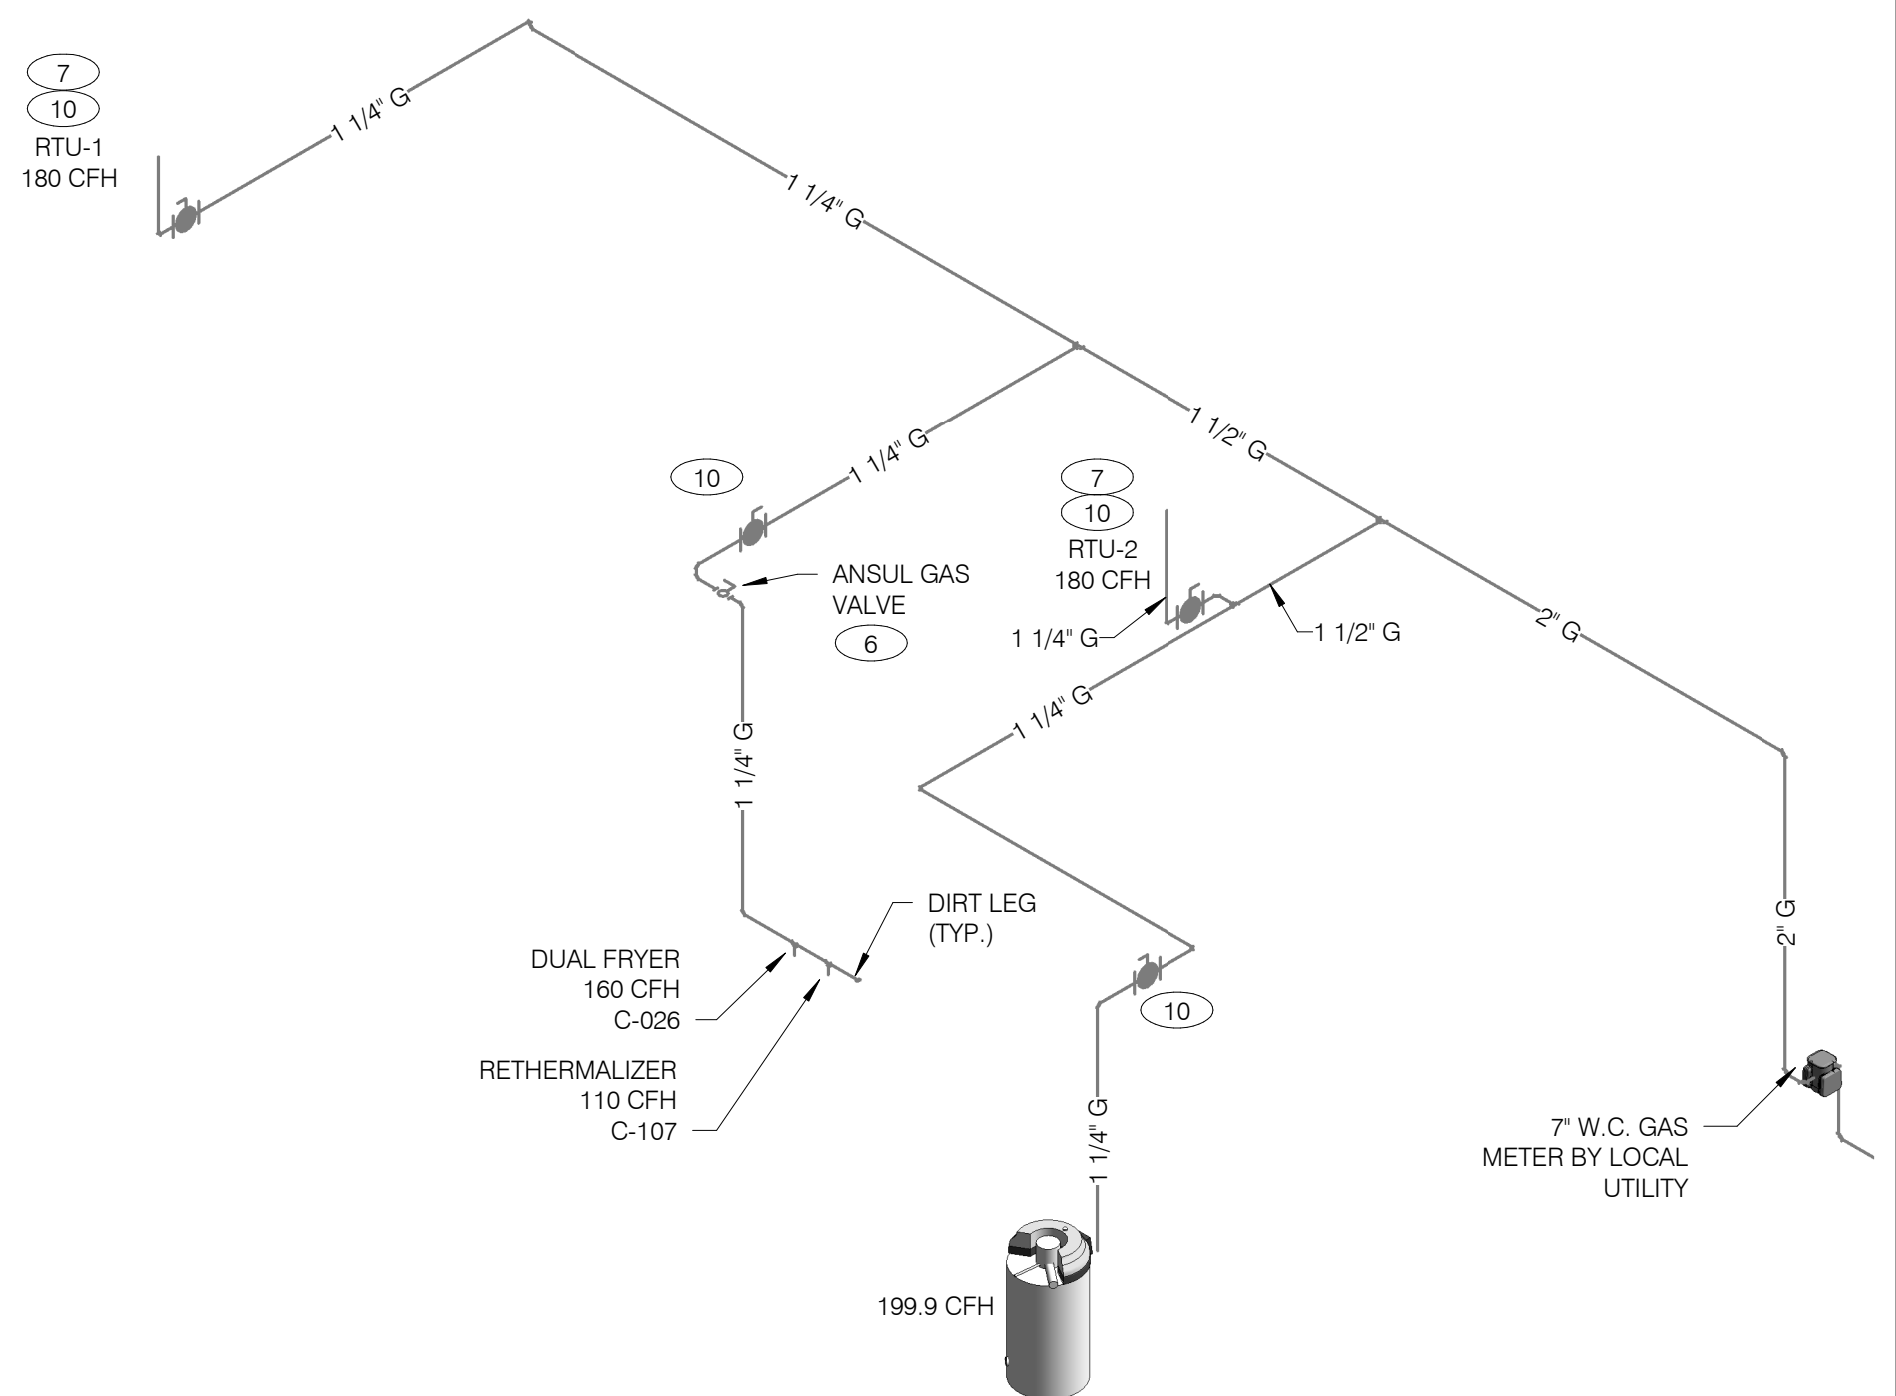

GAS ISOMETRIC NTS **5**

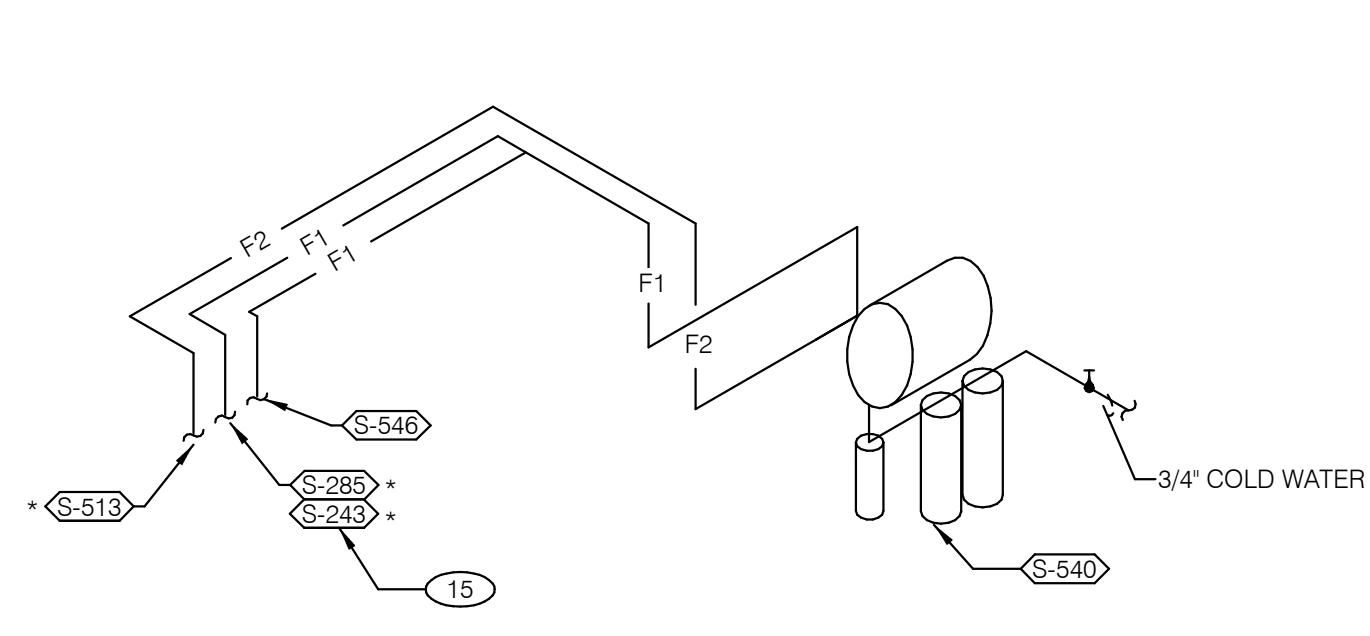

FILTERED EQUIPMENT AND LINES:
S-540 - WATER FILTER

FILTERED LINE (COLD WATER)
S-513 - ICE MAKER - ABOVE DRIVE-THRU BEVERAGE DISPENSER *
S-285 - DRIVE-THRU BEVERAGE DISPENSER *
S-546 - ICED TEA BREWER
S-543 - FROZEN BEVERAGE DISPENSER

* FILTERED WATER SUPPLIED VIA SYRUP BUNDLE. REFER TO 6/P6.0. SEE SCOPE OF WORK FOR RESPONSIBILITIES.

FILTERED WATER ISOMETRIC NTS **2**

- 1 ENTIRE RUN OF DRAIN LINES ON INLET TO GREASE TRAP SHALL BE SCHEDULE 40 PVC OR NO HUB CAST IRON AS REQUIRED BY CODE.
- 2 1/2" TEMPERED WATER DOWN IN WALL TO HAND SINK / LAVATORY.
- 3 1/2" HOT AND COLD WATER LINES DOWN IN WALL TO PREP SINK.
- 4 THERMOSTATIC MIXING VALVE.
- 5 METER AND REDUCED BACKFLOW PREVENTER PER LOCAL UTILITY REQUIREMENTS. METER LOCATED OUTSIDE. VERIFY LOCATIONS WITH CIVIL DRAWINGS.
- 6 EMERGENCY GAS SHUT-OFF VALVE (NORMALLY CLOSED) SHALL BE ELECTRIC SOLENOID TYPE WITH SPRING RETURN AND 24 VOLT ACTUATOR, SUITABLE FOR USE ON GAS PIPING SYSTEMS. VALVE SHALL BE ACTIVATED BY ANY OF THE EXHAUST HOOD FIRE SUPPRESSION SYSTEM. PROVIDE RELAYS AS REQUIRED TO ACTIVATE SHUT-OFF VALVE.
- 7 GAS PIPING AT ROOF TOP UNIT FOR THROUGH THE BASE PIPE CONNECTION. SHUT-OFF VALVE SHALL BE LOCATED OUTSIDE OF THE UNIT.
- 8 PROVIDE NO HUB CAST IRON PIPE FOR FIRST 10 FEET OF PIPE FROM CONNECTION TO FLOOR SINK FS-2
- 9 PIPE T&P RELIEF VALVE TO OUTSIDE OF BUILDING OR TO HUB DRAIN. RUN FULL SIZE PIPE FROM VALVE WITH TYPE "K" COPPER TUBING.
- 10 PROVIDE GAS SHUT-OFF VALVE IN CEILING SPACE.
- 11 1/2" HOT WATER PIPE DOWN IN WALL. PROVIDE SHUT-OFF VALVE OUTSIDE OF WALL FOR CONNECTION TO REITHERMALIZER.
- 12 1/2" COLD WATER CONNECT TO REVERSE OSMOSIS FILTER AND 1/2" FILTERED WATER FROM REVERSE OSMOSIS FILTER. PROVIDE SHUT-OFF ON CW PIPE PRIOR TO CONNECTION TO FILTER.
- 13 1/2" RO WATER FROM REVERSE OSMOSIS FILTER DOWN IN UTILITY CHASE OF M.A.P.S. LINE. PROVIDE SHUT-OFF VALVE ON FW PIPE IN CEILING NEAR UTILITY CHASE.
- 14 1/2" COLD WATER TO HOT WATER SYSTEM FILTER.
- 15 TEE OFF 3/8" LINE FROM DRIVE THRU BEVERAGE DISPENSER FILTERED WATER SUPPLY. SEE DETAIL 8/P6.0.
- 16 1/2" COLD WATER. CONNECT TO WATER FILTER FOR BUNN POD BREWER S-547. PROVIDE SHUT-OFF VALVE PRIOR TO CONNECTION TO THE WATER FILTER.
- 17 ROUTE HOT WATER MAIN DOWN IN WALL.

KEYNOTES - ISOMETRICS NTS **3**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: TH
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236




**ENDEAVOR 2.0
RISER
DIAGRAMS**

P5.0


PLOT DATE: 11/3/2022 9:59:55 AM

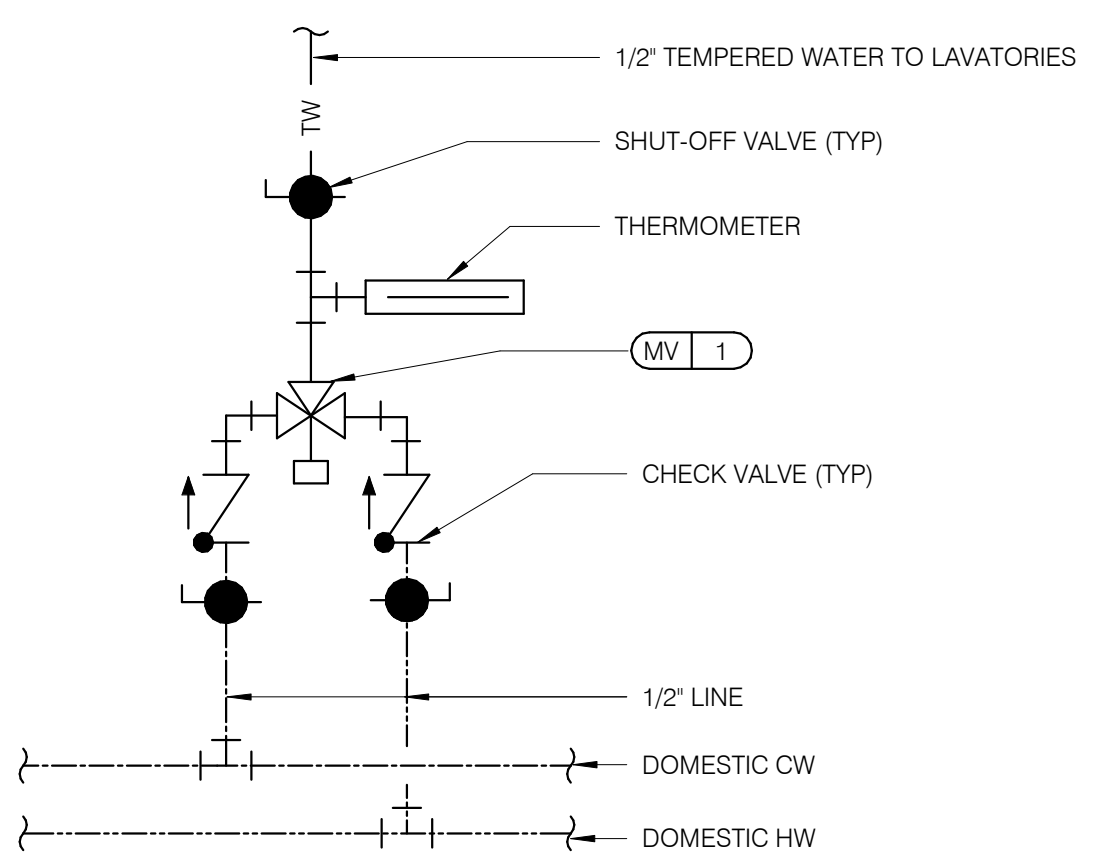


TEMPERING VALVE NTS **11**

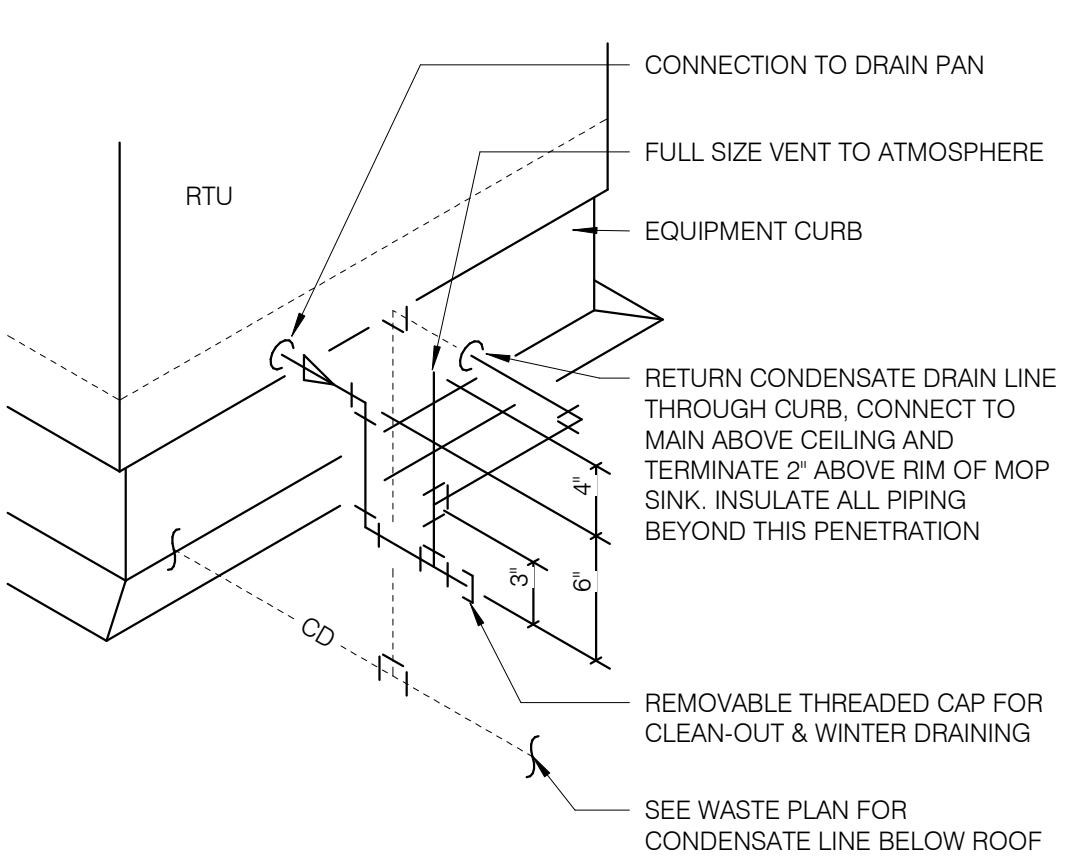

RTU CONDENSATE NTS **10**

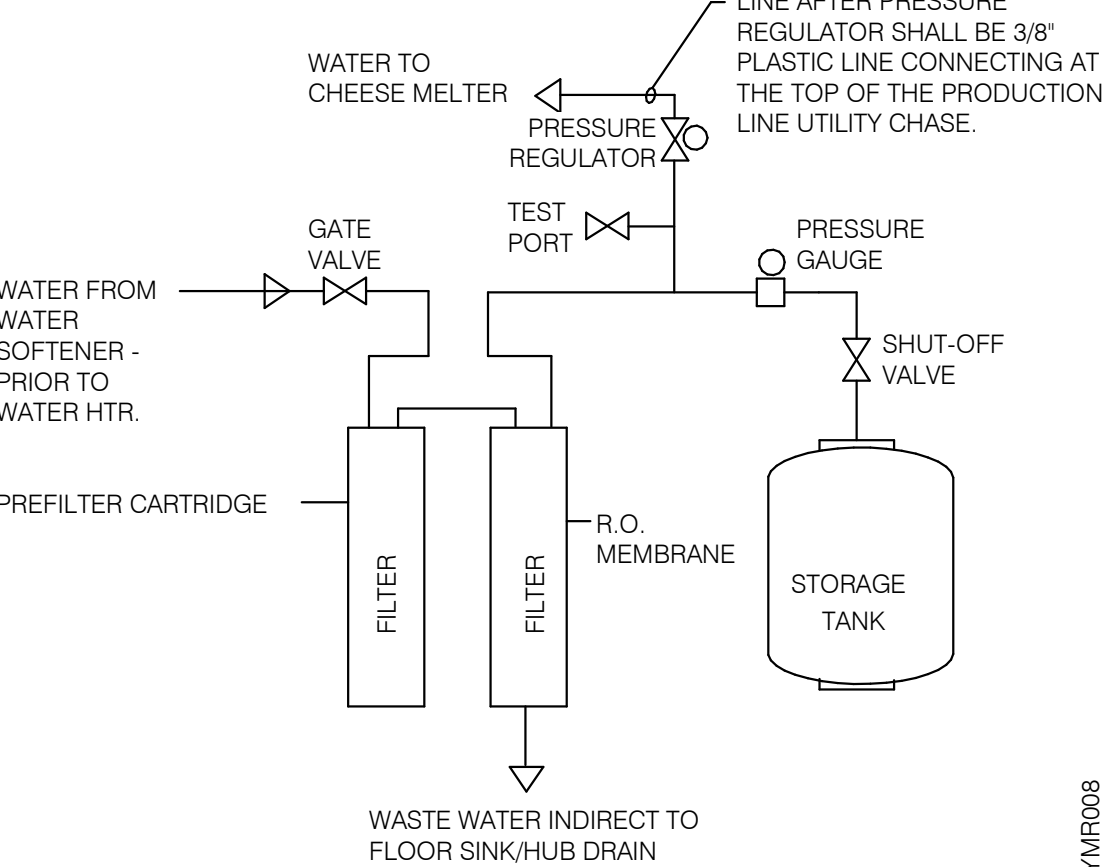


REVERSE OSMOSIS SYSTEM NTS **9**

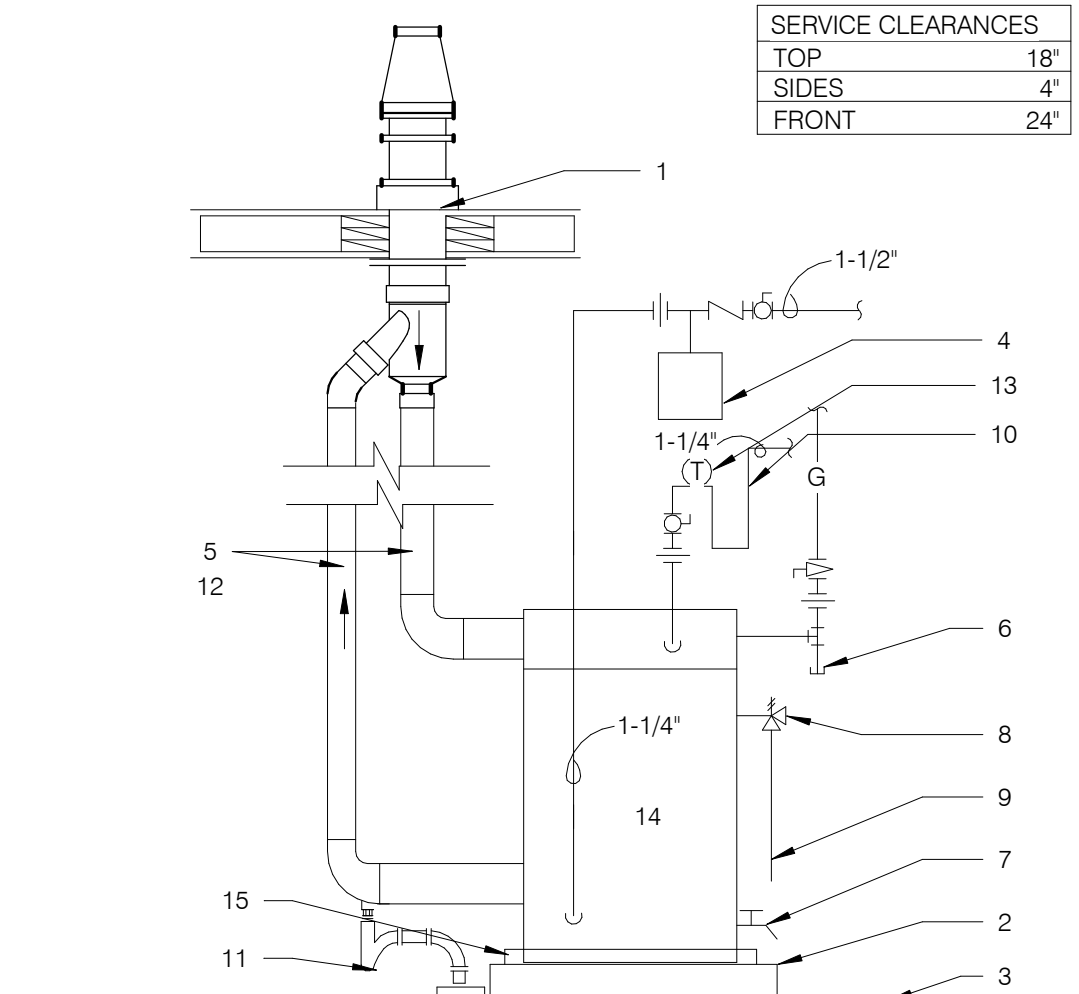


- 1 FLUE THRU ROOF
- 2 4" CONCRETE PAD
- 3 FINISHED FLOOR
- 4 THERMAL EXPANSION TANK BY WATTS - SEE PLUMBING SCHEDULE - STRAP AND SUPPORT TO WALL
- 5 SCHEDULE 40 PVC, MINIMIZE TURNS AND TRANSITIONS.
- 6 GAS COCK VALVE WITH FULL SIZE DIRT LEG
- 7 3/4" DRAIN WITH VALVE & CAP
- 8 COMBINATION TEMPERATURE AND PRESSURE RELIEF PER LOCAL CODE
- 9 RUN T&P DISCHARGE FULL SIZE TO HUB DRAIN
- 10 22" DEEP HEAT TRAP
- 11 P-TRAP AND LINE TO DRAIN PROVIDED BY MANUFACTURER. LEAVE AIR GAP BETWEEN BOTTOM OF TRAP AND DRAIN. SEE DETAIL 4/P2.0
- 12 SUPPORT VENT PIPE RUNS EVERY 5'-0" VERTICALLY AND EVERY 3'-0" HORIZONTALLY.
- 13 OUTLET THERMOMETER PROVIDED BY MFR. LOCATE WITHIN 12" OF W.H. OUTLET.
- 14 SEE DETAIL 2/P6.1 FOR SCHEDULE OF ITEMS PROVIDED BY W.H. MFR.
- 15 DRAIN PAN TO HUB DRAIN.

WATER HEATER NTS **2**

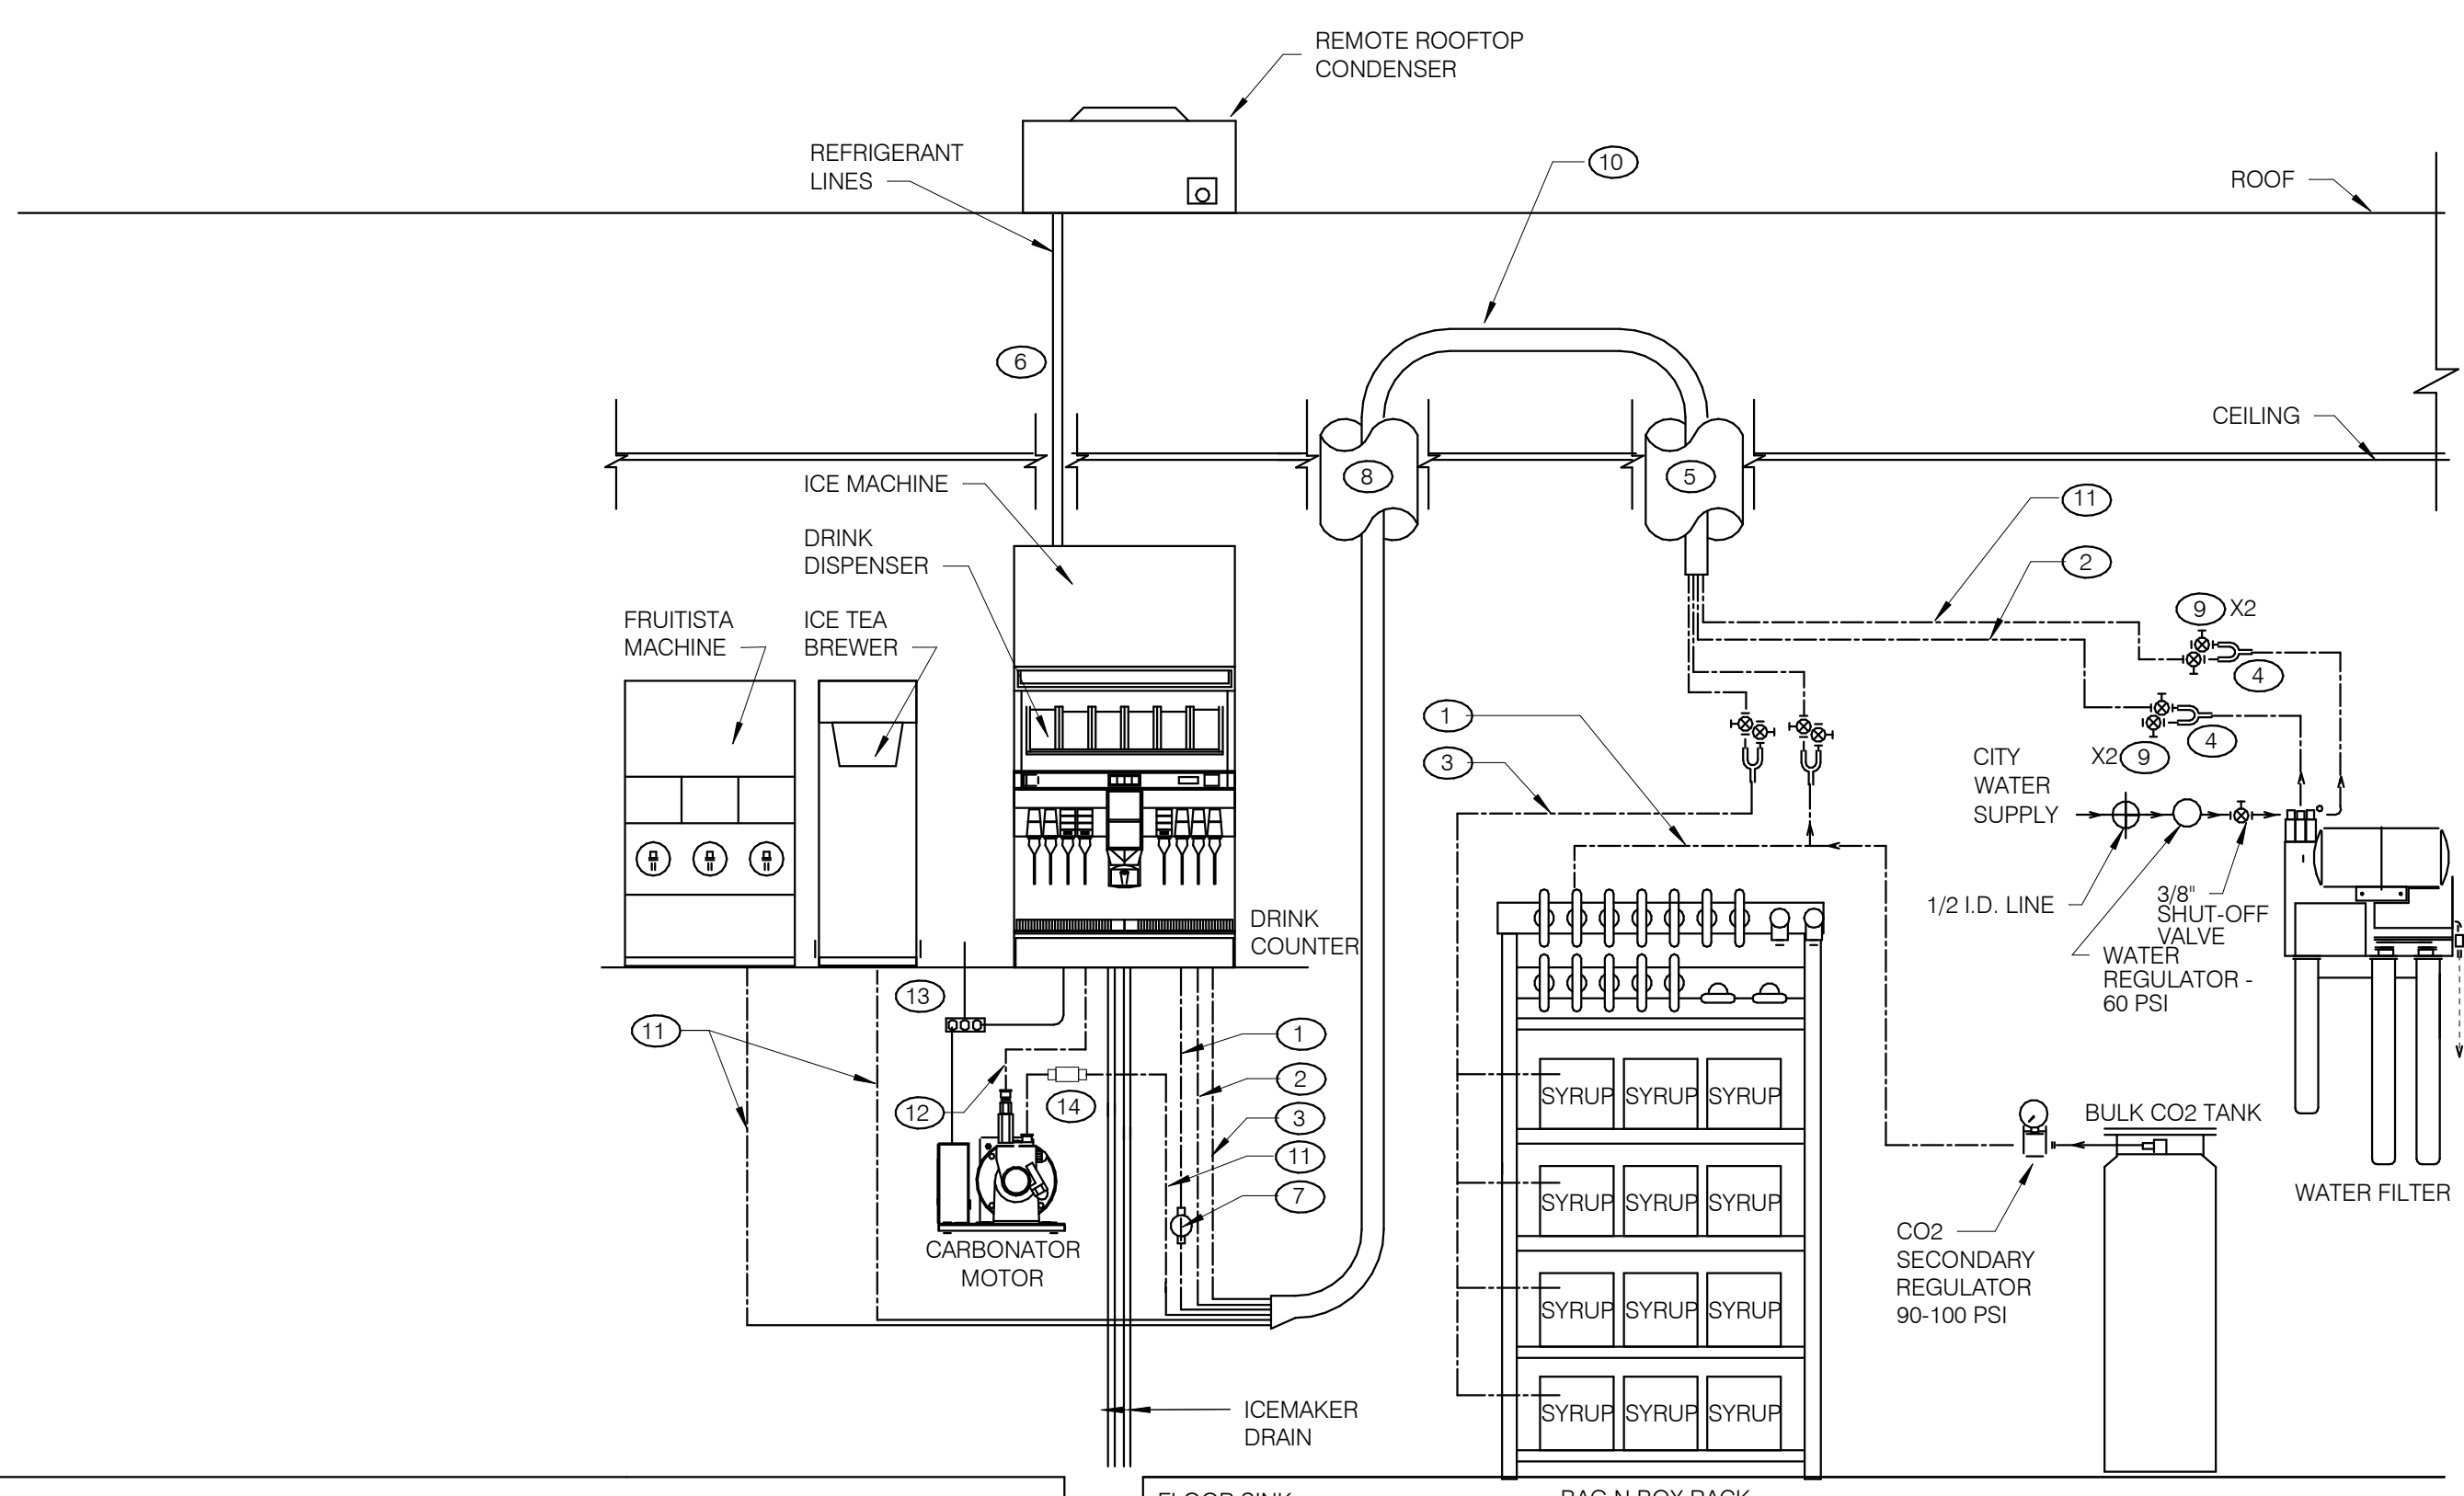


- GENERAL NOTES:**
1. OVERALL FILTER DIMENSIONS: 21" WIDE x 12" DEEP x 48 1/2" HIGH
 2. SEE DETAIL SCOPE OF WORK FOR SCOPE DEFINITIONS.
 3. ROUGH-INS SHALL BE PROVIDED BY CONTRACTOR.
 4. INSTALLATION SHALL COMPLY WITH STATE AND LOCAL PLUMBING CODES.
 5. FILTER SHALL BE PROTECTED AGAINST FREEZING.
 6. USE ONLY TEFLON (HIGH-LOW TEMPERATURE) TAPE TO SEAL THREADED PARTS; NO PIPE DOPE.
 7. DO NOT INSTALL WHERE LINE PRESSURE EXCEEDS 125 PSI OR WHERE TEMPERATURE EXCEEDS 100 F.
 8. SEE EQUIPMENT PLAN FOR LOCATION.
 9. SEE DETAIL 3 THIS SHEET FOR BUNDLE DETAILS
 10. "Y" FOR ICE MACHINES SUPPLY LINES SHALL BE INSTALLED @ FILTER OUTLET.
 11. BACKFLOW PREVENTERS FOR FILTER ASSEMBLY ARE PROVIDED.
 12. PROVIDE WATTS SD-3 BACKFLOW PREVENTER WITH STRAINER UPSTREAM OF THE SODA CARBONATOR. SEE NOTE 14 BELOW.
- THERE ARE TWO SELF-SERVE DRINK/ICE SYSTEMS WHICH SHARE A COMMON FLOOR SINK WITH THE D/T DRINK/ICE SYSTEM.
- INSTALL ELECTRICAL, WATER, AND DRAIN IN ACCORDANCE WITH ALL LOCAL, STATE & FEDERAL CODES.
- EQUIPMENT RATING:**
 ED250 DISPENSER - 115V, 3.5 AMPS
 ED300 DISPENSER - 115V, 4.0 AMPS
 CARBONATOR - 115V, 60 Hz, 7.0 AMPS
 BOOSTER ASSEMBLY - 115V, 60 Hz, 6.5 AMPS

DRINK SYSTEM SCHEMATIC NTS **8**

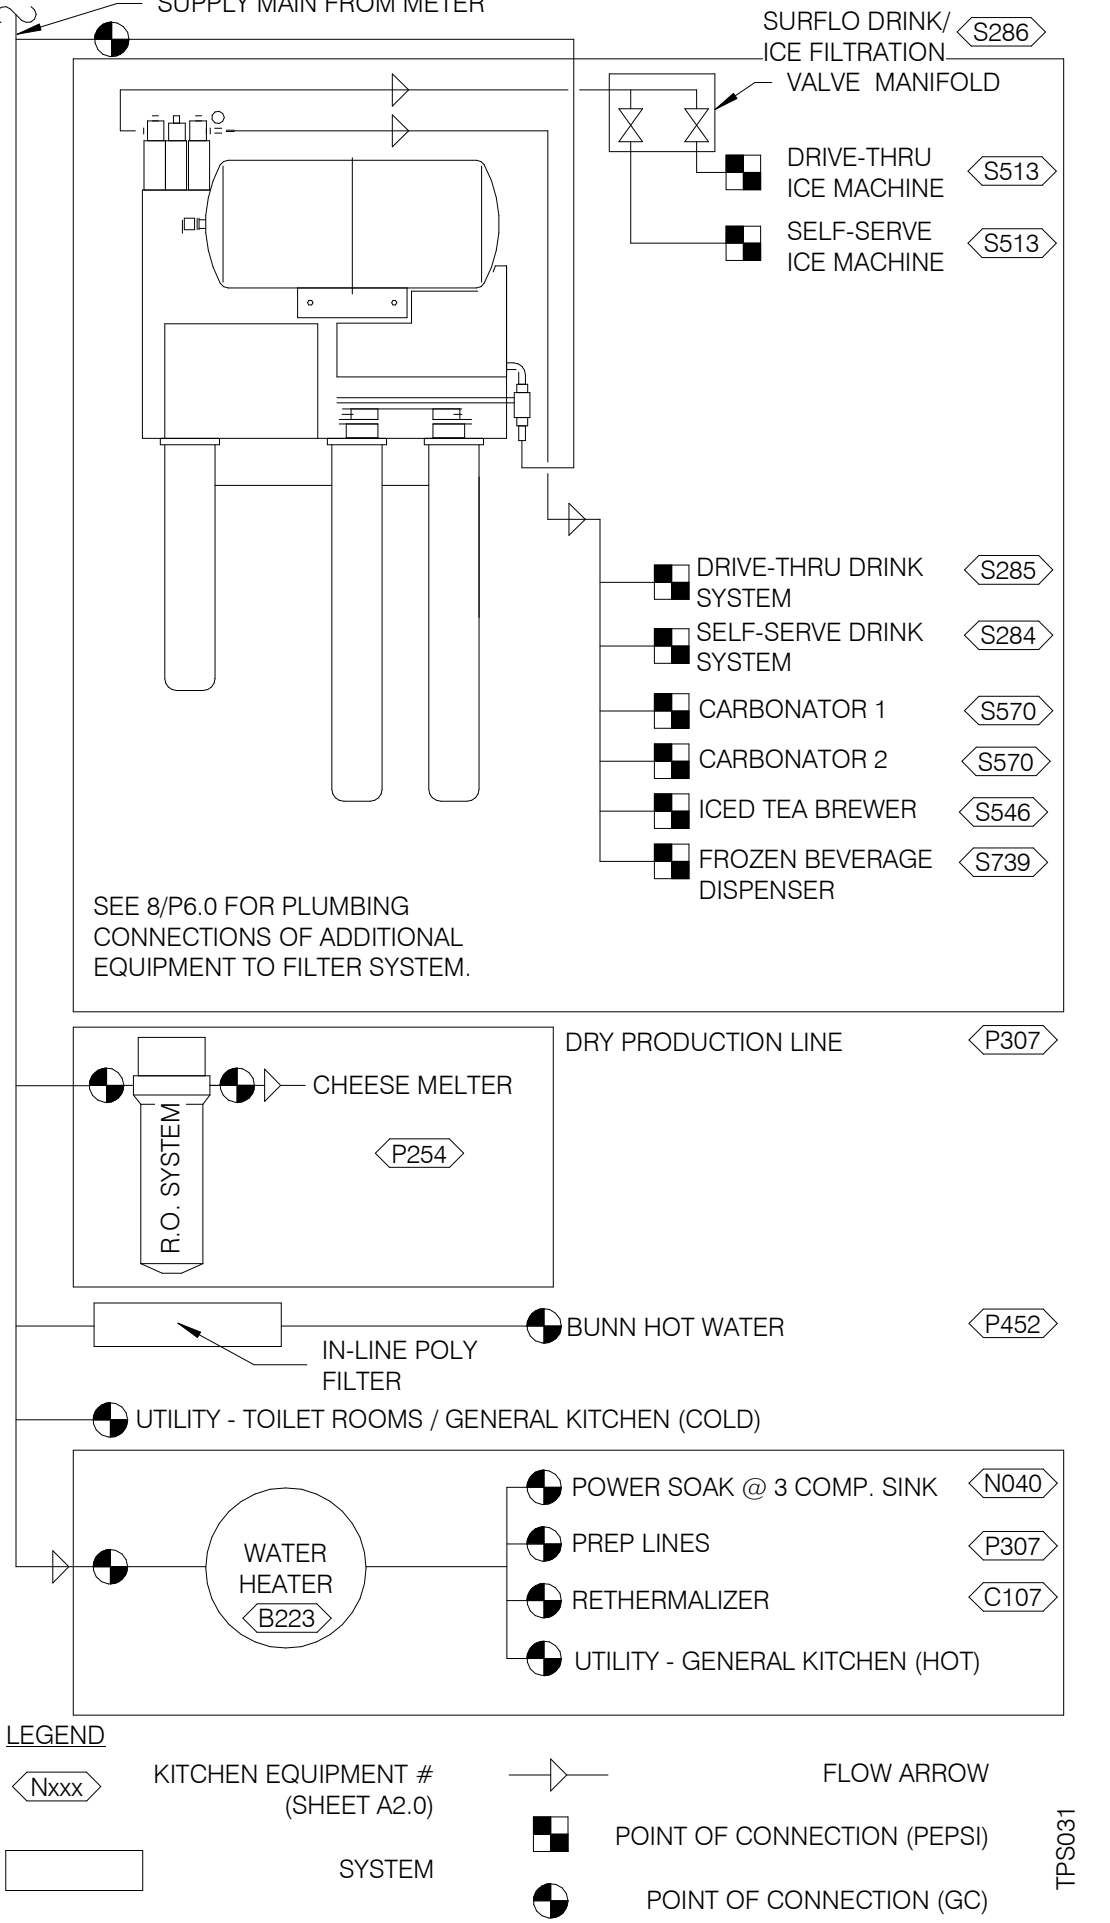


WATER FILTRATION SCHEMATIC NTS **3**

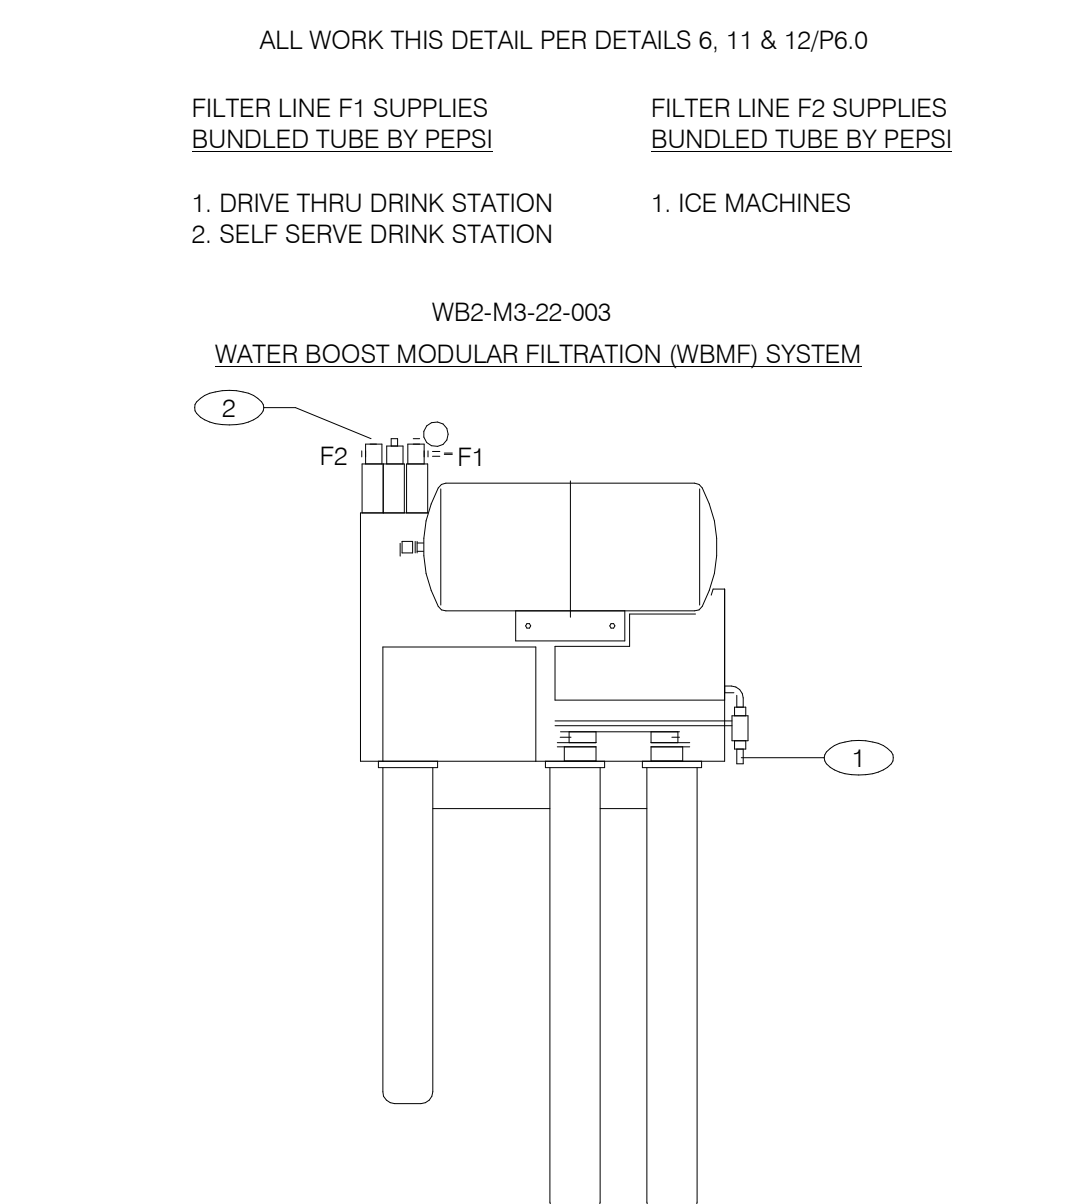


- ALL WORK THIS DETAIL PER DETAILS 6, 11 & 12/P6.0
- FILTER LINE F1 SUPPLIES BUNDLED TUBE BY PEPSI
 FILTER LINE F2 SUPPLIES BUNDLED TUBE BY PEPSI
1. DRIVE THRU DRINK STATION
 1. ICE MACHINES
- WB2-M3-22-003
 WATER BOOST MODULAR FILTRATION (WBMF) SYSTEM
- KEY NOTES:**
- 1 3/4" COLD WATER INLET TO 1/2" COPPER LINE AND FITTINGS AT FILTER.
 - 2 3/4" OUTLET W/ INTEGRAL BACKFLOW PREVENTER, EQUAL TO WATTS REGULATOR CO. SERIES 007 AND SERVICE BALL VALVE.
- GENERAL NOTES:**
1. OVERALL DIMENSIONS 21" WIDE x 12" DEEP x 48 1/2" HIGH
 2. SEE SCOPE OF WORK FOR ADDITIONAL INFORMATION.
 3. INSTALLATION SHALL COMPLY WITH STATE AND LOCAL PLUMBING CODES.
 4. THE UNIT SHALL BE PROTECTED AGAINST FREEZING.
 5. USE ONLY TEFLON (HIGH-LOW TEMPERATURE) TAPE TO SEAL THREADED PARTS; NO PIPE DOPE.
 6. DO NOT INSTALL WHERE LINE PRESSURE EXCEEDS 125 PSI OR WHERE TEMPERATURE EXCEEDS 100 F.
 7. SEE SHT. A2.0 FOR LOCATION.

WATER FILTER SYSTEM NTS **1**


- KEY NOTES:**
- 1 3/8" CO₂ LINE
 - 2 3/8" FILTERED WATER LINE - ICE MACHINES
 - 3 3/8" SYRUP LINES
 - 4 1/2 X 3/8 X 3/8 "Y"
 - 5 BUNDLED TUBING CEILING PENETRATION.
 - 6 STAINLESS CHASE SURFACE MOUNTED FROM CEILING TO TOP OF ICE MACHINE
 - 7 PRE-SET CO₂ REGULATOR
 - 8 RECESSED 4" DIA. PVC VERTICAL CHASE FOR DRINK SYSTEM BUNDLED TUBING SYSTEM.
 - 9 3/8" SHUT OFF VALVES BARB FITTINGS
 - 10 DRINK SYSTEM BUNDLED TUBING. SEE DETAIL 6/P6.0
 - 11 3/8" FILTERED WATERLINE - ICE TEA, FRUITISTA & DRINK MACHINES
 - 12 3/8" LINE FOR PRESSURIZED FILTERED WATER
 - 13 ELECTRICAL FOR DRINK SYSTEM. SEE SHEET E3.0
 - 14 CARBONATED BEVERAGE BACKFLOW PREVENTER

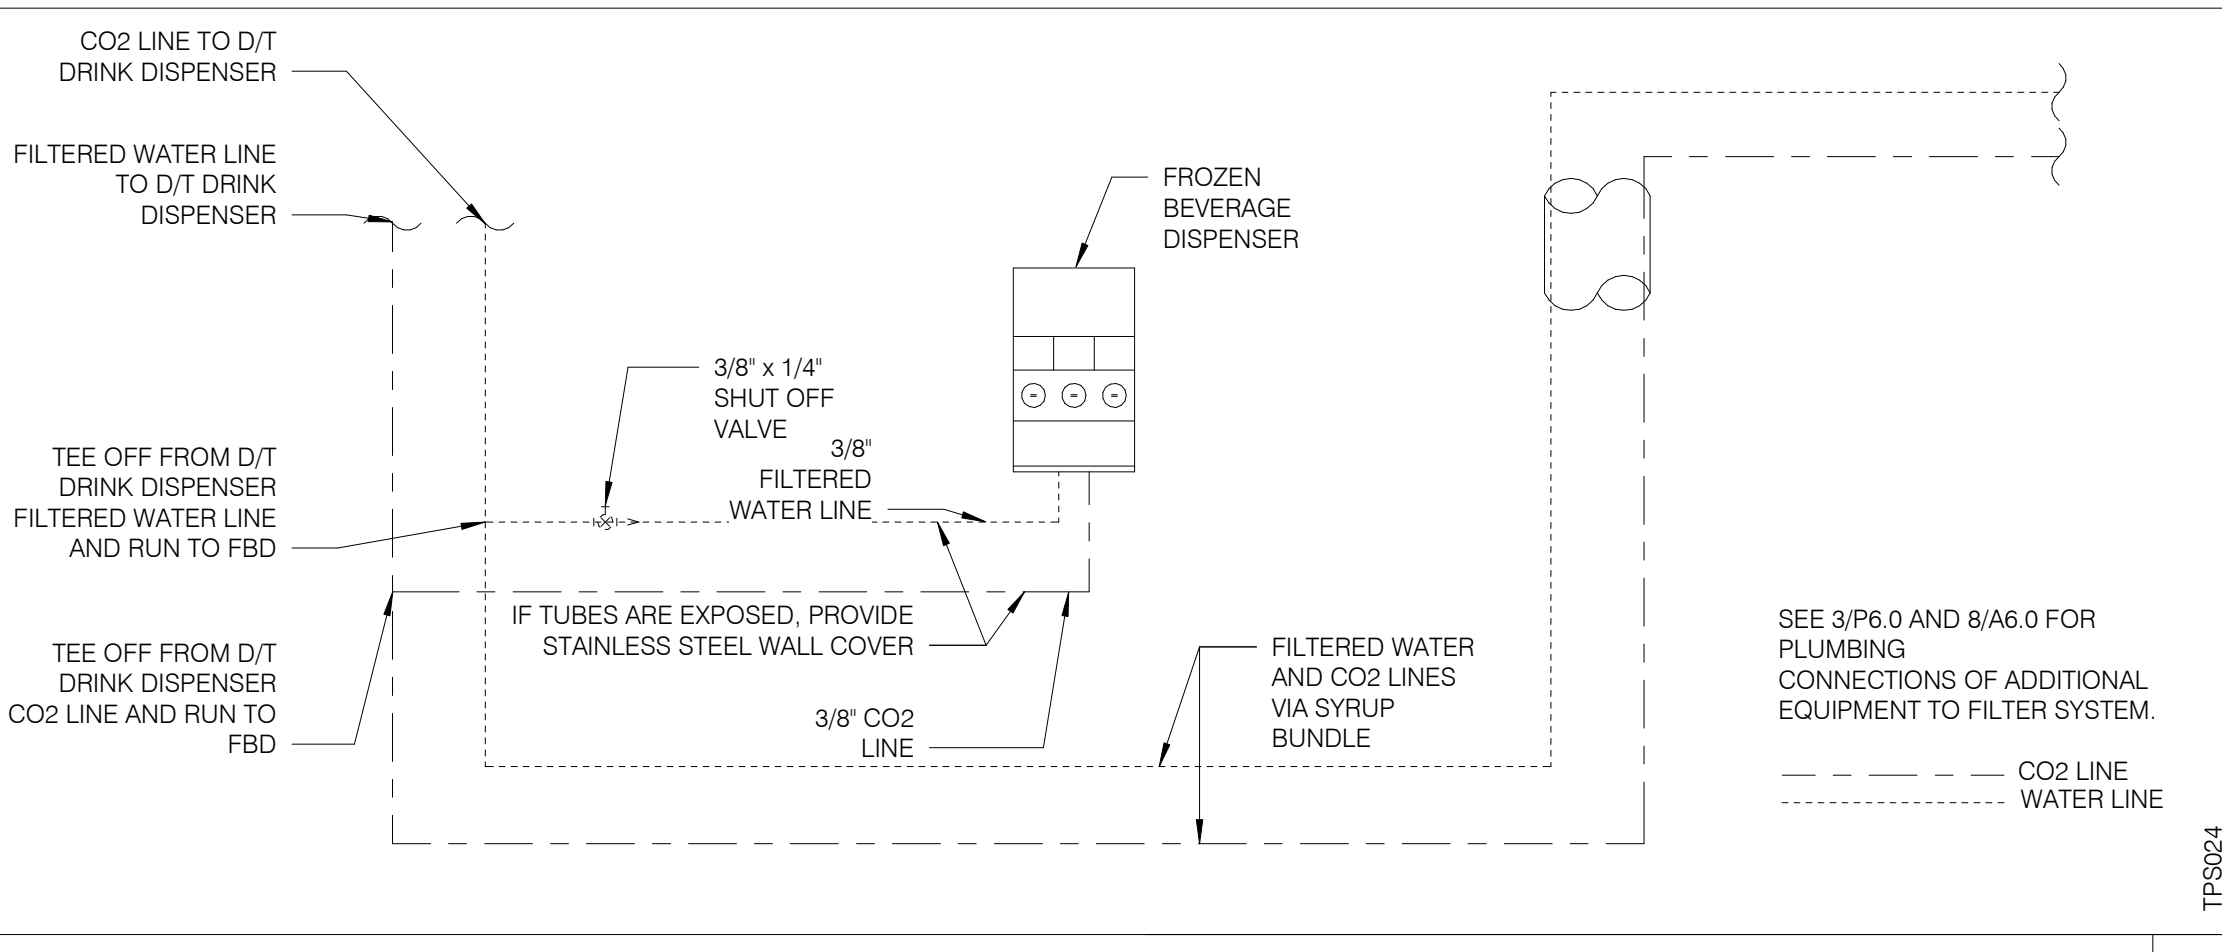

FBD DRINK SYSTEM DETAIL NTS **7**

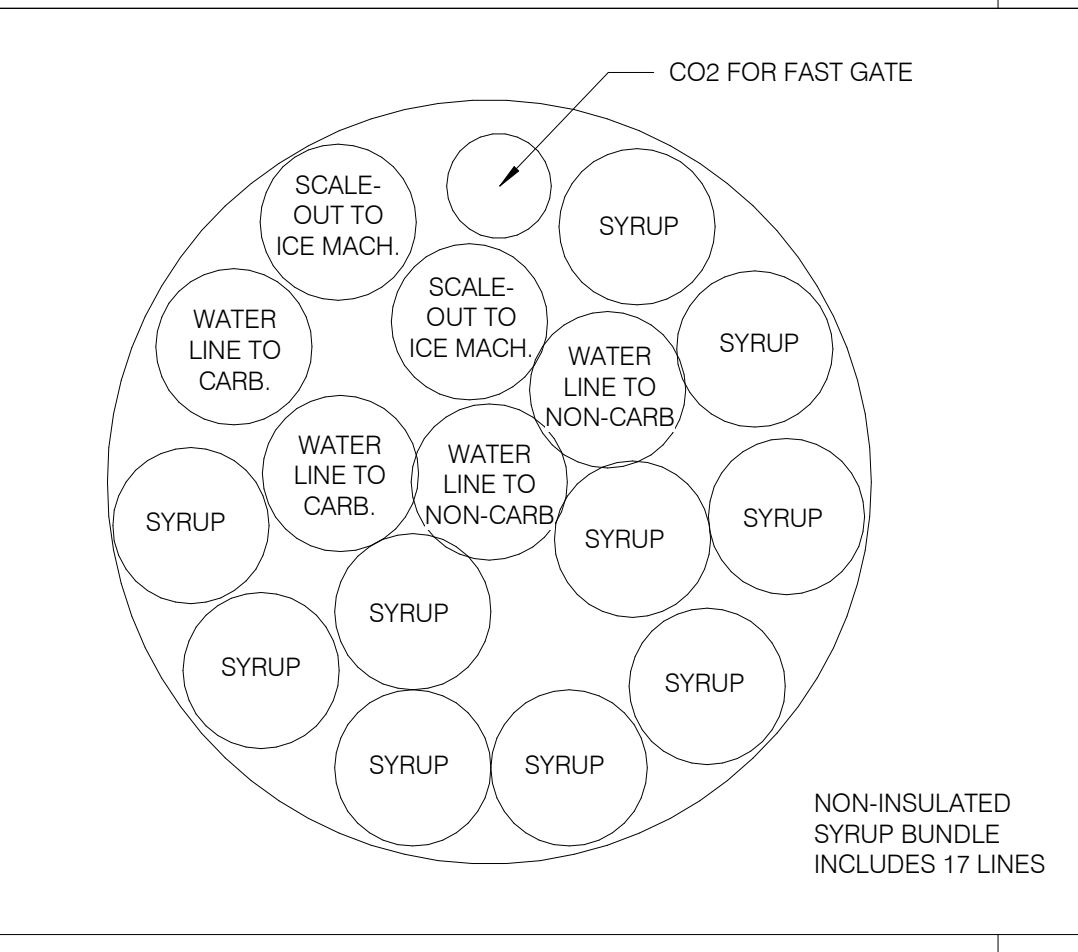

SYRUP BUNDLE CONFIGURATION NTS **6**

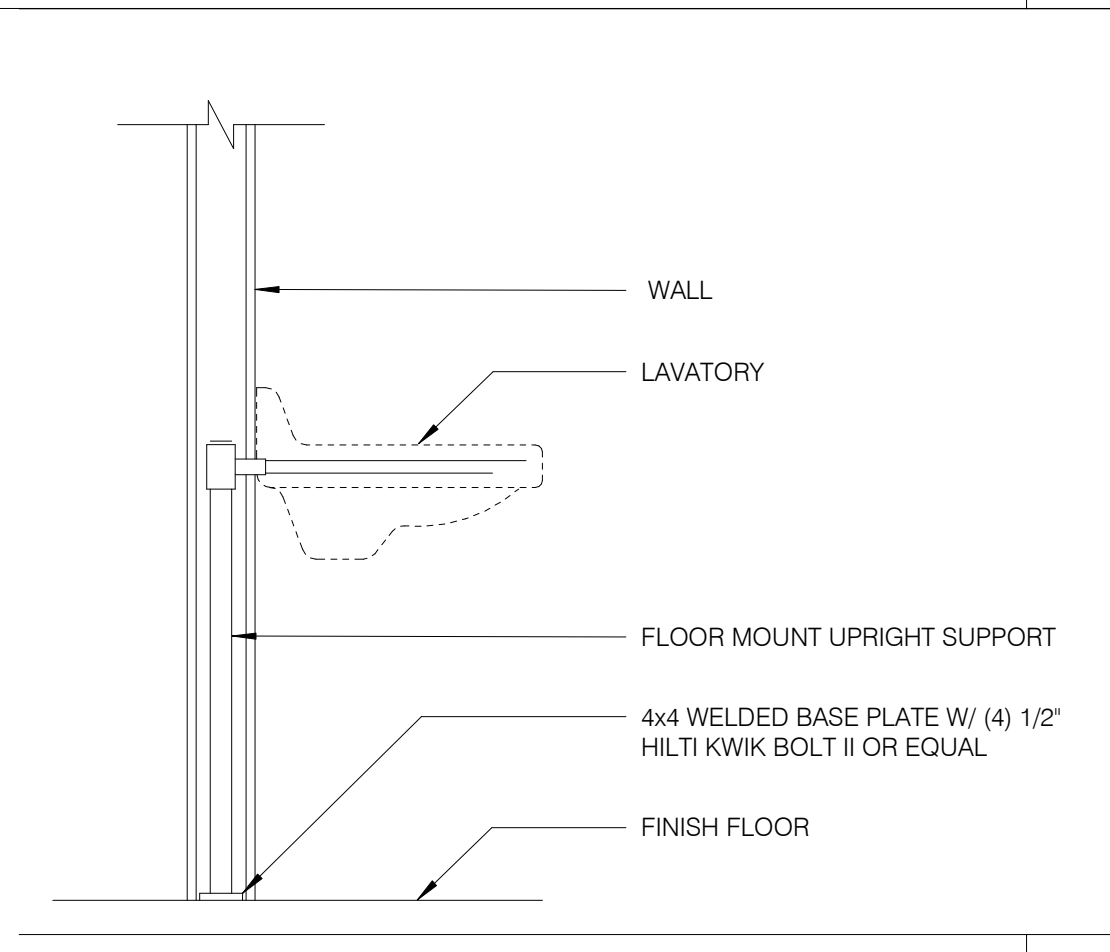

LAVATORY SUPPORT NTS **5**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY: TH
 JOB NO.: 2020088.03


TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236



ENDEAVOR 2.0 PLUMBING DETAILS

P6.0

PLOT DATE: 11/3/2022 9:59:56 AM

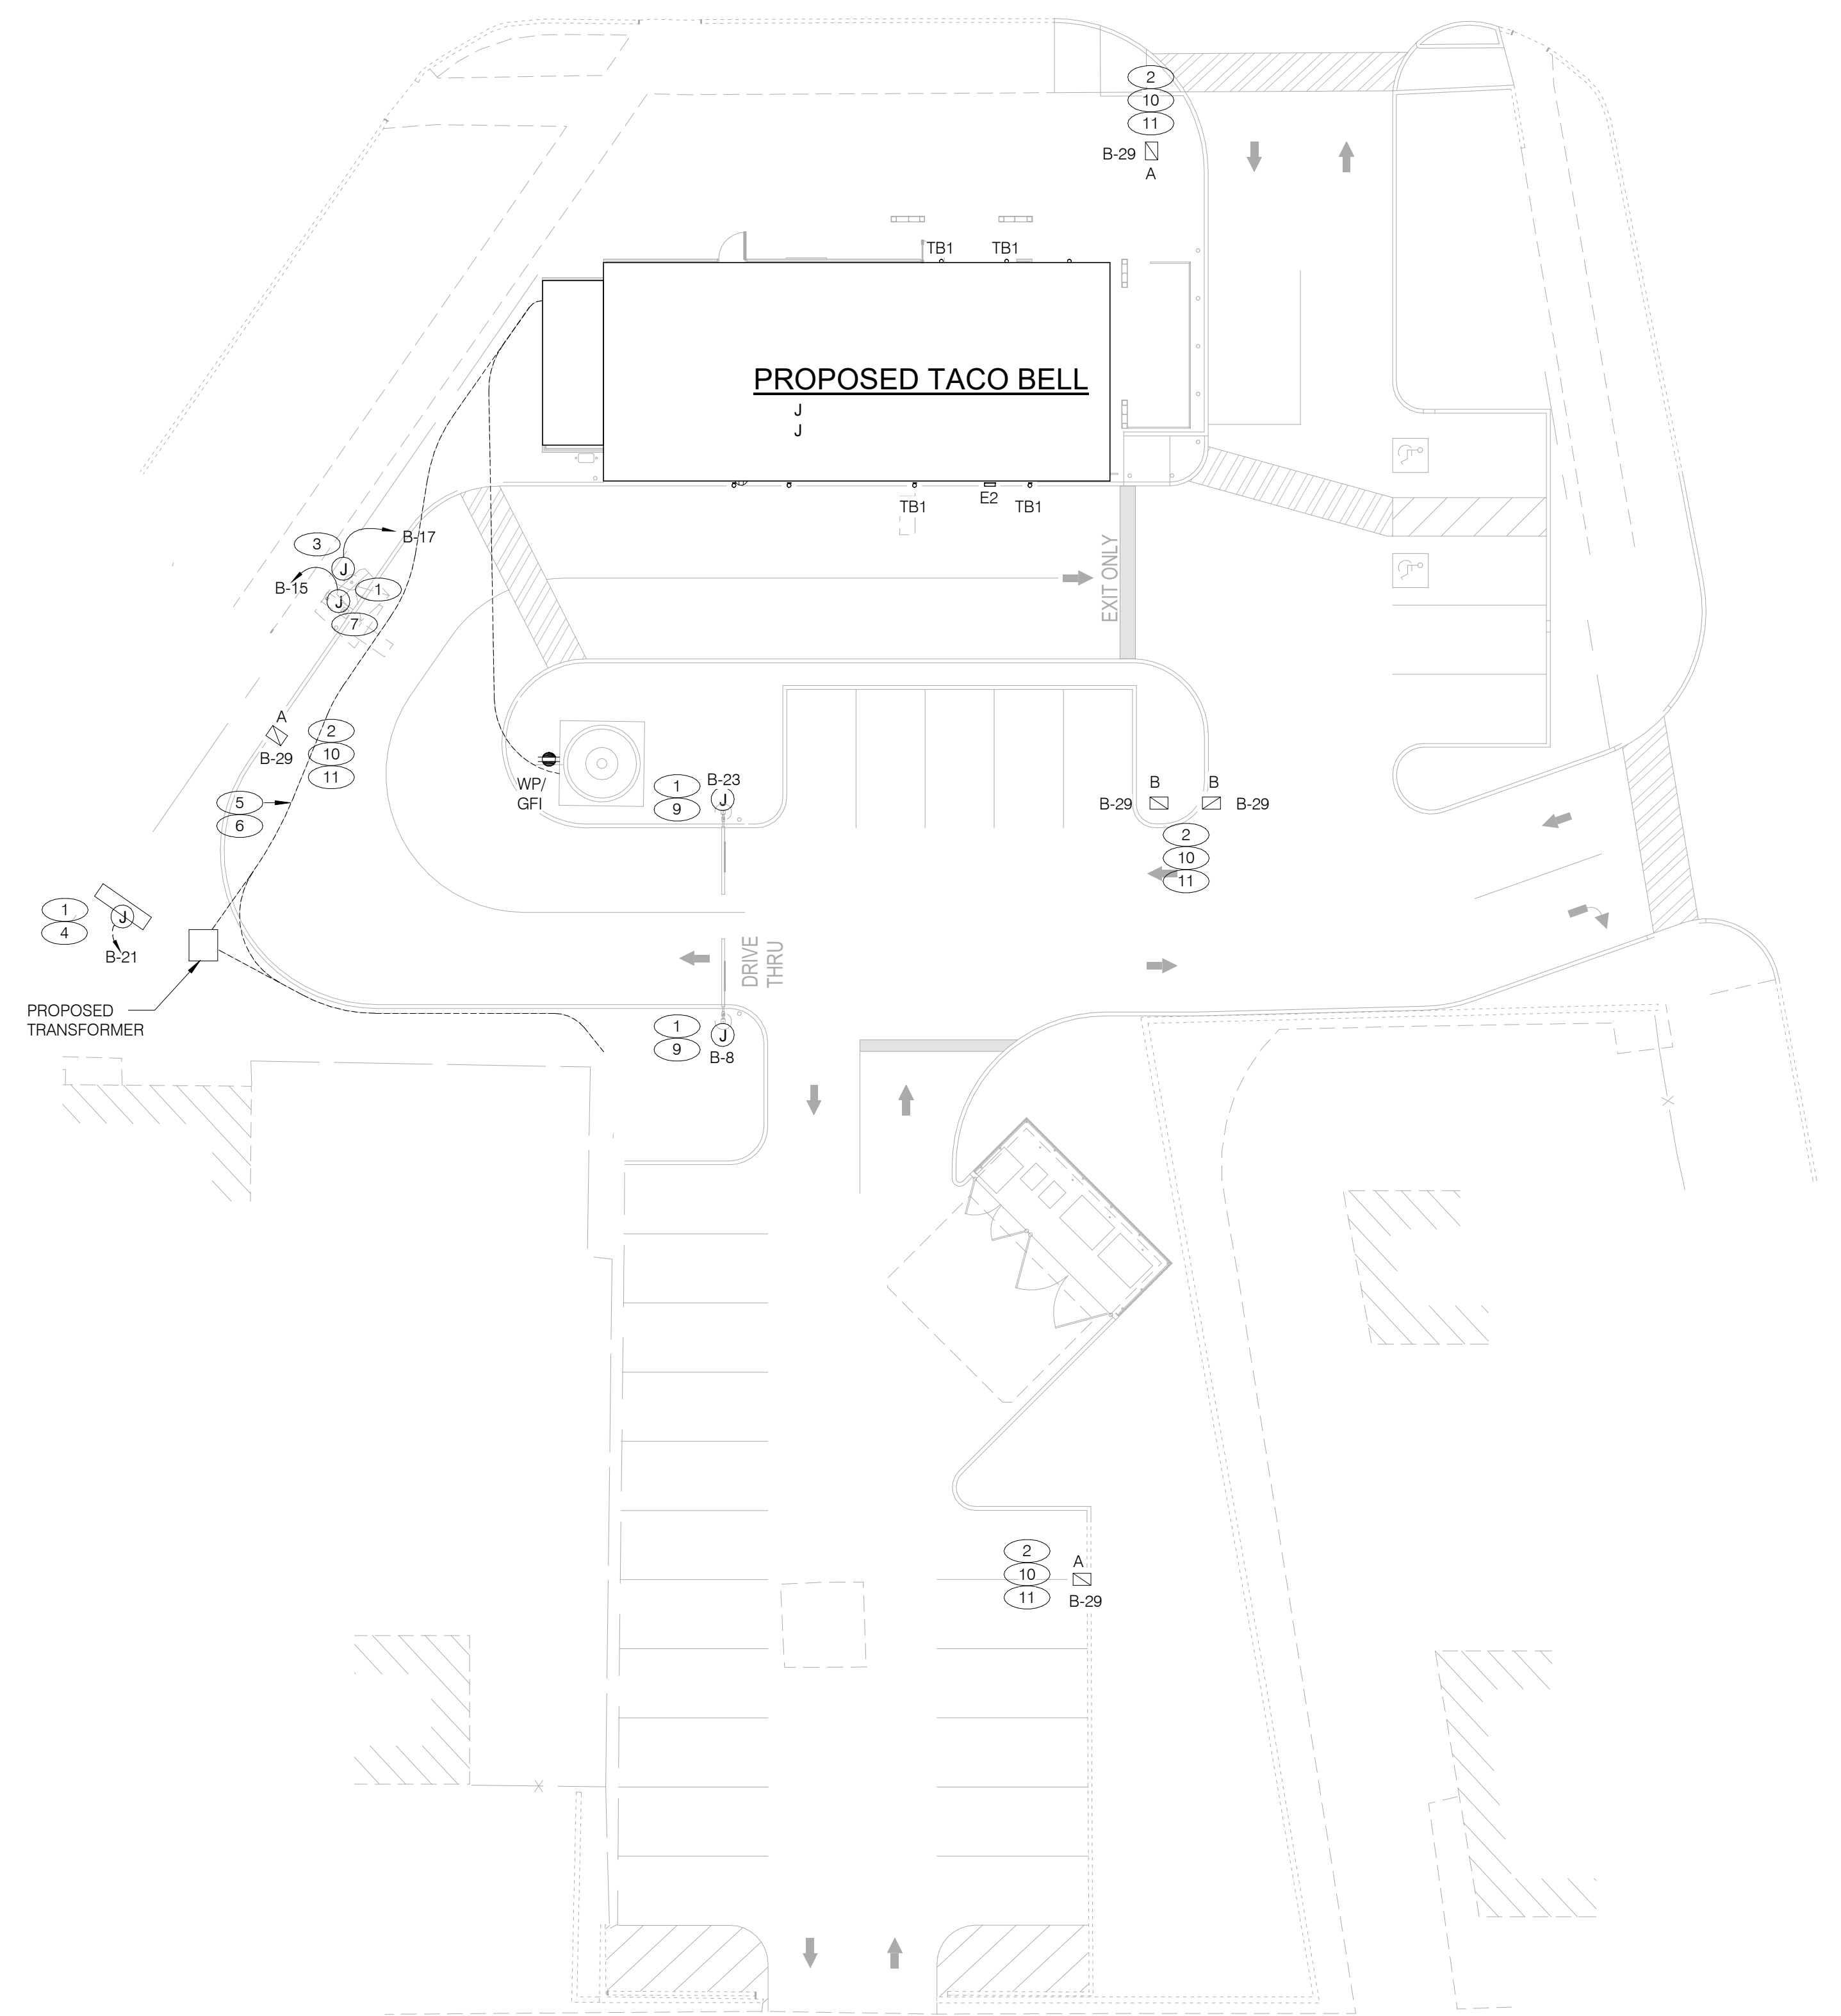

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: AJR
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236



ENDEAVOR 2.0
SITE ELECTRICAL PLAN


E1.0

PLOT DATE: 11/3/2022 9:59:31 AM

CONDUIT SCHEDULE		
DEVICE	POWER	DATA
DIRECTIONAL	(1) 1"	-
SPEAKER POST	(1) 1"	(1) 1"
MENUBOARD	(1) 1"	(2) 1"

- 1 1" C. - (2) #8, #8 GRD. (TYP. FOR ENTIRE CIRCUIT.)
- 2 REFER TO LIGHTING FIXTURE SCHEDULE ON E4.0 FOR ADDITIONAL INFORMATION ON LIGHTING FIXTURES. (TYPICAL)
- 3 DIGITAL MENU BOARD. REFER TO CONDUIT SCHEDULE FOR CONDUIT SIZE AND QUANTITY. PROVIDE (2) #8AWG., #8 GND. IN 1" C. REFER TO CIVIL DRAWINGS.
- 4 LED PYLON SIGN.
- 5 UNDERGROUND ELECTRIC SERVICE TO UTILITY CO. TRANSFORMER. REFER TO CIVIL SHEETS FOR LOCATION AND ROUTING. VERIFY AND COORDINATE ALL REQUIREMENTS WITH UTILITY CO.
- 6 PROVIDE SEPARATE 2" TELEPHONE AND CABLE (HIGH SPEED INCLUDED) CONDUITS TO CONNECTION ON SITE. REFER TO CIVIL SHEETS FOR LOCATION AND ROUTING. VERIFY AND COORDINATE ALL REQUIREMENTS WITH UTILITY CO.
- 7 SPEAKER POST AND CANOPY. REFER TO CONDUIT SCHEDULE FOR CONDUIT SIZE AND QUANTITY.
- 8 NOT USED.
- 9 CLEARANCE BAR. REFER TO CIVIL DRAWINGS.
- 10 LED SITE LIGHTING. REFER TO CIVIL DRAWINGS, TYP. REFER TO DETAIL 12/C1.1.
- 11 1" C. - (2) #8, #8 GND.

C:\Users\mtrinh\Documents\Taco Bell\Taco Bell - Electrical\Taco Bell - Electrical.dwg

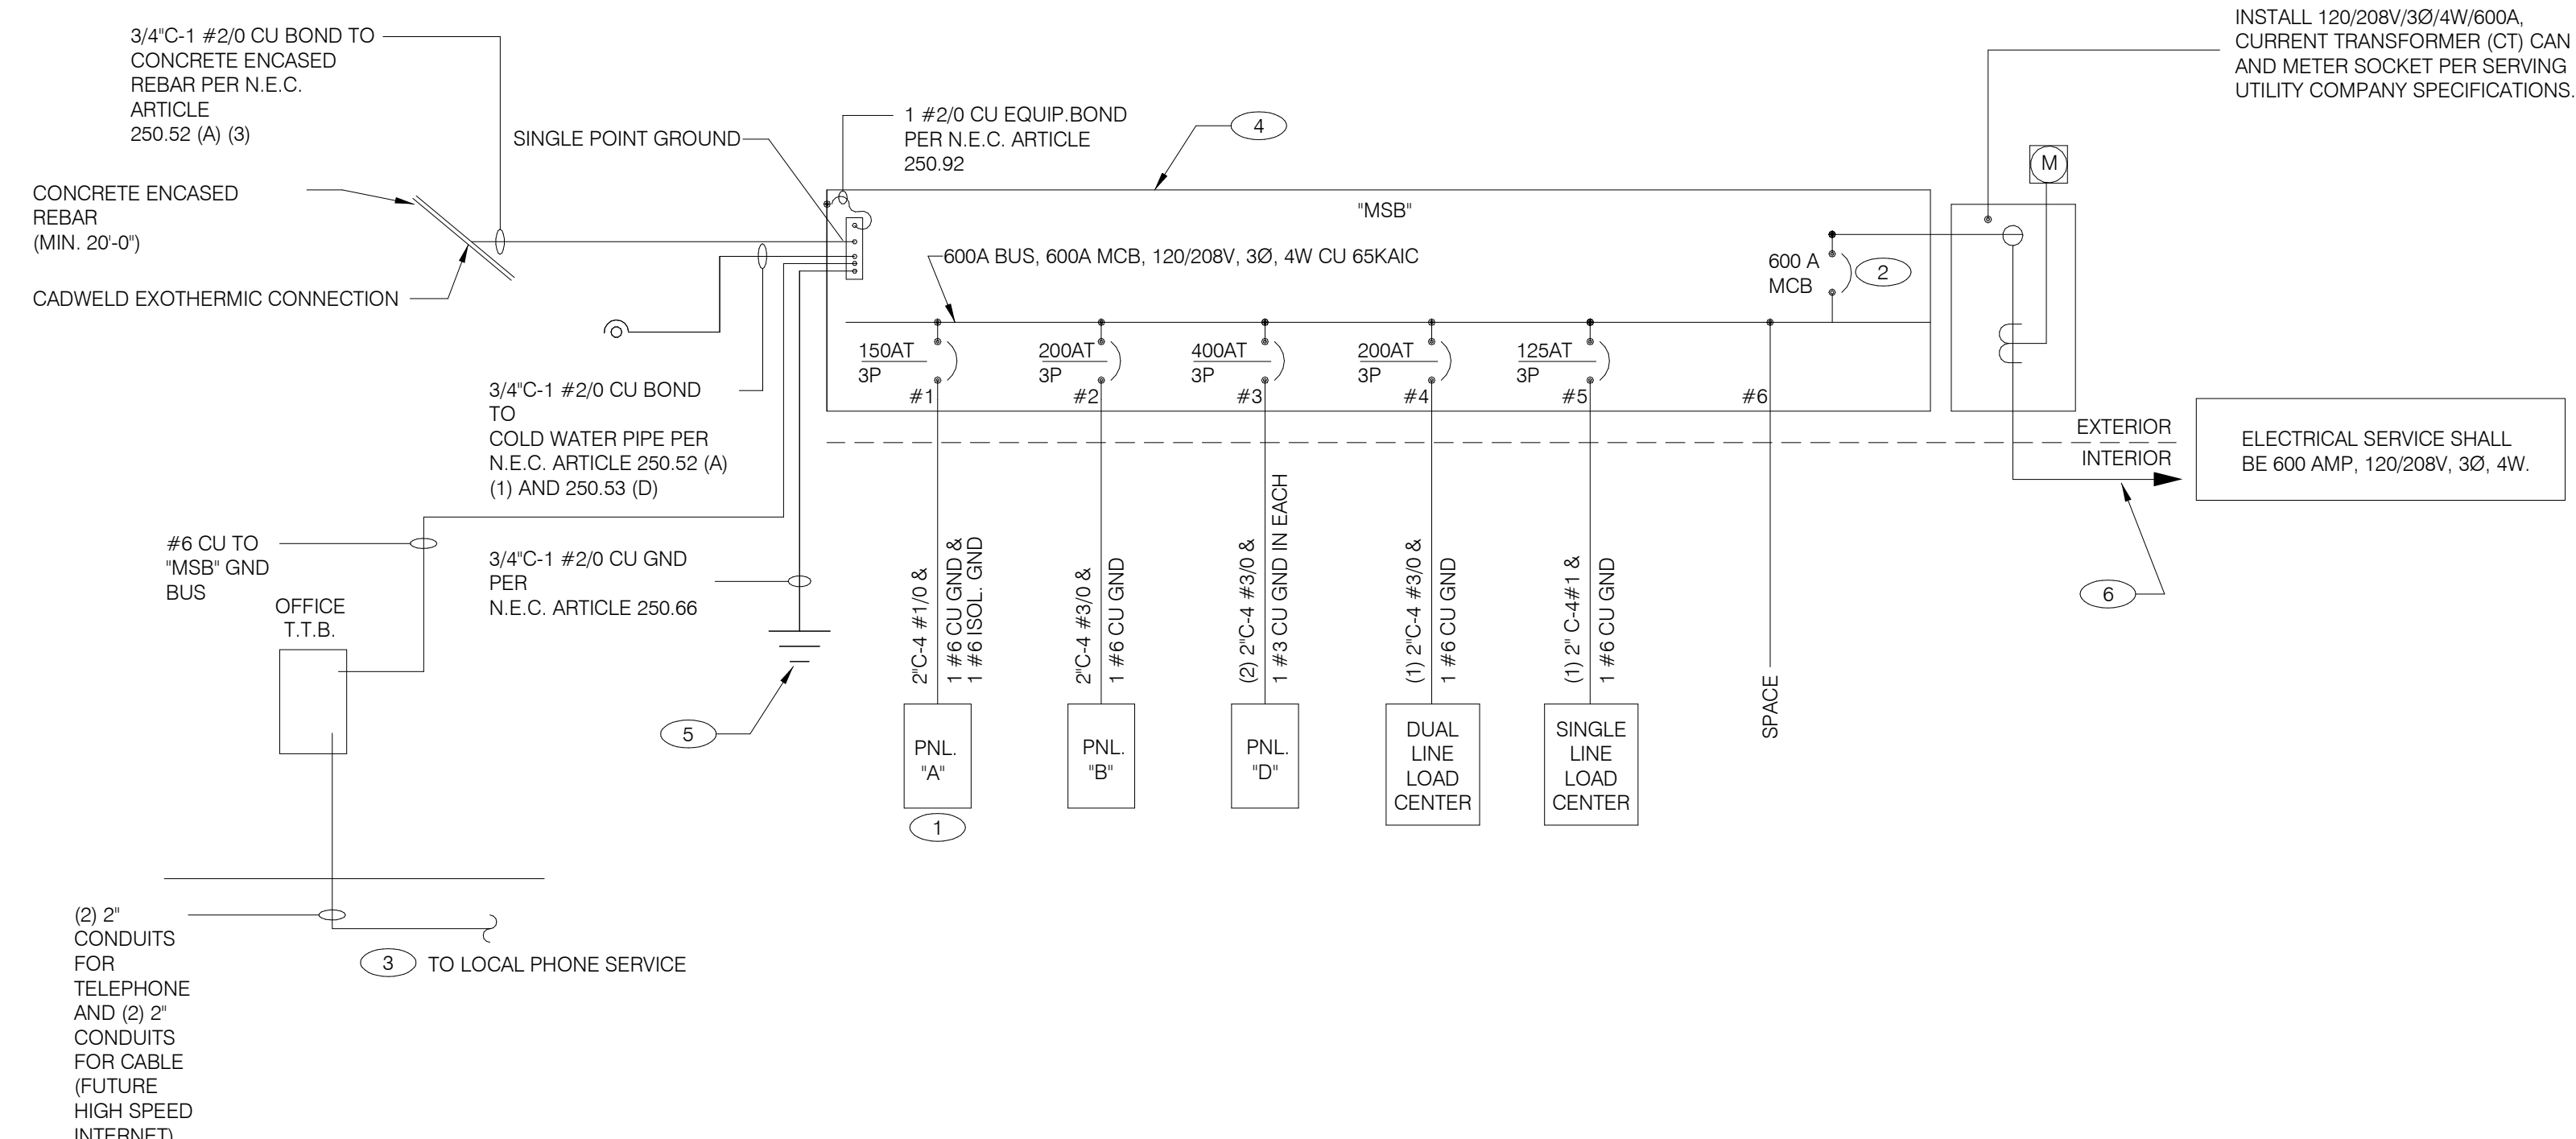

SINGLE LINE DIAGRAM NTS **A**

	2X4 LED FIXTURE	NL	NIGHTLIGHT		FUSIBLE DISCONNECT SWITCH WITH STARTER
	2X4 LED FIXTURE WITH BATTERY PACK	(S)	CEILING MOUNTED SPEAKER		FUSIBLE DISCONNECT SWITCH
	1X4 LED FIXTURE	(S)	WALL MOUNTED SPEAKER		NON-FUSIBLE DISCONNECT SWITCH
	1X4 LED FIXTURE WITH BATTERY PACK	(J)	JUNCTION BOX		PHOTOCELL
	DOWNLIGHT FIXTURE	(J)	WALL MOUNTED JUNCTION BOX		RAIN SENSOR
	SUSPENDED DOWNLIGHT FIXTURE	◀	TELEPHONE OUTLET		LED WALL MOUNT FIXTURE
	PENDANT MOUNTED LIGHT FIXTURE	⊕	DEDICATED GROUNDED OUTLET		EMERGENCY LIGHT
	TRACK MOUNTED PENDANT LIGHT FIXTURE	⊕	DUPLEX GROUNDED OUTLET		SINGLE POLE, SINGLE THROW TOGGLE SWITCH
	COOLER FIXTURE	⊕	DOUBLE DUPLEX GROUNDED OUTLET		SINGLE POLE, SINGLE THROW TOGGLE SWITCH W/ PILOT LIGHT
	EXIT SIGN (WALL MOUNTED)	⊕	GROUND FAULT DUPLEX OUTLET		WALL MOUNTED OCCUPANCY SENSOR
	EXIT SIGN (CEILING MOUNTED)	⊕	GROUND FAULT DUPLEX W/ BOTT. HALF SWITCHED		RELAY
	SECURITY STROBE	⊕	GROUND FAULT DEDICATED OUTLET		CONDUIT RUN, UNDERGROUND
		⊕	CEILING DUPLEX OUTLET		SMOKE DETECTOR
		⊕	DUPLEX ISOLATED GROUND OUTLET		EXTERIOR WALL FIXTURE
		⊕	DOUBLE DUPLEX ISOLATED GROUND OUTLET		EXTERIOR DECORATIVE WALL FIXTURE
		⊕	DEDICATED ISOLATED GROUND		EXTERIOR DECORATIVE WALL FIXTURE
		⊕	SPECIAL PURPOSE OUTLET		WEATHERPROOF GROUND FAULT
		⊕	CEILING SPECIAL PURPOSE OUTLET		
		⊕	ELECTRICAL PANEL. SEE SHEET E2.1 FOR PANEL SCHED.		
		⊕	HOLD UP EMERGENCY BUTTON		
		⊕	ELECTRICAL MOTOR		
		⊕	DUCT MOUNTED SMOKE DETECTOR		
		⊕	CONNECTION TO EQUIPMENT		

ELECTRICAL LEGEND NTS **D**

- THERE SHALL BE U.L. LISTED SERIES RATING BETWEEN CKT. BREAKERS LOCATED AT THE DISTRIBUTION PANEL AND THE DOWNSTREAM 10k A.I.C. RATED CIRCUIT BREAKERS AT PANELS "A", "B" DUAL-LINE EQUIPMENT CABINET BASED ON THE MAXIMUM FAULT CURRENT AS DETERMINED AT THE SERVICE ENTRANCE AND DOWNSTREAM 22k A.I.C. RATED CIRCUIT BREAKERS AT PANEL "D."
- SEE SCOPE OF WORK FOR DETAILS REGARDING OWNER SUPPLIED AND/OR INSTALLED PRODUCTS. GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL OTHER ASPECTS OF THE PROJECT
- IF UTILITY COMPANY PROPOSES A SERVICE DIFFERENT FROM THAT ILLUSTRATED, CONTACT THE CONSTRUCTION ENGINEER FOR A DECISION BEFORE PROCEEDING. COORDINATE AVAILABLE SHORT CIRCUIT CURRENT W/ LOCAL UTILITY AND PROVIDE CIRCUIT BREAKERS W/ SUFFICIENT INTERRUPTING CAPACITY.
- COORDINATE CT METERING COMPARTMENT SIZE WITH LOCAL UTILITY COMPANY. THE LOCAL ELECTRICAL INSPECTOR AND THE NATIONAL ELECTRICAL CODE TO MEET ALL REQUIREMENTS BEFORE PURCHASE AND INSTALLATION. NEW METER BY LOCAL UTILITY COMPANY.
- ALL WIRING SHOWN SHALL BE COPPER TYPE "THHN/THWN" EXCEPT FEEDERS FROM UTILITY TRANSFORMER TO SWITCH BOARD MAY BE ALUMINUM.
- ARMOR CABLE ACCEPTABLE FOR THE LAST 6'-0" FROM A JUNCTION BOX TO LIGHT FIXTURES. ARMOR CABLE IS NOT ALLOWED FOR NON-ACCESSIBLE FLOORS, WALLS AND CEILINGS.

ONE LINE DIAGRAM GENERAL NOTES NTS **C**

- WIRE ISOLATED GROUND TO ISOLATION GROUND BUS IN PANEL AND LAND ISOLATED GROUND TO SINGLE POINT GROUND. "DO NOT COMBINE COMMON GND TO ISOLATED GROUND". REF DETAIL 6/E3.1.
- PROVIDE 100% RATED MAIN CIRCUIT BREAKER IN MDP.
- PROVIDE 2" CONDUIT STUBBED INTO BUILDING FROM LATERAL POLE FOR TELEPHONE AND 2" CONDUIT FOR FUTURE HIGH SPEED CABLE.
- VERIFY AVAILABLE FAULT CURRENT AT SERVICE ENTRANCE WITH THE UTILITY COMPANY. IF THE AIC RATING AS INDICATED IS NOT SUFFICIENT, CONTACT PROJECT MANAGER AND ENGINEER PRIOR TO BID/PRICING TO UPDATE EQUIPMENT RATING.
- (3) 5/8" DIA. x 10'-0" COPPER CLAD GROUND RODS. INSTALL 10'-0" APART AND CONNECT GROUND SYSTEM PER N.E.C. ARTICLE 250
- PROVIDE UNDERGROUND SERVICE LATERAL TO UTILITY TRANSFORMER PER SERVING UTILITY COMPANY SPECIFICATIONS. 4#350 KCMIL CU. IN EACH OF (2) 3"C. TO PAD MOUNT TRANSFORMER. GC/ELECT. CONTRACTOR SHALL COORDINATE SERVICE POLES PER LOCAL UTILITY CODE. IF ALUMINUM CONDUCTORS ARE USED PROVIDE 4#500 KCMIL CU. IN EACH (2) 3-1/2"C.

ONE LINE DIAGRAM KEY NOTES NTS **B**

DATE	REMARKS
11.04.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: AJR
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236



ENDEAVOR 2.0
ELECTRICAL ONE LINE DIAGRAMS AND LEGEND
E2.0



520 S. MAIN STREET, SUIT 2531
AKRON, OH 44311
330.572.2100 FAX: 330.572.2102

Switchboard: MSB

Location: Volts: 120/208 Wye
Supply From: MSB Phases: 3
Mounting: SURFACE A.I.C. Rating: 65 KAIC
Enclosure: NEMA-3R Wires: 4 Mains Type: MCB
Mains Rating: 600 A
MCB Rating: 600 A
100% RATED CIRCUIT BREAKER

Notes:

CKT	Circuit Description	WIRE SIZE	# of Poles	Frame Size	Trip Rating	Load	Remarks
1	PANELBOARD A	1/0	3	225 A	150 A	27880 VA	--
2	PANELBOARD B	3/0	3	225 A	200 A	12300 VA	--
3	PANELBOARD D	3/0	3	400 A	400 A	58703 VA	--
4	DUAL COOK LINE PANEL	3/0	3	225 A	200 A	52000 VA	--
5	SINGLE COOK LINE	1	3	225 A	125 A	28800 VA	--
6	Space		--	--	--	0 VA	--

Total Conn. Load: 179683 VA
Total Amps: 499 A

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals
HVAC	32020 VA	100.00%	32020 VA	
Kitchen	10704 VA	65.00%	6958 VA	
Lighting	5234 VA	125.00%	6542 VA	
Other	630 VA	100.00%	630 VA	
Power	110692 VA	100.00%	110692 VA	
Receptacle	6224 VA	100.00%	6224 VA	
Refrigeration	14179 VA	100.00%	14179 VA	

Notes:

Panel: A

Location: Volts: 120/208 Wye
Supply From: MSB Phases: 3
Mounting: Recessed A.I.C. Rating: SERIES
Enclosure: Type 1 Wires: 4 Mains Type: M.L.O.
Mains Rating: 150 A
MCB Rating: N/A

Notes:

PROVIDE ISOLATED GROUND BAR

NOTES	CKT	Load Name	Trip	Poles	A	B	C	Poles	Trip	Load Name	CKT	NOTES
	1	P-417 TIMER	20 A	1	180 VA	300 VA				F-040 OFFICE COMPUTER	2	IG
	3	S-546 ICED TEA	20 A	1		480 VA	720 VA			DRIVE THRU POS/ORDER ENTRY 1	4	
	5	OFFICE QUAD RECEPTACLE	20 A	1			180 VA	480 VA		S-546 BREWER	6	GF
	7	J-BOX SECURITY SYSTEM / DVR	20 A	1	1180...	180 VA				U-011	8	
	9	S-026 HEAT CABINET	20 A	1		1800...	540 VA			RECEPTACLES - OFFICE	10	
	11	U-050 CREDIT CARD SAT. ROUTER JUNC.	20 A	1			860 VA	648 VA		S-204 D/T TIMING SYSTEM	12	
	13	F-090	20 A	1	1180...	1140...				R-009 FULL HEIGHT FREEZER	14	GF
	15	BEVERAGE DISPENSER D/T	15 A	1		1428...	2013...			P-452 HOT WATER SYSTEM	16	
	17	P-452 HOT WATER SYSTEM	30 A	2	2013...	240 VA		2013...	2013...		18	
	19									C-107 RETHERMALIZER	20	GF
	21	SECURITY CAMERA POWER	20 A	1		600 VA	0 VA			SHUNT TRIP SPACE	22	ST
	23	C-026 FRYER	20 A	1			972 VA	100 VA		C-400 COOK TIMER	24	
	25	SHUNT TRIP SPACE	0 A	1	0 VA	540 VA				INTERIOR DIGITAL MENUBOARD	26	
	27	Spare	20 A	1			0 VA	500 VA		OCB SWITCH	28	
	29	DINING POS ENTRY 2	20 A	1			680 VA	1800...		L-045 WARMER	30	GF
	31	DRIVE THRU MONITORS	20 A	1	180 VA	360 VA				SAFE W/TOUCHSCREEN CONTROLS	32	
	33	RECIRCULATION PUMP	20 A	1		200 VA	680 VA			DINING POS ENTRY 1	34	IG
	35	KIOSK POWER - FRONT COUNTER	20 A	1			800 VA	700 VA		AUTO FAUCET POWER	36	
	37	MAINTENANCE RECEPTACLE...	20 A	1	180 VA	0 VA				Spare	38	
	39	Spare	20 A	1			0 VA	0 VA		Spare	40	
	41	Spare	20 A	1			0 VA	0 VA		Spare	42	

Total Load: 7673 VA
Total Amps: 64 A 76 A 95 A

Legend:

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals
Power	22504 VA	100.00%	22504 VA	
Receptacle	2808 VA	100.00%	2808 VA	

Total Conn. Load: 27880 VA
Total Est. Demand: 27880 VA
Total Conn. Current: 77 A
Total Est. Demand Current: 77 A

Notes:

CIRCUIT BREAKER/MISC. ACC. ABBREVIATIONS:

GF - GROUND FAULT CIRCUIT INTERRUPTER
AF - ARC-FAULT CIRCUIT INTERRUPTER
ST - SHUNT TRIP
HL-ON - HANDLE-LOCK ON DEVICE
HL-OFF - HANDLE-LOCK OFF DEVICE
EPD - EQUIPMENT PROTECTION DEVICE
IG - ISOLATED GROUND

NOTE

PARKING LOT LIGHTING AND SIGNAGE SHALL PASS THROUGH TBCCB

NOTE TO CONTRACTORS

ALL CONTRACTORS PRIOR TO BID SUBMISSION PROCESS SHALL VISIT PROPOSED WORK SITE AND FIELD VERIFY ALL EXISTING CONDITIONS. ANY CONDITION THAT DIFFERS FROM THAT SHOWN ON THESE PLANS SHALL BE REPORTED TO THE TENANT'S ARCHITECT/ENGINEER SO THAT NEW AND REVISED BID DRAWINGS OR INFORMATION MAY BE ISSUED. MODIFICATION TO THE SCOPE OF WORK WHICH RESULTS FROM THE CONTRACTORS NEGLIGENCE TO VISIT THE SITE PRIOR TO SUBMITTING BID, SHALL BE THE CONTRACTORS SOLE RESPONSIBILITY.

GENERAL NOTE:

FOR PARKING LOT (SITE) LIGHTS AND OUTSIDE SIGNS: PROVIDE (5) 1" C FROM PANEL "B" AND STUB OUT 10'-0" AWAY FROM THE BUILDING. VERIFY EXACT LOCATION OF STUB PRIOR TO ROUGH-IN. LOADS MAY VARY WITH LOCATION. VERIFY OUTDOOR VOLTAGE DROP FOR ALL PARKING LIGHTING (SITE) CIRCUITS.

KEY NOTES:

- 1 PROVIDE LOCK-ON BREAKER.
- 2 CIRCUITS TO BE WIRED THROUGH COMBINED CONTROL BOX CONTACTOR. SEE SHEETS 6.0 AND 6.1.
- 3 PROVIDE GFI BREAKER. CIRCUIT TO BE WIRED THROUGH TBANS. SEE SHEETS E7.0 AND E7.1.

Panel: B

Location: Volts: 120/208 Wye
Supply From: MSB Phases: 3
Mounting: Recessed A.I.C. Rating: SERIES
Enclosure: Type 1 Wires: 4 Mains Type: M.L.O.
Mains Rating: 200 A
MCB Rating: N/A

Notes:

NOTES	CKT	Load Name	Trip	Poles	A	B	C	Poles	Trip	Load Name	CKT	NOTES
	1	DINING LTS	20 A	1	210 VA	1000...				EXTERIOR SIGNAGE	2	
	3	EXTERIOR SCONCE LTS.	20 A	1		100 VA	216 VA			UTILITY RECEIPT	4	GFCI
	5	KITCHEN/ BOH/ RESTROOM LTS	20 A	1			1252...	67 VA		EMERGENCY LTS INT/EXT, EXIT SIGNS	6	
	7	Spare	20 A	1	0 VA	500 VA				CLEARANCE BAR	8	
	9	LTG - SHOW WINDOW	20 A	1		900 VA	500 VA			TBCCB	10	
	11	LTG - COOLER & FREEZER	20 A	1			800 VA	500 VA		E1AN TBANS	12	
	13	Spare	20 A	1	0 VA	180 VA				OUTSIDE FOUNTAIN	14	
	15	DIGITAL MENU BOARD/SPEAKER POST	20 A	1		360 VA	0 VA			Spare	16	
	17	SPEAKER POST	20 A	1			500 VA	0 VA		Spare	18	
	19	Spare	20 A	1	0 VA	0 VA				Spare	20	
	21	LTG - PYLON SIGN	20 A	1		500 VA	0 VA			Spare	22	
	23	CLEARANCE BAR	20 A	1			500 VA	0 VA		Spare	24	
	25	Spare	20 A	1	0 VA	0 VA				Spare	26	
	27	Spare	20 A	1		0 VA	0 VA			Spare	28	
	29	LTG - SITE LIGHTING	20 A	1			935 VA	0 VA		Spare	30	
	31	EF-1	20 A	1	1120...	0 VA				Spare	32	
	33	EF-2	20 A	1		660 VA	1000...			PURPLE WALLWASH LIGHTS	34	
	35	Spare	20 A	1			0 VA	500 VA		PURPLE WALLWASH LIGHTS	36	
	37	Spare	20 A	1	0 VA	0 VA				Spare	38	
	39	Spare	20 A	1		0 VA	0 VA			Spare	40	
	41	Spare	20 A	1			0 VA	0 VA		Spare	42	

Total Load: 3010 VA
Total Amps: 25 A 37 A 44 A

Legend:

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals
Other	630 VA	100.00%	630 VA	
Power	3540 VA	100.00%	3540 VA	
Lighting	5234 VA	125.00%	6542 VA	
HVAC	1780 VA	100.00%	1780 VA	
Receptacle	1116 VA	100.00%	1116 VA	

Notes:

CIRCUIT BREAKER/MISC. ACC. ABBREVIATIONS:

GF - GROUND FAULT CIRCUIT INTERRUPTER
AF - ARC-FAULT CIRCUIT INTERRUPTER
ST - SHUNT TRIP
HL-ON - HANDLE-LOCK ON DEVICE
HL-OFF - HANDLE-LOCK OFF DEVICE
EPD - EQUIPMENT PROTECTION DEVICE
IG - ISOLATED GROUND


TACO BELL

18550 E. WARREN AVE.,
DETROIT, MI 48236




ENDEAVOR 2.0
ELECTRICAL
SCHEDULES

E2.1

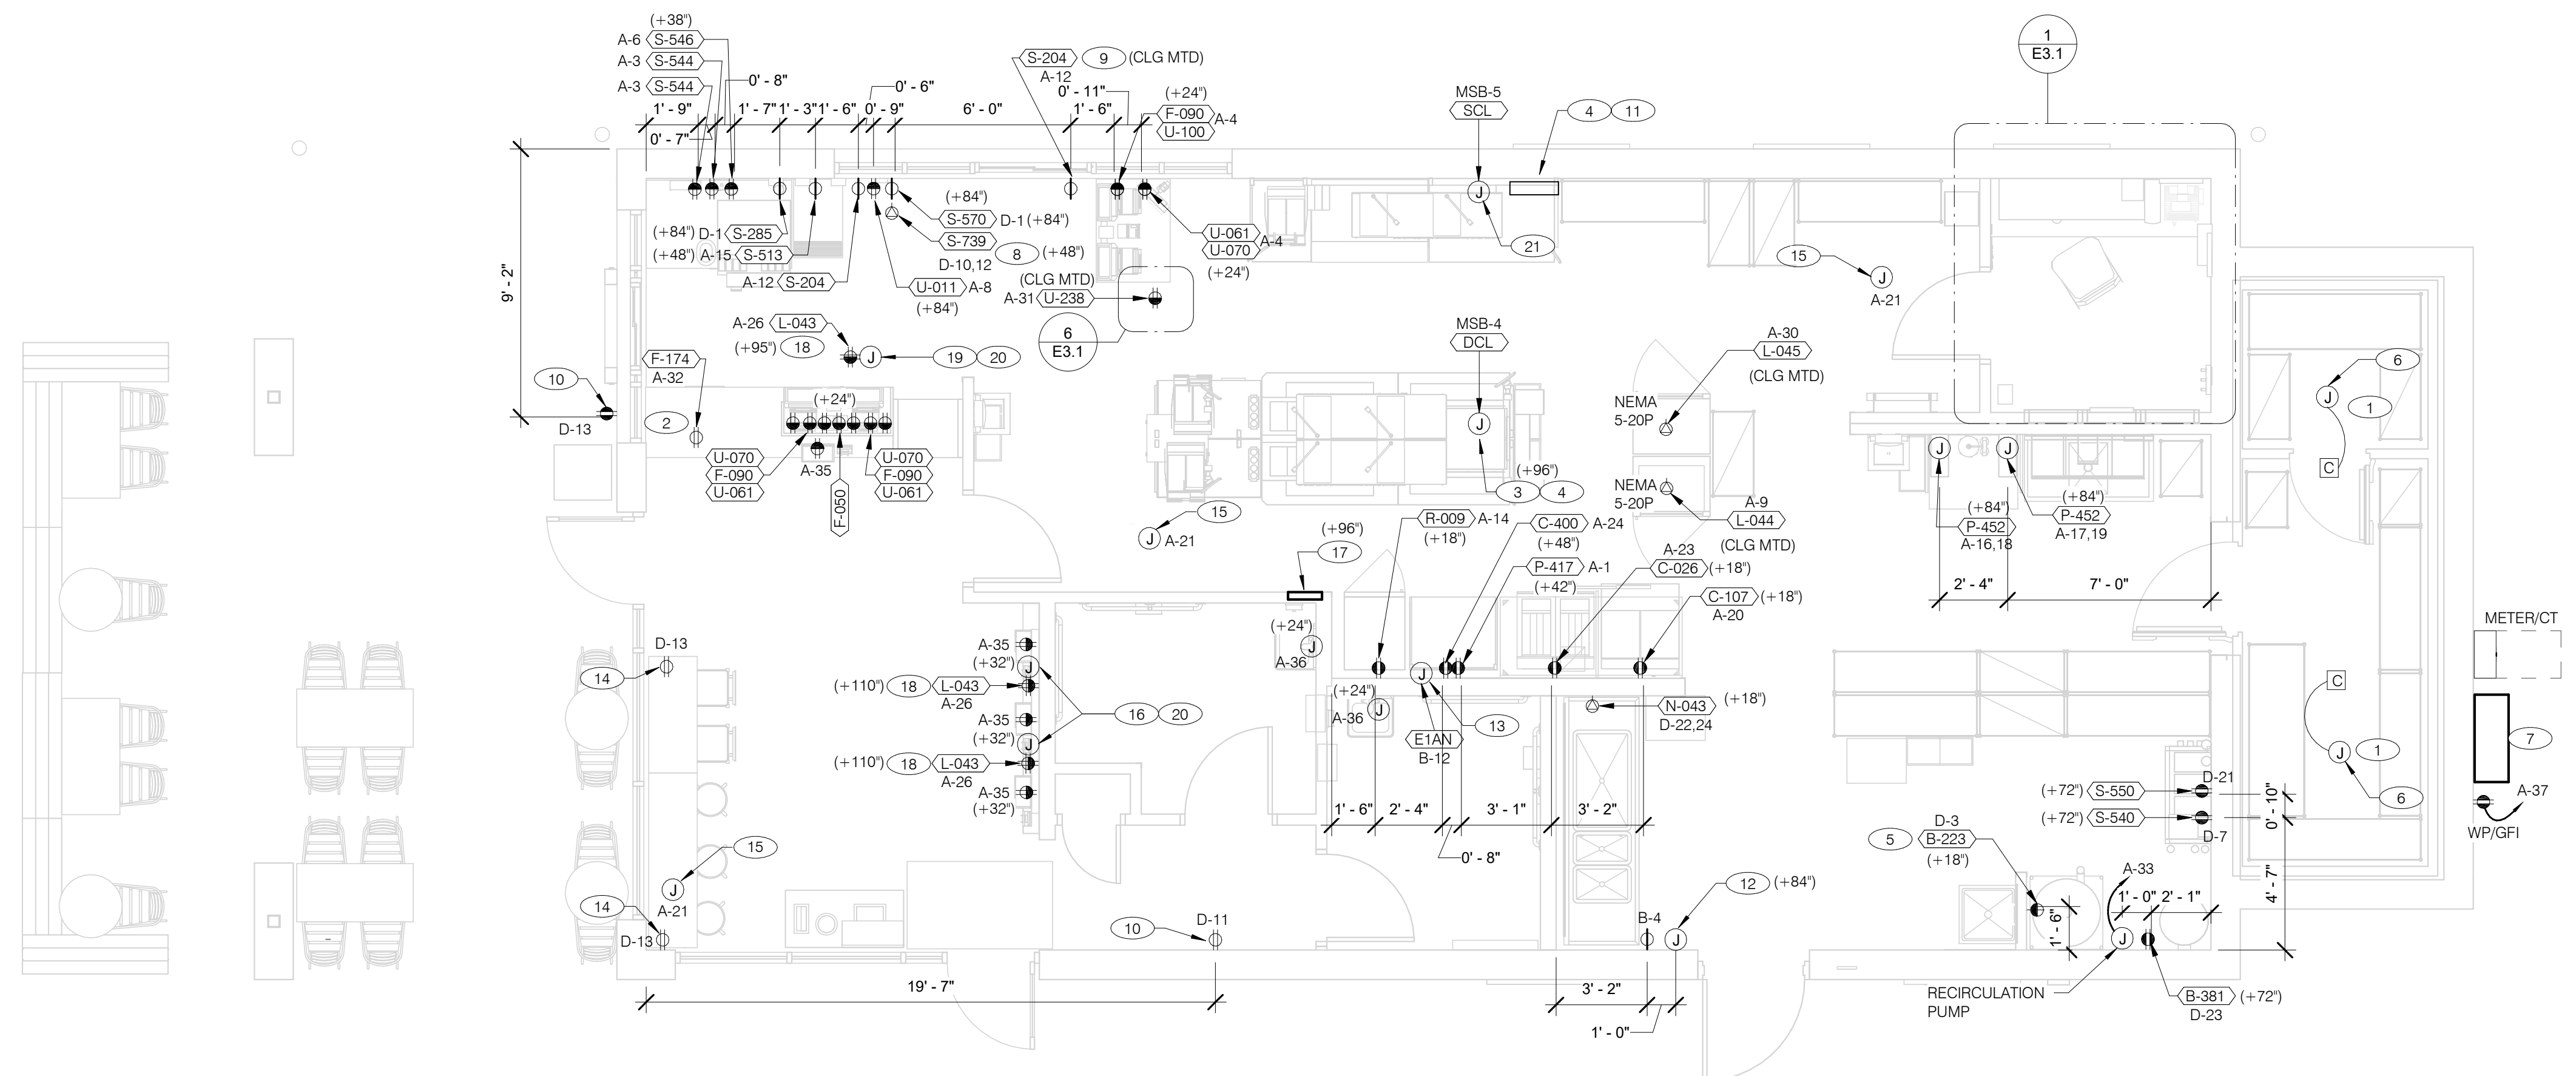

RECEPTACLE NOTE:
ALL RECEPTACLES IN PUBLIC AREAS SHALL BE TAMPER RESISTANT.

NOTE
5mA GFCI BREAKERS MUST BE USED WHERE OUTLETS REQUIRING GFCI PROTECTION ARE NOT ACCESSIBLE FOR COMPLIANCE WITH NEC 210.8. WHERE GFCI PROTECTION AND SHUNT TRIP IS REQUIRED, THE CIRCUIT SHALL HAVE A GFCI BREAKER AND PASS THROUGH THE TBANS PANEL REFER TO DETAILS IN E7.0 AND E7.1.



DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY: AJR
JOB NO.: 2020088.03

POWER PLAN 1/4" = 1'-0" **A**

- A. ALL DIMENSIONS TO J-BOXES ARE FROM FACE OF STUD TO CENTER OF BOX, U.O.N.
- B. ALL CONDUIT DROPS ARE INSIDE WALLS U.O.N. SEE ARCH. DWGS FOR WALL DIMS.
- C. ALL J-BOX CIRCUITS, CONDUITS, FIXTURES, ETC. SHALL BE AS INDICATED ON THE ELECT. DWGS AND SPECS.
- D. CONTRACTOR SHALL VERIFY UNDERGROUND CONDUIT LOCATIONS PRIOR TO POURING SLAB.
- E. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE THIS DATA ON THE LOCATION OF ELECT. ROUGH-INS WITH INFO PROVIDED ON THE ARCH. AND STRUCT. DWGS AND THE EQUIPMENT ACTUALLY SUPPLIED, AND TO CONFIRM THE CORRECTNESS OF ANY DIMENSIONS HEREIN.
- F. LOCATIONS OF ALL OUTLETS MAY BE RELOCATED TO NEAREST STUD. DO NOT CUT INTO STUDS.
- G. FOR EXACT LOCATIONS OF KITCHEN & MECHANICAL EQUIPMENT AND POINTS OF CONNECTION, REFER TO KITCHEN & MECHANICAL EQUIPMENT DRAWINGS AND MANUFACTURERS SHOP DRAWINGS.
- H. ALL CIRCUIT FEEDERS AND DISCONNECTS SHALL BE SIZED BY NEC.
- I. CONTRACTOR SHALL VERIFY CIRCUIT BREAKER, DISCONNECT SWITCH, STARTER AND FUSE SIZES WITH SELECTED EQUIPMENT MANUFACTURERS SHOP DRAWINGS PRIOR TO PLACING ORDER AND PROVIDE EVERYTHING AS REQUIRED.
- J. ELECTRICAL EQUIPMENT ENCLOSURES SHALL BE NEMA-1 FOR INTERIOR AND NEMA 3R FOR EXTERIOR. IN COASTAL REGIONS THE STANDARD FOR OUTSIDE SHALL BE NEMA-4X.
- K. PER SECTION 210.8 NEC 2020, ALL SINGLE PHASE RECEPTACLE RATED 150 VOLTS TO GROUND OR LESS, 50 AMPERES OR LESS AND THREE-PHASE RECEPTACLES RATED 150 VOLTS TO GROUND OR LESS, 100 AMPERES OR LESS.
- L. DO NOT MEASURE/LOCATE OUTLETS ON DRAWINGS. USE DIMENSIONS PROVIDED.
- M. CONDUIT MAY RUN UNDER SLAB AT G.C.'S DISCRETION.
- N. E.C. SHALL PROVIDE A PREPRINTED SELF-ADHESIVE LABEL ON ALL POS RECEPTACLES STATING "POS USE ONLY".
- O. PROVIDE ESCUTCHEON PLATES AND SEALANT AT ALL UTILITY PENETRATIONS INTO WALLS, CEILING, AND FLOORS. DO NOT USE CAULKS OR EXPANSION FOAM FOR SEALANT.
- P. ARMOR CABLE (BX) ALLOWED WHERE ACCEPTABLE BY CODE. ALL WIRE SHALL BE CONCEALED O.N.U.
- Q. FOR ALL CIRCUITS NOT SHOWN ON EQUIPMENT SCHEDULE, CONTRACTOR SHALL PROVIDE CONDUCTOR AND CONDUIT SIZES AS SHOWN ON BRANCH CIRCUIT WIRING SCHEDULE SHOWN ON E2.2. IF SIZES DIFFER FROM N.E.C., THE MORE STRINGENT (LARGER) SIZE SHALL BE PROVIDED.
- R. OUTLETS WITHIN FOH TO BE AT 18" AFF FOR ADA ACCESS.
- S. CONDUITS NEAR DRIVE THRU WINDOW AREA TO BE ROUTED FROM ABOVE CEILING OR STUBBED UP FROM UNDER SLAB SO AS TO NOT INTERFERE WITH WINDOW FRAMING.

- 1 REFER TO ROOF PLAN.
- 2 INSTALL IN CONDUIT RUNNING ON SURFACE OF KITCHEN SIDE OF CABINERY REAR WALL.
- 3 CONNECT PRODUCTION LINE CIRCUIT BREAKER PANEL VIA UTILITY CHASE IN CEILING TO A 3 POLE, 200 AMP CIRCUIT BREAKER IN MAIN SWITCHBOARD. SEE SHEET E2.0. VERIFY ALL REQUIREMENTS WITH ACTUAL EQUIPMENT SPECIFIED. THE MANUFACTURER WILL FULLY PRE-WIRE THE COMPLETE MAPS LINE AT THE FACTORY. THE UNITS WILL THEN BE PULLED APART FOR SHIPPING PURPOSES. ALL CONNECTION POINTS WILL BE MARKED. THE CONDUIT RUNS WILL BE COILED UP FOR FIELD INSTALLATION. SOME ELECTRICAL COMPONENTS MAY BE REMOVED FOR EASE OF DISASSEMBLING THE LINE-UP. THE ELECTRICAL CONTRACTOR WILL BE FULLY RESPONSIBLE FOR MAKING THE PROPER FIELD CONNECTIONS FROM THE ROUGH-IN LOCATION TO THE MANUFACTURER PROVIDED BREAKER PANEL BOX. IN ADDITION, THE ELECTRICAL CONTRACTOR WILL BE RESPONSIBLE FOR ANY SPLICE POINTS AND/OR JUNCTION BOXES THAT NEED TO BE RECONNECTED. SOME ELECTRICAL COMPONENT ASSEMBLY MAY ALSO BE REQUIRED.
- 4 EQUIPMENT CABINET.
- 5 LOCATED INSIDE SHELL OF HEATER.
- 6 INSTALL CONTROL CABLE FROM FREEZER/COOLER FAN COIL TO ROOF MOUNTED CONDENSOR.
- 7 LOCATE SWITCHGEAR PER GUIDELINES ON SHEET A4.1.
- 8 PROVIDE BOOST TRANSFORMER (208V, 1-PHASE IN, 240V, 1-PHASE OUT) FOR FROZEN BEVERAGE DISPENSER.
- 9 CEILING MOUNTED FOR WALL MOUNTED HME. SEE 7/E3.1
- 10 PROVIDE TAMPER RESISTANT DUPLEX RECEPTACLE WITH TWO (2) USB CHARGING PORTS.
- 11 VERIFY PANEL LOCATION OF COOK LINE WITH TACO BELL CONSTRUCTION MANAGER PRIOR TO INSTALLATION.
- 12 PROVIDE J-BOX FOR POWER SOAK INDICATOR LIGHT. (OPTIONAL)
- 13 VERIFY LOCATION OF JUNCTION BOX WITH CONSTRUCTION MANAGER.
- 14 E.C. SHALL PROVIDE, INSTALL AND WIRE A DUPLEX RECEPTACLE WITH (2) USB POWER PORTS IN SINGLE-GANG BOX PROVIDED WITH TABLE, AT EACH END OF THE TABLE. PROVIDE GALVANIZED COVER PLATE TO MATCH BOX.
- 15 PROVIDE POWER FOR SECURITY CAMERAS. COORDINATE WITH CAMERA VENDOR, SECURITY, AND CONSTRUCTION SUPERVISOR PRIOR TO ROUGH-IN.
- 16 EC / GC TO INSTALL (1) OPEN DATA JUNCTION BOX (JB) IN WALL. CONDUIT TERMINATED ABOVE CEILING TO HAVE BUSHING.
- 17 2-GANG FLUSH BOX WITH DEAD-FRONT GFCI DEVICES. MOUNT CENTER OF BOX AT 48" A.F.F.. REFER TO E7.0.
- 18 EC / GC TO INSTALL A TOTAL OF (2) QUAD OUTLETS IN (2) QUAD BOXES ON FRONT OF VALANCE WALL AS SHOWN. OUTLETS TO BE STRAIGHT BLADE. OUTLETS TO BE ON AN ISOLATED/DEDICATED GROUNDED CIRCUIT THAT IS NOT CONNECTED TO ANY RESTAURANT POWER MANAGEMENT SYSTEM.
- 19 EC / GC TO INSTALL (1) OPEN DATA JUNCTION BOX (JB) IN VALANCE WALL. CONDUIT TERMINATED ABOVE CEILING TO HAVE BUSHING.
- 20 EC / GC TO RUN (3) ORANGE CAT 6 LINES FROM NETWORK SWITCH TO DATA JUNCTION BOX. CAT6 LINES SHOULD HAVE BOTH ENDS PROPERLY TERMINATED WITH RJ-45 CONNECTORS. EXCESS CAT6 CABLE TO BE COILED INTO SERVICE LOOPS AT EACH END AND LEFT ACCESSIBLE FOR DMB INSTALL TEAM. CAT6 TO BE RUN IN ACCORDANCE WITH ALL LOCAL MUNICIPALITY CODE REQUIREMENTS.
- 21 CONNECT PRODUCTION LINE CIRCUIT BREAKER PANEL VIA UTILITY CHASE IN CEILING TO A 3 POLE, 125 AMP CIRCUIT BREAKER IN MAIN SWITCHBOARD. SEE SHEET E2.0. VERIFY ALL REQUIREMENTS WITH ACTUAL EQUIPMENT SPECIFIED. THE MANUFACTURER WILL FULLY PRE-WIRE THE COMPLETE MAPS LINE AT THE FACTORY. THE UNITS WILL THEN BE PULLED APART FOR SHIPPING PURPOSES. ALL CONNECTION POINTS WILL BE MARKED. THE CONDUIT RUNS WILL BE COILED UP FOR FIELD INSTALLATION. SOME ELECTRICAL COMPONENTS MAY BE REMOVED FOR EASE OF DISASSEMBLING THE LINE-UP. THE ELECTRICAL CONTRACTOR WILL BE FULLY RESPONSIBLE FOR MAKING THE PROPER FIELD CONNECTIONS FROM THE ROUGH-IN LOCATION TO THE MANUFACTURER PROVIDED BREAKER PANEL BOX. IN ADDITION, THE ELECTRICAL CONTRACTOR WILL BE RESPONSIBLE FOR ANY SPLICE POINTS AND/OR JUNCTION BOXES THAT NEED TO BE RECONNECTED. SOME ELECTRICAL COMPONENT ASSEMBLY MAY ALSO BE REQUIRED.

GENERAL NOTES - ELECTRICAL POWER PLAN NTS **C**

KEY NOTES - ELECTRICAL POWER PLAN NTS **B**

TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236



ENDEAVOR 2.0 ELECTRICAL POWER PLAN

E3.0

THE DEDICATED POS POWER CIRCUIT REQUIRES AN ISOLATED GROUND IN ADDITION TO THE NORMAL COMMON BUILDING GROUND. THE ISOLATED GROUND WIRE SERVES TWO PURPOSES:
* AS A SAFETY PATH TO GROUND.
* AS A ZERO REFERENCE POINT FOR ALL POS DIGITAL LOGIC.


THE GROUND MUST EXHIBIT THE LOWEST POSSIBLE IMPEDANCE TO MINIMIZE VOLTAGE TRANSIENTS AND NOISE.

BE SURE TO:

- * USE AN INSULATED CONDUCTOR FOR THE ISOLATED GROUND WIRE.
- * RUN THE ISOLATED GROUND WIRE THROUGH THE SAME CONDUIT AS THE HOT AND NEUTRAL WIRES.
- * INSTALL ONLY ISOLATED GROUND (IG) TYPE RECEPTACLES.
- * CONNECT THE ISOLATED GROUND WIRE TO BUILDING GROUND ONLY AT THE MAIN SERVICE PANEL.
- * VERIFY THAT IG RECEPTACLES PRE-WIRED IN OWNER SUPPLIED EQUIPMENT HAVE A TRUE ISOLATED GROUND THAT CAN BE TRACED BACK TO THE BUILDING GROUND AT THE MAIN SERVICE PANEL.


DO NOT CONNECT THE ISOLATED GROUND WIRE TO THE CONDUIT, JUNCTION BOXES, THE FRAME ON A SUBPANEL, OR ANY OTHER METAL SURFACE.

DEDICATED CIRCUITS: DEDICATED CIRCUITS REQUIRE A DEDICATED HOT AND A DEDICATED NEUTRAL THAT ARE NOT SHARED WITH ANY OTHER CIRCUITS. IG RECEPTACLES MUST BE "PHASE ALIGNED" WITH THE "B" PHASE OF BUILDING SUBPANEL "A".

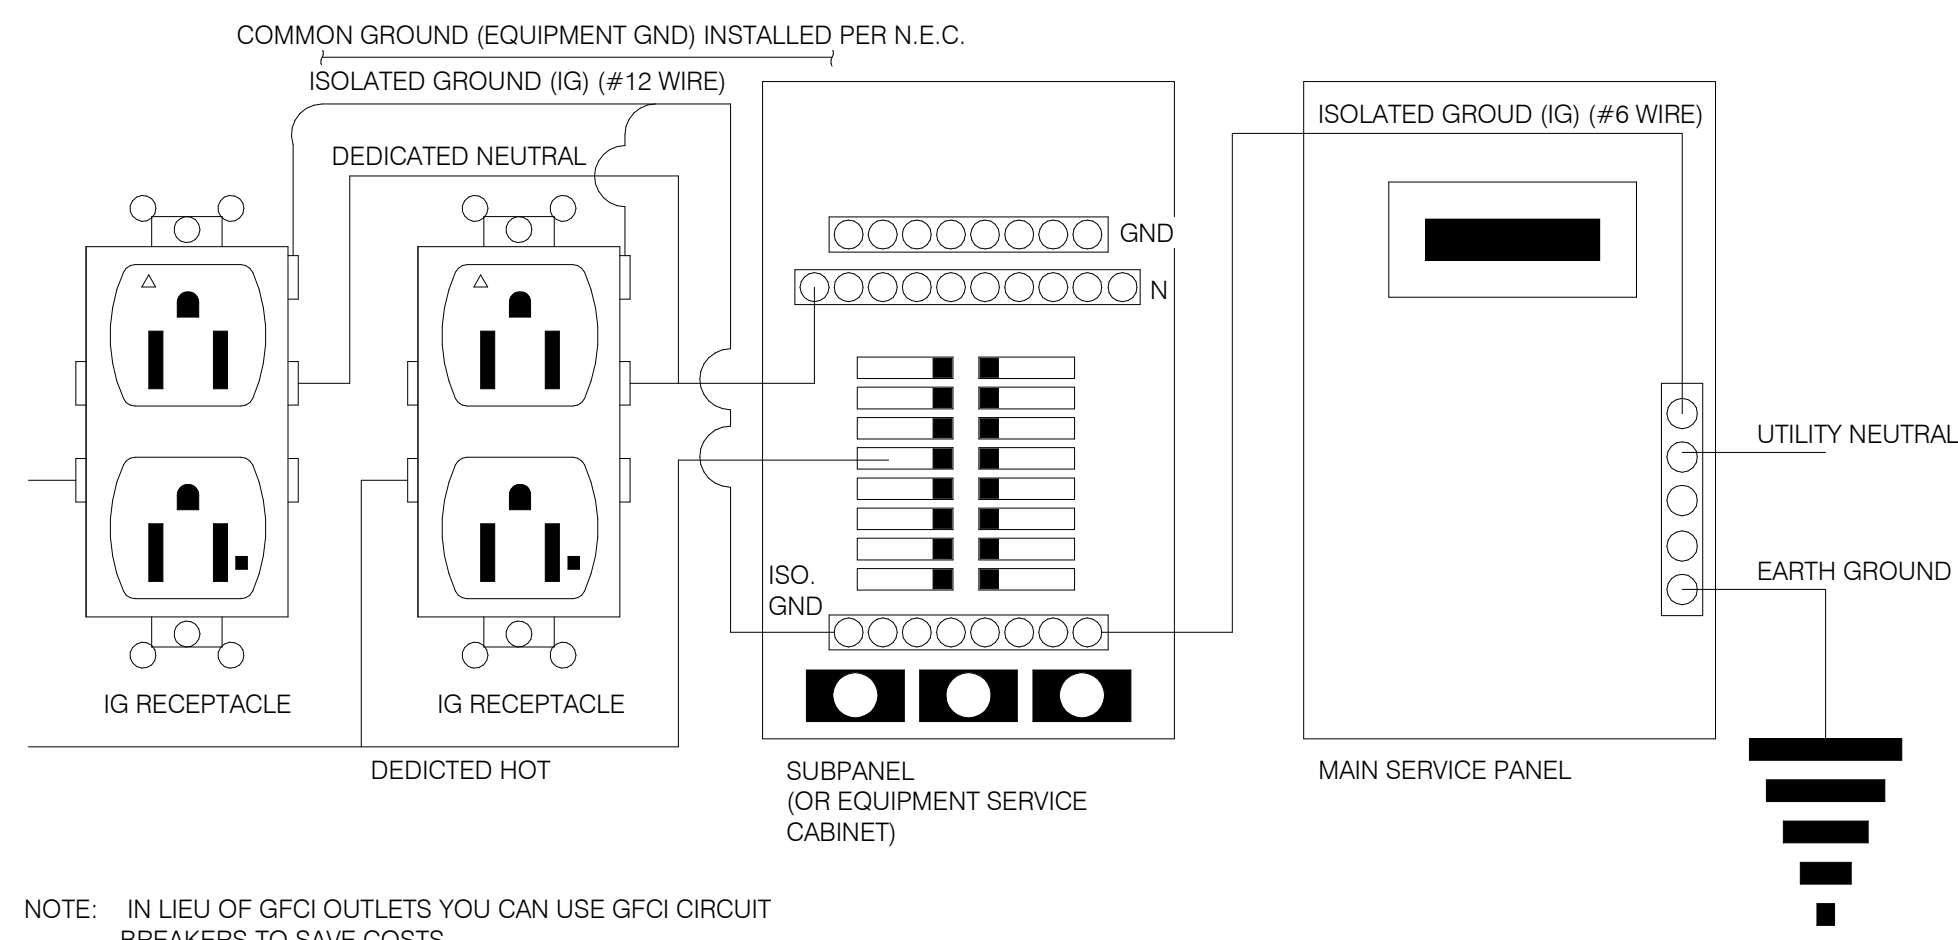


NOTE: IN LIEU OF GFCI OUTLETS YOU CAN USE GFCI CIRCUIT BREAKERS TO SAVE COSTS


P.O.S. ISOLATED GROUND SYSTEM NTS **6**

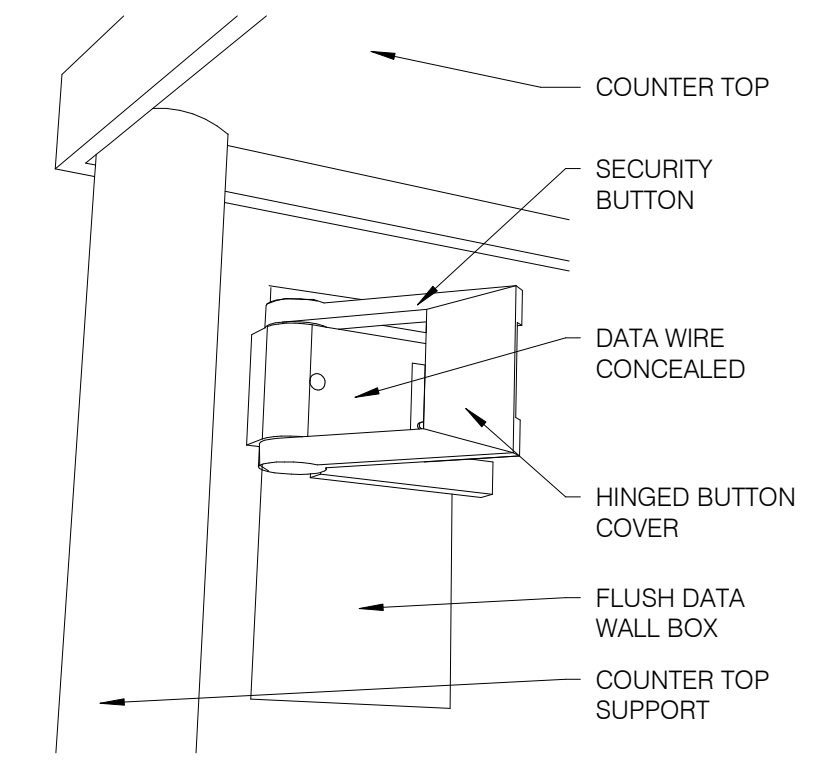


SECURITY BUTTON ON WALL NTS **3**

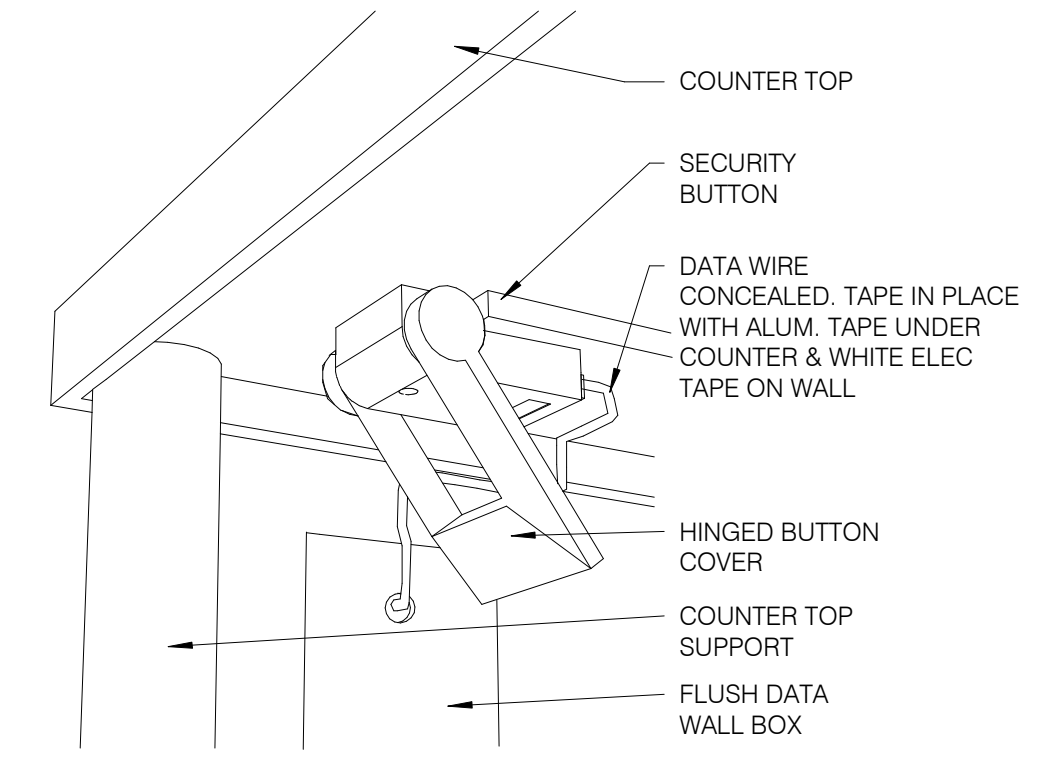

SECURITY BUTTON UNDER COUNTER NTS **4**

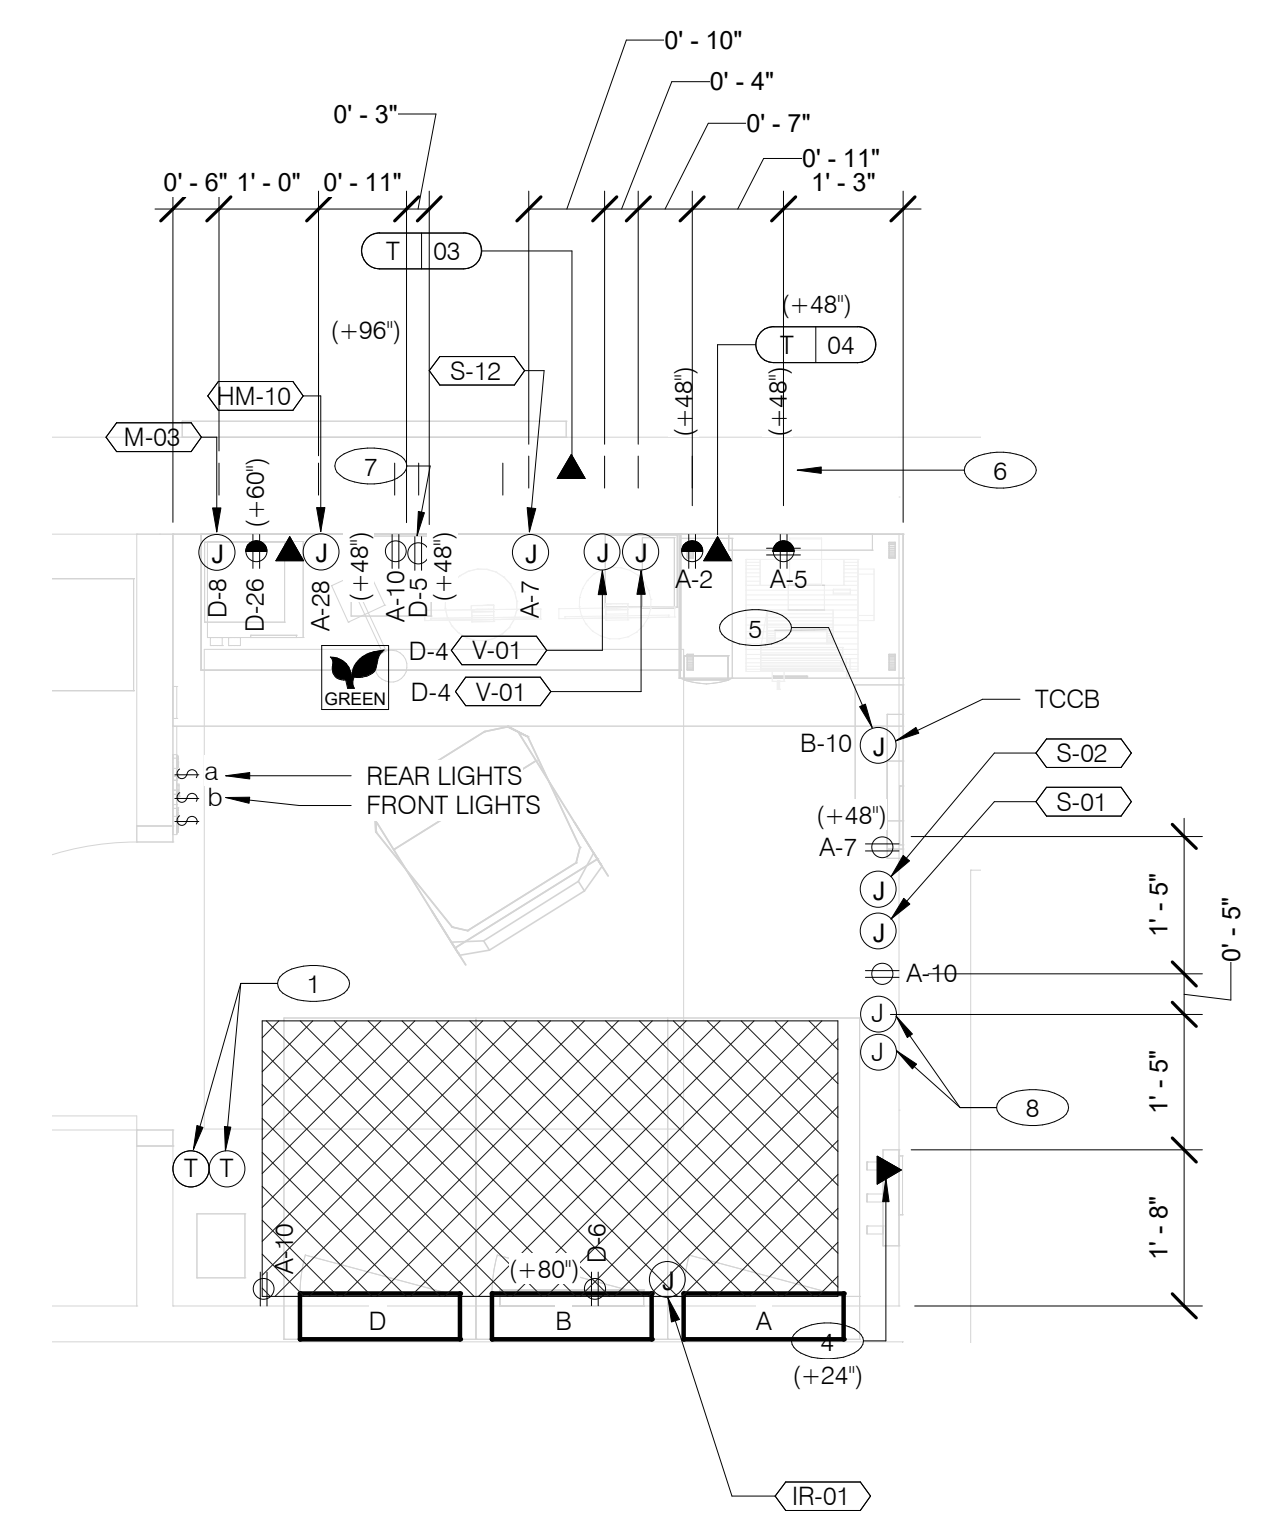

ENLARGED POWER AND COMMUNICATIONS PLAN (OFFICE) 1/2" = 1'-0" **1**

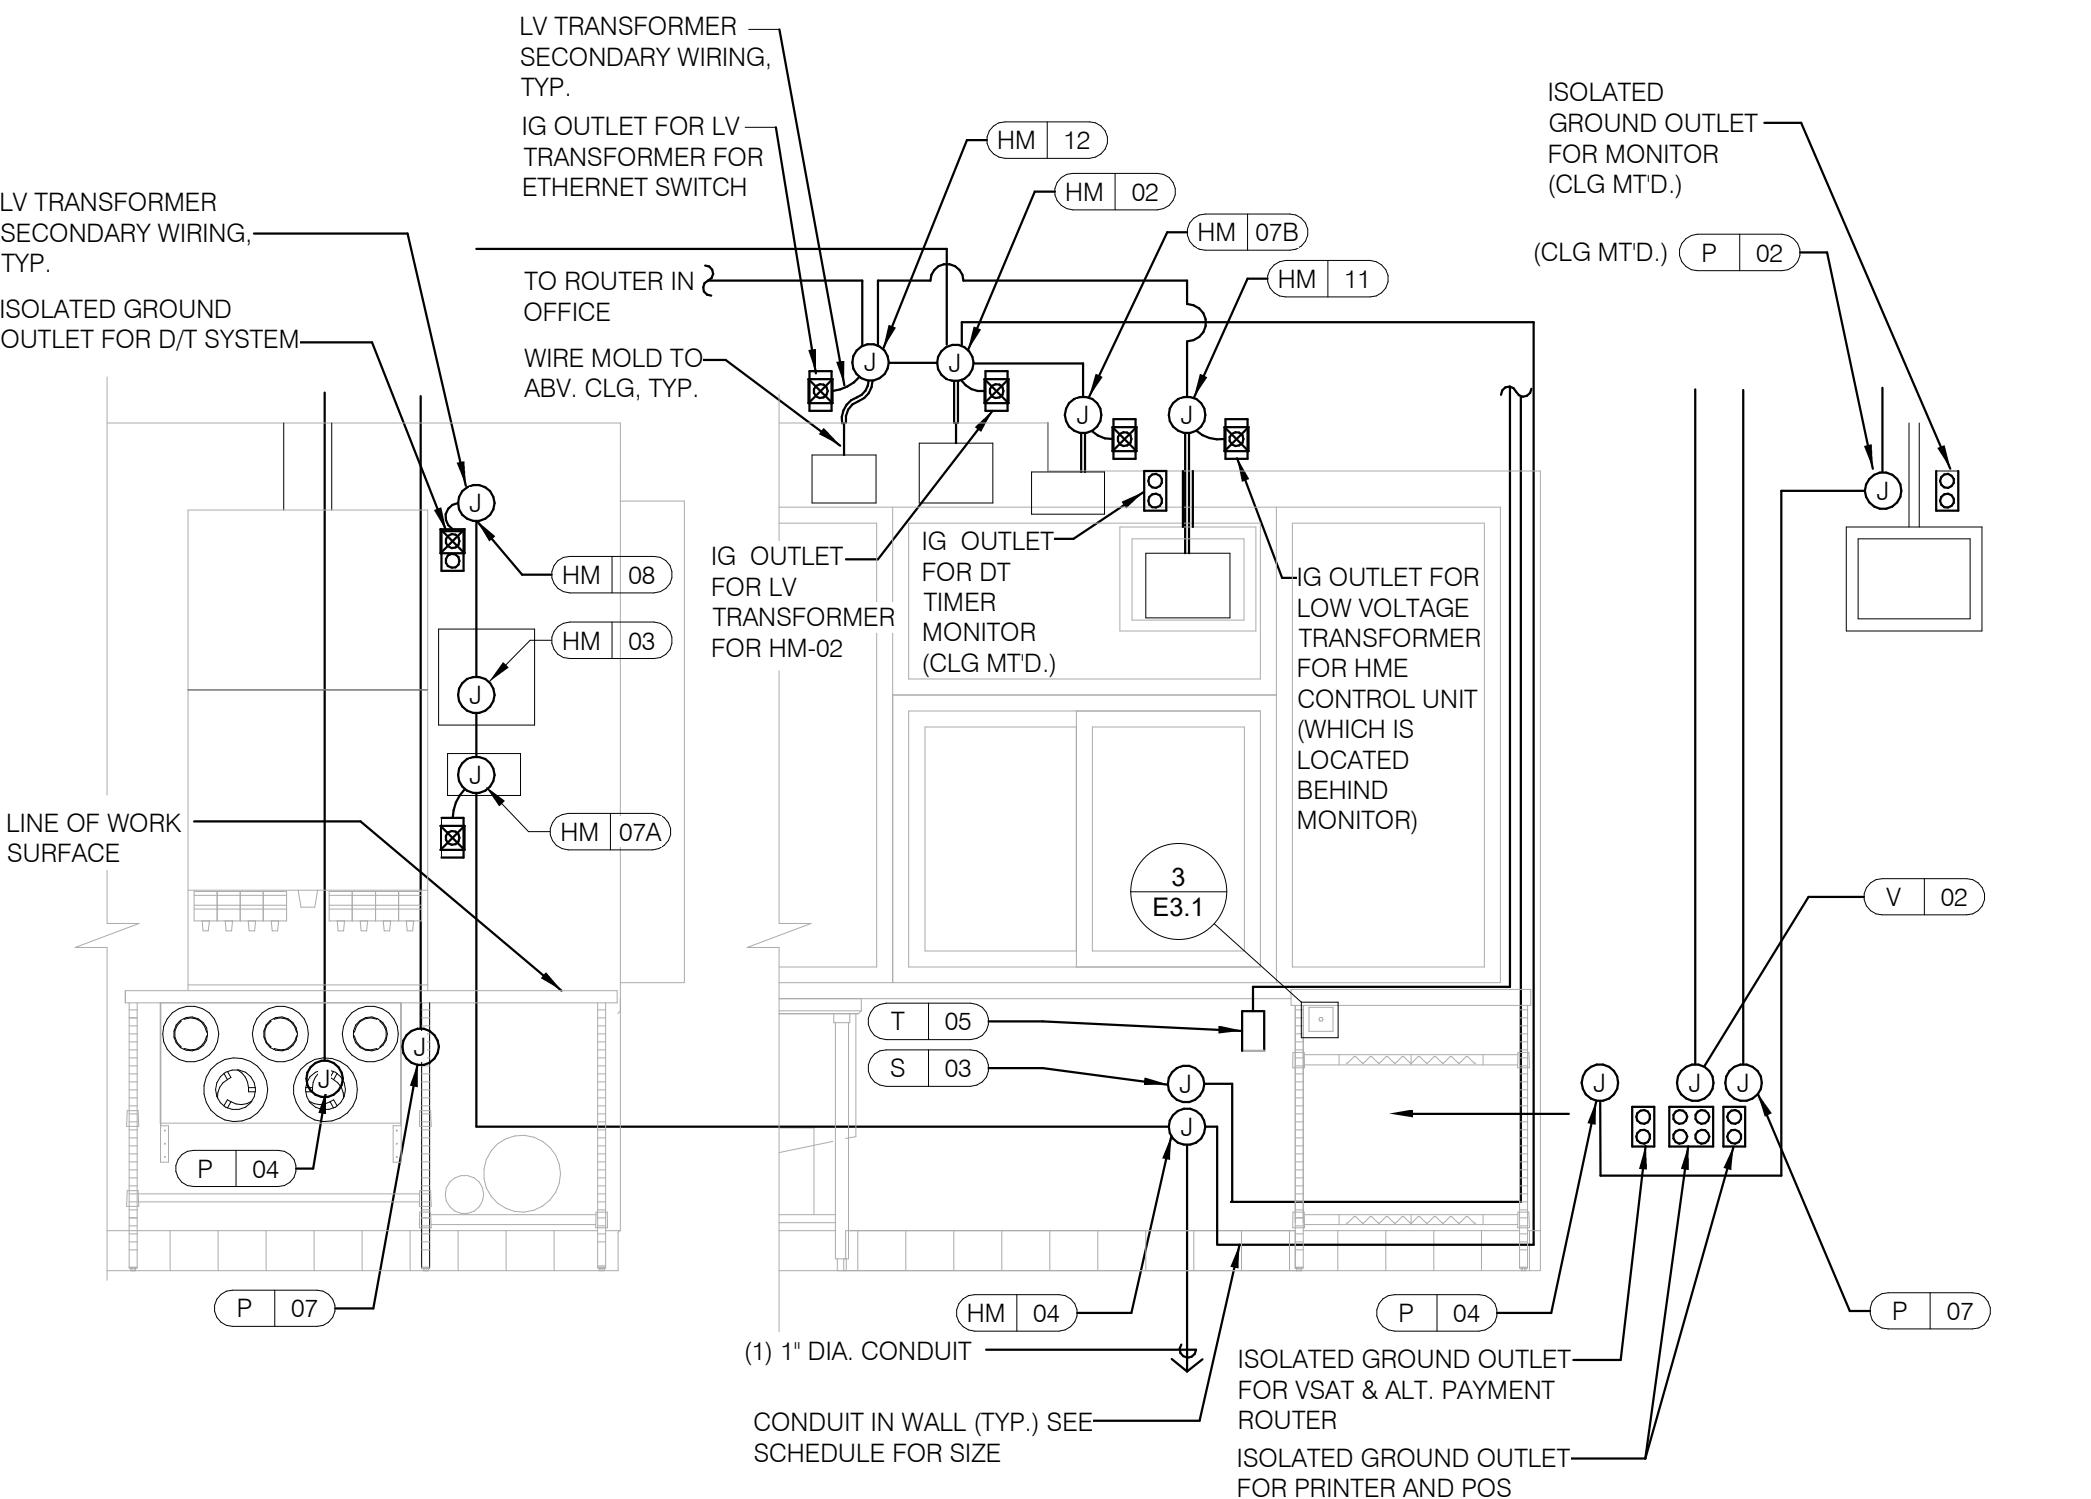

REFER TO COMMUNICATIONS SCHEDULE ON SHEET E5.0 FOR EQUIPMENT DESCRIPTIONS/MOUNTING HTS.

ENLARGED INTERIOR ELEVATION (D/T WINDOW) NTS **7**

NOTE
TBCCB AND TBANS REQUIRE VISUAL INSTALLATION VERIFICATION CERTIFICATE. CONTACT CERTIFY@ACE-BCX.COM OR CALL 949 770 2222 FOR CERTIFICATE. SEE SHEET SW2.0

- 1 THERMOSTATS CONTROLS.
- 2 NOT USED.
- 3 NOT USED.
- 4 PHONE JACK FOR MODEM.
- 5 LOCATION OF TBCCB COMBINED CONTROL BOX. COORDINATE EXACT LOCATION IN THE FIELD. CONSIDER OPERATOR NEED TO ACCESS SWITCHES ON THE FRONT OF THE CONTROL BOX AND BUILT IN OCCUPANCY SENSOR FOR MANAGERS OFFICE.
- 6 DATA JACK FOR TECH-IN-A-BOX WITH 2 PORTS.
- 7 ROUTE CIRCUIT THROUGH TBCCB OCCUPANCY SENSOR FOR CONTROLLED RECEPTACLE.
- 8 PROVIDE BACK-BOX AND CONDUIT WITH PULLSTRING FOR REMOTE TEST STATIONS PROVIDED BY MECHANICAL. COORDINATE REQUIREMENTS WITH MECHANICAL.

KEY NOTES - ELECTRICAL ENLARGED DETAILS NTS **2**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE:	02.28.22
BUILDING TYPE:	END. MED20
PLAN VERSION:	MARCH 2021
BRAND DESIGNER:	DICKSON
SITE NUMBER:	314481
STORE NUMBER:	454078
PA/PM:	SM
DRAWN BY.:	AJR
JOB NO.:	2020088.03



TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236



**ENDEAVOR 2.0
ENLARGED
POWER PLAN
AND DETAILS**

E3.1

PLOT DATE: 11/3/2022 9:59:36 AM

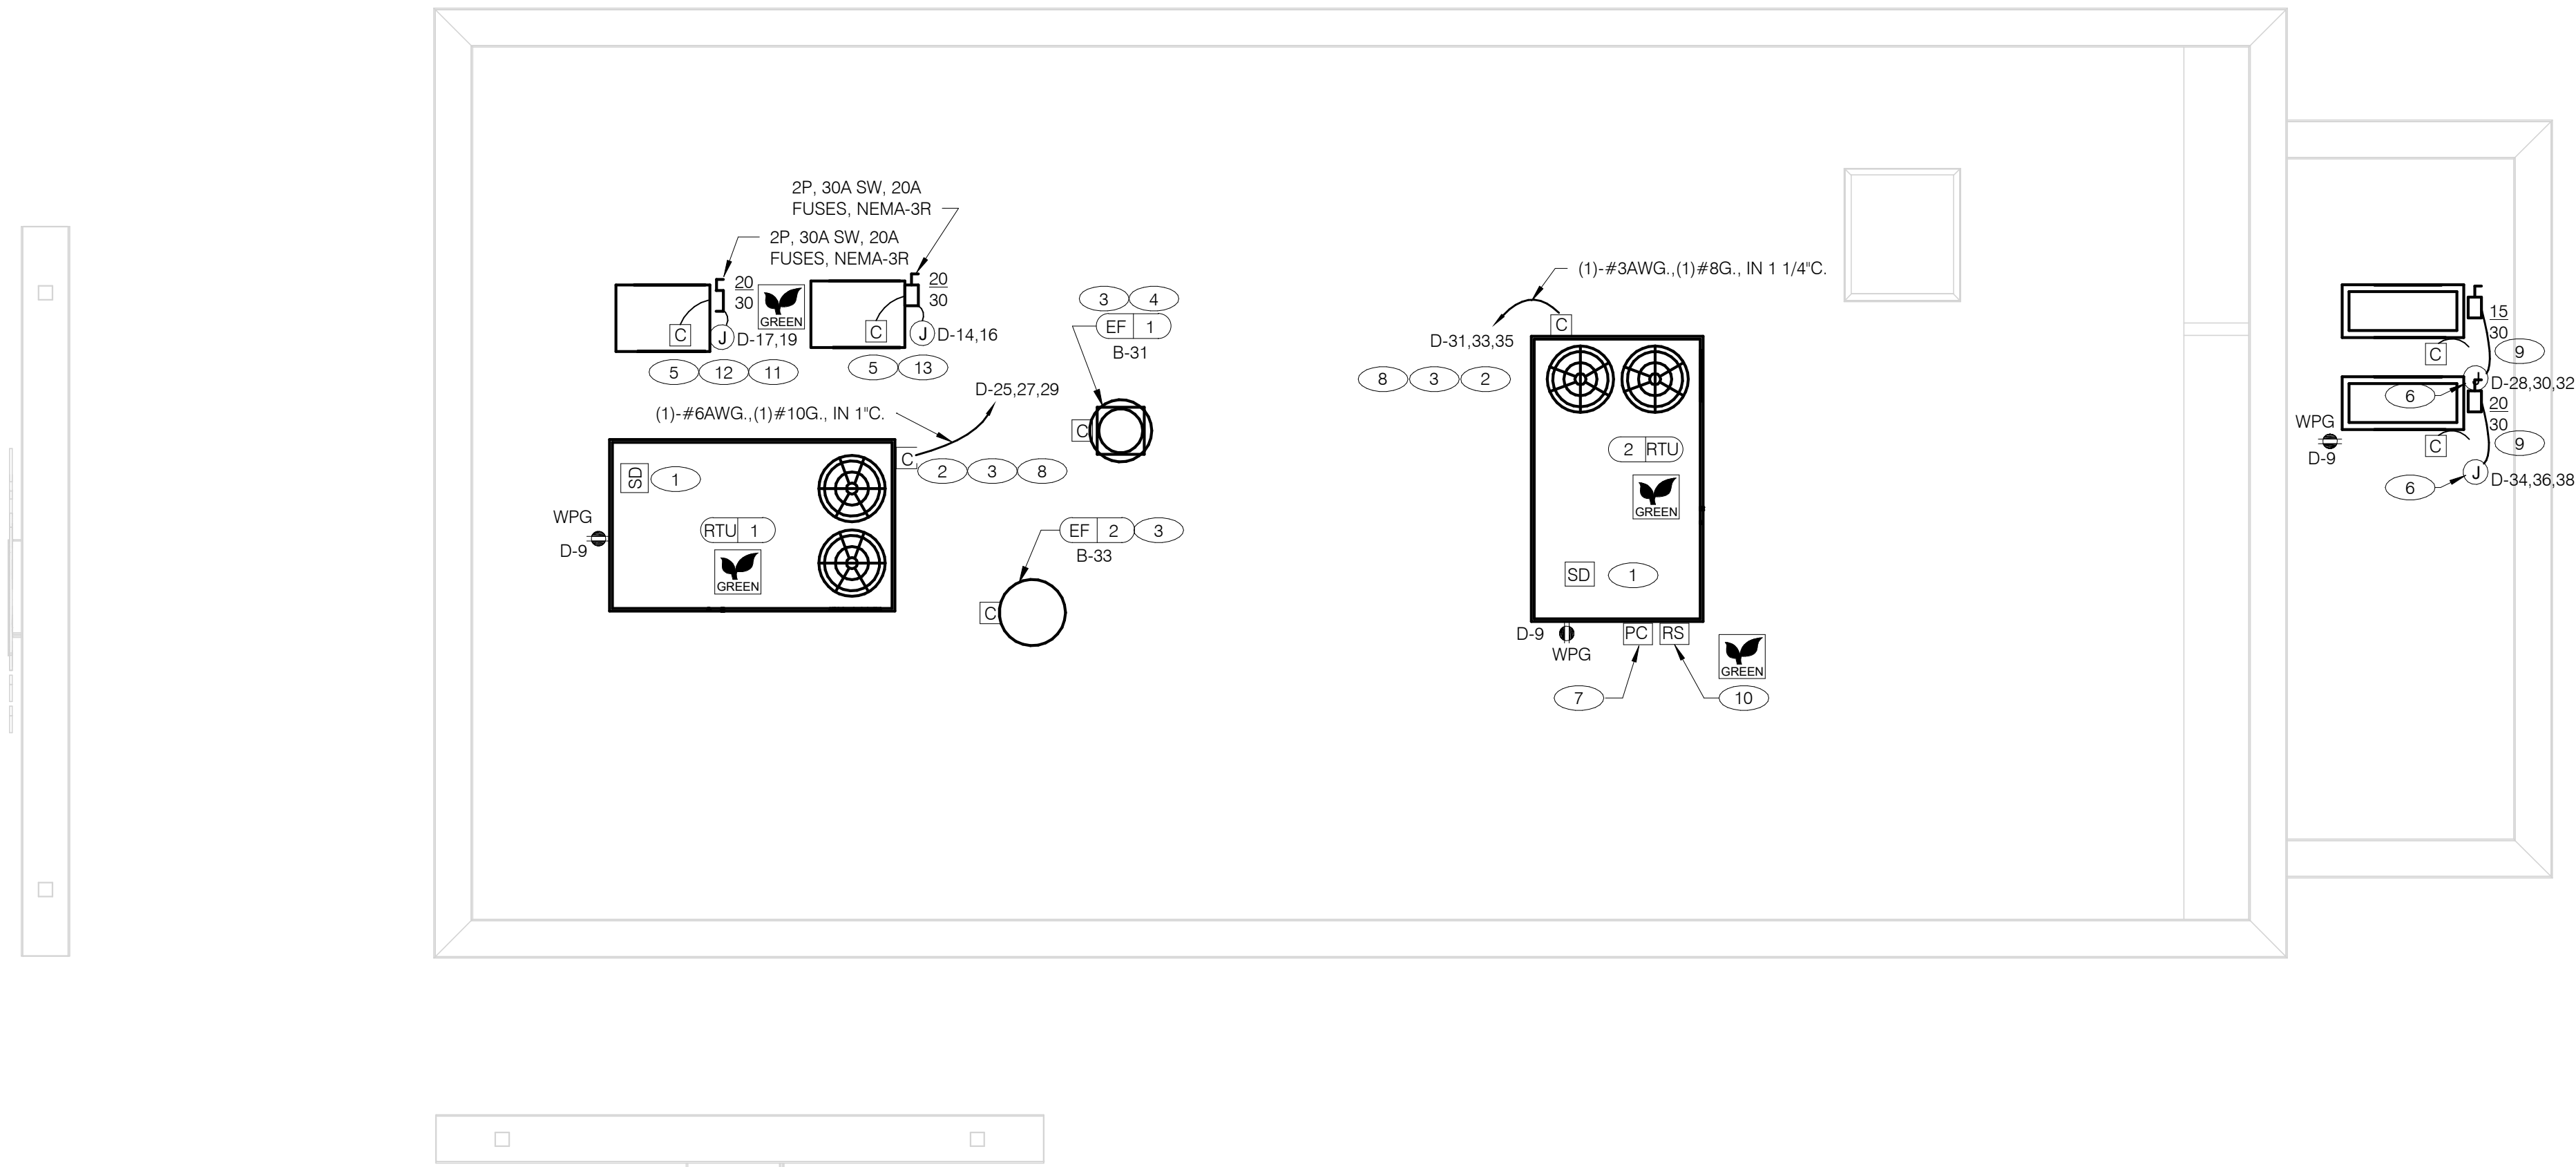

POWER ROOF PLAN 1/4" = 1'-0" **A**

- A. NO CONDUIT SHALL BE FASTENED DIRECTLY TO OR THROUGH ROOFING MEMBRANE.
- B. ALL CUTS IN ROOFING MEMBRANE SHALL BE MINIMAL AND IN ACCORDANCE WITH ROOFING MFRS AND INSTALLER'S REQ'S.
- C. REFER TO MECH. DWGS FOR MECHANICAL EQUIPMENT ELECTRICAL REQ'S.
- D. ALL EXPOSED ELECTRICAL CONDUITS SHALL PENETRATE ROOF MEMBRANE AT PIPE HOODS U.O.N.
- E. REFER TO ELECT. EQUIP. SCHEDULE AND ELECT. ROUGH-IN PLAN.
- F. ALL CONDUITS FROM EXHAUST FANS SHALL BE ROUTED INSIDE OF CURB.
- G. ALL CONDUITS TO AND FROM RTU SHALL BE ROUTED INSIDE OF RTU CURB. COORDINATE WITH RTU MFR RECOMMENDATIONS.
- H. REFER TO GENERAL NOTES SHEET E2.0 FOR IMPORTANT INFORMATION.
- I. ALL WIRING AND CONDUITS SHALL BE CONCEALED, NO CONDUITS PERMITTED TO RUN EXPOSED ACROSS ROOF DECK. ROUTE ALL CONDUITS THROUGH EQUIPMENT ROOF CURBS OR ARCHITECT SPECIFIED ROOF PENETRATIONS.
- J. ARMOR CABLE (BX) IS ONLY TO BE ALLOWED WHERE ACCEPTABLE BY AUTHORITY HAVING JURISDICTION.

- 1 MECHANICAL CONTRACTOR SHALL PROVIDE CONNECTIONS BETWEEN RTU FACTORY SMOKE DETECTORS AND REMOTE ENUNCIATOR. TEST AND RESET DEVICE IN MANAGER OFFICE. ELECTRICAL CONTRACTOR SHALL PROVIDE ANY NECESSARY CONDUITS FOR LOW VOLTAGE WIRING.
- 2 SPECIFIED RTU IS SUPPLIED WITH UNPOWERED, WEATHERPROOF GFCI CONVIENENCE OUTLET AND FACTORY INSTALLED HACR CIRCUIT BREAKER WITH WEATHER TIGHT ENCLOSURES AND ACCESS THRU SWINGING DOOR.
- 3 POWER AND CONTROL IN FLEXIBLE WATERPROOF CONDUIT (LFMC CONDUIT) TO ENTER FROM SIDE OF THE CURB AND UP TO FACTORY PROVIDED DISCONNECT SWITCH. COORDINATE WITH MECHANICAL CONTRACTOR.
- 4 CONNECT TO APPROPRIATE TERMINALS OF TBCCB CONTROL BOX. SEE E6.1 FOR DETAILS.
- 5 1/2" C. WITH REQ'D CONDUCTORS TO J-BOX IN CEILING ABOVE ICE MACHINE. MAKE CONNECTION TO ICE MACHINE AND CONDENSING UNIT.
- 6 REFER TO POWER PLAN FOR CONTINUATION TO COOLER / FREEZER.
- 7 CONNECT TO APPROPRIATE PHOTOCELL TERMINALS OF TBCCB CONTROL BOX. SEE E6.1 FOR DETAILS.
- 8 RTU'S SHALL BE PROVIDED WITH BUILT-IN DISCONNECT AND SINGLE POINT WIRING.
- 9 CONTRACTOR SHALL VERIFY CIRCUIT BREAKER TYPE, STARTER, DISCONNECT SWITCH, AND FUSE SIZE (IF REQUIRED) WITH SELECTED EQUIPMENT MANUFACTURER'S SHOP DRAWINGS PRIOR TO PLACING ORDER AND FURNISH AND INSTALL EVERYTHING AS REQUIRED.
- 10 RAIN SENSOR.
- 11 PIPE HOOD. SEE 9/A6.0
- 12 ELECTRICAL CONTRACTOR SHALL MAKE ALL ELEC. CONNECTIONS INCLUDING ALL NECESSARY INTERCONNECTIONS BETWEEN THE COMPRESSOR ON THE ROOF & THE EVAPORATOR IN THE ICE MACHINE AS REQ'D. REFER TO THE MFR'S SHOP DWGS FOR EXACT INSTALL. & INTERCONNECTION RQMTS. PRIOR TO ROUGH-IN INSTALL.

- 13 1/2" C. WITH REQ'D CONDUCTORS TO J-BOX IN CEILING ABOVE FROZEN BEVERAGE MACHINE. MAKE CONNECTION TO BEVERAGE MACHINE AND ASSOCIATED CONDENSING UNIT.

GENERAL NOTES - ELECTRICAL POWER ROOF PLAN NTS **C**

KEY NOTES - ELECTRICAL POWER ROOF PLAN NTS **B**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: AJR
 JOB NO.: 2020088.03

TACO BELL


18550 E. WARREN AVE.,
DETROIT, MI 48236




**ENDEAVOR 2.0
ELECTRICAL
POWER ROOF
PLAN**

E3.2

PLOT DATE: 11/3/2022 9:59:36 AM

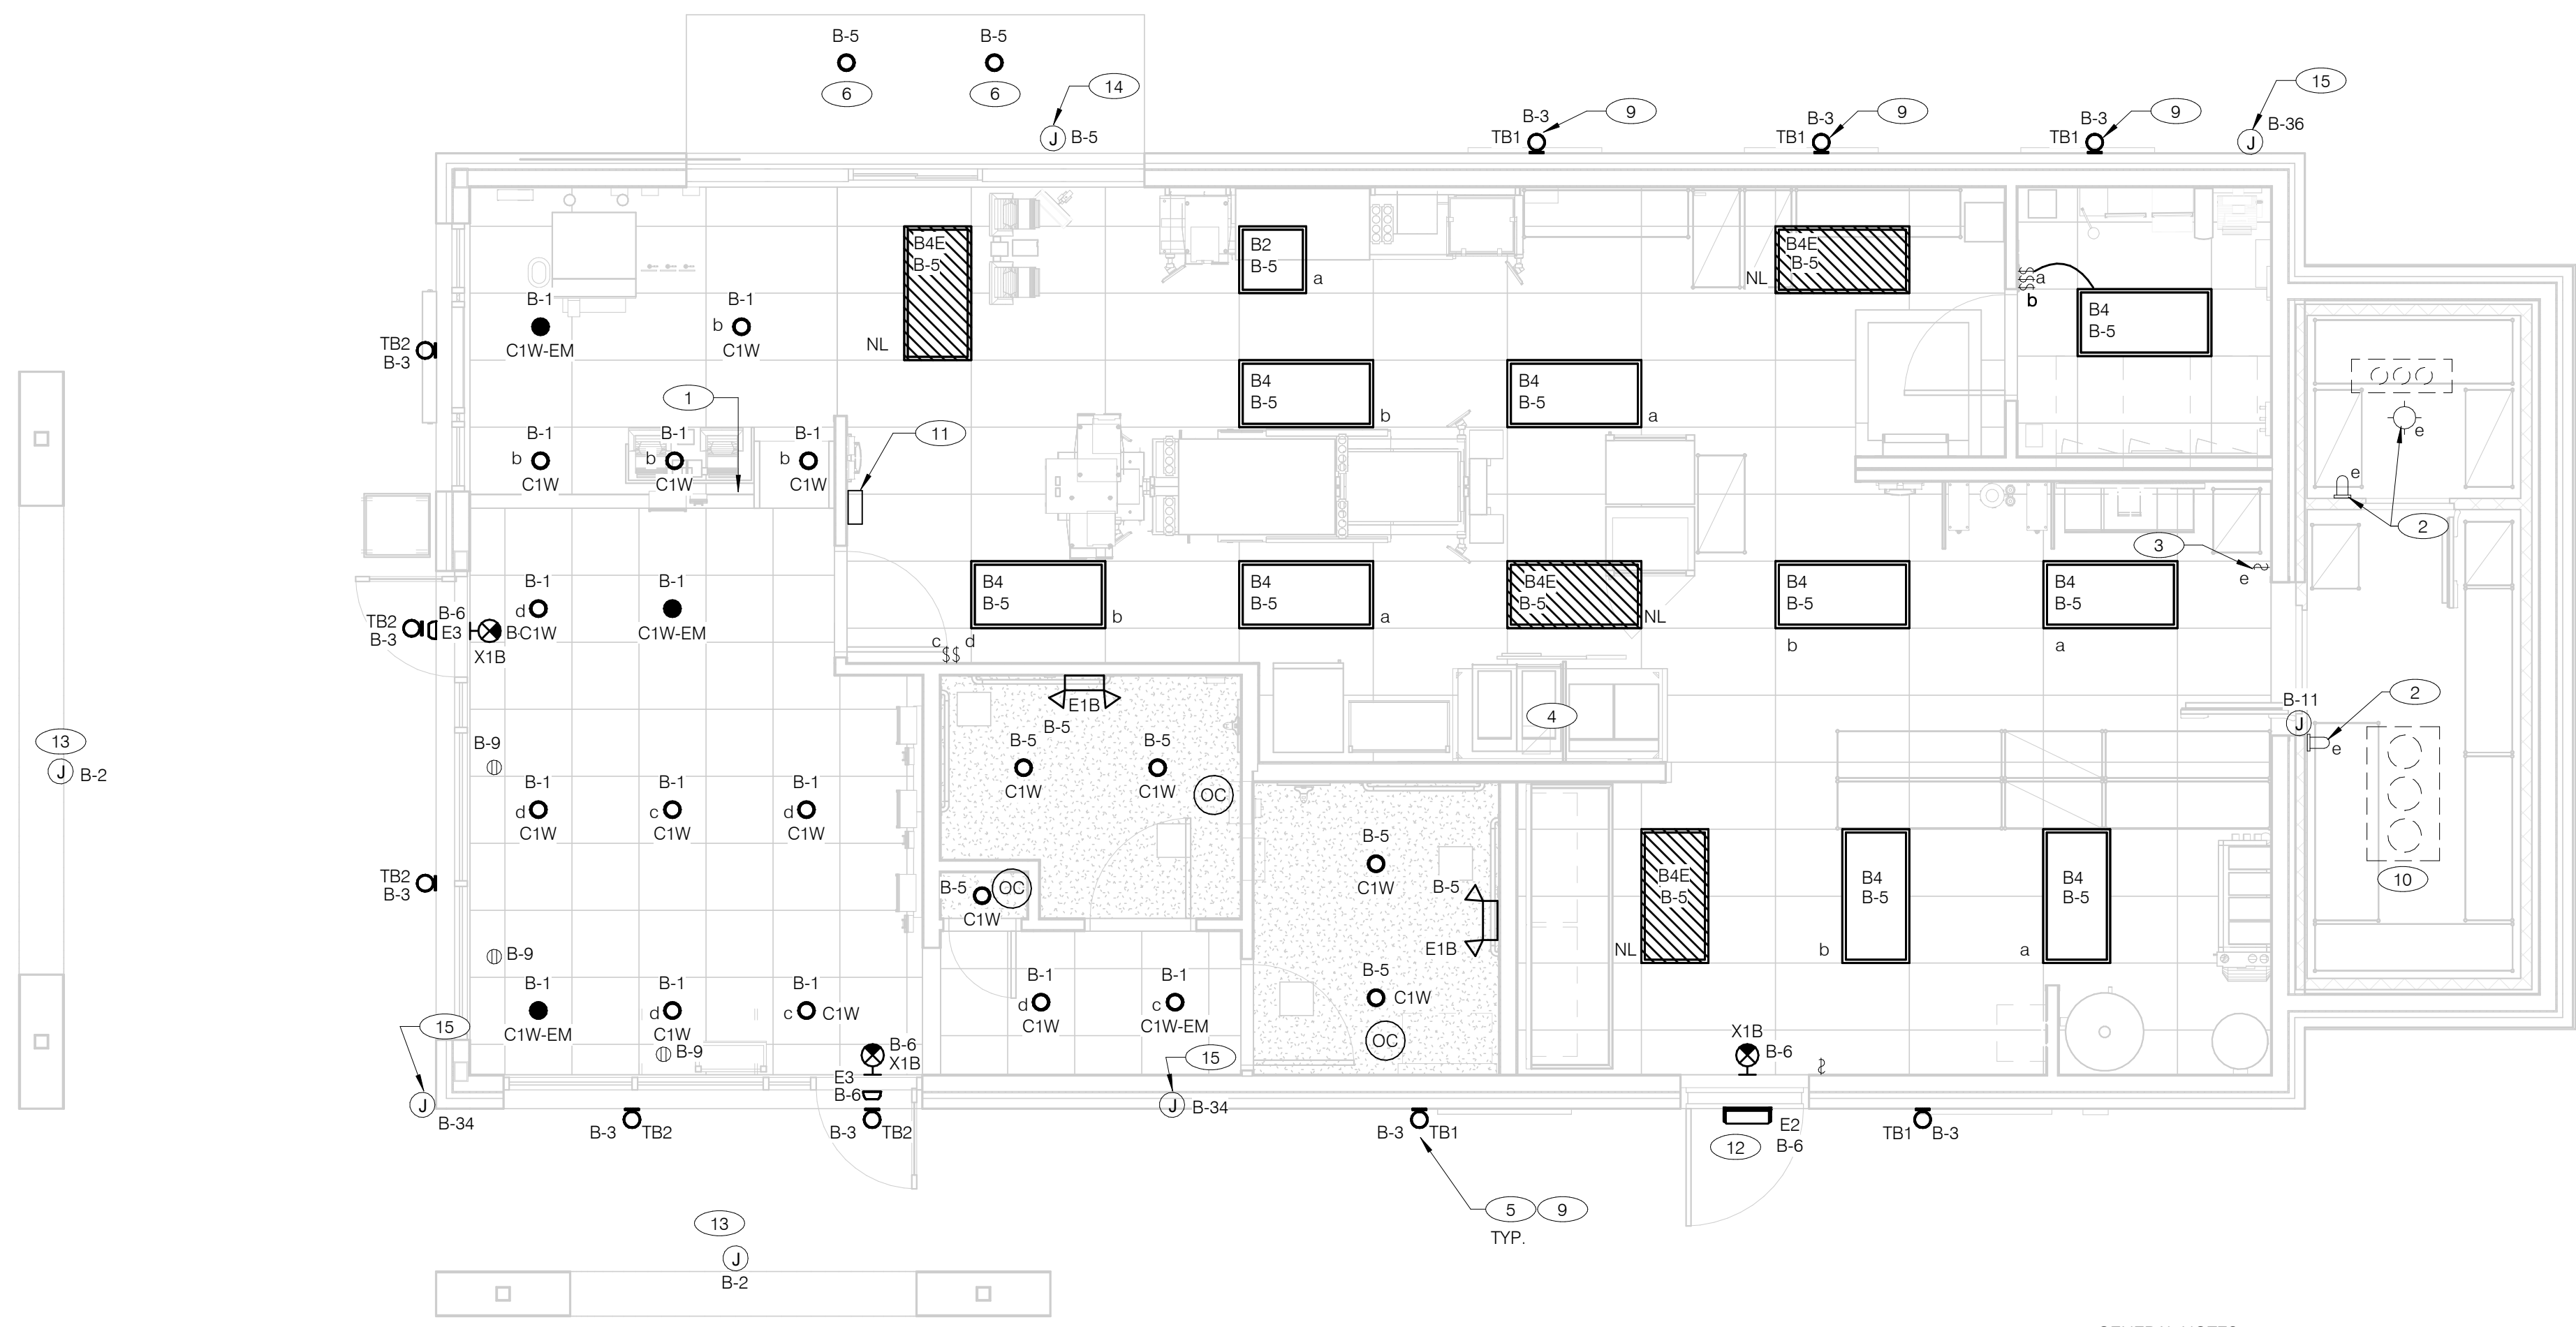

- GENERAL NOTES:
- A. CONFIRM LIGHTING FIXTURE QUANTITIES WITH SUPPLIER.
 - B. EMERGENCY AND NORMAL LIGHTING MARKED WITH "NL" SUBSCRIPT SHALL OPERATE CONTINUOUSLY. PROVIDE UNSWITCHED HOT TO NORMAL AND EMERGENCY BALLAST. EMERGENCY LIGHTING NOT MARKED WITH "NL" SUBSCRIPT SHALL OPERATE UNDER CONTROL OF LIGHTING SWITCH AS INDICATED. PROVIDE UNSWITCHED CONSTANT HOT TO EMERGENCY BALLAST AND SWITCHED HOT TO NORMAL BALLAST.
 - C. ALL CONDUITS ENTERING OR LEAVING COOLER/FREEZER SHALL BE PROVIDED WITH SEAL-OFF FITTING WITH COMPOUND PER NEC 300-77a).
 - D. ALL INTERIOR LIGHTING CIRCUITS TO BE WIRED THROUGH TBCCB. SEE E6.0 AND E6.1.
 - E. CONTRACTOR TO FIELD VERIFY FIXTURE TYPE AND PROVIDE PROPER MOUNTING HARDWARE.
 - F. ALL FIXTURES SUPPLIED WITH LAMPS.
 - G. ALL EXTERIOR NON-EMERGENCY LIGHT FIXTURES, BUILDING SIGNS, AND EXTERIOR SIGNS SHALL BE CONTROLLED THROUGH PHOTOCELL AND LIGHTING CONTROL RELAYS. SEE E6.0 AND E6.1 FOR ADDITIONAL DETAILS.
 - H.



ELECTRICAL LIGHTING PLAN 1/4" = 1'-0" **A**

NO.	MANUFACTURER	CATALOG NUMBER	DESCRIPTION	MOUNTING	LAMP #/TYPE	BALLAST TYPE	ELECTRICAL DATA	REMARKS
A	LSI INDUSTRIES	MRM-LED-12L-SIL-FT-40-70CRI-HL	LED POLE LIGHT	22' LIGHT POLE	LED	NA	120 V/1-187 VA	-
B	LSI INDUSTRIES	MRM-LED-24L-SIL-FT-40-70CRI	LED POLE LIGHT		LED	NA	120 V/1-187 VA	-
B2	ABB	FLP22-D53W40	2X2 LED TROFFER		LED		120 V/1-45 VA	-
B4	ABB	FLP24-D53W40	2X4 LED TROFFER		LED		120 V/1-45 VA	-
B4E	ABB	FLP24-D53W40-EM	2X4 LED TROFFER		LED		120 V/1-45 VA	PROVIDE 90 MIN. BACK UP BATTERY
C1W	MAXLITE	B6IC-AT-W-LED14DR5630KB95	LED TRIM 14W 6" RECESSED 30K 80CRI WHITE TRIM, W/ ELITE B6IC-AT-W 6" IC AIR SHUT HOUSING		LED		120 V/1-14 VA	-
C1W-EM	MAXLITE	B6IC-AT-W-LED14DR5630KB95	LED TRIM 14W 6" RECESSED 30K 80CRI WHITE TRIM, W/ ELITE B6IC-AT-W 6" IC AIR SHUT HOUSING		LED		120 V/1-14 VA	PROVIDE 90 MIN. BACK UP BATTERY
E1B	ELITE	ELM-809-B	EMERGENCY LIGHT FROG EYE - BLACK	WALL, TOP @ 9'-4" U.O.N.	-	EM	120 V/1-12 VA	-
E2	ELITE	ELM-807-SDT-BZ	CAMRAY LED EM WALL MNT, DRK BRNZ, CLD WEATHER	UNIVERSAL	-	EM	120 V/1-16 VA	-
E3	LITHONIA	AFF-PEL-DDBTXD-UVOLT-LTP-SDR T-WT-CW	SELF-POWERED EMERGENCY WALLPACK W/ PHOTOCELL	8'-6"	LED	EM	120 V/1-20 VA	-
TB1	ConTech Lighting	CY6130KMVDWXXXW-B	6" WALL CYLINDER, DOWNLIGHT - WALLWASH	SEE EXTERIOR ELEVATIONS	10W INTEGRATED LED		120 V/1-10 VA	-
TB2	ConTech Lighting	CY6130KMVDWXXWCLR-B	6" WALL CYLINDER, DOWNLIGHT - WIDE BEAM		10W INTEGRATED LED		120 V/1-10 VA	-
X1B	LIGHTALARMS	GRANNRB	LED UNIVERSAL MNTG THERMOPLASTIC EXIT, RED LETTERS, BLACK HSNG	UNIVERSAL	-LED	EM	120 V/1-3 VA	-

- 1 PRE-FABRICATED & PRE-FINISHED SOFFIT. REFER TO A7.1 FOR SPECIFICS. (OPTIONAL).
- 2 FOR LIGHTING FIXTURES, CONDUIT, CONDUCTORS AND INSTALLATION RESPONSIBILITIES, REFER TO SCOPE OF WORK.
- 3 FIXTURE AND SWITCH FACTORY INSTALLED WITH UNIT. G.C. TO COMPLETE CIRCUITING.
- 4 EXHAUST HOOD LIGHT FIXTURES SUPPLIED WITH HOOD AND MTD IN PRE-WIRED J-BOX. COMPLETE CIRCUITING PER SHEET E6.1.
- 5 COORD. J-BOX LOCATION WITH WOOD FRAMING SO IT REMAINS CONCEALED BEHIND FIXTURE. VERIFY MOUNTING HEIGHT WITH ARCH. DWGS.
- 6 PROVIDE POWER TO DRIVE THRU CANOPY LIGHTING FIXTURES. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH CANOPY VENDOR AND CONSTRUCTION SUPERVISOR PRIOR TO CONNECTIONS.
- 7 NOT USED.
- 8 NOT USED.
- 9 REFER TO ARCHITECTURAL EXTERIOR ELEVATIONS ON A4.0 AMD A4.1 FOR DIMENSIONED LOCATION OF FIXTURE.
- 10 SEAL ALL ELECTRICAL CONDUITS INTO THE WALK-IN COOLER.
- 11 ALERT LIGHT - ONLY APPLIES WHEN A GEN IV POWER SOAK IS USED. DISREGARD IF GEN III POWER SOAK IS USED. SEE SHEET E3.0 FOR POWER REQUIREMENTS.
- 12 MOUNT "E3" AT 8'-6" A.F.G. TO CENTER OF FIXTURE.
- 13 VERIFY POWER CONNECTION AND POWER REQUIREMENTS WITH MANUFACTURER AND SIGN VENDOR.
- 14 PROVIDE POWER CONNECTION TO CANOPY AT FACTORY INSTALLED DISCONNECT SWITCH FOR CANOPY LIGHTS. LIGHTS ARE FURNISHED WITH CANOPY. PROVIDE ALL REQUIRED FIELD WIRING. COORDINATE REQUIREMENTS WITH MANUFACTURER.
- 15 PROVIDE POWER CONNECTION TO PURPLE WALLWASH LIGHTS FURNISHED BY SIGN VENDOR. PROVIDE ALL REQUIRED FIELD WIRING. CONTROL FIXTURES WITH EXTERIOR LIGHTING FIXTURES. COORDINATE EXACT LOCATIONS WITH ARCHITECTURAL ELEVATIONS. COORDINATE REQUIREMENTS WITH VENDOR.

KEY NOTES - ELECTRICAL LIGHTING PLAN AND SCHEDULE NTS **B**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: AJR
 JOB NO.: 2020088.03

TACO BELL


18550 E. WARREN AVE.,
DETROIT, MI 48236




ENDEAVOR 2.0 LIGHTING PLAN AND DETAILS

E4.0

PLOT DATE: 11/3/2022 9:59:38 AM

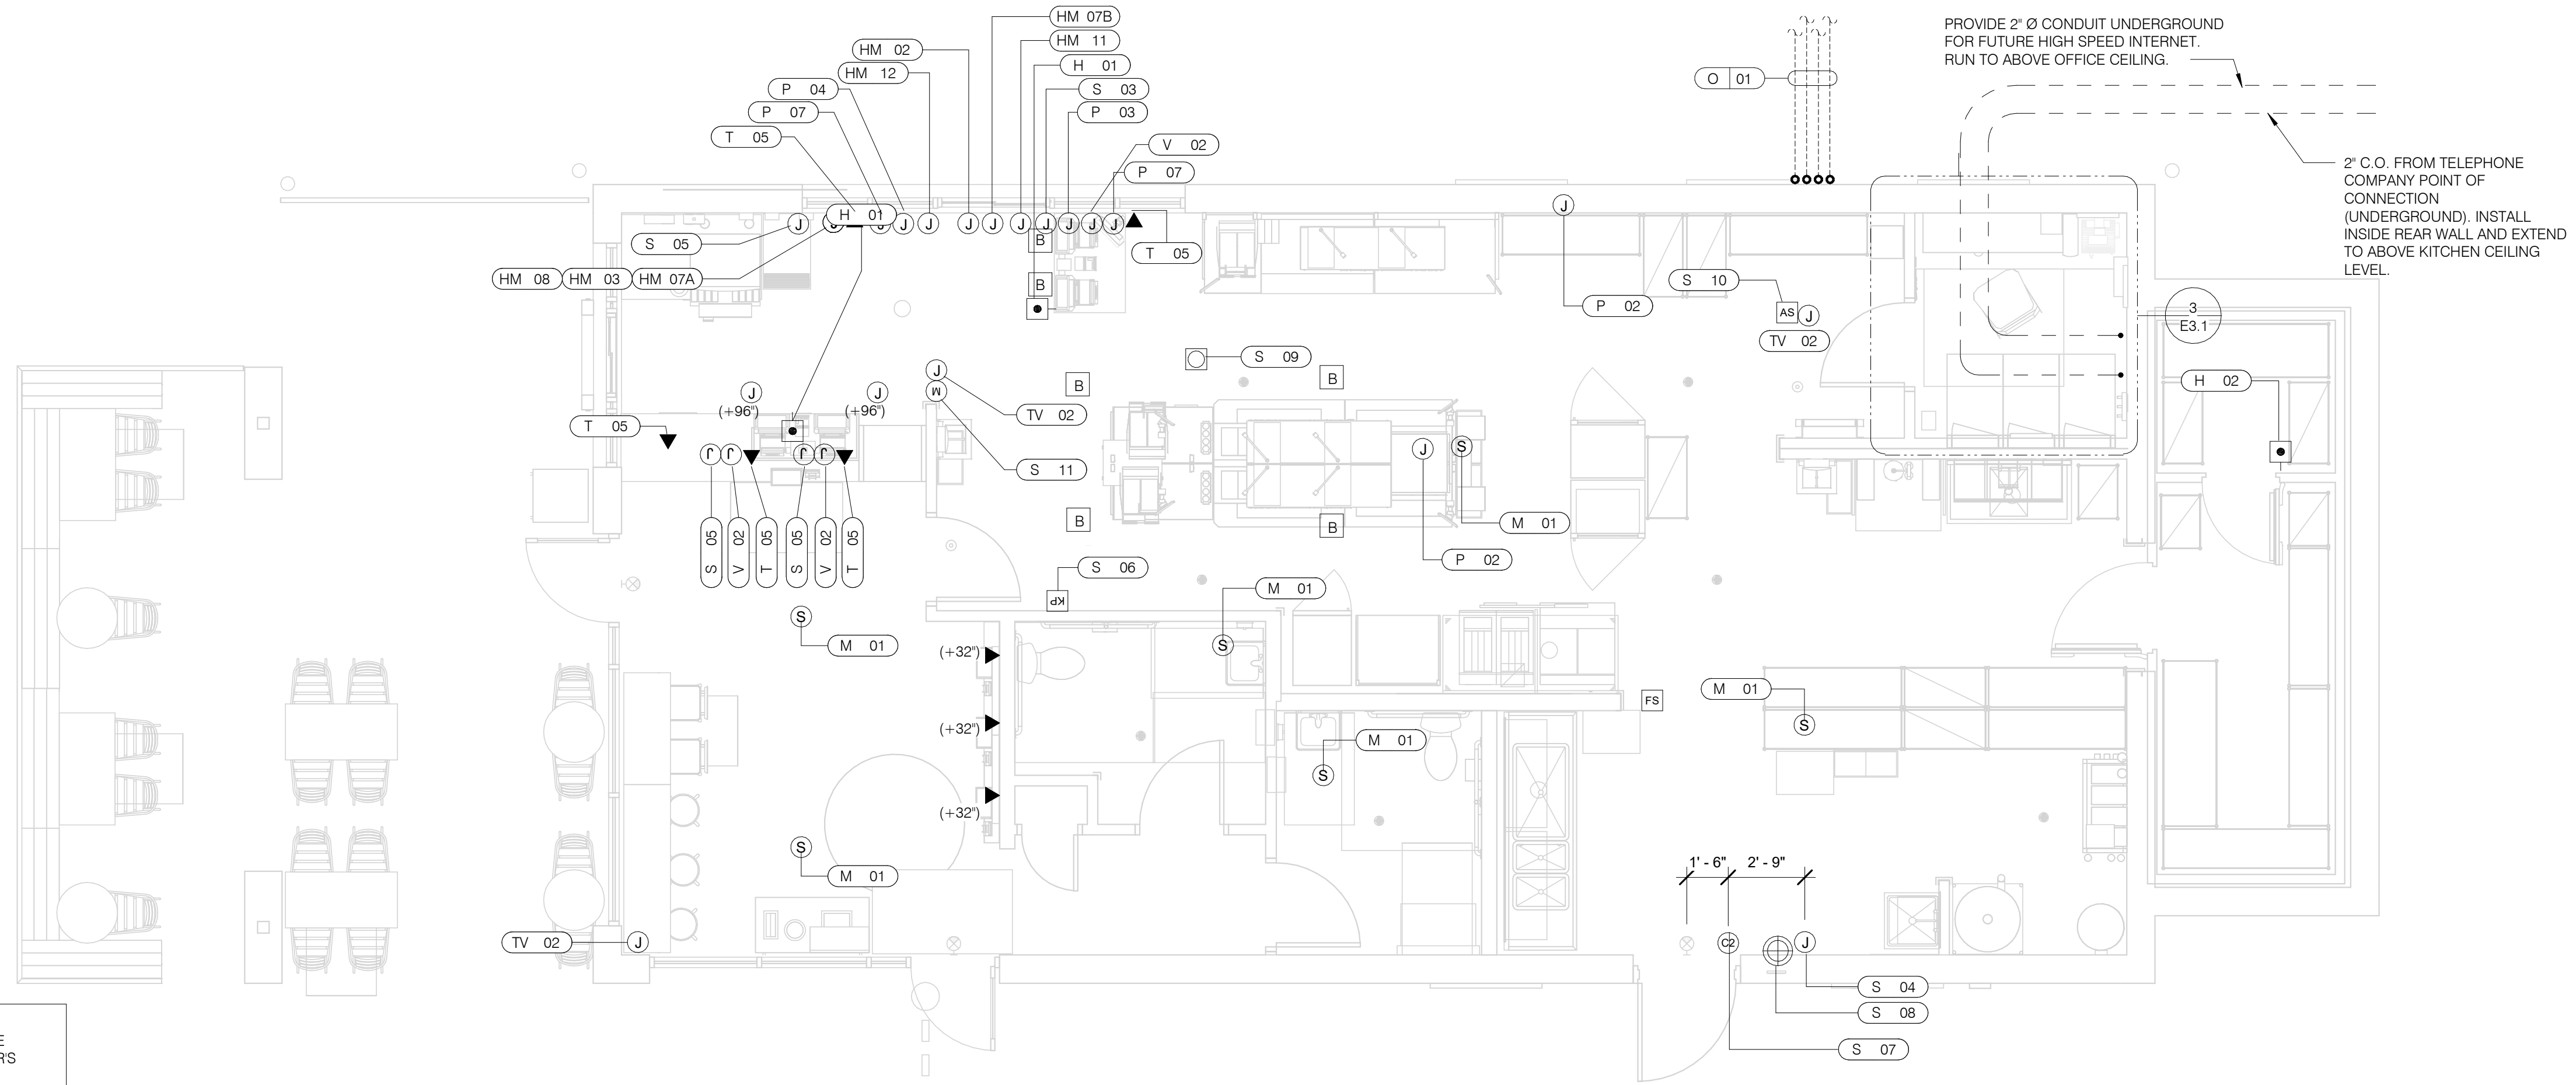

VOLUME CONTROL NOTES:
1) PATIO SPEAKER: DEDICATED WALL-MOUNT VOLUME CONTROL IN LOCATION OF HEAD-END (TYP. MANAGERS OFFICE).
2) DINING ROOM SPEAKERS: DEDICATED WALL-MOUNT VOLUME CONTROL IN LOCATION OF HEAD-END (TYP. MANAGERS OFFICE).
3) KITCHEN SPEAKERS: IF CONNECTED TO THE SOUND SYSTEM, CAN EITHER HAVE VOLUME CONTROL BUILT INTO THE SPEAKER ITSELF, OR HAVE A THIRD DEDICATED WALL-MOUNT VOLUME CONTROL IN LOCATION OF HEAD-END (TYP. MANAGERS OFFICE).
4) RESTROOM SPEAKERS: VOLUME CONTROL BUILT INTO SPEAKER.



COMMUNICATIONS PLAN 1/4" = 1'-0" **A**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: AJR
JOB NO.: 2020088.03

TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236



ENDEAVOR 2.0 COMMUNICATIONS PLAN

E5.0

PLOT DATE: 11/3/2022 9:59:40 AM

COMMUNICATIONS ROUGH-IN SCHEDULE

COMM. TYPE	COMM. #	EQUIPMENT ITEM	ELEVATION	REMARKS
H	01	UNDER COUNTER HOLD-UP BUTTON		SEE DETAIL 6/E3.1.
H	02	WALL MOUNTED HOLD-UP BUTTON	+18" A.F.F.	SURFACE MTD. 2X4 J-BOX ON INSIDE OF WALK-IN FREEZER HINGE WALL W/ (1) 1/2" CONDUIT TO ABOVE KITCHEN CEILING. BUTTON FACING DOWN. SEE DETAIL 3/E3.1
HM	02	D/T TIMER SIGNAL PROCESSOR J-BOX	+126" A.F.F.	4X4X4" DEEP (MIN.) J-BOX ABV. CLG. W/ (1) 1" CONDUIT TO HM-07B, (1) 1" CONDUIT TO HM-04, (1) 1-1/2" CONDUIT TO HM-08 & (1) 1" CONDUIT TO HM-12. SEE DET. 5/E3.1.
HM	03	D/T BASE STATION J-BOX	+72" A.F.F.	4X4 J-BOX @ D/T BASE STATION W/ (1) 1-1/2" C TO HM-08 & (1) 1-1/2" C TO HM-07A. SEE DETAIL 7/E3.1.
HM	07A	D/T TIMER DISPLAY J-BOX	+62" A.F.F.	2X4 J-BOX W/ (1) 1-1/2" CONDUIT TO HM-03 & (1) 1" C TO HM-04. SEE DETAIL 7/E3.1.
HM	07B	D/T TIMER DISPLAY J-BOX	+126" A.F.F.	2X4 J-BOX ABV. CEILING W/ (1) 1" CONDUIT TO HM-02. SEE DETAIL 7/E3.1.
HM	08	D/T J-BOX	+96" A.F.F.	4X4X4" DEEP (MIN.) J-BOX W/ (1) 1-1/2" CONDUIT TO HM-03 & (1) 1-1/2" CONDUIT TO HM-02. SEE DETAIL 7/E3.1.
HM	11	D/T CONTROL UNIT J-BOX	+126" A.F.F.	2X4 J-BOX ABV. CEILING W/ (1) 1" CONDUIT TO HM-12. SEE DETAIL 7/E3.1.
HM	12	D/T/ ETHERNET SWITCH J-BOX	+126" A.F.F.	2X4 J-BOX ABV. CEILING W/ (1) 1" CONDUIT TO HM-11, (1) 1" CONDUIT TO HM-02 & (1) 1" CONDUIT TO OFFICE ROUTER.
M	01	SPEAKER, CEILING MOUNTED	CEILING	SPEAKER WIRING FROM SPEAKERS IN DINING ROOM TO AMPLIFIER IN OFFICE. FOR EXACT LOCATION OF SPEAKERS, SEE LIGHTING PLAN SHEET E4.0.
P	02		CEILING	2X4 J-BOX FLUSH @ CEILING. FOR M.A.P.S. LINE MONITOR J-BOX.
P	03	KITCHEN MONITOR J-BOX	+84" A.F.F.	2X4 J-BOX W/ (1) 3/4" CONDUIT TO ABOVE CEILING
P	04	BUMP PAD J-BOX	+24" A.F.F.	2X4 J-BOX W/ (1) 3/4" CONDUIT TO P-03.
P	07	POS J-BOX W/ 2-1/2" DIA HOLE IN COVER PLATE	+24" A.F.F.	6X6X4" DEEP J-BOX W/ 2-1/2" CONDUIT IN WALL TO ABV. CEILING, WITH PULL STRING FOR POS.
S	03	J-BOX SECURITY SYSTEM	+30" A.F.F.	2X4 J-BOX W/ (1) 1/2" CONDUIT TO ABV. CLG. FOR HOLD-UP BUTTON SIGNAL WIRE.
S	04	J-BOX SECURITY SYSTEM	+84" A.F.F.	2X4 J-BOX W/ COVER & (1) 1/2" CONDUIT TO ABOVE CEILING.
S	05		+24" A.F.F.	2X4 J-BOX W/ 3/4" CONDUIT TO S-05 AND TO ABOVE CEILING.
S	06	J-BOX SECURITY SYSTEM	+48" A.F.F.	2X4 J-BOX W/ (1) 1/2" CONDUIT TO ABOVE CEILING FOR SECURITY SYSTEM KEYPAD.
S	07	J-BOX SECURITY SYSTEM	TOP OF JAMB	2X4 J-BOX W/ (1) 1/2" CONDUIT TO ABOVE CEILING FOR DOOR CONTACT.
S	08	"SOUND ALERT" DEVICE	CEILING	CONNECT TO SECURITY SYSTEM.
S	09	SECURITY STROBE LIGHT	CEILING	CONNECT TO SECURITY SYSTEM.
S	10	ALARM SIREN	ABV. CEILING	CONNECT TO SECURITY SYSTEM.
S	11	MOTION / HEAT DETECTOR	+78" A.F.F.	STUB 1/2" CONDUIT. D5835 OR D5820. MOUNT 90" A.F.F. FOR OFFICE

COMMUNICATIONS ROUGH-IN SCHEDULE

COMM. TYPE	COMM. #	EQUIPMENT ITEM	ELEVATION	REMARKS
T	03	VOICE LINE PHONE JACK	+42" A.F.F.	2X4 J-BOX W/ DOUBLE RJ-11 PHONE JACK & 1" CONDUIT TO ABOVE CEILING.
T	04	COMPUTER LINE PHONE JACK	+42" A.F.F.	2X4 J-BOX W/ RJ-11 PHONE JACK AND 1" CONDUIT TO ABOVE CEILING.
T	05		+24" A.F.F.	2X4 J-BOX W/ 1" CONDUIT TO ABOVE CEILING.
TV	02	SECURITY CAMERA	+96" A.F.F.	MINI-DOME CAMERA MTD. TO BTM. OF MENU BOARD BULKHEAD. 2X4 J-BOX W/ (1) 1/2" CONDUIT TO ABOVE CEILING MTD. ON BACK SIDE OF BULKHEAD (6 TOTAL).
V	02	CREDIT CARD READER (VSAT)	+24" A.F.F.	2X4 J-BOX W/ 1/2" CONDUIT TO ABOVE CEILING FOR ETHERNET CABLES.
S	01	J-BOX SECURITY SYSTEMS	+48" A.F.F.	4X4 J-BOX AT SECURITY SYSTEM CONTROL PANEL W/ (1) 2" CONDUIT TO S-02
S	02	J-BOX SECURITY SYSTEMS	+106" A.F.F.	4X4 J-BOX ADJACENT TO T-02 W/ (1) 2" CONDUIT TO S-01
S	12	J-BOX SECURITY DVR	+42" A.F.F.	2X4 J-BOX FOR SECURITY DVR
T	02	SECURITY SYSTEM PHONE JACK	+106" A.F.F.	2X4 J-BOX ADJACENT TO S-02 W/ RJ-31X PHONE JACK
V	01	ALTERNATE PAYMENT ROUTER BOX	+90" A.F.F.	4X4 J-BOX W/ 1/2" CONDUIT TO ABOVE CEILING FOR ETHERNET CABLES (DOUBLE JACK)
HM	10	OCB SWITCH	+52" A.F.F.	2X4 J-BOX W/ 1" CONDUIT TO ABOVE CEILING
IR	01	IRRIGATION TIMER	+80" A.F.F.	4X4 J-BOX W/ 1" CONDUIT TO IRRIGATION VALVES
O	01	(4) 1" DATA CONDUITS	CEILING	FROM MENU BOARD/SPEAKER POST TO ABOVE CEILING FOR OCB AND D/T COMM. SYST. SEE DETAIL 3/7.0
HM	04	OCB SWITCH	+80" A.F.F.	4X4 J-BOX W/ 1" CONDUIT TO IRRIGATION VALVES
T	01	TELEPHONE SERVICE BOX PER LOCAL TELEPHONE COMPANY. PROVIDE 24"X24"X3/4" PLYWOOD PANEL AT CLG. PROVIDE PULL STRING IN 2" CONDUIT.	+24" A.F.F.	PROVIDE (1) 25 PAIR TELEPHONE CABLE. ONLY (2) LINES TO BE USED. LINE ONE FOR VOICE/FAX. LINE (2) FOR COMPUTER MODEM.
TV	01	CLOSED CIRCUIT TELEVISION (CCTV)		CCTV INSTALLATION IS BASED ON THE CRIME INDEX AS DETERMINED BY YUM! LOSS PREVENTION MANAGER. THE STANDARD CCTV PACKAGE WILL CONSIST OF (1) CCTV MONITOR W/ WALL BRACKET AND (1) MINI DOME CAMERA MTD. ON BACK SIDE OF BULKHEAD (7 TOTAL)

	HOLD-UP BUTTON (MOUNT 2-1/2" BEHIND COUNTER EDGE)		DOOR CONTACT (LINKED TO AUDIO / VISUAL ALARM)
	MUSIC SYSTEM SPEAKERS		"SOUND ALERT" DEVICE
	SECURITY STROBE		KEYPAD (MTD AT 48" A.F.F.)
	J-BOX		ALARM SIREN ABOVE CLG
	2' x 4' J-BOX W/ DATA PORTS		BUMP PAD (MOUNT AT FRONT COUNTER)
	MOTION DETECTOR		HOOD FIRE SUPPRESSION SYSTEM PULL STATION
	OCCUPANCY SENSOR, CEILING MOUNTED. SEE DETAILS 1 & 2 / E7.0		USB OUTLET

COMMUNICATIONS LEGEND NTS **C**

- A. SUPPLY AND INSTALL OUTLETS AND CONDUIT FOR OWNER SUPPLIED AND INSTALLED CABLE AND LOW VOLTAGE WIRING (U.O.N.). TELEPHONE AND MUSIC SYSTEM WIRING SHALL BE SUPPLIED AND INSTALLED. SEE SCOPE OF WORK SHEETS.
- B. SEE SHEETS E3.0 AND E3.1 FOR ELECT. INFO ON POS, SECURITY SYSTEM, CCTV SYSTEM, (OFFICE) COMPUTER, DRIVE-THRU TIMER AND DRIVE-THRU COMMUNICATION SYSTEM.
- C. THIS PLAN INCLUDES CONDUITS AND J-BOXES FOR POS, SECURITY SYSTEM, CCTV SYSTEM, (OFFICE) COMPUTER, TELEPHONE SYSTEM, MUSIC SYSTEM, DRIVE-THRU TIMER AND DRIVE-THRU COMMUNICATION SYSTEM.
- D. ALL OUTLETS AND BOXES MOUNTED IN THE SERVING COUNTER CABINETY ARE TO BE 24" AFF. INSTALL JUNCTION BOXES WITH CONDUIT UNDER CABINET TO NEAREST WALL AND TO ABOVE CEILING.

COMMUNICATIONS NOTES NTS **B**

C:\Users\mtd\Documents\Taco Bell\Main\MKP_Arch\T1.rvt



TBCCB-3-WOS SEQUENCE OF OPERATION

The intent of the BMS Control Box (TBCCB-3-WOS) is to activate or deactivate the following:

- Kitchen Lighting
- Dining Room Lighting
- Exterior Lighting
- Exterior Signs
- Exhaust hood exhaust fan
- Exhaust hood lighting
- Make up air / replacement air fan
- Rest room / cook line exhaust fan
- Managers Office lighting & at least one duplex outlet

Sequence of Operation

(Building) Occupied Mode

When the Occupied/Unoccupied selector switch on the front of the TBCCB-3-WOS panel is in the "Auto" position, Channel 1 of the Timeclock in the Control Box is programmed to place the building in Occupied mode 15 minutes before the first Team Member arrives on the premises. This commands on the following:

- The Parking Lot Lights, provided the photo cell indicates it is dark enough for them to be on
- The restroom and cook line exhaust fan marked "EF-2"
- Dining Room Lights, provided their local switch is in the ON position
- Kitchen and rest room lights, provided their local switch and or occupancy sensors are in the ON position
- The exhaust hood exhaust fan marked "EF-1"
- The make up air replacement air fan (evaporator fan) in RTU 1 and RTU 2.

Occupied mode may also be invoked when any of the following occur:

- an Occupancy sensor on the front of the TBCCB-3-WOS panel senses motion
- when an optional remote Occupancy sensor senses motion
- when a remote Occupied switch is in the Occupied position
- when the Occupied/Unoccupied switch on the front of the TBCCB-3-WOS is placed in the MANUAL OCCUPIED position

(Building) Unoccupied Mode

When the Occupied/Unoccupied selector switch on the front of the TBCCB-3-WOS panel is in the "Auto" position, Channel 1 of the Timeclock in the Control Box is programmed to place the building in Unoccupied mode 15 minutes after the last Team Member leaves the premises. This commands OFF the following:

- The Parking Lot Lights
- The restroom and cook line exhaust fan marked "EF-2"
- Dining Room Lights
- Kitchen room lights
- The exhaust hood exhaust fan marked "EF-1"
- The make up air - replacement air fan (evaporator fan) in RTU 1 and RTU 2.

In the event of a rise in temperature above 85 degrees in the exhaust hood, the exhaust fan (EF-1) and the make up air source (RTU 1 and 2) will be activated. When in Unoccupied mode and the temperature under the hood drops below 85 degrees, the exhaust fan and make up air source will turn off fifteen minutes after the 85 degree setting is achieved.

Any detection by the Occupancy sensor in the TBCCB-3-WOS or the optional Remote Occupancy Sensor or the optional Remote Occupancy Switch or ON position of the Manual Occupied switch will override the Timeclock and keep the building in OCCUPIED mode.

(Sales) OPEN mode

When the OPEN/CLOSED selector switch on the front of the TBCCB-3-WOS panel is in the "Auto" position, Channel 2 of the Timeclock in the Control Box is programmed to place the building in OPEN (FOR SALES) mode. This commands on the following:

- The Exterior Building Lights, provided the photo cell indicates it is dark enough for them to be on
- The Exterior Signs, provided the photo cell indicates it is dark enough for them to be on

OPEN for sales mode may also be invoked when any of the following occur:

- when an optional remote OPEN (for sales) switch is in the OPEN position
- when the OPEN/CLOSED switch on the front of the TBCCB-3-WOS is placed in the MANUAL OPEN position

(Sales) CLOSED mode

When the OPEN/CLOSED selector switch on the front of the TBCCB-3-WOS panel is in the "Auto" position, Channel 2 of the Timeclock in the Control Box is programmed to place the building in CLOSED (FOR SALES) mode. This commands OFF the following:

- The Exterior Building Lights
- The Exterior Signs,



Manual CLOSED Mode

When a Team Member places the OPEN/CLOSED switch in the MANUALCLOSED position it turns off the Signs and Exterior Lights until the switch is placed back in AUTOMATIC or MANUAL OPEN position


External Operations Not Part Of The Control Box Operation But Required To Be Installed

The following operations should take place between the package units and various components:

- Control voltage for RTU 2 shall pass through contacts in the fire suppression system for the exhaust hood so that RTU 2 evaporator fan shuts down upon an activation of the fire suppressant into the hood. The system shall be wired directly between the fire suppression system and RTU 2 or TBANS control box. See sheet E-7.1.
- A remote smoke detector system featuring testing, annunciation and remote unit reset shall be installed in the manager's office for each RTU. The system shall be wired directly between each RTU and its respective testing, annunciation and reset device.

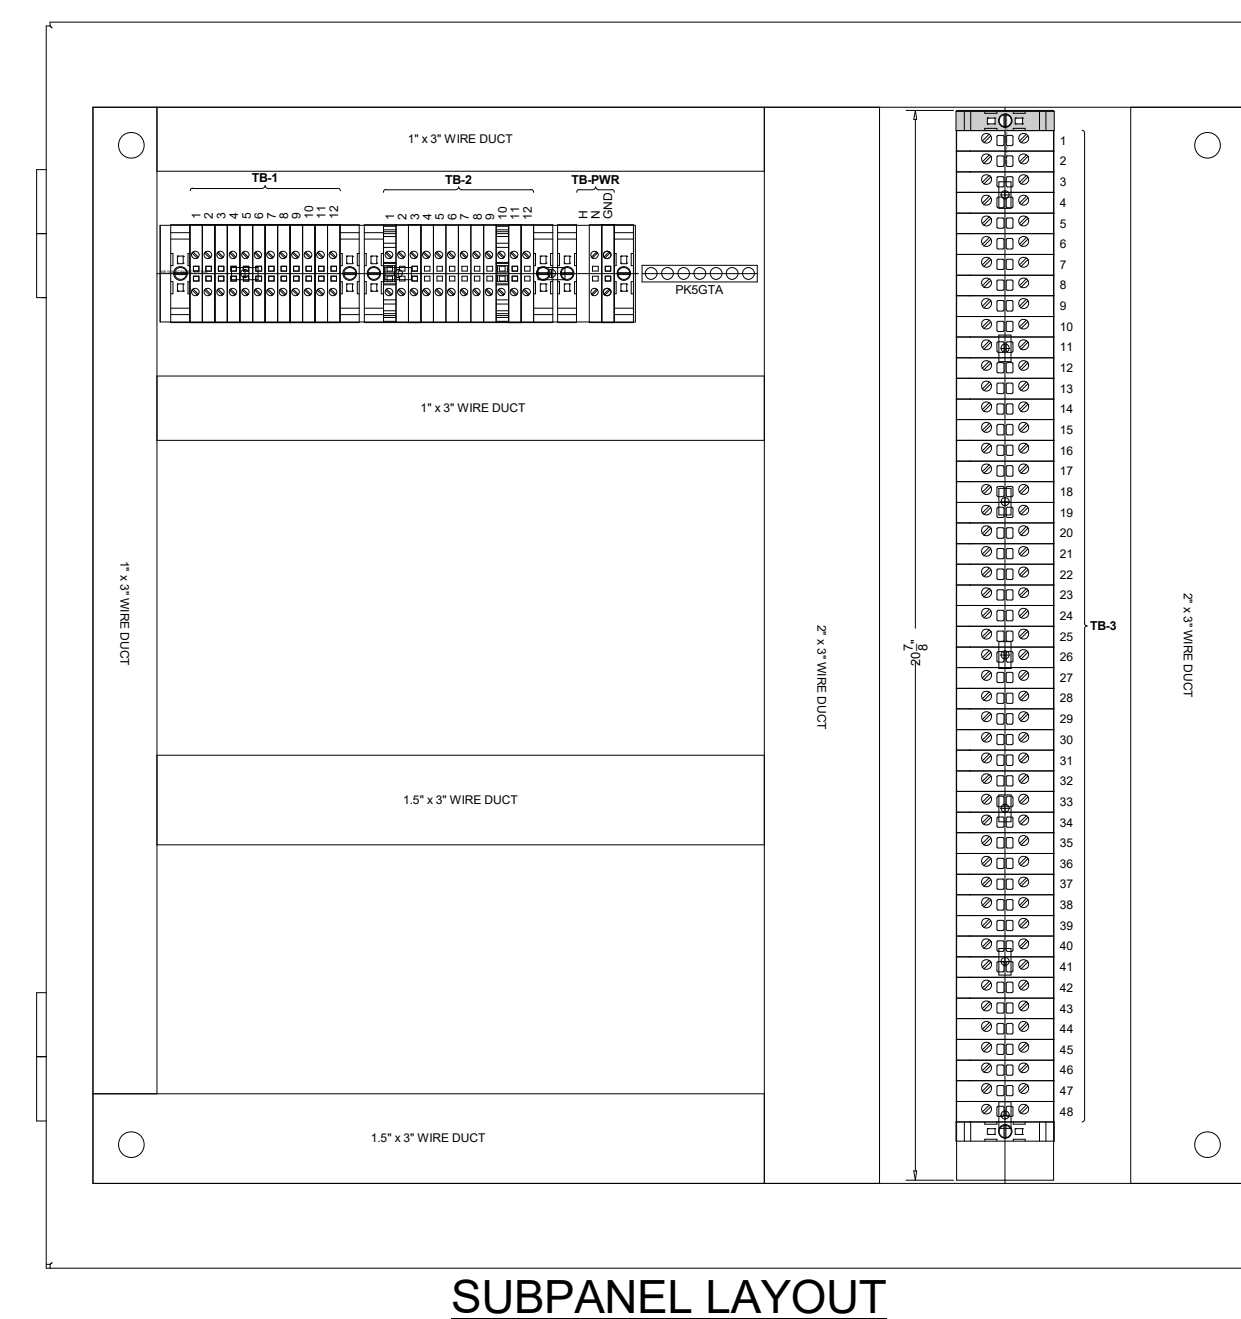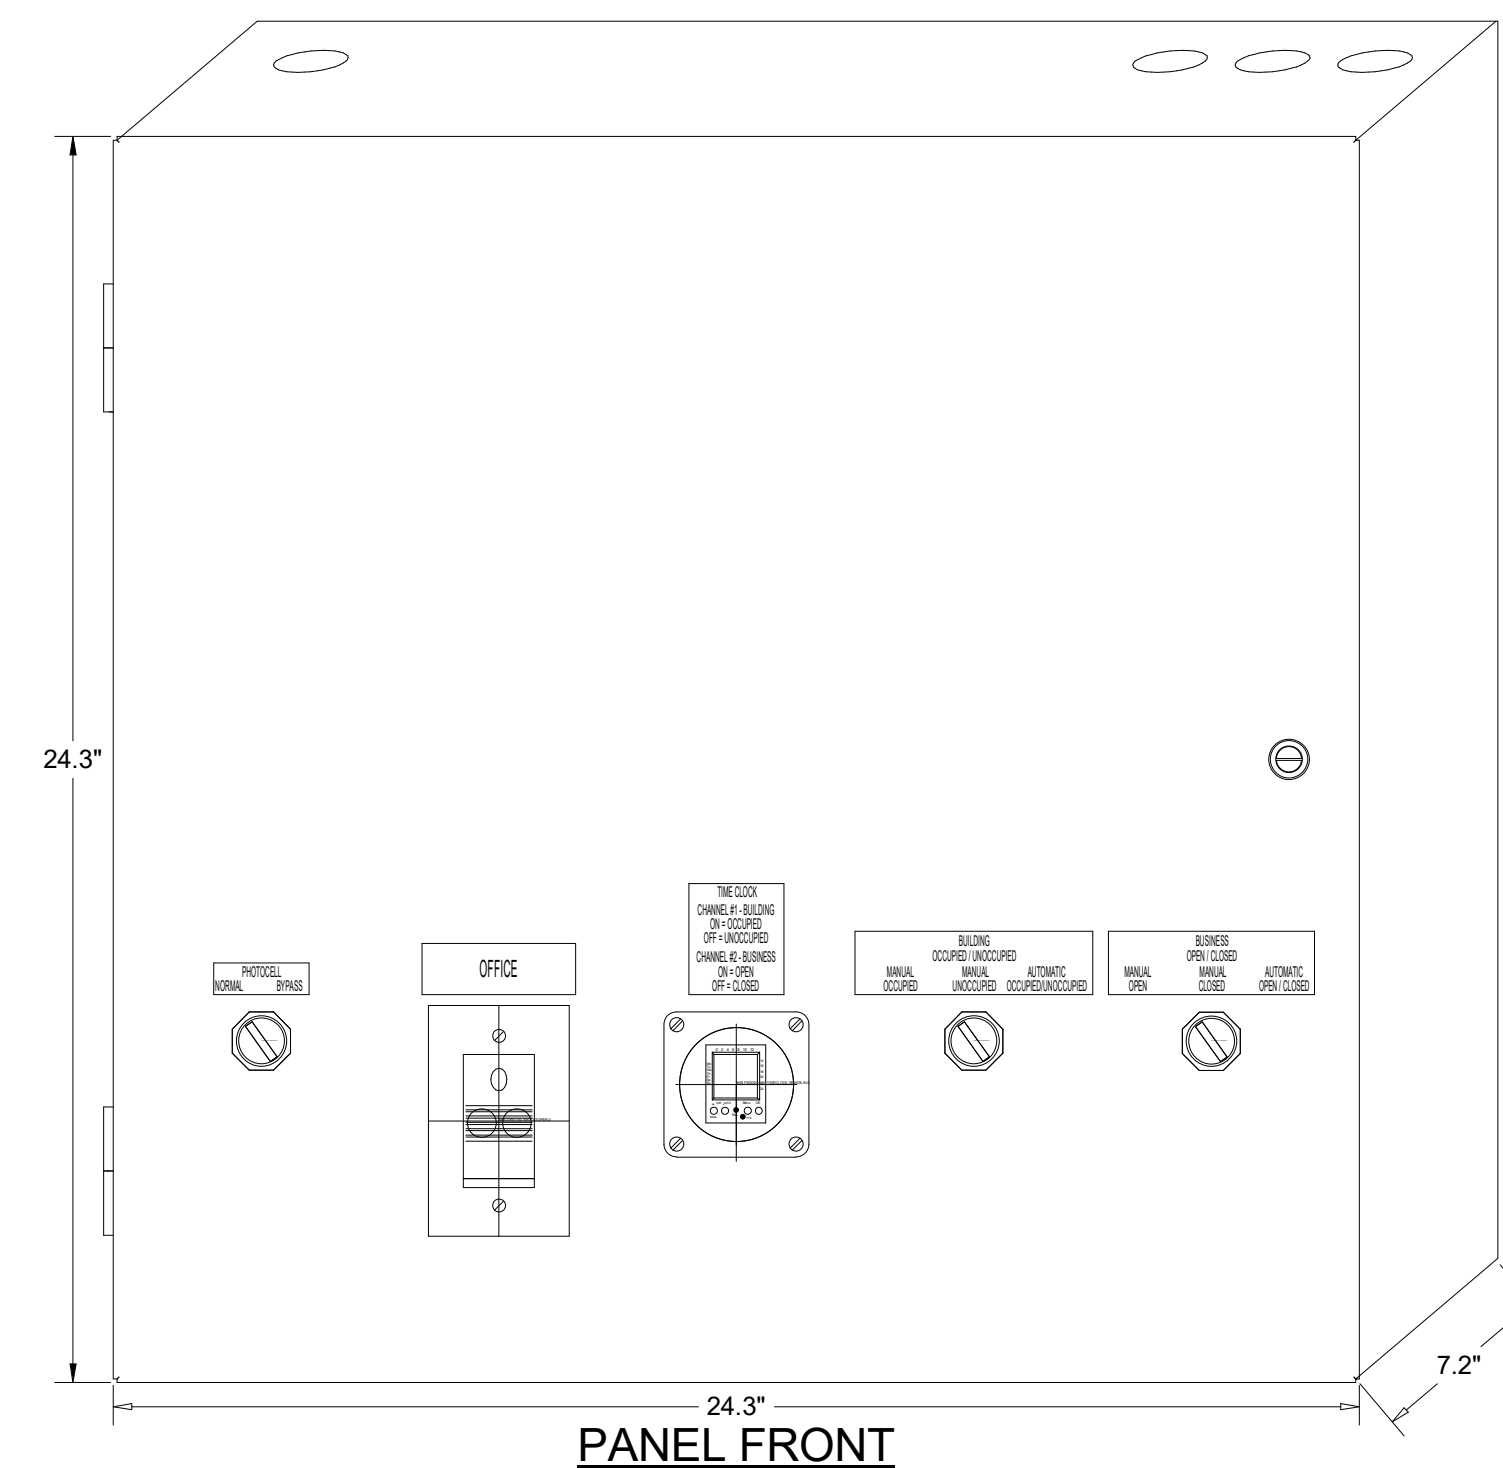

TACO BELL COMPONENT RELATIONSHIP

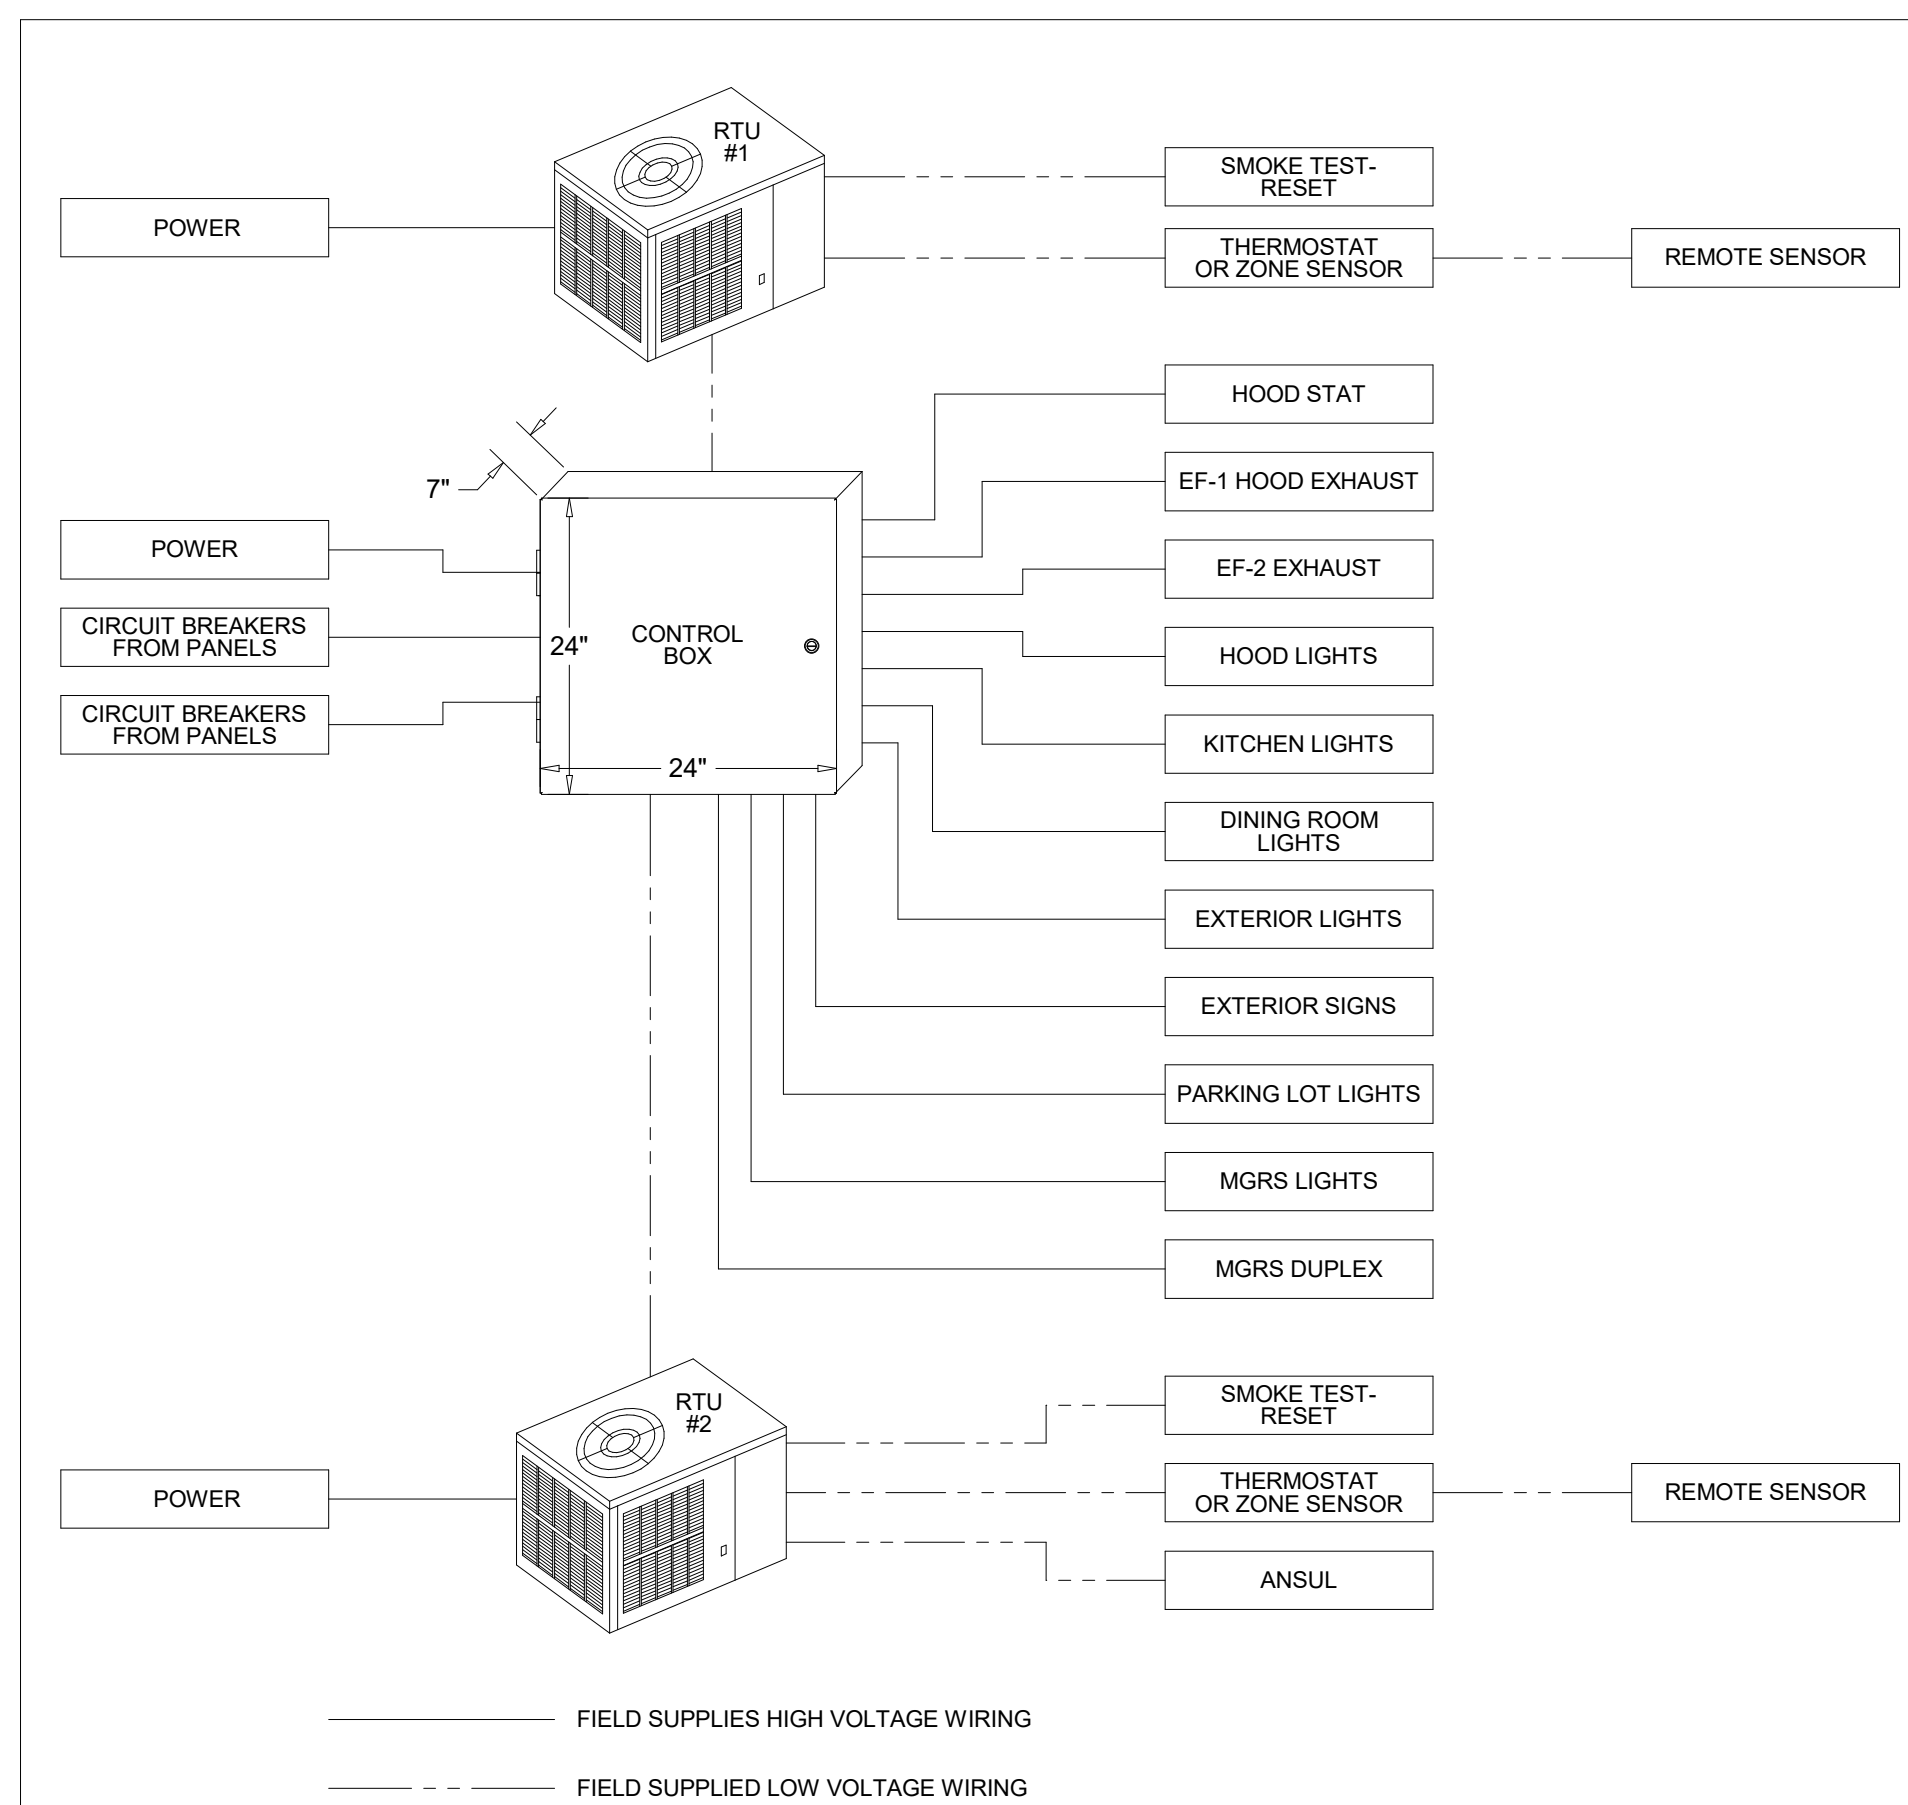

— FIELD WIRE BY OTHERS
THIS PANEL ENCLOSURE IS RATED TYPE 1. TO PRESERVE RATING USE TYPE 1 CONDUIT ENTRY HUBS



This panel is Listed to applicable UL Standards and requirements by UL. Field wiring or field components are not Listed under this mark.

CONTROL BOX

TACO BELL'S SUPPLIER OF THE CONTROL BOX IS AIR CARE EXPERTS. UNLESS NOTED OTHERWISE, TBCCB-3-WOS CONTROL BOX TO BE PURCHASED AND INSTALLED BY THE ELECTRICAL CONTRACTOR. NOTE: TBCCB-3 WOS MAY BE INCLUDED IN THE LIGHTING PACKAGE. ELECTRICAL CONTRACTOR IS RESPONSIBLE TO VERIFY. TBCCB-3-WOS INCLUDES ALL WIRING AND COMPONENTS SHOWN FACTORY INSTALLED WITHIN THE BOX. PRIMARY CONTACT: CHUCK MCCABE PHONE: 949 770 2222 EMAIL: INFO@ACE-EMS.COM

FOR REFERENCE ONLY

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END. MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY.: AJR
JOB NO.: 2020088.03

TACO BELL

18550 E. WARREN AVE.,
DETROIT, MI 48236



ENDEAVOR 2.0
ELECTRICAL
DETAILS -
TBCCB

E6.0

TBCCB-3-WOS

TBCCB-3-WOS



FOR REFERENCE ONLY

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: AJR
 JOB NO.: 2020088.03



TACO BELL

18550 E. WARREN AVE.,
 DETROIT, MI 48236





ENDEAVOR 2.0
**ELECTRICAL
 DETAILS -
 TBCCB**

E6.1

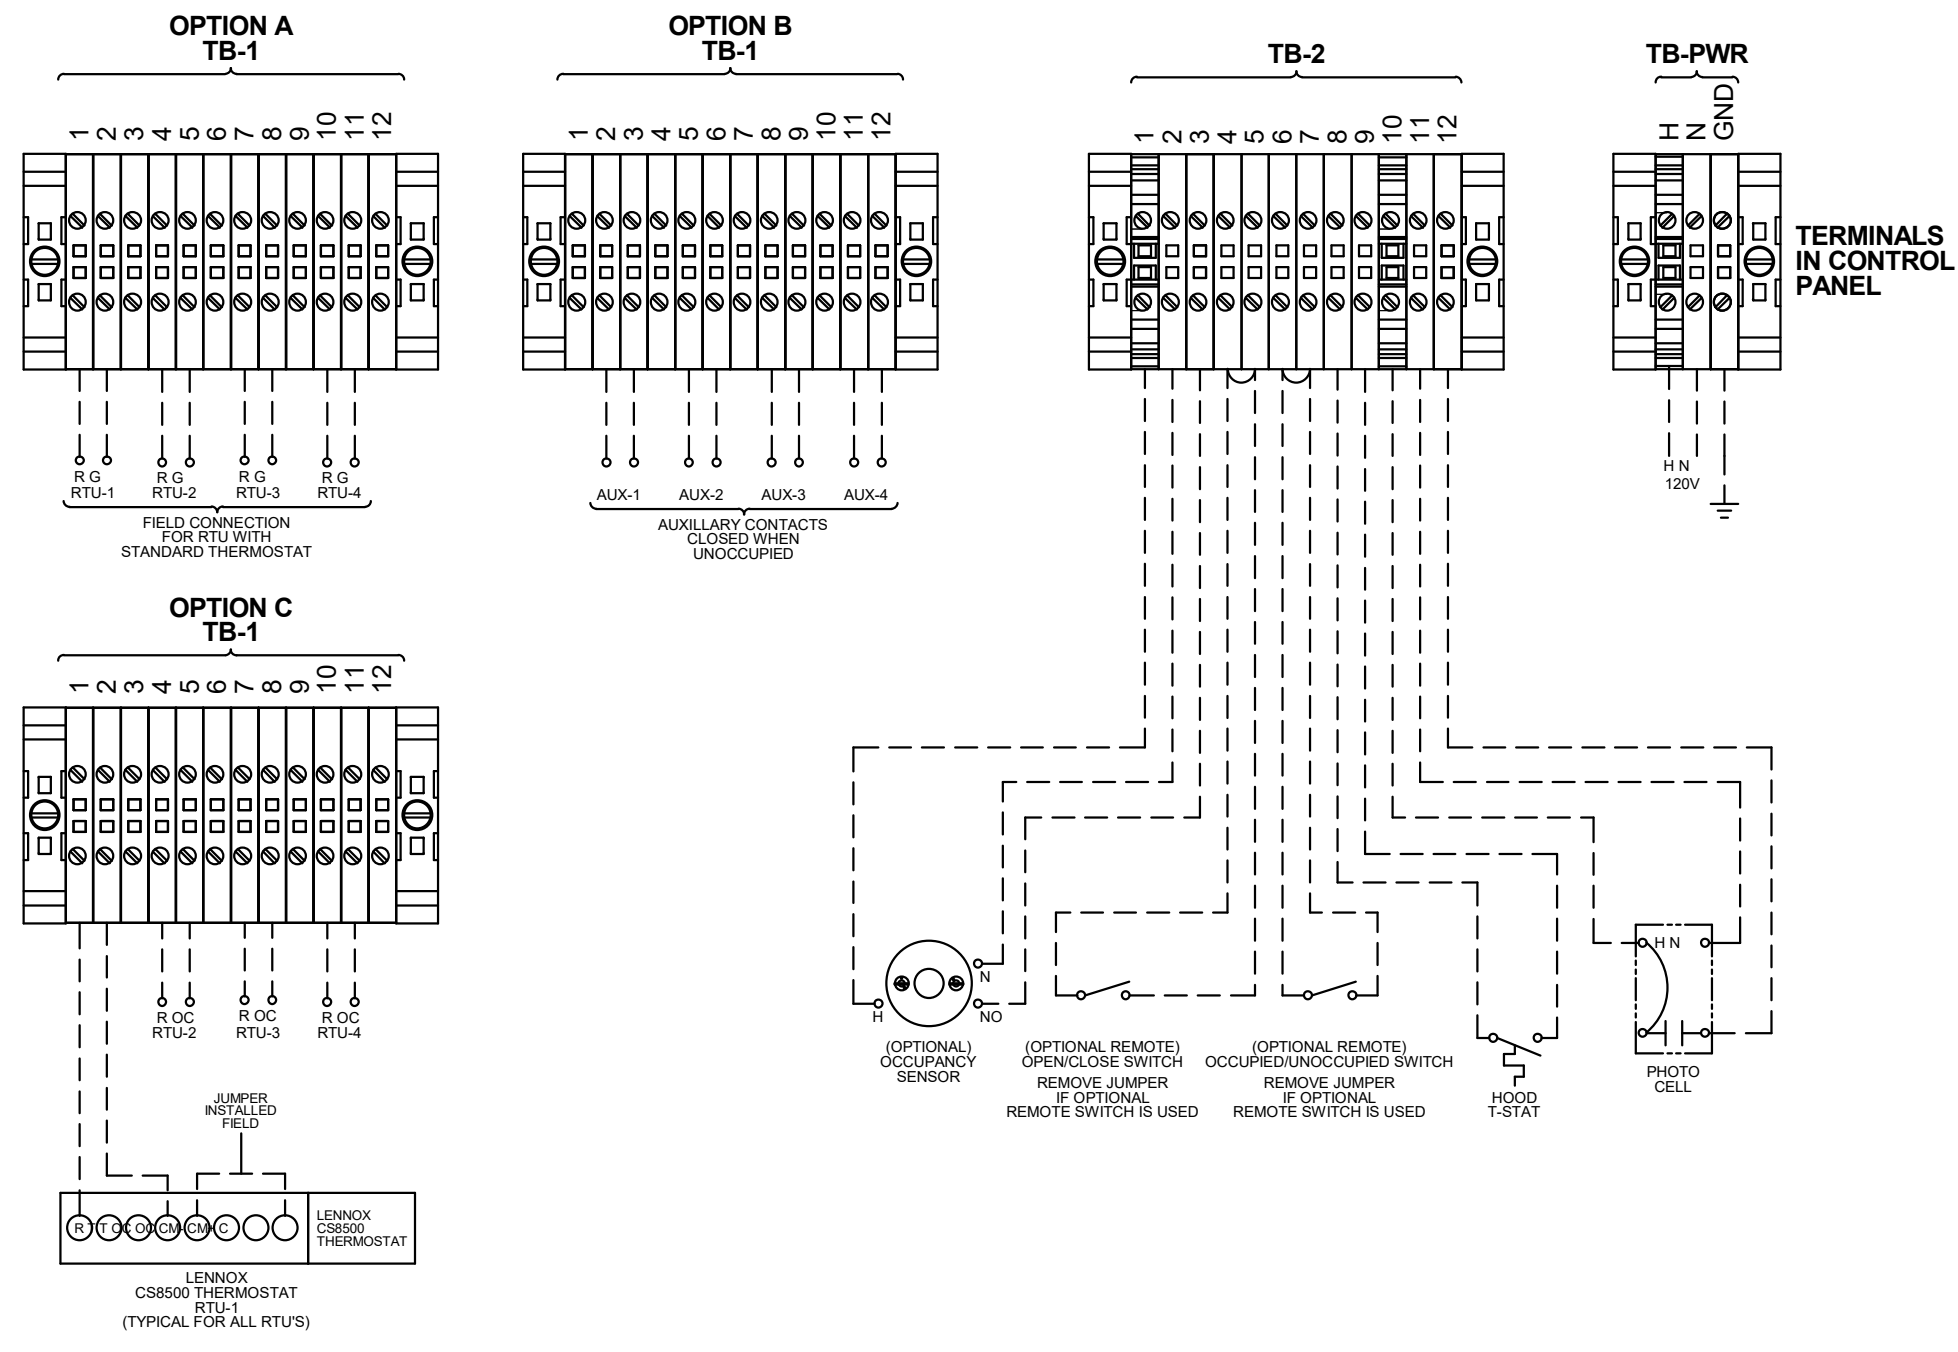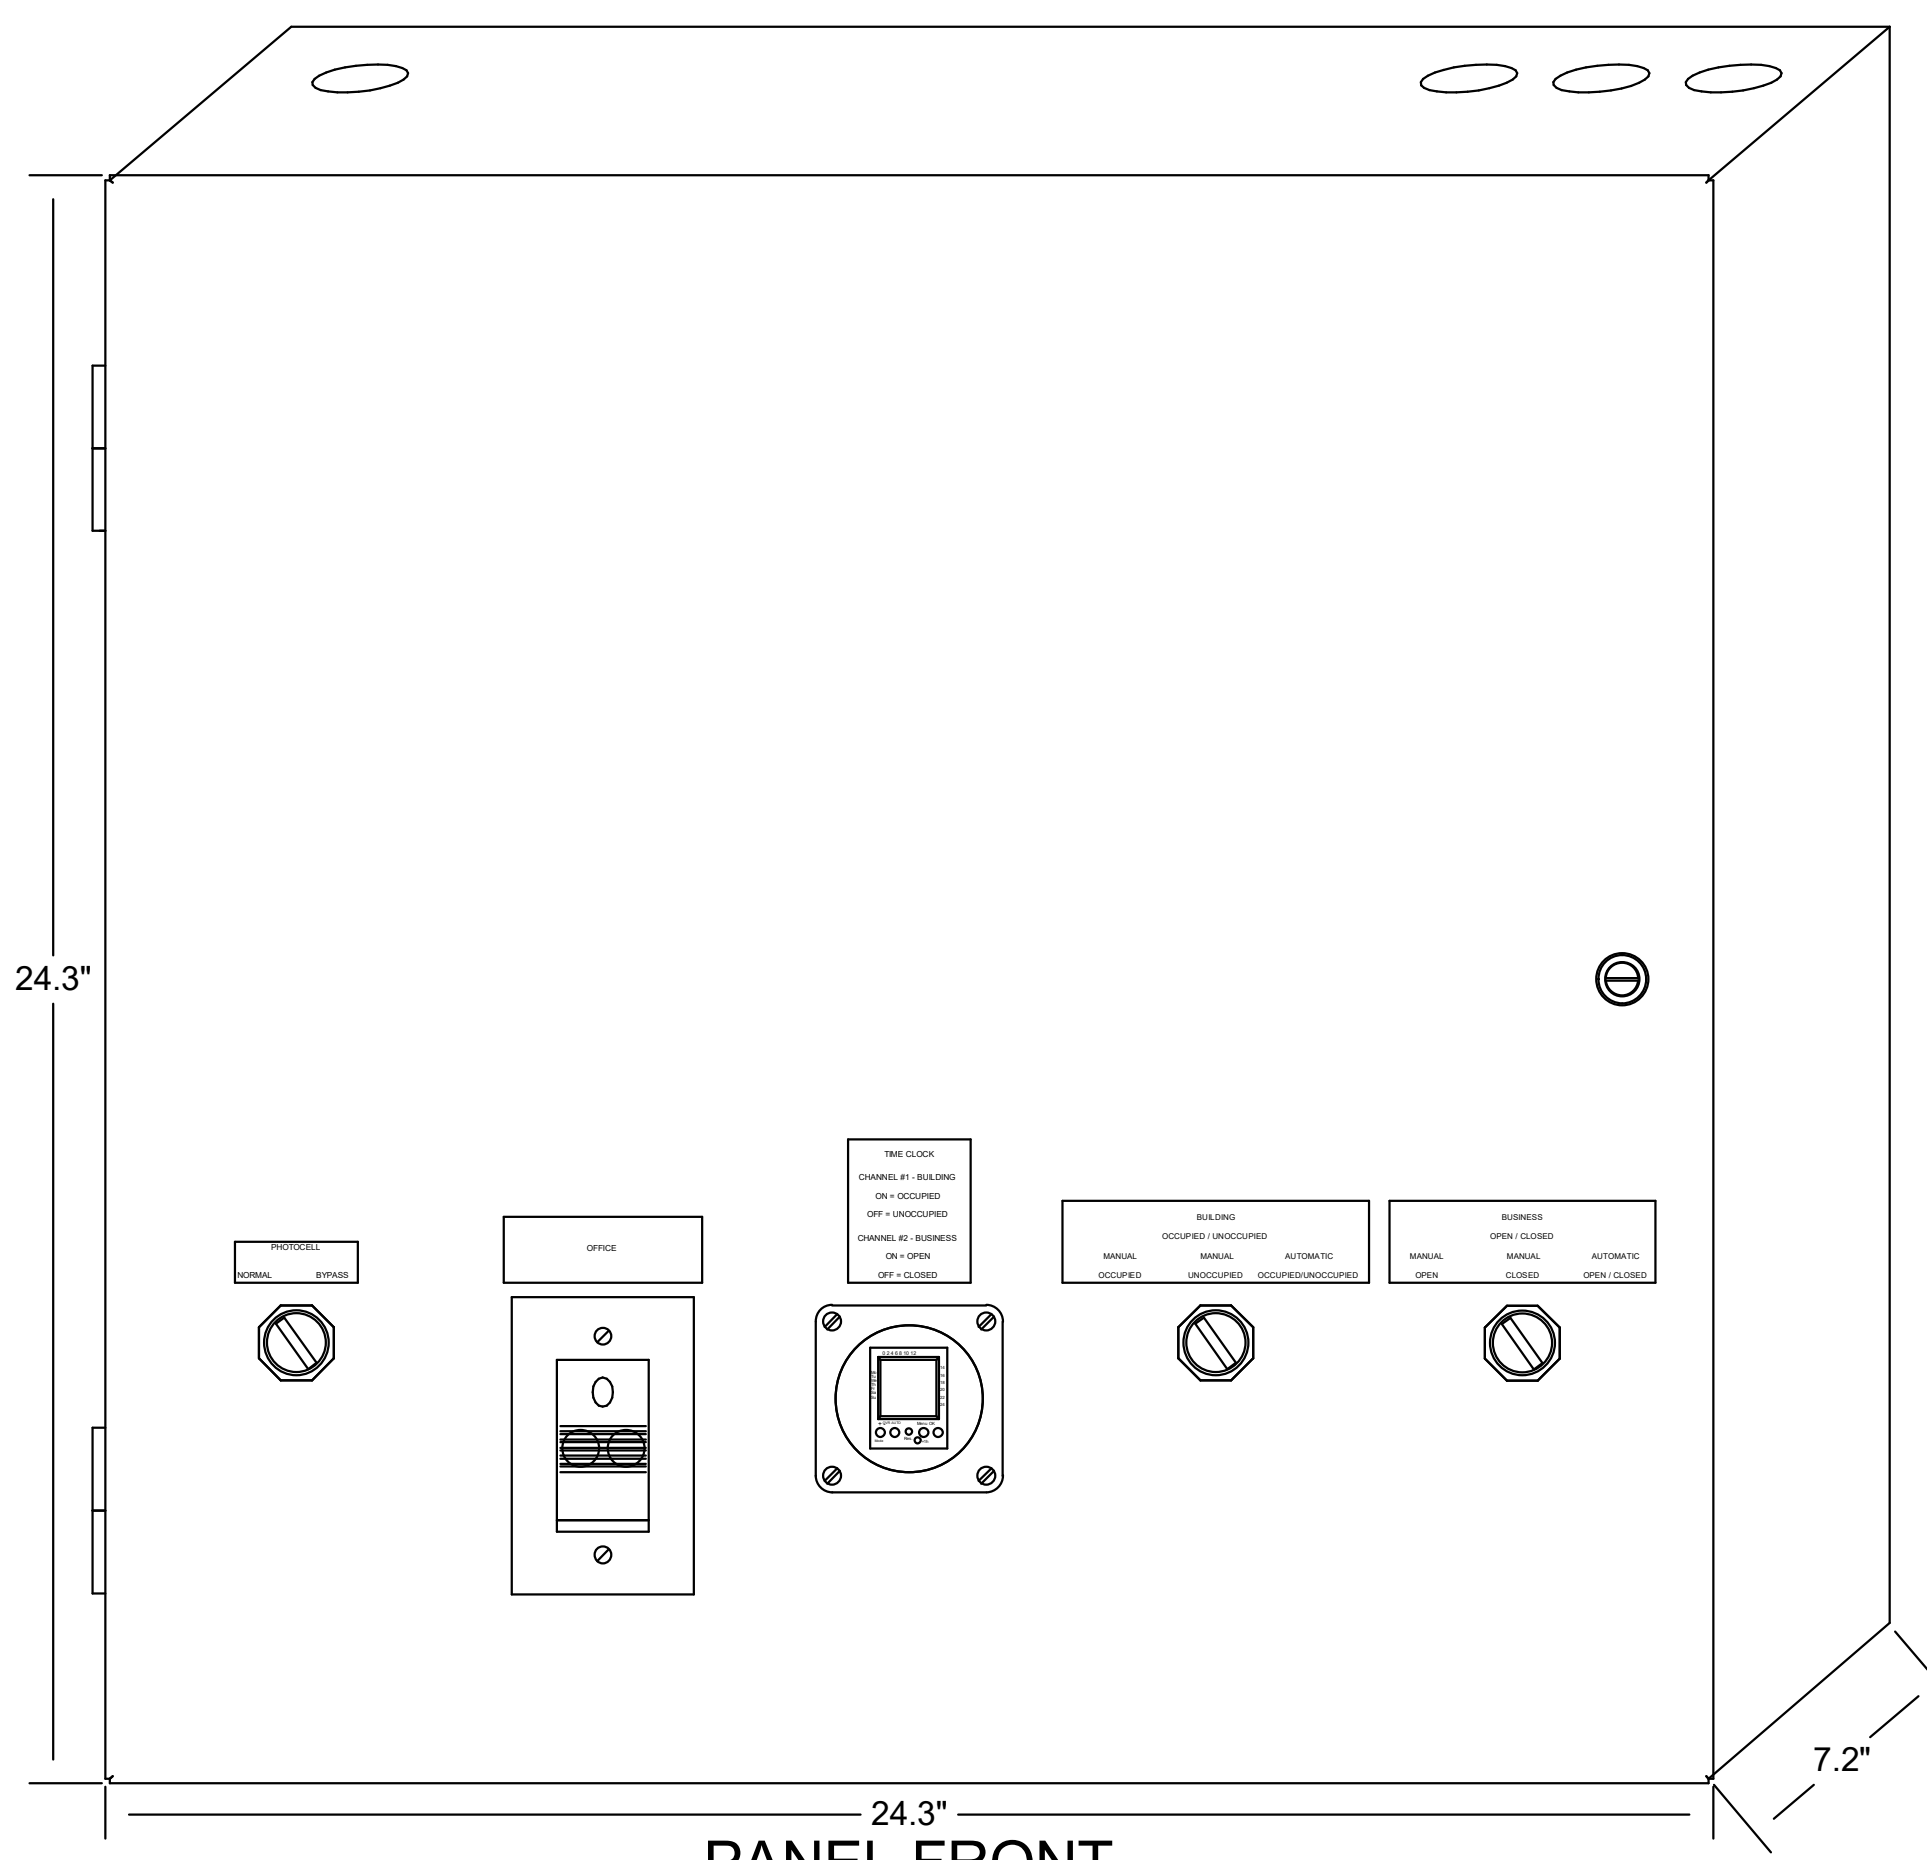

PANEL CIRCUI NUMBER
 REFER TO PANEL SCHEDULES FOR CIRCUIT INFORMATION (TYPICAL)

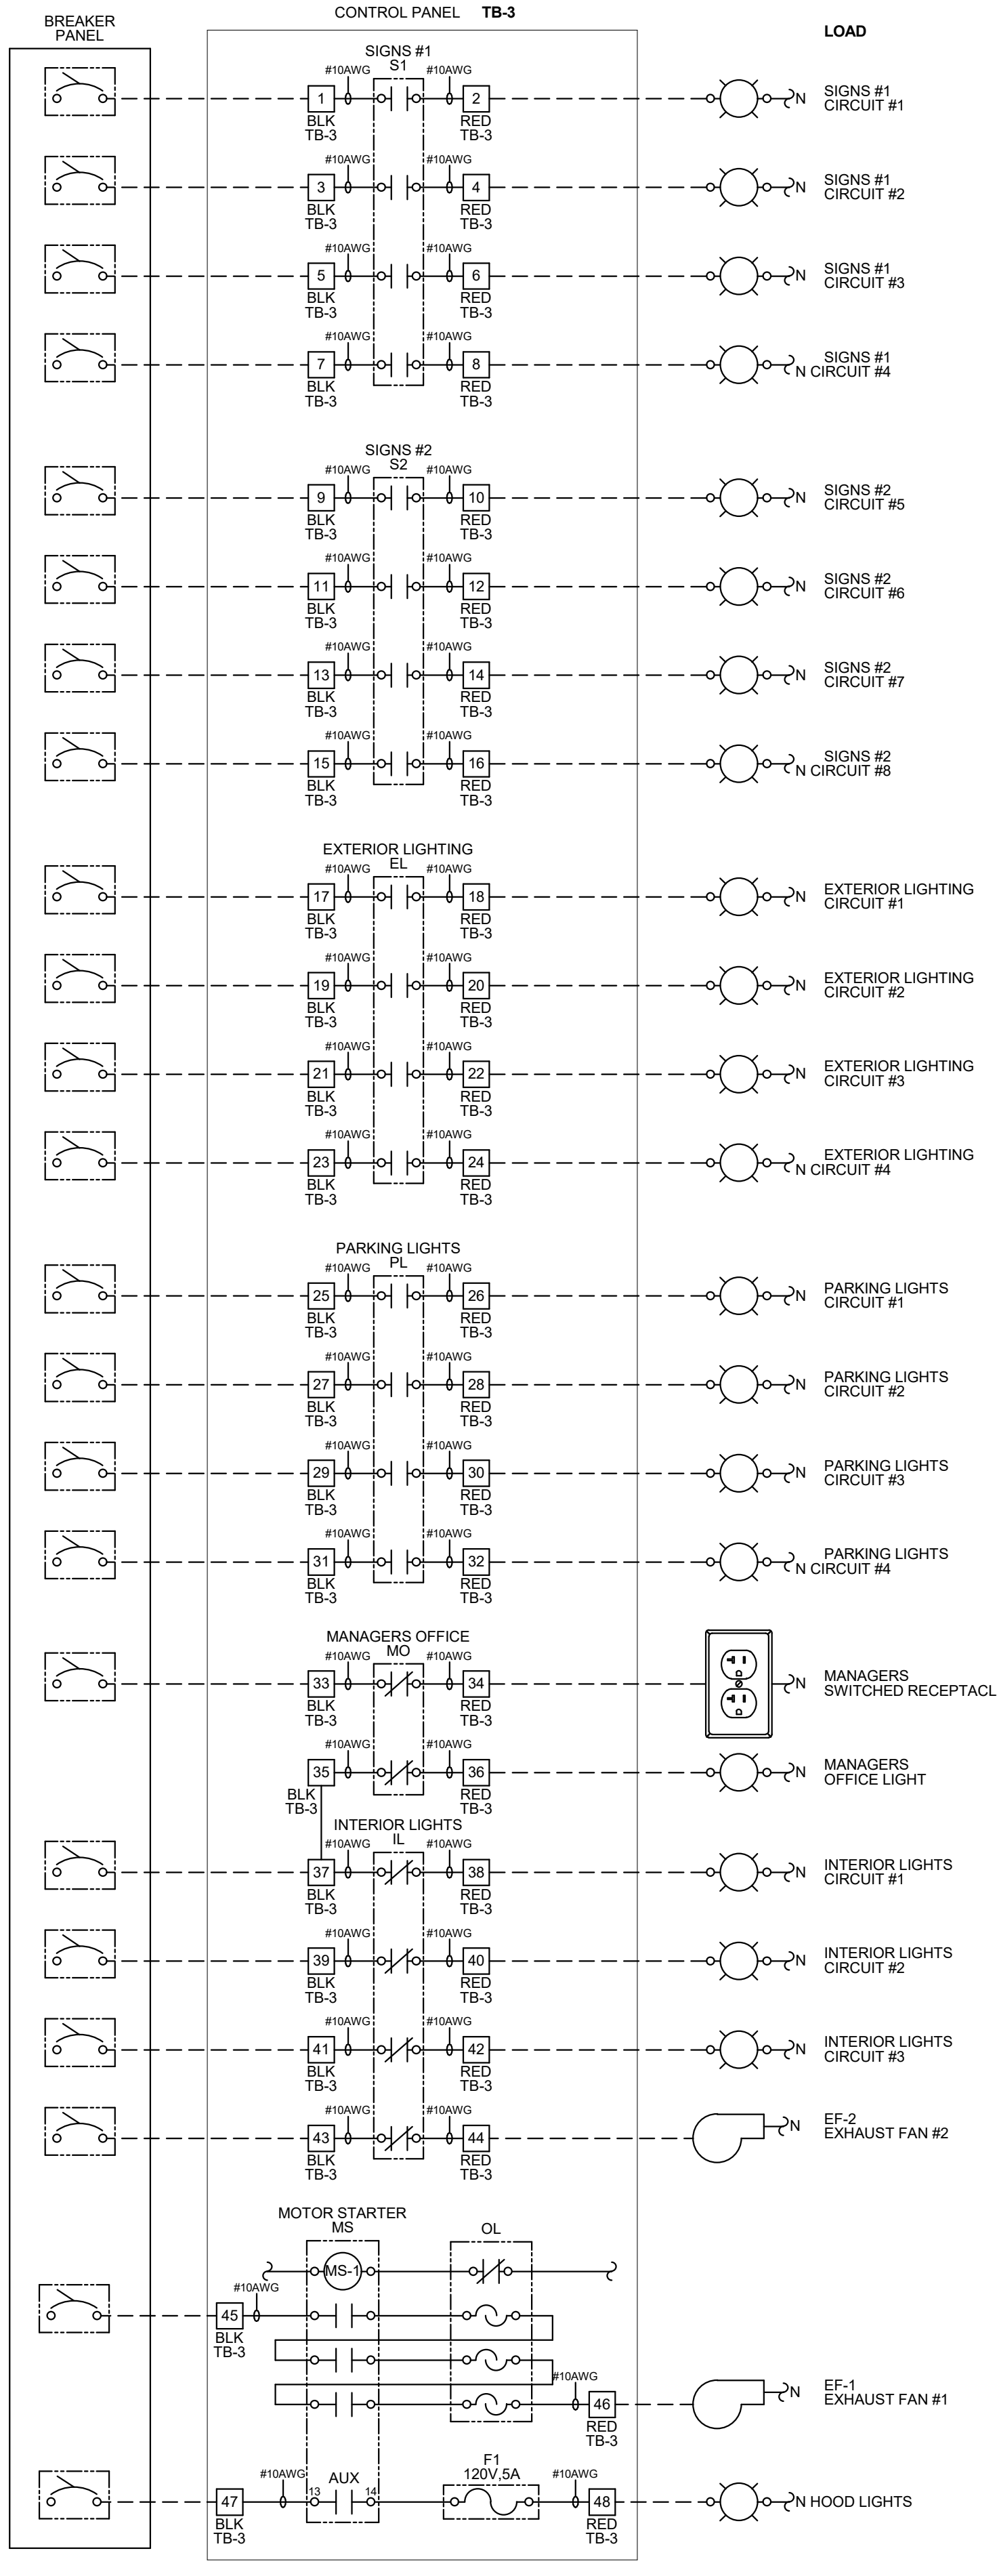

- NOTES:**
1. VISUAL VERIFICATION OF THIS INSTALLATION IS REQUIRED. SEE SHEET M5.0
 2. PANEL IS SURFACE MOUNT
 3. PROTECT INTERIOR FROM METAL SHAVINGS & DEBRIS

CONTROL BOX

TACO BELL'S SUPPLIER OF THE CONTROL BOX IS AIR CARE EXPERTS. UNLESS NOTED OTHERWISE, TBCCB-3-WOS CONTROL BOX TO BE PURCHASED AND INSTALLED BY THE ELECTRICAL CONTRACTOR.

NOTE: TBCCB-3 WOS MAY BE INCLUDED IN THE LIGHTING PACKAGE. ELECTRICAL CONTRACTOR IS RESPONSIBLE TO VERIFY.


TBCCB-3-WOS INCLUDES ALL WIRING AND COMPONENTS SHOWN FACTORY INSTALLED WITHIN THE BOX.

PRIMARY CONTACT: CHUCK MCCABE
 PHONE: 949 770 2222
 EMAIL: INFO@ACE-EMS.COM

--- FIELD WIRE BY OTHERS
 THIS PANEL ENCLOSURE IS RATED TYPE 1 TO PRESERVE RATING USE TYPE 1 CONDUIT ENTRY HUBS




This panel is Listed to applicable UL Standards and requirements by UL. Field wiring or field components are not Listed under this mark.

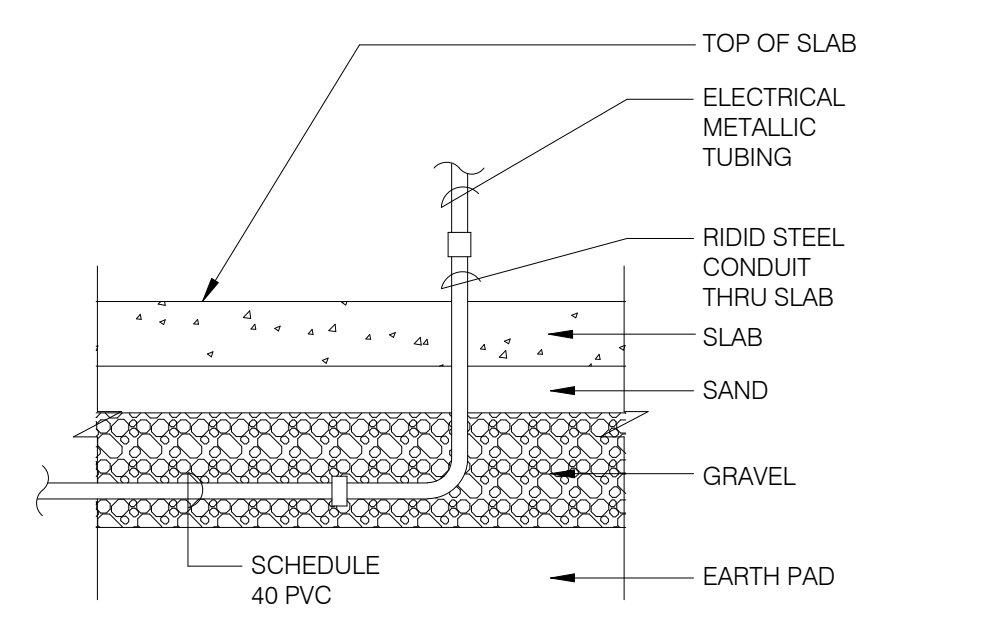


NOTE: GREEN GROUND WIRE REQUIRED IN ALL CONDUITS, SIZED PER N.E.C. REQUIREMENTS.

UNDER SLAB CONDUIT N.T.S. **7**

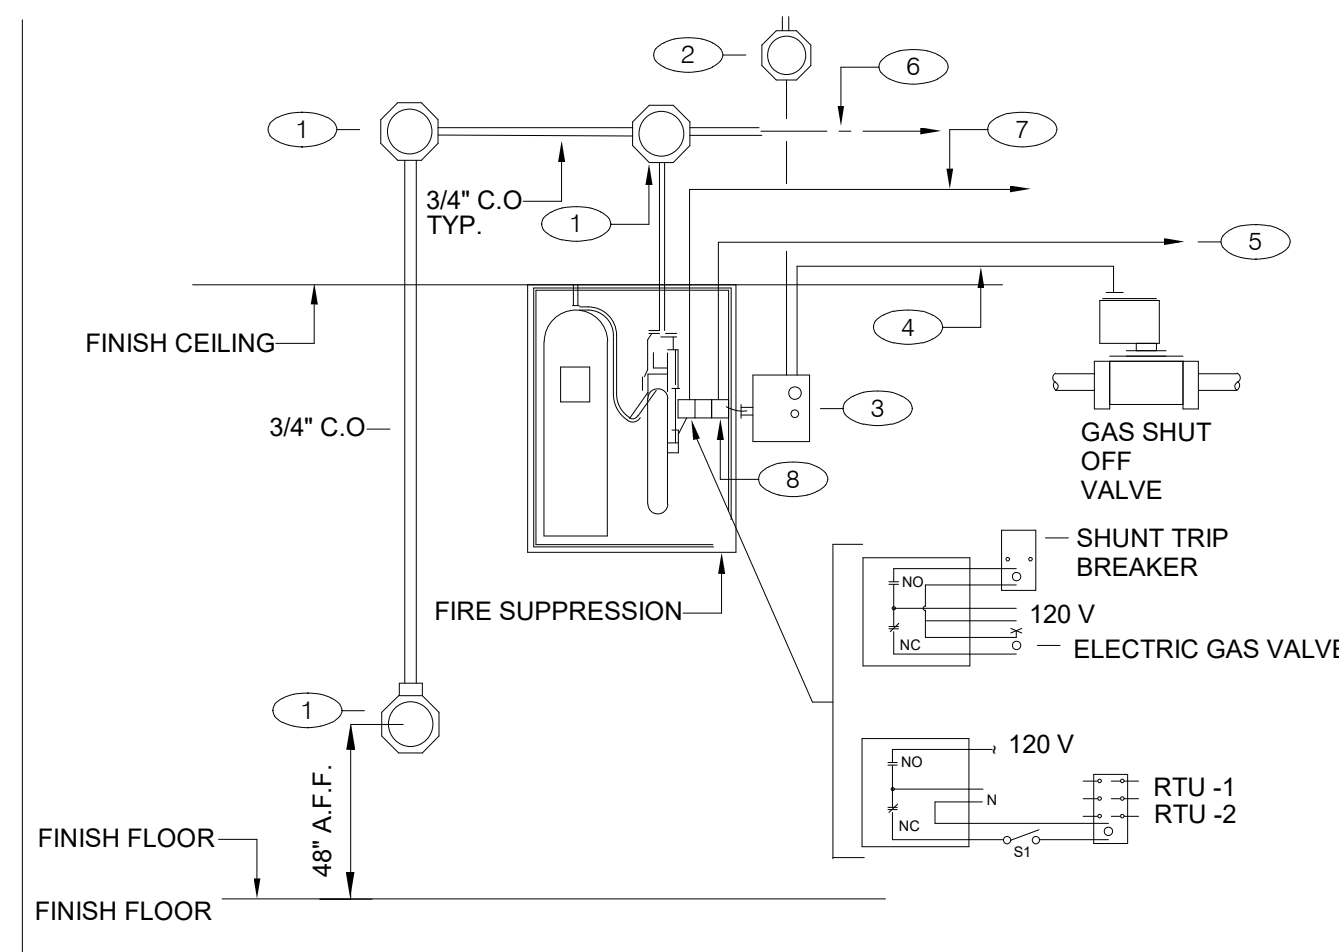


GENERAL NOTES:
 1. REFER TO SHEET M3.0
KEY NOTES:
 1. PROVIDE 4" OCTAGONAL J-BOX.
 2. PROVIDE J-BOX, AND 110 V CIRCUIT. REFER TO EQUIPMENT SCHEDULE/FLOOR PLAN FOR CIRCUIT ASSIGNMENT. CONNECT TO TBANS. SEE SHEET 7.1.
 3. TBANS INSTALLED BY ELECTRICAL CONTRACTOR.
 4. PROVIDE CONNECTIONS TO TBANS BOX FOR HOOD SHUTDOWN. SEE SHEET E7.1 FOR TBANS WIRING DIAGRAM.
 5. PROVIDE 1/2" C WITH CONTROL CABLE. MAKE INTERCONNECTIONS TO EXHAUST & SUPPLY FAN INTERFACE THROUGH MICROSWITCH ON HOOD.
 6. CABLE AND CONNECTION TO FUSIBLE LINKS AT EXHAUST HOOD BY K.E.C.
 7. PROVIDE INTERCONNECTION BETWEEN FIRE SUPPRESSION MICROSWITCH AND TBANS. SEE SHEET E7.1.
 8. FIRE SUPPRESSION SYSTEM TO INCLUDE TWO MICROSWITCHES. EACH MICROSWITCH SHALL HAVE A COMMON, NORMALLY OPEN AND NORMALLY CLOSED POLE.

FIRE SUPPRESSION SYSTEM WIRING DIAGRAM N.T.S. **4**

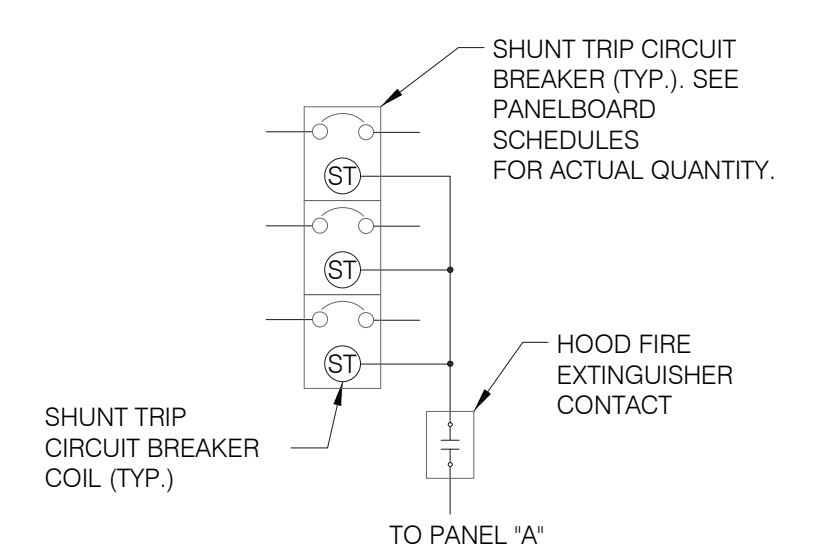


SEQUENCE OF OPERATION:
 UPON ACTIVATION OF ANY HOOD FIRE SUPPRESSION SYSTEM RELAY, A RELAY IN THAT FIRE SUPPRESSION SYSTEM SHALL CAUSE ALL SHUNT TRIP CIRCUIT BREAKERS TO OPERATE, THUS REMOVING POWER FROM ALL DEVICES CONNECTED TO EQUIPMENT LOCATED UNDER THE GREASE HOOD. EXHAUST FANS SHALL NOT BE AFFECTED BY THIS ACTION AND SHALL CONTINUE TO BE CONTROLLED AS INDICATED IN THE SEQUENCE OF OPERATIONS INDICATED ON CONTROLS SHEETS E6.0 AND E6.1

SHUNT TRIP DETAIL N.T.S. **1**

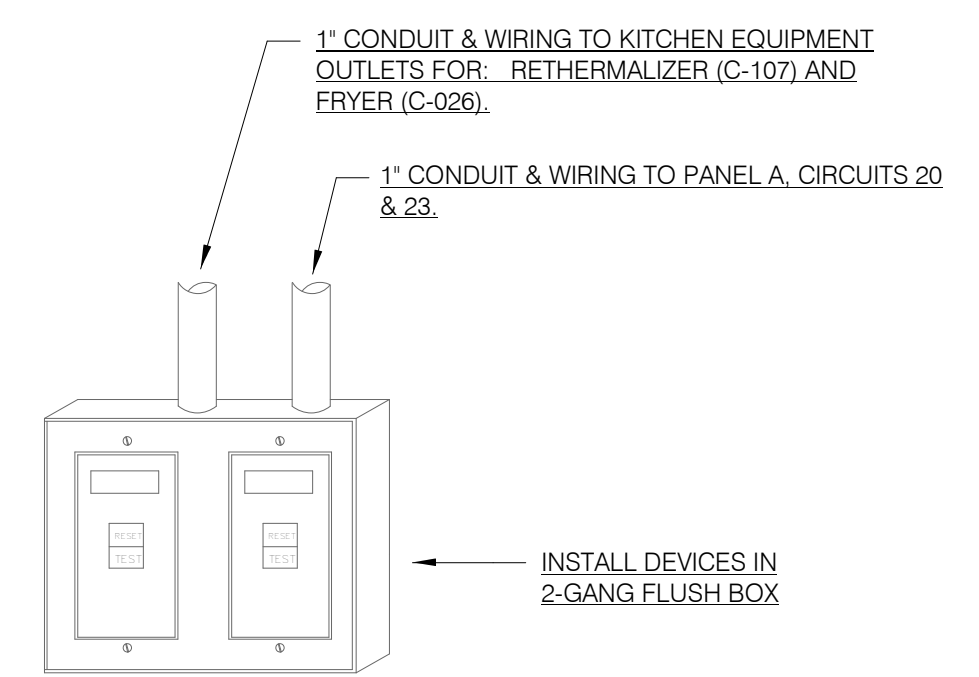


NOTES:
 1. DEAD FRONT GFCI DEVICES ARE REQUIRED FOR KITCHEN EQUIPMENT REQUIRING BOTH A SHUNT TRIP BREAKER AND GFCI PROTECTION.
 2. REFER TO SHEET E3.0 FOR LOCATION OF DEAD FRONT GFCI DEVICES.
 3. PROVIDE LABEL ON DEVICES WITH CIRCUIT NUMBER AND LOAD DESIGNATION.

DEAD FRONT GFCI DEVICE DETAIL N.T.S. **5**

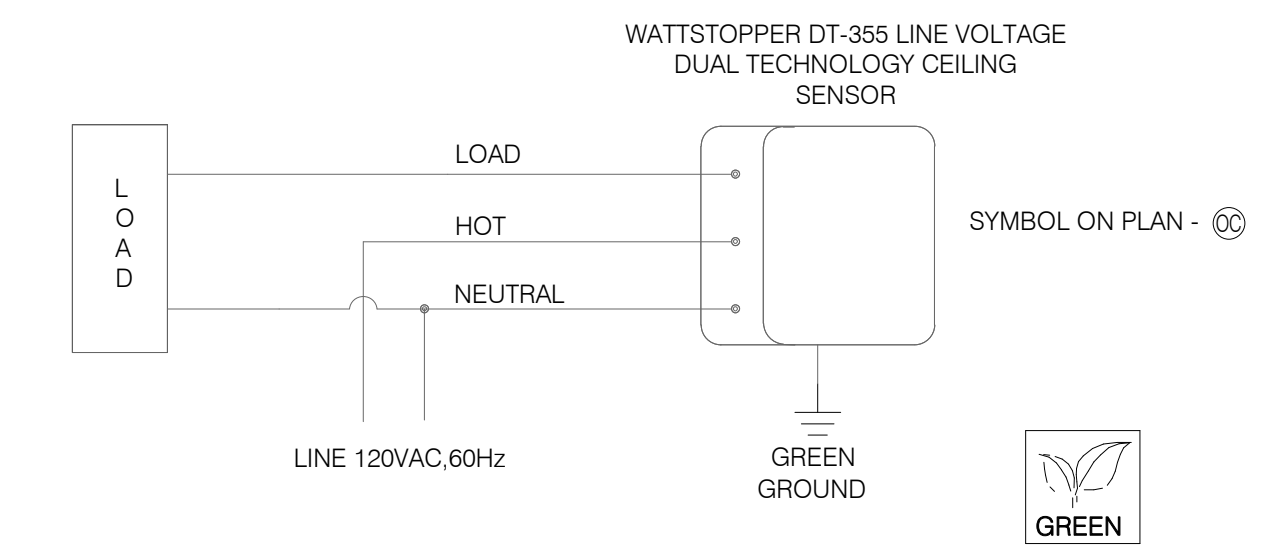

CEILING OCCUPANCY SENSOR WIRING DIAGRAM N.T.S. **2**

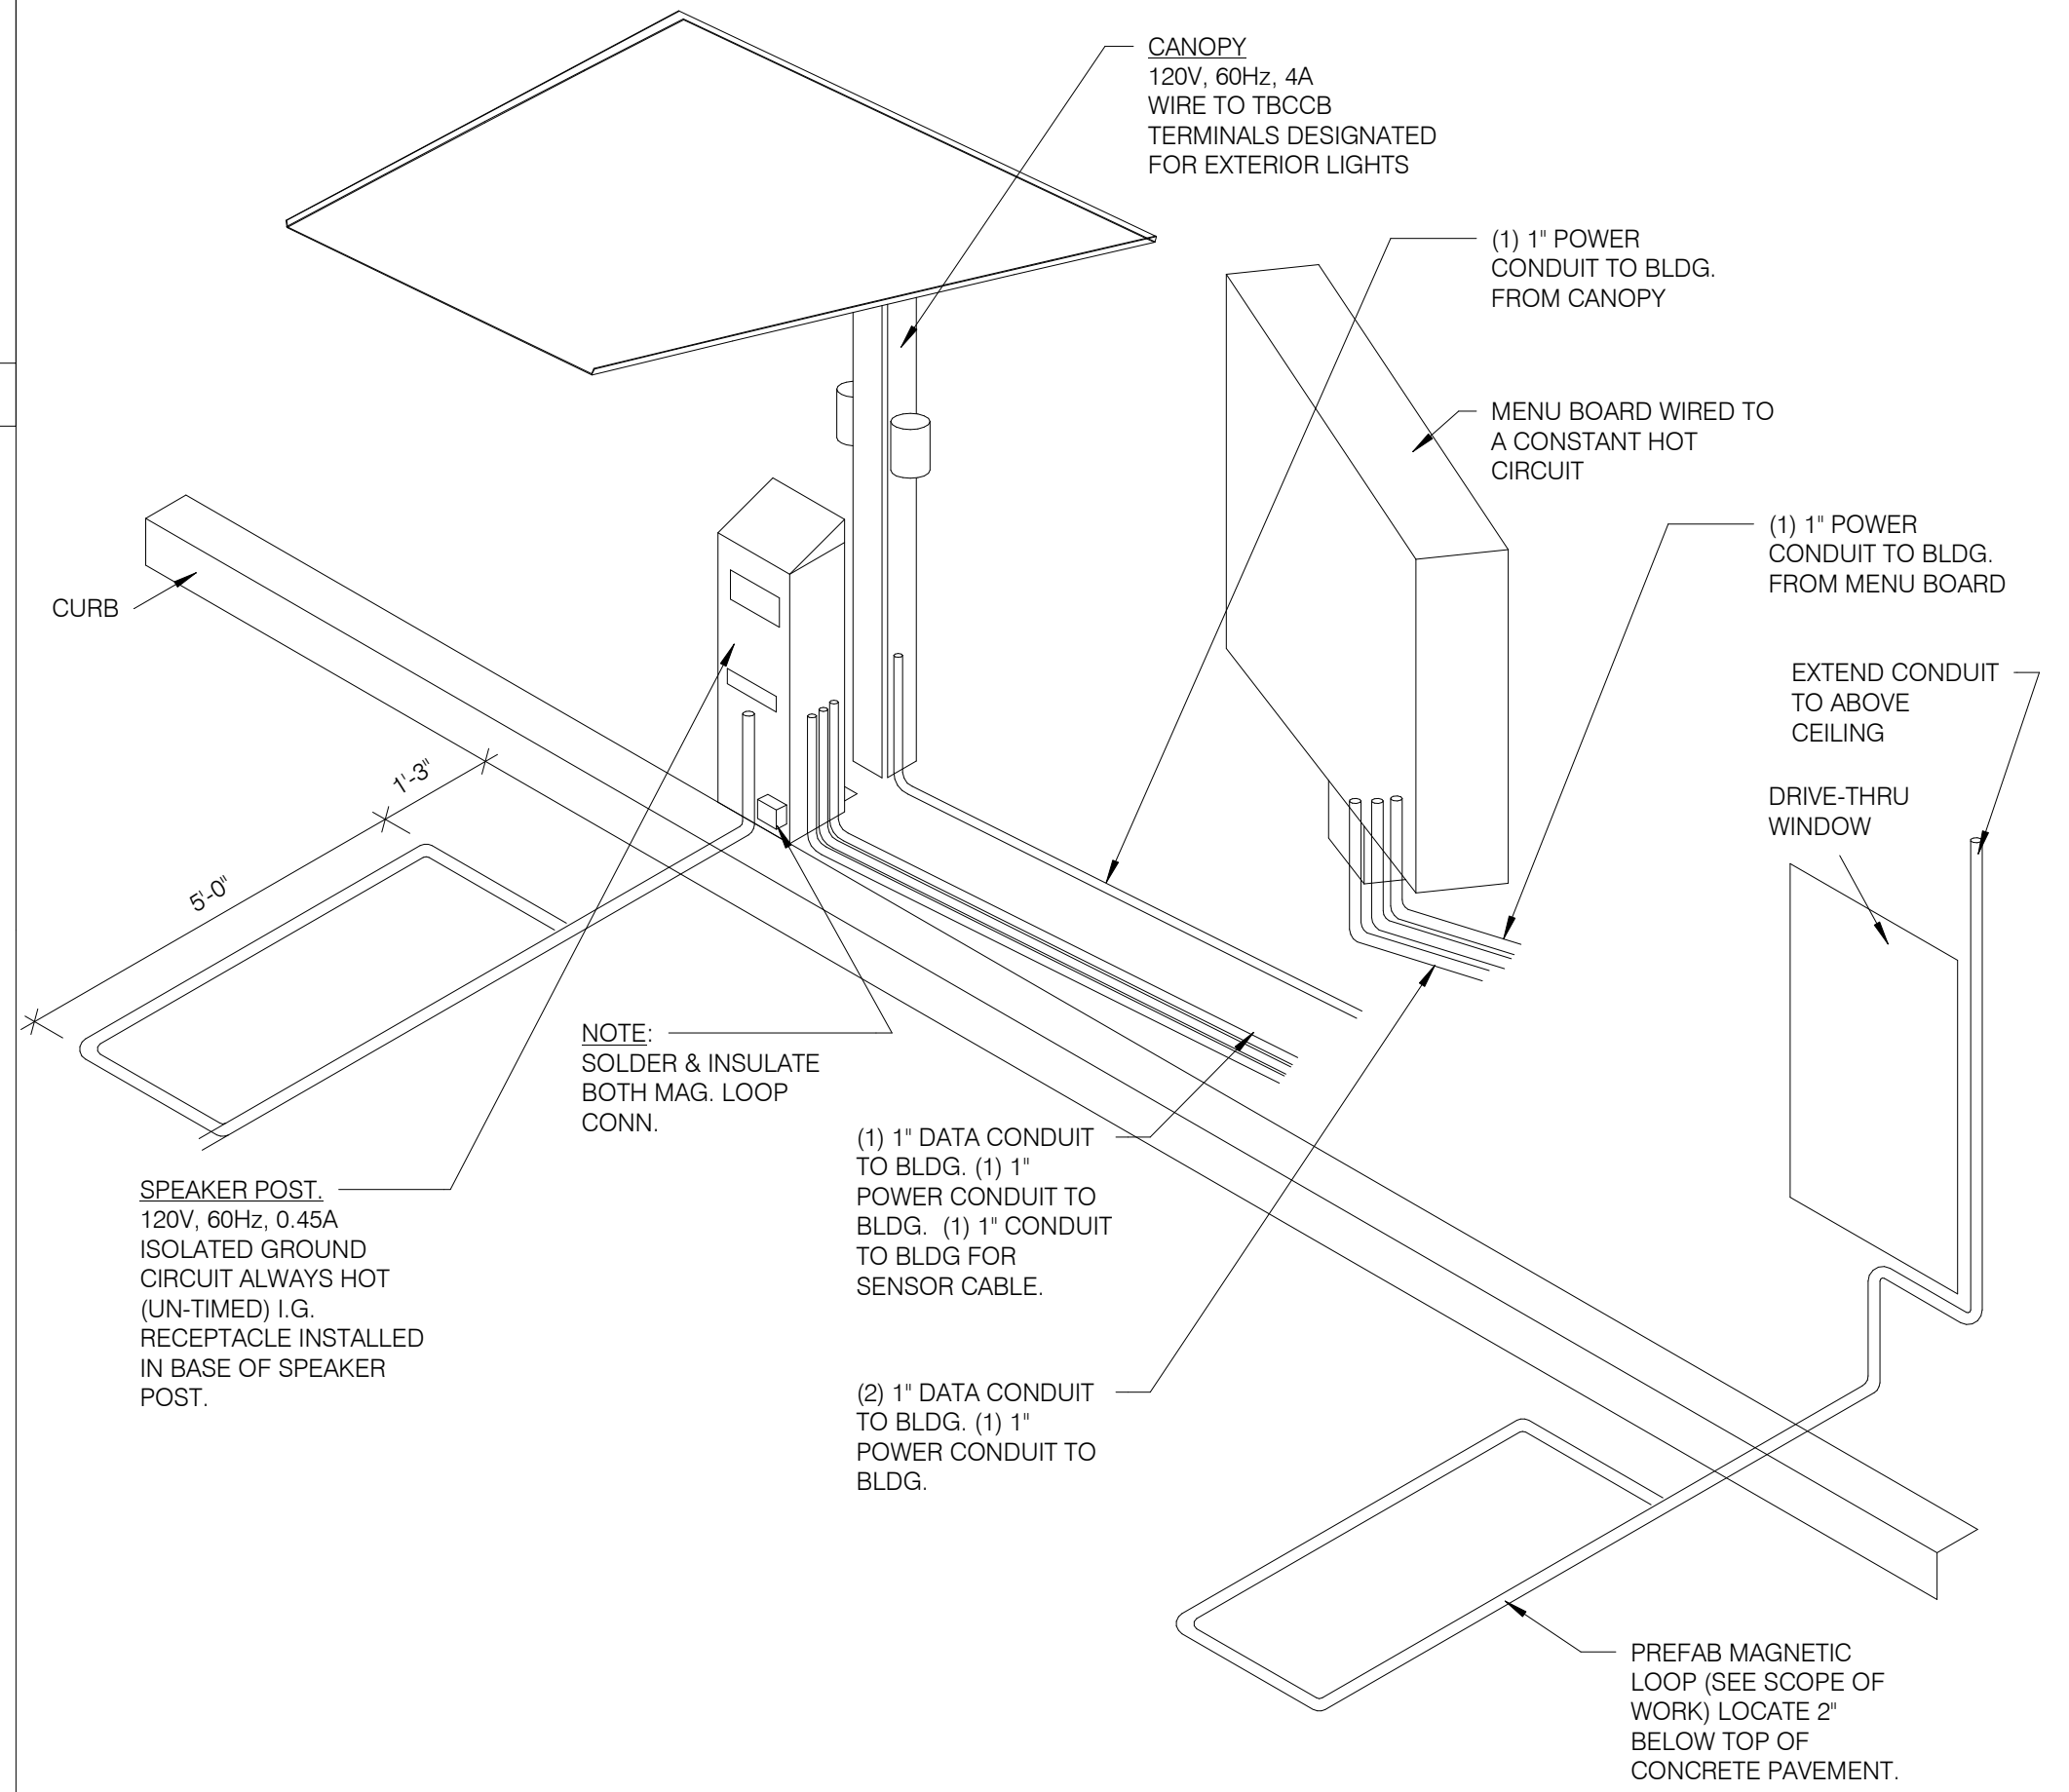

DRIVE-THRU COMMUNICATIONS ISOMETRIC N.T.S. **3**

NOT USED N.T.S. **8**

NOT USED N.T.S. **9**

NOT USED N.T.S. **6**

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER: DICKSON
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: AJR
 JOB NO.: 2020088.03


TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236



**ENDEAVOR 2.0
 ELECTRICAL
 DETAILS**

E7.0

PLOT DATE: 11/3/2022 9:59:41 AM

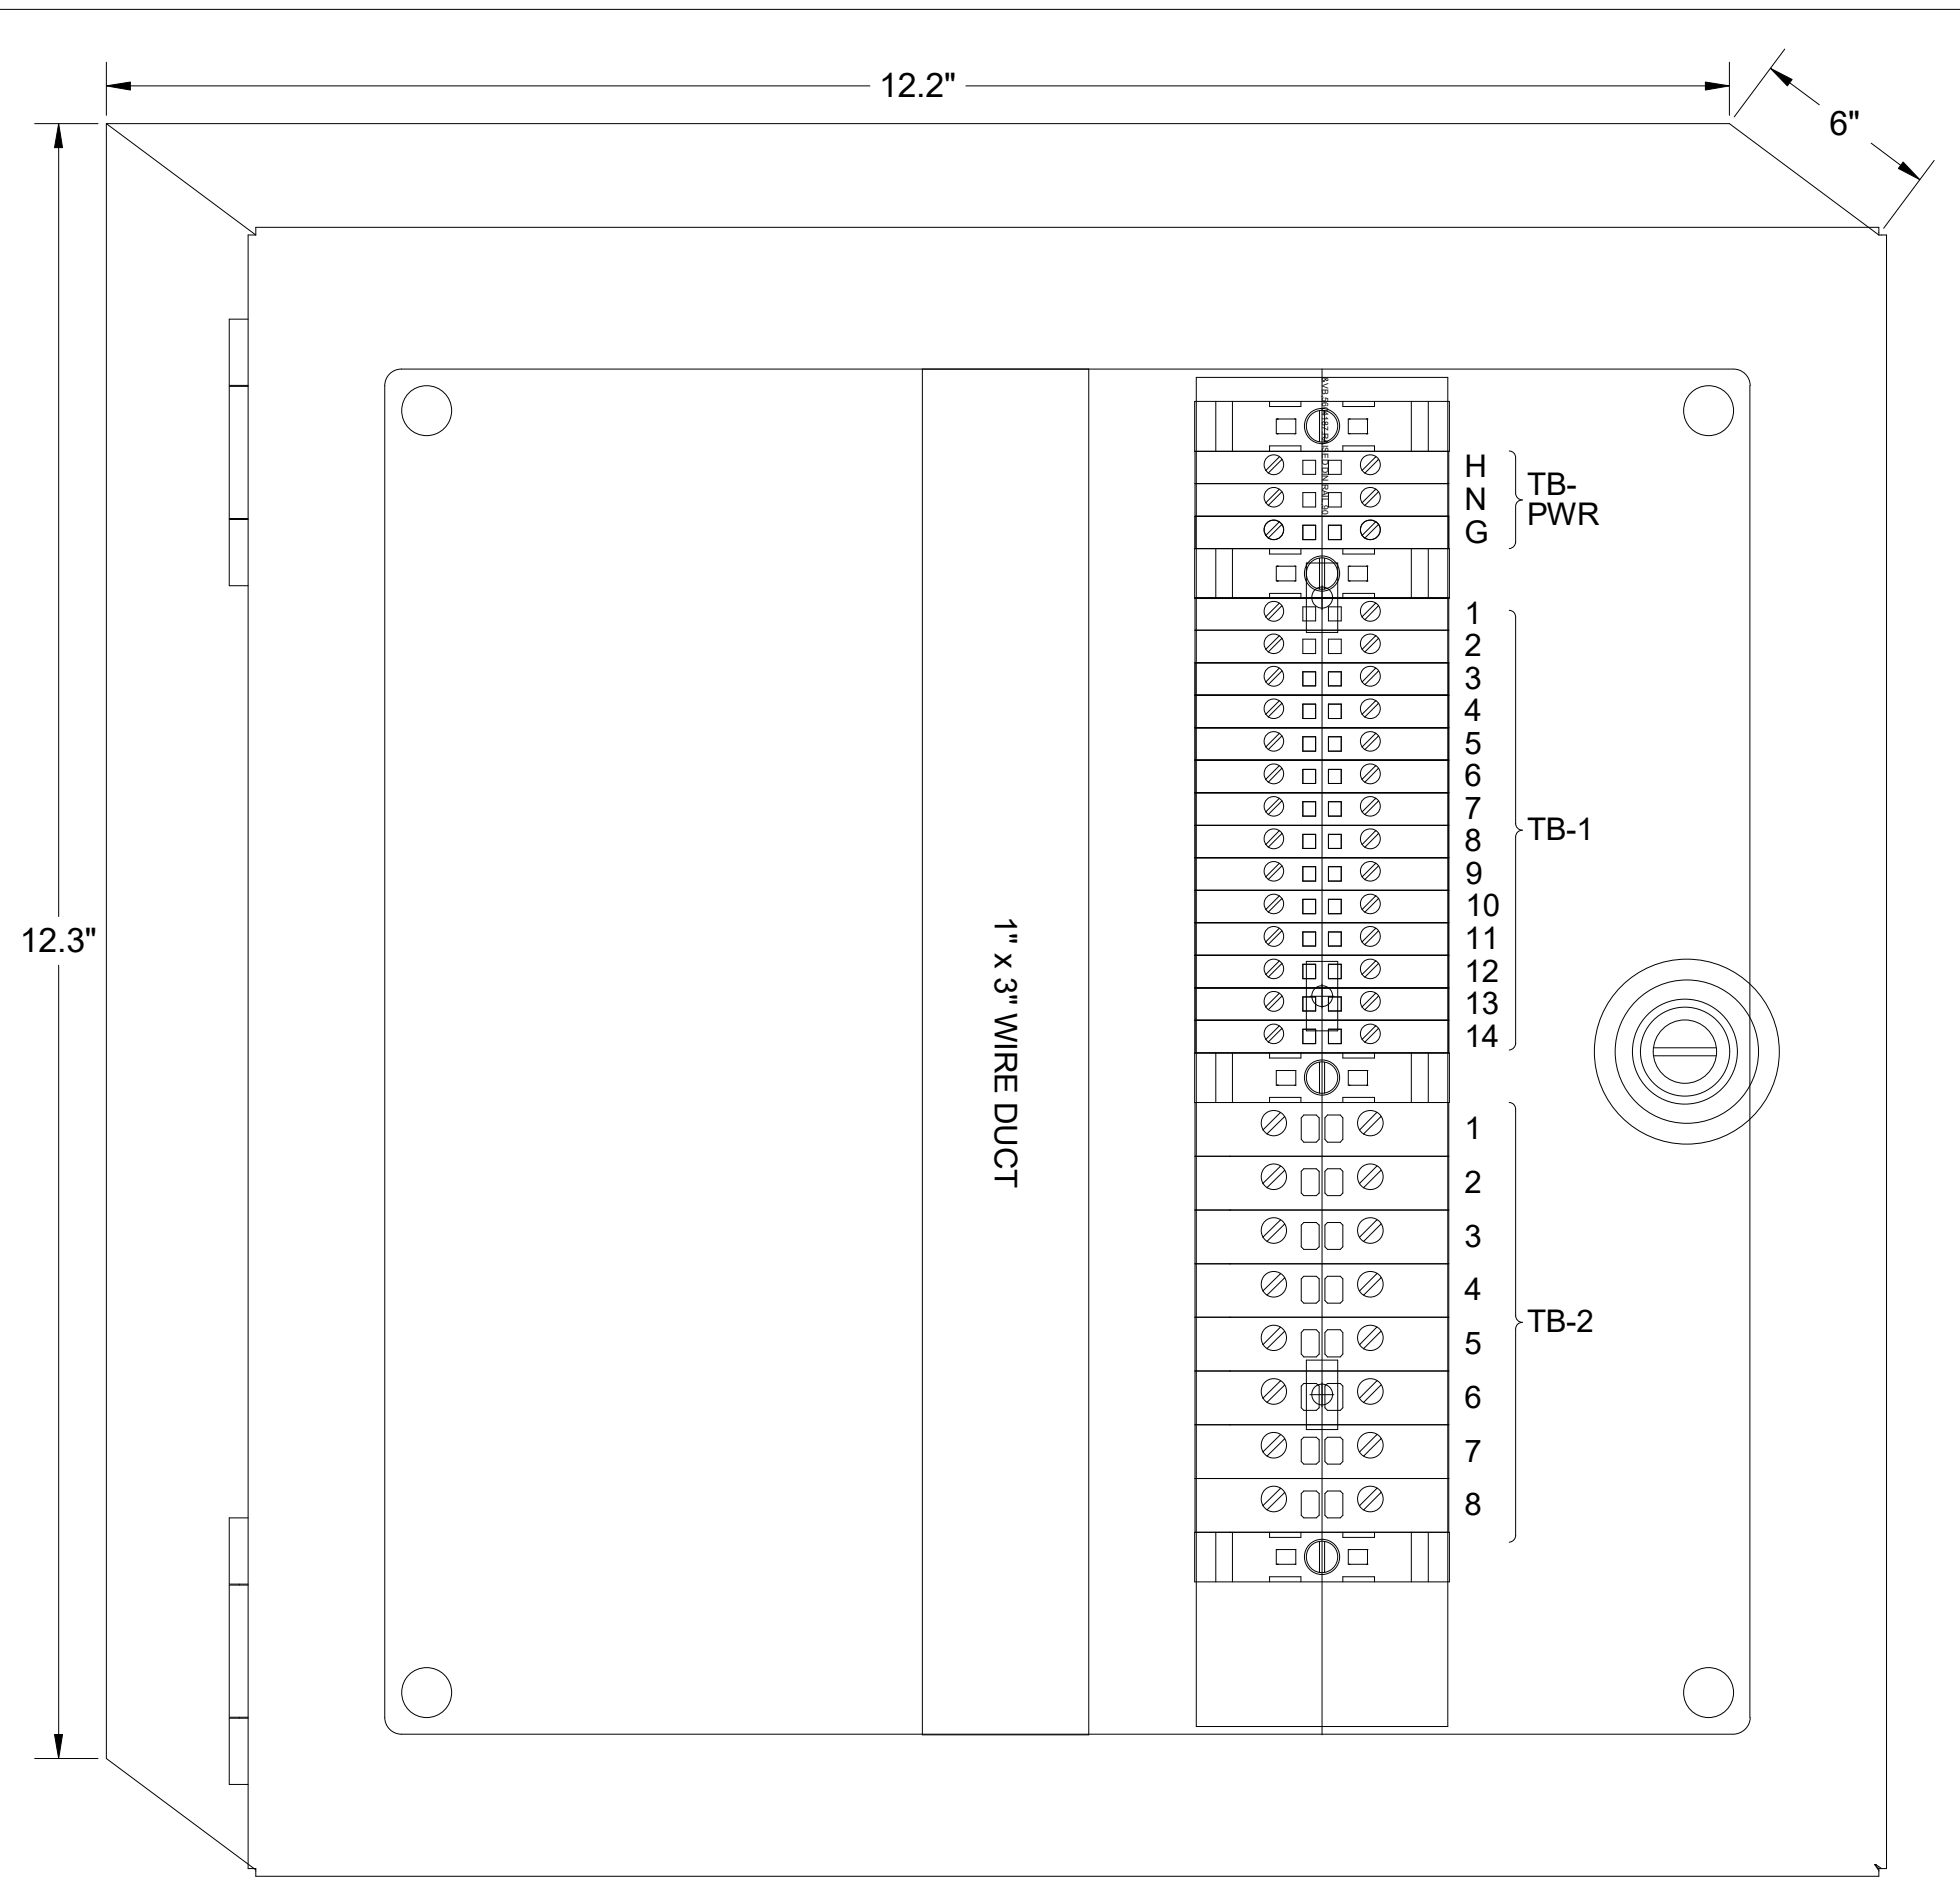


1 TBANS PANEL DIMENSIONS NTS


SEQUENCE OF OPERATION:
ACTIVATION OF HOOD FIRE SUPPRESSION SYSTEM RELAY SHALL CAUSE TBANS TO DE-ENERGIZE LOAD, THUS REMOVING POWER FROM ALL DEVICES CONNECTED TO EQUIPMENT LOCATED UNDER THE GREASE HOOD.

CONTROL BOX
TACO BELL'S SUPPLIER OF THE CONTROL BOX IS AIR CARE EXPERTS. UNLESS NOTED OTHERWISE, TBANS CONTROL BOX TO BE PURCHASED AND INSTALLED BY THE ELECTRICAL CONTRACTOR.
NOTE: TBANS MAY BE INCLUDED IN THE LIGHTING PACKAGE. ELECTRICAL CONTRACTOR IS RESPONSIBLE TO
VERIFY INCLUDES ALL WIRING AND COMPONENTS SHOWN FACTORY INSTALLED WITHIN THE BOX.
PRIMARY CONTACT: CHUCK MCCABE
PHONE: 949 770 2222
EMAIL: INFO@ACE-EMS.COM


TACO BELL REQUIRES VISUAL CERTIFICATION OF THIS INSTALLATION SEE SHEET M5.0 CONTACT CERTIFY@ACE-BCX.COM OR (949)-770-2222

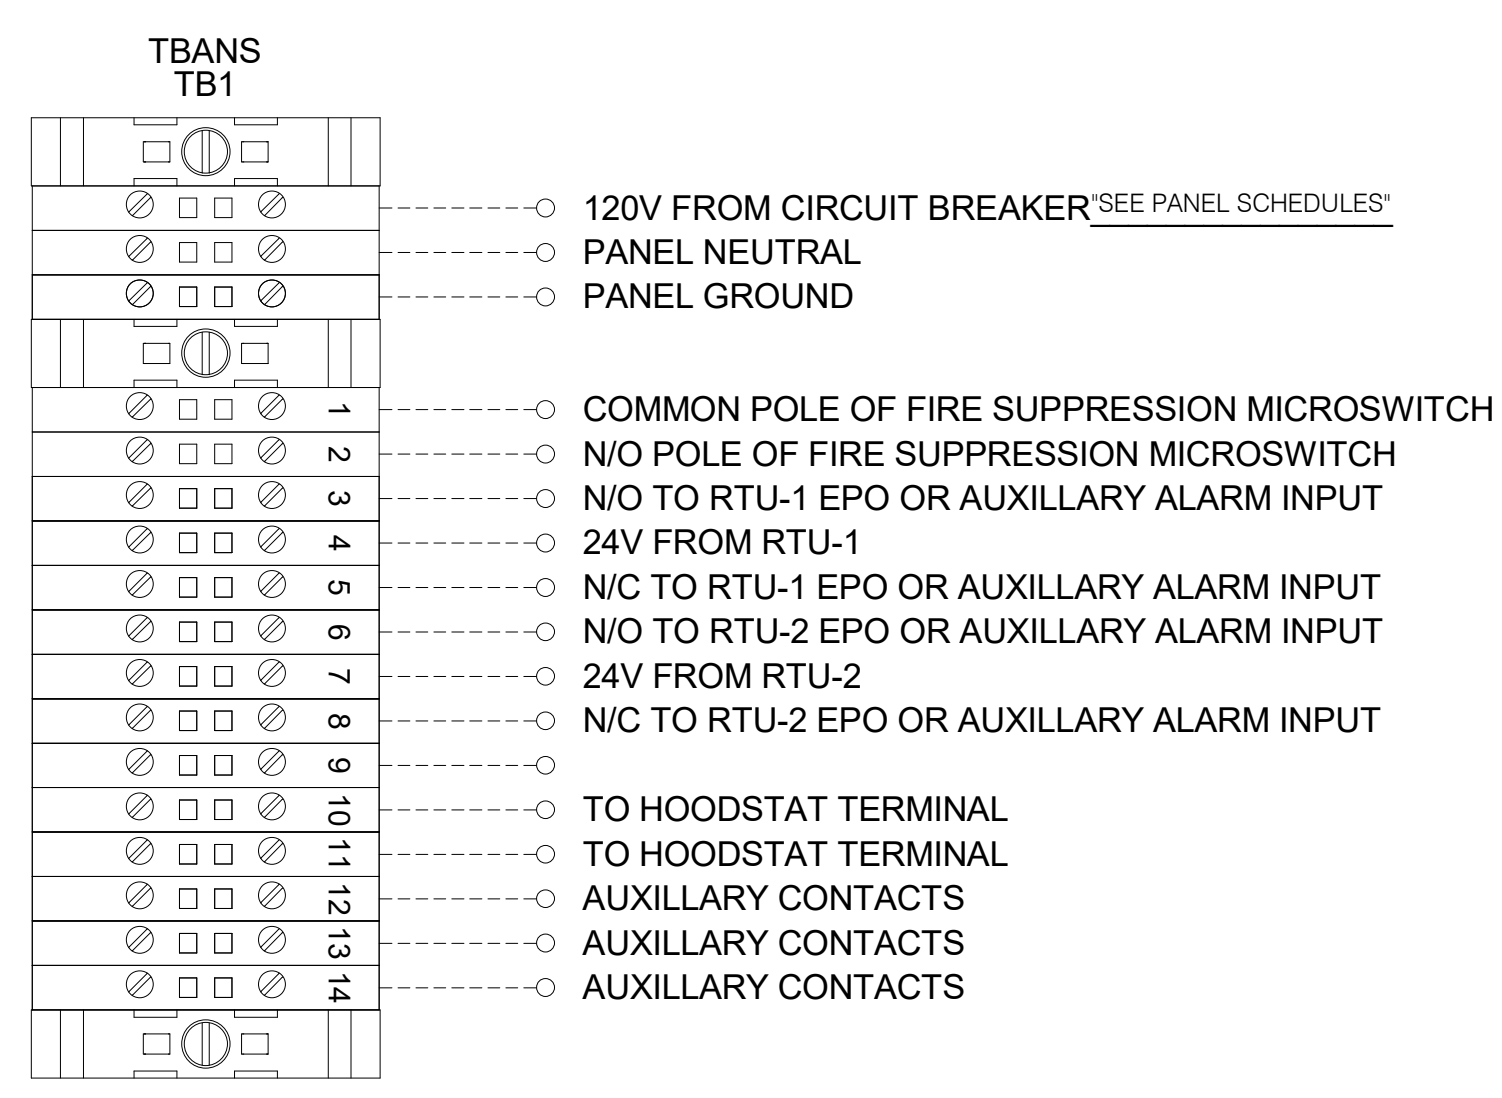


2 TBANS FIELD CONNECTIONS - VARIOUS NTS

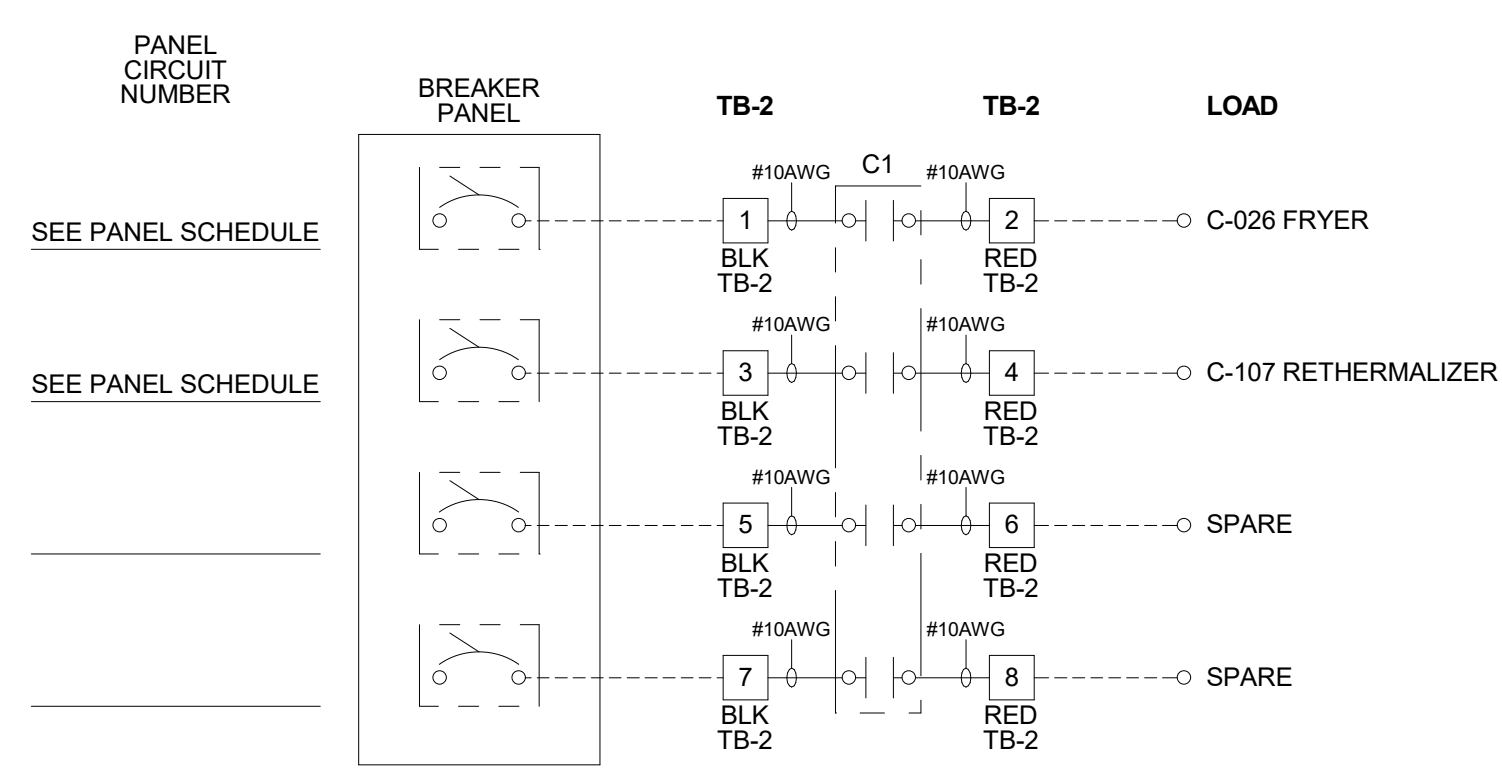


3 TBANS FIELD CONNECTIONS - APPLIANCES NTS

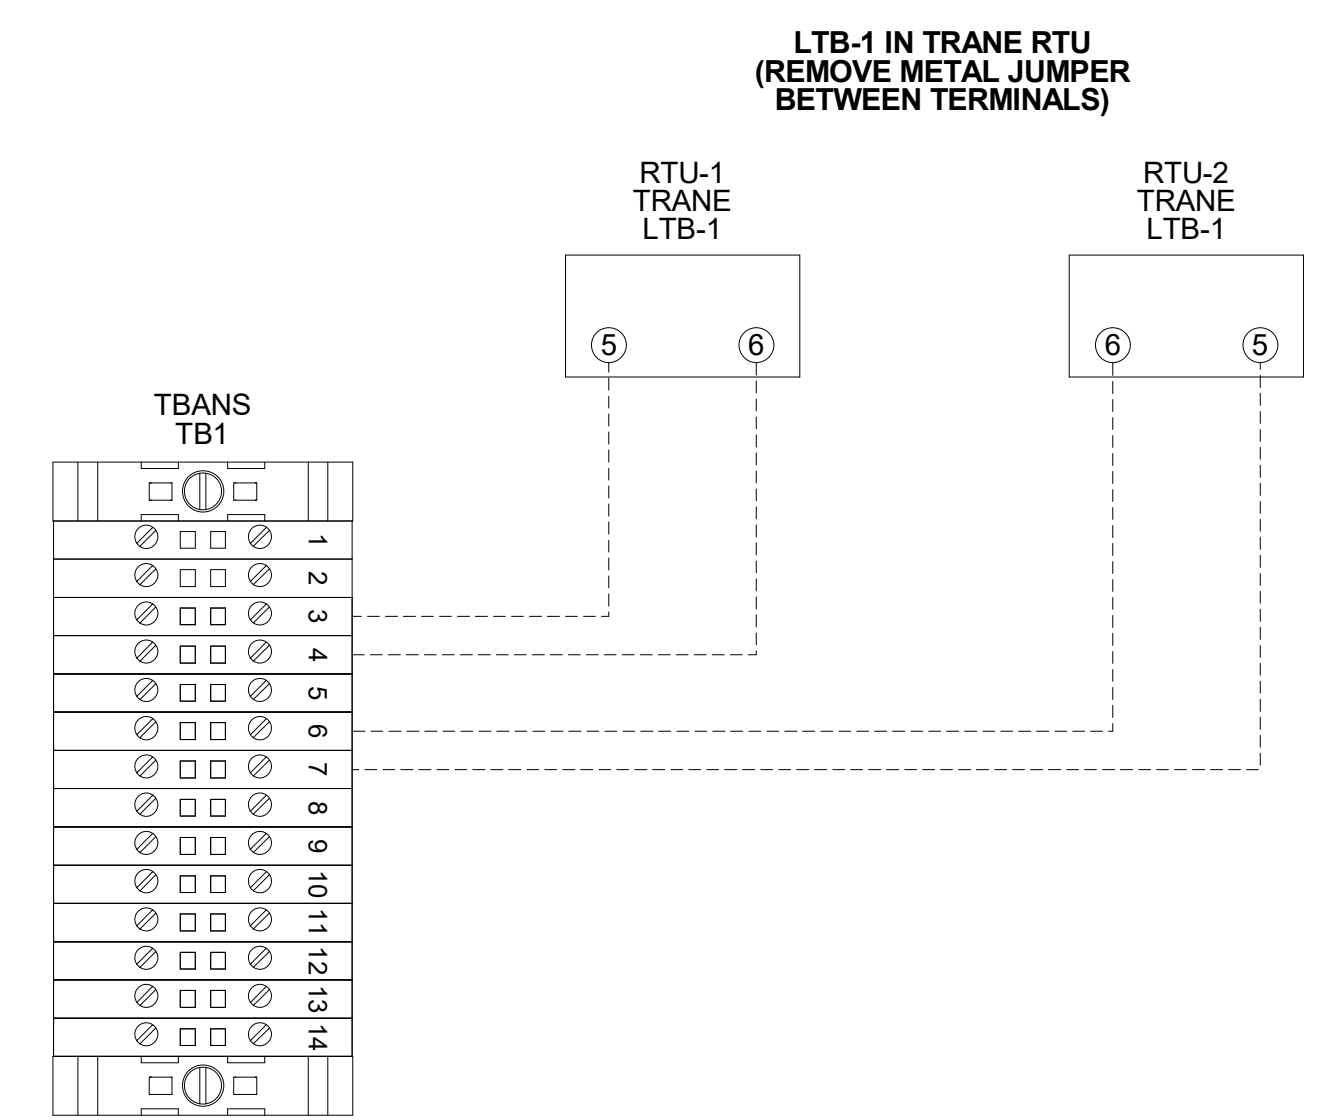

6 TBANS TO TRANE RTU SHUTDOWN NTS

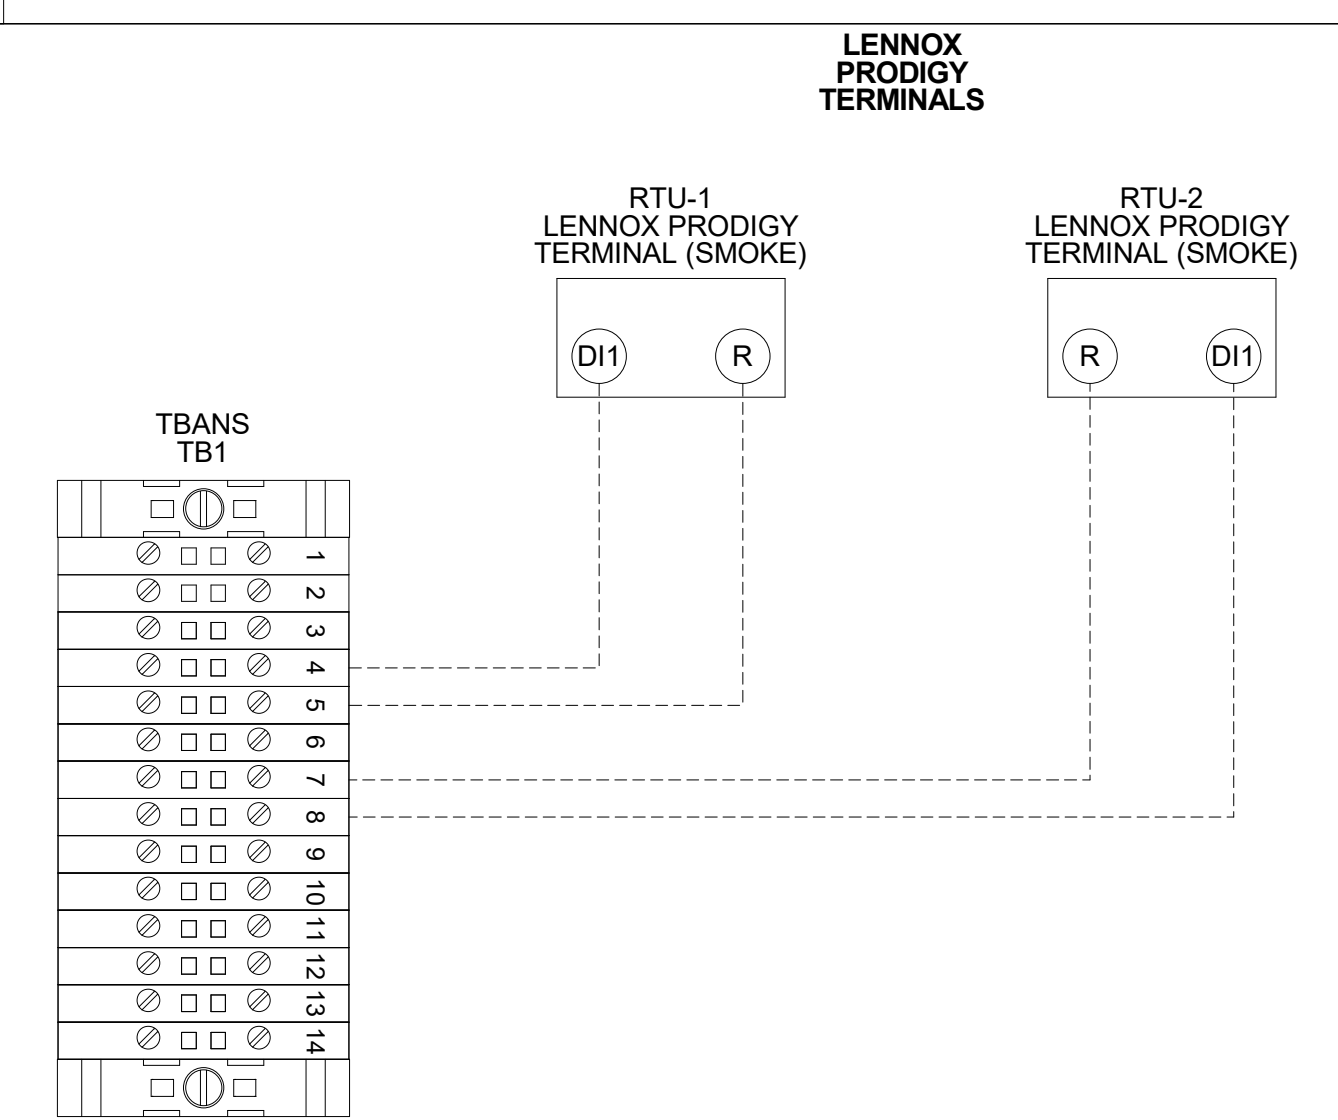

5 TBANS TO LENNOX PRODIGY SHUTDOWN NTS

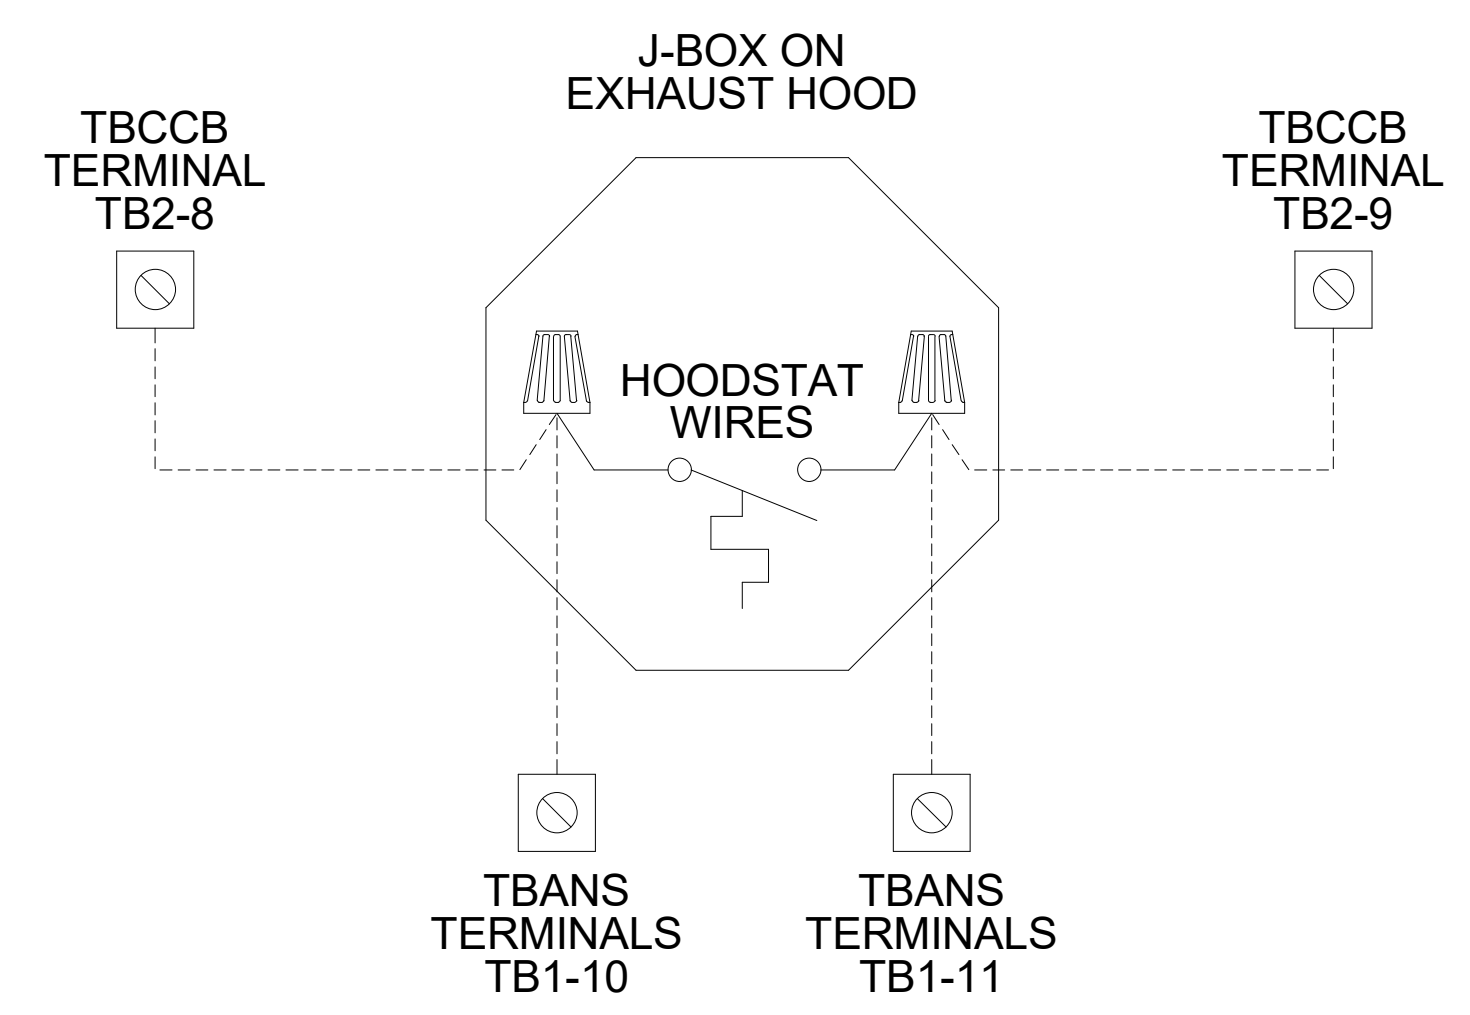

4 TBANS TO HOODSTAT TO TBCCB NTS

FOR REFERENCE ONLY

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
BUILDING TYPE: END, MED20
PLAN VERSION: MARCH 2021
BRAND DESIGNER: DICKSON
SITE NUMBER: 314481
STORE NUMBER: 454078
PA/PM: SM
DRAWN BY: AJR
JOB NO.: 2020088.03


TACO BELL
18550 E. WARREN AVE.,
DETROIT, MI 48236



ENDEAVOR 2.0
ELECTRICAL
DETAILS

E7.1

MECHANICAL – ELECTRICAL (ME) BALANCING & COMMISSIONING SEQUENCE & PROCEDURE

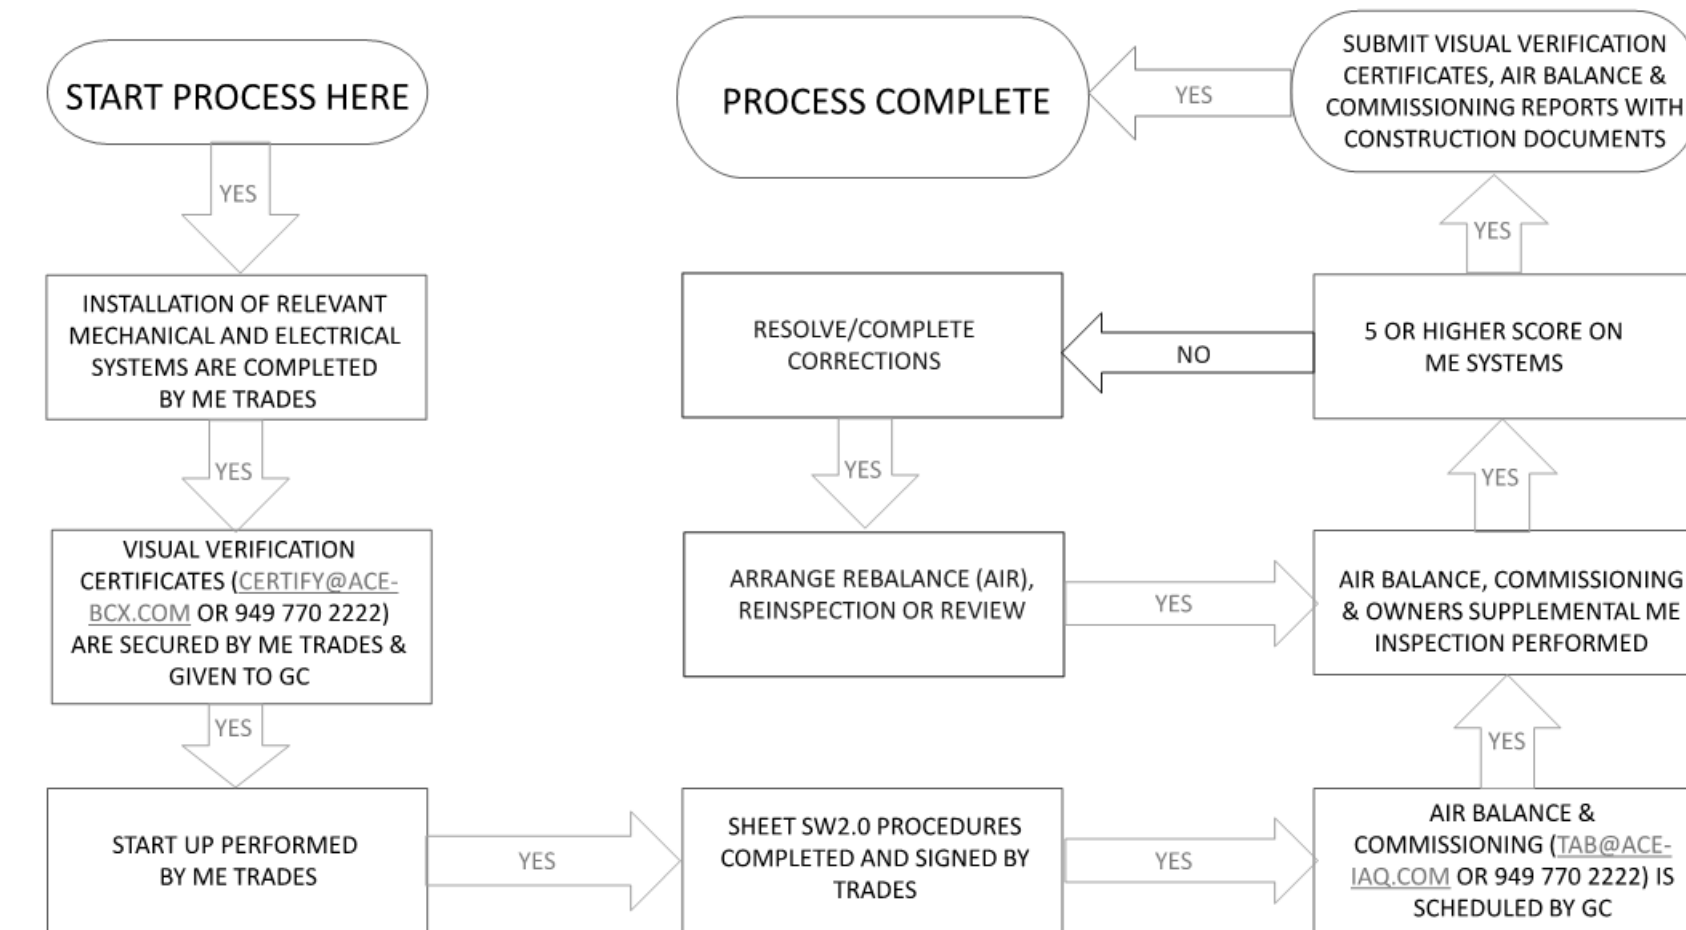

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END. MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.:
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE.,
 DETROIT, MI 48236



ENDEAVOR 2.0
BALANCING AND COMMISSIONING SEQUENCE

SW2.1

PLOT DATE: 11/3/2022 9:59:57 AM



TITLE	DESCRIPTION	SUPPLIER	MANUFACTURER'S MODEL	A&D ITEM #	ORDERED BY	SHIPPED BY	INSTALLED BY	SHOP DRAWINGS
6200	Roof Access Ladder & Hatch	Precision	FL 184 (Ladder) & PLHG (Hatch)	B-049 (Ladder) & B-050 (Hatch)	DIS	DIS	GC	
8341	Door - Security	LockNet	DU3670L52VED	-	RSCS	RSCS	GC	
10290-1	Air Curtain (D/T Window)	Marley	E2400-1115FG	B-151	DIS	DIS	GC	
10290-2	Air Curtain (Service Door)	Marley	E4200-1175	B-150	DIS	DIS	GC	
	Exterior Digital Menu Board & Optional Digital Preview Board	Everbrite Stratacache		-	CM (Company), CM or DIS (Franchise)	Manufacturer	GC - Foundation and Conduit Sign Vendor DMB Ins	X
	Interior Menuboard	VGS		-	DIS	Manufacturer	GC	
	Digital Menu Board	Stratacache		-				
10430	Signage (Bldg Signs, Road Signs, Directional Signs)	Cummings Signs Everbrite (Preferred Supplier) AGI	VARIES VARIES	VARIES VARIES	CM (Company), CM or DIS (Franchise)	Manufacturer	Manufacturer (Local Installer)	X
10536	Canopies	Cummings Signs Everbrite (Preferred Supplier) AGI	VARIES VARIES	VARIES VARIES	CM (Company), CM or DIS (Franchise)	Manufacturer	Manufacturer (Local Installer)	X
10810	Restroom Accessories	Accuserv	VARIES	F-452 (if indicated in plan set), B-241, B-265, B-275, B-290 (where occurs), B-291 (where occurs), B-300, B-305, B-405, B-410	DIS	DIS	GC	
11020-1	Safe	Brinks	Tidel Series 4 (duel single note validator, standard side vault)	F-174	CM	BRINKS	BRINKS	
11020-2	Security System	Tyco	-	-	CM	Manufacturer	GC	X
11030-1	Drive-thru Window	Quikserv	QKSRVSC4030BR	B-140	RSCS	Manufacturer	GC	
11030-3	Drive-thru Clearance Bar	Cummings Signs Everbrite (Preferred Supplier) AGI	- - -	- - -	CM	Manufacturer	GC	
11030-4	Drive-thru Sensor Loops	ERC Parts Inc.	WX8171	-	Manufacturer	Manufacturer	GC	
11100-3	P.O.S.	IBM NCR PAR	- - -	VARIES VARIES VARIES	TB / IT	Manufacturer	SSP	X
11100-4	Credit Card Payment System	Hughes Network Systems	-	-	TB / IT	Manufacturer	SSP	
11300-1	Order Confirmation Board (OCB)	Delphi Display Systems Hyperactive Texas Digital	P6YUC5STDUSV1S; P6YOC5STDUSEN1S TDMHX2H01TCB;TDMHX1H26 AVNGE60	L-090 L-095	DIS	DIS	GC (see Scope of Work notes)	
11300-2	Drive-thru Speaker & Microphone	HME 3M Food Services Trad Dept	C400005HS3TB; C11422TB 78691149153; G55HSSINGLE	U-011; S-204	DIS	Manufacturer	GC	
11300-4	DT Canopy	Cummings Signs Everbrite (Preferred Supplier) AGI	- - -	V-350	CM, Franchisee or DIS on behalf of Franchisee	Manufacturer	GC (see Scope of Work notes)	X
11400-1	Kitchen Equipment	N. Wasserstrom (Franchise only) RSCS (Preferred Supplier)	VARIES VARIES	VARIES VARIES	DIS	DIS	GC (see General Comments)	X
11400-5	GTO with EVO Production Line	Delfield Duke Carter Hoffman (Evo cabinets)	VARIES VARIES VARIES	VARIES VARIES VARIES	DIS	DIS	GC / Manufacturer (Local Installer)	X
11405-3	Kitchen Shelving / Workstations	I.S.S.	VARIES	VARIES	DIS	DIS	GC	
11405-4	Walk-In Cooler / Freezer (Panelized)	I.C.S. Norlake	VARIES VARIES	VARIES VARIES	GC	Manufacturer	GC or Manufacturer (up to CM's discretion)	X
11425	Exhaust Hoods	Stratavent (preferred supplier) Gaylord Industries (Boiler hood) Randell (alternate supplier)	VARIES VARIES VARIES	VARIES VARIES VARIES	DIS	DIS	GC	X
11430-2	Drink Dispensers / Line Sets	Pepsi	-	-	RSCS	Pepsi	Pepsi (Local installer)	
11435-6	Ice Machines	Manitowoc Ice Inc & Hoshisaki	Manitowoc SY-1474C	S-513	DIS	Manufacturer	Manufacturer (Local Installer)	
11680	Office Computer (Taco System)	En Pointe Global Services	-	F-040, F-060	TB / IT	SSP	SSP	
12100-1	Artwork	GFX VGS Creative Pallette	VARIES - -	- - -	DIS	DIS	GC	
12400-5	Décor	Custom Seating (Company Supplier, base décor) FCI (Company Supplier, base décor) IDX	VARIES VARIES VARIES	- - -	DIS	DIS	GC	X
12430	Fruitista Machine	Equipment Delivery, Install and Activation FBD Equipment Manufacturer Cornelius Taco Bell Engineering	VARIES VARIES VARIES VARIES	VARIES VARIES VARIES VARIES	DIS - Equipment; GC - Installation & Setup (notify vendor 2 weeks from install date)	DIS	Service Agents - ICEE (East) or RepTec (West)	
12440	Iced Tea	Pepsi	E56150000	S-546	DIS	Supplier	GC / Supplier	
13200	CO2 - Bulk	MVE (bulk tank) NU CO2 (CO2 and service)	VARIES VARIES	S-580 S-580	DIS	DIS	Manufacturer (Local Installer)	
13700-4	CCTV	MARTCO	-	-	RSCS	MARTCO	MARTCO	X
13800-1	Energy/Building Management System	Air Care Experts Air Care Experts	TBCCB-Varies TBCCB-Varies	- -	DIS DIS	DIS DIS	GC GC	
13800-2	Hood Shutdown System	Air Care Experts	TBANS	-	Contractor	Air Care	GC	
13900-1	Fire Suppression System	Ansul	-	-	GC	GC	GC (Local Installer)	
15410	Hand Sinks	Aero	HS-Mod	N-053	DIS	DIS	GC	
15470-5	Water Filter	Shurflo	WB6-M3-22-003	-	DIS	Manufacturer	GC (see Vendor Scope - Pepsi Drink System)	
15480-3	Water Heater	AO Smith (standard) Bradford White (alternate)	AO Smith BTH-120 (standard) -	B-215 B-215	RSCS	RSCS	GC	
	Water softener	-	-	-	RSCS	RSCS	GC	
15500-1	HVAC - Test and Balance	- Melink Corp/ Air Care Experts	- - -	- - -	Determined by CM or RCM; Approved options - GC CM/RCM	Determine by CM or RCM; Approved options - GC CM/RCM	Determined by GC / CM / RCM	X
15500-2	Commissioning	Air Care Experts	-	-	GC	Air Care Experts	GC	
15500-3	Visual Verification	Air Care Experts	-	-	GC	Air Care Experts	GC	
15700-1	HVAC	Trane (Franchisee Only) Lennox (Company and Franchisee Stores) York international (Franchisee Only)	VARIES VARIES VARIES	- - -	GC GC	Manufacturer Manufacturer	GC GC	X
16300-1	Switchgear - Franchisee	Accuserv	Square-D and Cutler Hammer	VARIES	DIS	DIS	GC	X
16300-2	Switchgear - Company	Capital Lighting Capital Lighting Accuserv	Square-D and Cutler Hammer Square-D and Cutler Hammer Square-D and Cutler Hammer	VARIES VARIES VARIES	DIS DIS GC or RSCS (confirm with CM at time of bid)	DIS DIS GC	GC GC GC	X
16500	Light Fixtures - Interior and Building	Capital Lighting Accuserv (all lighting except BOH & restrooms)	VARIES VARIES	- -	DIS DIS	DIS DIS	GC GC	X
16520	Light Fixtures - Site	Capital Lighting Accuserv	VARIES VARIES	- -	DIS DIS	DIS DIS	GC GC	
16720	Telephone Communications	YUM! Telecom (Company stores) By owner through local phone service provider (franchise)	- -	- -	TB Franchisee	Manufacturer Manufacturer	Manufacturer (Local Installer) Manufacturer (Local Installer)	X
16820-3	Music System	Mood Media	-	F-131	TB	Manufacturer	Manufacturer (Local Installer)	X
	Coffee Brewer	Bunn	42300.0008	S-547	RSCS	RSCS	GC	
	Floor and Wall Tile	Creative Materials	-	-	GC	Manufacturer	GC	X

DATE	REMARKS
11.07.22	Issued for Construction

CONTRACT DATE: 02.28.22
 BUILDING TYPE: END, MED20
 PLAN VERSION: MARCH 2021
 BRAND DESIGNER:
 SITE NUMBER: 314481
 STORE NUMBER: 454078
 PA/PM: SM
 DRAWN BY.: RS
 JOB NO.: 2020088.03

TACO BELL
 18550 E. WARREN AVE
 DETROIT, MI 48236



ENDEAVOR 2.0
SCOPE OF WORK

SW1.0
 PLOT DATE: 11/3/2022 11:20:41 AM