



STRATOVENT EXHAUST FAN

TAG	STRATOVENT MODEL #	CFM	ESP	RPM	H.P.	B.H.P.	Ø	VOLT	FLA	MCA/MOP	WEIGHT (LBS.)	SONES
KEF-1	SVDU8SHFA	1700	1.300	1414	0.75	0.55	1	115	9.8	12.3/20	117	15
KEF-2	SVDU8SHFA	1700	1.300	1414	0.75	0.55	1	115	9.8	12.3/20	117	15

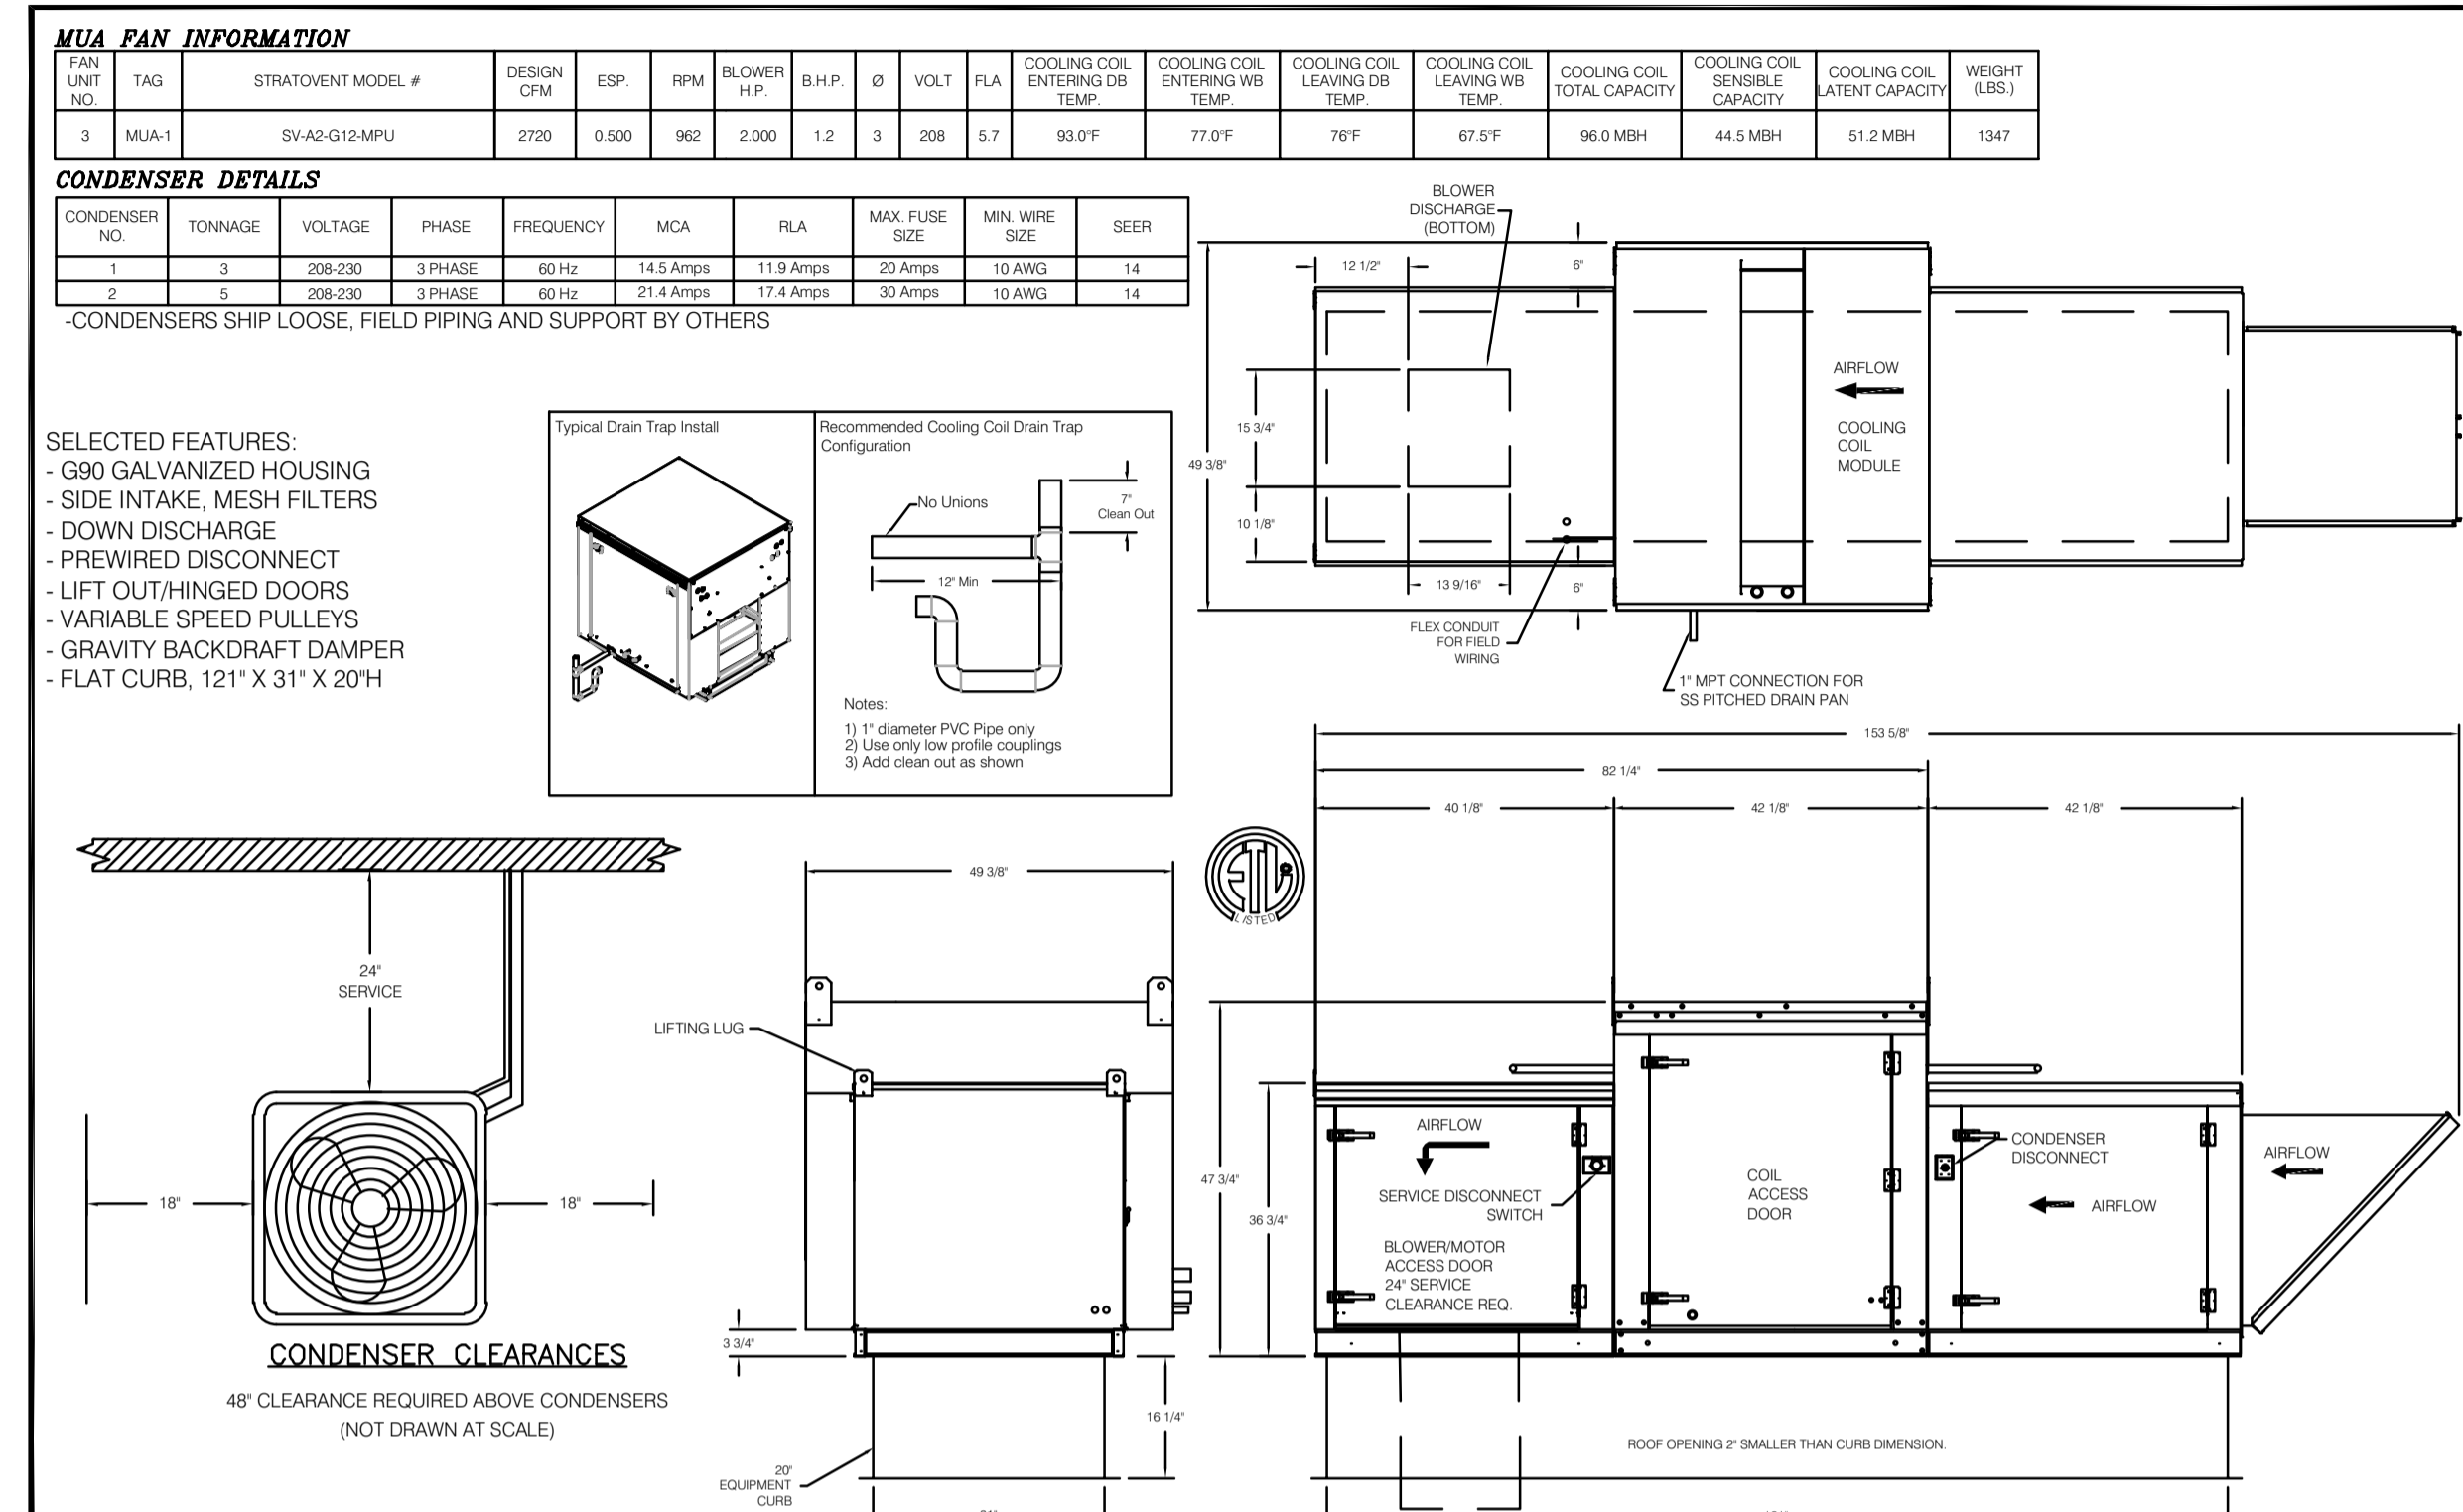

REVIEWED
For Code Compliance
City of Ocala Growth Management
BLD22-1101 09/07/22

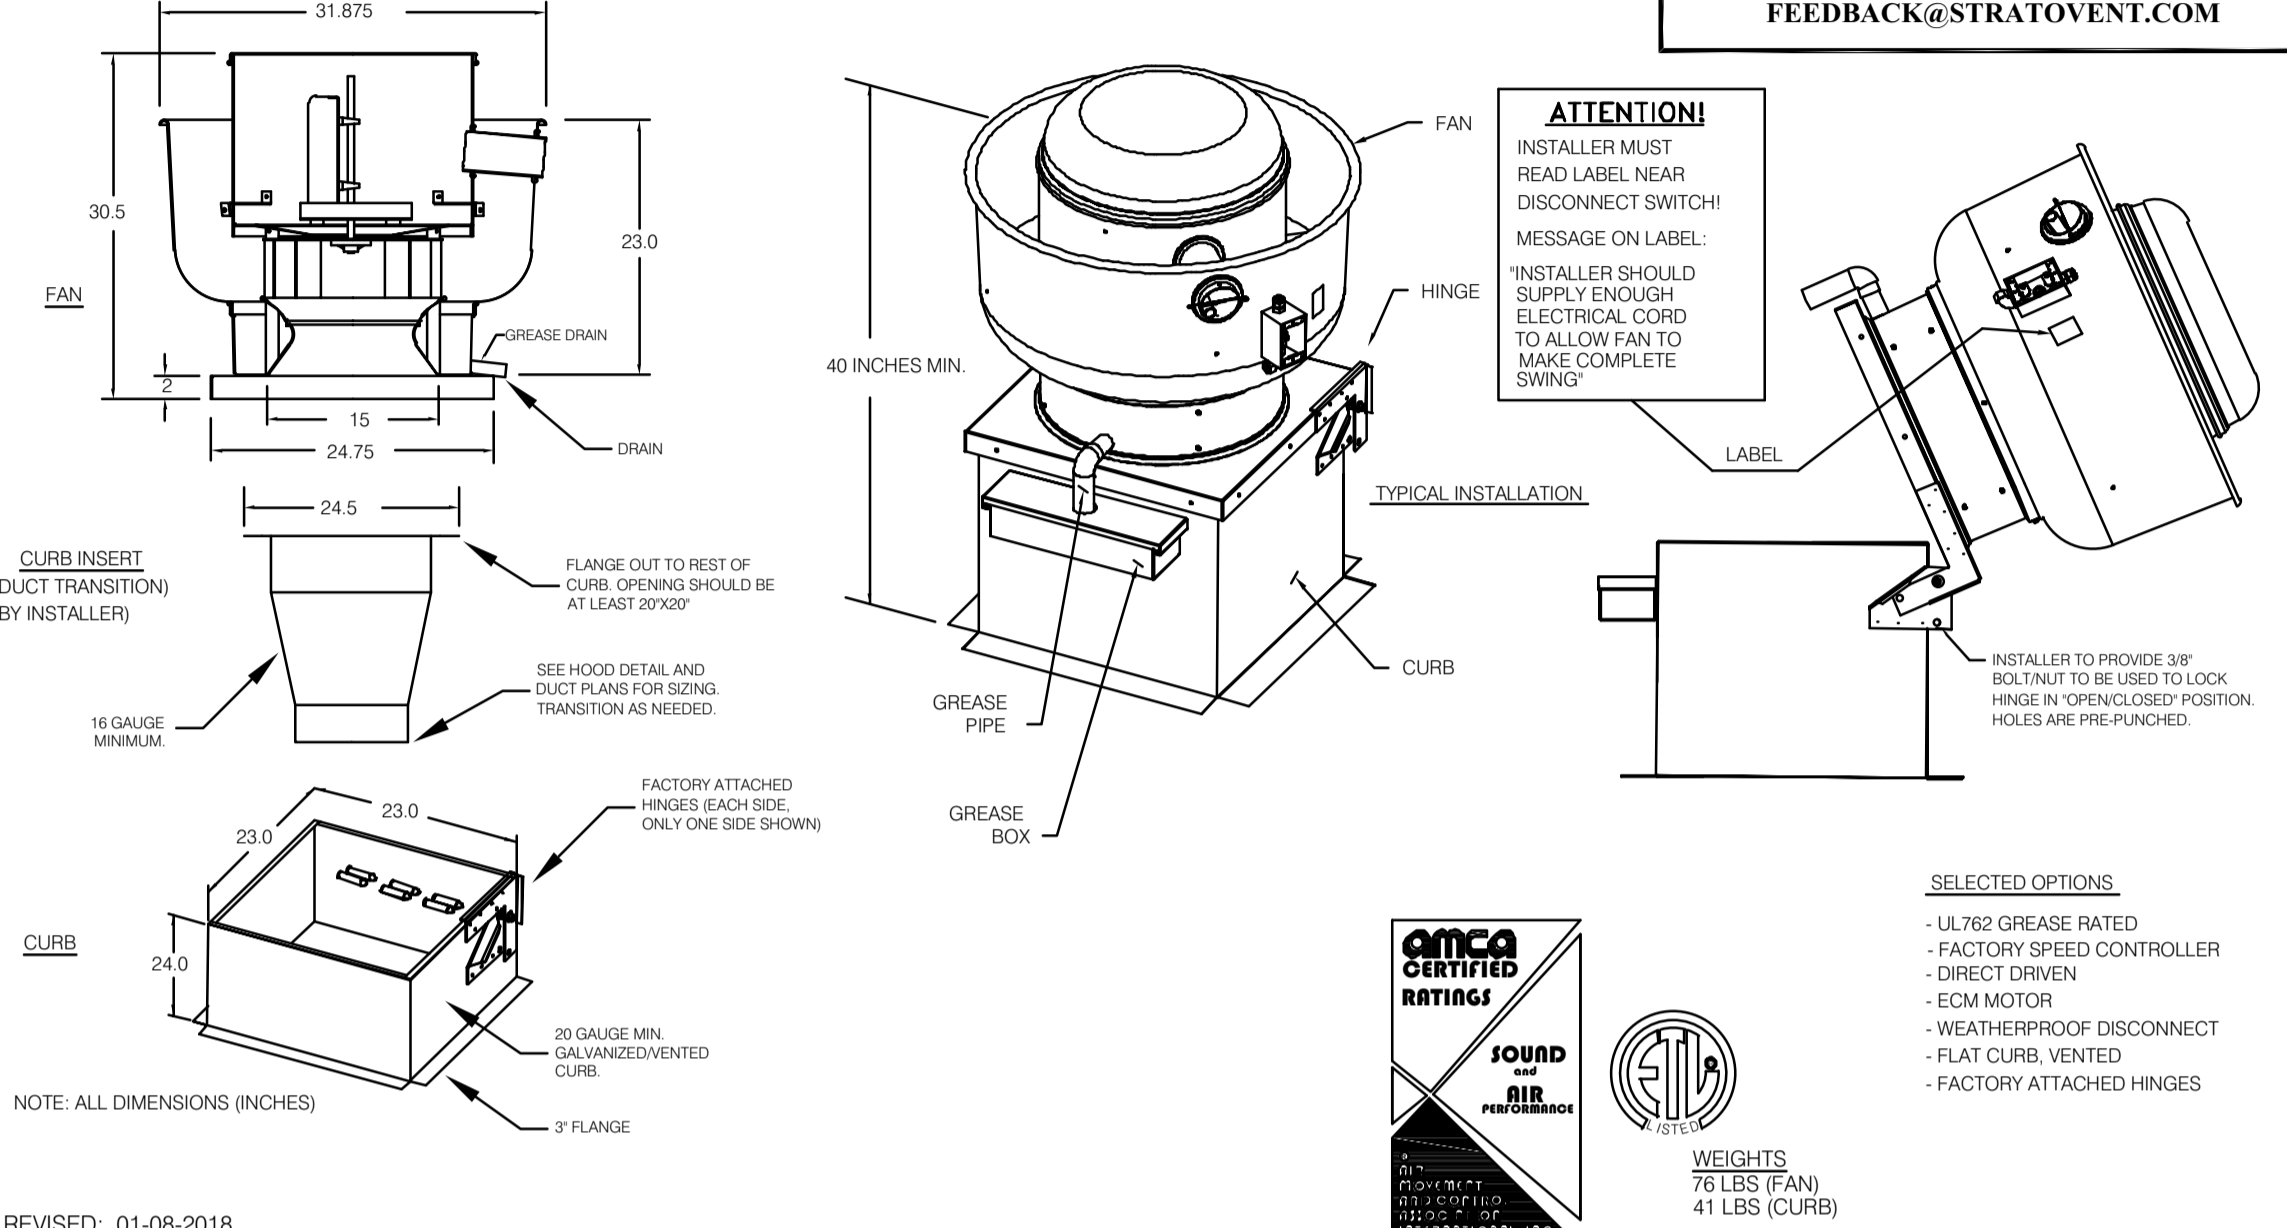

4641 Paragon Park, Raleigh, NC, 27616 PHONE: (919) 573-4250 FAX: (919) 573-4250 EMAIL: jeff.johnson@stratovent.com

LIS ARCHITECTURE ENGINEERING
LAND INVESTMENT SERVICES, LLC
AA 2602040 CA NO: 6853 LB1057
ARCHITECTURE / ENGINEERING OFFICE
1101 E. Palm Beach Blvd.
Suite 2064, Ocala, FL 32765
Phone: (321) 244-0402
facsimile: (321) 244-0419

Digitally signed by ROBERT W. CASE
Date: 2022.03.31 10:27:53 -04'00'
ROBERT WAYNE CASE
FLORIDA PE #44643

PLAN SET REVISIONS:

△	
△	
△	
△	
△	
△	
△	
△	
△	
△	



CONTRACT DATE: ...-2019
BUILDING TYPE: Kf 30-19
PLAN VERSION: 2018.A
SITE NUMBER:
ENTITY NUMBER:
STORE NUMBER:
LIS PROJECT: 2019-304

KFC
3615 W SILVER SPRINGS BLVD.
OCALA, FL

HOOD PLAN ELEVATIONS AND SECTIONS

M3.1

PLOT DATE: 03/29/2022

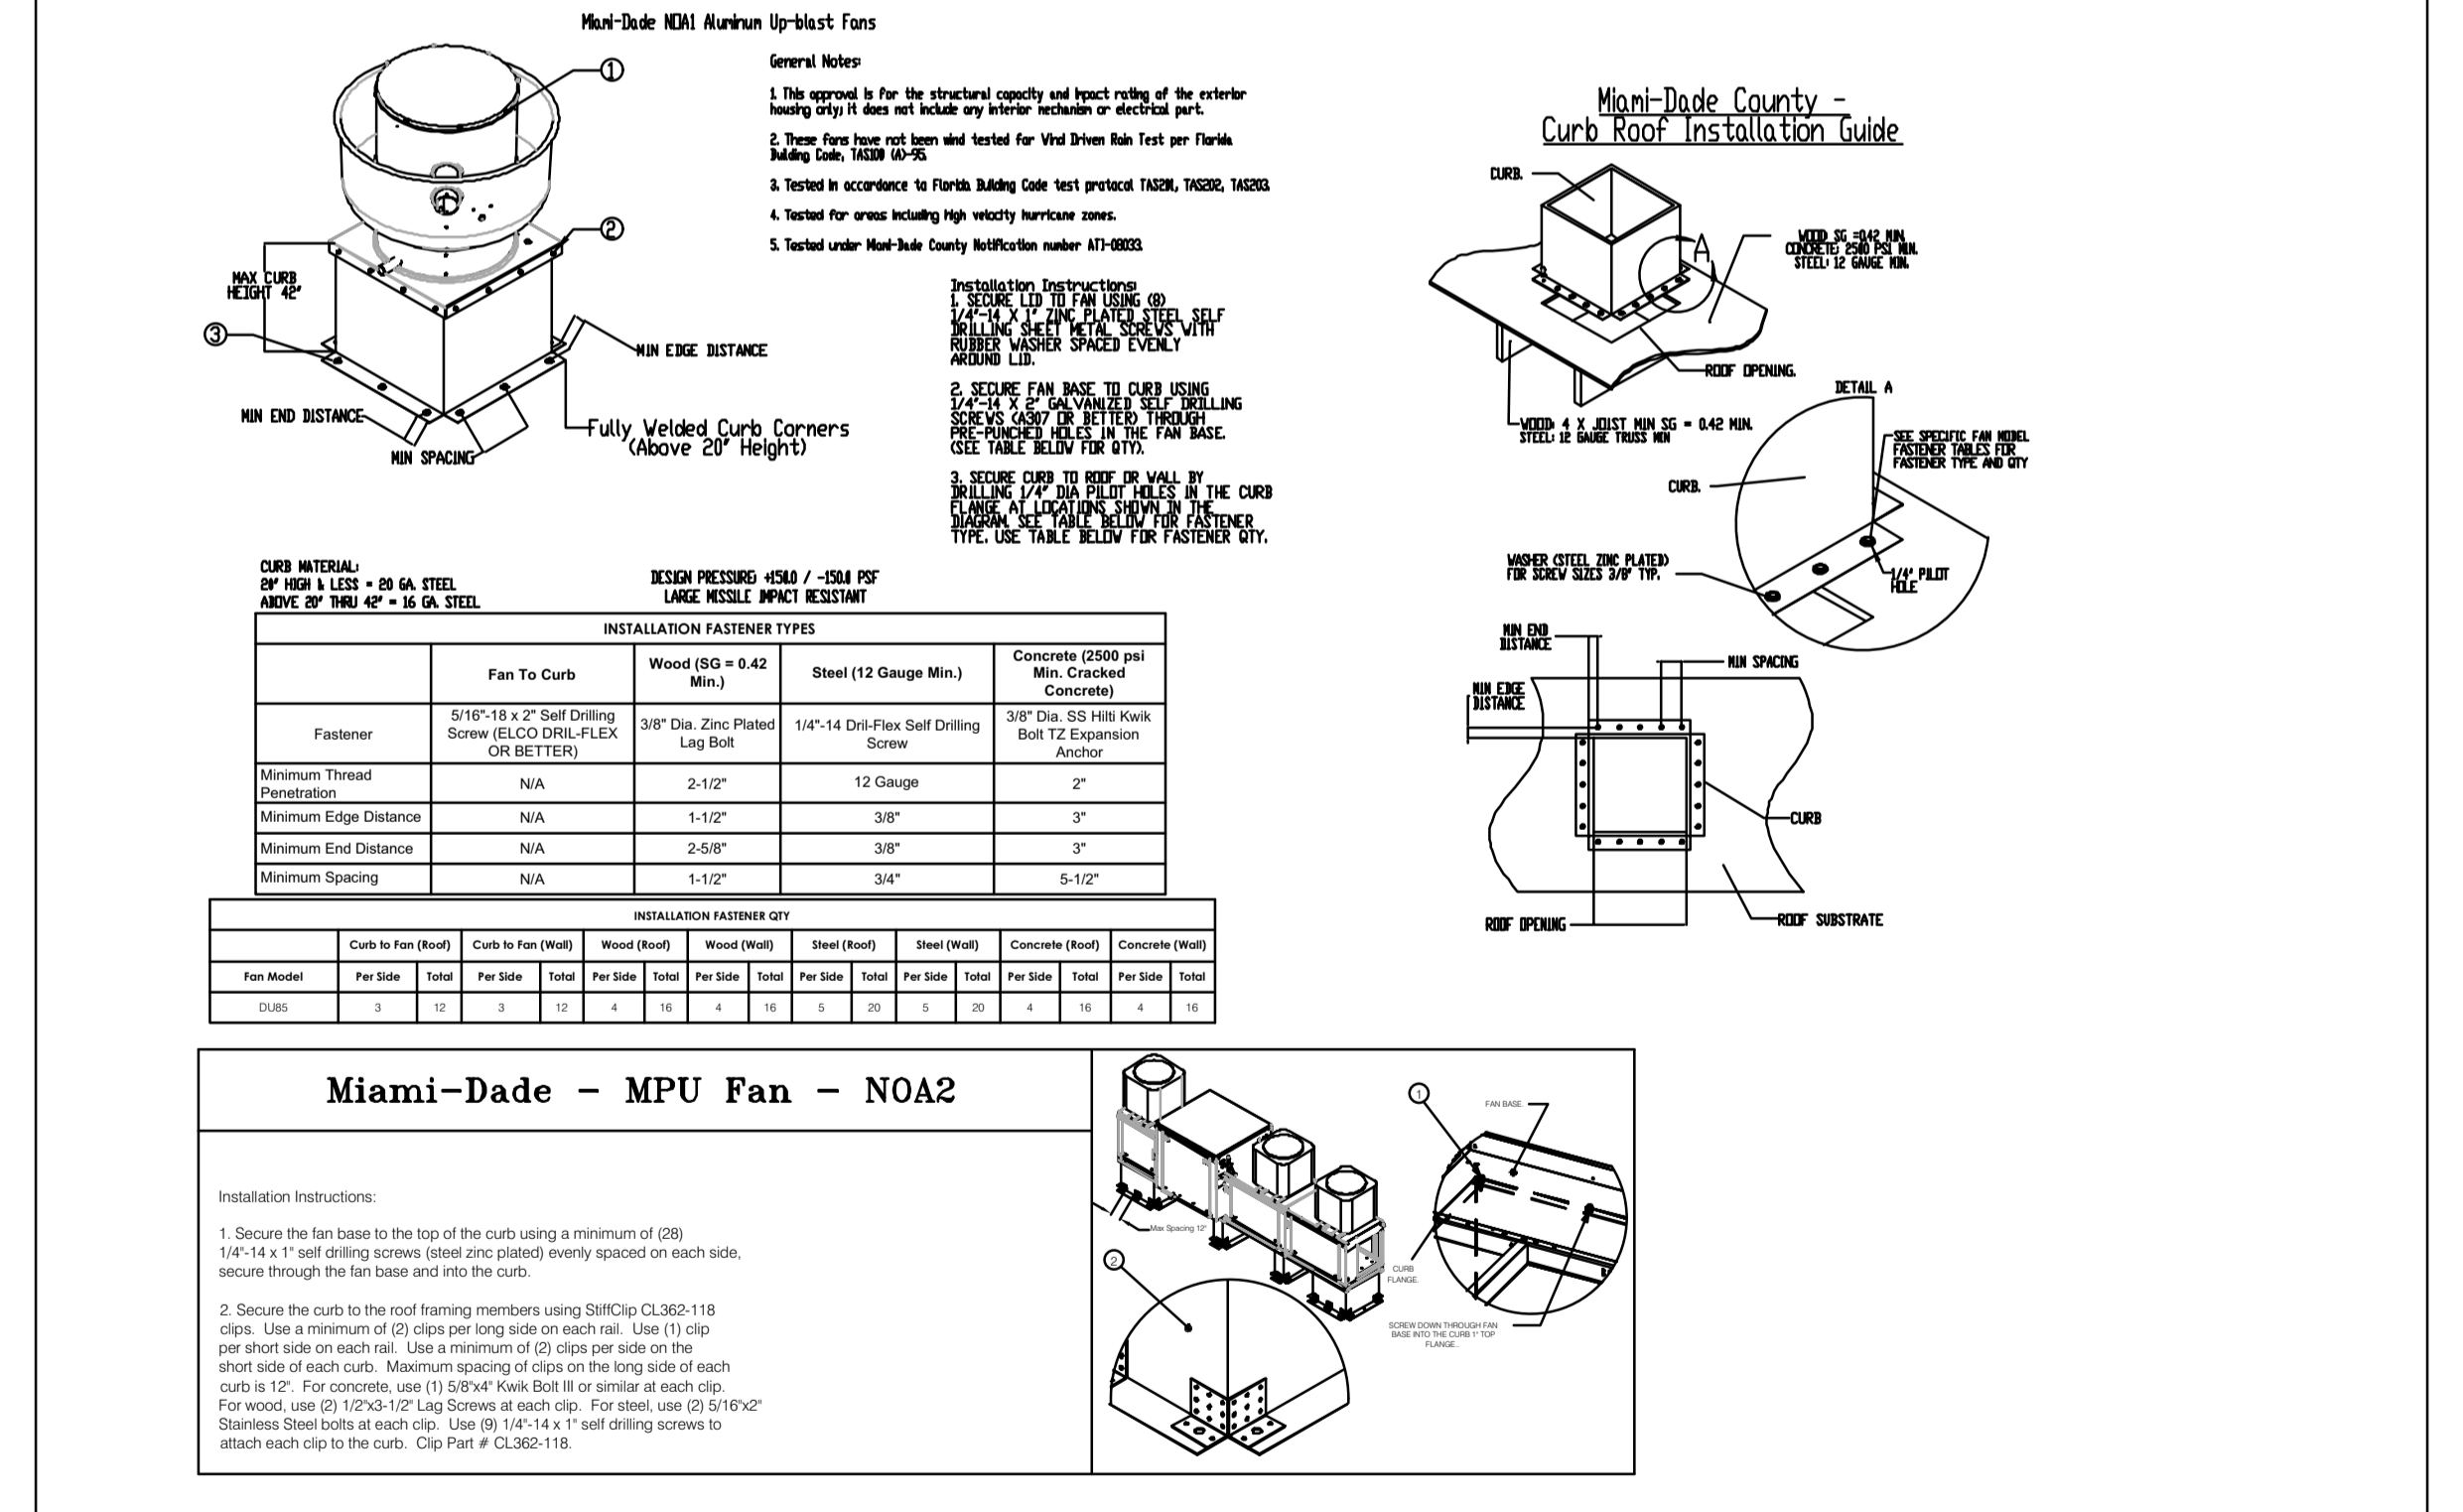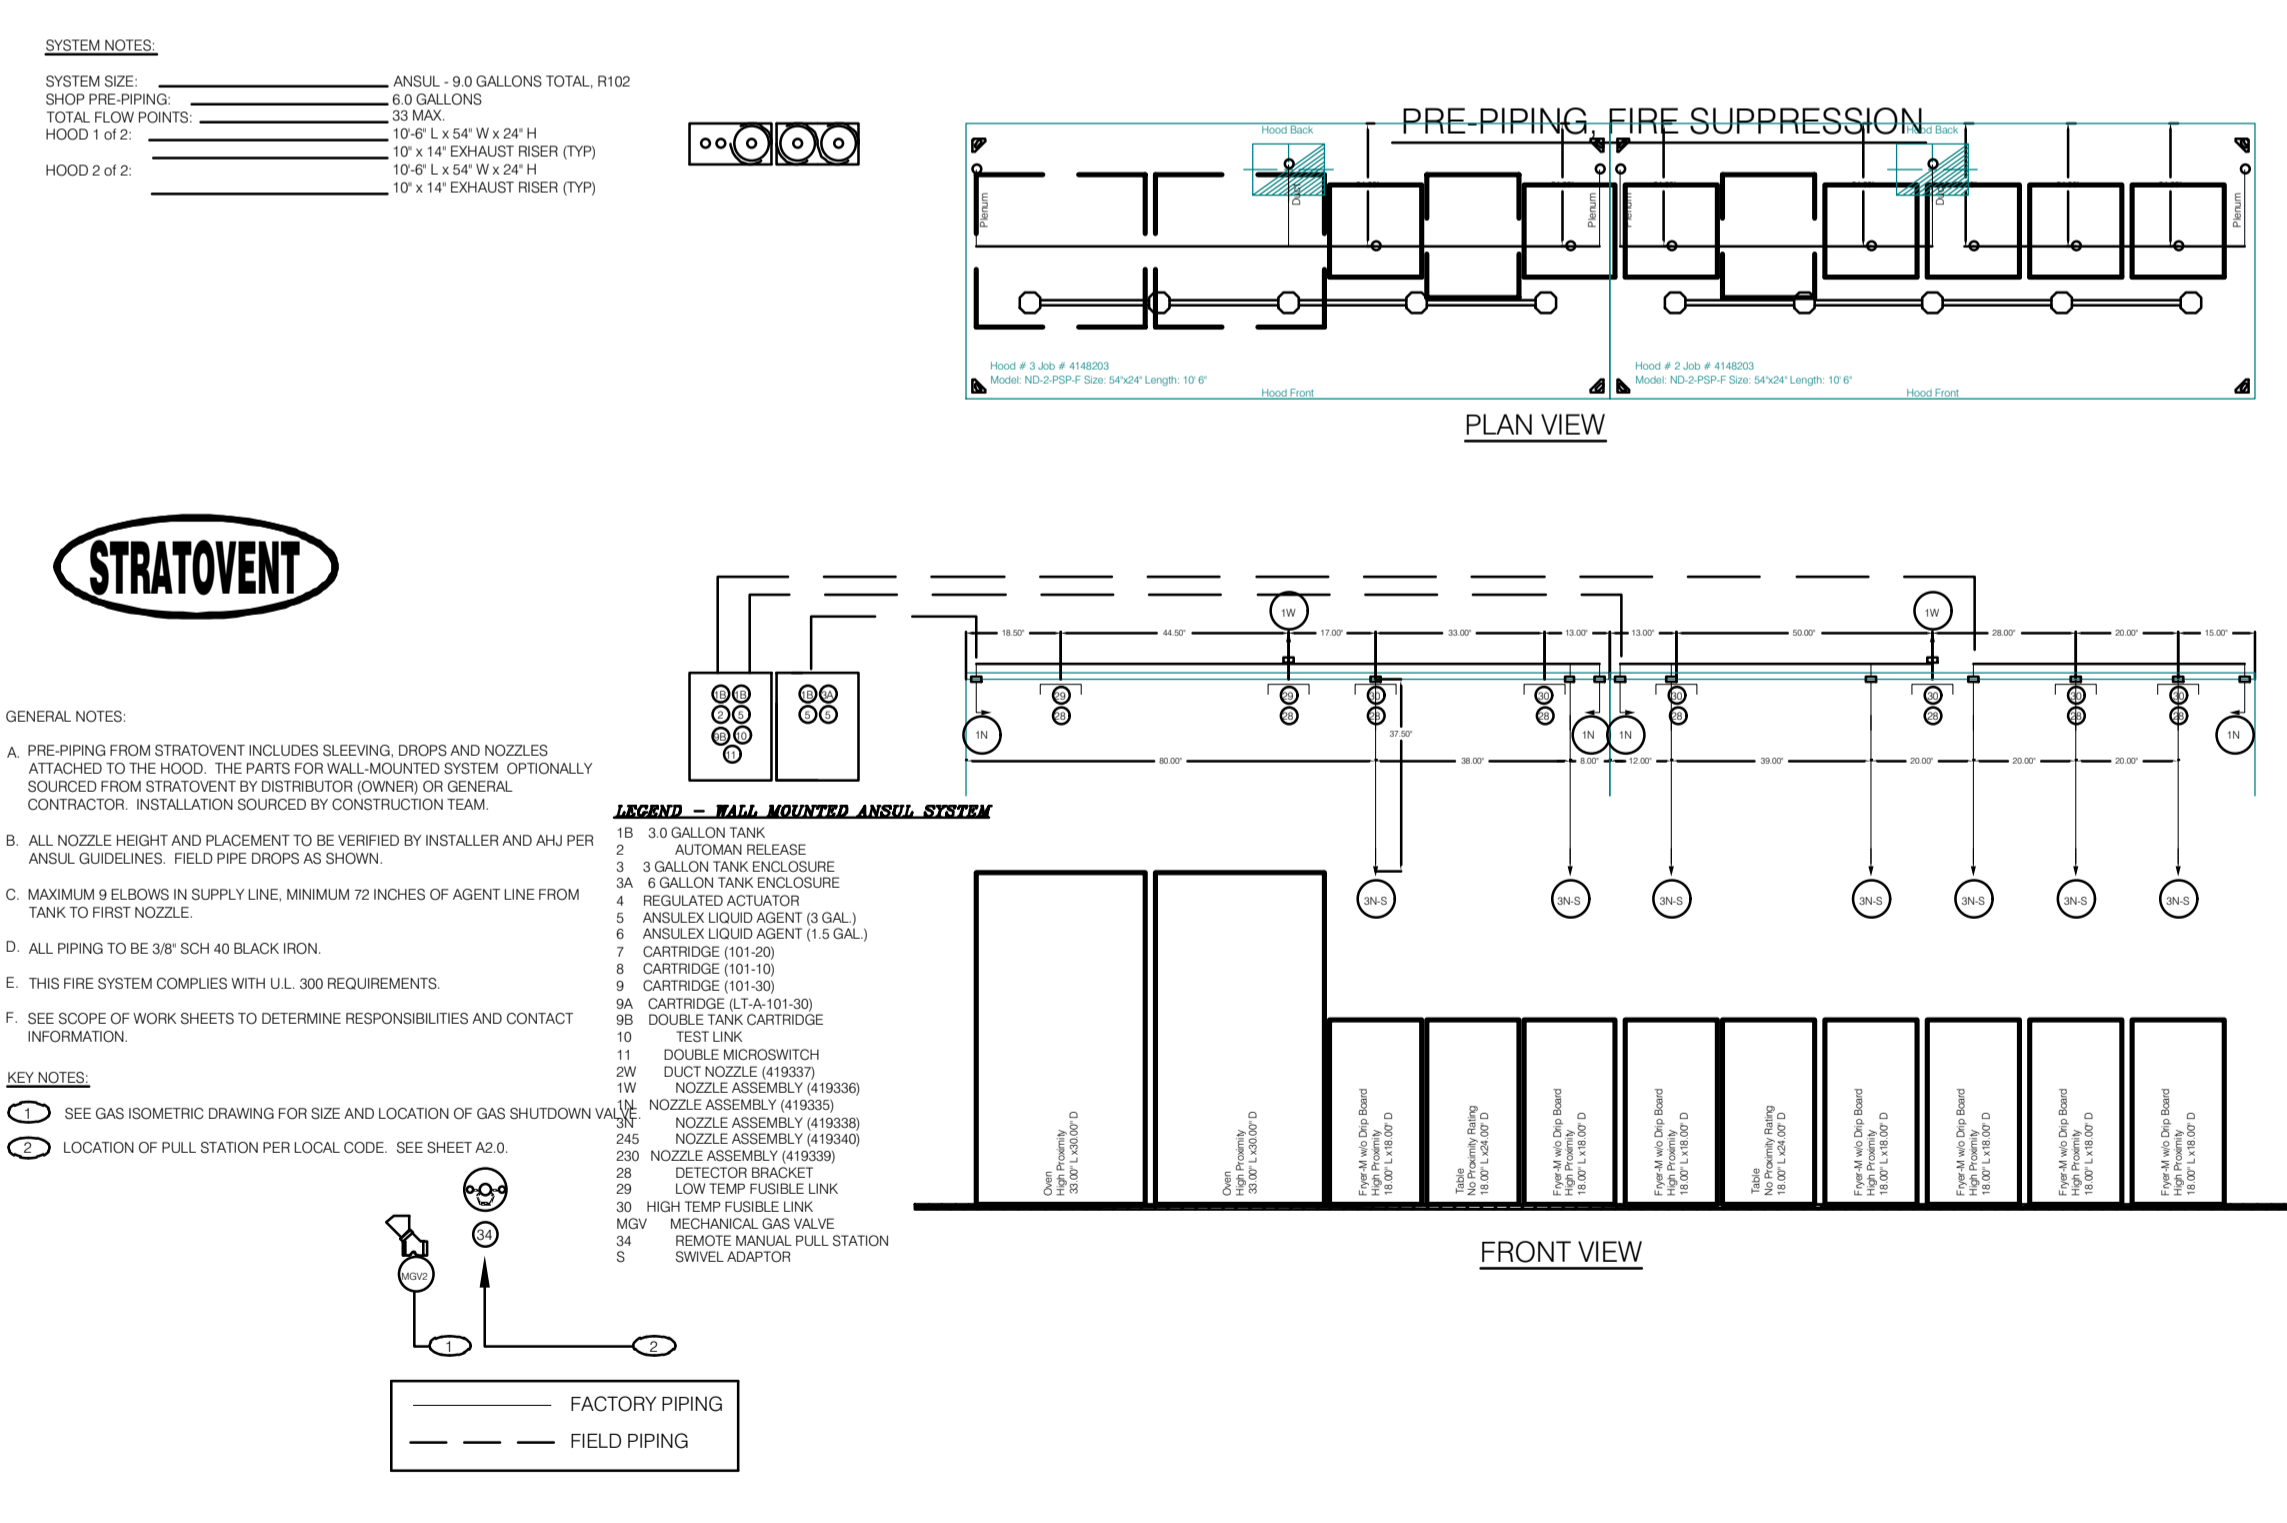

KFC ADDRESS ANYTOWN, USA
DATE: 01/07/2020
DWG.#: 4148203
DRAWN BY: JJ-REG24
SCALE: NTS
MASTER DRAWING

SHEET NO. 2